

HTE# BLOM1905-0001

Harnett County Department of Public Health

No. **26739**

PERMIT # NA

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 2028 MATTHEWS ROAD (SL 1436)

Name: (owner) GREATER LIGHT BAPTIST CHURCH SUBDIVISION _____ LOT # _____

System Installer: YELLOW DOG GRADING Registration # _____ 560 GALL/DAY MAX


Basement with plumbing: Garage Number of Bedrooms NA

Type of Water Supply: Community Public Well Distance from well NA feet 112 SEATS X 5 GR/240 (w/ KITCHEN)

System Type: 25% REDUCTION SYS - ITG Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

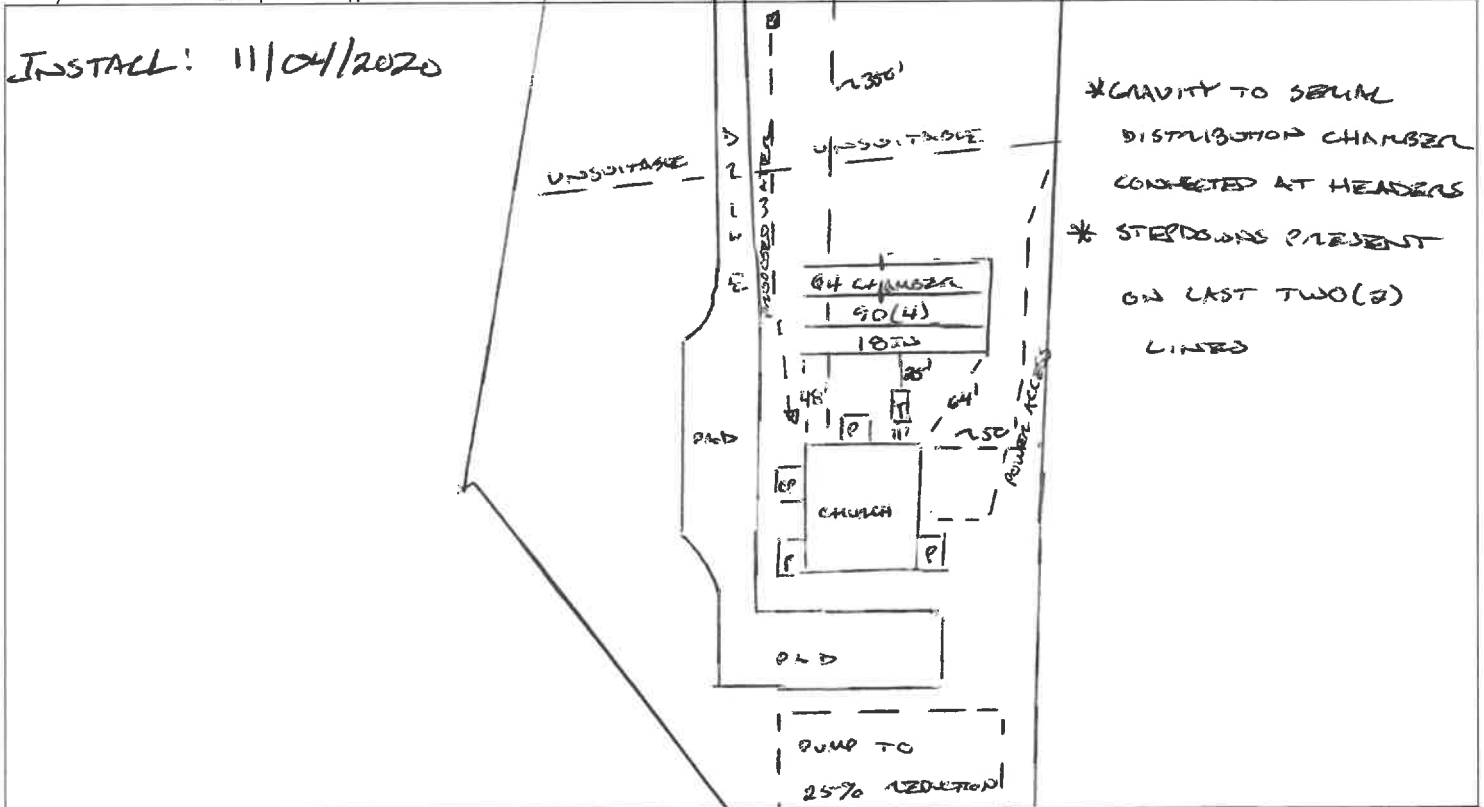

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 4 CHAMBER Septic Tank: 1250 gallons Pump Tank: _____ gallons

Subsurface Drainage Field: No. of ditches 4 exact length of each ditch 90 feet width of ditches 3 feet depth of ditches 20 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 11/04/2020