

Carolina Fire Protection, Inc.
4055 Hodges Chapel Road
P.O. Box 250 (28335)
Dunn, NC 28334
910-892-1700

Kim Nelson
NCEC # 132077

FS-23769

Job Name : GOOD HOPE 2020 Addition Area #1
Building : Remote area #1
Location : 410 Denim Drive
System :
Contract : 20K533
Data File : GOOD HOPE 2020 ADDITION.wxtmp

Hydraulic Design Information Sheet

Name - GOOD HOPE 2020 Addition Area #1 Date - 12-3-2020
 Location - 410 Denim Drive
 Building - Remote area #1 System No. -
 Contractor - Carolina Fire Protection, Inc. Contract No. - 20K533
 Calculated By - Mark Ford Drawing No. -
 Construction: () Combustible (X) Non-Combustible Ceiling Height - 10'
 Occupancy - Hospital

S (X) NFPA 13 (X) Lt. Haz. Ord.Haz.Gp. () 1 () 2 () 3 () Ex.Haz.
 Y () NFPA 231 () NFPA 231C () Figure Curve

S Other

T Specific Ruling Made By Date

Specific Ruling	Made By	Date
M Area of Sprinkler Operation - 913	System Type	Sprinkler/Nozzle
Density - .10	() Wet	Make Reliable
D Area Per Sprinkler - 225	() Dry	Model Pendent
E Elevation at Highest Outlet - 10	() Deluge	Size 1/2
S Hose Allowance - Inside - n/a	() Preaction	K-Factor 5.6
I Rack Sprinkler Allowance - n/a	() Other	Temp.Rat.155
G Hose Allowance - Outside - 100		

N Note

Calculation Flow Required - 371.037 Press Required - 39.818 Test
 Summary C-Factor Used: 120 Overhead 140 Underground

Water Flow Test:	Pump Data:	Tank or Reservoir:
A Date of Test - 20-19-2020		Cap. -
T Time of Test - 4:10 pm	Rated Cap.-	Elev.-
E Static Press - 54	@ Press -	
R Residual Press - 46	Elev. -	Well
Flow - 888		Proof Flow
S Elevation - 0		

U Location - 410 Denim Drive

P Source of Information - Erwin Fire Department

Y

Commodity	Class	Location	
Storage Ht.	Area	Aisle W.	
Storage Method:	%	Palletized %	Rack
() Single Row	() Conven. Pallet	() Auto. Storage	() Encap.
S R () Double Row	() Slave Pallet	() Solid Shelf	() Non
T A () Mult. Row		() Open Shelf	

O C
 R K Flue Spacing Clearance:Storage to Ceiling
 A Longitudinal Transverse

G
 E Horizontal Barriers Provided:

Water Supply Curve

Carolina Fire Protection, Inc.
 GOOD HOPE 2020 Addition Area #1


Page 2
 Date 12-3-2020

City Water Supply:

C1 - Static Pressure : 54
 C2 - Residual Pressure: 46
 C2 - Residual Flow : 888

Demand:

D1 - Elevation : 4.331
 D2 - System Flow : 271.037
 D2 - System Pressure : 39.818
 Hose (Demand) : 100
 D3 - System Demand : 371.037
 Safety Margin : 12.590

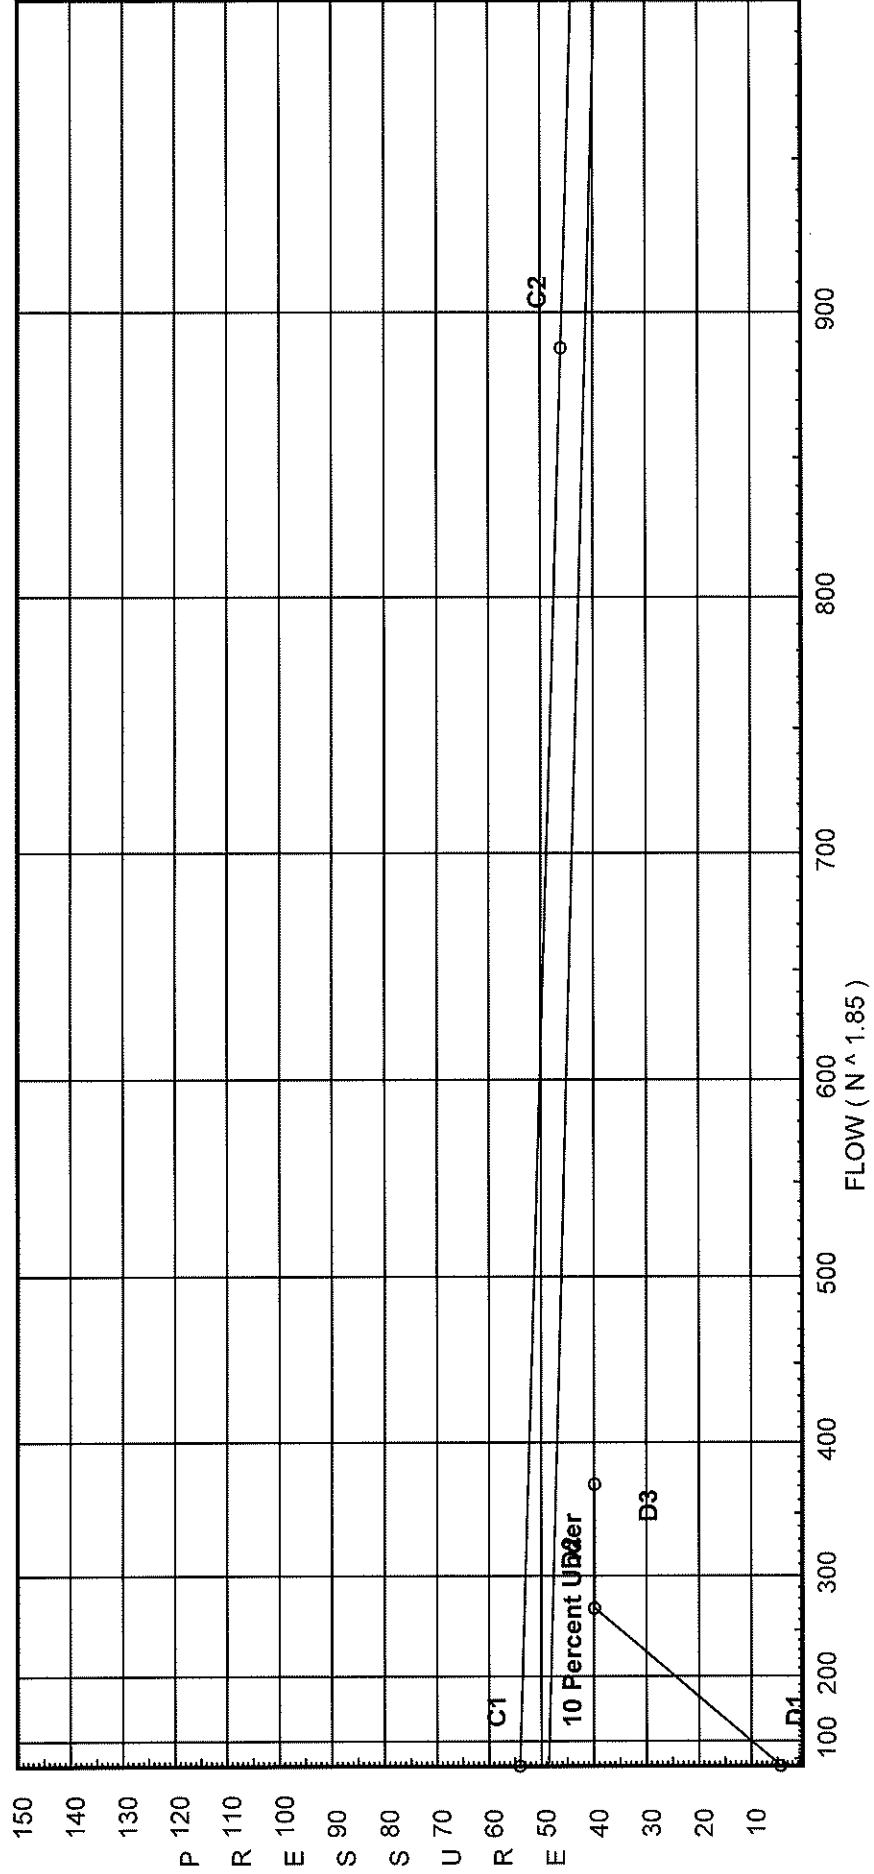

Fittings Used Summary

Carolina Fire Protection, Inc.
 GOOD HOPE 2020 Addition Area #1

Page 3
 Date 12-3-2020

Fitting Legend Abbrev. Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
B NFPA 13 Butterfly Valve	0	0	0	0	0	6	7	10	0	12	9	10	12	19	21	0	0	0	0	0
E NFPA 13 90' Standard Elbow	1	2	2	3	4	5	6	7	8	10	12	14	18	22	27	35	40	45	50	61
F NFPA 13 45' Elbow	1	1	1	1	2	2	3	3	3	4	5	7	9	11	13	17	19	21	24	28
G NFPA 13 Gate Valve	0	0	0	0	0	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13
Rcr Reliable G Riser Ck					6.7	9.6	6	5.3		7.1		13.7	15.9	28.8						
T NFPA 13 90' Flow thru Tee	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121
Zcj Colt C500 Horz OSY	Fitting generates a Fixed Loss Based on Flow																			

Units Summary

- Diameter Units Inches
- Length Units Feet
- Flow Units US Gallons per Minute
- Pressure Units Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with *. The fittings marked with a * show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a * will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

Flow Summary - NFPA

Carolina Fire Protection, Inc.
GOOD HOPE 2020 Addition Area #1

Page 4
Date 12-3-2020

SUPPLY ANALYSIS

<i>Node at Source</i>	<i>Static Pressure</i>	<i>Residual Pressure</i>	<i>Flow</i>	<i>Available Pressure</i>	<i>Total Demand</i>	<i>Required Pressure</i>
TEST	54.0	46	888.0	52.408	371.04	39.818

NODE ANALYSIS

<i>Node Tag</i>	<i>Elevation</i>	<i>Node Type</i>	<i>Pressure at Node</i>	<i>Discharge at Node</i>	<i>Notes</i>
1A	10.0	5.6	16.2	22.54	0.1 225
2A	10.0	5.6	16.15	22.5	0.1 225
3A	10.0	5.6	16.14	22.5	0.1 225
4A	10.0	5.6	16.15	22.51	0.1 225
5A	10.0	5.6	16.22	22.55	0.1 225
6A	10.0	5.6	16.23	22.56	0.1 225
7A	10.0	5.6	16.17	22.52	0.1 225
8A	10.0	5.6	16.16	22.51	0.1 225
9A	10.0	5.6	16.17	22.52	0.1 225
10A	10.0	5.6	16.23	22.56	0.1 225
11A	10.0	5.6	16.68	22.87	0.1 225
12A	10.0	5.6	16.69	22.88	0.1 225
13	25.75		17.47		
14	23.0		18.66		
15	21.167		19.46		
16	23.333		18.52		
17	25.75		17.47		
18	23.0		18.66		
19	21.167		19.46		
20	25.75		17.47		
21	23.0		18.66		
22	21.167		19.46		
M1	19.0		20.39		
M2	19.0		20.39		
M3	19.0		20.39		
F1	11.5		22.97		
1	11.5		22.37		
2	11.5		22.3		
3	11.5		22.29		
4	11.5		22.3		
5	11.5		22.4		
F2	11.5		23.0		
6	11.5		22.41		
7	11.5		22.33		
8	11.5		22.32		
9	11.5		22.33		
10	11.5		22.42		
F3	11.5		23.1		
11	11.5		23.04		
12	11.5		23.05		
F4	11.5		23.26		
F5	11.5		23.38		

Flow Summary - NFPA

Carolina Fire Protection, Inc.
GOOD HOPE 2020 Addition Area #1

Page 5
Date 12-3-2020

NODE ANALYSIS (cont.)

<i>Node Tag</i>	<i>Elevation</i>	<i>Node Type</i>	<i>Pressure at Node</i>	<i>Discharge at Node</i>	<i>Notes</i>
F6	11.5		23.49		
F7	11.5		23.54		
F8	11.5		23.6		
F9	11.5		23.62		
F10	11.5		23.65		
F11	11.5		23.68		
F12	11.5		23.7		
F13	11.5		23.74		
F14	11.5		23.76		
F15	11.5		23.77		
N1	11.5		23.47		
N2	11.5		23.48		
N3	11.5		23.51		
N4	11.5		23.57		
N5	11.5		23.65		
N6	11.5		23.64		
N7	11.5		23.64		
N8	11.5		23.64		
N9	11.5		23.64		
N10	11.5		23.64		
N11	11.5		23.68		
N12	11.5		23.73		
N13	11.5		23.88		
N14	11.5		24.11		
N16	11.5		24.25		
TASR	11.5		25.02		
BASR	1.0		30.19	100.0	
TEST	0.0		39.82		

Final Calculations : Hazen-Williams

Carolina Fire Protection, Inc.
GOOD HOPE 2020 Addition Area #1

Page 6
Date 12-3-2020

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
1A to 1	10 11.5	5.60	22.54 22.54	1 1.049	T Eq 5.0 36.0	1.000 41.000 42.000	120 0.1624	16.202 -0.650 6.819			Vel = 8.37
1			0.0 22.54					22.371			K Factor = 4.77
2A to 2	10 11.5	5.60	22.50 22.5	1 1.049	T Eq 5.0 36.0	1.000 41.000 42.000	120 0.1619	16.150 -0.650 6.799			Vel = 8.35
2			0.0 22.50					22.299			K Factor = 4.76
3A to 3	10 11.5	5.60	22.50 22.5	1 1.049	T Eq 5.0 36.0	1.000 41.000 42.000	120 0.1618	16.143 -0.650 6.797			Vel = 8.35
3			0.0 22.50					22.290			K Factor = 4.77
4A to 4	10 11.5	5.60	22.51 22.51	1 1.049	T Eq 5.0 36.0	1.000 41.000 42.000	120 0.1619	16.153 -0.650 6.801			Vel = 8.36
4			0.0 22.51					22.304			K Factor = 4.77
5A to 5	10 11.5	5.60	22.55 22.55	1 1.049	T Eq 5.0 36.0	1.000 41.000 42.000	120 0.1625	16.221 -0.650 6.827			Vel = 8.37
5			0.0 22.55					22.398			K Factor = 4.76
6A to 6	10 11.5	5.60	22.56 22.56	1 1.049	T Eq 5.0 36.0	1.000 41.000 42.000	120 0.1626	16.228 -0.650 6.830			Vel = 8.37
6			0.0 22.56					22.408			K Factor = 4.77
7A to 7	10 11.5	5.60	22.52 22.52	1 1.049	T Eq 5.0 36.0	1.000 41.000 42.000	120 0.1621	16.172 -0.650 6.807			Vel = 8.36
7			0.0 22.52					22.329			K Factor = 4.77
8A to 8	10 11.5	5.60	22.51 22.51	1 1.049	T Eq 5.0 36.0	1.000 41.000 42.000	120 0.1620	16.164 -0.650 6.805			Vel = 8.36
8			0.0 22.51					22.319			K Factor = 4.76
9A to 9	10 11.5	5.60	22.52 22.52	1 1.049	T Eq 5.0 36.0	1.000 41.000 42.000	120 0.1621	16.174 -0.650 6.808			Vel = 8.36
9			0.0 22.52					22.332			K Factor = 4.77
10A to 10	10 11.5	5.60	22.56 22.56	1 1.049	T Eq 5.0 36.0	1.000 41.000 42.000	120 0.1627	16.234 -0.650 6.833			Vel = 8.37

Final Calculations : Hazen-Williams

Carolina Fire Protection, Inc.
 GOOD HOPE 2020 Addition Area #1

Page 7
 Date 12-3-2020

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
10			0.0 22.56						22.417		K Factor = 4.76	
11A to 11	10 11.5	5.60	22.87 22.87	1 1.049	T Eq	5.0 36.0	1.000 41.000 42.000	120 0.1668	16.681 -0.650 7.005		Vel = 8.49	
11			0.0 22.87						23.036		K Factor = 4.76	
12A to 12	10 11.5	5.60	22.88 22.88	1 1.049	T Eq	5.0 36.0	1.000 41.000 42.000	120 0.1669	16.692 -0.650 7.010		Vel = 8.49	
12			0.0 22.88						23.052		K Factor = 4.77	
13 to 14	25.750 23		0.0	1.5			8.000	120	17.471 1.191		Vel = 0	
14 to 15	23 21.167		0.0	1.5			8.000 6.000	0 120	0.0 18.662 0.794		Vel = 0	
15 to M1	21.167 19		0.0	1.5	E T	4.95 9.9	2.250 14.850 17.100	120 -0.0001	19.456 0.939 -0.001		Vel = 0	
M1			0.0 0.0						20.394		K Factor = 0	
16 to 17	23.333 25.750		0.0	1.5	2E	9.9	13.000 9.900 22.900	120 0	18.518 -1.047 0.0		Vel = 0	
17 to 18	25.750 23		0.0	1.5			8.000	120	17.471 1.191		Vel = 0	
18 to 19	23 21.167		0.0	1.5			8.000 6.000	0 120	0.0 18.662 0.794		Vel = 0	
19 to M2	21.167 19		0.0	1.5	E T	4.95 9.9	2.250 14.850 17.100	120 -0.0001	19.456 0.939 -0.001		Vel = 0	
M2			0.0 0.0						20.394		K Factor = 0	
20 to 21	25.750 23		0.0	1.5			8.000	120	17.471 1.191		Vel = 0	
21 to 22	23 21.167		0.0	1.5			8.000 6.000	0 120	0.0 18.662 0.794		Vel = 0	
22 to M4	21.167 0		0.0	1.5	E T	4.95 9.9	2.250 14.850 17.100	120 0	19.456 9.167 0.0		Vel = 0	
			0.0									

Final Calculations : Hazen-Williams

Carolina Fire Protection, Inc.
GOOD HOPE 2020 Addition Area #1

Page 8
Date 12-3-2020

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
M4			0.0						28.623		K Factor = 0	
M1 to M2	19 19		0.0	2			12.000	120	20.394 0.0			
M2 to M3	19 19		0.0	2.157			12.000	0	0.0		Vel = 0	
M2 to M3	19 19		0.0	2			1.833	120	20.394 0.0			
M3 to M4	19 0		0.0	2.157			1.833	0	0.0		Vel = 0	
M3 to M4	19 0		0.0	2			8.917	120	20.394 8.229			
M4 to M5	0 0		0.0	2.157			8.917	0	0.0		Vel = 0	
M4			0.0 0.0						28.623		K Factor = 0	
M3 to M5	19 0		0.0	2	2E 2T	12.307 24.613	27.167 36.920	120	20.394 8.229			
M5			0.0 0.0						28.623		K Factor = 0	
F1 to 1	11.5 11.5		-54.95	2	T	12.307	11.583 12.307	120	22.974 0.0			
1 to 2	11.5 11.5		-54.95	2.157			23.890	-0.0252	-0.603		Vel = 4.82	
1 to 2	11.5 11.5		22.54	2			7.667	120	22.371 0.0			
2 to 3	11.5 11.5		-32.41	2.157			7.667	-0.0094	-0.072		Vel = 2.85	
2 to 3	11.5 11.5		22.50	2			8.417	120	22.299 0.0			
3 to 4	11.5 11.5		-9.91	2.157			8.417	-0.0011	-0.009		Vel = 0.87	
3 to 4	11.5 11.5		22.50	2			8.583	120	22.290 0.0			
4 to 5	11.5 11.5		12.59	2.157			8.583	0.0016	0.014		Vel = 1.11	
4 to 5	11.5 11.5		22.51	2			8.583	120	22.304 0.0			
5 to N1	11.5 11.5		35.1	2.157			8.583	0.0110	0.094		Vel = 3.08	
5 to N1	11.5 11.5		22.55	2	T	12.307	26.583 12.307	120	22.398 0.0			
N1			57.65	2.157			38.890	0.0276	1.072		Vel = 5.06	
N1			0.0 57.65						23.470		K Factor = 11.90	
F2 to 6	11.5 11.5		-55.29	2	T	12.307	11.083 12.307	120	23.005 0.0			
6 to 7	11.5 11.5		-55.29	2.157			23.390	-0.0255	-0.597		Vel = 4.85	
6 to 7	11.5 11.5		22.56	2			8.167	120	22.408 0.0			
7 to 8	11.5 11.5		-32.73	2.157			8.167	-0.0097	-0.079		Vel = 2.87	
7 to 8	11.5 11.5		22.52	2			9.250	120	22.329 0.0			
8 to 9	11.5 11.5		-10.21	2.157			9.250	-0.0011	-0.010		Vel = 0.90	
8 to 9	11.5 11.5		22.51	2			8.583	120	22.319 0.0			
9			12.3	2.157			8.583	0.0015	0.013		Vel = 1.08	

Final Calculations : Hazen-Williams

Carolina Fire Protection, Inc.
GOOD HOPE 2020 Addition Area #1

Page 9
Date 12-3-2020

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
9 to 10	11.5 11.5		22.53 34.83	2 2.157			7.750 7.750	120 0.0110	22.332 0.0 0.085			Vel = 3.06
10 to N2	11.5 11.5		22.56 57.39	2 2.157	T	12.307	26.583 12.307 38.890	120 0.0273	22.417 0.0 1.063			Vel = 5.04
N2			0.0 57.39						23.480			K Factor = 11.84
F3 to 11	11.5 11.5		-12.03 -12.03	2 2.157	T	12.307	26.750 12.307 39.057	120 -0.0015	23.096 0.0 -0.060			Vel = 1.06
11 to 12	11.5 11.5		22.87 10.84	2 2.157			12.500 12.500	120 0.0013	23.036 0.0 0.016			Vel = 0.95
12 to N3	11.5 11.5		22.88 33.72	2 2.157	T	12.307	32.167 12.307 44.474	120 0.0102	23.052 0.0 0.454			Vel = 2.96
N3			0.0 33.72						23.506			K Factor = 6.96
F4 to N4	11.5 11.5		18.04 18.04	2 2.157	2T	24.613	71.417 24.613 96.030	120 0.0032	23.264 0.0 0.308			Vel = 1.58
N4			0.0 18.04						23.572			K Factor = 3.72
F5 to N5	11.5 11.5		16.69 16.69	2 2.157	2T	24.613	71.417 24.613 96.030	120 0.0028	23.381 0.0 0.267			Vel = 1.47
N5			0.0 16.69						23.648			K Factor = 3.43
F6 to N6	11.5 11.5		12.25 12.25	2 2.157	2T	24.613	71.417 24.613 96.030	120 0.0016	23.493 0.0 0.151			Vel = 1.08
N6			0.0 12.25						23.644			K Factor = 2.52
F7 to N7	11.5 11.5		9.85 9.85	2 2.157	2T	24.613	71.417 24.613 96.030	120 0.0011	23.542 0.0 0.101			Vel = 0.86
N7			0.0 9.85						23.643			K Factor = 2.03
F8 to N8	11.5 11.5		6.39 6.39	2 2.157	2T	24.613	71.417 24.613 96.030	120 0.0005	23.597 0.0 0.045			Vel = 0.56
N8			0.0 6.39						23.642			K Factor = 1.31
F9 to N9	11.5 11.5		4.29 4.29	2 2.157	4E 2T	24.613 24.613	71.417 49.226 120.643	120 0.0002	23.615 0.0 0.027			Vel = 0.38

Final Calculations : Hazen-Williams

Carolina Fire Protection, Inc.
GOOD HOPE 2020 Addition Area #1

Page 10
Date 12-3-2020

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
N9			0.0 4.29						23.642		K Factor = 0.88	
F10 to N10	11.5 11.5		-1.53	2	8E 2T	49.227 24.613	81.917 73.840	120	23.648 0.0			Vel = 0.13
N10			0.0 -1.53						23.642		K Factor = -0.31	
F11 to N11	11.5 11.5		-1.03	2	4E 2T	24.613 24.613	71.417 49.226	120	23.682 0.0			Vel = 0.09
N11			0.0 -1.03						23.680		K Factor = -0.21	
F12 to N12	11.5 11.5		4.93	2	4E 2T	24.613 24.613	71.417 49.226	120	23.699 0.0			Vel = 0.43
N12			0.0 4.93						23.734		K Factor = 1.01	
F13 to N13	11.5 11.5		11.88	2	2T	24.613	71.417 24.613	120	23.737 0.0			Vel = 1.04
N13			0.0 11.88						23.880		K Factor = 2.43	
F14 to N14	11.5 11.5		17.46	2	2E 2T	12.307 24.613	77.917 36.920	120	23.758 0.0			Vel = 1.53
N14			0.0 17.46						24.106		K Factor = 3.56	
F15 to N15	11.5 0		23.06	2	2T	24.613	71.417 24.613	120	23.768 4.981			Vel = 2.02
N15			0.0 23.06						29.234		K Factor = 4.26	
F1 to F2	11.5 11.5		54.95	3			9.167	120	22.974 0.0			Vel = 2.11
F2 to F3	11.5 11.5		55.29	3			7.417	120	23.005 0.0			Vel = 4.24
F3 to F4	11.5 11.5		110.24	3.26			7.417	0.0123	0.091			Vel = 4.70
F4 to F5	11.5 11.5		122.27	3.26			11.333	0.0148	0.168			Vel = 4.01
F4 to F5	11.5 11.5		-18.03	3			10.667	120	23.264 0.0			Vel = 4.01
F5 to F6	11.5 11.5		104.24	3.26			10.667	0.0110	0.117			Vel = 3.37
F5 to F6	11.5 11.5		-16.69	3			14.000	120	23.381 0.0			Vel = 3.37

Final Calculations : Hazen-Williams

Carolina Fire Protection, Inc.
GOOD HOPE 2020 Addition Area #1

Page 11
Date 12-3-2020

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Equiv Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
F6 to F7	11.5 11.5		-12.25 75.3	3 3.26		8.083 8.083	120 0.0061	23.493 0.0 0.049			Vel = 2.89
F7 to F8	11.5 11.5		-9.85 65.45	3 3.26		11.833 11.833	120 0.0046	23.542 0.0 0.055			Vel = 2.52
F8 to F9	11.5 11.5		-6.39 59.06	3 3.26		4.667 4.667	120 0.0039	23.597 0.0 0.018			Vel = 2.27
F9 to F10	11.5 11.5		-4.30 54.76	3 3.26		9.667 9.667	120 0.0034	23.615 0.0 0.033			Vel = 2.10
F10 to F11	11.5 11.5		1.53 56.29	3 3.26		9.667 9.667	120 0.0035	23.648 0.0 0.034			Vel = 2.16
F11 to F12	11.5 11.5		1.03 57.32	3 3.26		4.833 4.833	120 0.0035	23.682 0.0 0.017			Vel = 2.20
F12 to F13	11.5 11.5		-4.92 52.4	3 3.26		12.333 12.333	120 0.0031	23.699 0.0 0.038			Vel = 2.01
F13 to F14	11.5 11.5		-11.89 40.51	3 3.26		10.917 10.917	120 0.0019	23.737 0.0 0.021			Vel = 1.56
F14 to F15	11.5 11.5		-17.45 23.06	3 3.26		14.500 14.500	120 0.0007	23.758 0.0 0.010			Vel = 0.89
F15			0.0 23.06					23.768			K Factor = 4.73
N1 to N2	11.5 11.5		57.65 57.65	4 4.26		9.167 9.167	120 0.0011	23.470 0.0 0.010			Vel = 1.30
N2 to N3	11.5 11.5		57.39 115.04	4 4.26		7.500 7.500	120 0.0035	23.480 0.0 0.026			Vel = 2.59
N3 to N4	11.5 11.5		33.72 148.76	4 4.26		11.333 11.333	120 0.0058	23.506 0.0 0.066			Vel = 3.35
N4 to N5	11.5 11.5		18.04 166.8	4 4.26		10.667 10.667	120 0.0071	23.572 0.0 0.076			Vel = 3.75
N5 to N6	11.5 11.5		-198.06 -31.26	4 4.26		14.000 14.000	120 -0.0003	23.648 0.0 -0.004			Vel = 0.70
N6 to N7	11.5 11.5		12.25 -19.01	4 4.26		8.083 8.083	120 -0.0001	23.644 0.0 -0.001			Vel = 0.43
N7 to N8	11.5 11.5		9.85 -9.16	4 4.26		11.833 11.833	120 -0.0001	23.643 0.0 -0.001			Vel = 0.21

Final Calculations : Hazen-Williams

Carolina Fire Protection, Inc.
 GOOD HOPE 2020 Addition Area #1

Page 12
 Date 12-3-2020

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
N8 to N9	11.5 11.5		6.39 -2.77	4 4.26			4.833 4.833	120 0	23.642 0.0			Vel = 0.06
N9 to N10	11.5 11.5		4.30 1.53	4 4.26			11.667 11.667	120 0	23.642 0.0			Vel = 0.03
N10 to M5	11.5 0		-1.53 0.0	4 4.26			5.000 5.000	120 0	23.642 4.981 0.0			Vel = 0
M5			0.0 0.0						28.623			K Factor = 0
N5 to N11	11.5 11.5		214.75 214.75	4 4.26			2.750 2.750	120 0.0116	23.648 0.0 0.032			Vel = 4.83
N11 to N12	11.5 11.5		-1.03 213.72	4 4.26			4.833 4.833	120 0.0112	23.680 0.0 0.054			Vel = 4.81
N12 to N13	11.5 11.5		4.92 218.64	4 4.26			12.333 12.333	120 0.0118	23.734 0.0 0.146			Vel = 4.92
N13 to N14	11.5 11.5		11.88 230.52	4 4.26			17.333 17.333	120 0.0130	23.880 0.0 0.226			Vel = 5.19
N14 to N16	11.5 11.5		17.46 247.98	4 4.26			10.000 10.000	120 0.0148	24.106 0.0 0.148			Vel = 5.58
N16 to N15	11.5 0		-271.04 -23.06	4 4.26			3.583 3.583	120 -0.0003	24.254 4.981 -0.001			Vel = 0.52
N15			0.0 -23.06						29.234			K Factor = -4.26
N16 to TASR	11.5 11.500		271.04 271.04	4 4.26	E T	13.167 26.334	4.250 39.501 43.751	120 0.0176	24.254 0.0 0.769			Vel = 6.10
TASR to BASR	11.500 1		0.0 271.04	4 4.26	B Rcr	15.8 9.349	10.000 25.149 35.149	120 0.0176	25.023 4.548 0.617			Vel = 6.10
BASR to TEST	1 0	H100	100.00 371.04	6 6.16	5E 2F T G Zcj	100.42 20.084 43.037 4.304 0.0	235.000 167.845 402.845	140 0.0039	30.188 8.052 1.578		** Fixed Loss = 7.619	Vel = 3.99
TEST			0.0 371.04						39.818			K Factor = 58.80

Erwin Fire Department And Rescue Squad

Flow Test for Hydrant 43070016

Start Time: 2020-10-19 08:00:00

End Time: 2020-10-19 08:10:00

Tested By: WARRICK, DAVID

Test Hydrant

Static Pressure:	54.0
Residual Pressure:	46.0
Desired Pressure:	20.0
Volume at Desired Pressure:	1939.0

Flow Hydrants

Downstream Hydrant ID	Port Diameter	Friction Coefficient	Pitot Pressure	Flow (Calculated)
43070017	2.5	0.9000000000000002	28.0	888.0

adorman@carolinafireprotection.com

From: Allen Monds <cfdfirecapt5@gmail.com>
Sent: Thursday, November 19, 2020 3:28 PM
To: adorman@carolinafireprotection.com
Subject: Hydrant information for Good Hope Hospital project
Attachments: Good Hope Hospital Hydrant # 16.pdf

Andrew,


My map is showing hydrant # 16 on Denim Drive to be on a 6 inch main, however, the line on 8th street is 8 inch and the line on 10th street is 10 inch. At the end of the day it is on a looped system. Attached you will find the 2 most recent flow tests.

Allen Monds-Asst.Fire Chief
Erwin Fire Department

PRODUCT DESCRIPTION -


UNBRAIDED FLEXIBLE HOSE

No	Item Description
1	Flexible Hose / Bellow
2	Isolation Ring
3	Gasket
4	Nut
5	Branch Line Nipple (1")
6	Reducer

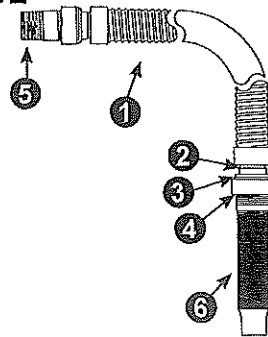


BRAIDED FLEXIBLE HOSE

No	Item Description
1	Flexible Hose / Bellow
2	Isolation Ring
3	Gasket
4	Nut
5	Branch Line Nipple (1")
6	Reducer
7	Braid
8	Welded Collar Fitting

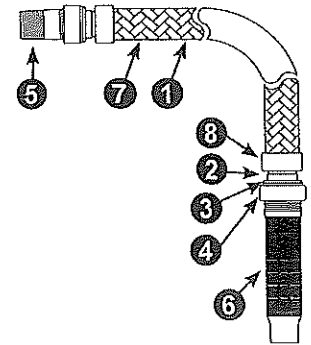

UL FRICTION LOSS DATA - BRAIDED FLEXIBLE HOSE

Length of Flexible Hose (inch)	Outlet Size		Sprinkler K-Factor	Maximum Ambient Temperature °F (°C)	Maximum Working Pressure psi (bar)	Maximum Number of 90° Bends at 3" (76mm) Bend Radius	Equivalent Length of 1" (33.7mm) Sch. 40 Pipe (C=120), ft (m)
	Size (inch)	Type					
24	1/2	Straight	5.6 (80)	300°F (149°C)	175 (12.07)	2	10 (3)
	3/4	Straight	14.0 (200)	300°F (149°C)	175 (12.07)	2	13 (4)
31	1/2	Straight	5.6 (80)	300°F (149°C)	175 (12.07)	3	14 (4.3)
	3/4	Straight	14.0 (200)	300°F (149°C)	175 (12.07)	3	16 (3.9)
40	1/2	Straight	5.6 (80)	300°F (149°C)	175 (12.07)	4	21 (6.4)
	3/4	Straight	14.0 (200)	300°F (149°C)	175 (12.07)	4	23 (7)
48	1/2	Straight	5.6 (80)	300°F (149°C)	175 (12.07)	4	24 (7.3)
	3/4	Straight	14.0 (200)	300°F (149°C)	175 (12.07)	4	26 (7.9)
60	1/2	Straight	5.6 (80)	300°F (149°C)	175 (12.07)	4	25 (7.6)
	3/4	Straight	14.0 (200)	300°F (149°C)	175 (12.07)	4	30 (9.1)
72 	1/2	Straight	5.6 (80)	300°F (149°C)	175 (12.07)	5	36 (11)
	3/4	Straight	14.0 (200)	300°F (149°C)	175 (12.07)	5	33 (10.1)

Reliable®

RASCOFLEX® Sprinkler Connections

cULus Listed, FM Approved

Product Description

RASCOFLEX® Sprinkler Connections are intended to connect a branch line to a sprinkler using a flexible stainless steel hose assembly. RASCOFLEX® Sprinkler Connections are suitable for use in suspended and hard ceiling applications such as T-Bar ceiling grids, wood, metal stud, or hat furring channel hard lid ceilings. Every package contains one (1) fully assembled stainless steel flexible sprinkler system complete with hose, branch line connection, and sprinkler connection, as well as the pre-assembled bracket assembly to attach to the ceiling.

RASCOFLEX® Sprinkler Connections are designed for use in hydraulically calculated wet, preaction, or dry sprinkler systems per NFPA 13, 13R, 13D, and FM Global Loss Prevention Data Sheets.

Technical Data

Table A

Maximum Working Pressure		FM: 200 psi (13.8 bar) UL: 175 psi (12.1 bar)
Maximum Working Temperature		300°F (149°C)
Connections	Inlet/Branch Line	1" NPT
	Outlet/Reducer	1/2" or 3/4" NPT
Minimum Bending Radius		UL: 3" (76 mm) FM: 7" (178 mm)
Maximum Number of Bends		See Friction Loss Chart
Maximum K-Factor	1/2" Outlet	5.6 (80 metric)
	3/4" Outlet	14.0 (200 metric)

Maintenance

RASCOFLEX® Sprinkler Connections should be inspected and the sprinkler system maintained in accordance with NFPA 25, as well as the requirements of any Authorities Having Jurisdiction.


Patents

RASCOFLEX® Sprinkler Connections may be covered by one or more of the following US Patent Nos. 10,173,088 and 10,328,296.

Listings and Approvals

FM Approved Class No. 1637 (FM)

UL Listed and UL Certified for Canada to ANSI/UL 2443 (cULus)

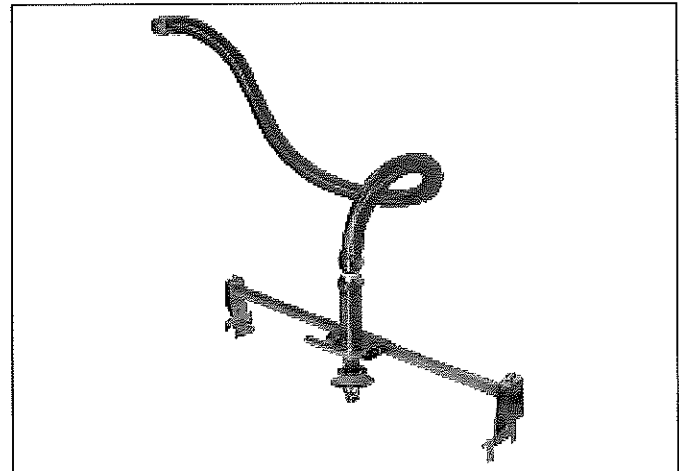

RASCOFLEX® Sprinkler Connections

Ordering Information

Specify:

Model Name

- Model RFB

Nominal Hose Length

- 24" (610 mm)
- 31" (790 mm)
- 40" (1015 mm)
- 48" (1220 mm)
- 60" (1525 mm)
- 72" (1830 mm)

Reducer Outlet: 1/2" NPT or 3/4" NPT

Reducer Type

Standard:

- 6-1/8" (155 mm) straight

Optional:

- 4-5/16" (110 mm) straight
- 5-5/16" (135 mm) straight
- 11-3/4" (300 mm) straight
- 5-5/8" (143 mm) elbow
- 7-3/8" (187 mm) elbow

Bracket Assembly Length


- 24" (610 mm) standard
- 48" (1220 mm) optional

Accessories

- See Table F


Bracket Dimensions


Figure 1

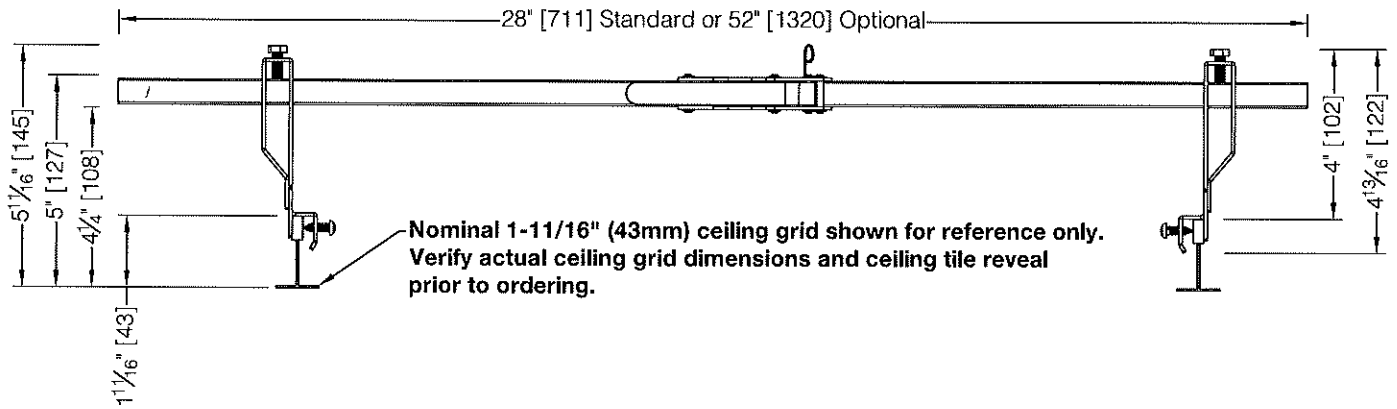

Reducer Dimensions

Figure 2

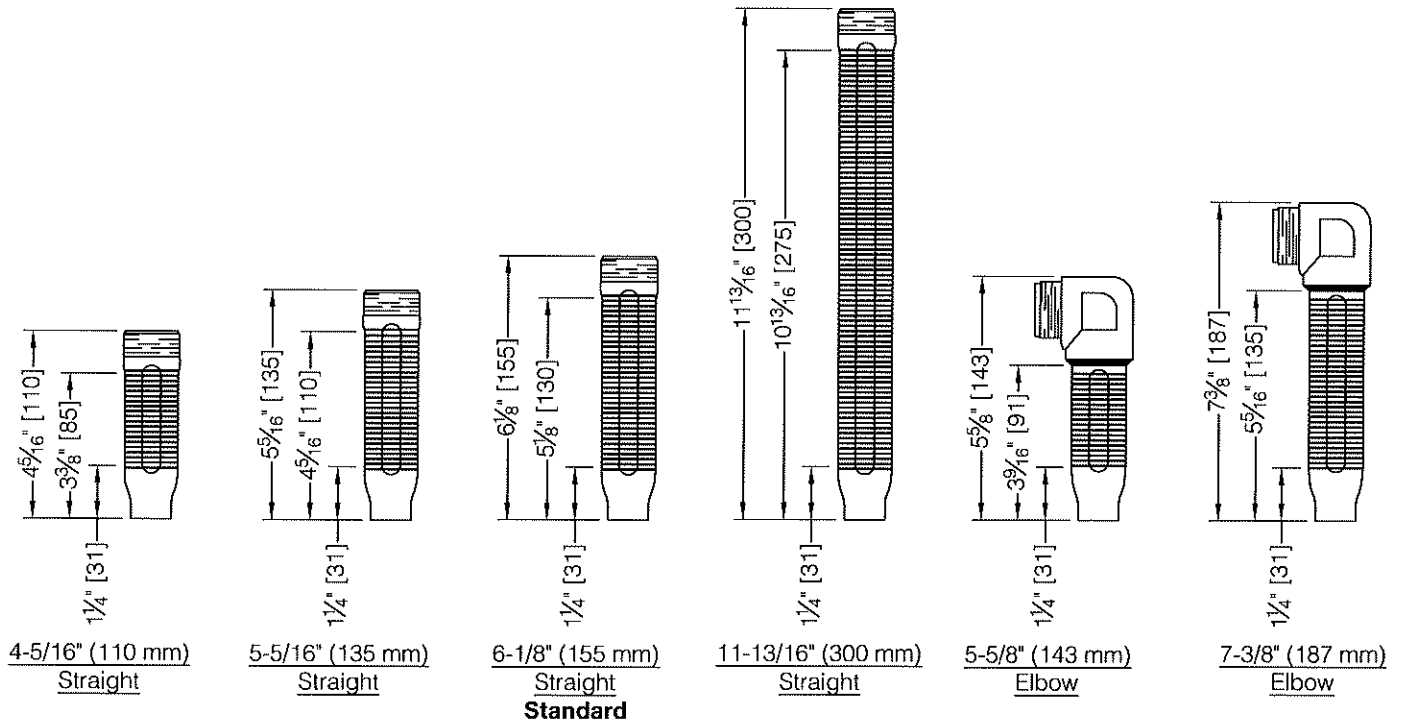

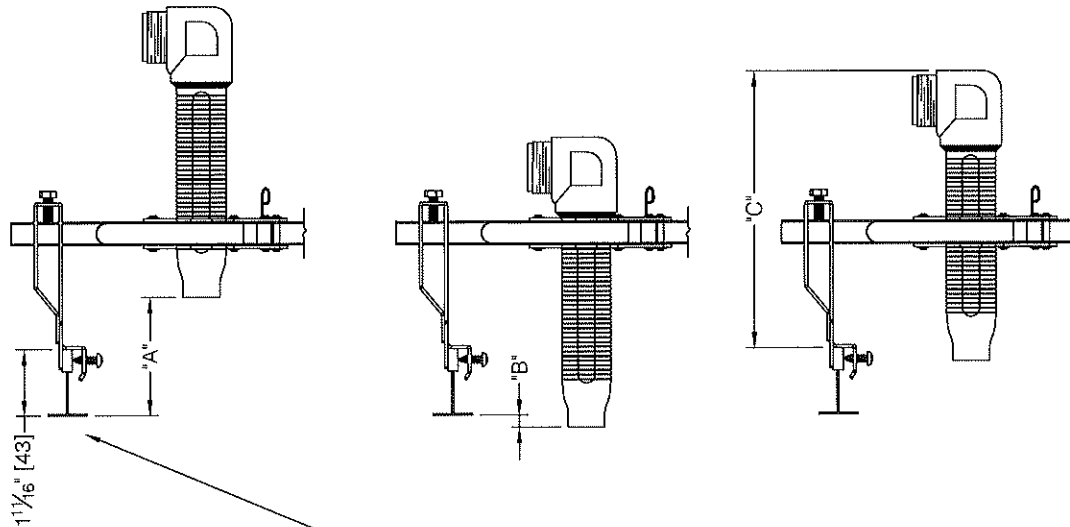

Nominal 1-11/16" (43mm) ceiling grid shown for reference only. Verify actual ceiling grid dimensions and ceiling tile reveal prior to ordering.

Minimum and Maximum Face of Fitting to Bottom of Ceiling Grid for Each Reducer

Table B

	6-1/8" (155mm) Straight Standard	4-5/16" (110mm) Straight	5-5/16" (135mm) Straight	11-13/16" (300mm) Straight	5-5/8" (143mm) Elbow	7-3/8" (187mm) Elbow
Fig. 3 Dimension A Max. Face of Fitting Distance above Bottom of Ceiling Grid	3" (77mm)	3" (7mm)	3" (7mm)	3" (7mm)	3" (7mm)	3" (7mm)
Fig. 3 Dimension B Max. Face of Fitting Distance from Bottom of Ceiling Grid	1/8" (3mm) below	1-5/8" (42mm) above	11/16" (17mm) above	6-3/8" (148mm) below	1-7/16" (36mm) above	5/16" (60mm) below

Note: Based on 1-11/16" (43mm) tall ceiling grid.

Fig. 3 Dimension C - Clearance Above Ceiling Required at Max. Sprinkler Recess

Table C


Recessed Escutcheon or Concealed/Flush Sprinkler	Reducer	
	5-5/8" (143mm) Elbow	7-3/8" (187mm) Elbow
F1 recessed escutcheon	NC	5-5/8" (144mm)
F2 or FV recessed escutcheon	NC	5-3/8" (138mm)
FP recessed escutcheon	NC	6-1/4" (160mm)
CCP conical concealed cover plate	NC	6-1/4" (160mm)
G4 series concealed sprinklers	5-5/8" (144mm)	7-3/8" (188mm)
G5 series concealed sprinklers	5-1/4" (134mm)	7" (179mm)
RFC series concealed sprinklers	5-1/4" (134mm)	7" (179mm)
XL commercial flush sprinkler with flat escutcheon	4-7/8" (125mm)	6-5/8" (169mm)
XL commercial flush sprinkler with conical escutcheon	4-3/8" (112mm)	6-1/8" (157mm)

Note: NC - Reducer not compatible with sprinkler adjustment range. Based on 1-11/16" (43mm) tall ceiling grid and flush ceiling tile.

Materials


Figure 4

Number	Item Description	Material
1	Flexible Hose/Bellow	AISI Type 304 Stainless Steel
2	Isolation Ring	Nylon 66
3	Gasket	EPDM
4	Nut	Zinc Plated Carbon Steel
5	Branch Line Nipple (1")	Zinc Plated Carbon Steel
6	Reducer	Zinc Plated Carbon Steel
7	Braid	AISI Type 304 Stainless Steel
8	Welded Collar Fitting	AISI Type 304 Stainless Steel
-	Bar Stock	Zinc Plated SGCC Steel
-	Brackets: Center and Side	Zinc Plated SPCC Steel

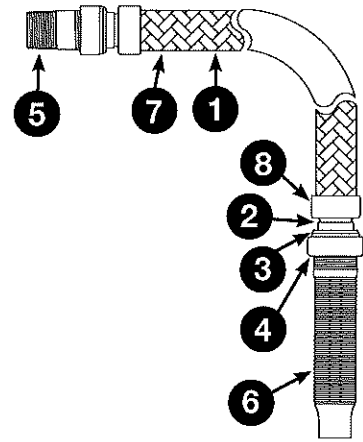

Flexible Hose Number of Bends

Figure 5

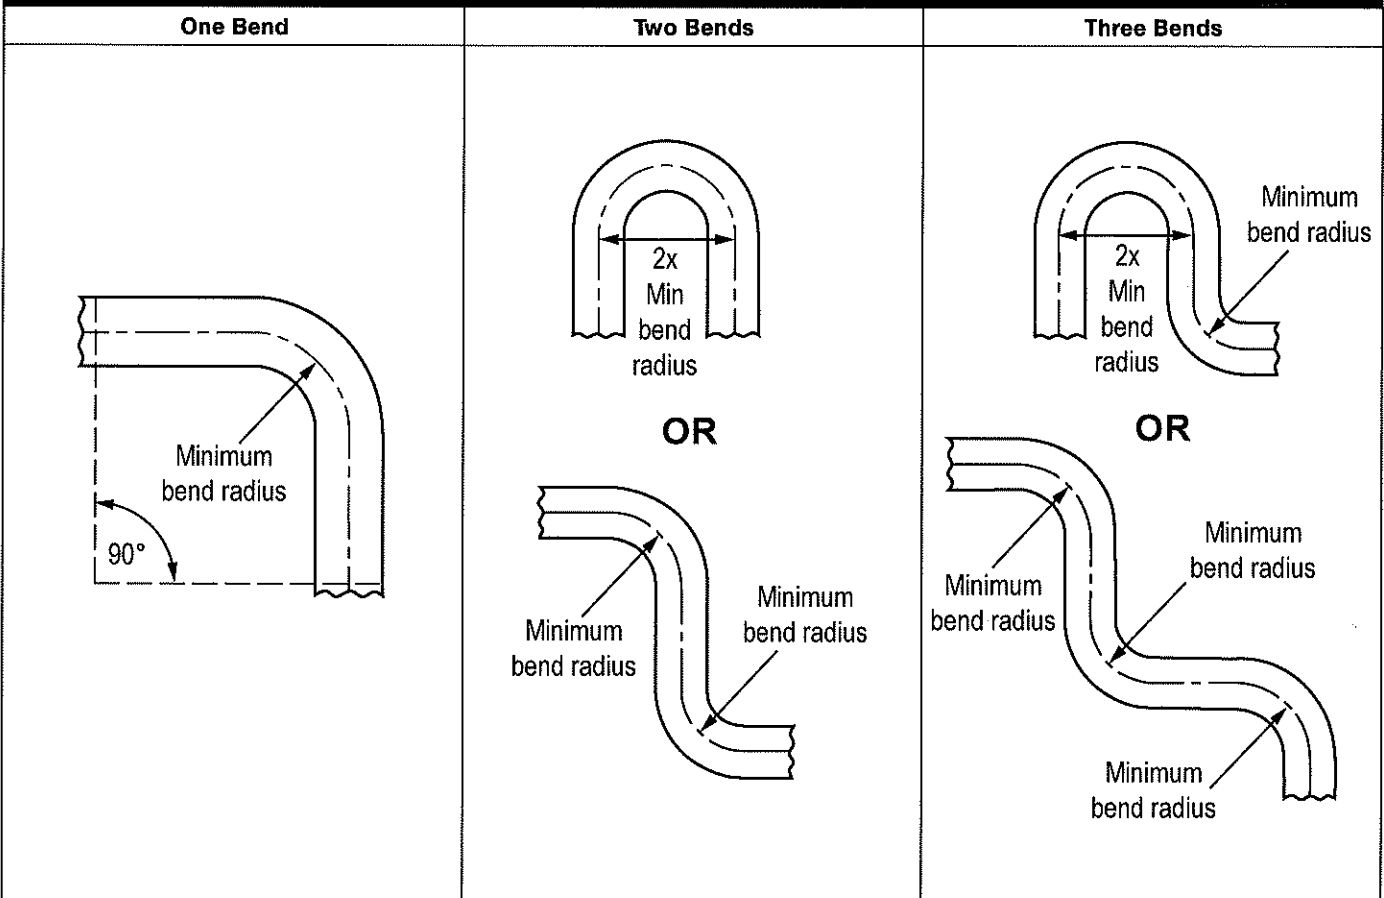



cULus Friction Loss Data

Table D

Nominal Length of Flexible Hose in (mm)	Reducer		Maximum Sprinkler K-Factor gpm/psi ^{1/2} (lpm/bar ^{1/2})	Maximum Number of 90° Bends at 3" (76mm) Bend Radius	Equivalent Length of 1" (33.7mm) Sch. 40 Pipe (C=120), ft (m)
	NPT Threads	Type			
24 (610)	1/2	Straight	5.6 (80)	2	10 (3)
	3/4	Straight	14.0 (200)	2	13 (4)
31 (790)	1/2	Straight	5.6 (80)	3	14 (4.3)
	3/4	Straight	14.0 (200)	3	16 (4.9)
40 (1015)	1/2	Straight	5.6 (80)	4	21 (6.4)
	3/4	Straight	14.0 (200)	4	23 (7)
48 (1220)	1/2	Straight	5.6 (80)	4	24 (7.3)
	3/4	Straight	14.0 (200)	4	26 (7.9)
60 (1525)	1/2	Straight	5.6 (80)	4	25 (7.6)
	3/4	Straight	14.0 (200)	4	30 (9.1)
72 (1830)	1/2	Straight	5.6 (80)	5	36 (11)
	3/4	Straight	14.0 (200)	5	33 (10.1)

UL Notes:

1. Available data for use with 6.1" straight reducers.
2. Sprinkler K-Factor: 5.6 (80 metric) for 1/2-inch reducer and 14.0 (200 metric) for 3/4-inch reducer.
3. RASCOFLEX® Sprinkler Connections have been tested and approved by Underwriter's Laboratories, Inc. for use in wet, preaction, and dry sprinkler systems per NFPA 13, 13D, 13R and UL2443.



FM Friction Loss Data

Table E

Nominal Length of Flexible Hose in (mm)	Reducer		Maximum Sprinkler K-Factor gpm/psi ^{1/2} (lpm/bar ^{1/2})	Maximum Number of 90° Bends at 7" 178mm) Bend Radius	Equivalent Length of 1" (33.7mm) Sch. 40 Pipe (C=120), ft (m)
	NPT Threads	Type			
24 (610)	1/2	Straight	5.6 (80)	1	9.7 (2.9)
	1/2	90° Elbow	5.6 (80)	0	11.5 (3.5)
	3/4	Straight	8.0 (115)	1	9.9 (3)
			11.2 (160)	1	9.8 (2.9)
			14.0 (200)	1	9.6 (2.9)
	3/4	90° Elbow	8.0 (115)	0	10.2 (3.1)
			11.2 (160)	0	10 (3)
			14.0 (200)	0	9.8 (2.9)
	31 (790)	1/2	Straight	5.6 (80)	2
1/2		90° Elbow	5.6 (80)	2	15.8 (4.8)
3/4		Straight	8.0 (115)	2	13.7 (4.1)
			11.2 (160)	2	12.9 (3.9)
			14.0 (200)	2	12.2 (3.7)
3/4		90° Elbow	8.0 (115)	2	14.5 (4.4)
			11.2 (160)	2	13.7 (4.1)
			14.0 (200)	2	13 (3.9)
40 (1015)		1/2	Straight	5.6 (80)	2
	1/2	90° Elbow	5.6 (80)	2	21.6 (6.6)
	3/4	Straight	8.0 (115)	2	18.5 (5.6)
			11.2 (160)	2	17.4 (5.3)
			14.0 (200)	2	16.3 (4.9)
	3/4	90° Elbow	8.0 (115)	2	20 (6)
			11.2 (160)	2	18.9 (5.7)
			14.0 (200)	2	20 (6)
	48 (1220)	1/2	Straight	5.6 (80)	3
1/2		90° Elbow	5.6 (80)	3	25.9 (7.9)
3/4		Straight	8.0 (115)	3	22.7 (6.9)
			11.2 (160)	3	21.5 (6.5)
			14.0 (200)	3	20.5 (6.2)
3/4		90° Elbow	8.0 (115)	3	24.8 (7.5)
			11.2 (160)	3	23.6 (7.2)
			14.0 (200)	3	22.6 (6.8)

FM Friction Loss Data (cont.)

Table E

Nominal Length of Flexible Hose in (mm)	Reducer		Maximum Sprinkler K-Factor gpm/psi ^{1/2} (lpm/bar ^{1/2})	Maximum Number of 90° Bends at 7" (178mm) Bend Radius	Equivalent Length of 1" (33.7mm) Sch. 40 Pipe (C=120), ft (m)	
	NPT Threads	Type				
60 (1525)	1/2	Straight	5.6 (80)	4	23.7 (7.2)	
	1/2	90° Elbow	5.6 (80)	4	33.1 (10)	
	3/4	Straight	8.0 (115)	4	29.1 (8.8)	
			11.2 (160)	4	28 (8.5)	
			14.0 (200)	4	27 (8.2)	
	3/4	90° Elbow	8.0 (115)	4	32.2 (9.8)	
			11.2 (160)	4	31.1 (9.5)	
			14.0 (200)	4	30 (9.1)	
	72 (1830)	1/2	Straight	5.6 (80)	4	28.4 (8.6)
		1/2	90° Elbow	5.6 (80)	4	40.4 (12.3)
3/4		Straight	8.0 (115)	4	35.5 (10.8)	
			11.2 (160)	4	34.3 (10.4)	
			14.0 (200)	4	33.2 (10.1)	
3/4		90° Elbow	8.0 (115)	4	39.5 (12)	
			11.2 (160)	4	38.3 (11.6)	
			14.0 (200)	4	37.2 (11.3)	

FM Notes:

1. RASCOFLEX® Sprinkler Connections have been tested and approved by FM Approvals for use in wet, preaction, and dry sprinkler systems per FM data sheets 2-0, 2-5, and 2-8 per FM1637.
2. Maximum sprinkler K-Factor: 5.6 (80 metric) for 1/2-inch reducer and 14.0 (200 metric) for 3/4-inch reducer.
3. Differences in equivalent lengths are due to varying test methods, per FM 1637 standards.
4. Above data of friction loss for use with 6.1" straight reducers.

Accessories List

Table F

 <p>5-5/8" (143mm) Elbow Reducer-Short 1/2": 7M99003303 3/4": 7M99003305</p>	 <p>7-3/8" (187mm) Elbow Reducer-Long 1/2": 7M99003302 3/4": 7M99003304</p>	 <p>4-5/16" (110mm) Straight Reducer 1/2": 7M99003306 3/4": 7M99003325</p>
 <p>5-5/16" (135mm) Straight Reducer 1/2": 7M99003307 3/4": 7M99003326</p>	 <p>Replacement 6-1/8" (155mm) Standard Straight Reducer 1/2": 7M99003308 3/4": 7M99003327</p>	 <p>11-13/16" (300mm) Straight Reducer 1/2": 7M99003309 3/4": 7M99003328</p>
 <p>Hat Channel End Bracket- Short 3" (76mm) 7M99003310</p>	 <p>Hat Channel End Bracket- Long 3-3/4" (95mm) 7M99003311</p>	 <p>Metal Stud End Bracket-Short 1-1/2" (38mm) 7M99003312</p>
 <p>Metal Stud End Bracket- Long 2-1/16" (53mm) 7M99003313</p>	 <p>T-Bar End Bracket- Short 2-5/8" (68mm) 7M99003314</p>	 <p>T-Bar End Bracket- Long 4-1/8" (105mm) 7M99003316</p>
 <p>Wood Beam Stud End Bracket 7M99003317</p>	 <p>Replacement Center Bracket 7M99003321</p>	 <p>3" (76 mm) Bend Radius Indicator 7M99004179</p>
 <p>Replacement 1" NPT Inlet Adapter 7M99003322</p>	 <p>#2 Square Drive Bit 7M99004539</p>	 <p>Replacement Gasket 7M99004319</p>
		<p>48" (1220mm) Bracket Assembly 7M99003301</p>

P/N 9999970560

Job Name _____

Contractor _____

Job Location _____

Approval _____

Engineer _____

Contractor's P.O. No. _____

Approval _____

Representative _____

Colt™ Series C500 (Colt 500), C500N (Colt 500N), C500Z (Colt 500Z)

Reduced Pressure Detector Assemblies

Sizes: 2½" – 10"

The Colt C500, C500N, C500Z Reduced Pressure Detector Assemblies are designed to protect drinking water supplies from dangerous cross-connections in accordance with national plumbing codes and water authority requirements for health-hazard non-potable service applications such as irrigation, fire line, or industrial processing. The Colt C500, C500N, C500Z are used to monitor unauthorized use of water from the fire protection system.


Features

- Extremely Compact Design
- 70% Lighter than Traditional Designs
- 304 (Schedule 40) Stainless Steel Housing & Sleeve
- Groove Fittings Allow Integral Pipeline Adjustment
- Patented Link Check Provides Lowest Pressure Loss
- Unmatched Ease of Serviceability
- Replaceable Check Disc Rubber
- Available with Grooved Butterfly Valve Shutoffs
- Bottom Mounted Cast Stainless Steel Relief Valve
- Metered Bypass to Detect Leakage or Theft of Water from the Fire Sprinkler System


Specifications

The Colt C500, C500N, C500Z Reduced Pressure Detector Assemblies shall consist of two independent Link Check modules, a differential pressure relief valve located between and below the two modules, two drip tight shutoff valves, and required test cocks. Link Check modules and relief valve shall be contained within a sleeve accessible single housing constructed from 304 (Schedule 40) stainless steel pipe with groove end connections. Link Checks shall have reversible elastomer discs and in operation produce drip tight closure against the reverse flow of liquid caused by backpressure or backsiphonage. The bypass assembly consists of a meter registering either gallon or cubic measurements, a reduced pressure zone assembly and required test cocks. Assembly shall be Colt C500, C500N, C500Z as manufactured by the Ames Fire & Waterworks.

C500N OSY
(Colt 500N GV)

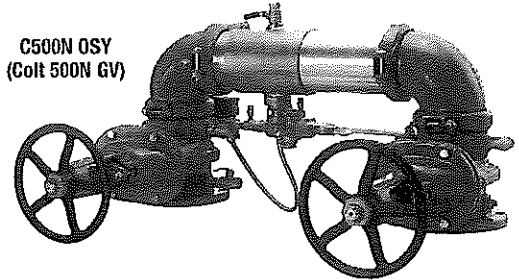

C500 OSY
(Colt 500 GV)

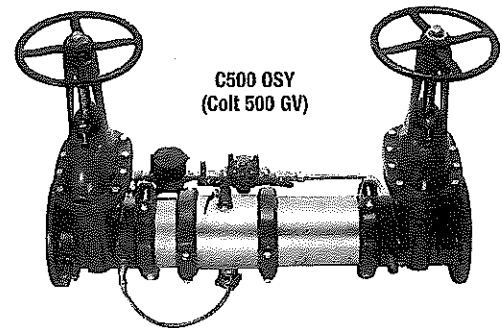

⚠ WARNING

It is illegal to use this product in any plumbing system providing water for human consumption, such as drinking or dishwashing, in the United States. Before installing standard material product, consult your local water authority, building and plumbing codes.

NOTICE

The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.

Ames Fire & Waterworks product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Ames Fire & Waterworks Technical Service. Ames Fire & Waterworks reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Ames Fire & Waterworks products previously or subsequently sold.


AMES
 FIRE & WATERWORKS
 A WATTS Brand

Configurations

- Horizontal
- "Z" pattern horizontal
- "N" pattern horizontal

Materials

- Housing & Sleeve: 304 (Schedule 40) Stainless Steel
- Elastomers: EPDM, Silicone and Buna 'N'
- Link Checks: Noryl®, Stainless Steel
- Check Discs: Reversible Silicone or EPDM
- Test Cocks: Lead Free* Bronze Body
- Pins & Fasteners: 300 Series Stainless Steel
- Springs: Stainless Steel

*The wetted surface of this product contacted by consumable water contains less than 0.25% of lead by weight.

Pressure – Temperature

Temperature Range: 33°F – 140°F (0.5°C – 60°C)

Maximum Working Pressure: 175 psi (12.1 bar)

Available Models

Suffix:

OSY — UL/FM outside stem and yoke resilient seated gate valves

BFG — UL/FM grooved gear operated butterfly valves w/ tamper switch

*OSY FxG — Flanged inlet gate connection and grooved outlet gate connection

*OSY GxG — Grooved inlet gate connection and flanged outlet gate connection


*OSY GxG — Grooved inlet gate connection and grooved outlet gate connection

Available with grooved NRS gate valves — consult factory*

Post indicator plate and operating nut available — consult factory*


*Consult factory for dimensions

Dimensions – Weights

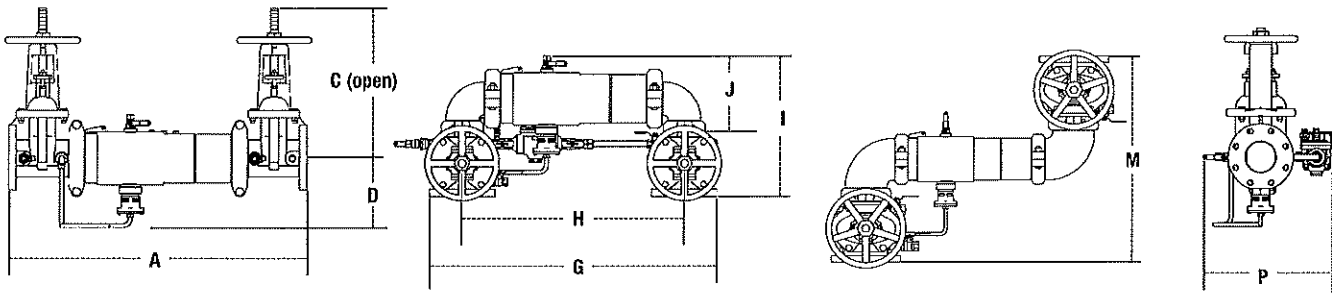

C500, C500N, C500Z

SIZE	DIMENSIONS												WEIGHT									
	A		C (OSY)		D		G		H		I		J		M		P		C500		C500N	
in.	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kgs.	lbs.	kgs.
2½	30¾	781	16¾	416	6½	165	29¼	738	21½	546	15½	393	8⅞	223	21¼	540	13⅞	335	118	54	126	57
3	31¾	806	18¾	479	6⅞	170	30¼	768	22¼	565	17½	435	9⅞	233	23	584	14½	368	134	61	147	67
4	33¾	857	22¾	578	7	178	35¾	905	23½	597	18½	470	9⅞	252	26¼	667	15⅞	386	164	74	187	85
6	43½	1105	30¾	765	8½	216	44¾	1137	33¼	845	23¾	589	13⅞	332	34¼	870	19	483	276	125	317	144
8	49¾	1264	37¾	959	9⅞	246	54¾	1375	40¾	1019	27⅞	697	15⅞	399	36¾	937	21⅞	538	441	200	516	234
10	57¾	1467	45¾	1162	11¾	285	66	1676	49½	1257	32½	826	17¾	440	44½	1124	24	610	723	328	893	405

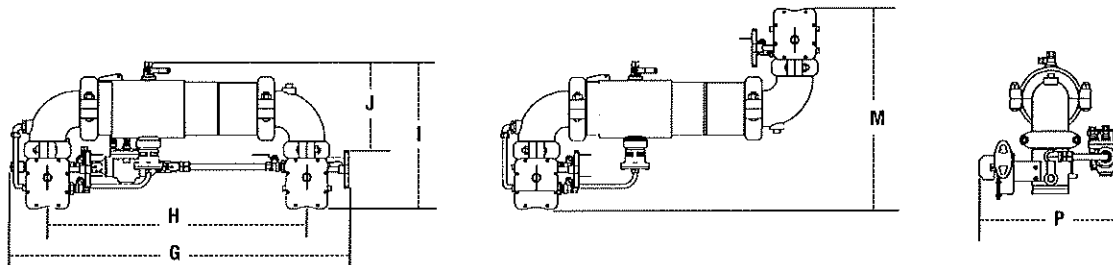


C500NBF/C500ZBF

SIZE	DIMENSIONS												WEIGHT			
	G		H		I		J		M		P		C500BFG			
in.	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kgs.		
2½	32½	826	23	584	15½	394	9½	241	19¾	502	15⅞	402	81	37		
3	34	864	24	610	16⅞	414	10⅞	256	21¼	540	16⅞	410	84	38		
4	35¾	905	25½	648	17⅞	437	10⅞	279	23½	597	16¾	422	101	46		
6	46½	1181	35¼	895	20½	521	13½	343	27¼	692	19	483	174	79		

Noryl® is a registered trademark of SABIC Innovative Plastics™.

Approvals

- Approved by the Foundation for Cross-Connection Control and Hydraulic Research at The University of Southern California (FCCCHR-USC) (Excluding 10" 'N' and 'Z' configurations)
- AWWA C551-92

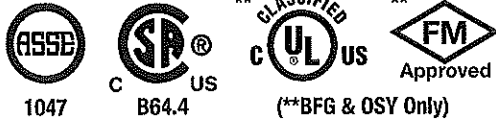

For additional approval information please contact the factory or visit our website at www.amesfirewater.com

Capacity







UL/FM Certified Flow Characteristics

N&Z Flow characteristics collected using butterfly shutoff valves.

Flow capacity chart identifies valve performance based upon rated water velocity up to 25fps


- Service Flow is typically determined by a rated velocity of 7.5fps based upon schedule 40 pipe.
- Rated Flow identifies maximum continuous duty performance determined by AWWA.
- UL Flow Rate is 150% of Rated Flow and is not recommended for continuous duty.
- AWWA Manual M22 [Appendix C] recommends that the maximum water velocity in services be not more than 10fps.

— Horizontal — N - Pattern - - - - Z - Pattern

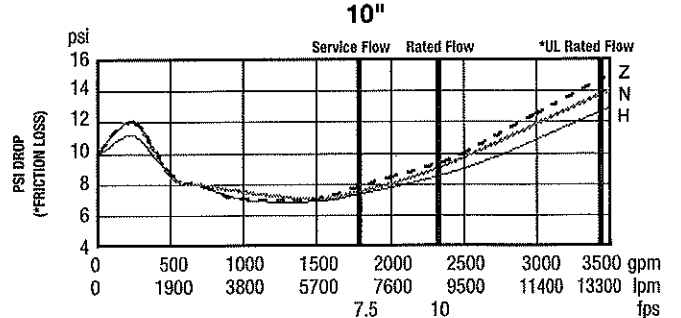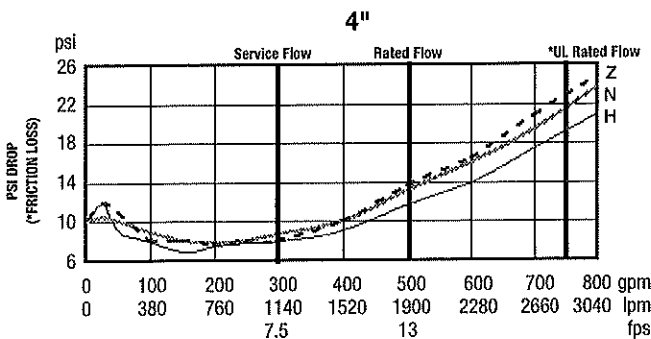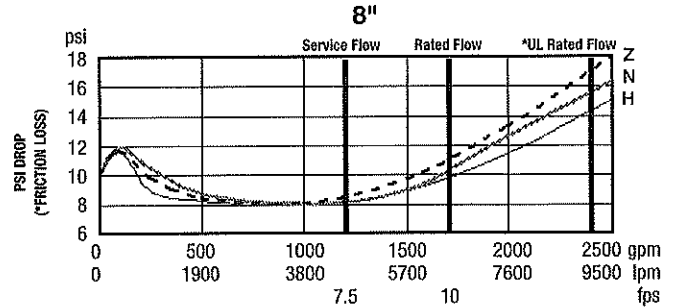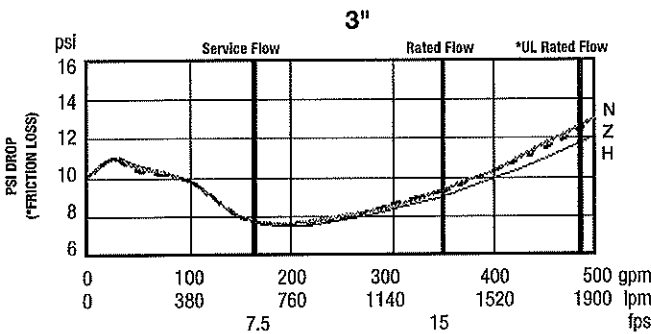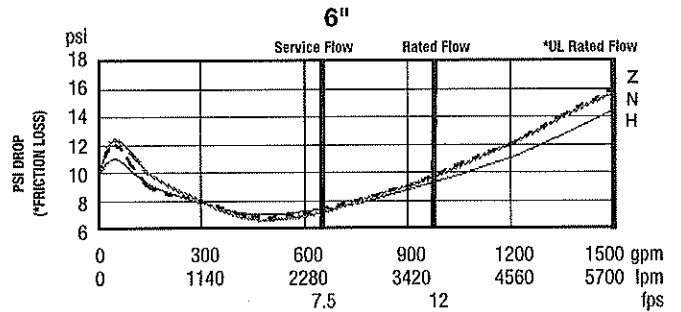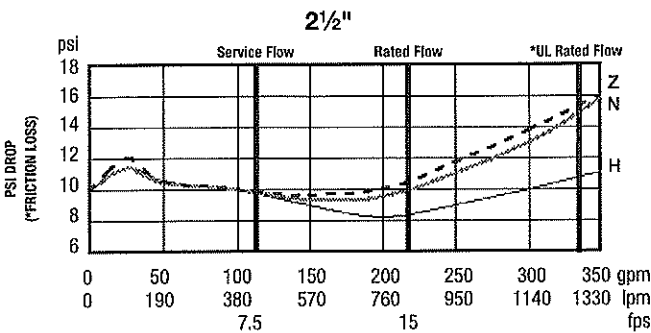

NOTICE

Inquire with governing authorities for local installation requirements



A WATTS Brand

USA: Backflow Tel: (978) 689-6066 • Fax: (978) 975-8350 • AmesFireWater.com
USA: Control Valves Tel: (713) 943-0688 • Fax: (713) 944-9445 • AmesFireWater.com
Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • AmesFireWater.ca
Latin America: Tel: (52) 55-4122-0138 • AmesFireWater.com