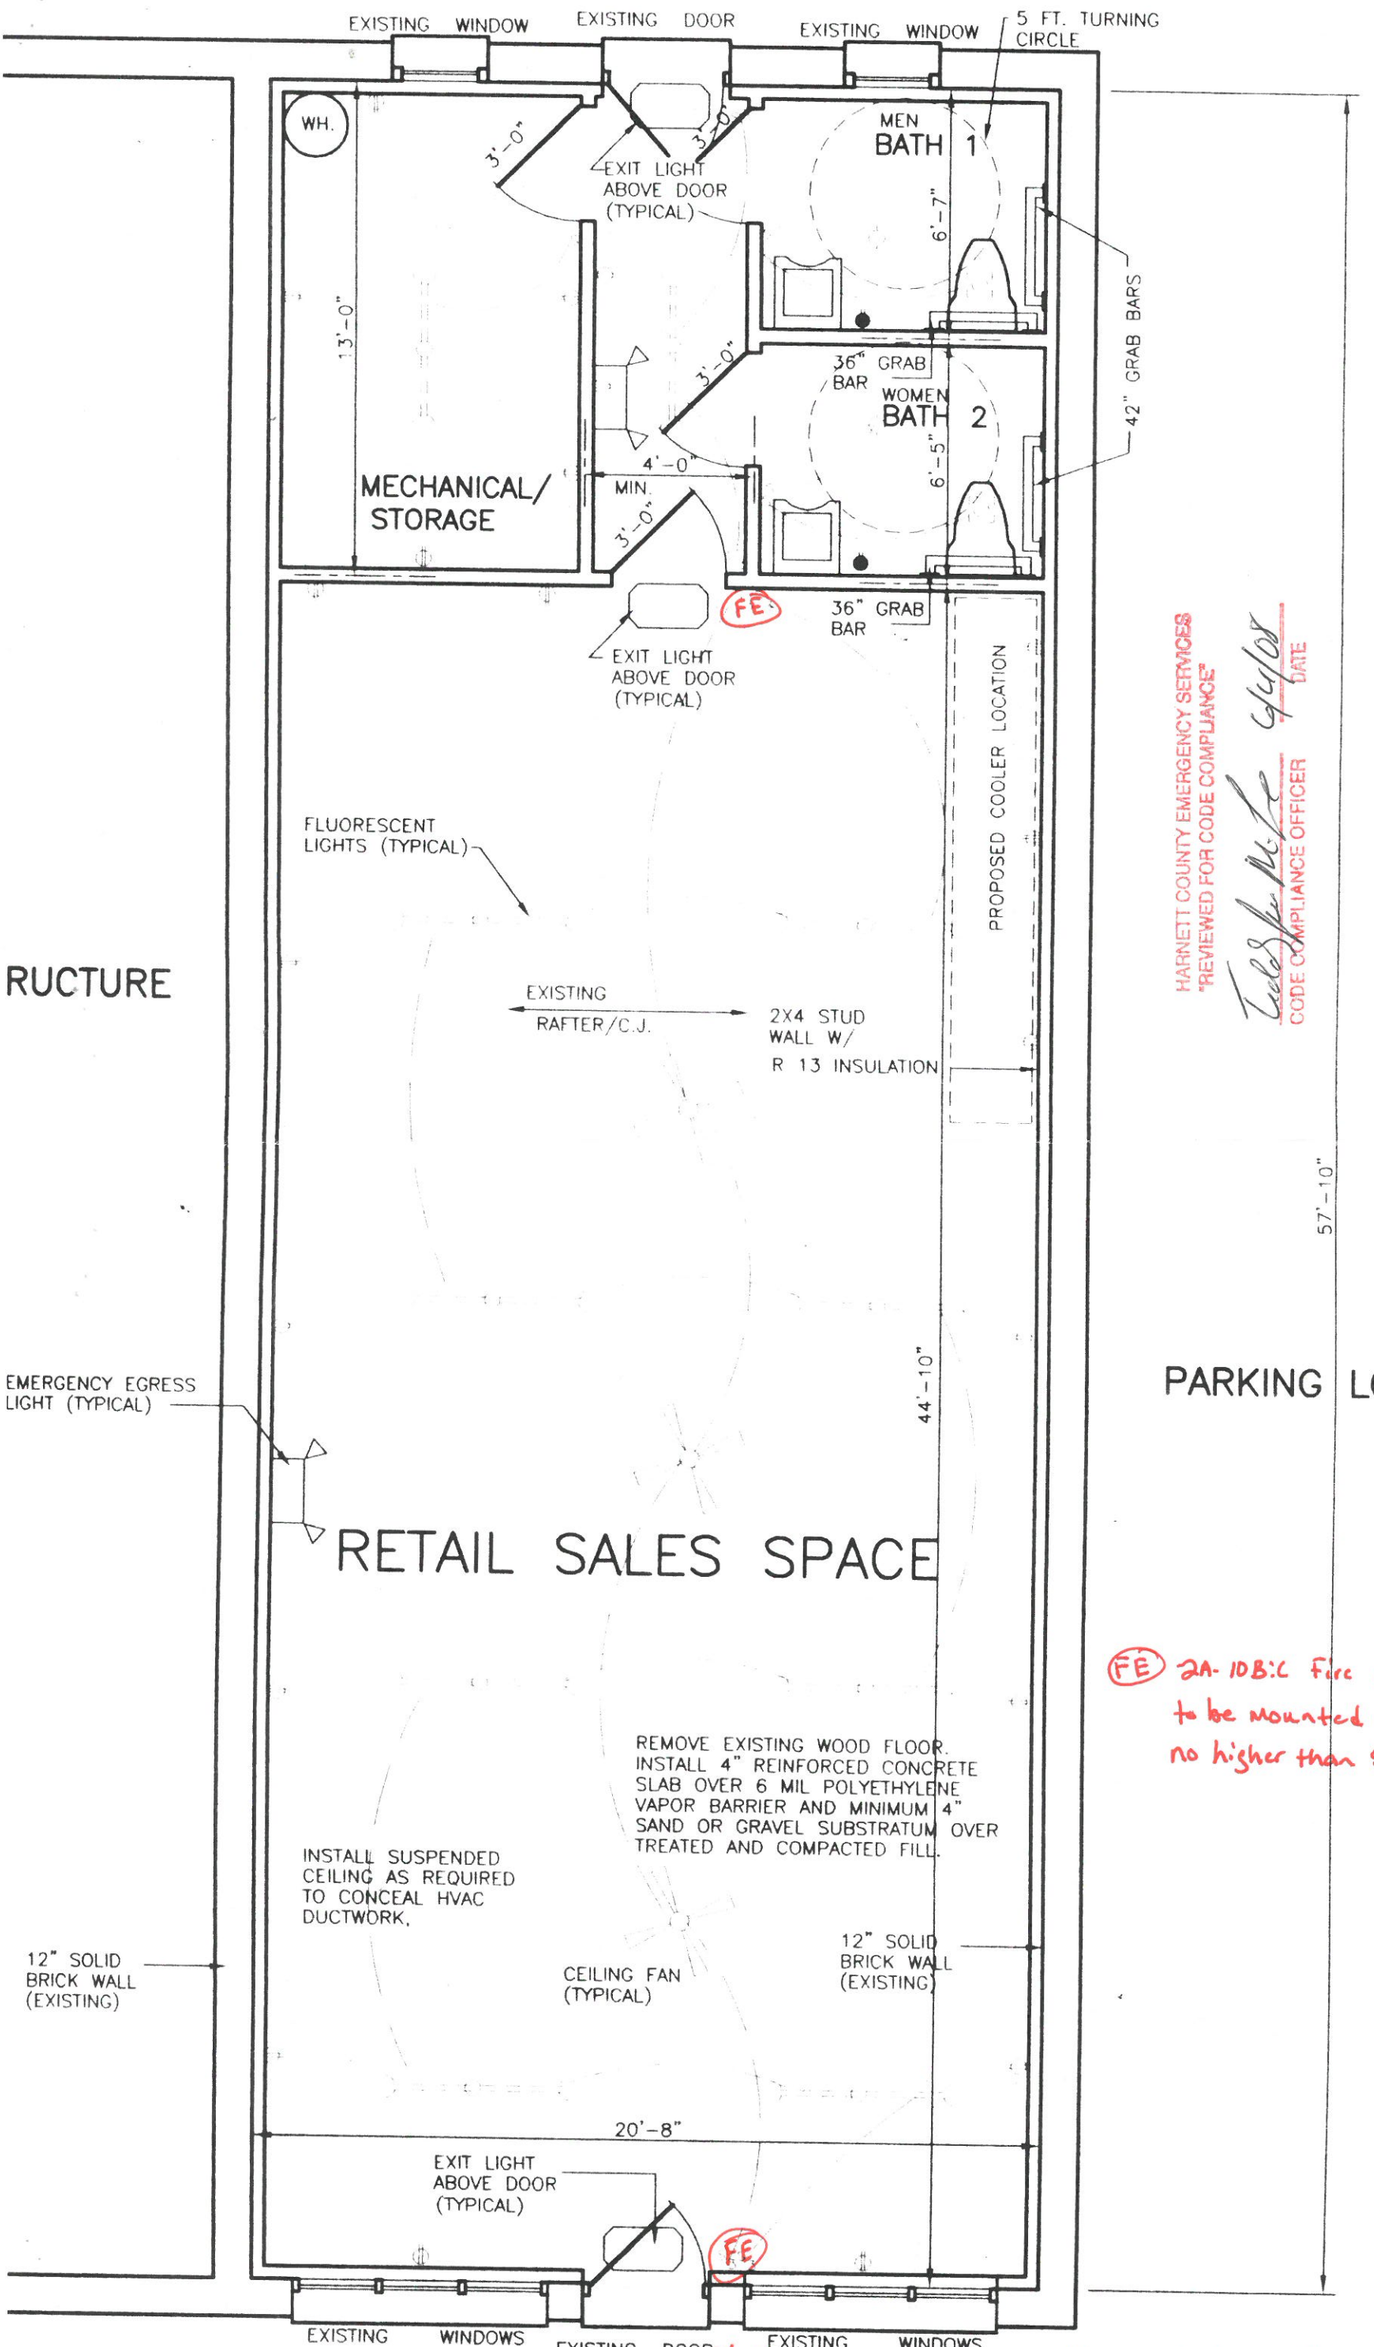

HARNETT COUNTY CENTRAL PERMITTING
APPLICATION # B108-0005
JOB NAME Rodrigues Guillermo
DATE PLANS RECEIVED 8/9/10
SITE PLANS APPROVED _____
APPROVED BY _____

EXPOSED HOT WATER SUPPLY AND DRAIN LINES MUST BE INSULATED.

HARNETT COUNTY EMERGENCY SERVICES
"REVIEWED FOR CODE COMPLIANCE"
CODE COMPLIANCE OFFICER
DATE 9/1/08

DASHED LINE SIZE OF REM NON-METALL

33" MIN TO 36" MAX.

OWNER/ WITH EX DIMENSI

ALL WO ELECTR BE DON CURREN GENERA

FE 2A-10B:C Fire extinguisher to be mounted on wall no higher than 5' A.F.F.

X-knox box to be mounted on exterior wall no higher than 5' A.F.F.

EXISTING WITH MOD

SCALE 1/4" = 1

1204 EAST DENIUM
ERWIN, N.C.