



Amerex Pre-Engineered Fire Suppression System

Reviewed For Code Compliance By:
D. Banks Wallace
 Chief Deputy Fire Marshal
 07/23/2020 11:03:26 AM

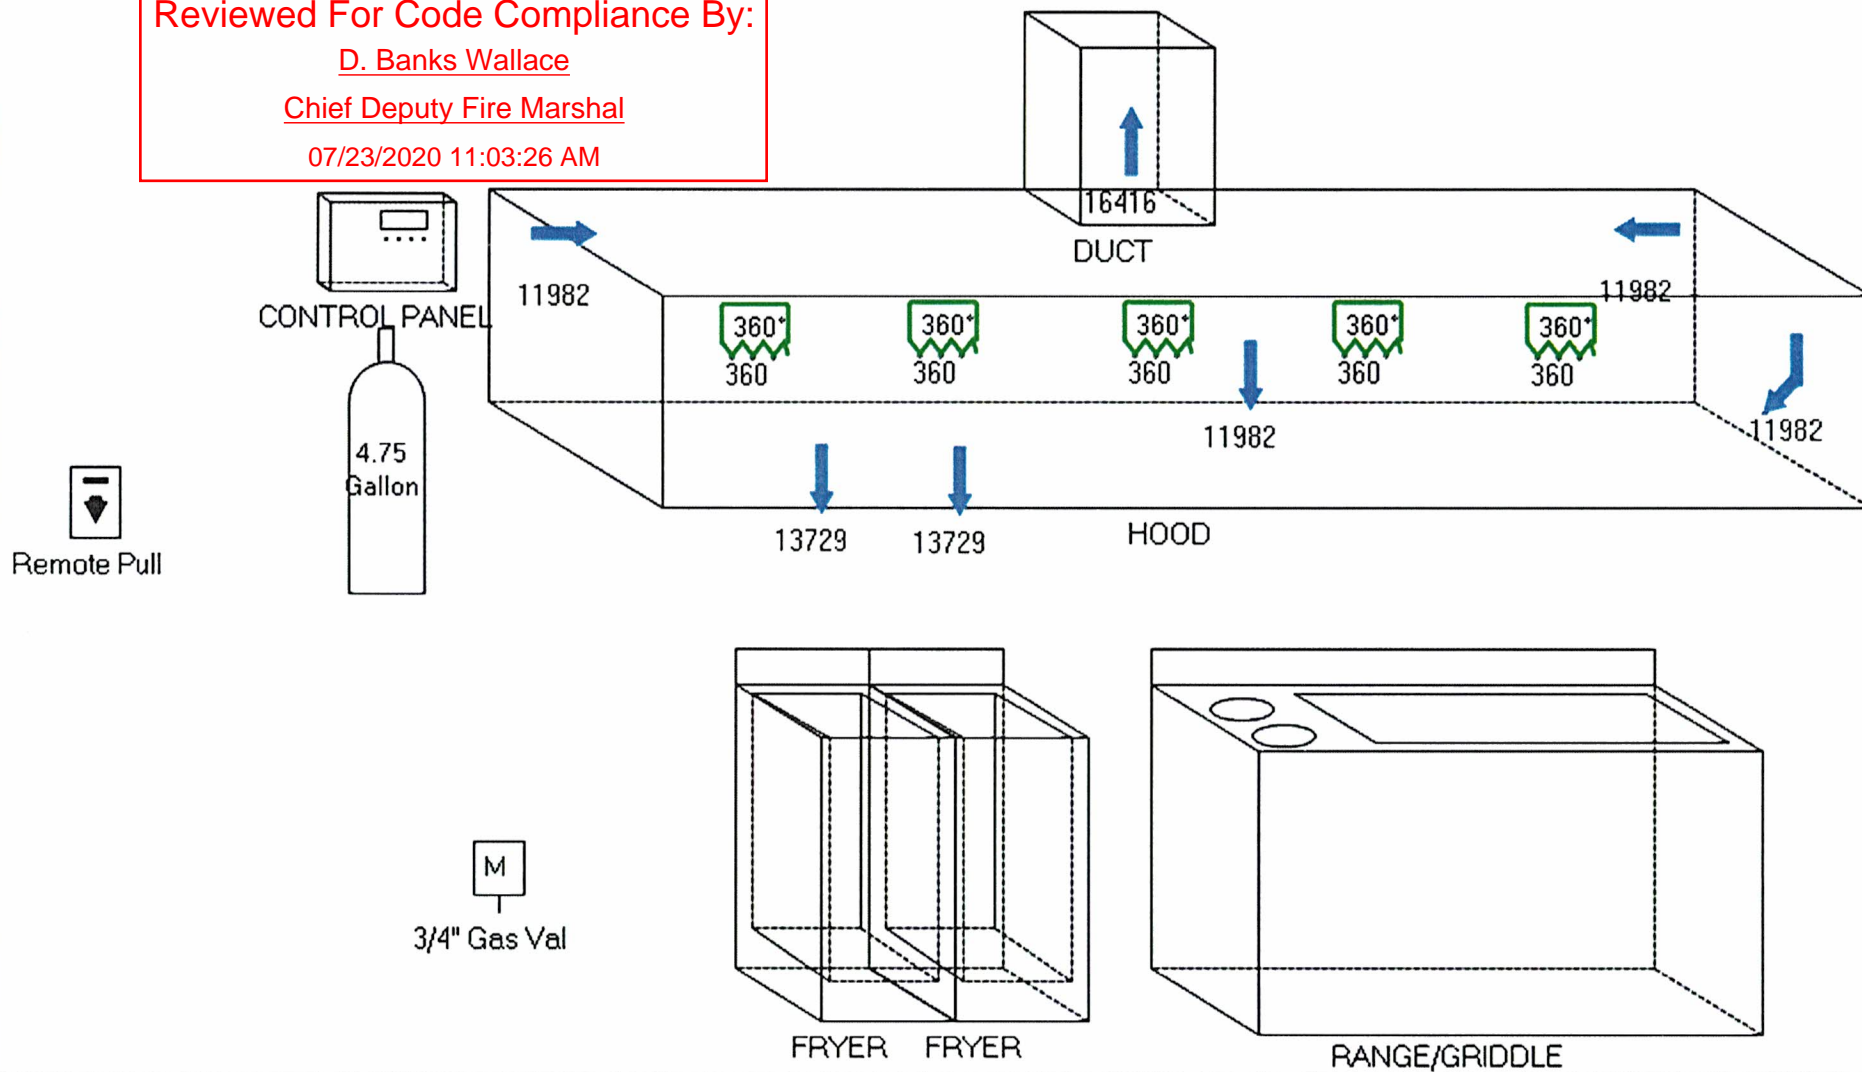

Total System Flow Points = 14 : Flow Points Used = 9



Designed & Installed by:
 Parrish Fire and Safety Inc
 104 S. Railroad St
 Benson, NC 27504
 919-894-8495

For:
 Donna's Country Kitchen
 174 N McKinley St
 Coats, NC 28334

Date: 6/6/2020

Stamp