

PERMIT # NA

Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 232 OLD BOIES CREEK RD (S21542)

Name: (owner) MALTY WADDELL SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: CLINT ADAMS Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms NA 200 GALL/DAY MAX

Type of Water Supply:  Community  Public  Well Distance from well NA feet 8 EMPLOYEE MAX


System Type: 25% REDUCTION SYS. III G Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

\* SUPPLY LINE CASED  
IN SCH. 80 PIPE  
\* NO DRIVING OVER  
SEPTIC AREA/TANK

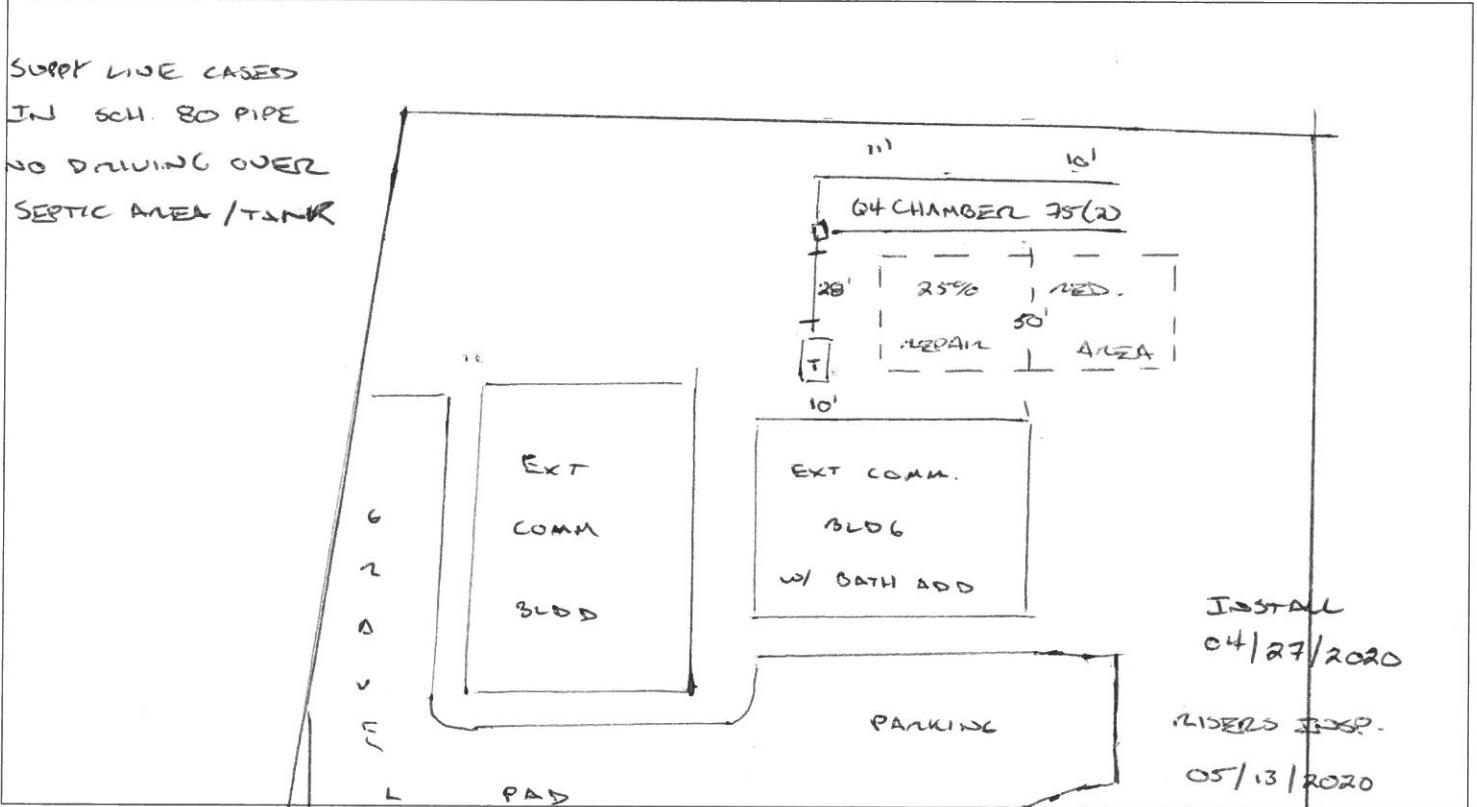

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961 Other: \_\_\_\_\_

Subsurface system operator required? Yes  No  OLD BOIES CREEK RD (S21542)  
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other 64 CHAMBER III G Septic Tank: 1000 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface Drainage Field No. of ditches 2 exact length of each ditch 75 feet width of ditches 3 feet depth of ditches 24 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 05/13/2020