

# NEILL'S CREEK BAPTIST CHURCH ADDITION

4200 NEILL'S CREEK ROAD  
ANGIER, NORTH CAROLINA

REVISIONS	

**NOTICE TO CONTRACTOR**  
All construction must comply with current NC Building Codes and is subject to field inspection and verification.

**APPROVED**  
Limited building only review  
Permit holder responsible for full compliance with the code

06/04/2020




### INDEX OF DRAWINGS

SHEET NUMBER	SHEET NAME	ISSUE DATE	REVISION
A-0.1	COVER SHEET	02-06-2020	
A-0.2	APPENDIX B	02-06-2020	
A-0.3	THERMAL ENVELOPE	02-06-2020	
A-0.4	LIFE SAFETY PLAN	02-06-2020	
A-1	ELEVATIONS	02-06-2020	
A-2	FLOOR PLAN	02-06-2020	
A-3	ENLARGED TOILET PLAN / BOXED COLUMN DETAILS	02-06-2020	
A-4	BUILDING SECTION / ENLARGED WALL SECTION	02-06-2020	
A-5	BUILDING SECTION / ENLARGED WALL SECTION	02-06-2020	
A-6	SCHEDULES	02-06-2020	
A-7	KITCHEN EQUIPMENT PLAN / ELEVATIONS	02-06-2020	



**NEILL'S CREEK BAPTIST CHURCH  
FELLOWSHIP HALL  
ANGIER, NORTH CAROLINA**

919-550-7717  
TONY@TONYJOHNSONARCHITECT.COM  
104 N. LOMBARD ST.  
CLAYTON, NC 27520  
TONYJOHNSONARCHITECT.COM





**TONY  
JOHNSON  
ARCHITECT**

DATE 02-06-2020

SHEET

**A-0.1**

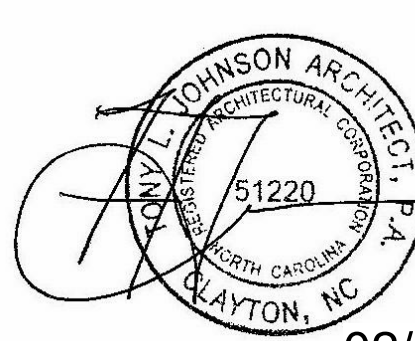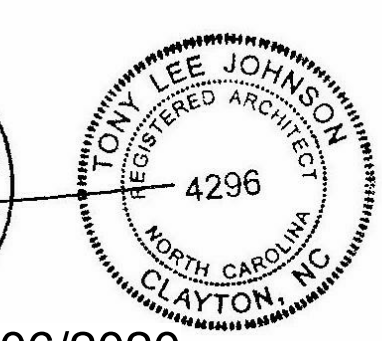02/06/2020

2018 APPENDIX B
BUILDING CODE SUMMARY FOR ALL COMMERCIAL PROJECTS
(EXCEPT 1 AND 2-FAMILY DWELLINGS AND TOWNHOUSES)
(Reproduce the following data on the building plans sheet 1 & 2)

Name of Project: NEILL'S CREEK BAPTIST CHURCH ADDITION
Address: 4200 NEILL'S CREEK ROAD, ANGIER, NC
Zip Code: 27501
Owner/Authorized Agent: KENT ALEXANDER
Phone#: 919-625-0963
E-Mail: KENT@ALEXANDERDESIGNBUILD.COM
Owned By:
City/County:
State:
Code Enforcement Jurisdiction:
City:
County: HARNETT
State:

CONTACT:

Table with columns: DESIGNER, FIRM, NAME, LICENSE#, TELEPHONE#, EMAIL. Lists various design firms like Tony Johnson Architect, Kilian Engineering, etc.

(\*Other\* should include firms and individuals such as truss, precast, pre-engineer, interior designers, etc.)

2018 NC BUILDING CODE EDITION:
New Building:
Renovation:
Addition:
Phased Construction:

2018 EXISTING BUILDING CODE:
Check all that apply:
Alteration:
Constructed: (date)
Renovated: (date)
Risk Category (Table 1604.5):

BASIC BUILDING DATA:
Construction Type:
Sprinklers:
Standpipes:
Primary Fire District:
Special Inspections Required:

GROSS BUILDING AREA TABLE:
Table with columns: Floor, Existing (sq.ft.), New (sq.ft.), Renovated (sq.ft.), Sub-Total.

ALLOWABLE AREA: CHAPTER 5
OCCUPANCY
Primary Occupancy:
Accessory Occupancies (-10%):

ACCESSIBLE DWELLING UNITS: (Section 1107)
Table with columns: Total Units, Accessible Units Req'd, Type A Units Req'd, etc.

ACCESSIBLE PARKING REQUIREMENTS: (Section 1106)
Table with columns: Lot or Parking Area, Total Number of Parking Spaces, # of Accessible Spaces Provided, etc.

INCIDENTAL USES:
LIFE SAFETY SYSTEM REQUIREMENTS: Chapters 9 and 10
LIFE SAFETY PLAN REQUIREMENTS:
Fire and/or smoke rated wall locations
Occupancy types for each area
Occupant loads for each area
Exit access travel distances
Common path of travel distances
Dead end lengths
Clear exit widths for each exit door
Maximum calculated occupant load capacity

ALLOWABLE AREA table with columns: Story Number, Description and Use, Building Area Per Story (Actual), etc.

- 1. Frontage area increases from Section 506.2 are computed thus:
a. Perimeter which fronts a public way or open space having 20 feet minimum width=
b. Total Building Perimeter=
c. Ratio (F/P)=
d. W=Minimum width of public way=
e. Percent of frontage increase (f)=
2. The sprinkler increase per Section 506.3 is as follows:
a. Multi-story building (f)=200 percent
b. Single story building (f)=300 percent
3. Unlimited area applicable under conditions of Sections Group B, F, M, S, A-4 (507.3), A-3 (507.6);
Group A motion picture (507.1); Covered Mall Buildings (507.12); and H-2 aircraft paint hangers (507.9).
4. Maximum Building Area=total number of stories in the building x E, But not greater than 3xE (506.4-1).
5. The maximum area of a single-use parking garage shall be permitted to comply with Table 406.3.5.
The maximum area of air traffic control towers must comply with table 412.3.2.

ALLOWABLE HEIGHT: CHAPTER 5
Table with columns: Type of Construction, Allowable (Table 504.3), Increased for Sprinklers (506.3), Shown on Plans, Code Reference.

FIRE PROTECTION REQUIREMENTS: CHAPTER 6 (TABLE 601)
Table with columns: Building Element, Fire Separation Distance (Feet), Rating\* (Required, Provided), Detail # and Sheet #, Design # for Rated Assembly, Design # for Rated Penetration, Design # for Rated Joints.

PERCENTAGE OF WALL OPENING CALCULATIONS:
Table with columns: Fire Separation Distance (Feet) From Property Lines, Degree of Openings Protection (Table 705.8), Allowable Area (%), Actual Shown on Plans (%).

LIFE SAFETY SYSTEM REQUIREMENTS: Chapters 9 and 10
Emergency Lighting: 51006
Exit Signs: 51011
Fire Alarm: S907, NFPA 72-07
Smoke Detection Systems: S907
Carbon Monoxide Detection:
LIFE SAFETY PLAN REQUIREMENTS:
Fire and/or smoke rated wall locations
Occupancy types for each area
Occupant loads for each area
Exit access travel distances
Common path of travel distances
Dead end lengths
Clear exit widths for each exit door
Maximum calculated occupant load capacity

ACCESSIBLE DWELLING UNITS: (Section 1107)
Table with columns: Total Units, Accessible Units Req'd, Type A Units Req'd, Type B Units Req'd, Total Accessible Units Provided.

ACCESSIBLE PARKING REQUIREMENTS: (Section 1106)
Table with columns: Lot or Parking Area, Total Number of Parking Spaces, # of Accessible Spaces Provided, Total # Accessible Provided.

PLUMBING FIXTURE REQUIREMENTS: Chapter 29 (Table 2902.1)
Table with columns: Occupancy Use Group and/or Space Designation, Waterclosets, Urinals, Lavatories, Showers/Tubs, Drinking Fountains.

SPECIAL APPROVAL:
Special approval: (Local Jurisdiction, Department of Insurance, OSC, DPI, DHHS, ICC, etc., describe below)

ENERGY SUMMARY

ENERGY REQUIREMENTS:
The following data shall be considered minimum and any special attribute required to meet the energy code shall also be provided.
Existing building envelope complies with code:
Exempt Building:
Climate Zone:
Method of Compliance:
Thermal Envelope:
Roof/Ceiling Assembly (each assembly):
Exterior Walls (each assembly):
Openings (windows or doors with glazing):
Walls Below Grade (each assembly):

Floors over unconditioned space (each assembly)
Description of assembly:
U-Value of total assembly:
R-Value of insulation:
Floors slab on grade
Description of assembly:
U-Value of total assembly:
R-Value of insulation:
Horizontal/vertical requirement:
Slab heated:

2018 APPENDIX B
BUILDING CODE SUMMARY FOR ALL COMMERCIAL PROJECTS
STRUCTURAL DESIGN
(PROVIDE ON THE STRUCTURAL SHEETS IF APPLICABLE)

DESIGNS LOADS:
Importance Factors:
Live Loads:
Ground Snow Load:
Wind Load:
SEISMIC DESIGN CATEGORY:
Provide the following Seismic Design Parameters:


Risk Category (Table 1604.5)
Spectral Response Acceleration Ss
Site Classification (ASCE 7)
Basic Structural System: (check one)
Analysis Procedure:
LATERAL DESIGN CONTROL:
SOIL BEARING CAPACITIES:
Field Test (provide copy of test report)
Presumptive Bearing Capacity
Pile Size, Type, and Capacity
SOIL BEARING CAPACITIES:

2018 APPENDIX B
BUILDING CODE SUMMARY FOR ALL COMMERCIAL PROJECTS
MECHANICAL DESIGN
(PROVIDE ON THE MECHANICAL SHEETS IF APPLICABLE)

MECHANICAL SUMMARY
MECHANICAL SYSTEMS, SERVICE SYSTEMS AND EQUIPMENT
Thermal Zone
Interior Design Conditions
Building heating load:
Building cooling load:
Mechanical Spacing Conditioning System
Unitary
Boiler
Chiller
List equipment efficiencies:

2018 APPENDIX B
BUILDING CODE SUMMARY FOR ALL COMMERCIAL PROJECTS
ELECTRICAL DESIGN
(PROVIDE ON THE ELECTRICAL SHEETS IF APPLICABLE)
ELECTRICAL SUMMARY

ELECTRICAL SYSTEM AND EQUIPMENT
Method of Compliance:
Lighting schedule (each fixture type)
Additional Efficiency Package Options
(When using the 2018 NCECC; not required for ASHRAE 90.1)

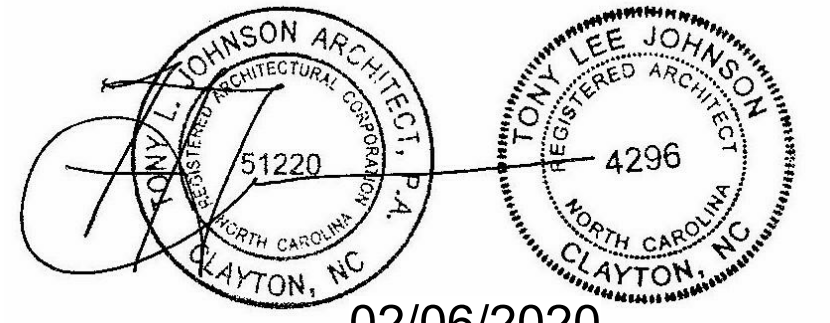

02/06/2020

REVISIONS table with columns for revision number, description, and date.

NEILL'S CREEK BAPTIST CHURCH
FELLOWSHIP HALL
ANGIER, NORTH CAROLINA

919-550-7717
TONY@TONYJOHNSONARCHITECT.COM
104 N. LOMBARD ST.
CLAYTON, NC 27520
TONYJOHNSONARCHITECT.COM



DATE 02-06-2020

SHEET

A-0.2



**COMcheck Software Version null**  
**Envelope Compliance Certificate**

**Project Information**

Energy Code: 2015 IECC  
 Project Title: NEILL'S CREEK BAPTIST CHURCH  
 Location: Angier, North Carolina  
 Climate Zone: 4a  
 Project Type: New Construction  
 Vertical Glazing / Wall Area: 1%

Construction Site: 4200 NEILL'S CREEK ROAD, ANGIER, NC 27501  
 Owner/Agent: \_\_\_\_\_  
 Designer/Contractor: \_\_\_\_\_

**Additional Efficiency Package(s)**  
 Dedicated Outdoor Air System

Building Area	Floor Area
1-Gymnasium : Nonresidential	6142

**Envelope Assemblies**

Assembly	Gross Area or Perimeter	Cavity R-Value	Cont. R-Value	Proposed U-Factor	Budget U-Factor <sub>min</sub>
Roof 1: Metal Building, Standing Seam, Double Insulation Layer with Thermal Blocks (d), [Bldg. Use 1 - Gymnasium]	6575	11.0	19.8	0.034	0.035
Floor 1: Slab-On-Grade/Unheated, [Bldg. Use 1 - Gymnasium] (c)	333	---	---	0.730	0.540
<b>NORTH</b>					
North Wall - Left Side: Metal Building Wall, Single Layer Mineral Fiber (compressed at girt), [Bldg. Use 1 - Gymnasium]	2062	0.0	19.8	0.048	0.052
Door 2: Insulated Metal, Swinging, [Bldg. Use 1 - Gymnasium]	42	---	---	0.200	0.610
<b>EAST</b>					
East Wall - Rear Elevation: Metal Building Wall, Single Layer Mineral Fiber (compressed at girt), [Bldg. Use 1 - Gymnasium]	1140	0.0	19.8	0.048	0.052
Door 4: Insulated Metal, Swinging, [Bldg. Use 1 - Gymnasium]	21	---	---	0.200	0.610
<b>SOUTH</b>					
South Wall - Right Side: Metal Building Wall, Single Layer Mineral Fiber (compressed at girt), [Bldg. Use 1 - Gymnasium]	2062	0.0	19.8	0.048	0.052
Window 1: Metal Frame/Fixed, Perf. Specs.: Product ID NA, SHGC 0.25, [Bldg. Use 1 - Gymnasium] (b)	12	---	---	0.450	0.380
Window 2: Metal Frame/Fixed, Perf. Specs.: Product ID NA, SHGC 0.25, [Bldg. Use 1 - Gymnasium] (b)	12	---	---	0.450	0.380
Window 3: Metal Frame/Fixed, Perf. Specs.: Product ID NA, SHGC 0.25, [Bldg. Use 1 - Gymnasium] (b)	12	---	---	0.450	0.380
Door 3: Insulated Metal, Swinging, [Bldg. Use 1 - Gymnasium]	42	---	---	0.200	0.610
<b>WEST</b>					
West Wall - Front Elevation: Steel-Framed, 16" o.c., [Bldg. Use 1 - Gymnasium]	1140	19.0	3.8	0.077	0.064
Door 1 - Entrance: Glass (> 50% glazing)/Nonmetal Frame, Entrance	43	---	---	0.450	0.770

Project Title: NEILL'S CREEK BAPTIST CHURCH  
 Data filename: G:\My Drive\2019 Project Folders\2019-025 - Neill's Creek Baptist Church Fellowship Hall, 4200 Neill's Creek Road, Angier (G. Leonard Johnson - Construction Committee Chair)  
 Report date: 02/11/20  
 Page 1 of 9

Assembly	Gross Area or Perimeter	Cavity R-Value	Cont. R-Value	Proposed U-Factor	Budget U-Factor <sub>min</sub>
Door, Perf. Specs.: Product ID NA, SHGC 0.25, PF 1.30, [Bldg. Use 1 - Gymnasium] (b)					

- (a) Budget U-factors are used for software baseline calculations ONLY, and are not code requirements.
- (b) Fenestration product performance must be certified in accordance with NFRC and requires supporting documentation.
- (c) Slab-On-Grade proposed and budget U-factors shown in table are F-factors.
- (d) Thermal spacer block with minimum R-3.5 must be installed above the purlin/batt, and the roof deck secured to the purlins.

**Envelope PASSES: Design 1% better than code**

**Envelope Compliance Statement**

Compliance Statement: The proposed envelope design represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed envelope systems have been designed to meet the 2015 IECC requirements in COMcheck Version null and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

TONY JOHNSON, ARCHITECT  
 Name - Title: \_\_\_\_\_ Signature:  Date: 02/11/2020

REVISIONS	


**NEILL'S CREEK BAPTIST CHURCH**  
**FELLOWSHIP HALL**  
**ANGIER, NORTH CAROLINA**

919-550-7717  
 TONY@TONYJOHNSONARCHITECT.COM  
 104 N. LOMBARD ST.  
 CLAYTON, NC 27520  
 TONYJOHNSONARCHITECT.COM



DATE 02-06-2020

SHEET  
**A-0.3**

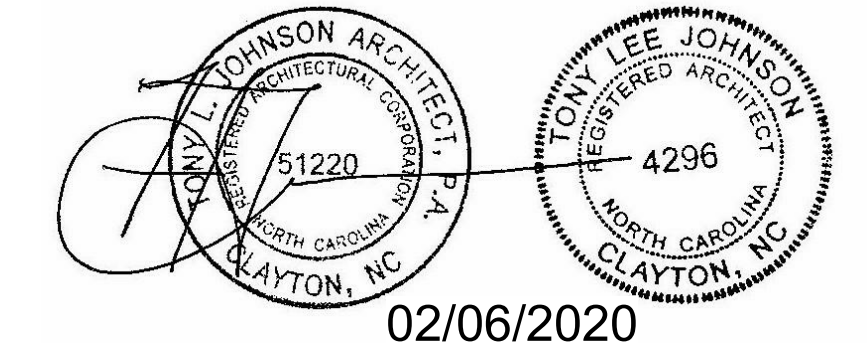

REVISIONS	

**NEILL'S CREEK BAPTIST CHURCH  
FELLOWSHIP HALL  
ANGIER, NORTH CAROLINA**


919-550-7717  
TONY@TONYJOHNSONARCHITECT.COM  
104 N. LOMBARD ST.  
CLAYTON, NC 27520  
TONYJOHNSONARCHITECT.COM

**TONY JOHNSON ARCHITECT**


DATE 02-06-2020

SHEET


**A-1**

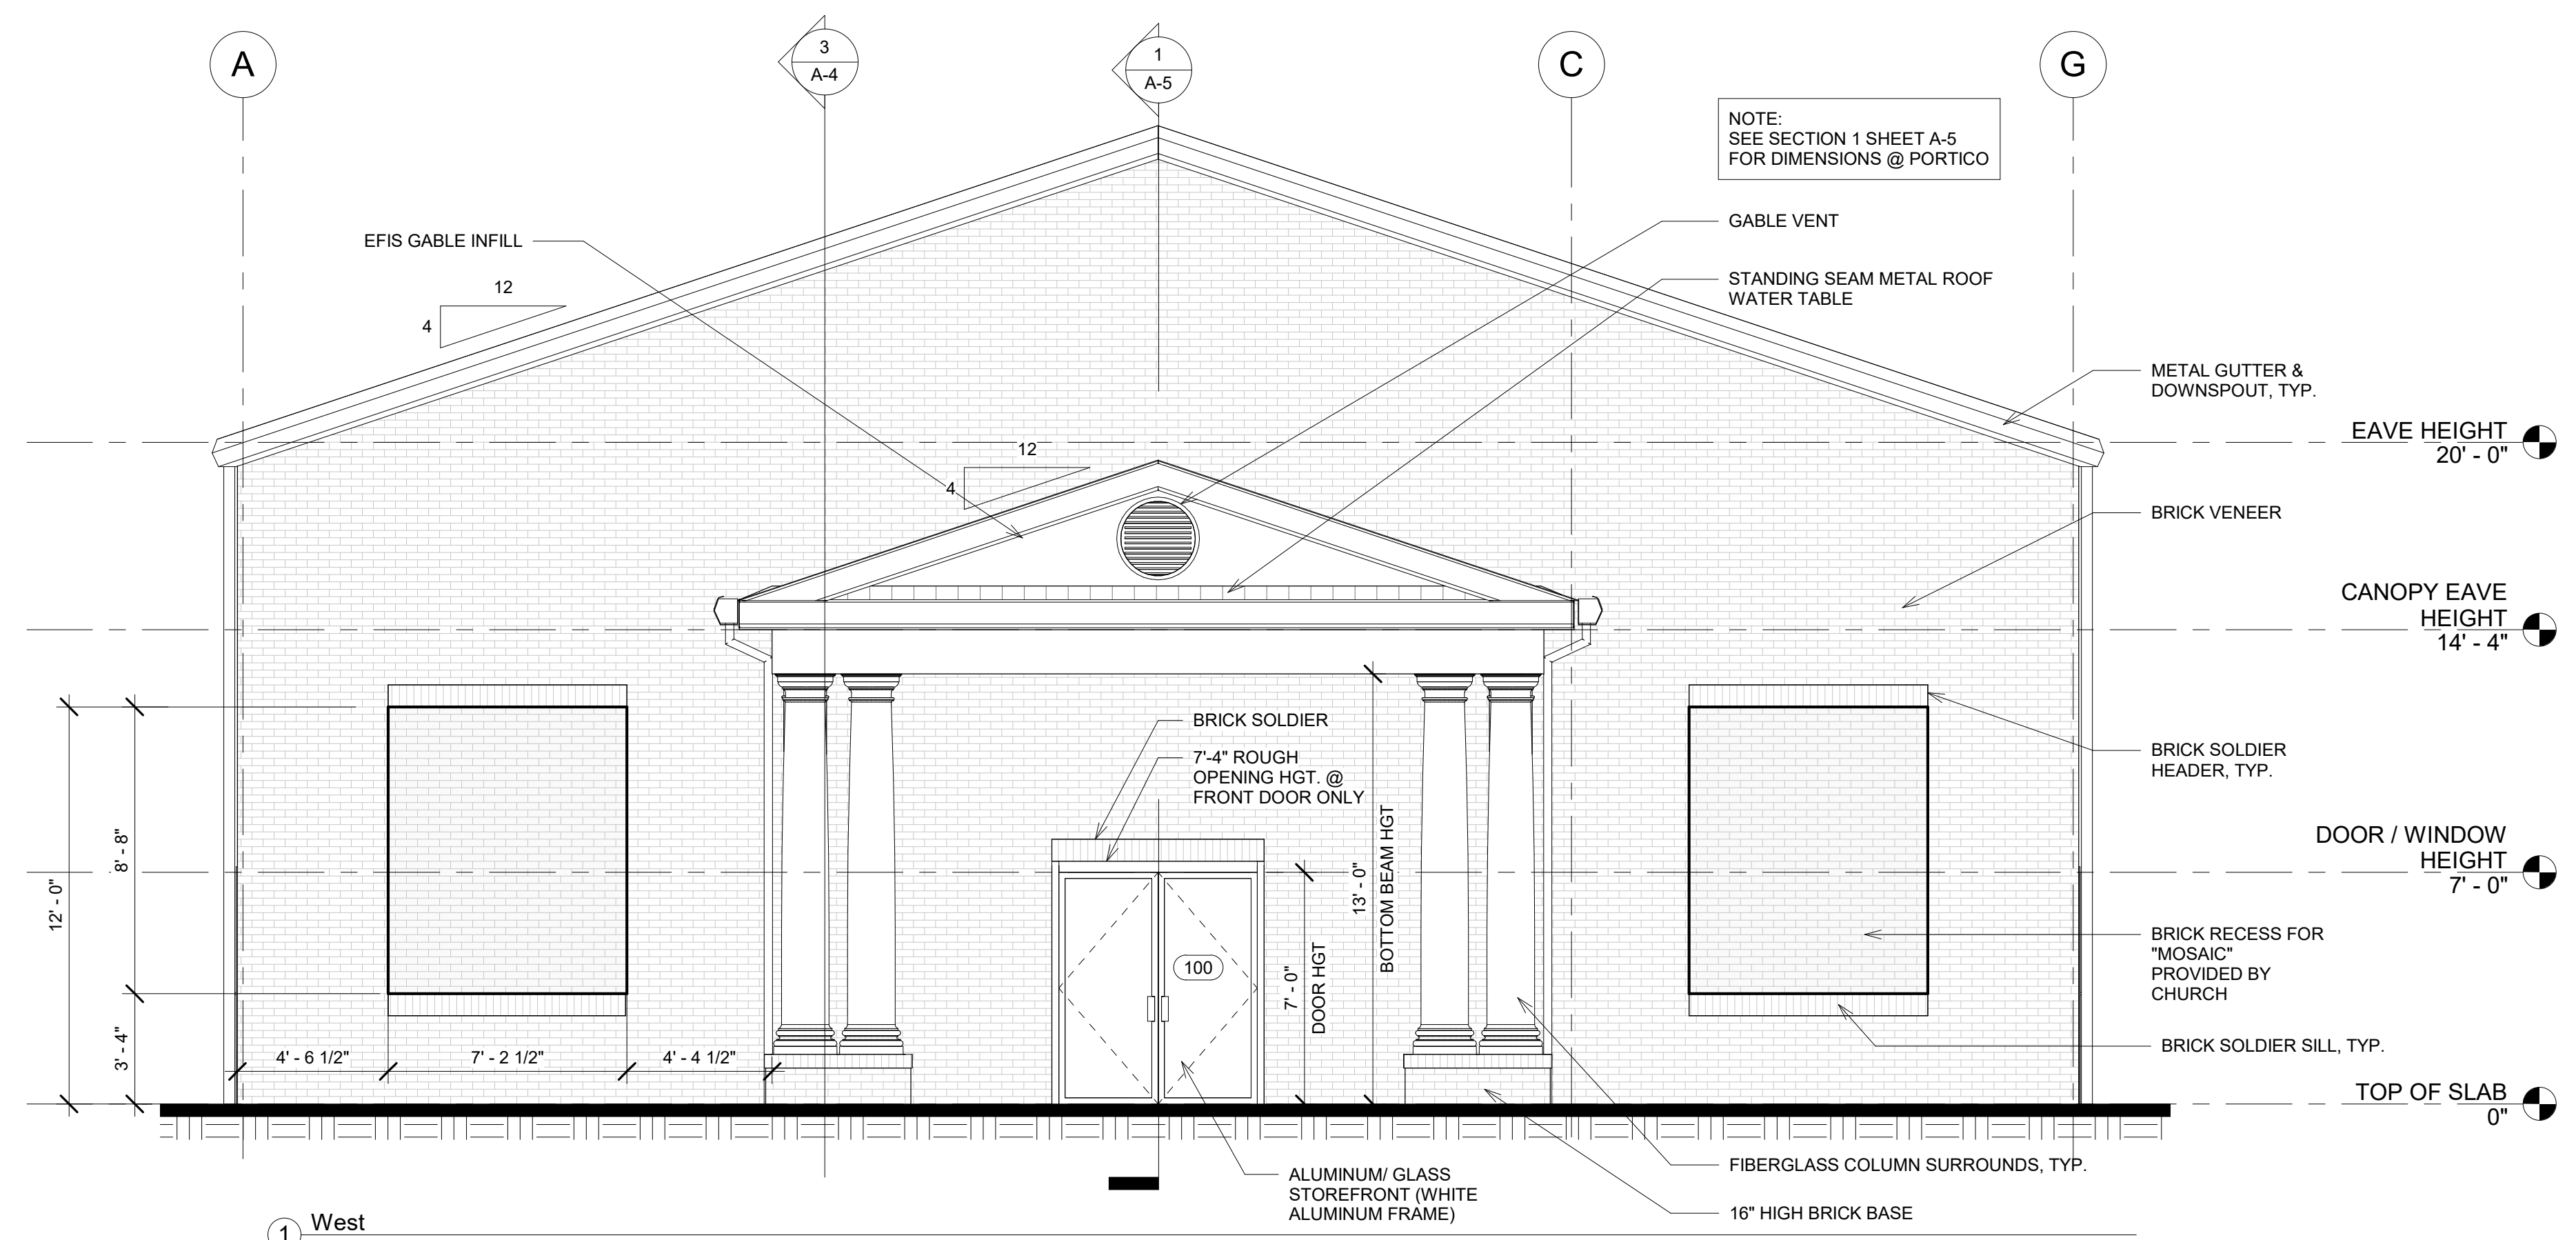


1 West  
1/4" = 1'-0"

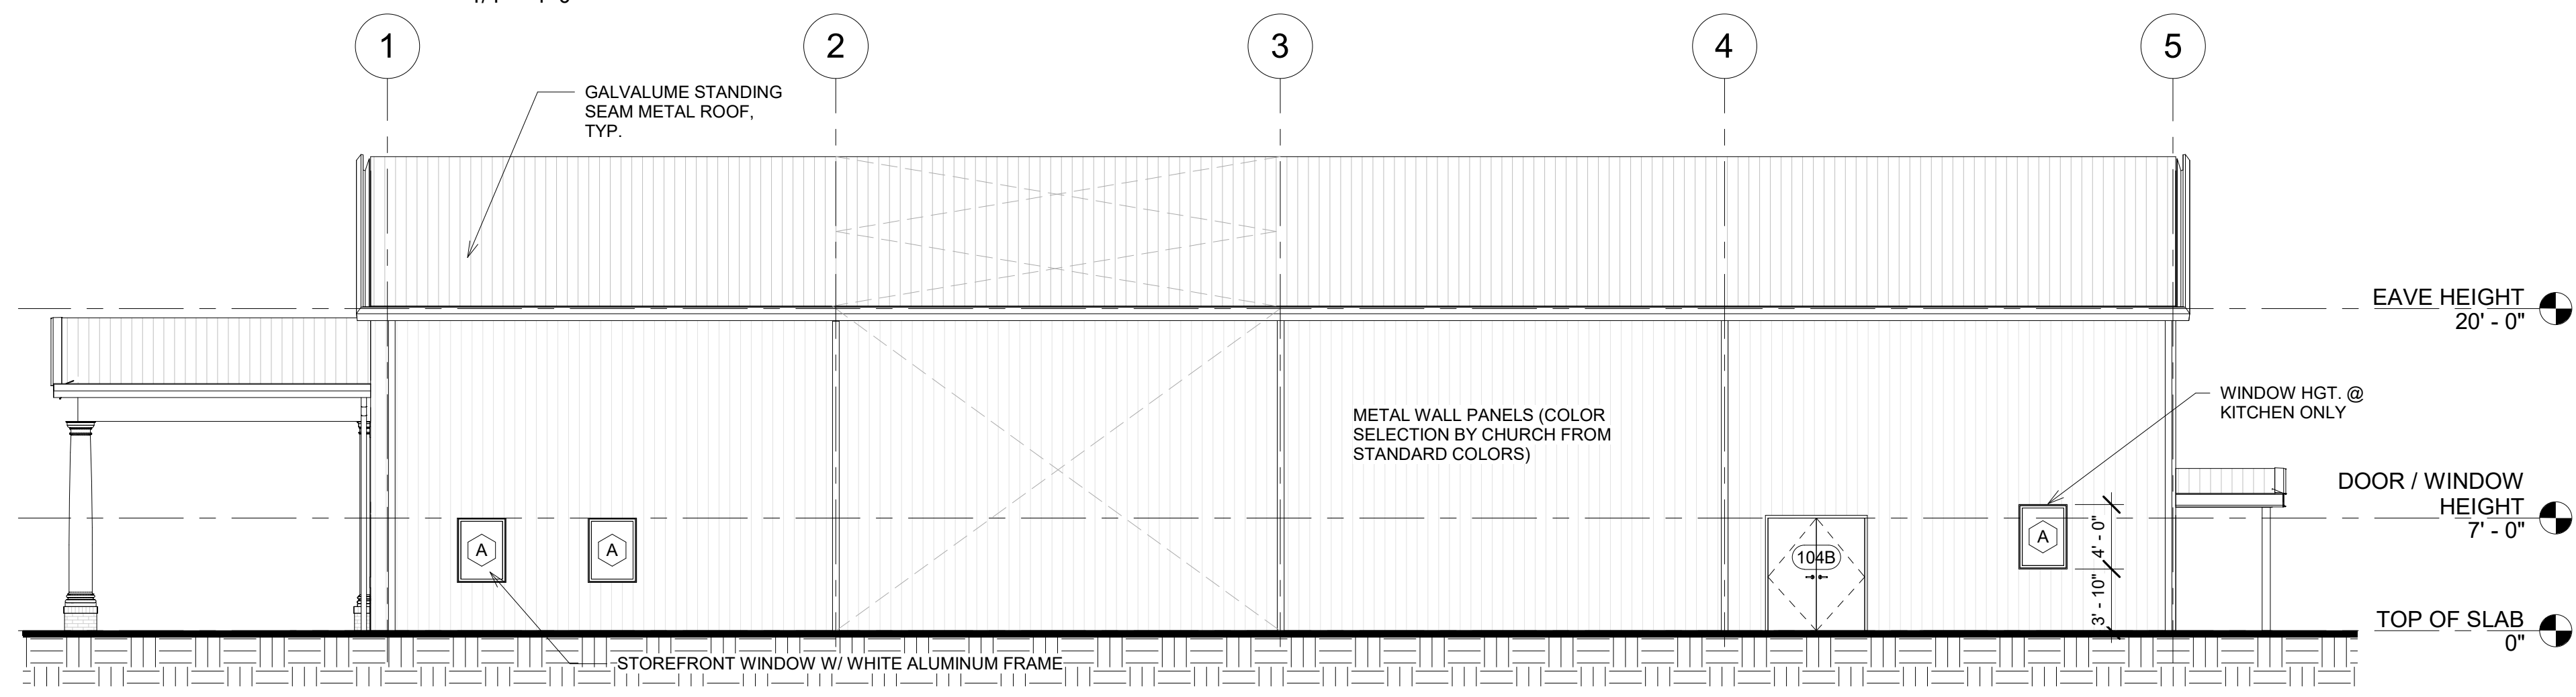

4 South  
1/8" = 1'-0"

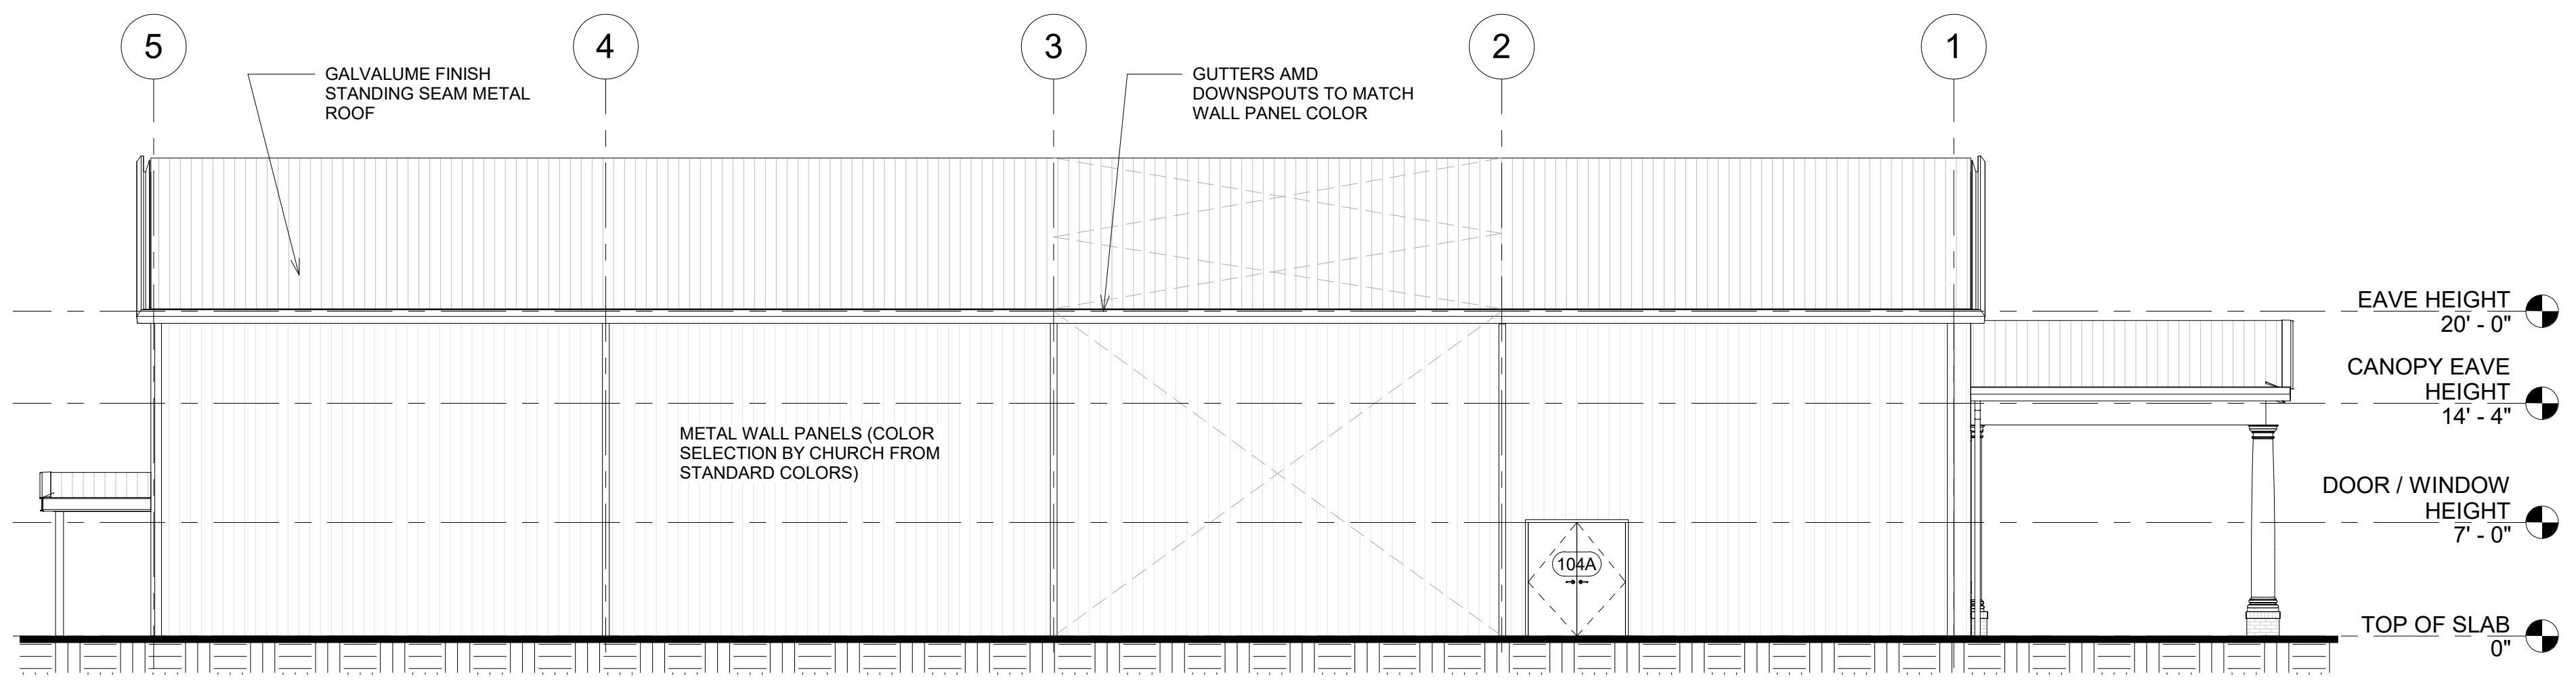

3 North  
1/8" = 1'-0"

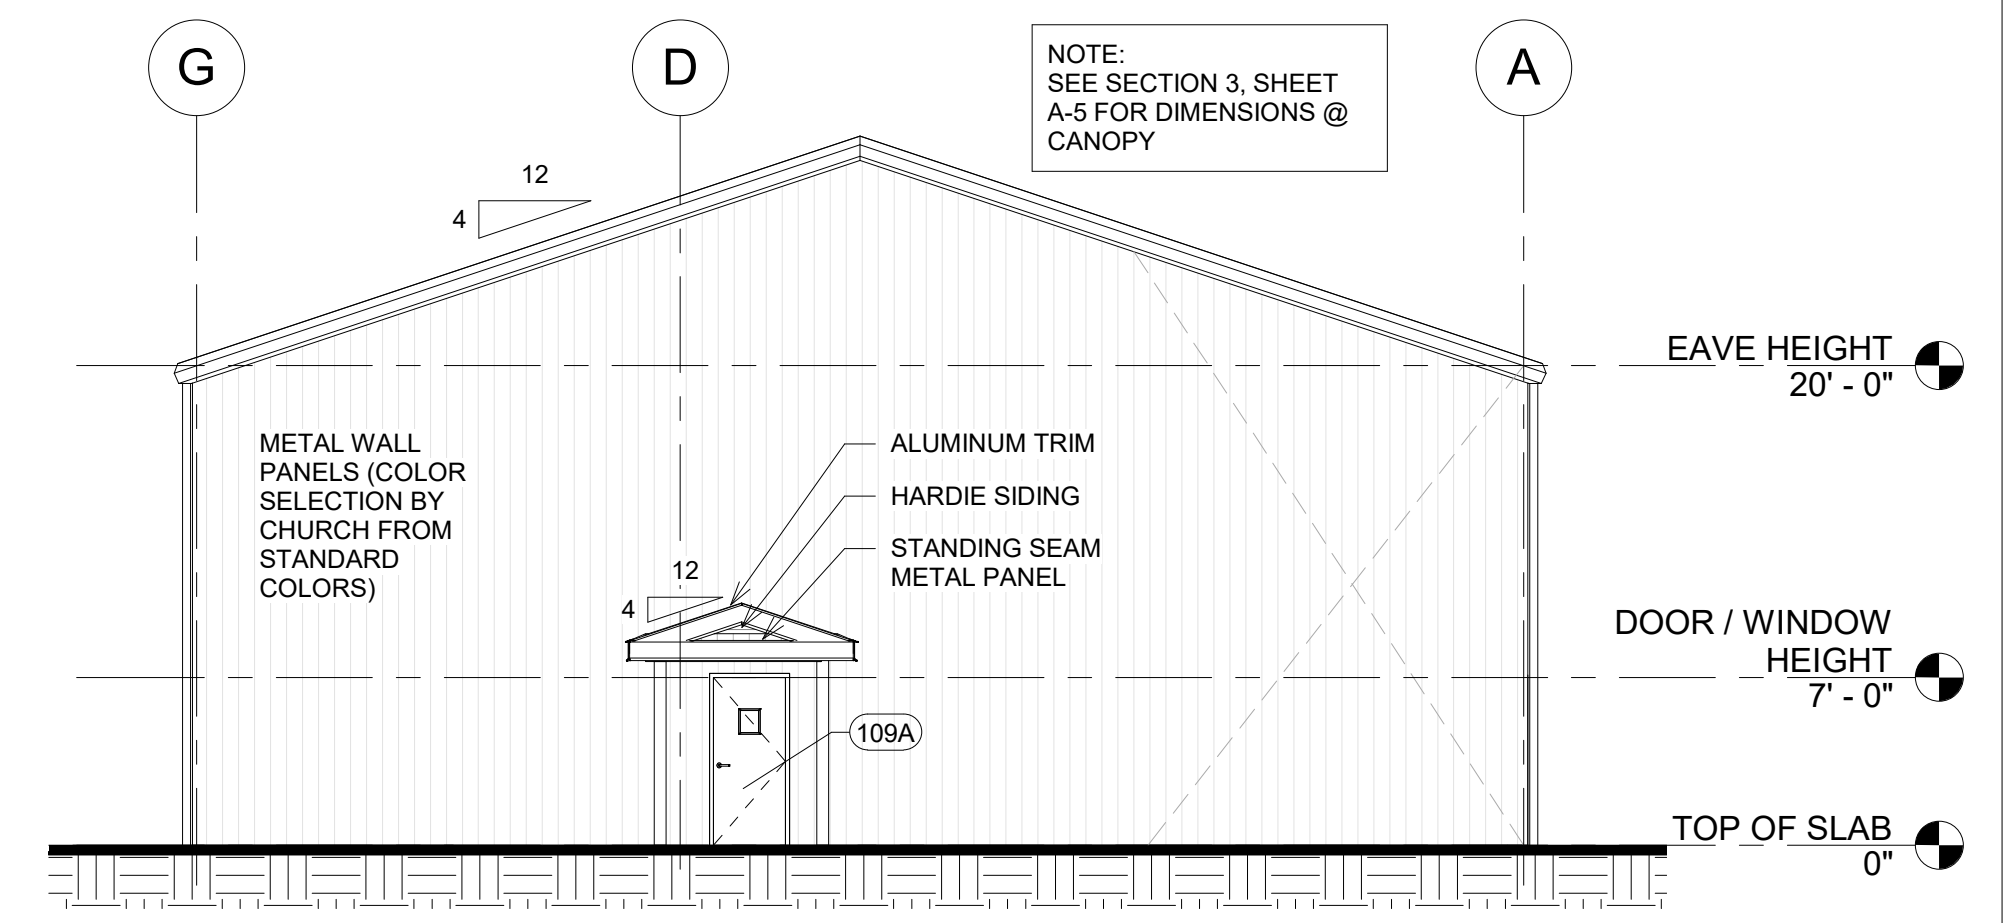


2 East  
1/8" = 1'-0"

02/06/2020


### FLOOR PLAN NOTES

- ALL INTERIOR DIMENSIONS ARE FROM WALL FACE TO WALL FACE, U.N.O. ALL DIMENSIONS REFERENCED HEREIN ARE IMPERIAL STANDARD, U.N.O. SEE ENLARGED FLOOR PLANS SHEET A-3 FOR DIMENSIONS & INFO NOT NOTED.
- ALL EXTERIOR DIMENSIONS ARE FROM FACE OF STUD TO FACE OF STUD, TO STEEL LINE, & TO OUTLINE OF OPENING, U.N.O.
- REFER TO DETAIL 8 SHEET A-3 FOR INSULATION AT BOXED COLUMNS.
- PROVIDE SOUND BATT INSULATION AT TOILET ROOMS.
- PROVIDE FLASHING AS REQUIRED TO ENSURE A WEATHER TIGHT CONDITION TO PROTECT THE EXTERIOR MATERIALS AND FINISHES.
- PROVIDE CAULKING, AS RECOMMENDED BY THE MANUFACTURER, TO SEAL EXTERIOR AND INTERIOR JOINTS AT EXPANSION JOINTS, FRAMES OF DOORS, WINDOWS, AND OTHER WALL OPENINGS.

REVISIONS	
03-20-2020	1

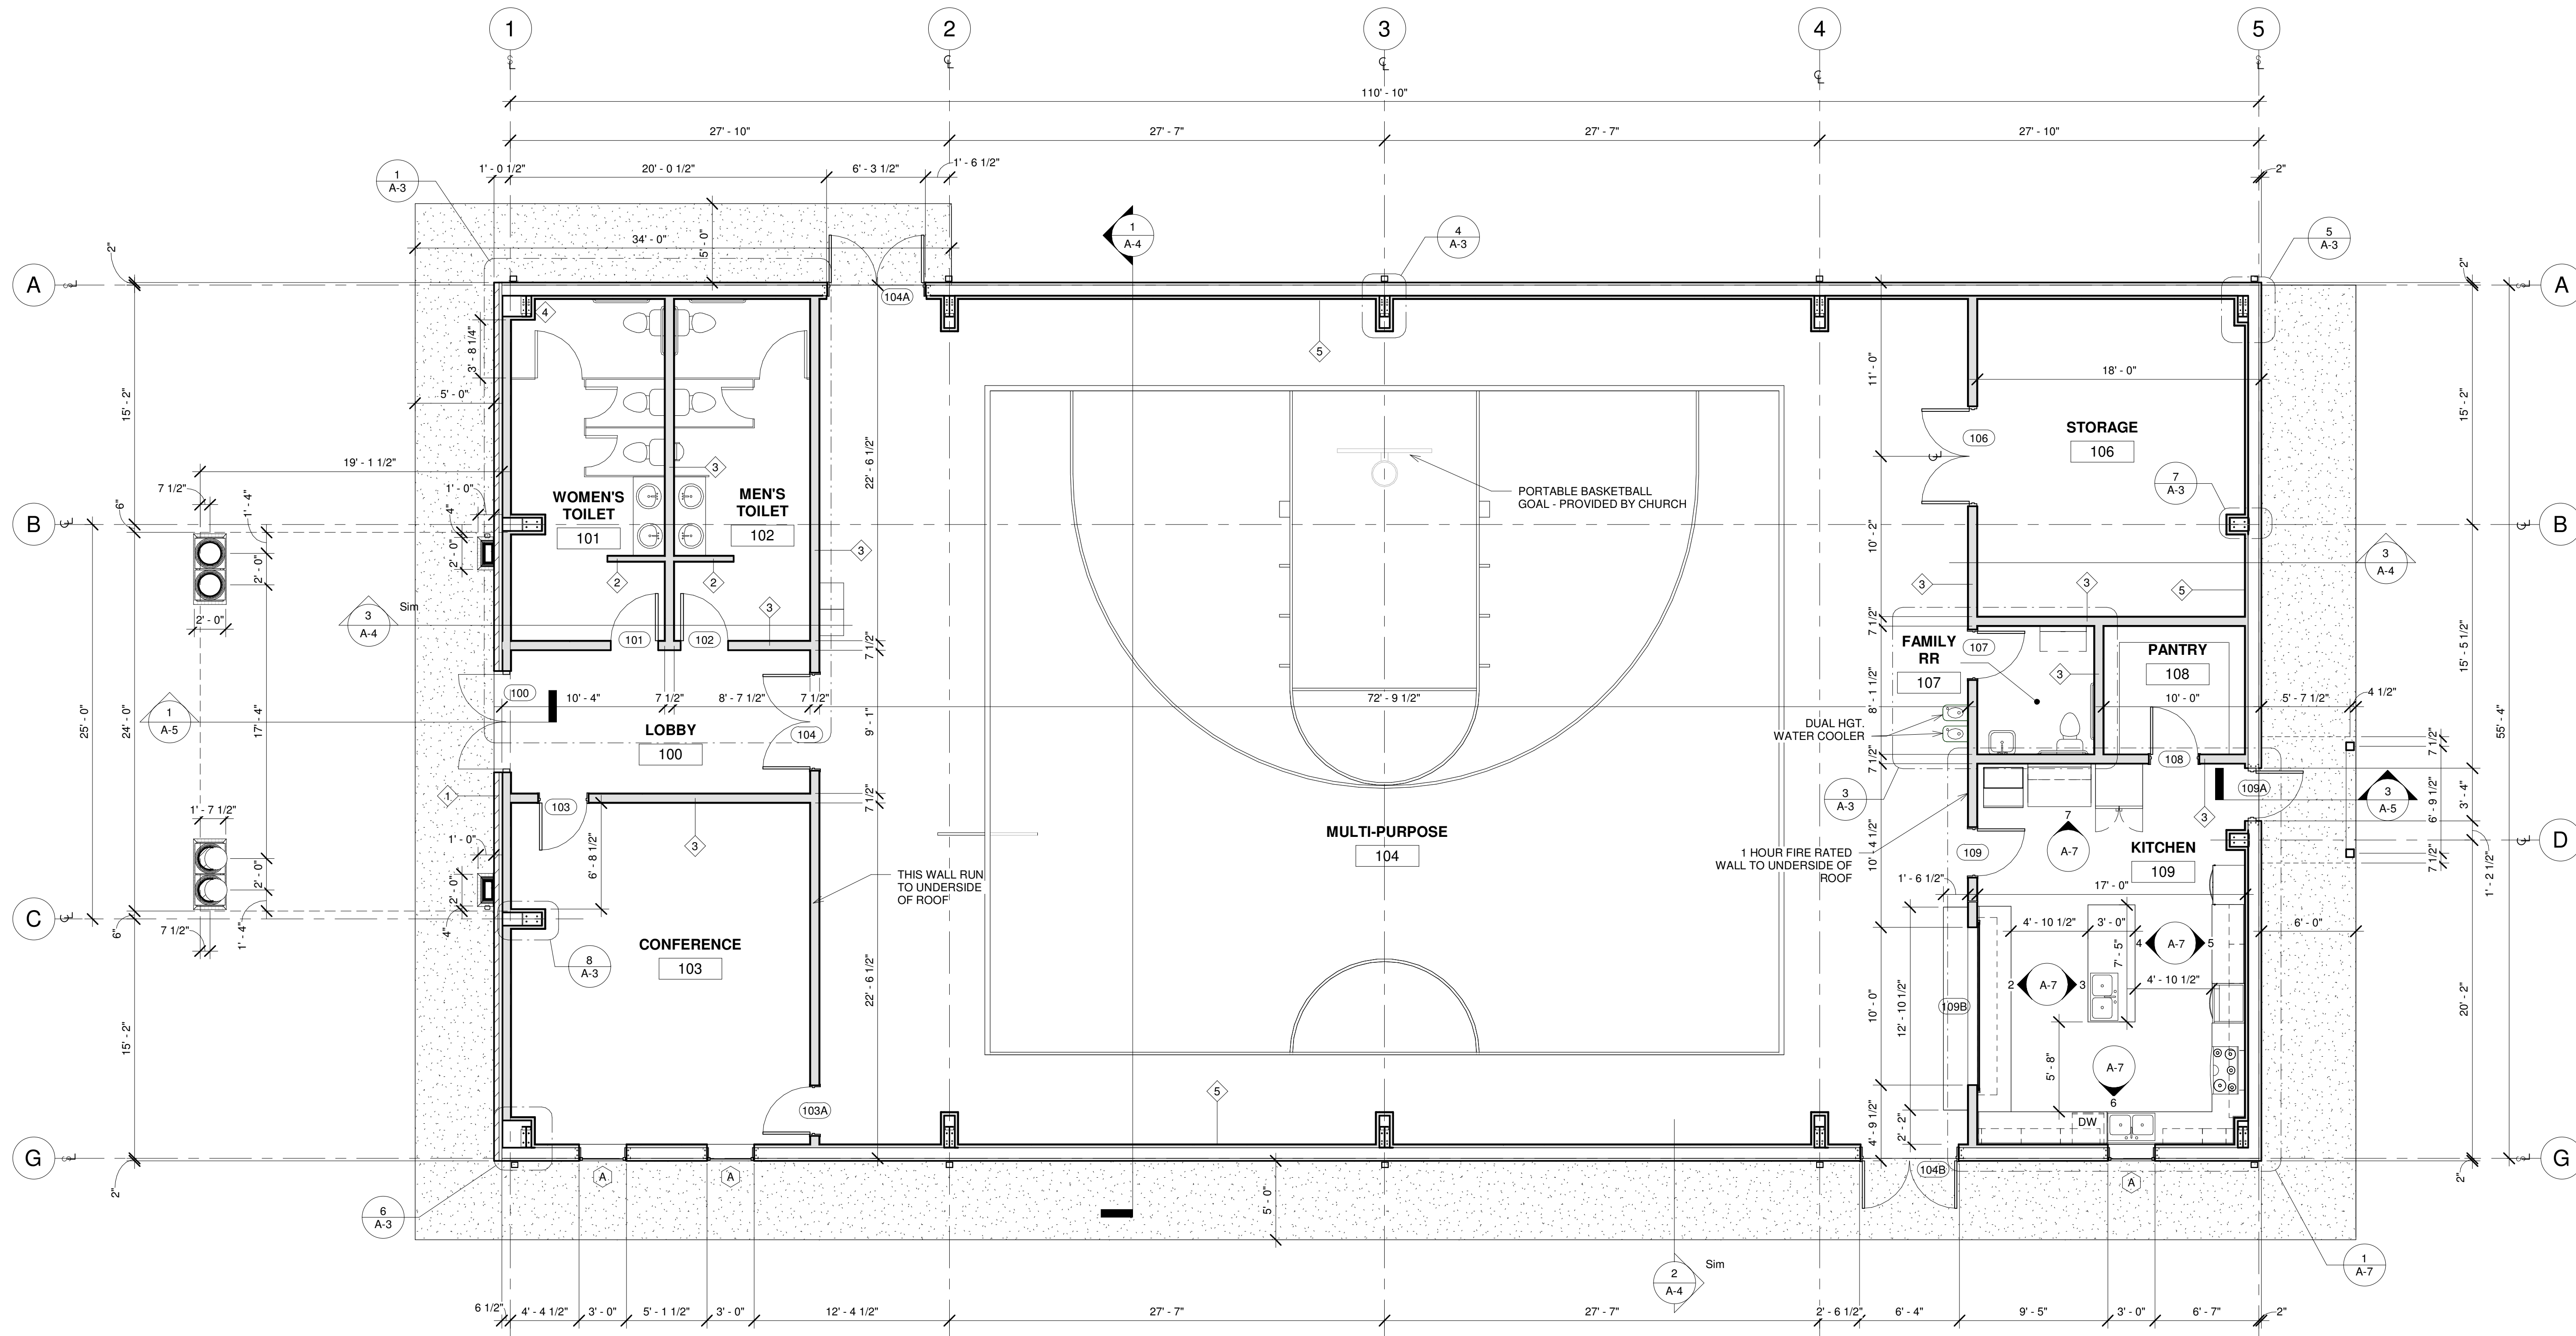

1 FLOOR PLAN  
3/16" = 1'-0"

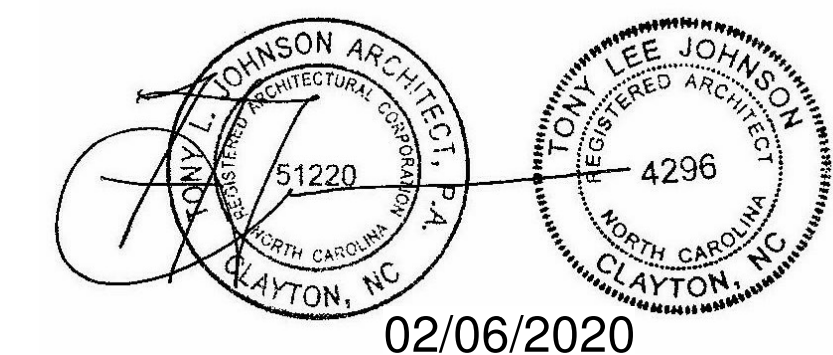

**NEILL'S CREEK BAPTIST CHURCH  
FELLOWSHIP HALL  
ANGIER, NORTH CAROLINA**

919-550-7717  
TONY@TONYJOHNSONARCHITECT.COM  
104 N. LOMBARD ST.  
CLAYTON, NC 27520  
TONYJOHNSONARCHITECT.COM




DATE 02-06-2020


SHEET

**A-2**


REVISIONS	
03-20-2020	1

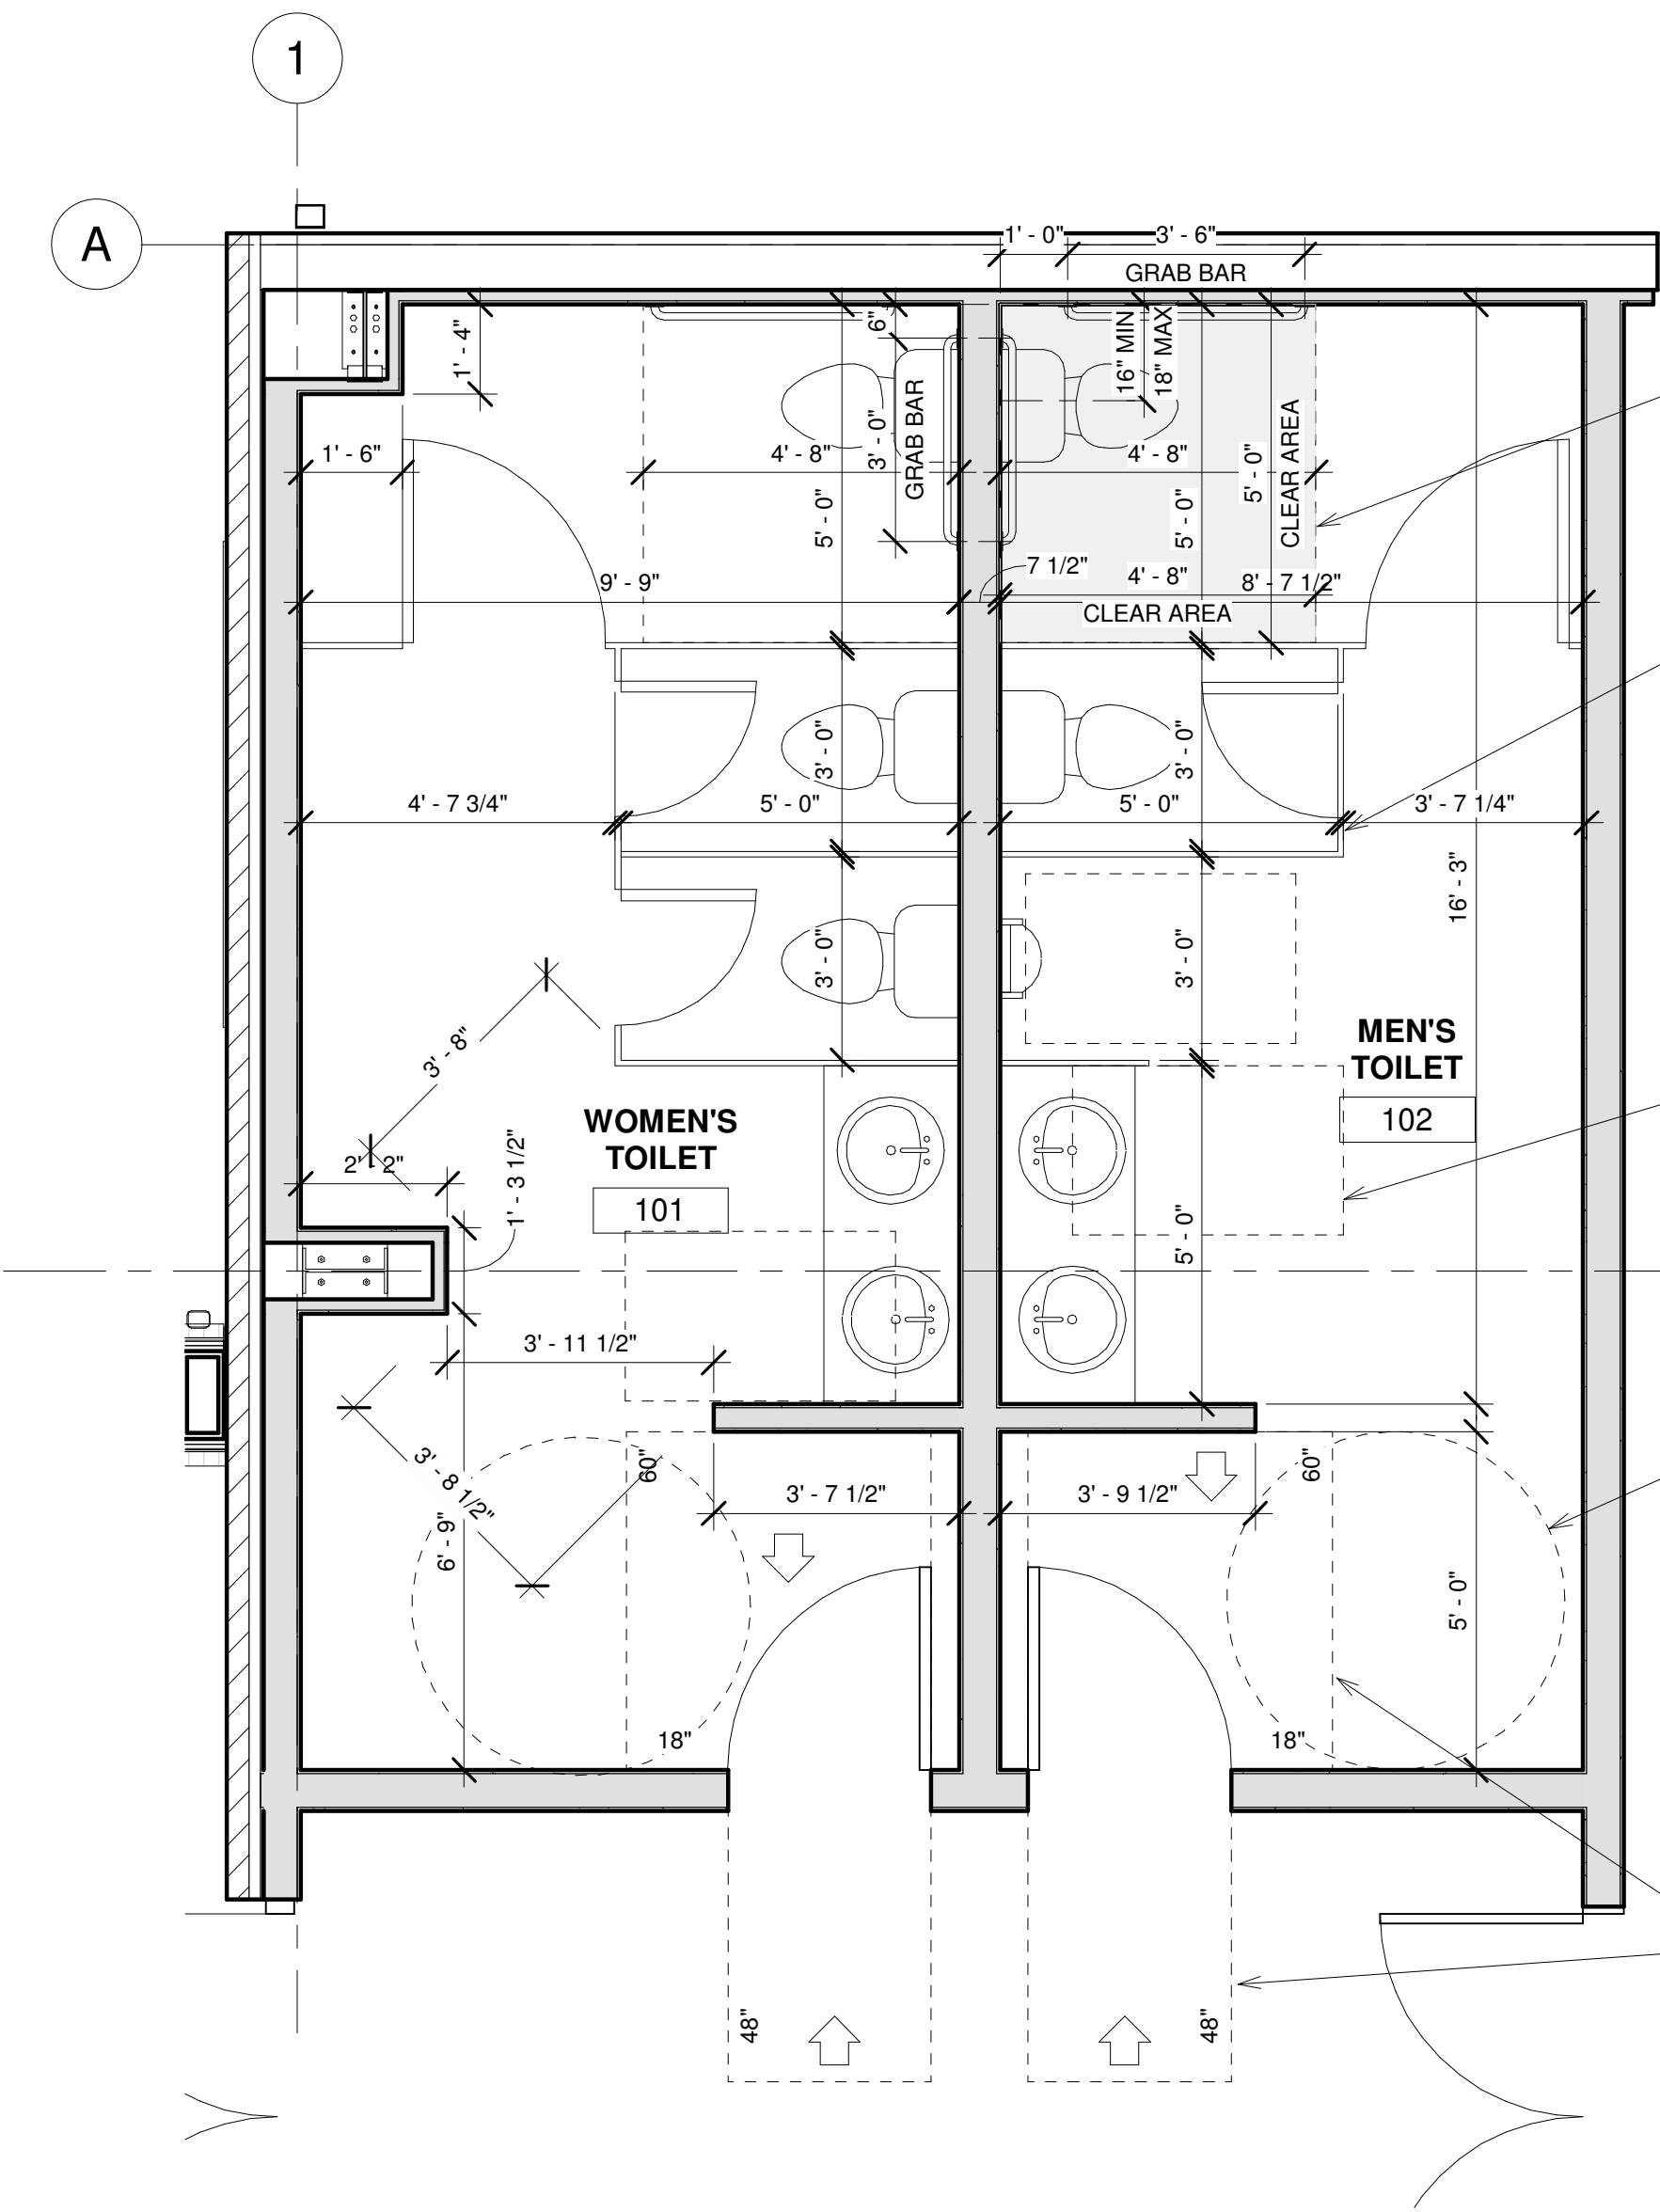


1 ENLARGED TOILET PLAN @ ENTRY  
3/8" = 1'-0"

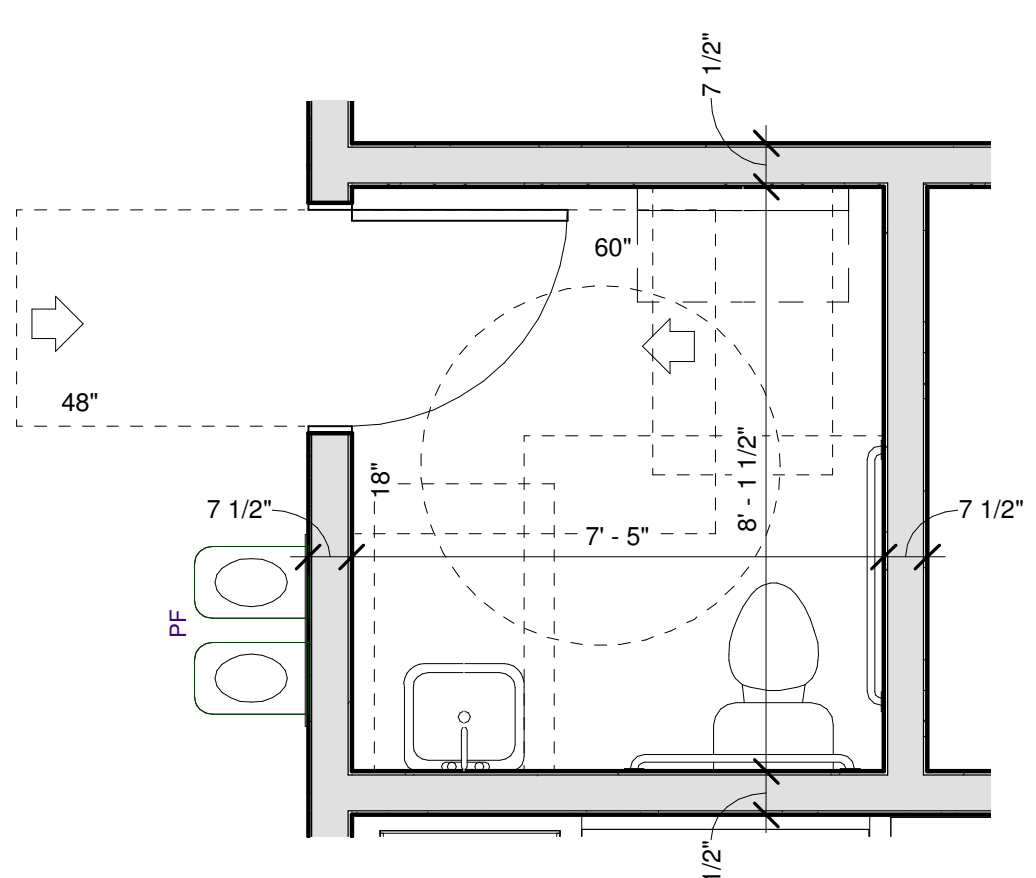


3 ENLARGED TOILET PLAN 2  
3/8" = 1'-0"

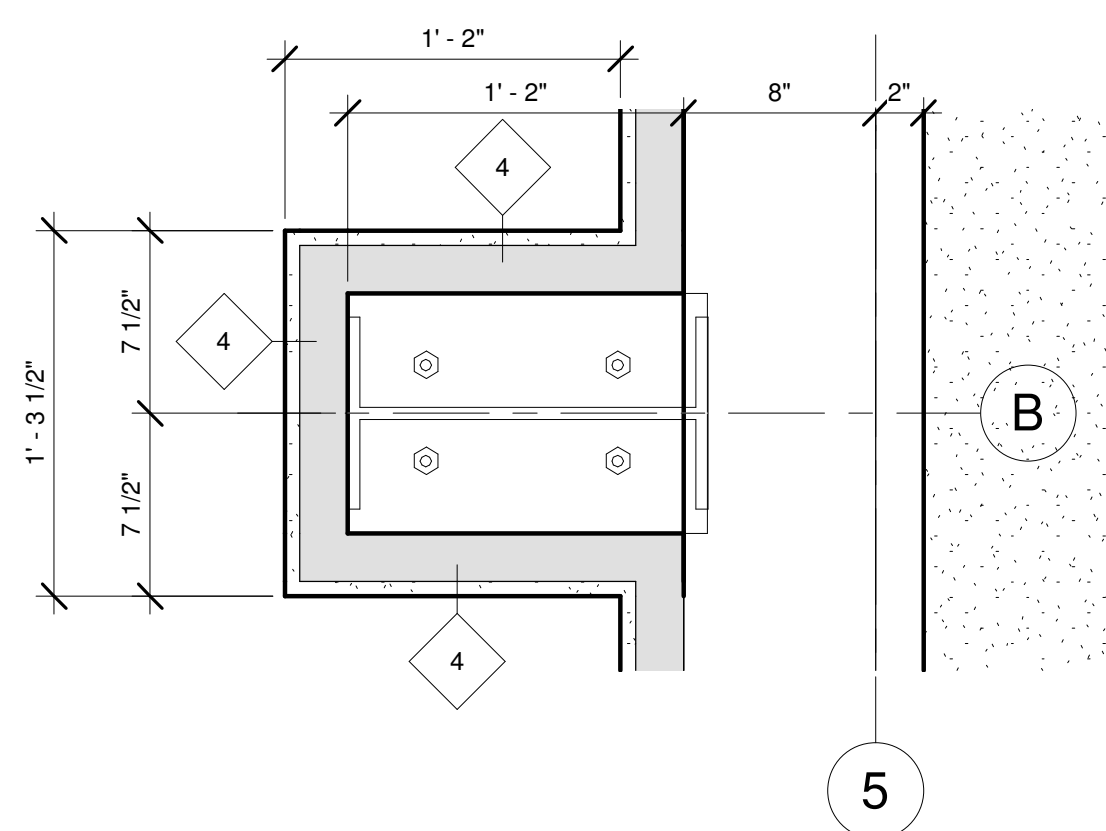


7 TYPICAL BOXED COLUMN @ GRID LINE  
B-5, F-5, C-1, E-1  
1 1/2" = 1'-0"

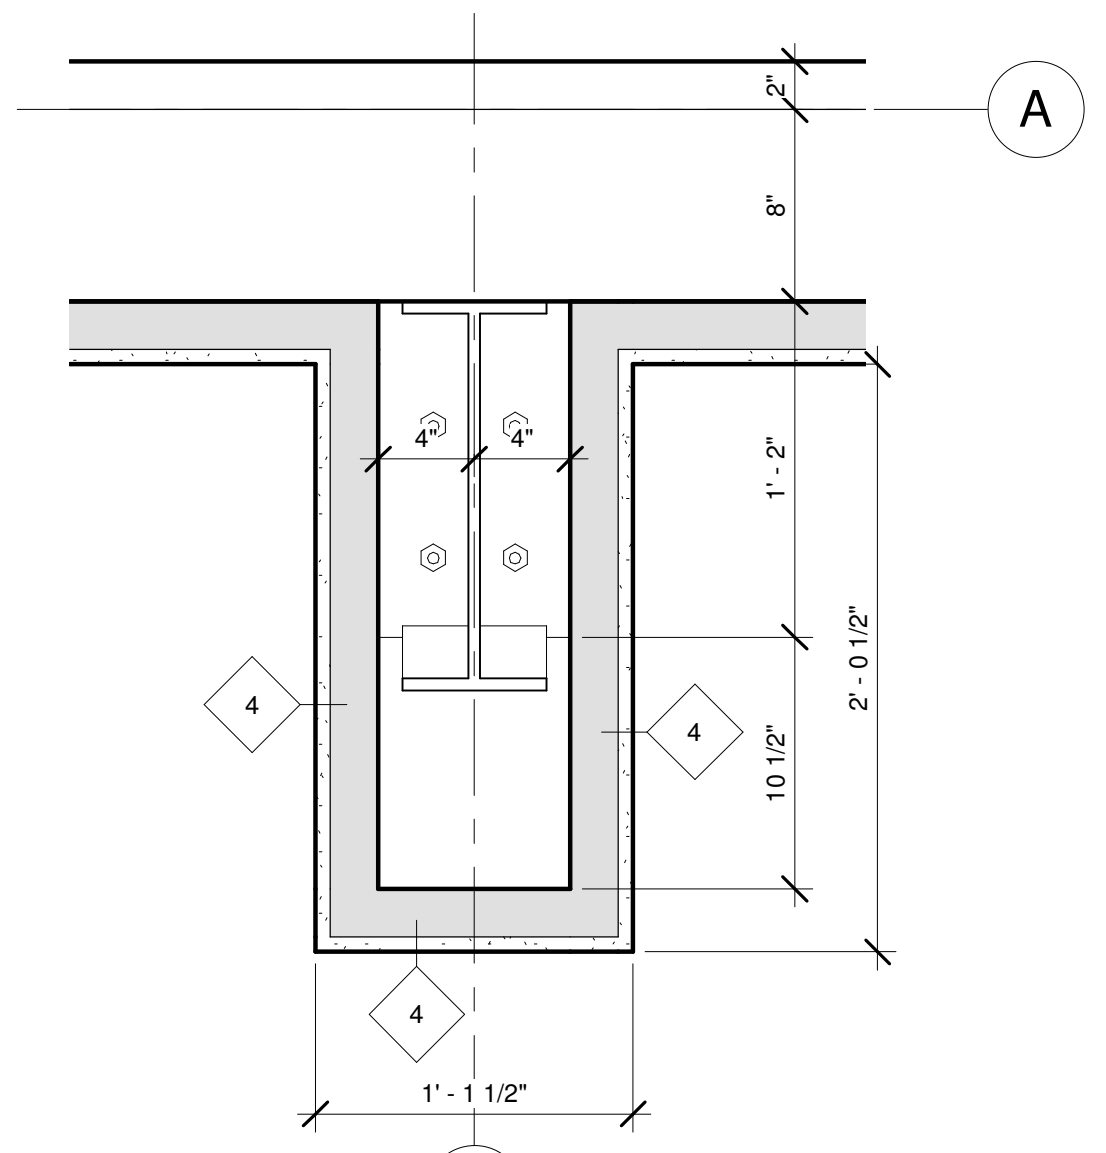




4 TYPICAL BOXED COLUMN @ GRID LINE  
A-2, A-3, A-4, G-2, G-3, G-4  
1 1/2" = 1'-0"

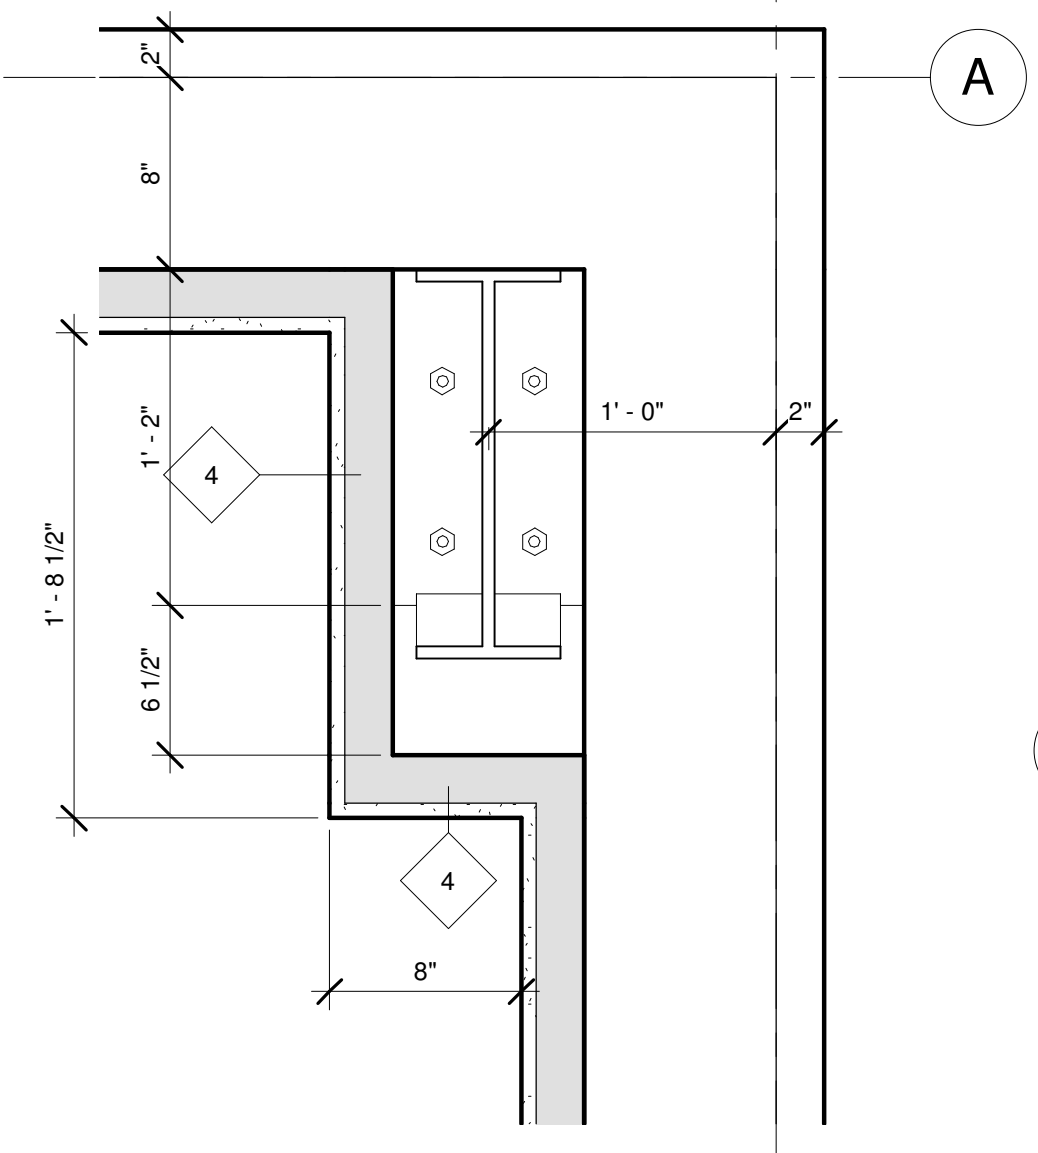




5 TYPICAL BOXED COLUMN @ GRID LINE  
A-5, G-5  
1 1/2" = 1'-0"

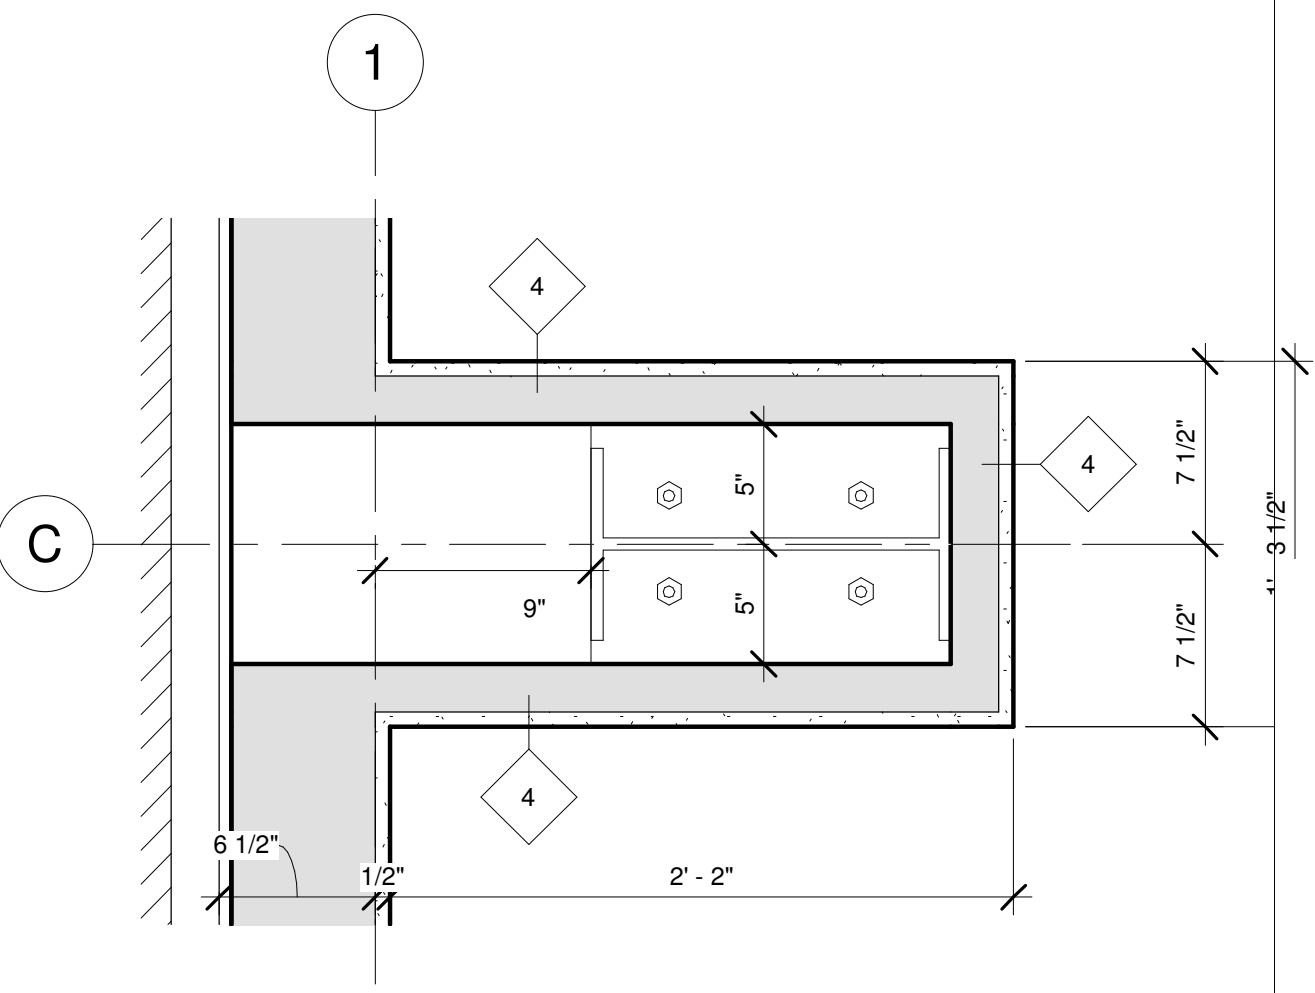


8 TYPICAL BOXED COLUMN @ GRID LINE  
C-1  
1 1/2" = 1'-0"

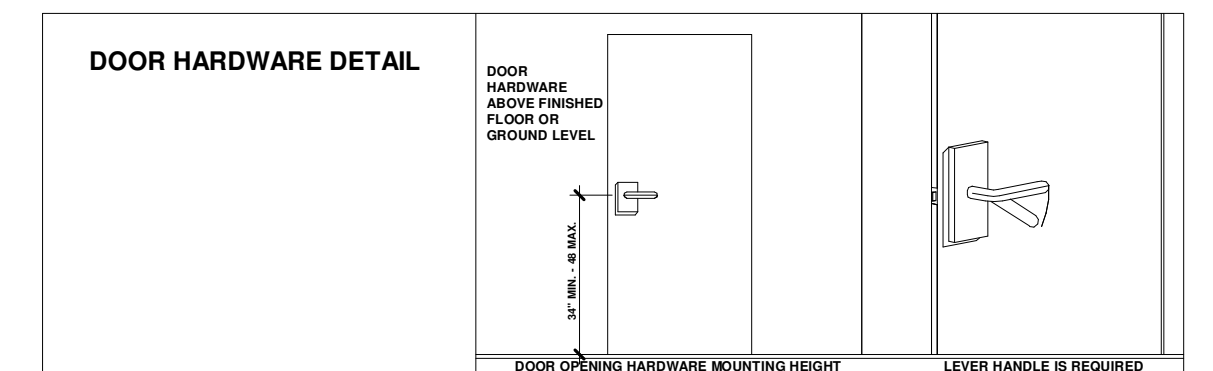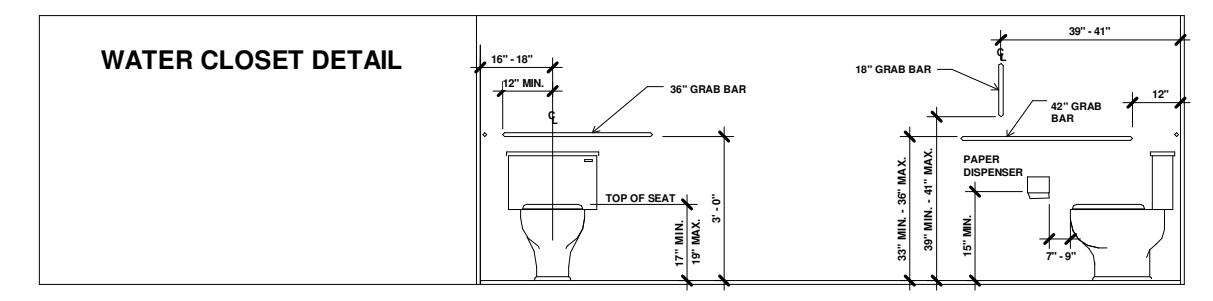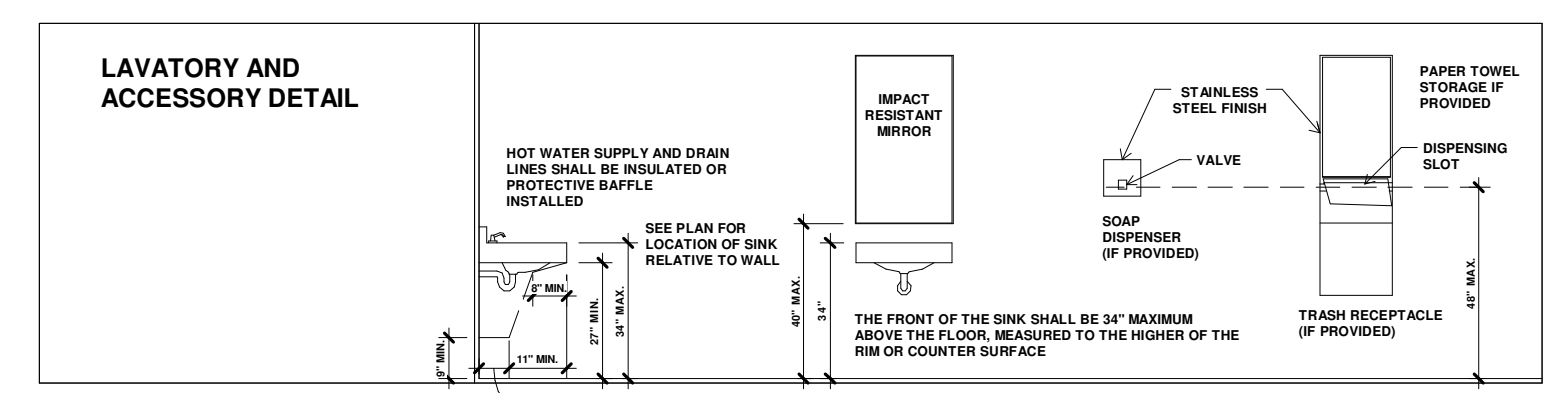


2 ACCESSIBILITY DETAILS  
1/4" = 1'-0"

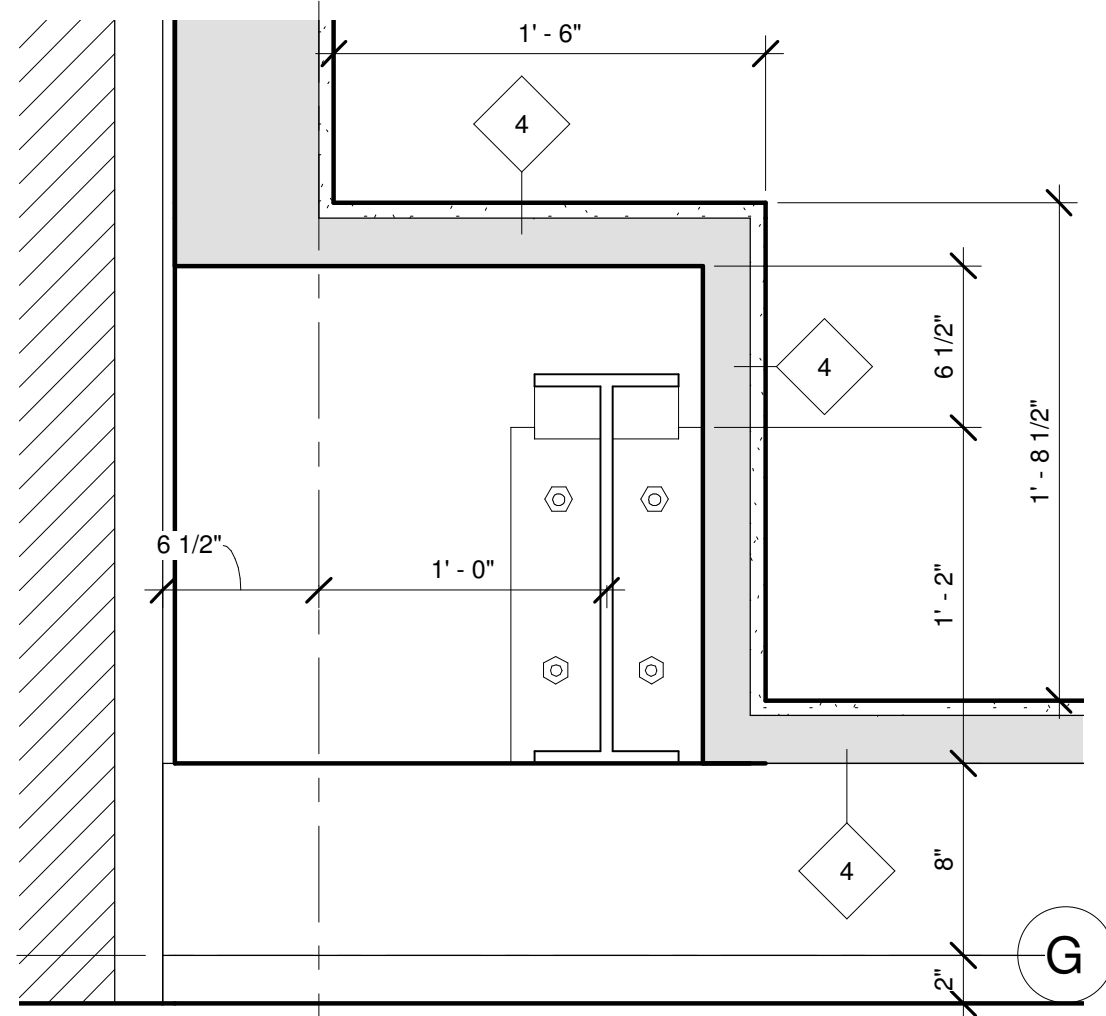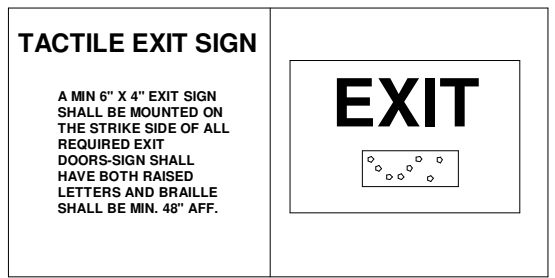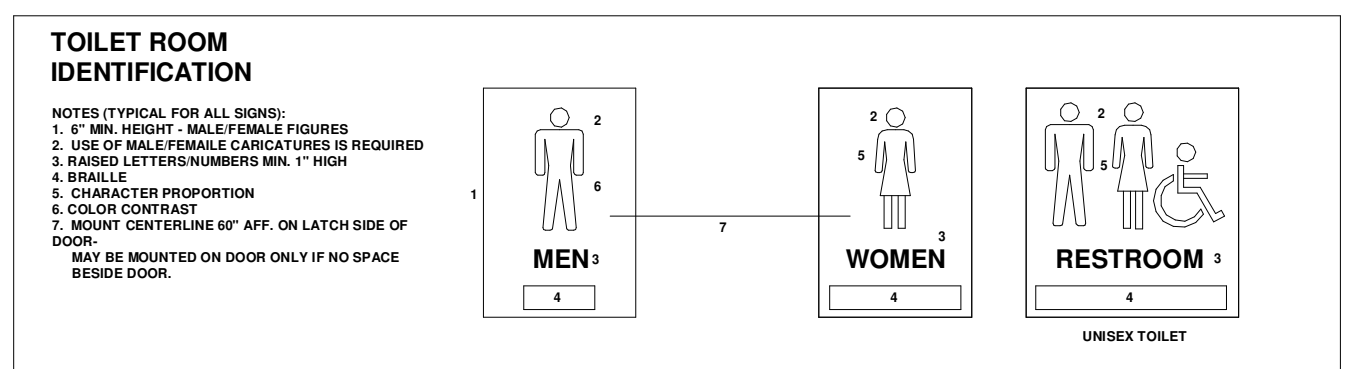

6 TYPICAL BOXED COLUMN @ GRID LINE  
A-1, G-1  
1 1/2" = 1'-0"

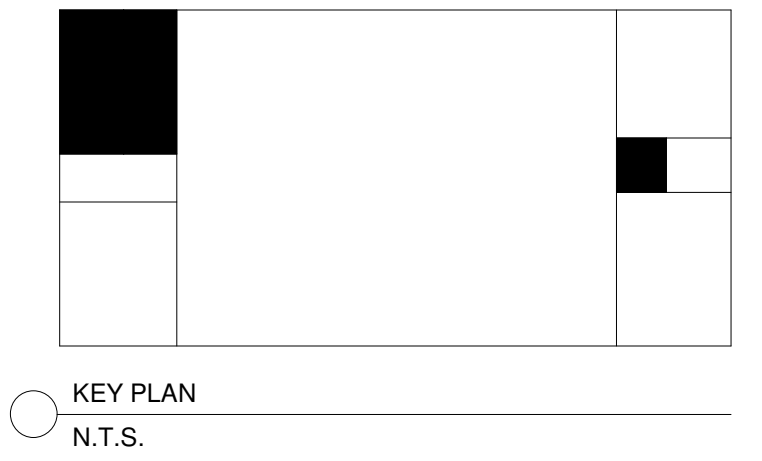

KEY PLAN  
N.T.S.

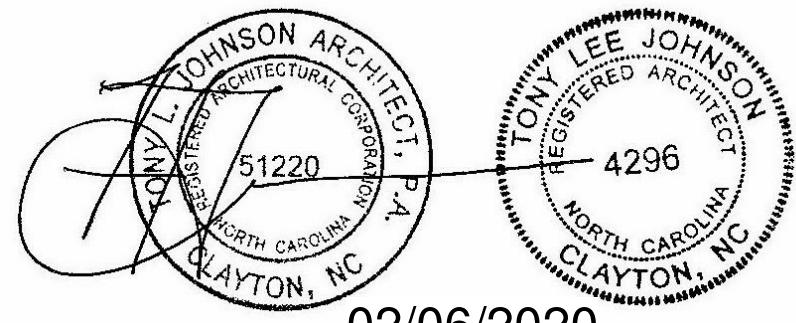

02/06/2020

NEILL'S CREEK BAPTIST CHURCH  
FELLOWSHIP HALL  
ANGIER, NORTH CAROLINA

919-550-7717  
TONY@TONYJOHNSONARCHITECT.COM  
104 N. LOMBARD ST.  
CLAYTON, NC 27520  
TONYJOHNSONARCHITECT.COM




DATE 02-06-2020


SHEET

A-3


NOTE:  
REFER TO STRUCTURAL PEMB  
DRAWINGS FOR GIRTS HEIGHTS  
@ DIFFERENT WALLS

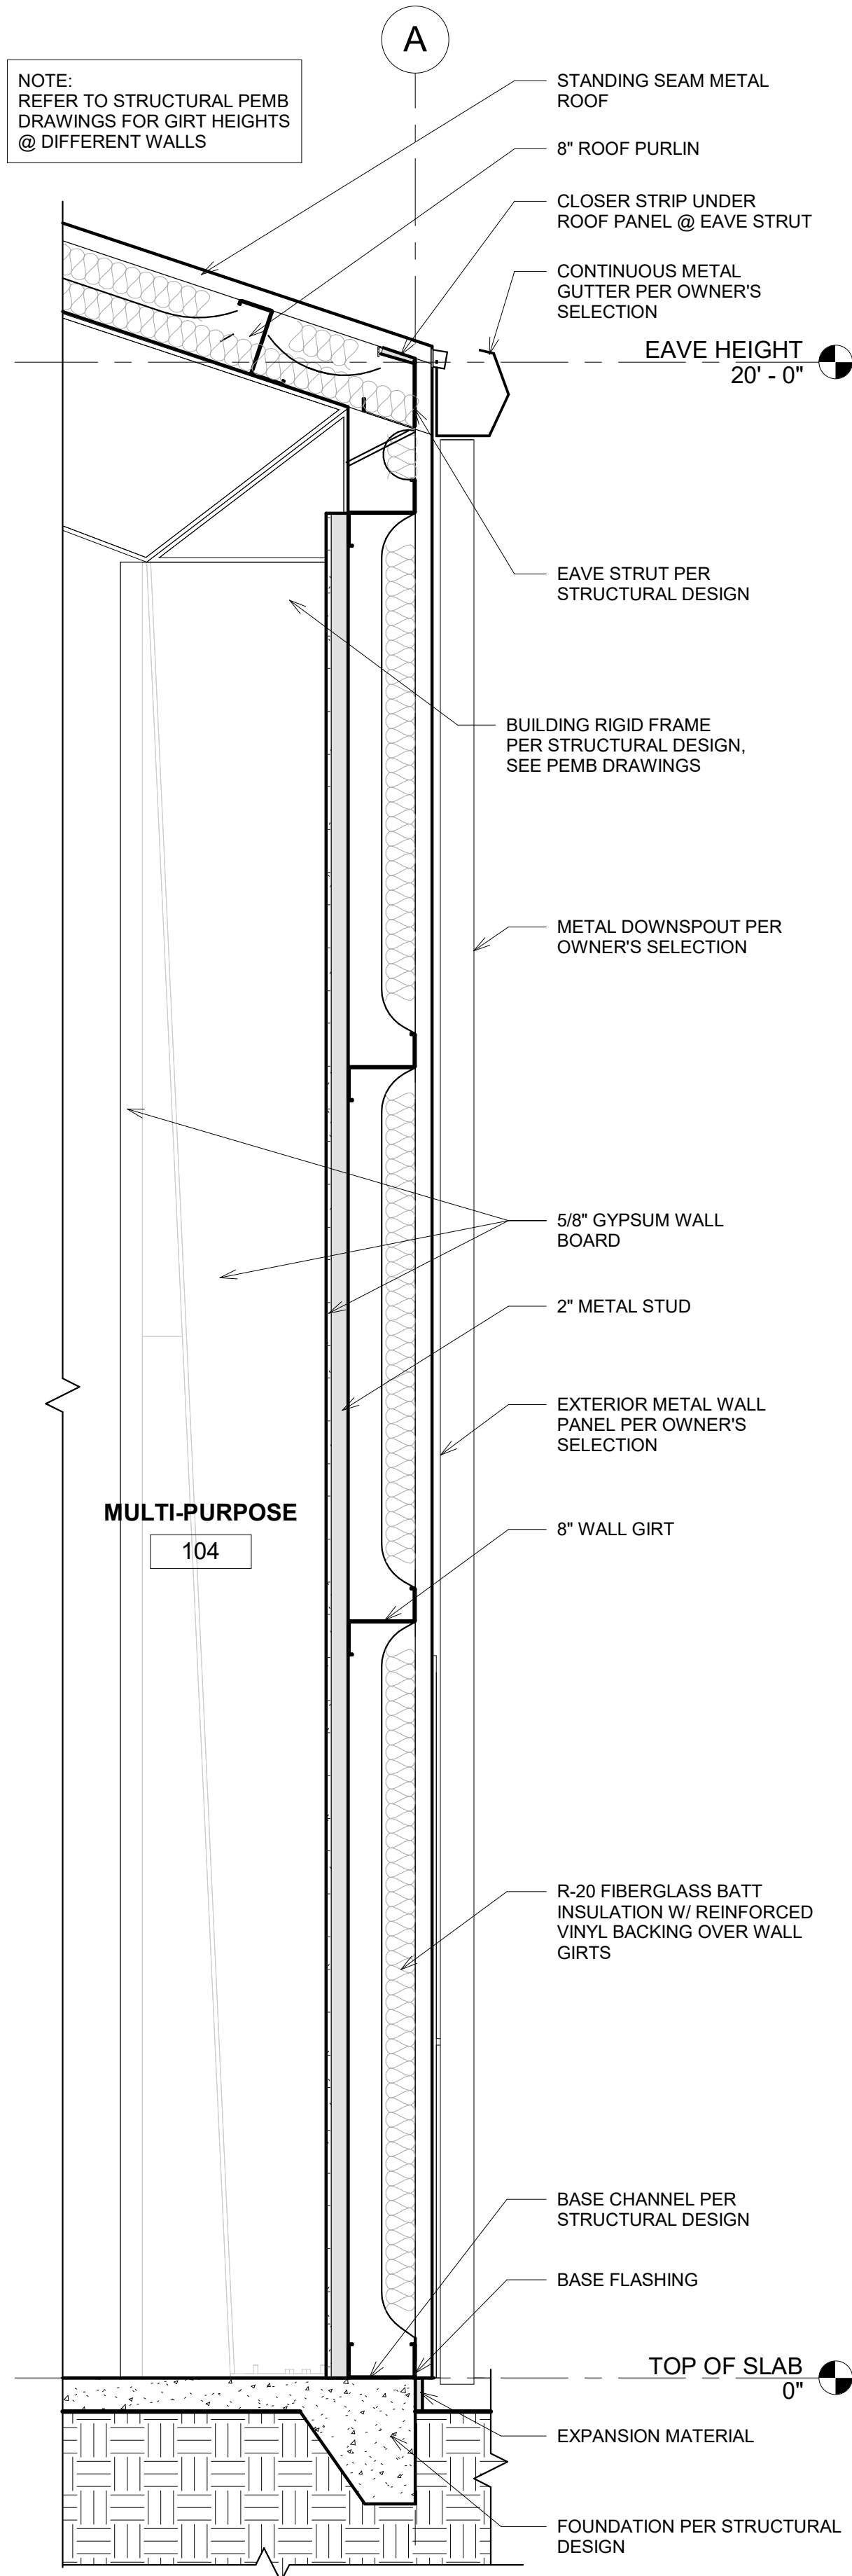

2 TYPICAL ENLARGED WALL SECTION @  
GRID LINE A  
3/4" = 1'-0"

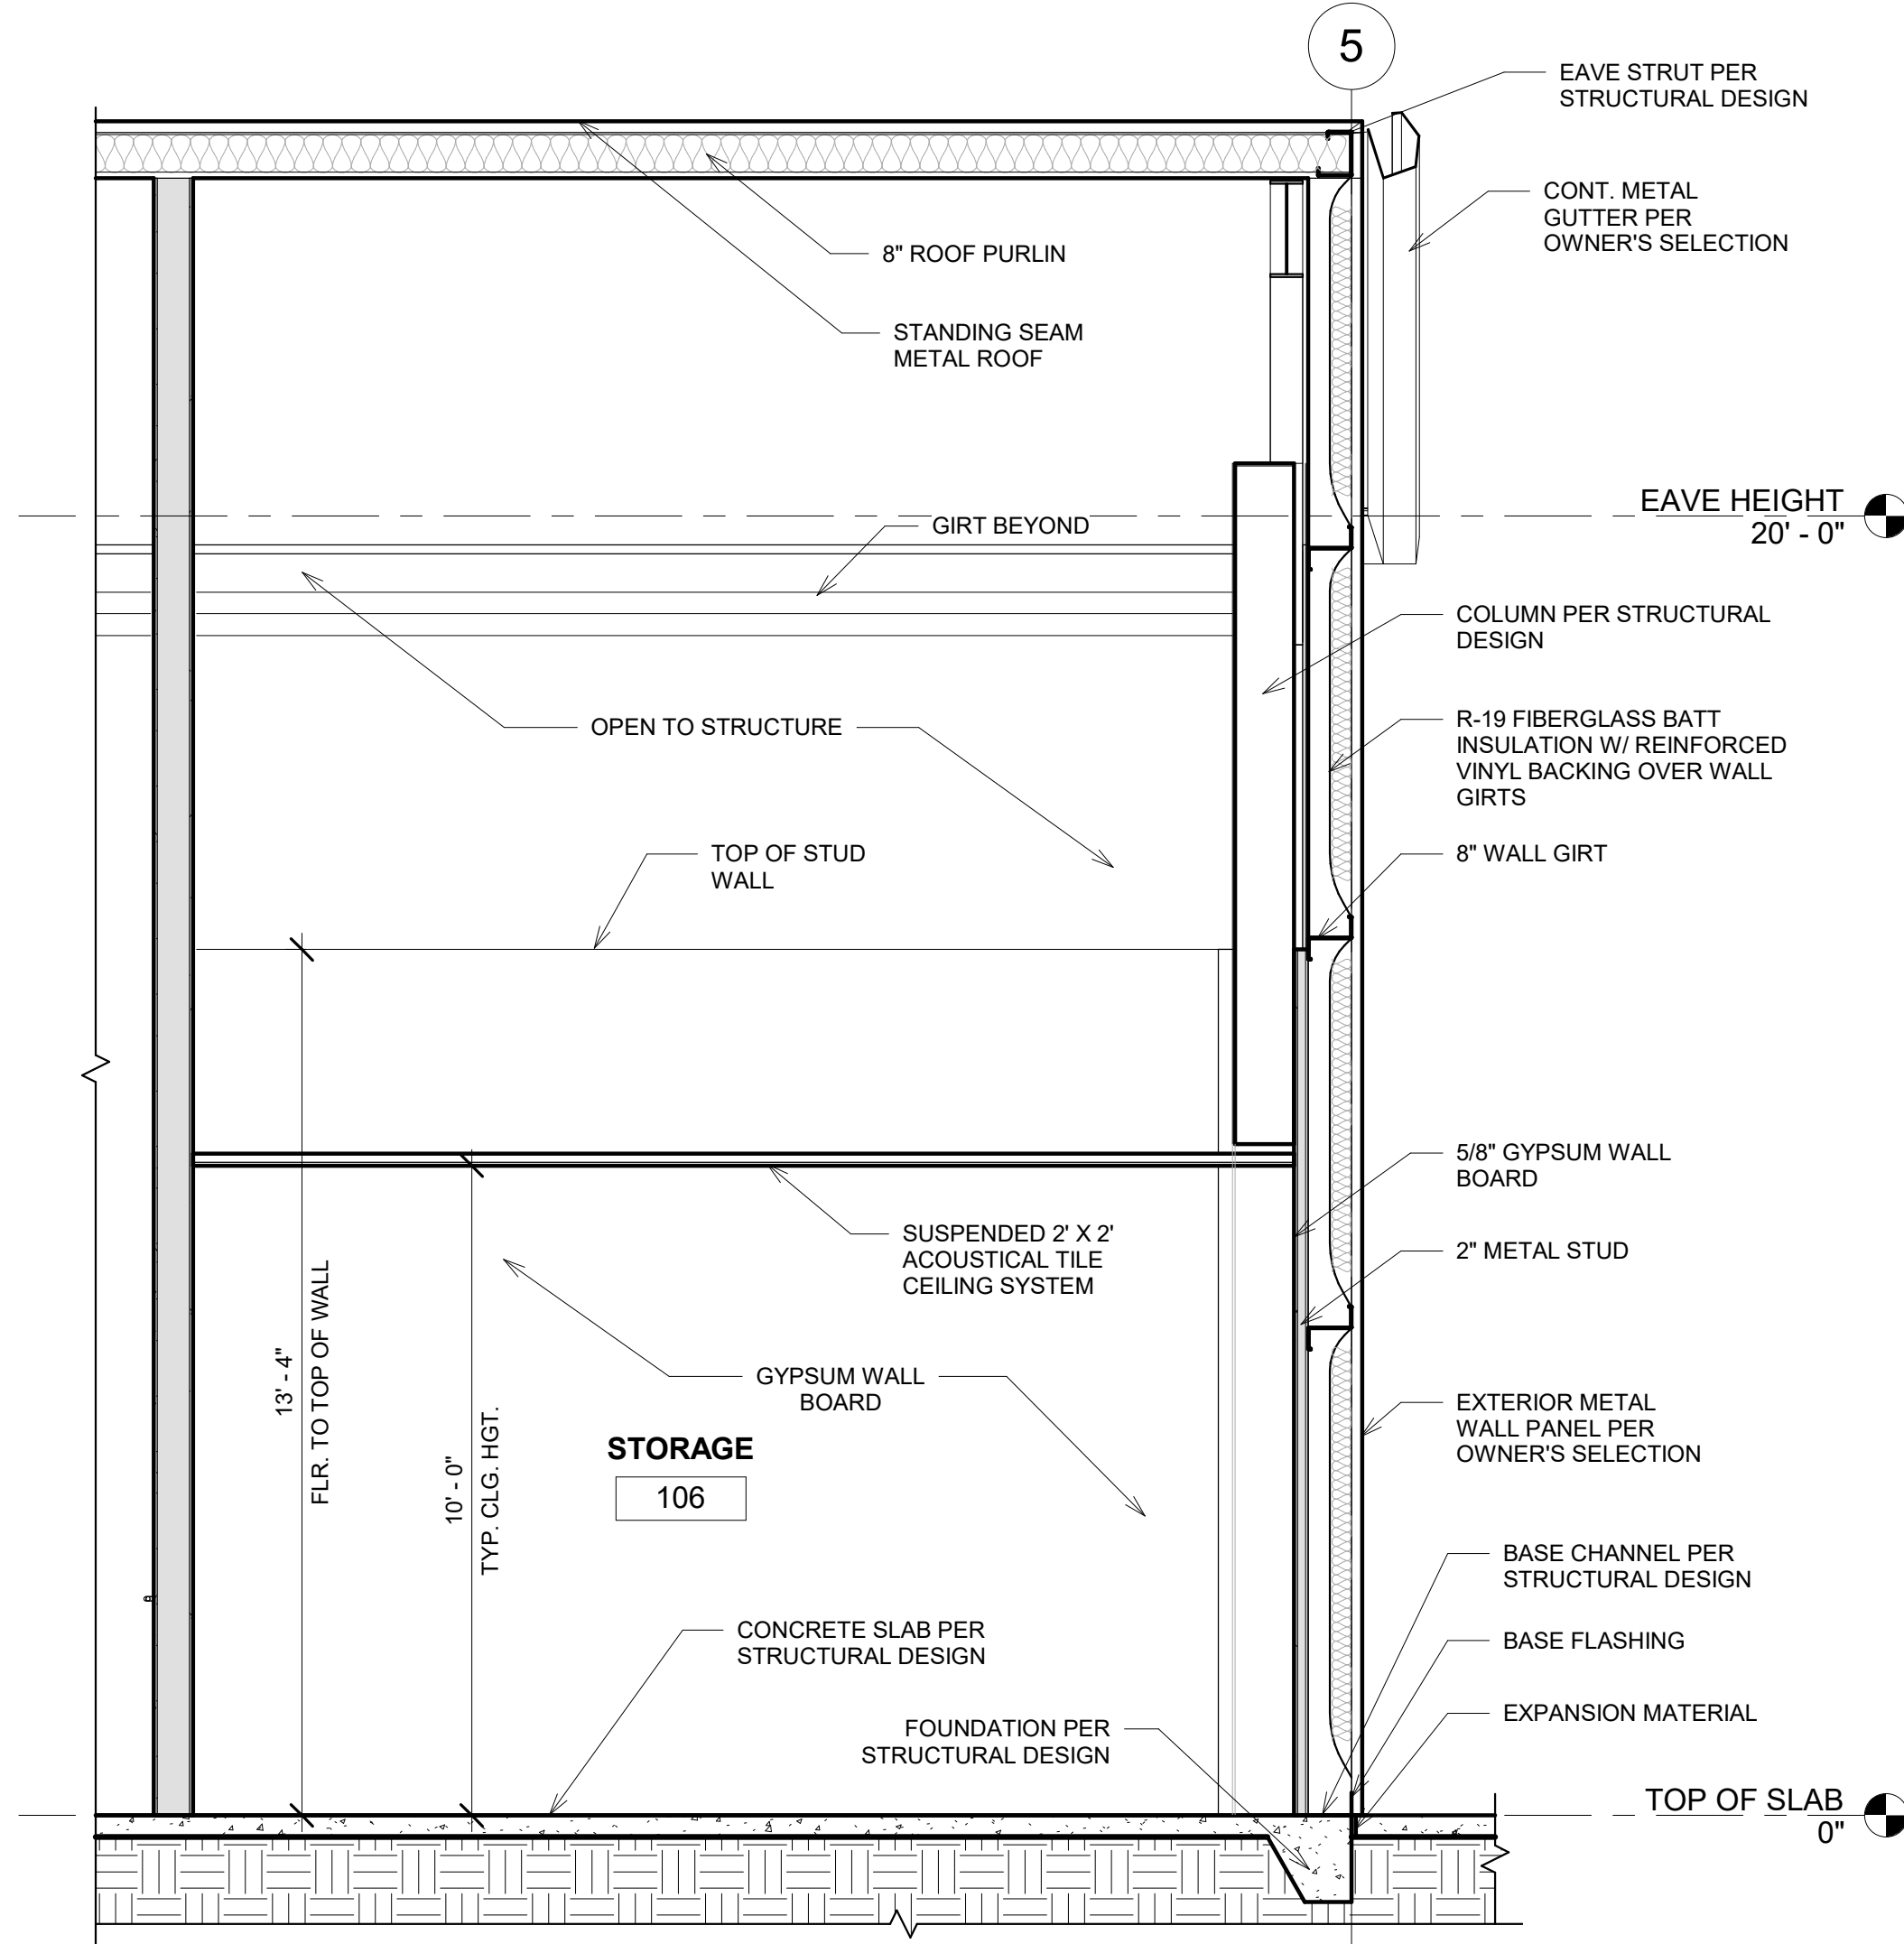

3 TYPICAL SECTION @ GRID LINE 5  
3/8" = 1'-0"

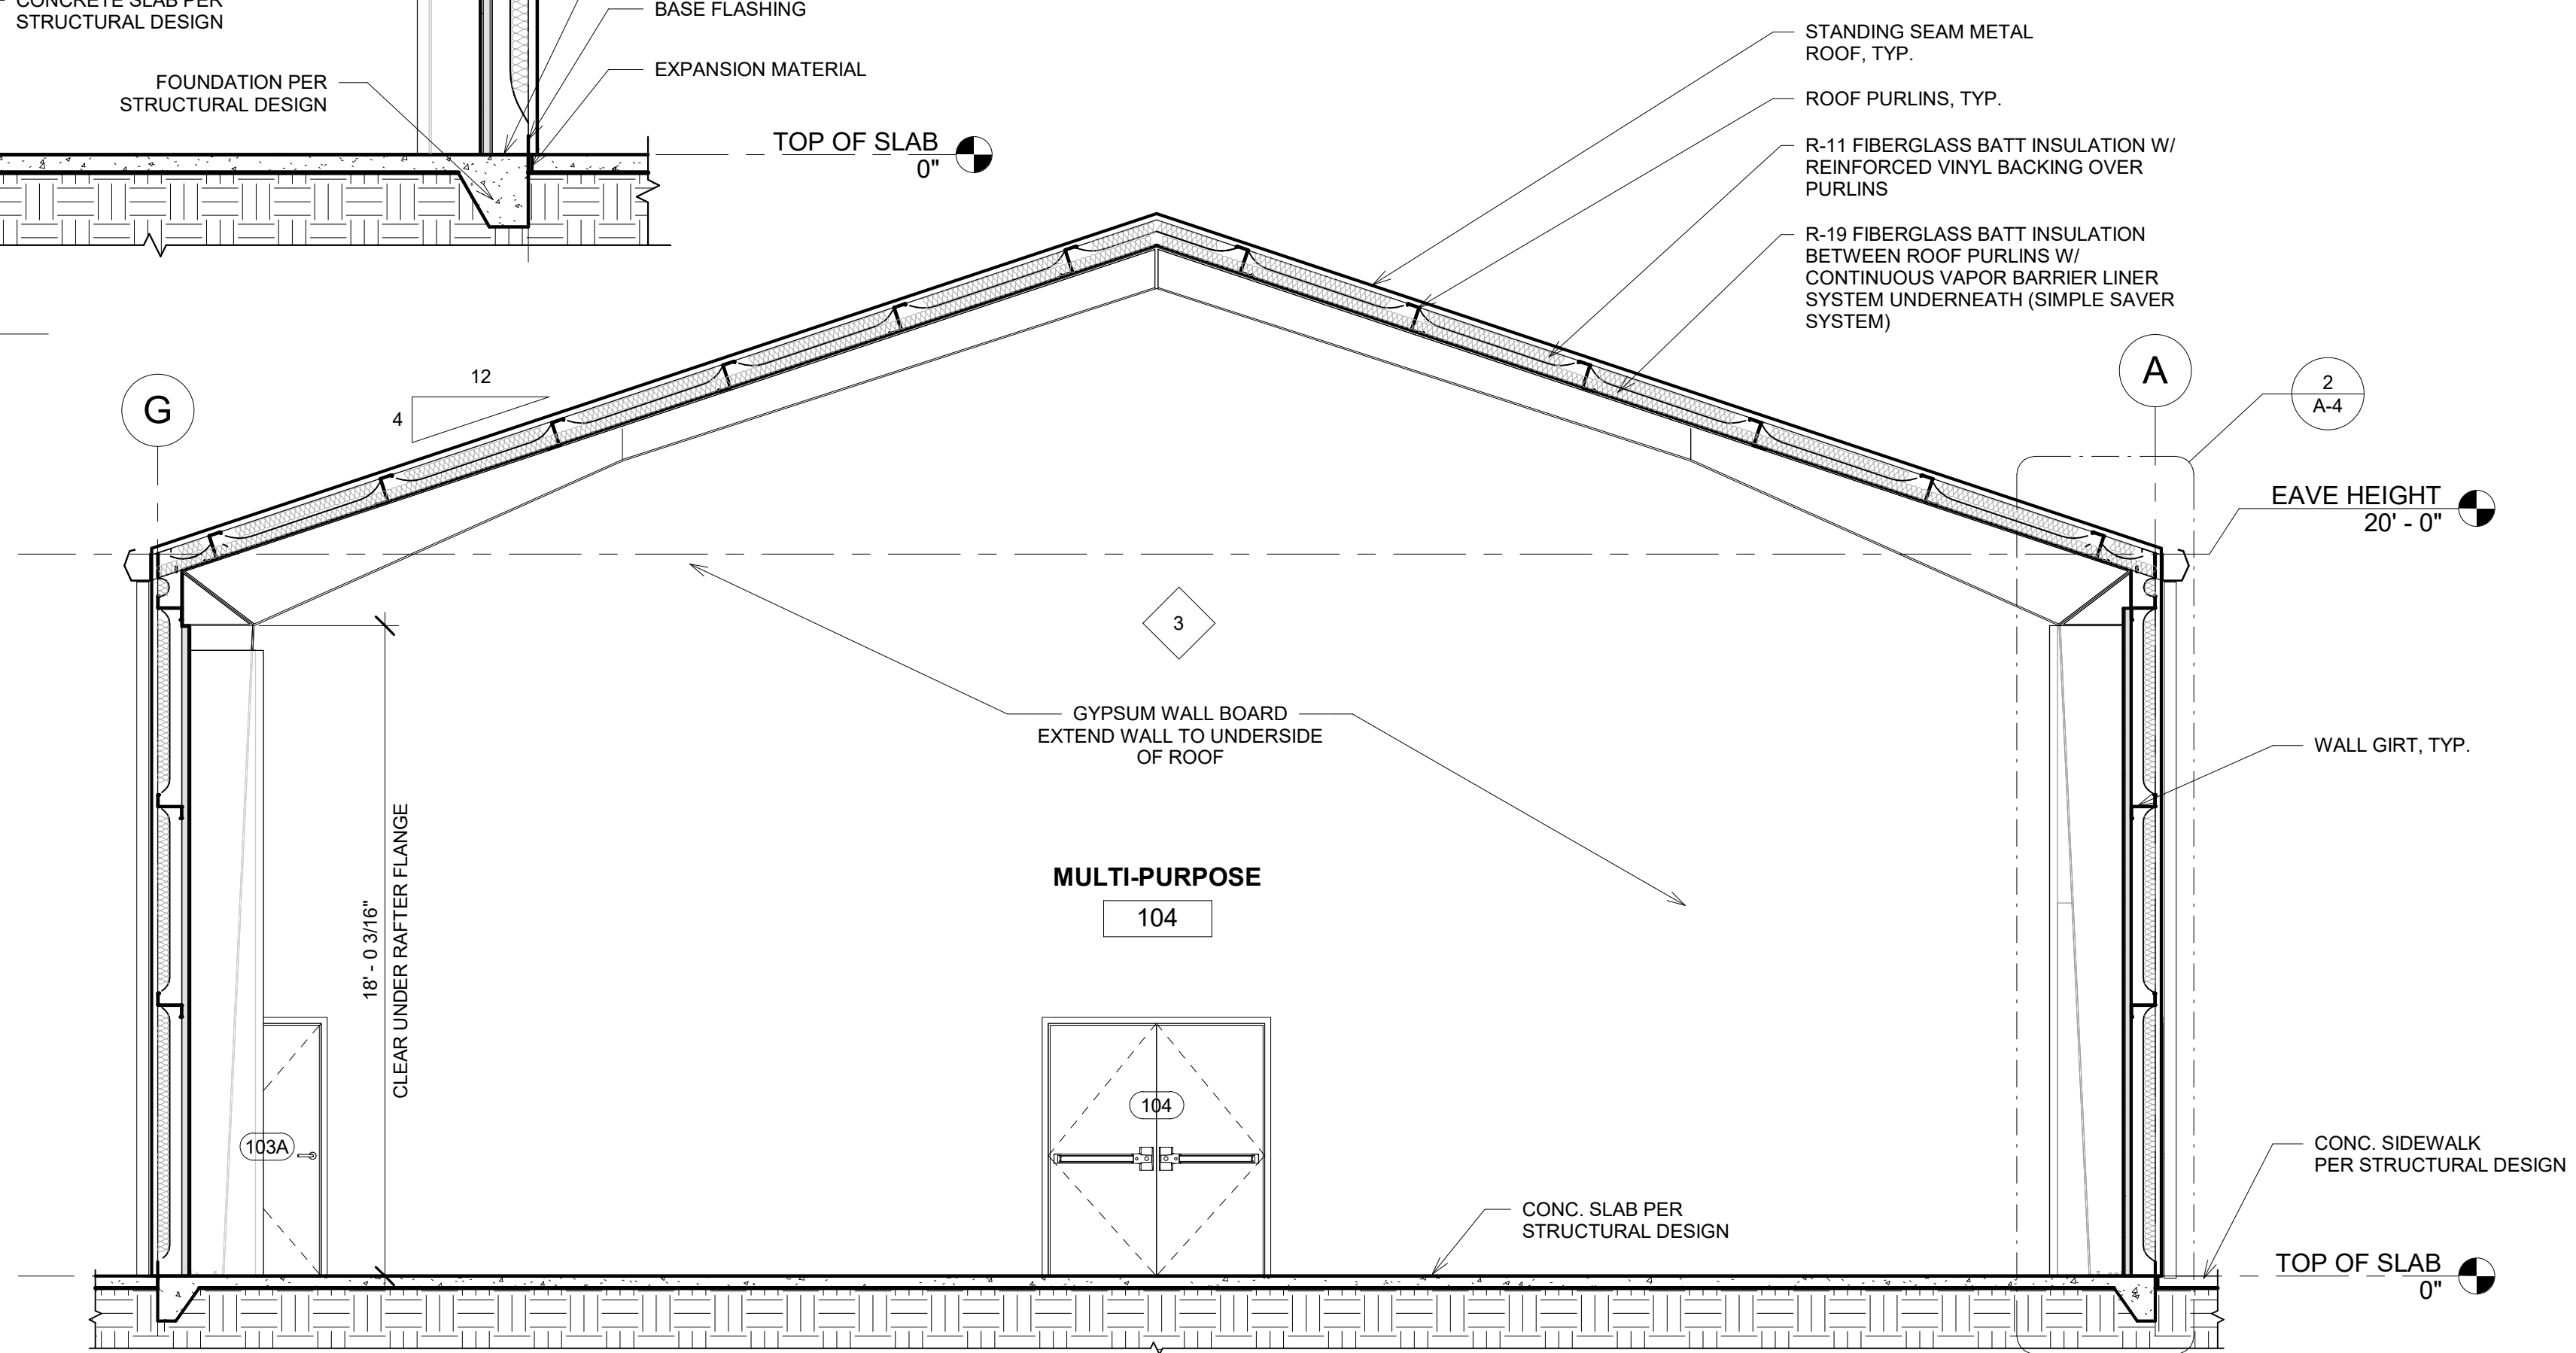

1 CROSS SECTION @ GRID LINE 2  
1/4" = 1'-0"

TONY JOHNSON ARCHITECT  
51220  
NORTH CAROLINA  
CLAYTON, NC

TONY LEE JOHNSON  
REGISTERED ARCHITECT  
4296  
NORTH CAROLINA  
CLAYTON, NC

02/06/2020

REVISIONS


NEILL'S CREEK BAPTIST CHURCH  
FELLOWSHIP HALL  
ANGIER, NORTH CAROLINA

919-550-7717  
TONY@TONYJOHNSONARCHITECT.COM  
104 N. LOMBARD ST.  
CLAYTON, NC 27520  
TONYJOHNSONARCHITECT.COM

TONY  
JOHNSON  
ARCHITECT

DATE 02-06-2020

SHEET

A-4

NO.	DESCRIPTION

**NEILL'S CREEK BAPTIST CHURCH  
FELLOWSHIP HALL  
ANGIER, NORTH CAROLINA**


919-550-7717  
TONY@TONYJOHNSONARCHITECT.COM  
104 N. LOMBARD ST.  
CLAYTON, NC 27520  
TONYJOHNSONARCHITECT.COM




DATE 02-06-2020

SHEET


**A-5**

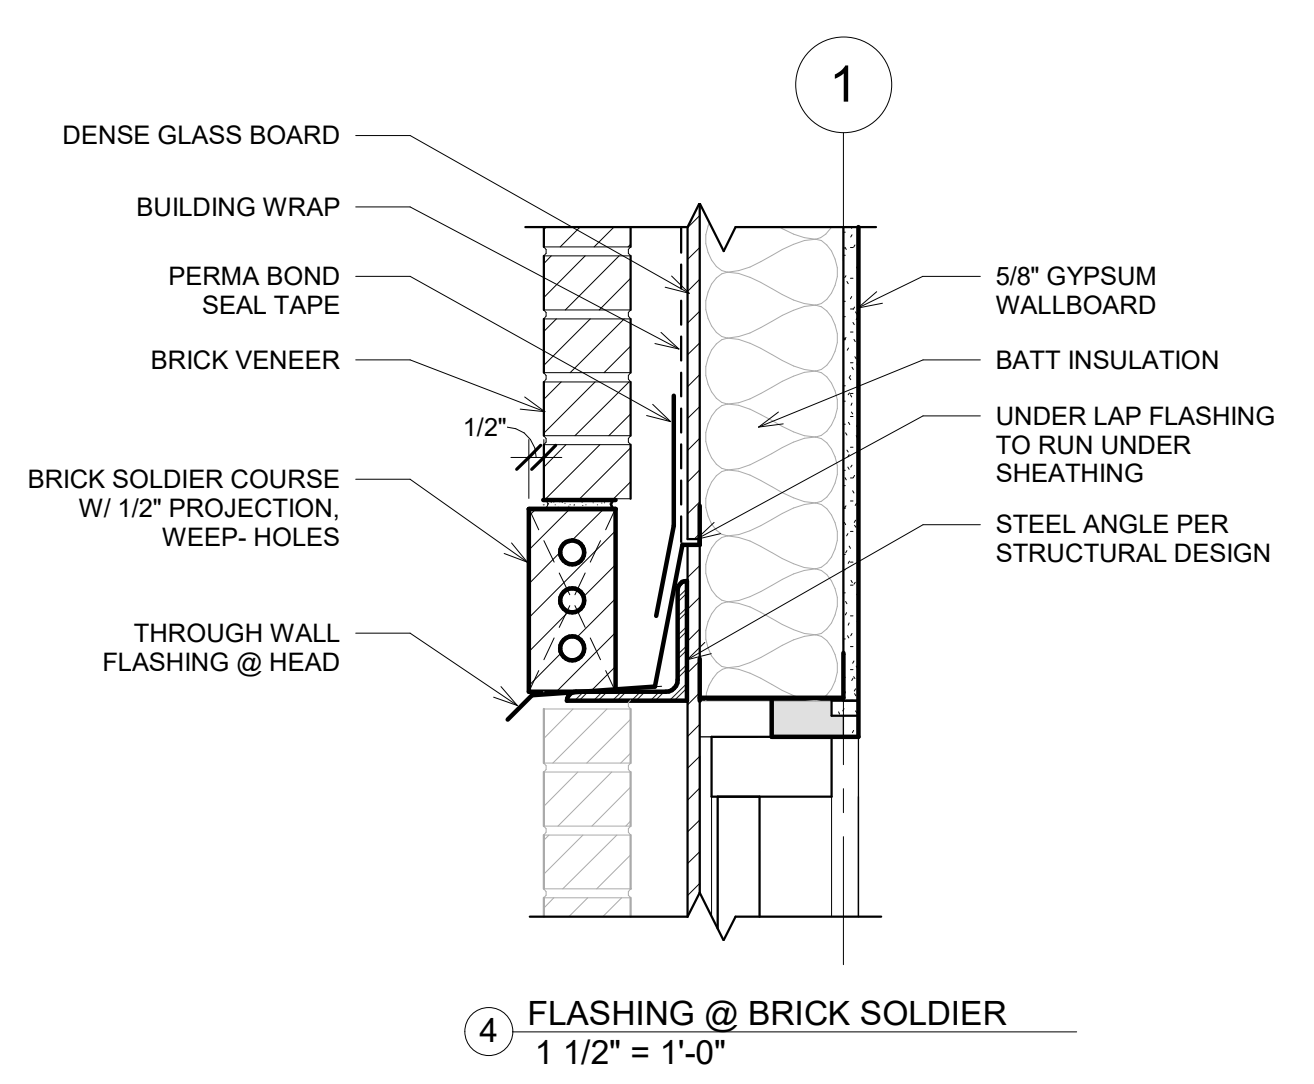


**4 FLASHING @ BRICK SOLDIER**  
1 1/2" = 1'-0"

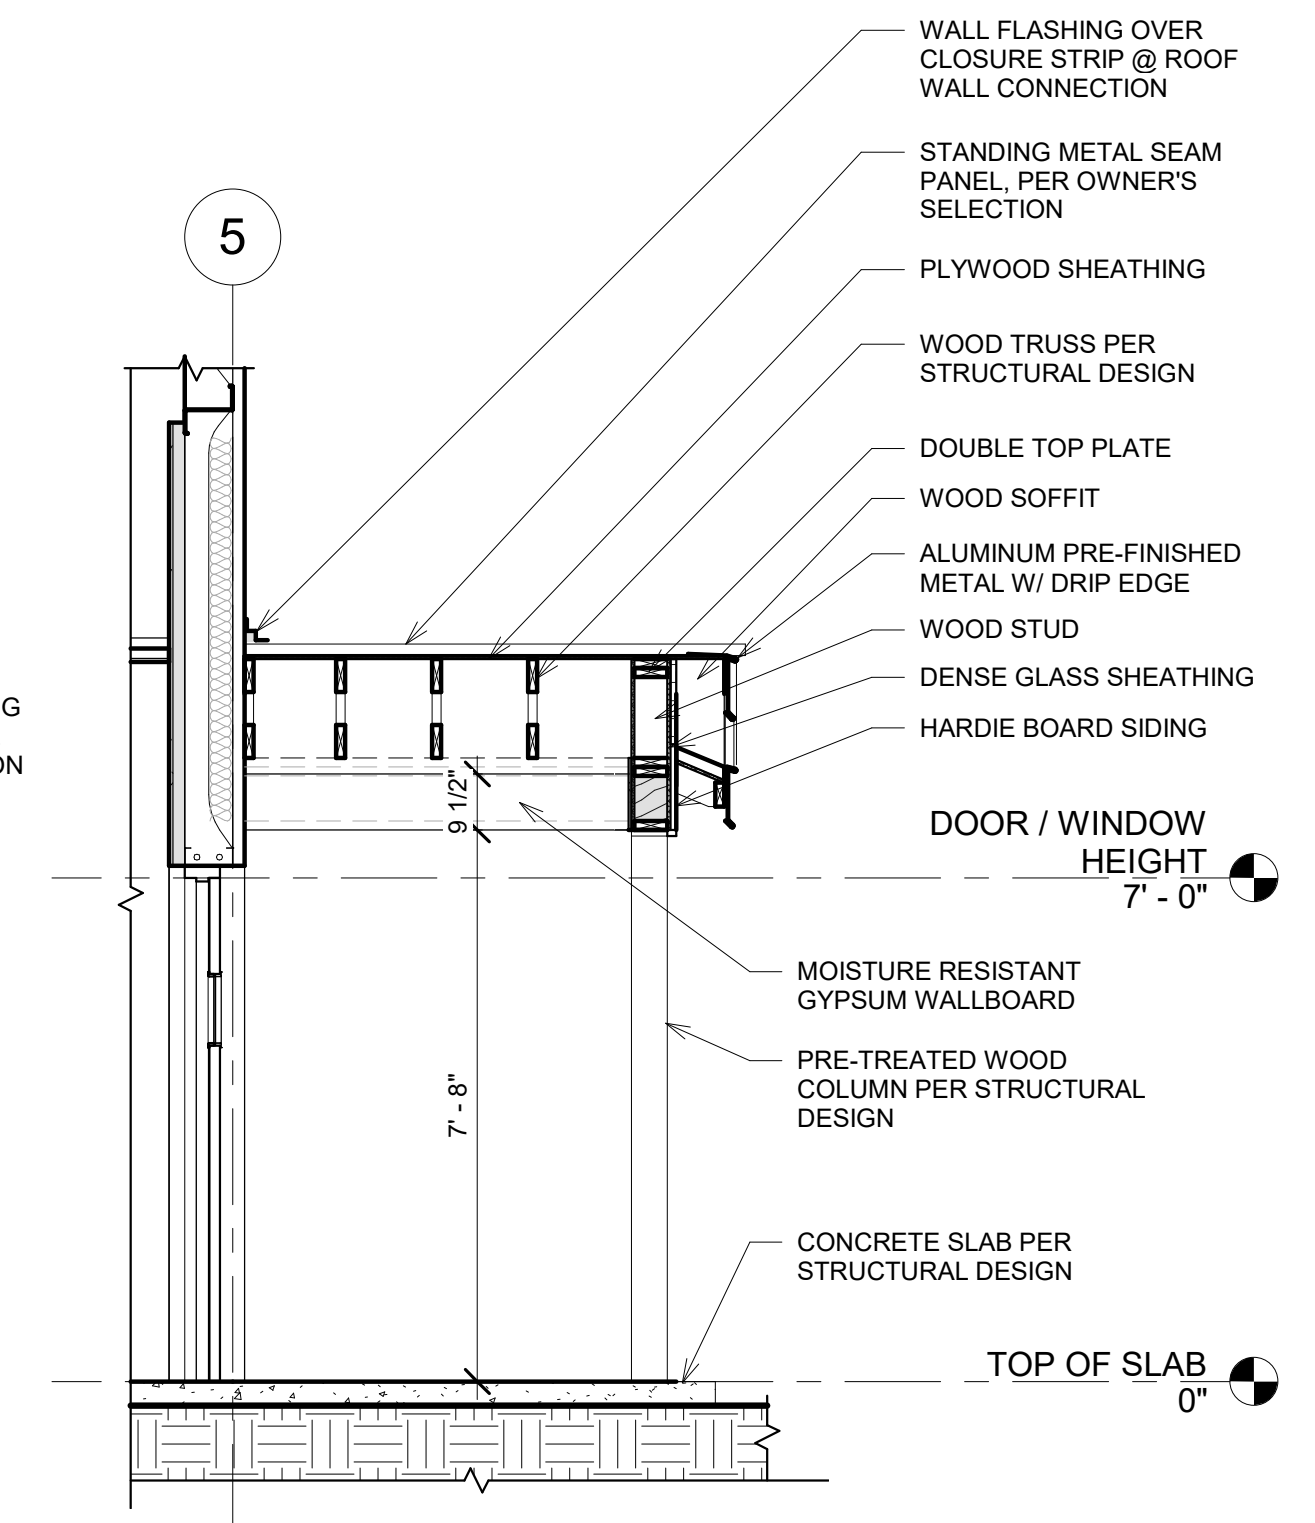


**5 SECTION @ REAR CANOPY**  
3/8" = 1'-0"

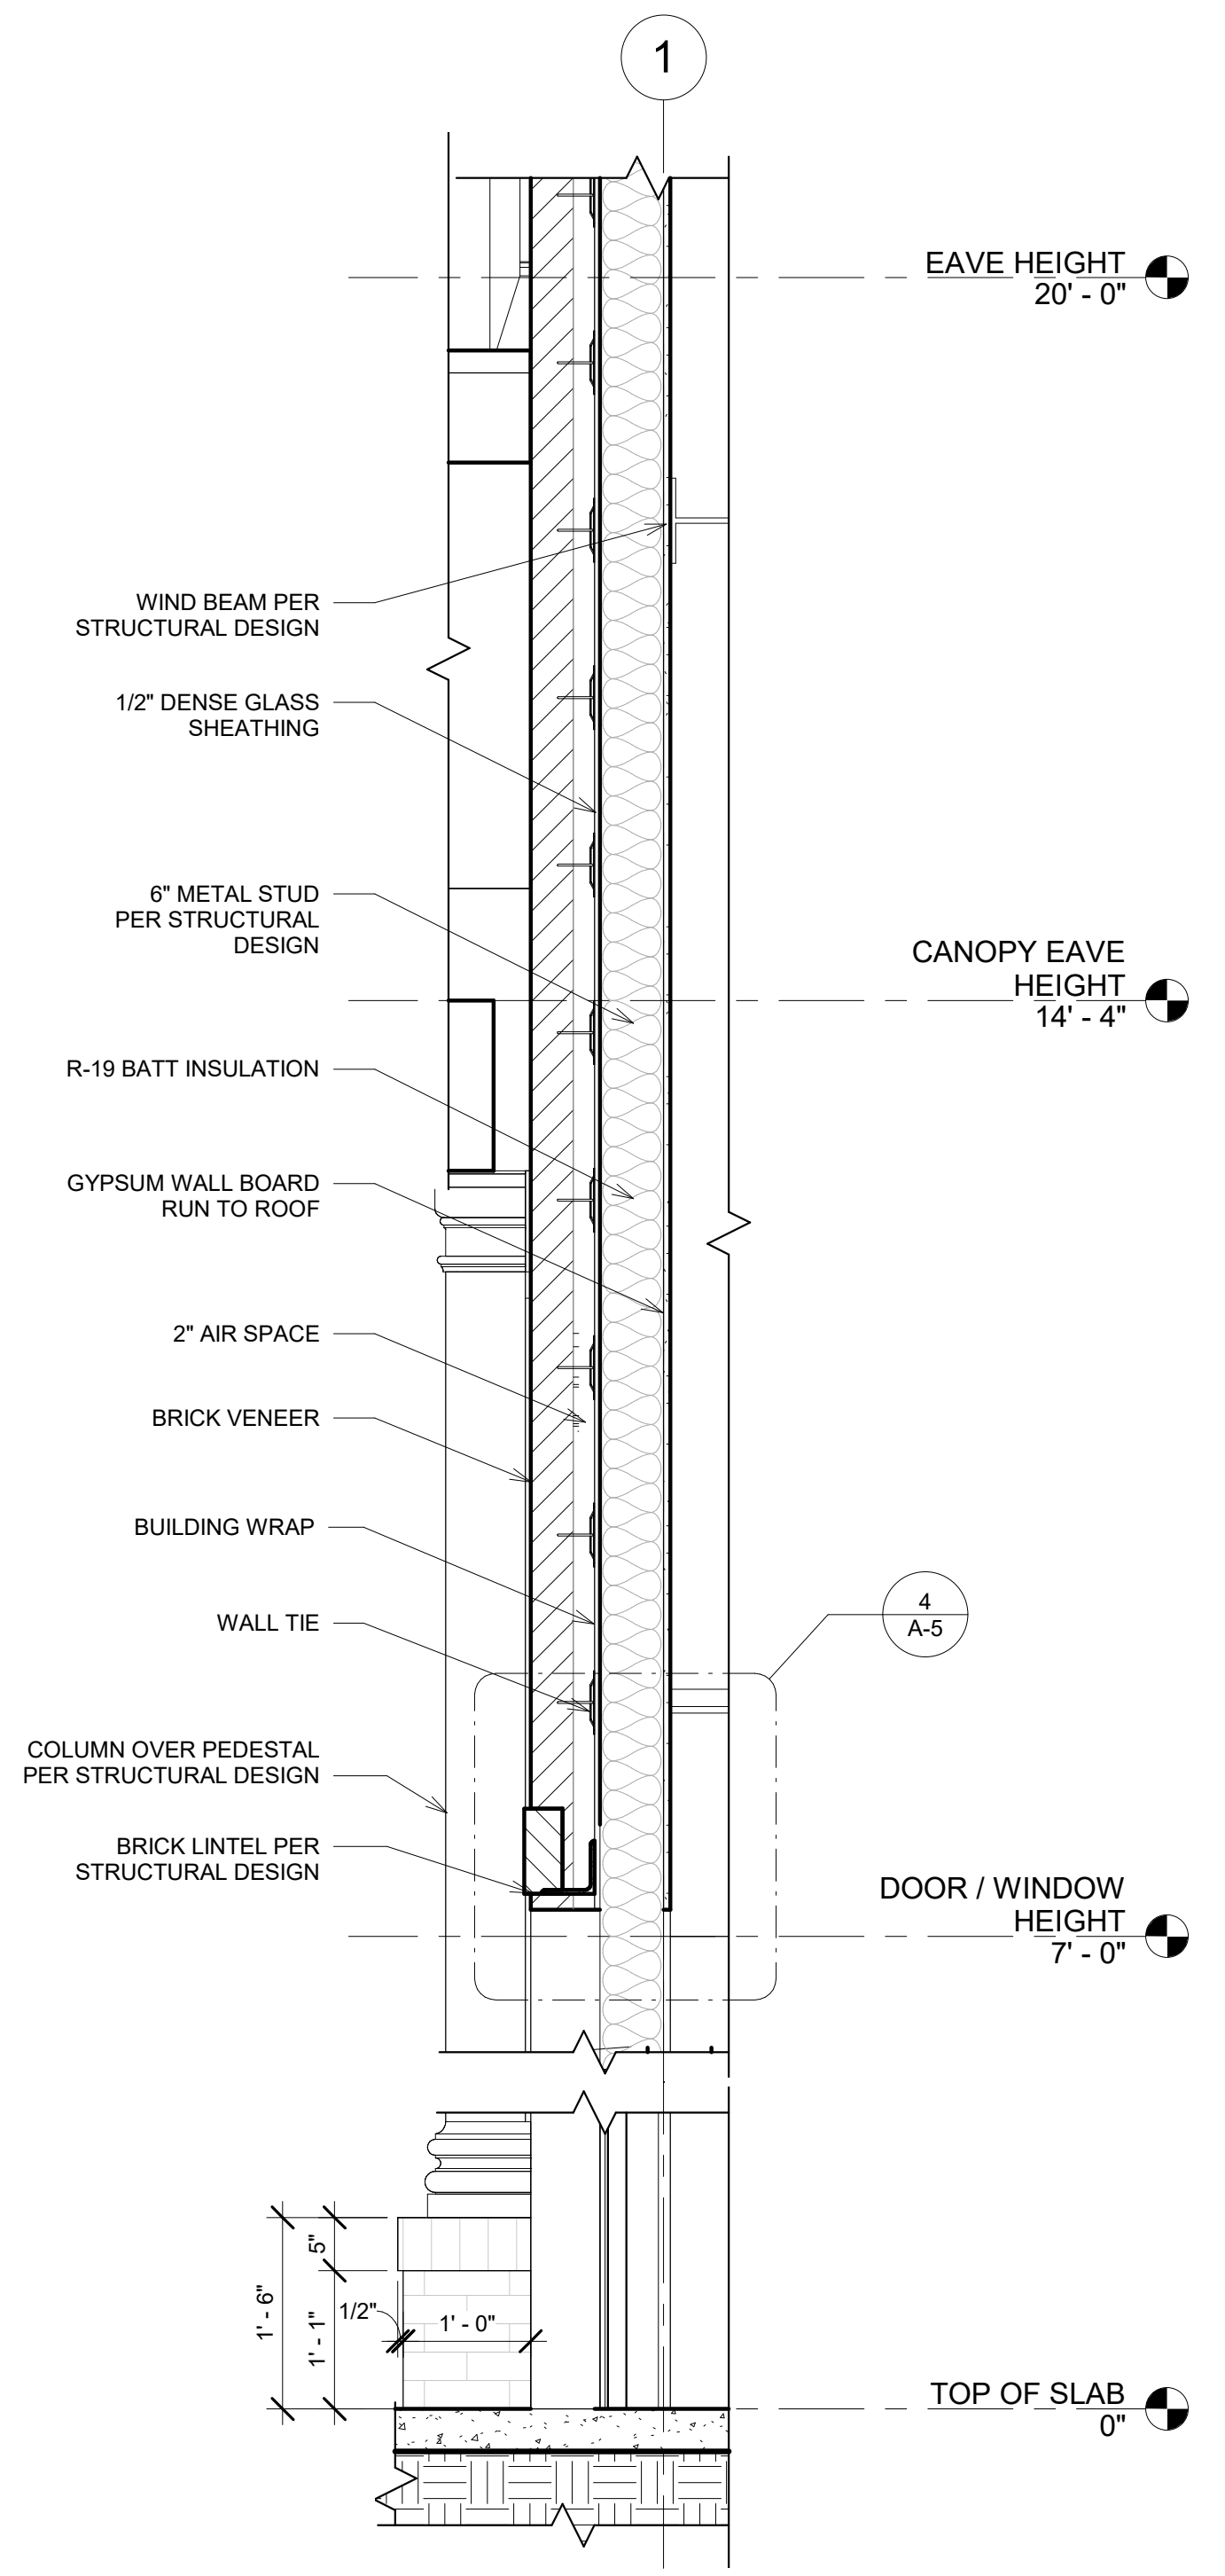

**2 ENLARGED SECTION @ GRID LINE 1**  
3/4" = 1'-0"

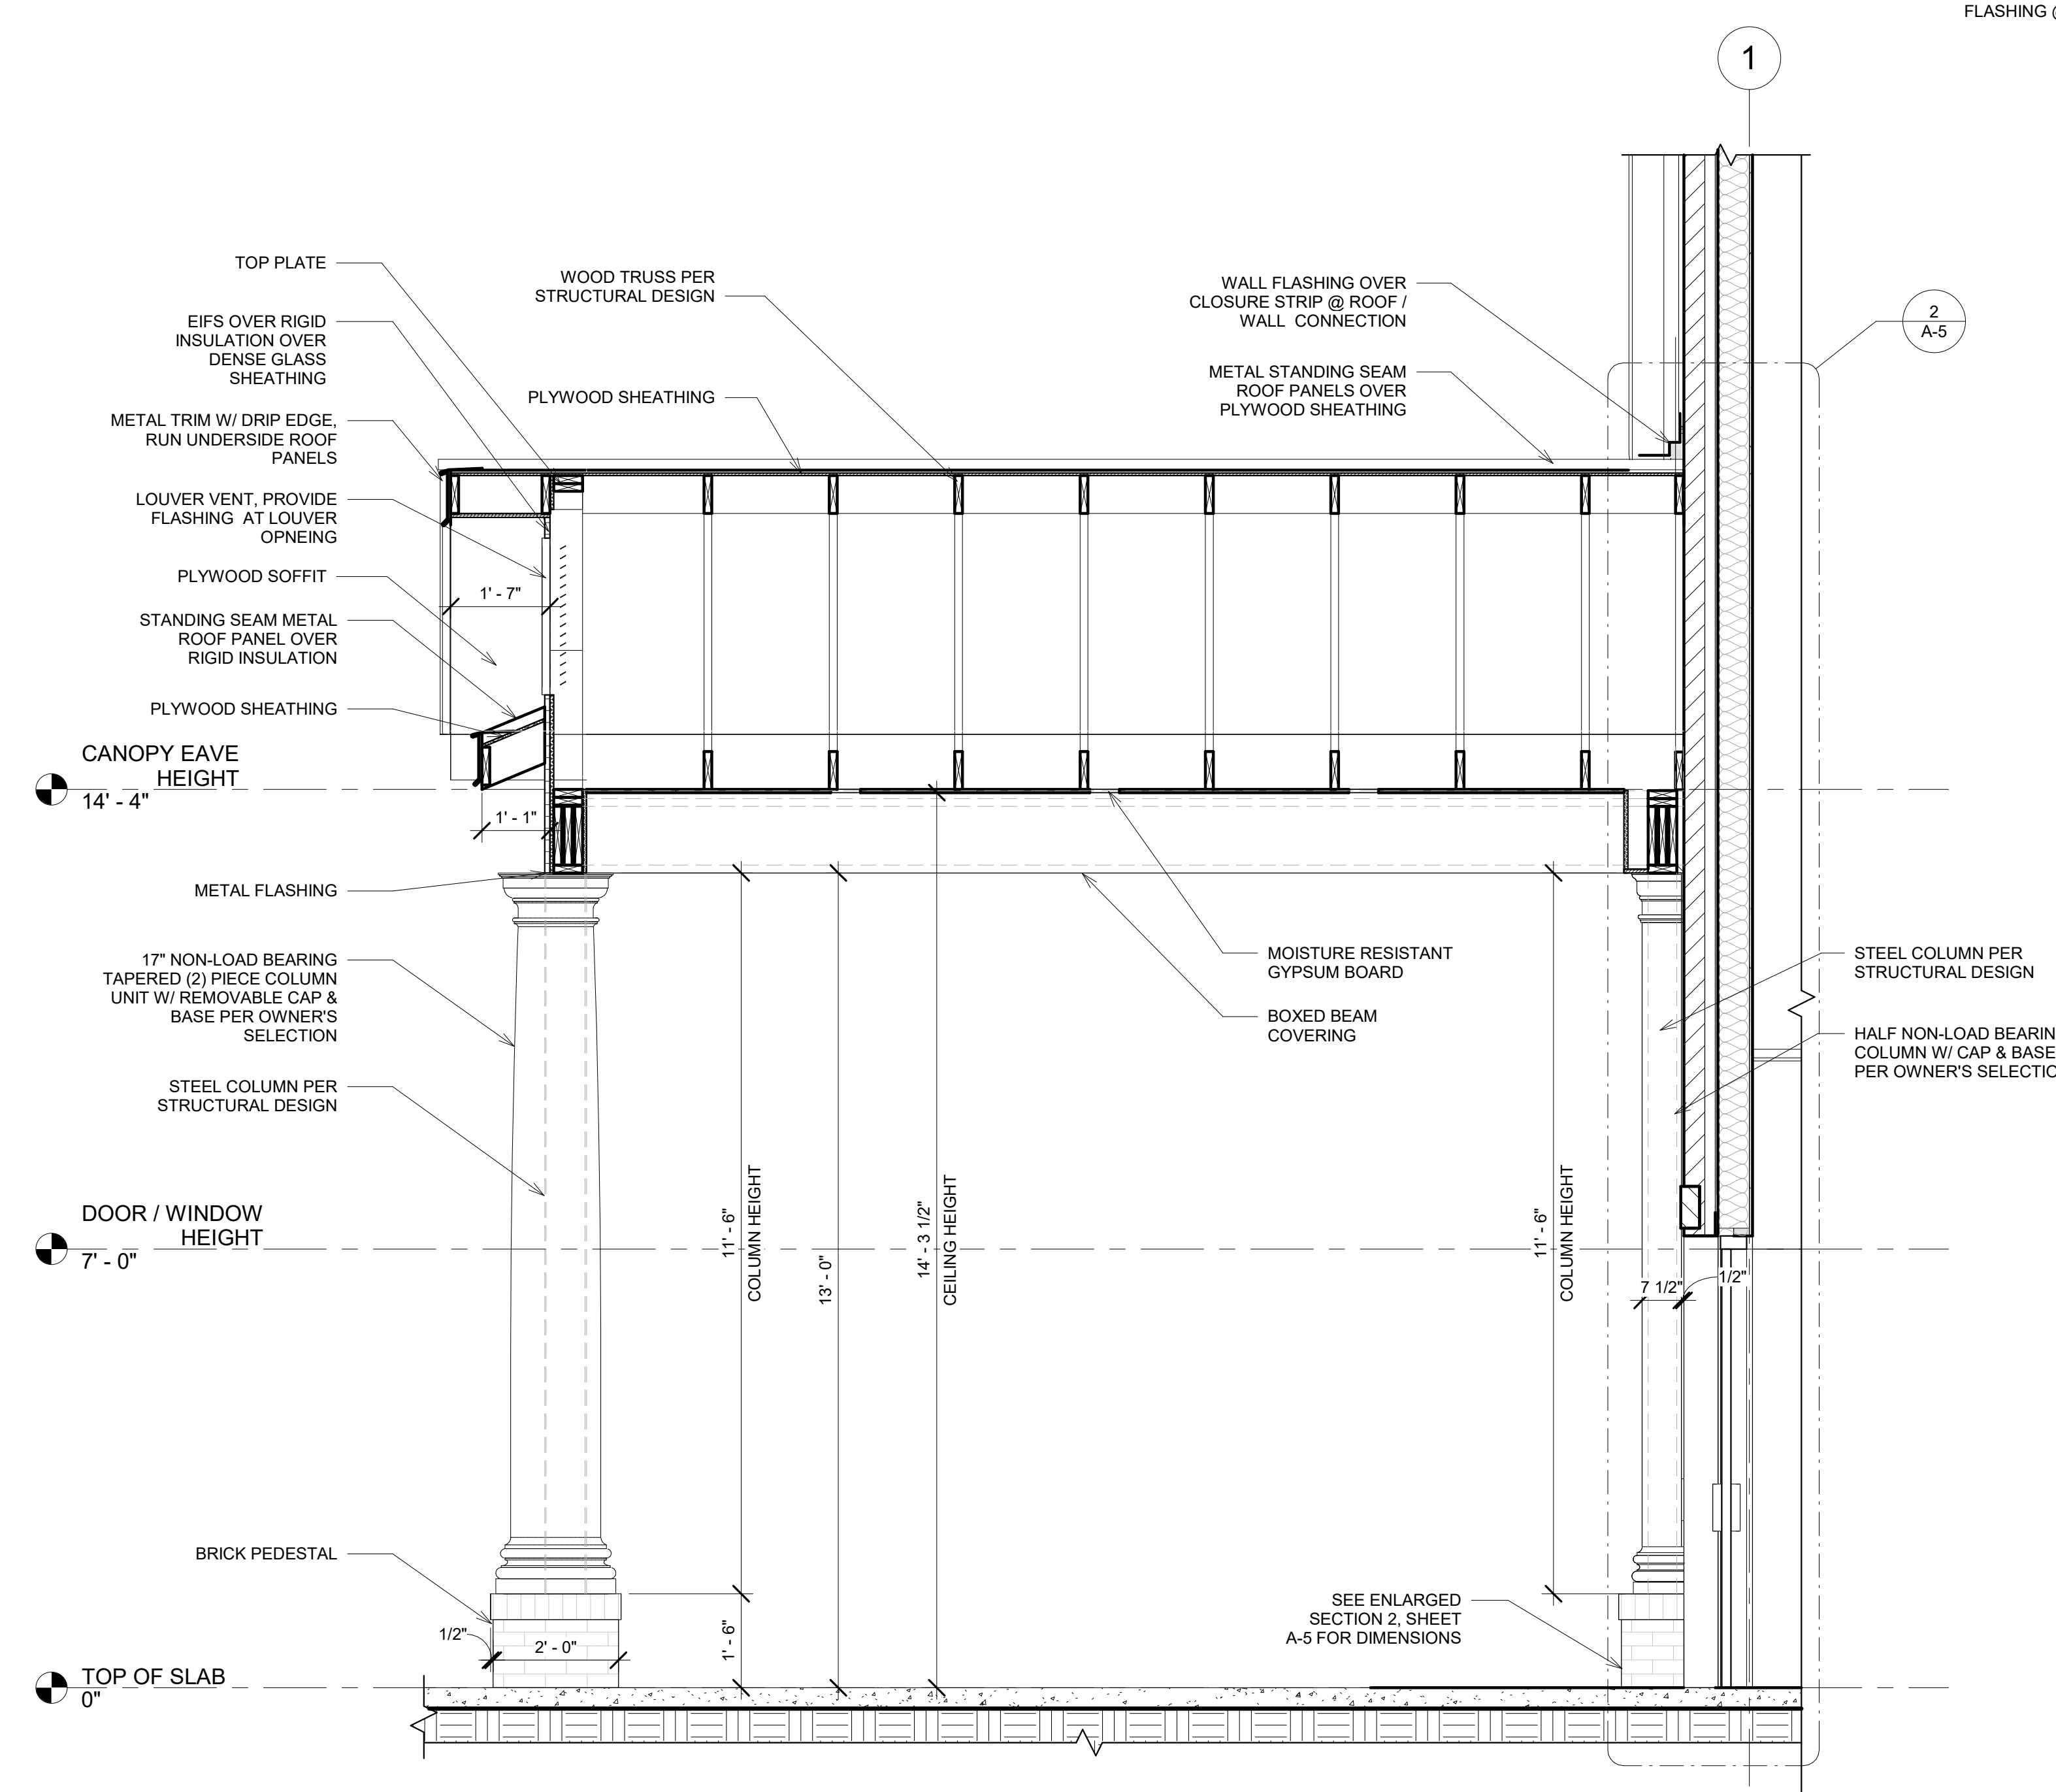

**1 SECTION @ FRONT PORTICO**  
1/2" = 1'-0"

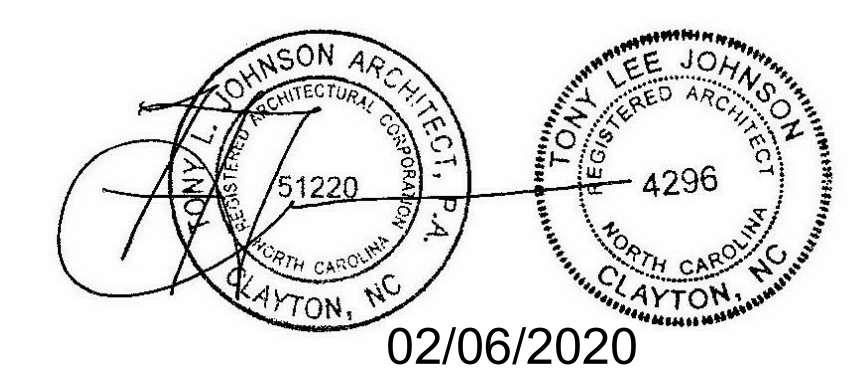





FINISH SCHEDULE							
#	ROOM NAME	FLOOR FINISH	BASE FINISH	WALL FINISH	CEILING FINISH	CEILING HEIGHT	COMMENTS
100	LOBBY	SEALED CONCRETE	4" VINYL COVE	PAINTED GYPSUM BOARD	2'X2' ACOUSTICAL TILE	10' - 0"	
101	WOMEN'S TOILET	SEALED CONCRETE	4" VINYL COVE	EPOXY PAINTED GYPSUM BOARD	2'X2' ACOUSTICAL TILE	10' - 0"	
102	MEN'S TOILET	SEALED CONCRETE	4" VINYL COVE	EPOXY PAINTED GYPSUM BOARD	2'X2' ACOUSTICAL TILE	N/A	
103	CONFERENCE	SEALED CONCRETE	4" VINYL COVE	PAINTED GYPSUM BOARD	2'X2' ACOUSTICAL TILE	10' - 0"	
104	MULTI-PURPOSE	SEALED CONCRETE	4" VINYL COVE	PAINTED GYPSUM BOARD	OPEN TO STRUCTURE ABOVE	N/A	
106	STORAGE	SEALED CONCRETE	4" VINYL COVE	PAINTED GYPSUM BOARD	2'X2' ACOUSTICAL TILE	10' - 0"	
107	FAMILY RR	SEALED CONCRETE	4" VINYL COVE	EPOXY PAINTED GYPSUM BOARD	2'X2' ACOUSTICAL TILE	10' - 0"	
108	PANTRY	SEALED CONCRETE	4" VINYL COVE	PAINTED GYPSUM BOARD	2'X2' ACOUSTICAL TILE	10' - 0"	
109	KITCHEN	SEALED CONCRETE	4" VINYL COVE	PAINTED GYPSUM BOARD	2'X2' ACOUSTICAL TILE	10' - 0"	

DOOR SCHEDULE										
MARK	DOOR		ELEVATION	DOOR			CLOSER	HARDWARE	COMMENTS	
	W	H		MATERIAL	FINISH	FRAME				FRAME FINISH
100	6' - 0"	7' - 0"	A	INSULATED GLASS	WHITE ALUMINUM	ALUMINUM	WHITE ALUMINUM	YES	PANIC HARDWARE	1" INSULATED TEMPERED GLASS, TINTED
101	3' - 0"	7' - 0"	G	WOOD FLUSH	PAINTED BIRCH	METAL	PAINTED	YES	PUSH PULL	
102	3' - 0"	7' - 0"	G	WOOD FLUSH	PAINTED BIRCH	METAL	PAINTED	YES	PUSH PULL	
103	3' - 0"	7' - 0"	B	WOOD FLUSH	PAINTED BIRCH	METAL	PAINTED	NO	LEVER HANDLE	
103A	3' - 0"	7' - 0"	B	WOOD FLUSH	PAINTED BIRCH	METAL	PAINTED	NO	LEVER HANDLE	
104	6' - 0"	7' - 0"	C	WOOD FLUSH	PAINTED BIRCH	METAL	PAINTED	YES	LEVER HANDLE	
104A	6' - 0"	7' - 0"	D	HOLLOW METAL	PAINTED	METAL	PAINTED	YES	PANIC HARDWARE	EGRESS EXIT
104B	6' - 0"	7' - 0"	D	HOLLOW METAL	PAINTED	METAL	PAINTED	YES	PANIC HARDWARE	EGRESS EXIT
106	6' - 0"	7' - 0"	C	WOOD FLUSH	PAINTED BIRCH	METAL	PAINTED	NO	LEVER HANDLE	
107	3' - 0"	7' - 0"	B	WOOD FLUSH	PAINTED BIRCH	METAL	PAINTED	NO	LEVER HANDLE	
108	3' - 0"	7' - 0"	B	WOOD FLUSH	PAINTED BIRCH	METAL	PAINTED	NO	LEVER HANDLE	
109	3' - 0"	7' - 0"	B	WOOD FLUSH	PAINTED BIRCH	METAL	PAINTED	NO	LEVER HANDLE	
109A	3' - 0"	7' - 0"	E	HOLLOW METAL W/ LITE	PAINTED	METAL	PAINTED	YES	LEVER HANDLE	
109B	10' - 0"	5' - 2"	F	METAL	PAINTED	METAL	PAINTED	NO	-	OVERHEAD ROLLING SHUTTER DOOR

WINDOW SCHEDULE				
MARK	WIDTH	HEIGHT	OPERATION	NOTES
A	3' - 0"	4' - 0"	FIXED UNIT	STEEL FRAME
A	3' - 0"	4' - 0"	FIXED UNIT	STEEL FRAME
A	3' - 0"	4' - 0"	FIXED UNIT	STEEL FRAME

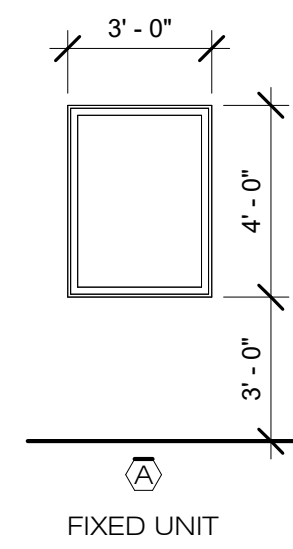

WINDOW ELEVATIONS  
1/4" = 1'-0"

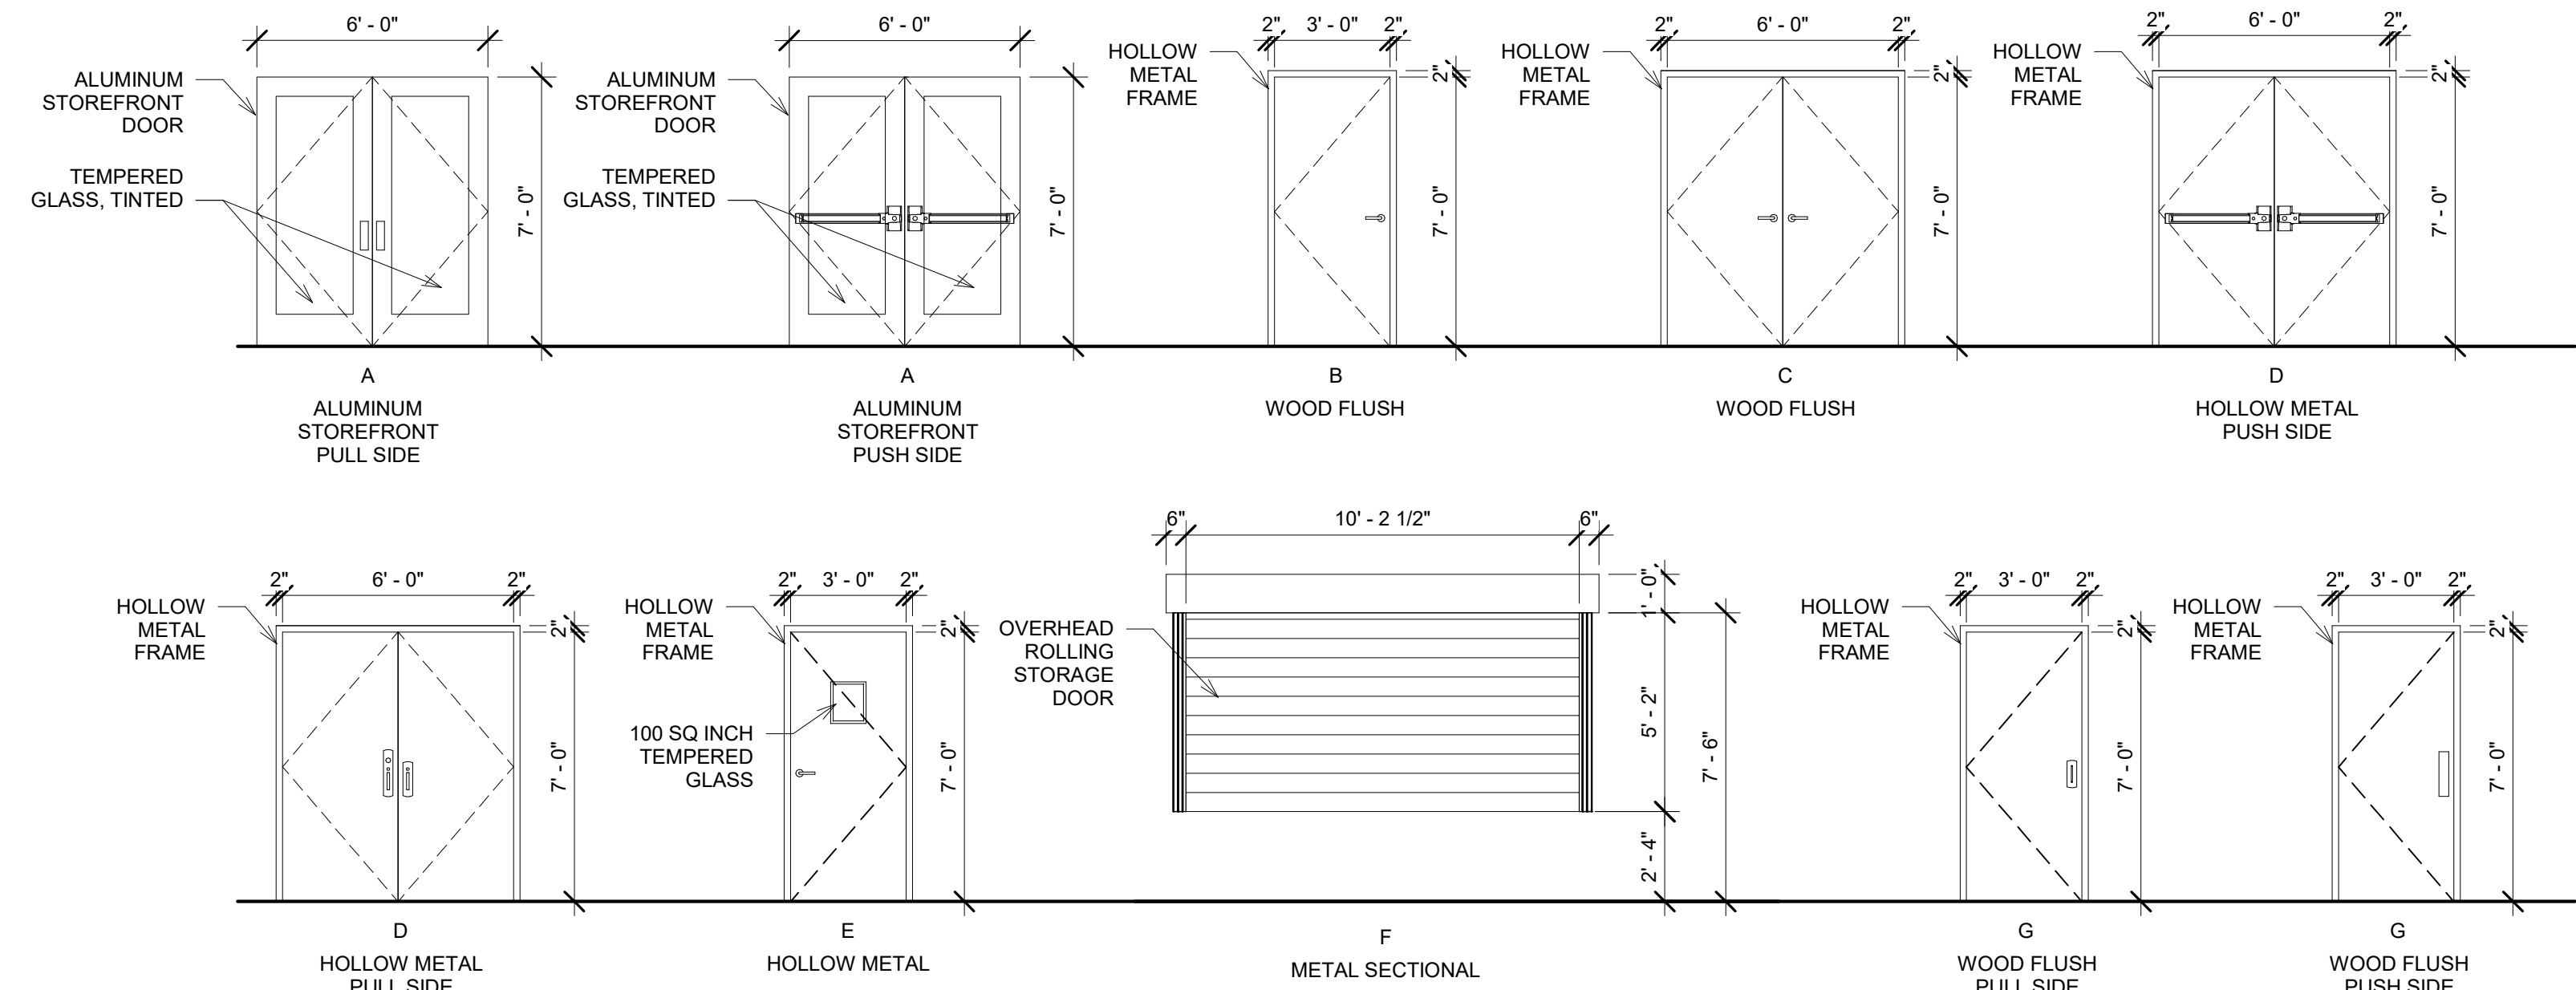

DOOR ELEVATIONS  
1/4" = 1'-0"

WALL TYPES		
SYMBOL	TAG	DESCRIPTION
	1	EXTERIOR - BRICK VENEER, 2" AIR SPACE, BUILDING WRAP, 1/2" DENSE GLASS BOARD, 6" METAL STUD (SEE STRUCTURAL FOR GAUGE), R-19 BATT INSULATION, 5/8" GYPSUM WALL BOARD, RUN GYPSUM WALLBOARD TO STRUCTURE ABOVE
	2	INTERIOR - 3-5/8" METAL STUD, 5/8" GYPSUM WALL BOARD BOTH SIDES, SOUND BATT INSULATION, 10'-2" HGT. U.N.O.
	3	INTERIOR - 6" 20 GAUGE METAL STUD, 5/8" GYPSUM WALL BOARD BOTH SIDES, SOUND BATT INSULATION, 10'-2" HGT. U.N.O. AT MULTI-PURPOSE ROOM
	4	INTERIOR - 2" METAL STUD, 5/8" GYPSUM WALL BOARD, HEIGHT VARIES
	5	EXTERIOR - METAL WALL PANEL, WALL GIRT, R-19 INSULATION OVER WALL GIRT, 2" METAL STUD, 5/8" GYP WALL BOARD, 10'-2" HGT U.N.O. AT MULTI-PURPOSE ROOM

KITCHEN EQUIPMENT SCHEDULE				
MARK	COUNT	DESCRIPTION	FURNISHED BY	INSTALLED BY
K-1	1	DISHWASHER	OWNER	CONTRACTOR
K-2	1	ELECTRIC COOKTOP	OWNER	CONTRACTOR
K-3	1	MICROWAVE / EXHAUST FAN	OWNER	CONTRACTOR
K-4	1	WALL OVEN	OWNER	CONTRACTOR
K-5	1	DOUBLE WALL OVEN	OWNER	CONTRACTOR
K-6	1	WARMING DRAWER	OWNER	CONTRACTOR
K-7	1	REFRIGERATOR	OWNER	CONTRACTOR
K-8	1	2 DOOR UNDER COUNTER FREEZERS	OWNER	CONTRACTOR
K-9	1	EXISTING / ICE MAKER - RELOCATED	OWNER	CONTRACTOR



REVISIONS	

NEILL'S CREEK BAPTIST CHURCH  
FELLOWSHIP HALL  
ANGIER, NORTH CAROLINA

919-550-7717  
TONY@TONYJOHNSONARCHITECT.COM  
104 N. LOMBARD ST.  
CLAYTON, NC 27520  
TONYJOHNSONARCHITECT.COM



DATE 02-06-2020

SHEET

A-6


REVISIONS	

**NEILL'S CREEK BAPTIST CHURCH  
FELLOWSHIP HALL  
ANGIER, NORTH CAROLINA**


919-550-7717  
TONY@TONYJOHNSONARCHITECT.COM  
104 N. LOMBARD ST.  
CLAYTON, NC 27520  
TONYJOHNSONARCHITECT.COM




DATE	02-06-2020
SHEET	A-7

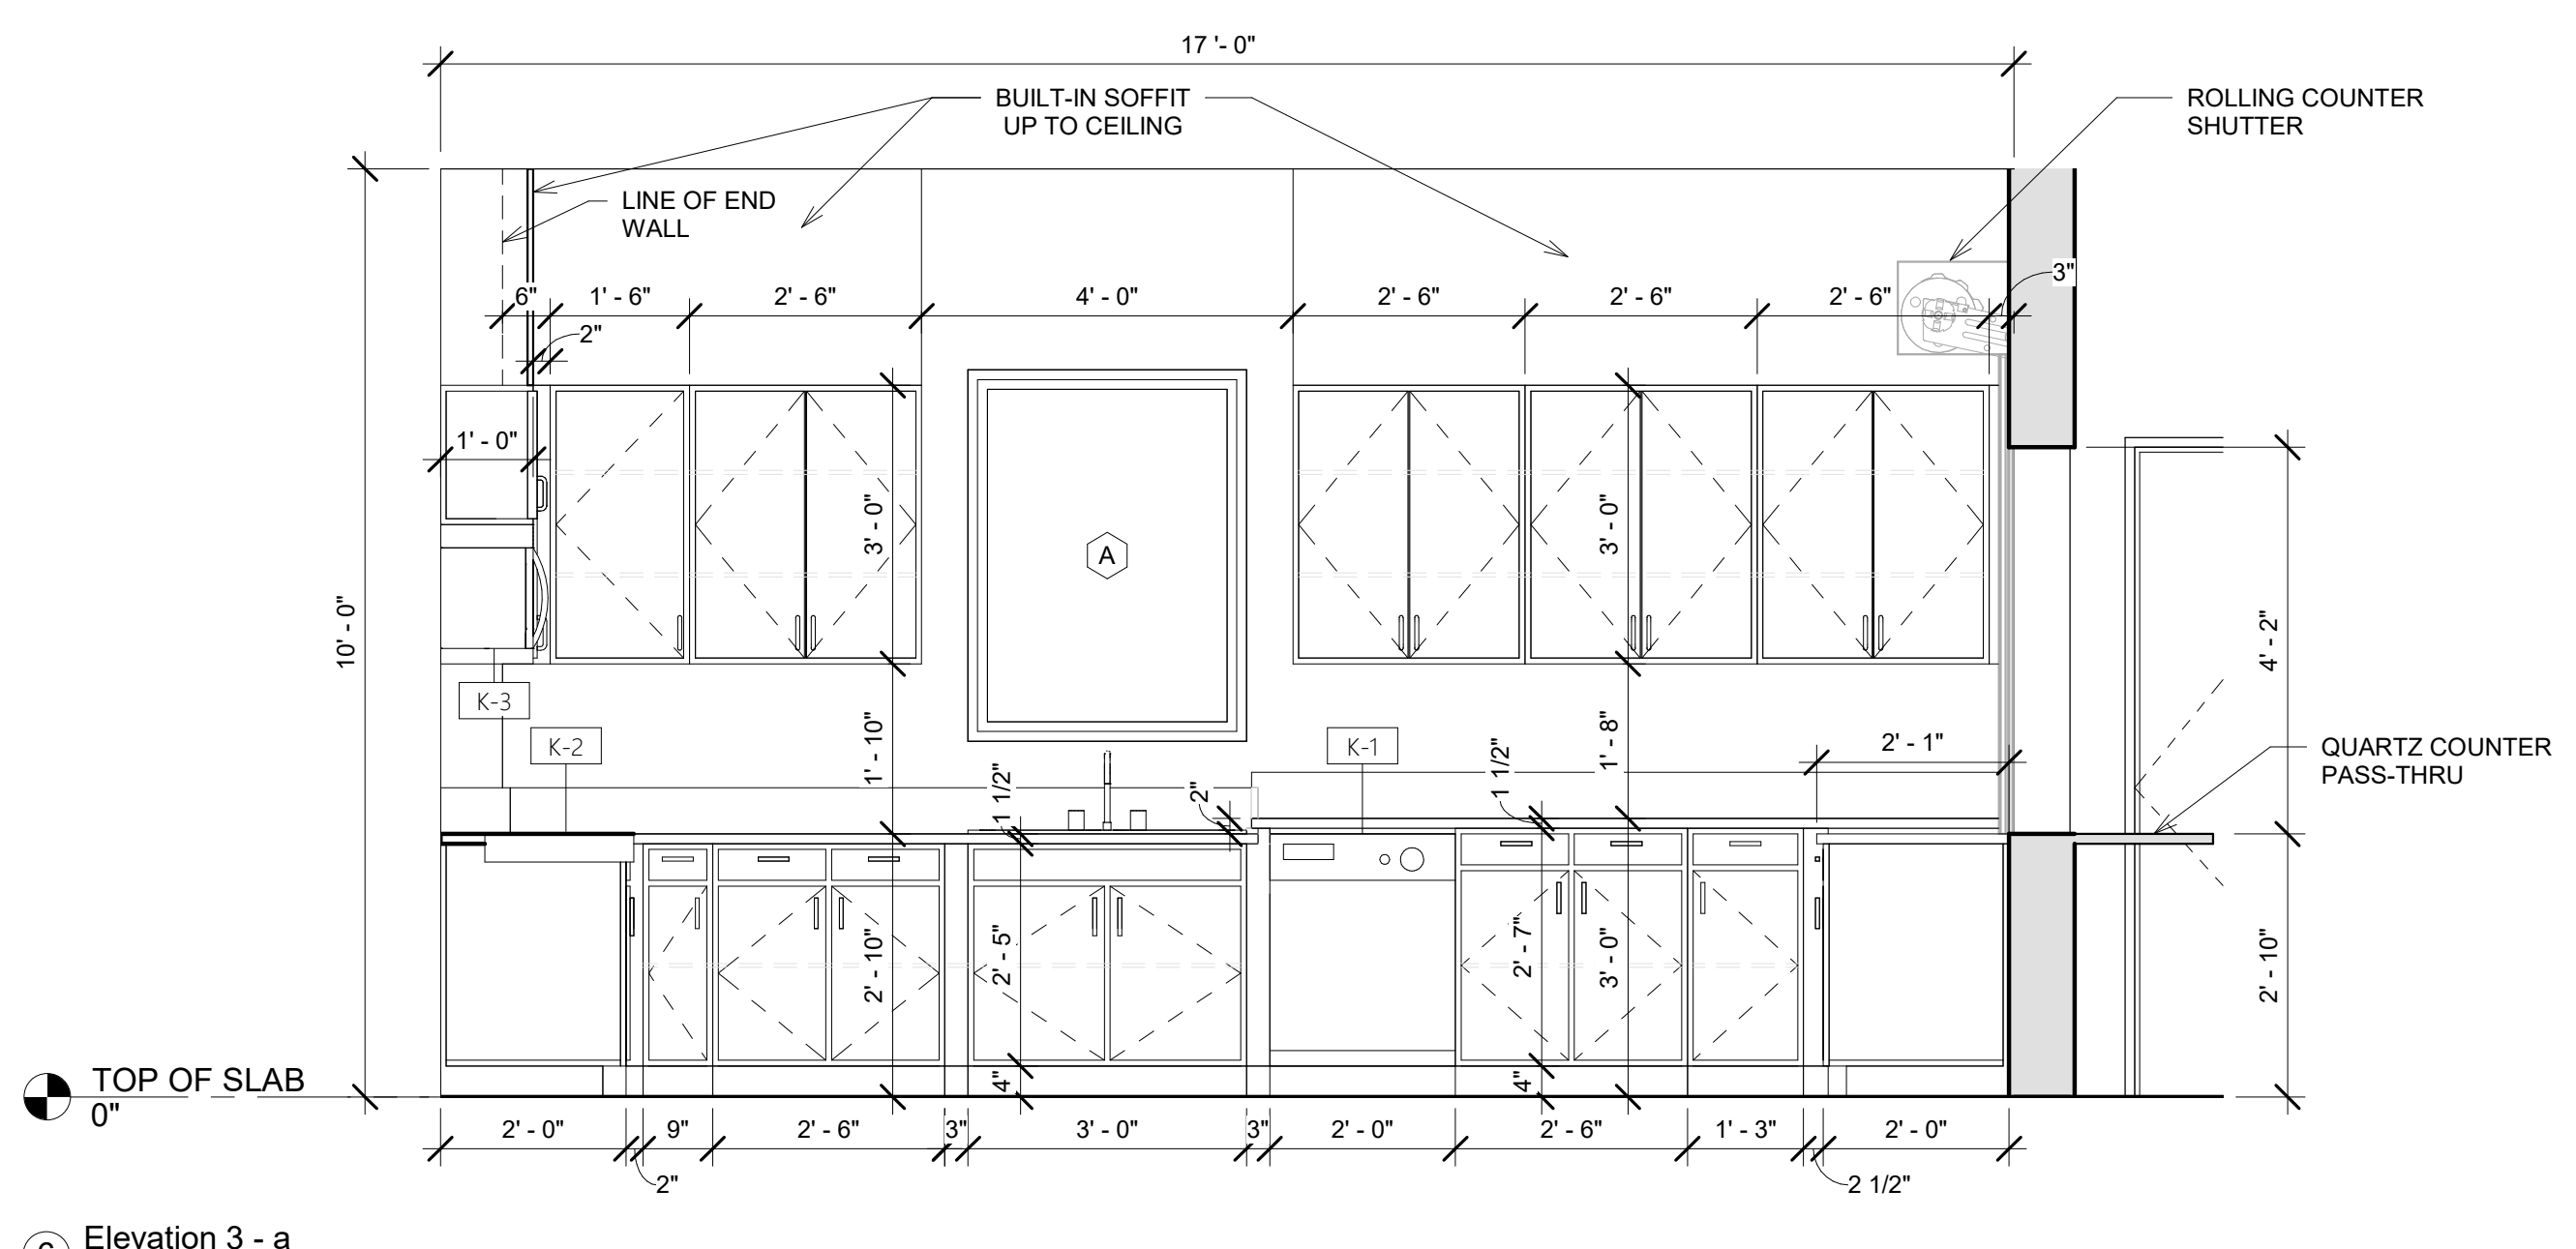


6 Elevation 3 - a  
1/2" = 1'-0"

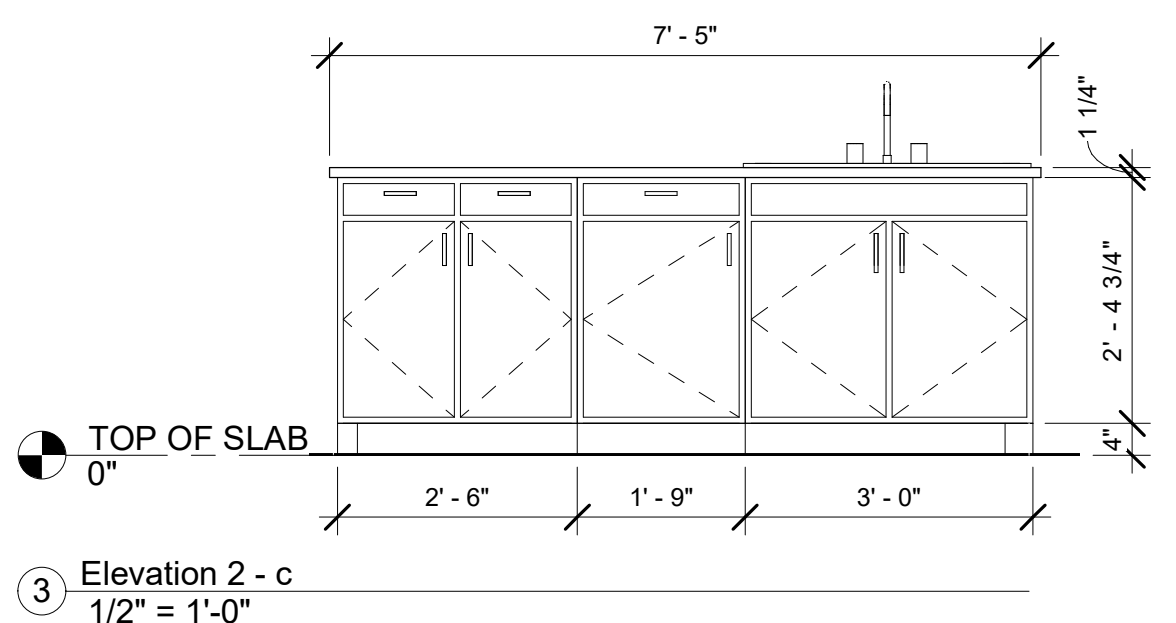


3 Elevation 2 - c  
1/2" = 1'-0"

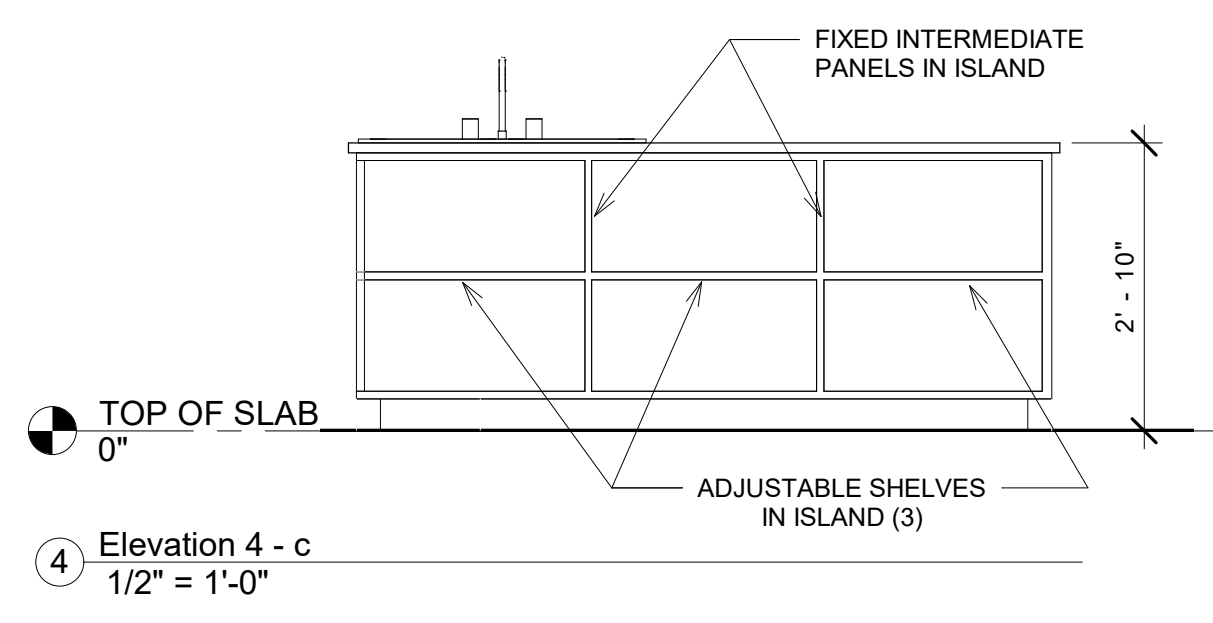


4 Elevation 4 - c  
1/2" = 1'-0"

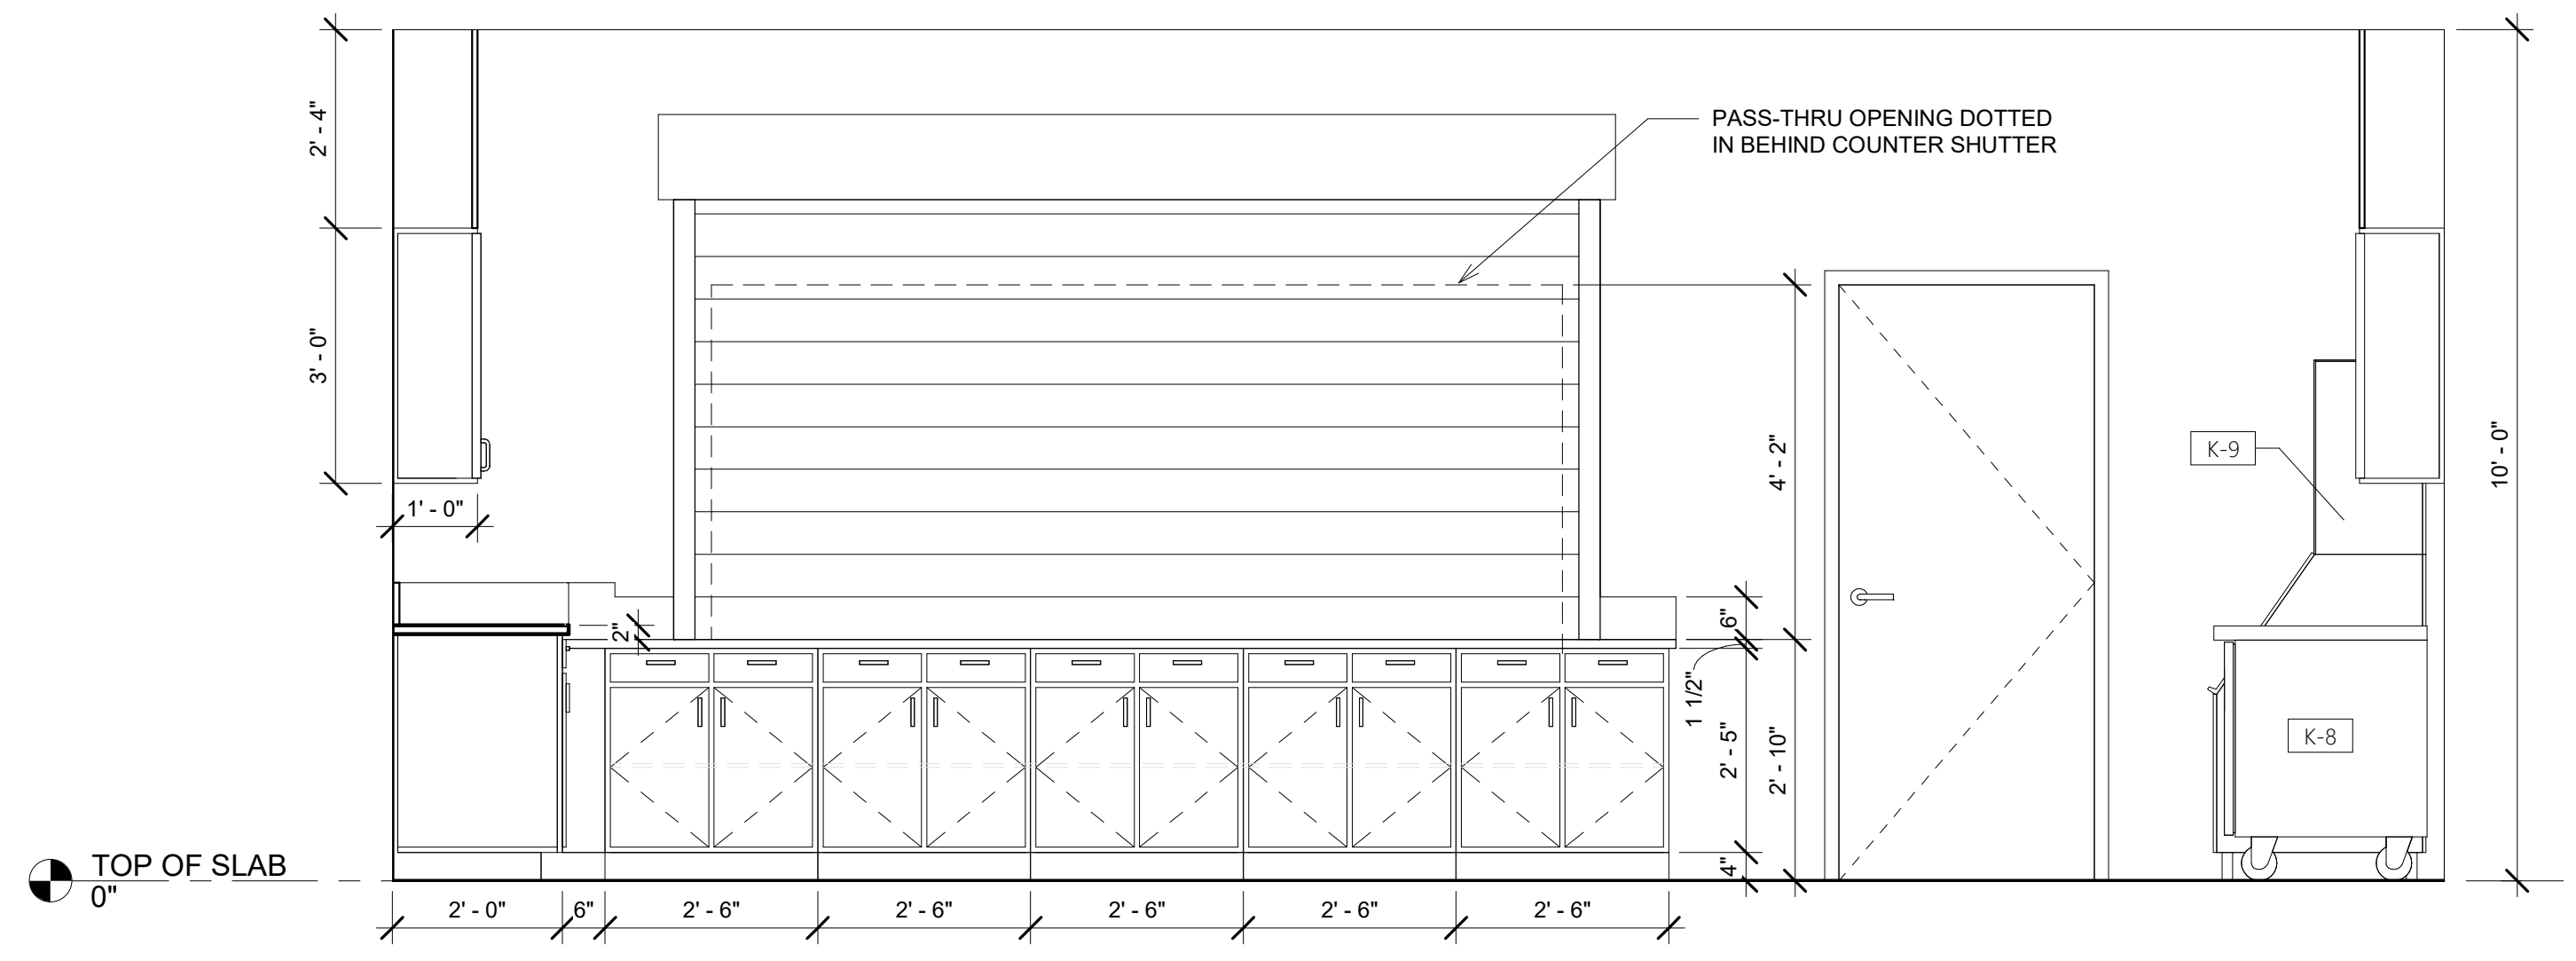


2 Elevation 2 - a  
1/2" = 1'-0"

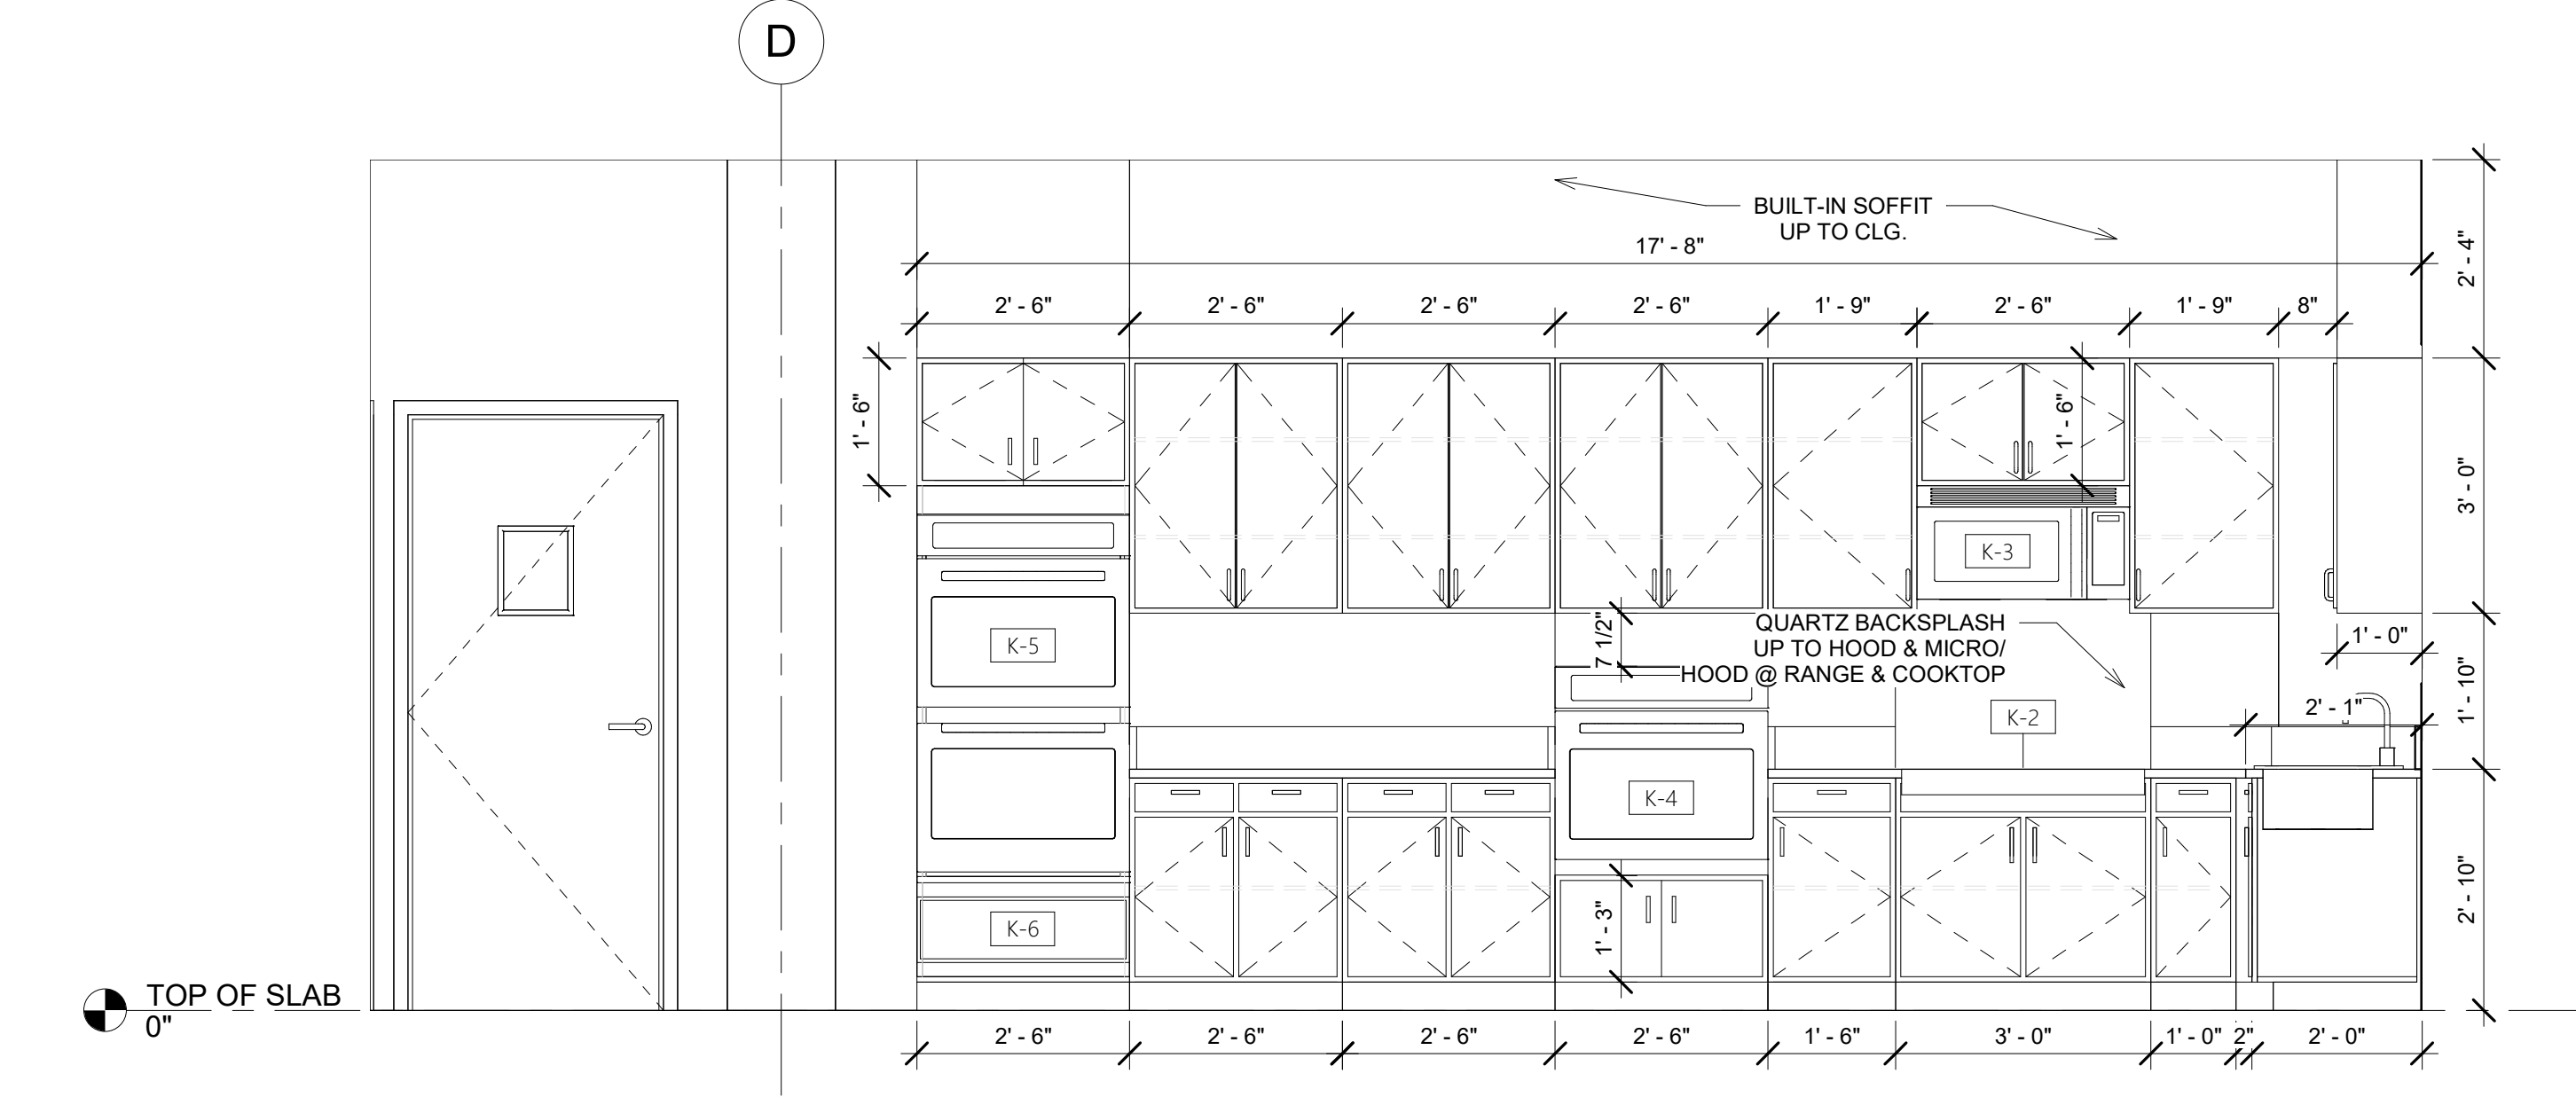


5 Elevation 4 - a  
1/2" = 1'-0"

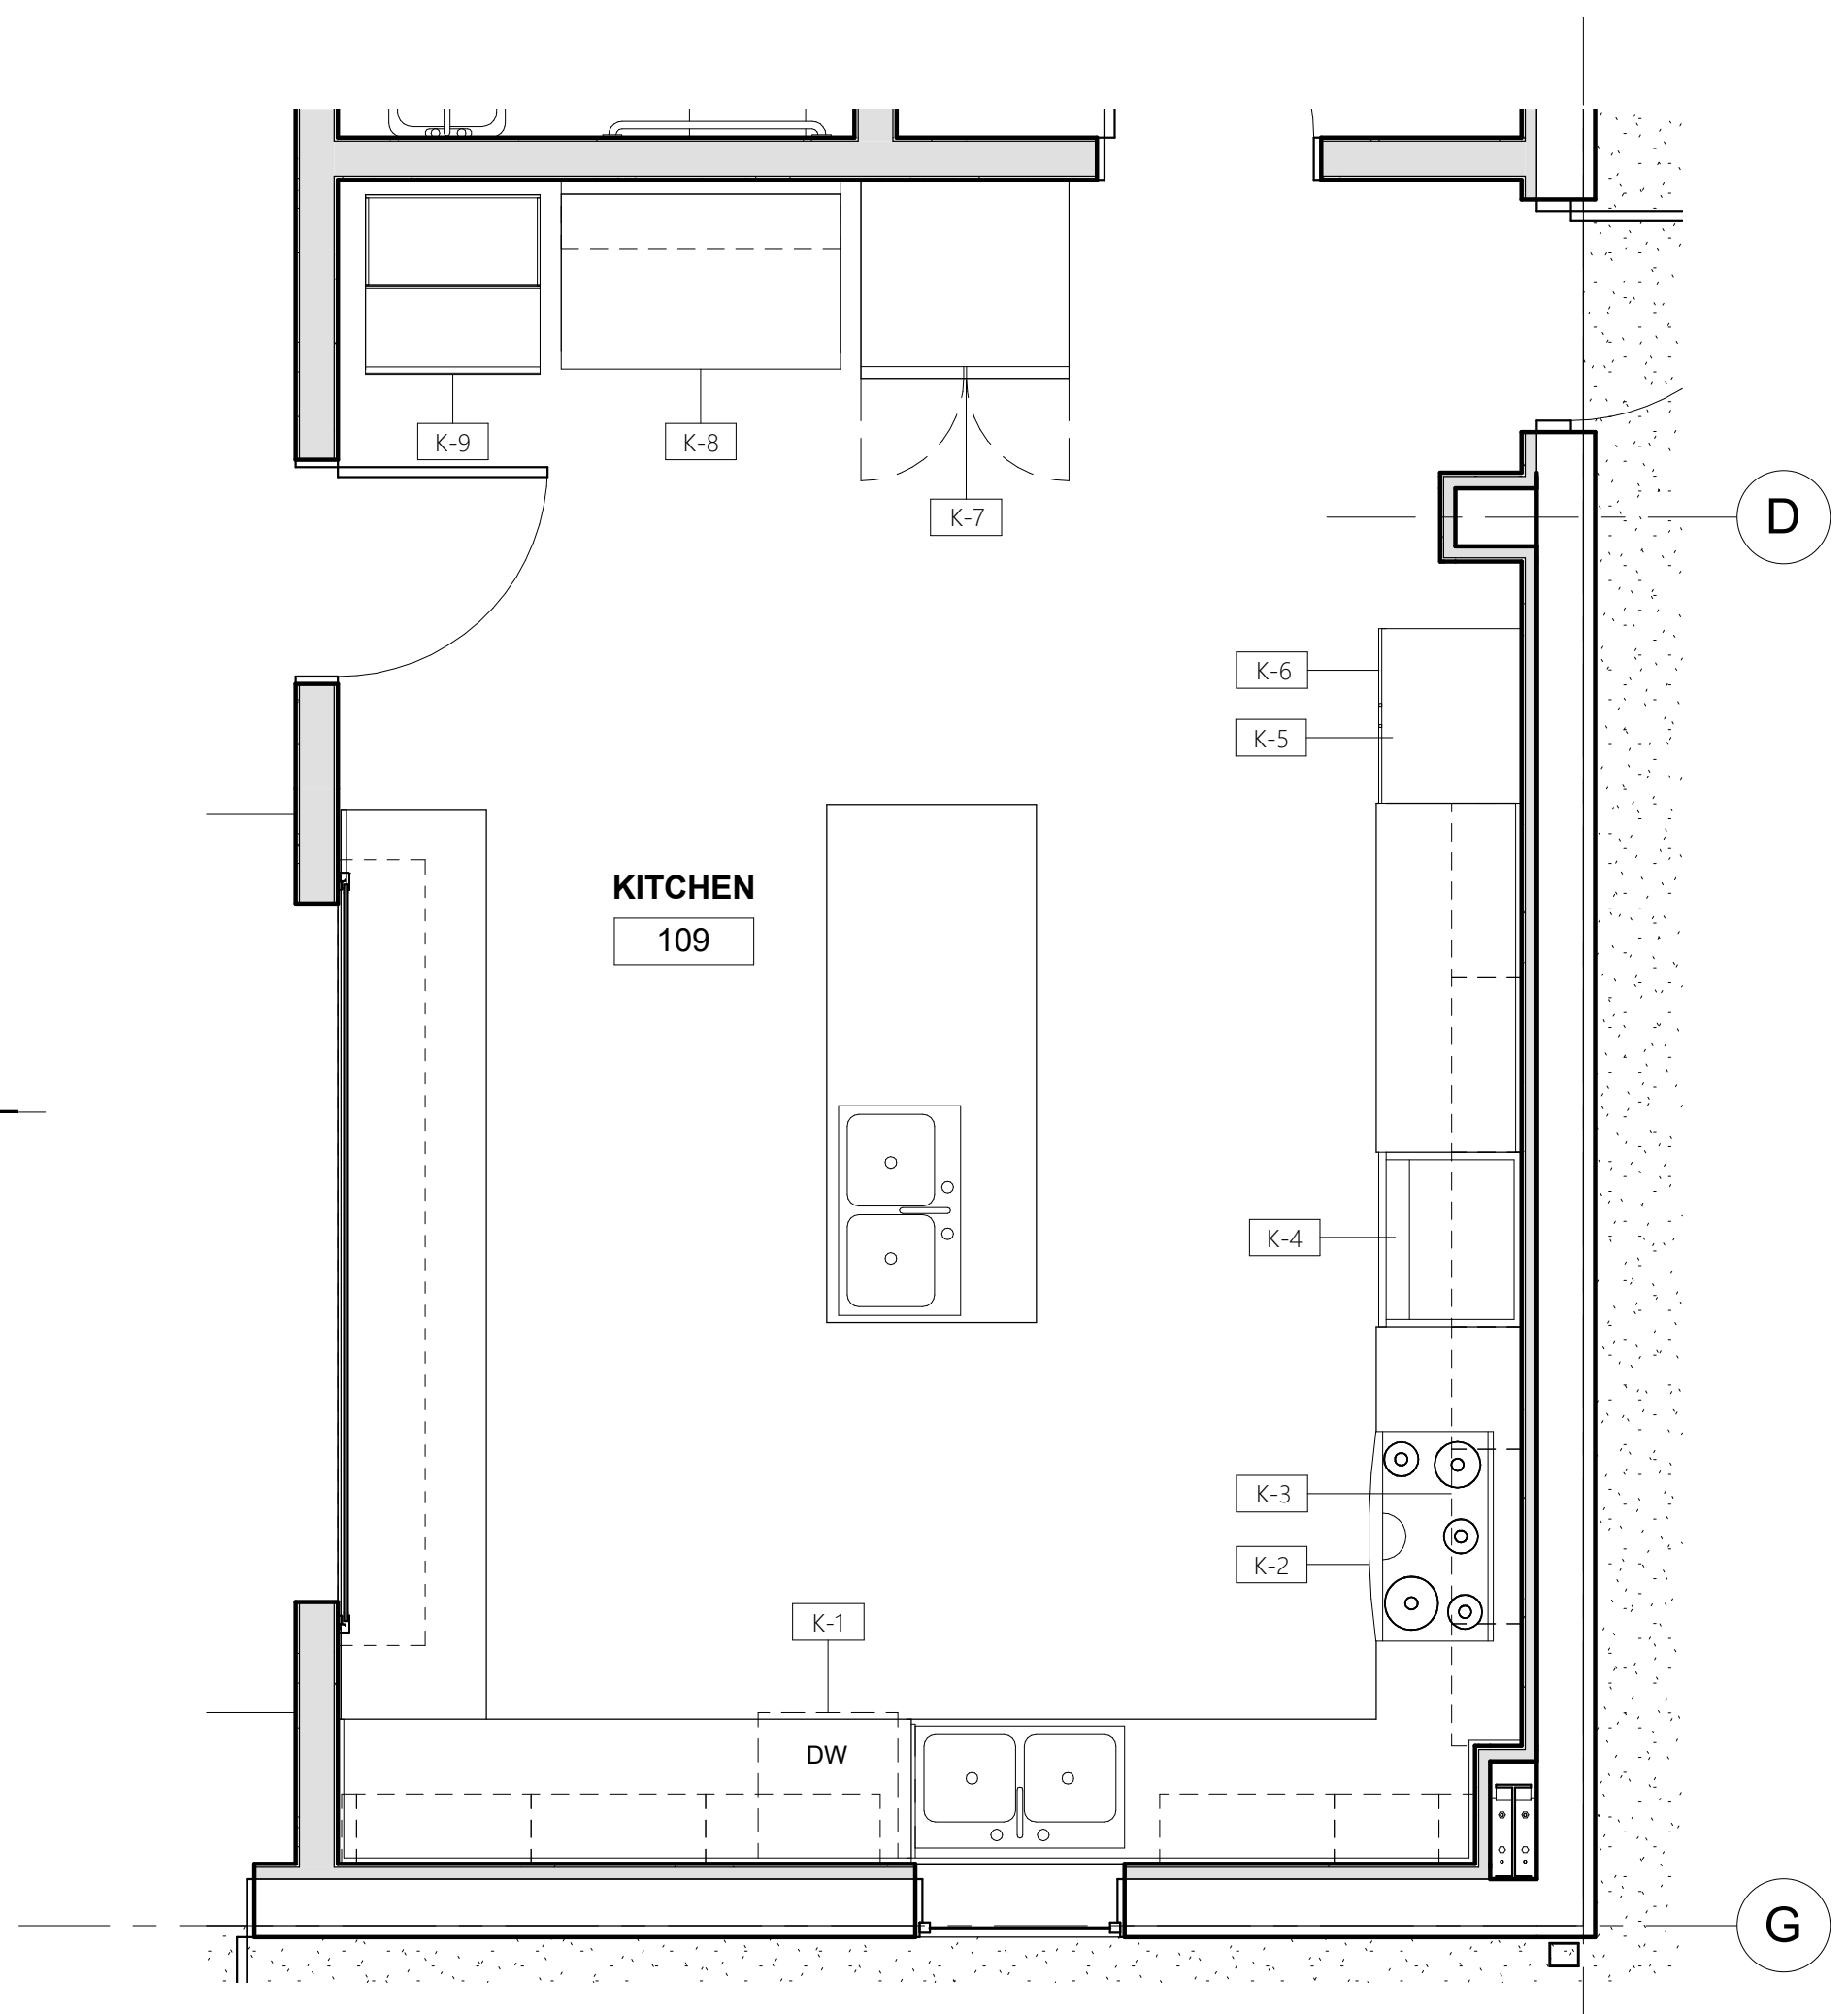

1 KITCHEN EQUIPMENT PLAN  
3/8" = 1'-0"

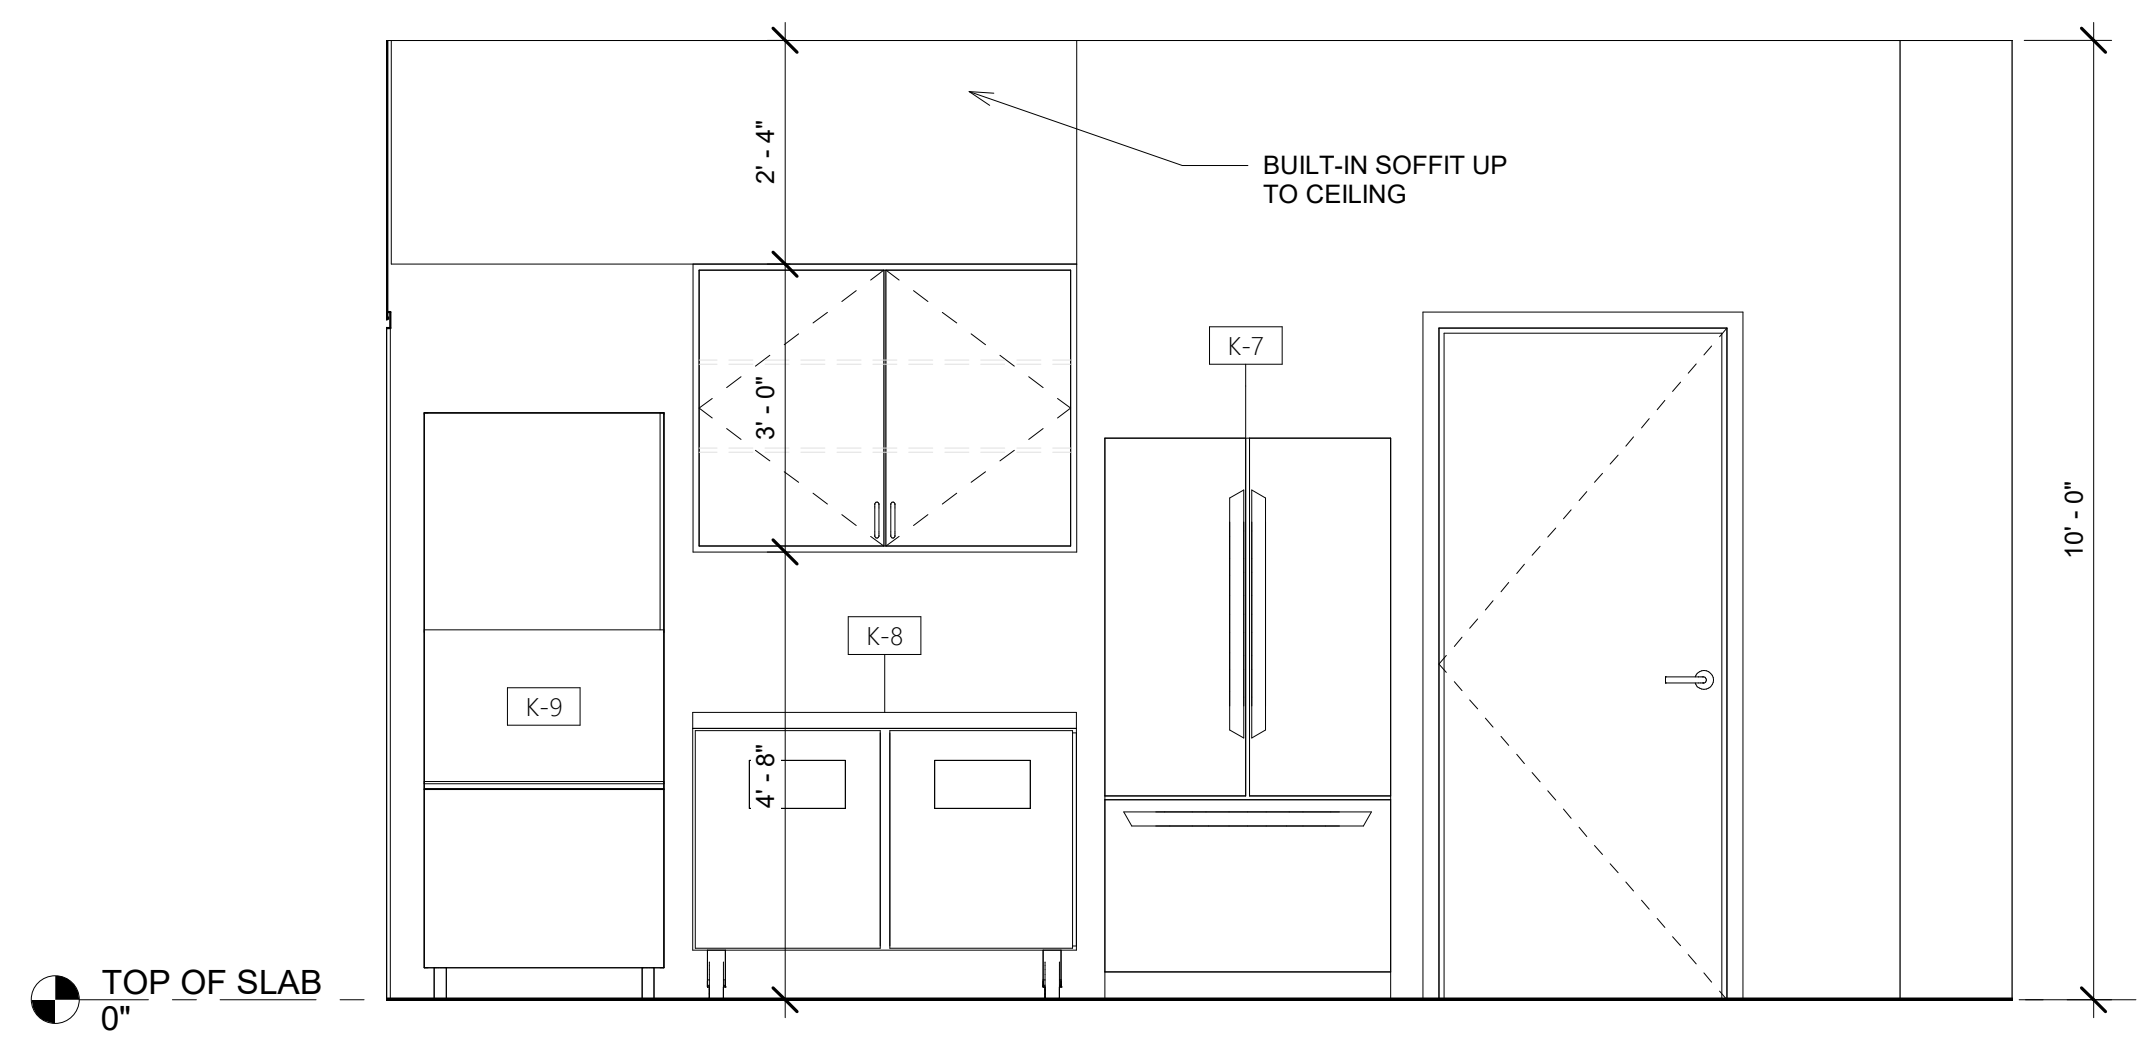

7 Elevation 5 - a  
1/2" = 1'-0"

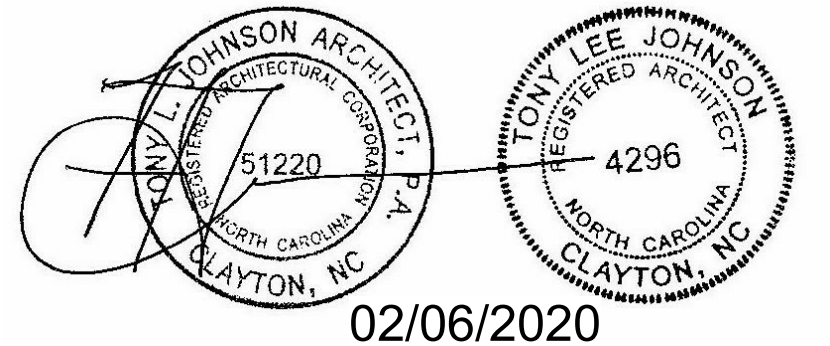

02/06/2020





7200 N Lake Dr, Ste 200  
Columbus, GA 31909

Ph: (706) 562-8020  
Fax: (706) 562-8017

March 17, 2020

Alexander Design Build, LLC  
205 West Main Street  
Clayton, NC 27520

Project Name: Niell's Creek Church Gym  
Buildings: A->55'-4"x110'-10"x20'-0"(RCG,4.0:12)

Attn.: Kent Alexander  
Project Location: Angier, NC 27501  
NBG Project #: A20B0267A

This Letter of Design Certification ensures that the materials furnished by the metal building supplier are designed in accordance with the information specified to the metal building supplier on the order documents and summarized by the loading information listed below. The Project Engineer of Record (not the metal building supplier) is responsible for verifying that the building code and design loads meet any and all applicable local requirements.

The Professional Engineer whose seal appears on this Letter of Certification is employed by the metal building manufacturer. and does not serve as or represent the Engineer of Record for this project and shall not be construed as such.

**DESIGN LOAD CRITERIA:**

Structural Loads Applied in General Accordance with: North Carolina (NCBC 2018)  
Risk Category: II - Standard Buildings

**PROJECT-WIDE LOADING INFORMATION:**

Ground Snow Load:	15.0 psf	Snow Exposure Factor, Ce:	0.90	Snow Imp. Factor, Is:	1.00
Roof Live Load:	20.0 psf	Reducible As Per Code:			
Ultimate Design Wind Velocity:	115 mph	Nominal Design Wind Velocity:	89 mph		
***Components & Cladding Pressures:	24 psf/ -32 psf				
Is Roof to meet UL 90 Requirements?:	No	Wind Exposure:		B	
Seismic Criteria:	Ss: 0.229 S1: 0.086	• No ground snow included in seismic calculations.			
Design Sds / Sd1:	0.244/0.138	Analysis Procedure: Equiv. Lat. Force Procedure			
Seis. Imp. Factor, Ie:	1.00	Basic SFRS: Not Detailed for Seismic			
Seis. Design Category:	C	Site Class:	D		

**BUILDING-SPECIFIC LOADING INFORMATION:**

Bldg	Roof Dead	Collateral Dead		Snow Coefficient		Snow Load (psf)		Wind		Seismic		
	(psf)*	Pri (psf)	Sec (psf)	Ct	Cs	Ps (psf)	**Pm (psf)	Enclosure	GCpi	R	Cs	V (kips)
A	3.5	3.0	3.0	1.0	1.00	9.45	---	Enclosed	± 0.18	3.00	0.081	8.3

\*Primary Structural Not Included

\*\*P<sub>m</sub> is based on the minimum roof snow load calculated per building code or the contract-specified roof snow load, whichever is greater. This value, P<sub>m</sub>, is only applied in combination with Dead and Collateral Loads. Roof Snow in other loading conditions is determined per the specified Building Code.

\*\*\*Ultimate Design wind pressures to be used for wall exterior component and cladding materials not provided by Metal Building Supplier

Mezzanine Information:

Floor Dead Load: N/A      Floor Collateral Load: N/A      Floor Live Load: N/A

Crane Information:

No cranes on building.

Roof-Top Unit Information

No roof-top units on building.

The design of structural members supporting roof gravity loads is controlled by the more critical effect of roof live load or roof snow applied in accordance with the governing building code.


**DESIGN STANDARDS REFERENCED:**

- AISC Specification for Structural Steel Buildings - Steel Construction Manual, 14th Edition, © 2010.
- AISI North-American Specification for the Design of Cold-Formed Steel Structures, © 2012 Edition.
- IBC codes are designed in accordance with ASCE7-10 Edition.
- MBMA Low Rise Building Systems Manual, Latest Edition.
- AWS Latest Edition of Structural Welding Code.
- No buyout structural components provided on this project.



Professional Seal



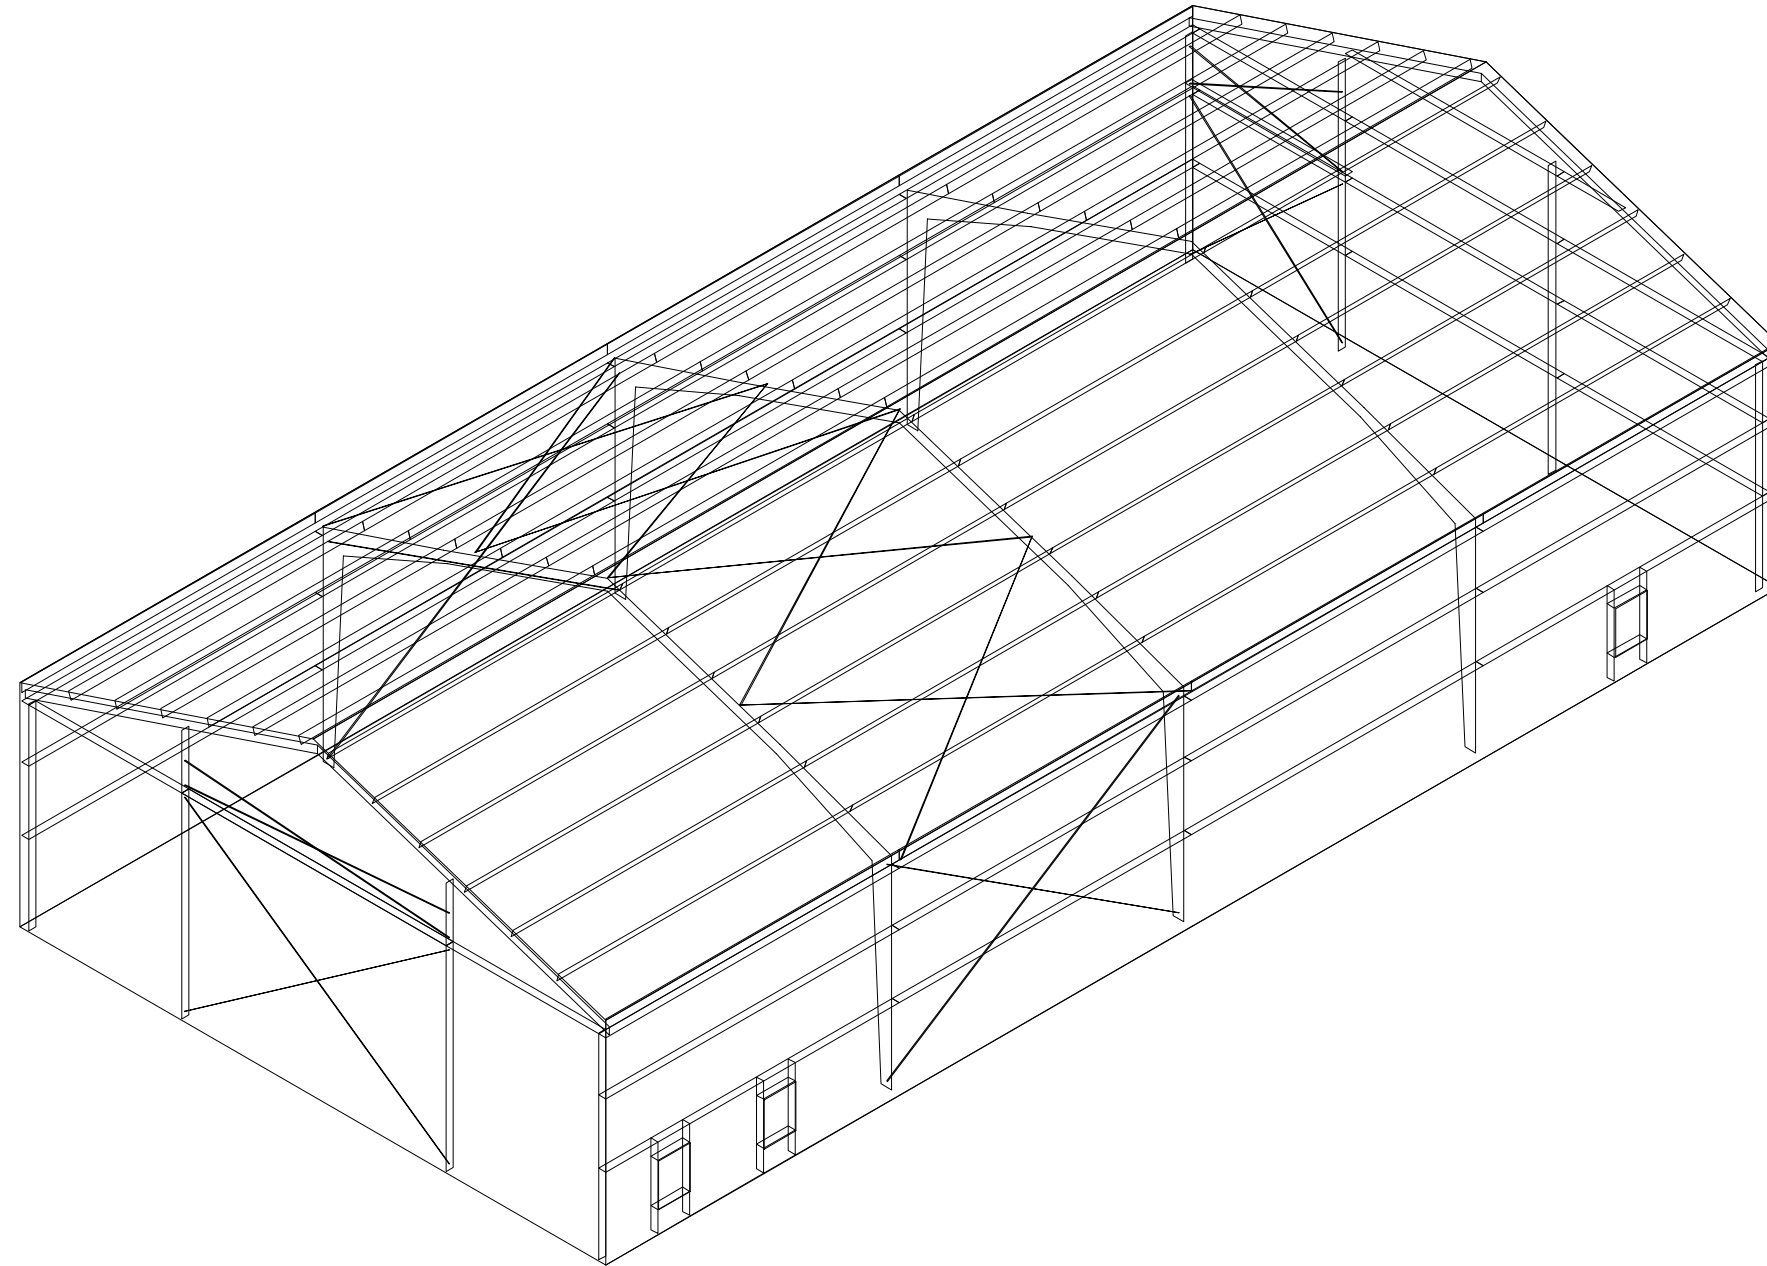


BUILDER :ALEXANDER DESIGN BUILD., LLC  
CUSTOMER :NIELL'S CREEK CHURCH GYM  
LOCATION :ANGIER NC





ANCHOR BOLT SUMMARY			
Qty	Locate	Dia (in)	Type
32	Endwall	3/4"	F1554
24	Frame	3/4"	F1554

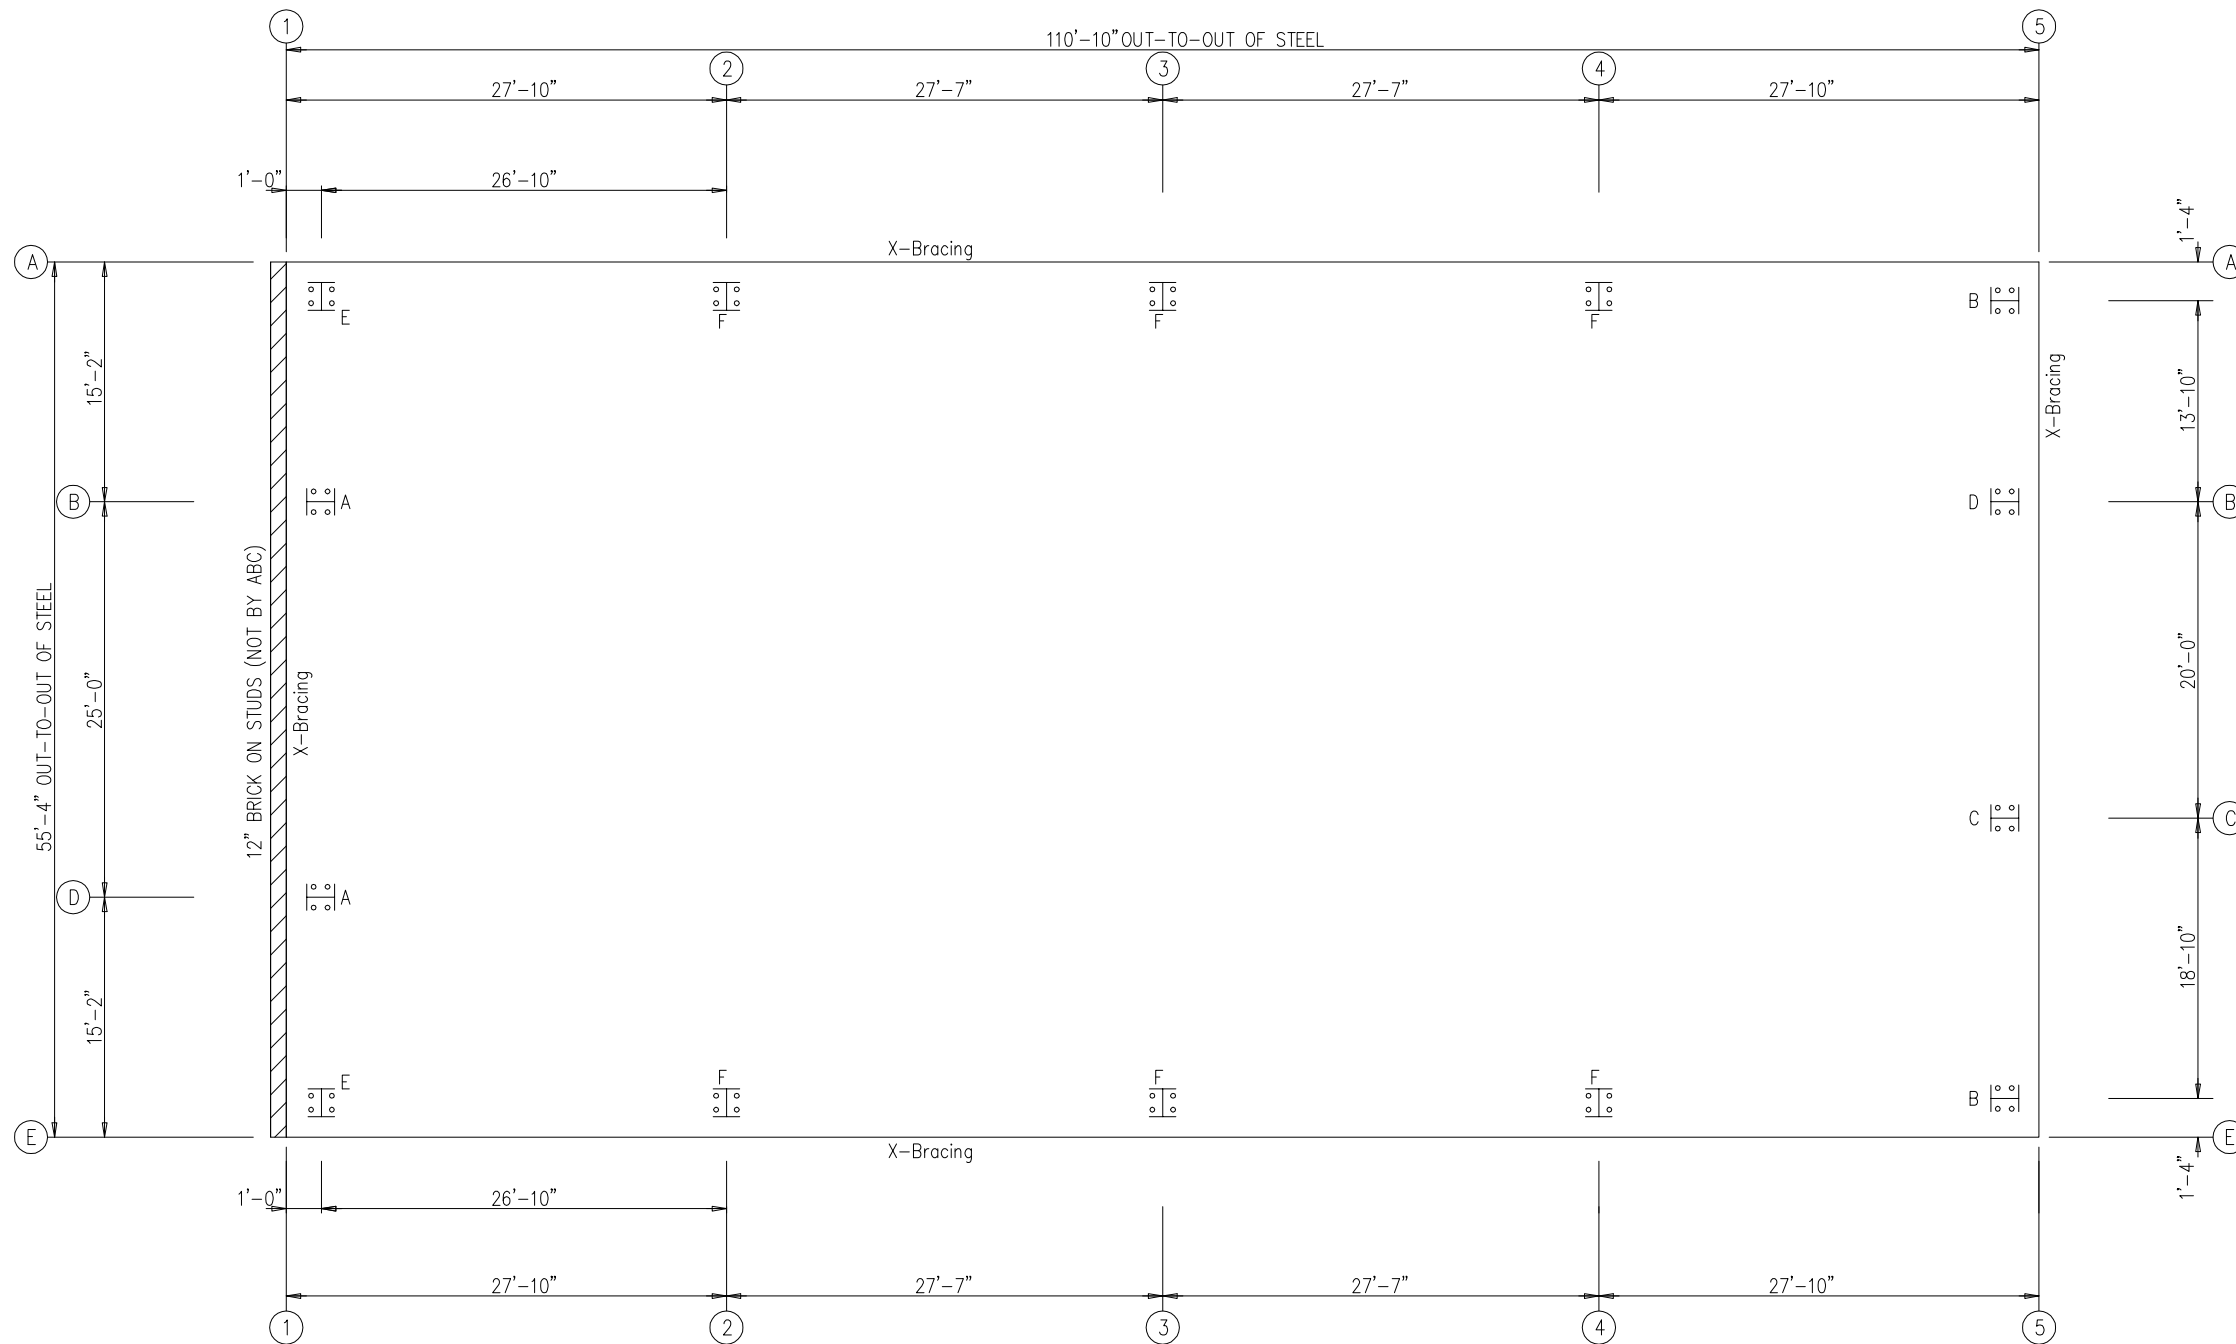

ANCHOR BOLT PLAN  
NOTE: All Base Plates @ 100'-0" (U.N.)

o Dia= 3/4"

### ANCHOR BOLT PLAN

#### GENERAL NOTES

1. THE SPECIFIED ANCHOR ROD DIAMETER ASSUMES F1554 GRADE 36 UNLESS NOTED OTHERWISE. ANCHOR ROD MATERIAL OF EQUAL DIAMETER MEETING OR EXCEEDING THE STRENGTH REQUIREMENTS SET FORTH ON THESE DRAWINGS MAY BE UTILIZED AT THE DISCRETION OF THE FOUNDATION DESIGN ENGINEER. ANCHOR ROD EMBEDMENT LENGTH SHALL BE DETERMINED BY THE FOUNDATION DESIGN ENGINEER.
2. METAL BUILDING MANUFACTURER IS NOT RESPONSIBLE FOR PROJECT FOUNDATION DESIGN. THE FOUNDATION DESIGN IS THE RESPONSIBILITY OF A REGISTERED PROFESSIONAL ENGINEER, FAMILIAR WITH LOCAL SITE CONDITIONS.
3. ALL ANCHOR RODS, FLAT WASHERS FOR ANCHOR RODS, EXPANSION BOLTS, AS WELL AS ALL CONCRETE/MASONRY EMBEDMENT PLATES ARE NOT BY METAL BUILDING MANUFACTURER.
4. THIS DRAWING IS NOT TO SCALE.
5. FINISHED FLOOR ELEVATION = 100'-0" UNLESS NOTED OTHERWISE.
6. "SINGLE" CEE COLUMNS SHALL BE ORIENTED WITH THE "TOES" TOWARD THE LOW EAVE UNLESS NOTED OTHERWISE.
7. ANCHOR RODS ARE REQUIRED ONLY IN THE QUANTITIES SPECIFIED. BASEPLATES MAY BE FABRICATED WITH MORE HOLES THAN NEEDED FOR THIS PROJECT.
8. THE ANCHOR BOLT LOCATIONS PROVIDED BY METAL BUILDING MANUFACTURER SATISFY PERTINENT REQUIREMENTS FOR THE DESIGN OF THE MATERIALS SUPPLIED BY THE METAL BUILDING MANUFACTURER. PLEASE NOTE THAT THESE REQUIREMENTS MAY NOT SATISFY ALL ANCHOR BOLT CONCRETE EDGE DISTANCE REQUIREMENTS DEPENDING ON THE DETAILS OF THE FOUNDATION DESIGN. BECAUSE FOUNDATION DESIGN IS NOT WITHIN THE METAL BUILDING MANUFACTURER'S SCOPE OF WORK, IT IS THE RESPONSIBILITY OF THE QUALIFIED PROFESSIONAL DESIGNING THE FOUNDATION TO MAKE CERTAIN THAT SUFFICIENT CONCRETE EDGE DISTANCE IS PROVIDED FOR THE ANCHOR BOLTS IN THE DETAILS OF THE FOUNDATION DESIGN.

ISSUE	RELEASE FOR CONST. (ABP)	DRN	CHK	ENG	PRE	DATE
		BR	TR	JRF	RHB	3/17/20

AMERICAN BUILDING COMPANY  
7200 N. LAKE DRIVE STE. 200  
COLUMBUS, GA 31909  
PHONE: (706) 562-8020  
FAX: (706) 562-8017

PROJECT NAME  
**NIELL'S CREEK CHURCH GYM**  
ANGIER, NC 27501

CUSTOMER NAME  
**ALEXANDER DESIGN BUILD. LLC**  
CLAYTON, NC 27520







JOB NUMBER  
**A20B0267A**

SHEET TITLE  
**ANDWG-1**




This seal pertains only to the materials designed and supplied by the Metal Building Manufacturer on these drawings and the metal building work the Metal Building Manufacturer, product of the Metal Building Manufacturer. The registered professional engineer whose seal appears on these drawings is employed by the Metal Building Manufacturer and does not serve as or represent the project engineer of record and shall not be construed as such.

SHEET  
**AB-1**

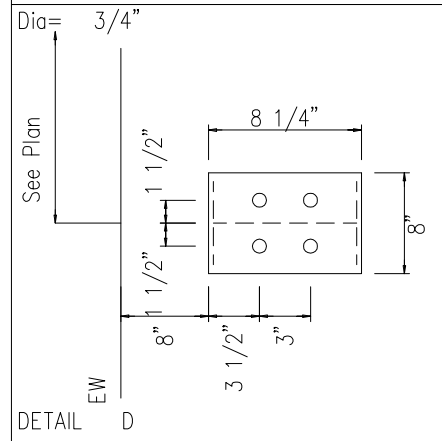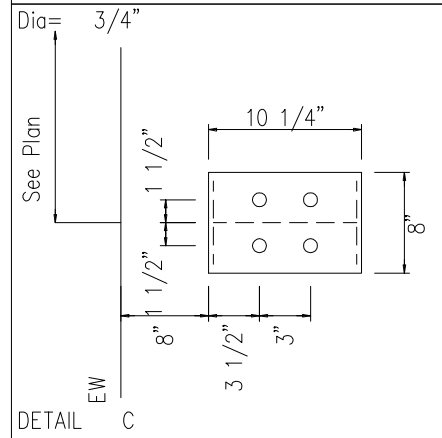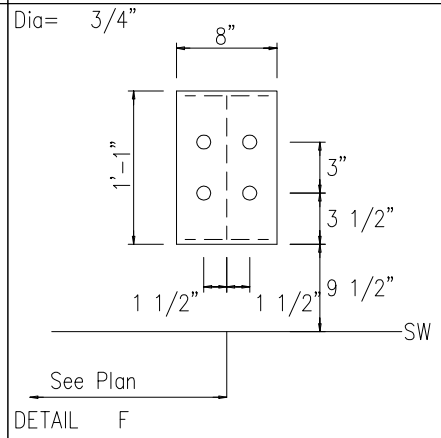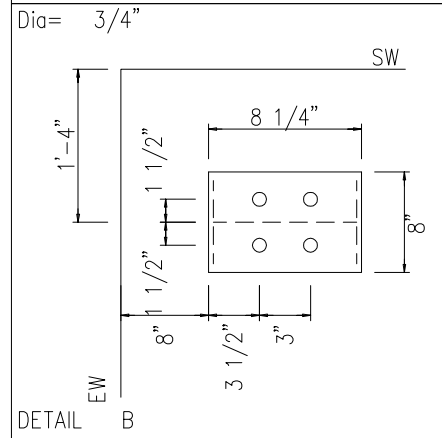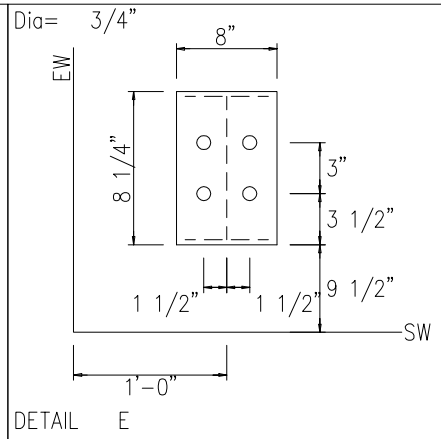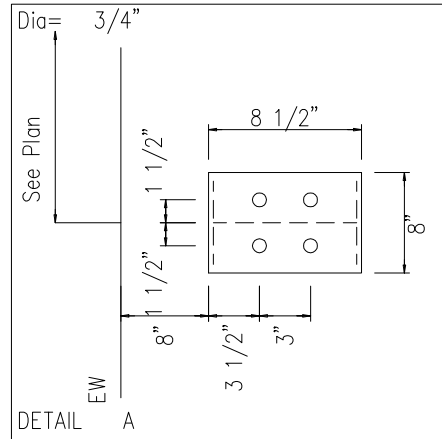


**FOUNDATION DESIGN NOTES:**

1. THE ORIENTATION OF THE ANCHOR BOLT DETAILS SHOWN ON THIS PAGE MAY NOT COINCIDE WITH THE ACTUAL COLUMN ORIENTATION SHOWN ON THE ANCHOR BOLT DRAWING. PLEASE REFERENCE THE SIDEWALL (SW) AND ENDWALL (EW) STEEL LINES SHOWN ON THE ANCHOR BOLT PLAN DURING LAYOUT OF COLUMN AND ANCHOR BOLT LOCATIONS.
2. COLUMN BASE PLATES MAY HAVE MORE HOLES THAN ARE REQUIRED DUE TO PRODUCTION LIMITATIONS. PLEASE FOLLOW ANCHOR BOLT DETAILS FOR QUANTITY OF ANCHOR BOLTS REQUIRED. EXTRA BASE PLATE HOLES DO NOT NEED INFILLED PER THE MBS DESIGN SPECIFICATIONS.

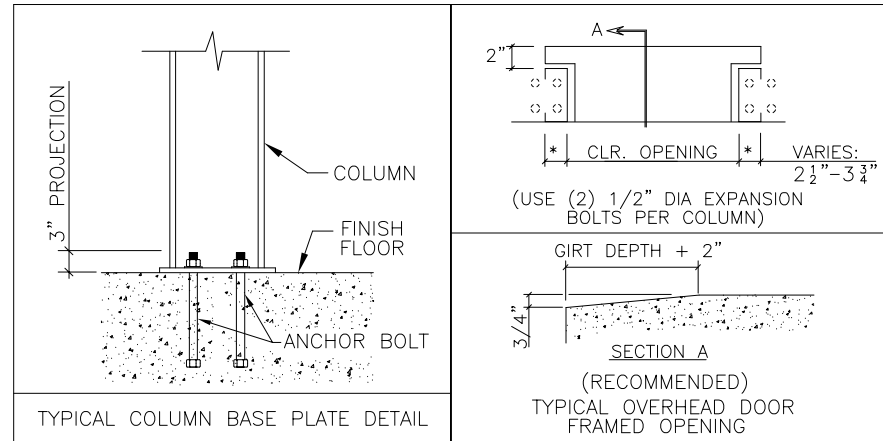

PROJECT NAME <b>NIELL'S CREEK CHURCH GYM</b> ANGIER, NC 27501 CUSTOMER NAME <b>ALEXANDER DESIGN BUILD, LLC</b> CLAYTON, NC 27520 JOB NUMBER <b>A20B0267A</b>	ISSUE RELEASE FOR CONST. (ABP)	DRWN	CHK	ENG - PE	DATE
		BR	TR	RHB	3/17/20
This seal pertains only to the materials designed and supplied by the Metal Building Manufacturers Association and the metal building products manufactured by the Metal Building Manufacturer. The registered professional engineer whose seal appears on these drawings is employed by the Metal Building Manufacturer and does not serve as or represent the project engineer of record and shall not be construed as such.					
SHEET <b>AB-2</b>					



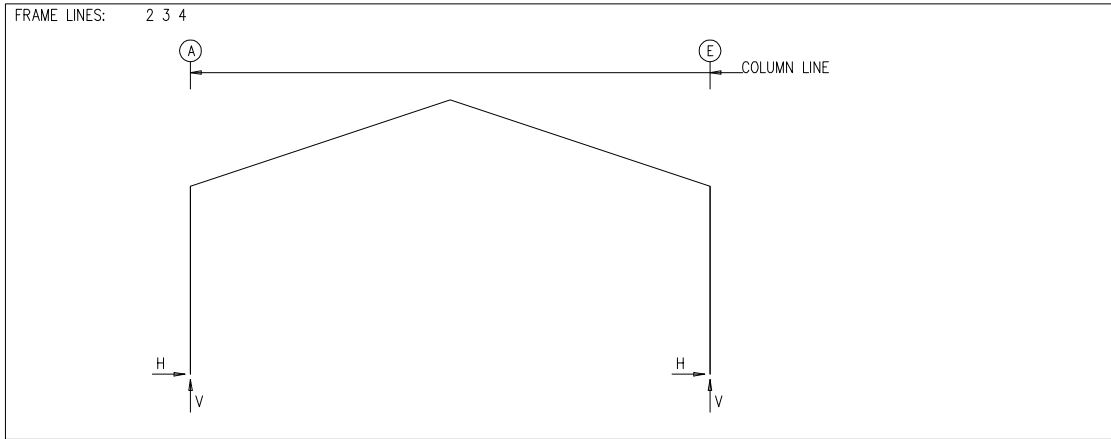

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

Frm Line	Col Line	Anc. Bolt Qty	Anc. Bolt Dia	Base Plate (in)		Thick	Grout (in)
				Width	Length		
2*	A	4	0.750	8.000	13.00	0.375	0.0
2*	E	4	0.750	8.000	13.00	0.375	0.0

2\* Frame lines: 2 3 4

ENDWALL COLUMN: ANCHOR BOLTS & BASE PLATES

Frm Line	Col Line	Anc. Bolt Qty	Anc. Bolt Dia	Base Plate (in)		Thick	Grout (in)
				Width	Length		
1	A	4	0.750	8.000	8.250	0.375	0.0
1	B	4	0.750	8.000	8.500	0.375	0.0
1	D	4	0.750	8.000	8.500	0.375	0.0
1	E	4	0.750	8.000	8.250	0.375	0.0
5	E	4	0.750	8.000	8.250	0.375	0.0
5	C	4	0.750	8.000	10.25	0.375	0.0
5	B	4	0.750	8.000	8.250	0.375	0.0
5	A	4	0.750	8.000	8.250	0.375	0.0

GENERAL NOTES

- ALL LOADING CONDITIONS ARE EXAMINED. THE MAXIMUM AND MINIMUM HORIZONTAL (H) AND VERTICAL (V) REACTIONS AND THE CORRESPONDING VERTICAL (V) OR HORIZONTAL (H) REACTIONS ARE REPORTED.
- REACTIONS ARE PROVIDED BY LOAD CASE IN ORDER TO AID THE FOUNDATION ENGINEER IN DETERMINING THE APPROPRIATE LOAD FACTORS AND COMBINATION TO BE USED WITH EITHER WORKING STRESS OR ULTIMATE STRENGTH DESIGN METHODS. WIND LOAD CASES ARE GIVEN FOR EACH PRIMARY WIND DIRECTION.
- FOR ASCE7-10 AND LATER BASED BUILDING CODES THE UNFACTORED LOAD CASE REACTIONS DUE TO WIND ARE GENERATED USING ULTIMATE DESIGN WIND SPEEDS (Vult).
- POSITIVE (+) REACTIONS ARE AS SHOWN ABOVE. FOUNDATION LOADS ARE IN OPPOSITE DIRECTIONS.
- BRACING REACTIONS ARE IN THE PLANE OF THE BRACE WITH THE HORIZONTAL REACTION (H) ACTING AWAY FROM THE BRACED BAY AND THE VERTICAL REACTION (V) ACTING DOWNWARD.

\*\*\*\*\* RIGID FRAME LOAD CASE ABBREVIATIONS: \*\*\*\*\*

Wind\_L1/Wind\_R1: LATERAL WIND FROM THE LEFT/RIGHT, CASE 1  
 Wind\_L2/Wind\_R2: LATERAL WIND FROM THE LEFT/RIGHT, CASE 2  
 Wind\_Ln1/Wind\_Ln2: LONGITUDINAL WIND, CASE 1/2  
 Seismic\_L/Seismic\_R: LATERAL SEISMIC LOAD FROM LEFT/RIGHT  
 LWIND#\_L#/E/WIND#\_R#: LONGITUDINAL WIND EDGE ZONES  
 F#UNB\_SL\_L/F#UNB\_SL\_R: UNBALANCED ROOF SNOW WITH WIND FROM LEFT/RIGHT  
 F#PAT\_LL #/F#PAT\_SL #: PARTIAL LIVE/SNOW LOADING FOR CONTINUOUS BEAM SYSTEMS

\*\*\*\*\* ENDWALL COLUMN LOAD CASE ABBREVIATIONS: \*\*\*\*\*

Collat: COLLATERAL LOAD  
 Rafter Wind\_L/Rafter Wind\_R: LATERAL WIND FROM THE LEFT/RIGHT  
 Brace Wind\_L/Brace Wind\_R: LATERAL WIND FROM THE LEFT/RIGHT  
 Wind\_P/Wind\_S: LONGITUDINAL WIND PRESSURE/SUCTION ON COLUMNS  
 Wind\_Ln: LONGITUDINAL WIND SUCTION ON ROOF  
 Seis\_L/Seis\_R: LATERAL SEISMIC LOAD FROM LEFT/RIGHT  
 E#UNB\_SL\_L/E#UNB\_SL\_R: UNBALANCED ROOF SNOW WITH WIND FROM LEFT/RIGHT  
 E#PAT\_LL #/E#PAT\_SL #: PARTIAL LIVE/SNOW LOADING FOR CONTINUOUS BEAM SYSTEMS

RIGID FRAME: BASIC COLUMN REACTIONS (k)

Frame Line	Column Line	Dead Horiz	Dead Vert	Collateral Horiz	Collateral Vert	Live Horiz	Live Vert	Snow Horiz	Snow Vert	Wind_Left1 Horiz	Wind_Left1 Vert	Wind_Right1 Horiz	Wind_Right1 Vert
2*	A	1.4	3.9	1.0	2.5	3.8	9.7	3.0	7.6	-9.2	-15.0	2.3	-9.4
2*	E	-1.4	3.9	-1.0	2.5	-3.8	9.7	-3.0	7.6	-2.3	-9.4	9.2	-15.0

Frame Line	Column Line	Wind_Left2 Horiz	Wind_Left2 Vert	Wind_Right2 Horiz	Wind_Right2 Vert	Wind_Long1 Horiz	Wind_Long1 Vert	Wind_Long2 Horiz	Wind_Long2 Vert	Seismic_Left Horiz	Seismic_Left Vert	Seismic_Right Horiz	Seismic_Right Vert
2*	A	-9.9	-9.2	1.6	-3.6	0.9	-12.1	-0.9	-11.0	-0.7	-0.5	0.7	0.5
2*	E	-1.6	-3.6	9.9	-9.2	0.9	-11.0	-0.9	-12.1	-0.7	0.5	0.7	-0.5

Frame Line	Column Line	F1UNB_SL_L Horiz	F1UNB_SL_L Vert	F1UNB_SL_R Horiz	F1UNB_SL_R Vert
2*	A	2.7	7.6	2.7	4.6
2*	E	-2.7	4.6	-2.7	7.6

2\* Frame lines: 2 3 4

ENDWALL COLUMN: BASIC COLUMN REACTIONS (k)

Frm Line	Col Line	Dead Vert	Collat Vert	Live Vert	Snow Vert	Wind_Left1 Vert	Wind_Right1 Vert	Wind_Left2 Vert	Wind_Right2 Vert	Wind Press Horiz	Wind Suct Horiz	Wind Long1 Vert	Wind Long2 Vert
1	A	0.5	0.2	1.4	0.7	-1.3	-2.1	-0.1	-0.9	-1.5	1.8	-2.0	-1.1
1	B	2.1	1.1	6.9	3.3	-7.7	-4.6	-5.9	-2.8	-4.6	5.1	-7.0	-4.8
1	D	2.1	1.1	6.9	3.3	-4.6	-7.7	-2.8	-5.9	-4.6	5.1	-4.8	-7.0
1	E	0.5	0.2	1.4	0.7	-2.1	-1.3	-0.9	-0.1	-1.5	1.8	-1.1	-2.0

Frm Line	Col Line	Seis Left Vert	Seis Right Vert	E1UNB_SL_L Horiz	E1UNB_SL_L Vert	E1UNB_SL_R Horiz	E1UNB_SL_R Vert	E1PAT_LL_1 Horiz	E1PAT_LL_1 Vert	E1PAT_LL_2 Horiz	E1PAT_LL_2 Vert	E1PAT_LL_3 Horiz	E1PAT_LL_3 Vert
1	A	0.3	0.1	0.0	0.5	0.0	0.0	0.0	2.2	0.0	-0.8	0.0	1.3
1	B	-0.5	0.0	0.0	4.0	0.0	1.9	0.0	2.4	0.0	4.6	0.0	7.2
1	D	0.0	-0.5	0.0	1.9	0.0	4.0	0.0	2.4	0.0	4.6	0.0	4.3
1	E	0.1	0.3	0.0	0.0	0.0	0.5	0.0	2.2	0.0	-0.8	0.0	-0.7

Frm Line	Col Line	E1PAT_LL_4 Horiz	E1PAT_LL_4 Vert
1	A	0.0	-0.7
1	B	0.0	4.3
1	D	0.0	7.2
1	E	0.0	1.3

Frm Line	Col Line	Dead Vert	Collat Vert	Live Vert	Snow Vert	Wind_Left1 Vert	Wind_Right1 Vert	Wind_Left2 Vert	Wind_Right2 Vert	Wind Press Horiz	Wind Suct Horiz	Wind Long1 Vert	Wind Long2 Vert
5	E	0.8	0.4	2.2	1.1	-2.5	-3.2	-1.0	-1.6	-2.0	2.3	-3.2	-1.8
5	C	2.0	1.1	6.7	3.2	-7.3	-3.9	-5.7	-2.3	-5.0	5.5	-6.4	-4.6
5	B	1.5	0.9	5.5	2.6	-4.3	-6.5	-2.8	-5.0	-4.1	4.5	-3.4	-6.3
5	A	0.6	0.3	1.7	0.8	-1.3	-1.8	0.0	-0.6	-1.5	1.8	-1.5	-1.8

Frm Line	Col Line	Seis Left Vert	Seis Right Vert	E2UNB_SL_L Horiz	E2UNB_SL_L Vert	E2UNB_SL_R Horiz	E2UNB_SL_R Vert	E2PAT_LL_1 Horiz	E2PAT_LL_1 Vert	E2PAT_LL_2 Horiz	E2PAT_LL_2 Vert	E2PAT_LL_3 Horiz	E2PAT_LL_3 Vert
5	E	0.1	-0.1	0.0	1.1	0.0	0.2	0.0	2.7	0.0	-0.3	0.0	2.3
5	C	-0.1	0.1	0.0	3.9	0.0	1.9	0.0	3.3	0.0	3.2	0.0	6.9
5	B	-0.2	-0.1	0.0	1.1	0.0	3.4	0.0	2.0	0.0	3.5	0.0	2.8
5	A	0.3	0.0	0.0	0.2	0.0	0.7	0.0	2.2	0.0	-0.5	0.0	-0.3

Frm Line	Col Line	E2PAT_LL_4 Horiz	E2PAT_LL_4 Vert
5	E	0.0	-0.3
5	C	0.0	2.9
5	B	0.0	6.1
5	A	0.0	1.5

BUILDING BRACING REACTIONS

Wall Loc	Col Line	Wind Horiz	Wind Vert	Seismic Horiz	Seismic Vert	Panel_Shear (lb/ft)
L_EW	1	B,D	3.6	3.4	3.9	3.6
F_SW	E	2,3	5.4	3.5	4.3	2.8
R_EW	5	B,A	3.5	5.7	0.9	1.5
B_SW	A	3,2	5.4	3.5	4.3	2.8



PROJECT NAME	NIELL'S CREEK CHURCH GYM
PROJECT ADDRESS	ANGIER, NC 27501
CUSTOMER NAME	ALEXANDER DESIGN BUILD, LLC
CUSTOMER ADDRESS	CLAYTON, NC 27520
JOB NUMBER	A20B0267A
SHEET TITLE	ANDWG-3
DATE	3/17/20
PREPARED BY	RHB
CHECKED BY	TR
DESIGNED BY	BR
ISSUE FOR	RELEASE FOR CONST. (ABP)

7200 N. LAKE DRIVE STE. 200  
 COLUMBUS, GA 31909  
 PHONE: (706) 562-8020  
 FAX: (706) 562-8017

AMERICAN BUILDING COMPANY


This seal pertains only to the materials designed and supplied by the Metal Building Manufacturers Association and the metal building manufacturer. The registered professional engineer whose seal appears on these drawings is employed by the Metal Building Manufacturer and does not serve as or represent the project engineer of record and shall not be construed as such.

AB-3

SPLICE PLATE & BOLT TABLE									
Mark	Qty		Int	Type	Dia	Length	Width	Thick	Length
	Top	Bot							
SP-1	4	4	0	A325	0.625	2.25	6"	5/8"	2'-6 7/8"
SP-2	4	4	0	A325	0.625	2.25	6"	3/8"	1'-7 1/4"

▽ FLANGE BRACES: (1) One Side; (2) Two Sides  
A - L2525105

CONNECTION PLATES		
ID	Qty	Mark/Part
1	8	FBL&N01

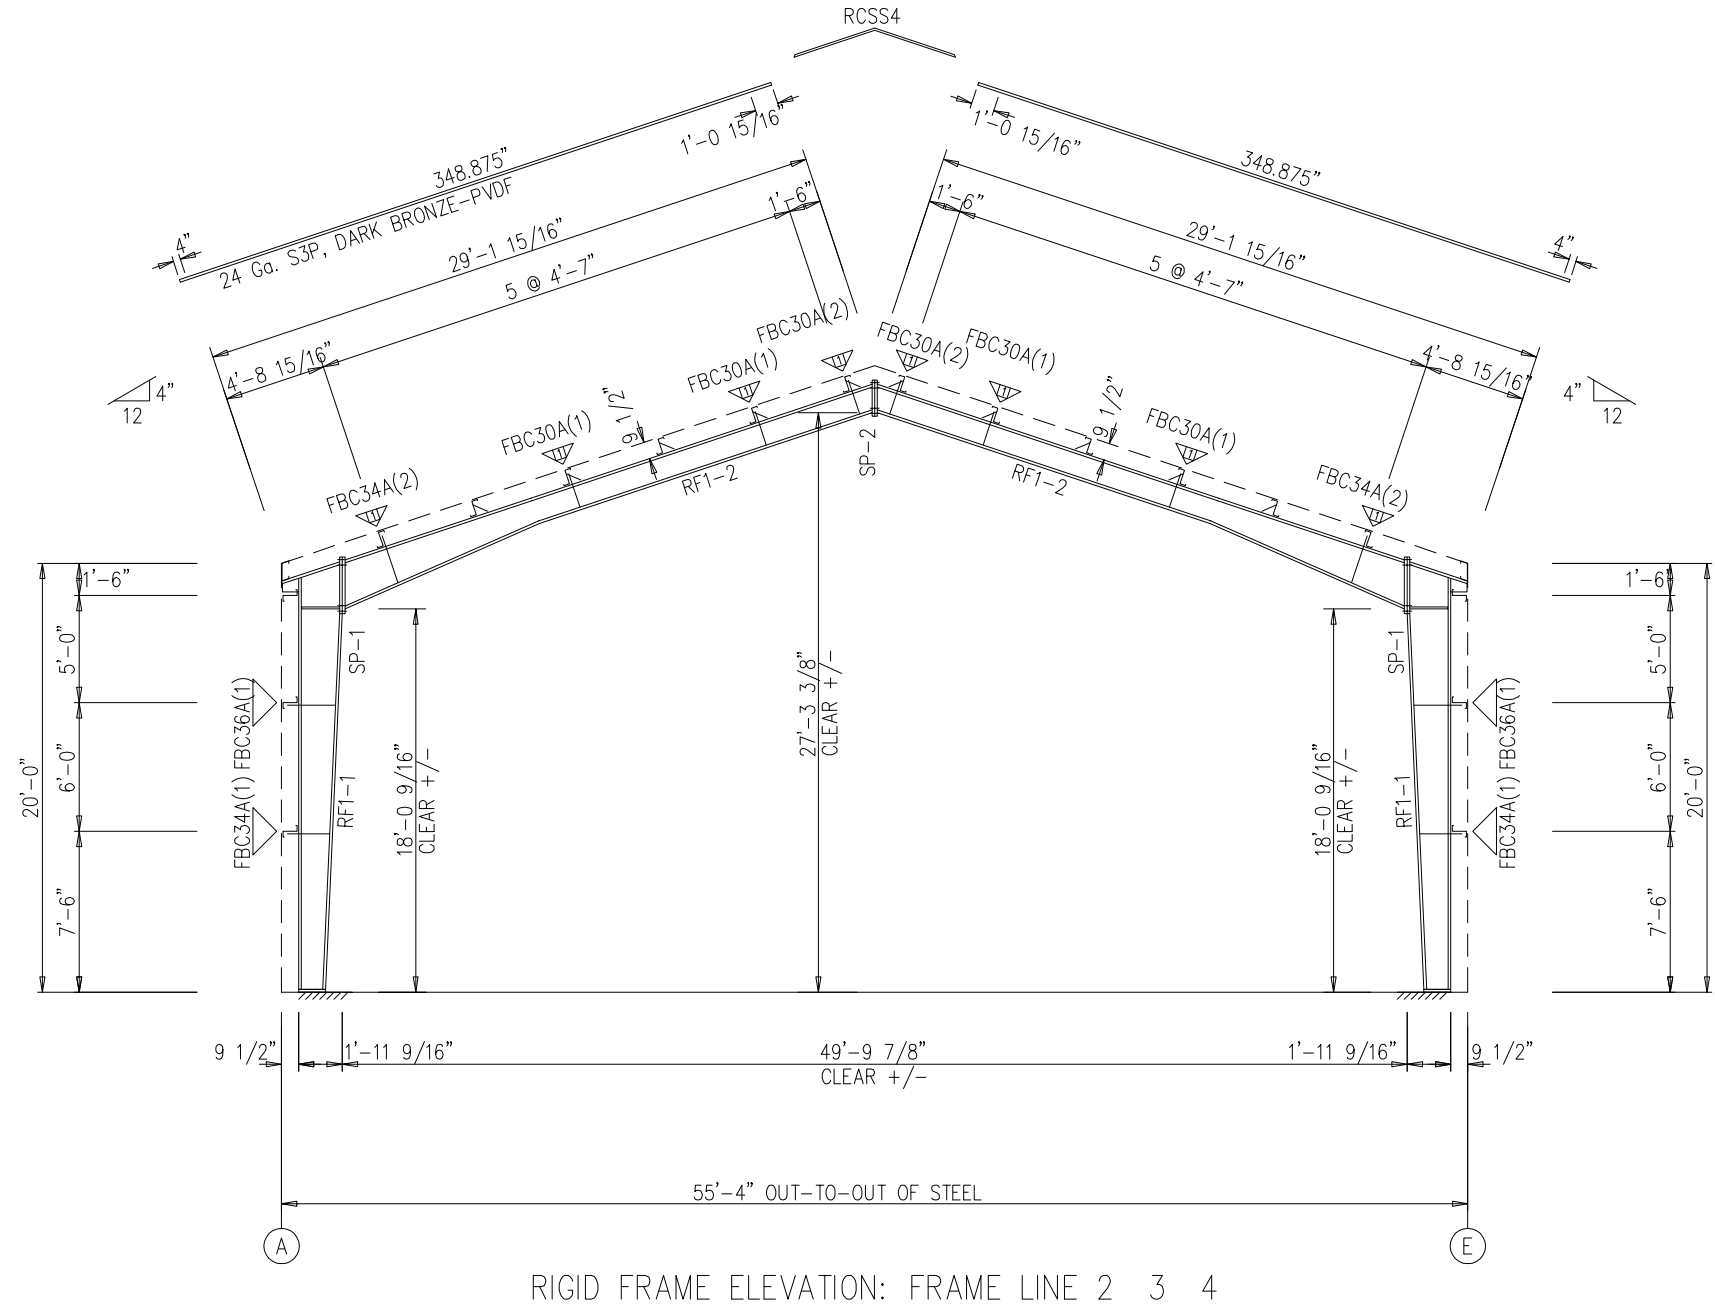


RIGID FRAME ELEVATION: FRAME LINE 2 3 4



<p>PROJECT NAME <b>NIELL'S CREEK CHURCH GYM</b> ANGIER, NC 27501</p> <p>CUSTOMER NAME <b>ALEXANDER DESIGN BUILD. LLC</b> CLAYTON, NC 27520</p> <p>JOB NUMBER <b>A20B0267A</b></p>	<p>ISSUE RELEASE FOR PERMIT</p>	<p>DATE 3/17/20</p>	<p>PREPARED BY RHB</p>	<p>CHECKED BY TR</p>	<p>DATE 3/17/20</p>
<p>AMERICAN BUILDINGS COMPANY</p> <p>7200 N. LAKE DRIVE STE. 200 COLUMBUS, GA 31909 PHONE: (706) 562-8020 FAX: (706) 562-8017</p>					
<p>SHEET TITLE <b>RFDWG-1</b></p>			<p>SHEET <b>E-01</b></p>		

This seal pertains only to the materials designed and supplied by the Metal Building Manufacturers Association and the metal building work that is the direct product of the Metal Building Manufacturer. The registered professional engineer whose seal appears on these drawings is employed by the Metal Building Manufacturer and does not serve as or represent the project engineer of record and shall not be construed as such.

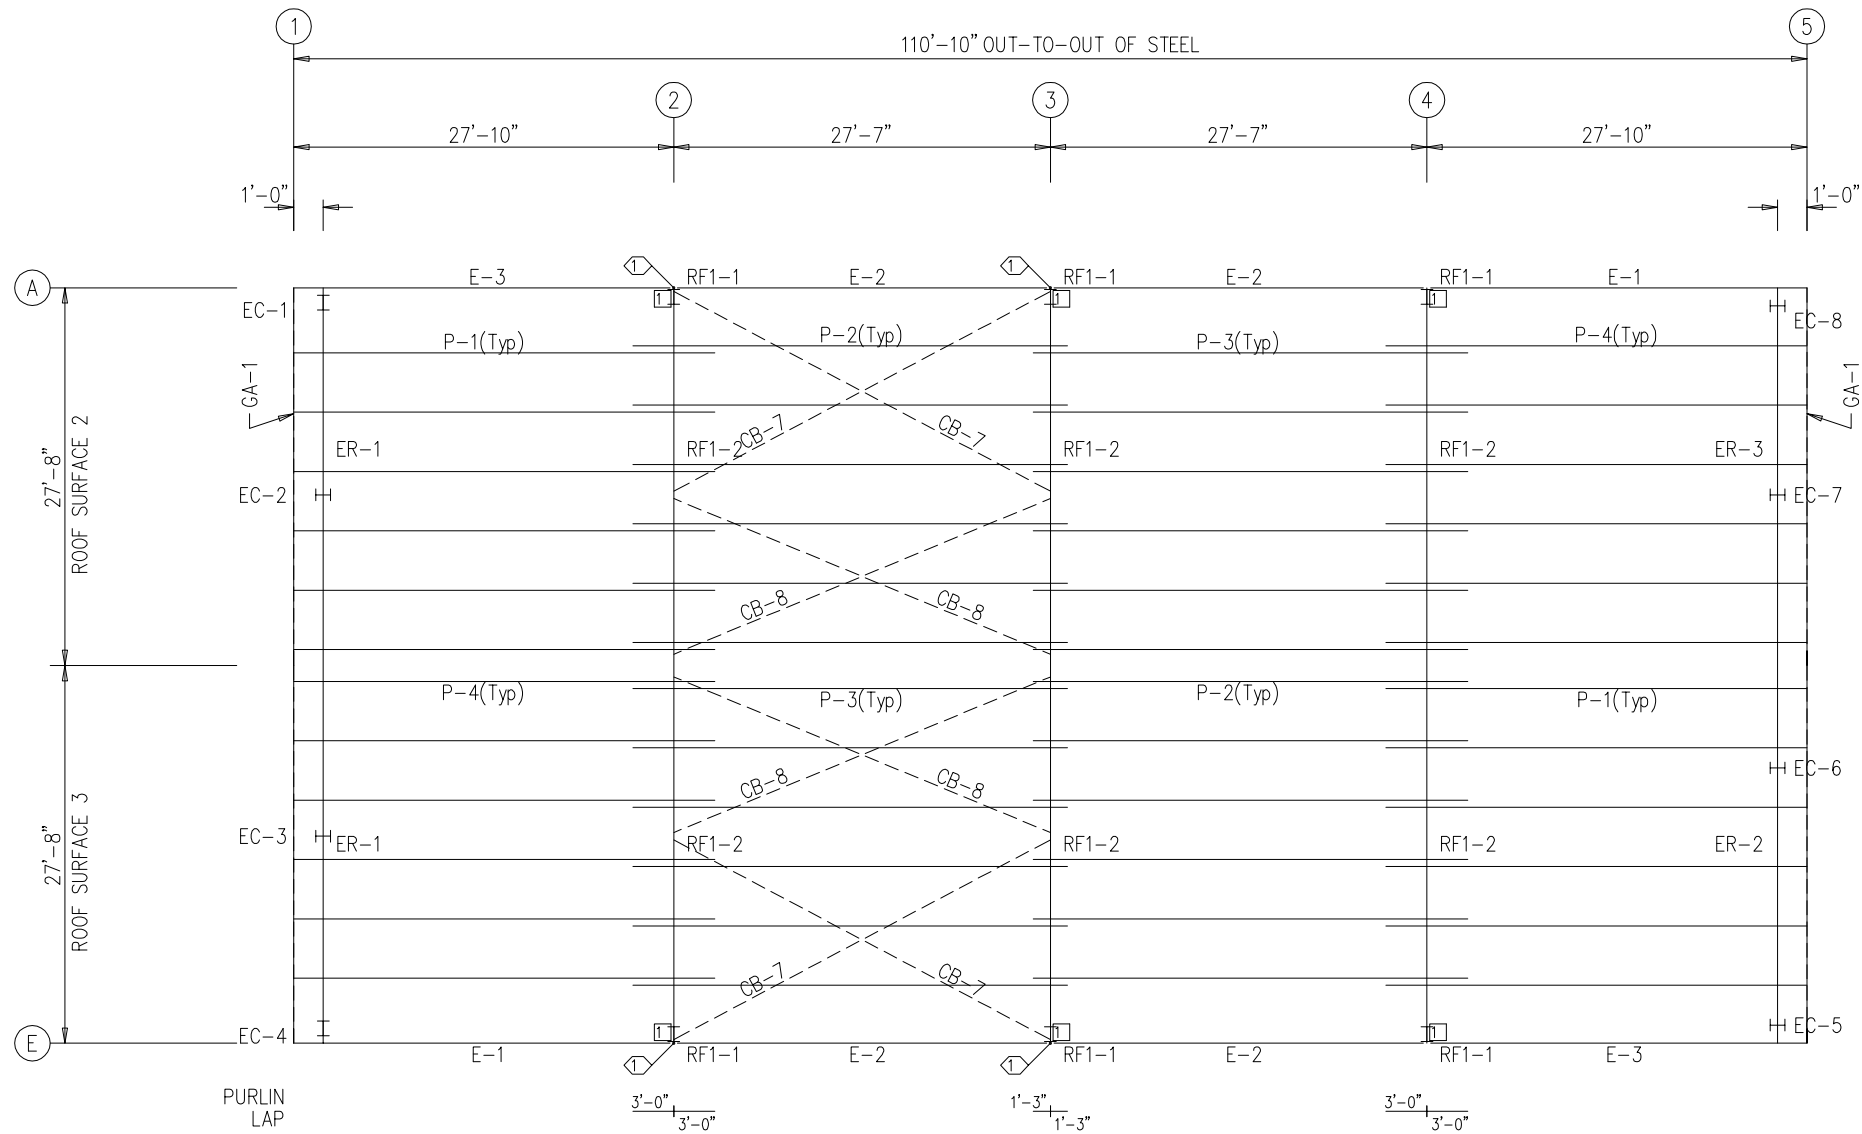

ROOF FRAMING PLAN

TRIM TABLE			
ROOF PLAN			
ID	QUAN	PART	LENGTH
1	8	RCSS4	182.000

SPECIAL BOLTS					
ROOF PLAN					
ID	QUAN	TYPE	DIA	LENGTH	WASH
1	4	A325	1/2"	2"	1


MEMBER TABLE		
ROOF PLAN		
MARK	PART	LENGTH
P-1	95Z075	369.750
P-2	95Z067	382.000
P-3	95Z067	382.000
P-4	95Z075	369.750
E-1	95E3060	333.625
E-2	95E3060	330.750
E-3	95E3060	333.625
CB-7	RD05-	378.000
CB-8	RD05-	369.000

CONNECTION PLATES		
ROOF PLAN		
ID	QUAN	MARK/PART
1	6	ESCO2



<p>PROJECT NAME <b>NIELL'S CREEK CHURCH GYM</b> ANGIER, NC 27501</p> <p>CUSTOMER NAME <b>ALEXANDER DESIGN BUILD, LLC</b> CLAYTON, NC 27520</p> <p>JOB NUMBER <b>A20B0267A</b></p>	<p>ISSUE RELEASE FOR PERMIT</p>	<p>DATE 3/17/20</p>	<p>7200 N. LAKE DRIVE STE. 200 COLUMBUS, GA 31909 PHONE: (706) 562-8020 FAX: (706) 562-8017</p>	<p>SHEET TITLE <b>ROOFDWG</b></p>	<p>SHEET <b>E-02</b></p>
---	-------------------------------------	-------------------------	---	---------------------------------------	------------------------------

This seal pertains only to the materials designed and supplied by the Metal Building Manufacturers Association and the metal building work is the product of the Metal Building Manufacturer. The registered professional engineer whose seal appears on these drawings is employed by the Metal Building Manufacturer and does not serve as or represent the project engineer of record and shall not be construed as such.

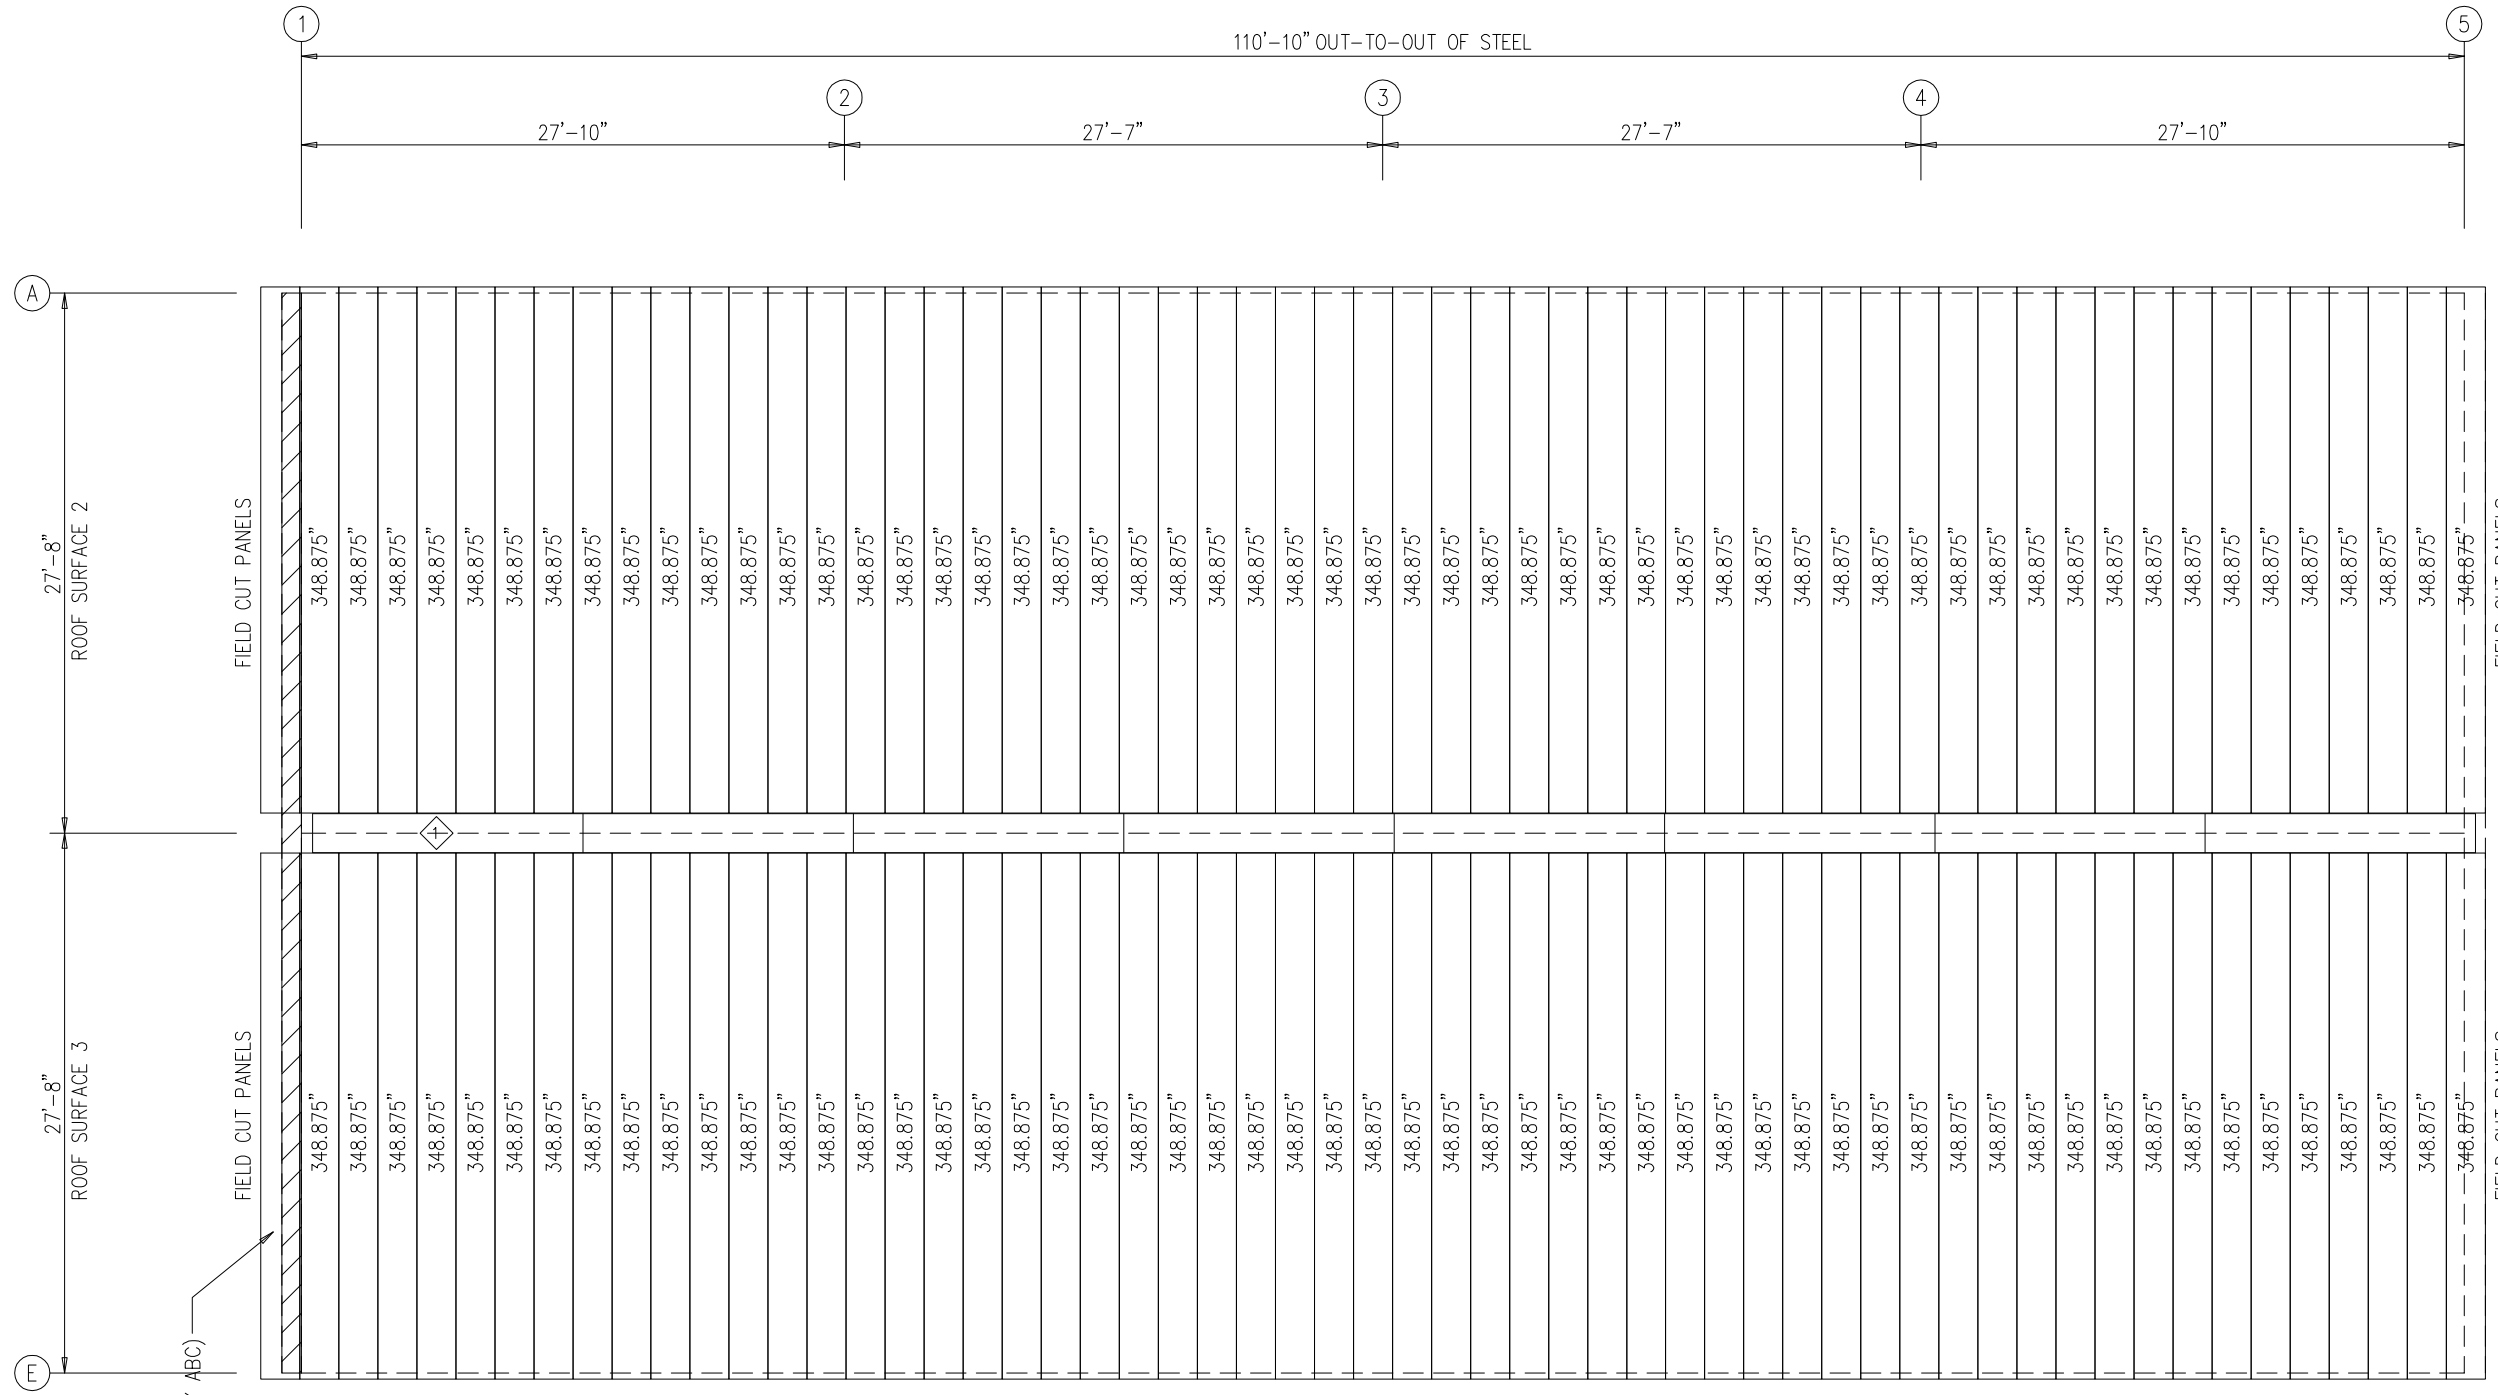

TRIM TABLE			
ROOF PLAN			
ID	QUAN	PART	LENGTH
1	8	RCSS4	182.000

ROOF SHEETING PLAN  
 PANELS: 24 Ga. S3P - DARK BRONZE-PVDF



This seal pertains only to the materials designed and supplied by the Metal Building Manufacturers Association and the metal building work that is the direct product of the Metal Building Manufacturer. The registered professional engineer whose seal appears on these drawings is employed by the Metal Building Manufacturer and does not serve as or represent the project engineer of record and shall not be construed as such.

PROJECT NAME  
**NIELL'S CREEK CHURCH GYM**  
 ANGLIER, NC 27501

CUSTOMER NAME  
**ALEXANDER DESIGN BUILD. LLC**  
 CLAYTON, NC 27520

JOB NUMBER  
**A20B0267A**

SHEET TITLE  
**ROOFDWG2**

ISSUE  
 RELEASE FOR PERMIT

DATE  
 3/17/20

7200 N. LAKE DRIVE STE. 200  
 COLUMBUS, GA 31909  
 PHONE: (706) 562-8020  
 FAX: (706) 562-8017

AMERICAN BUILDING COMPANY

DATE  
 3/17/20

CHK  
 TR

ENR  
 JRF


PRE  
 RHB

DRN  
 BR


ENG  
 TR

DATE  
 3/17/20

E-03

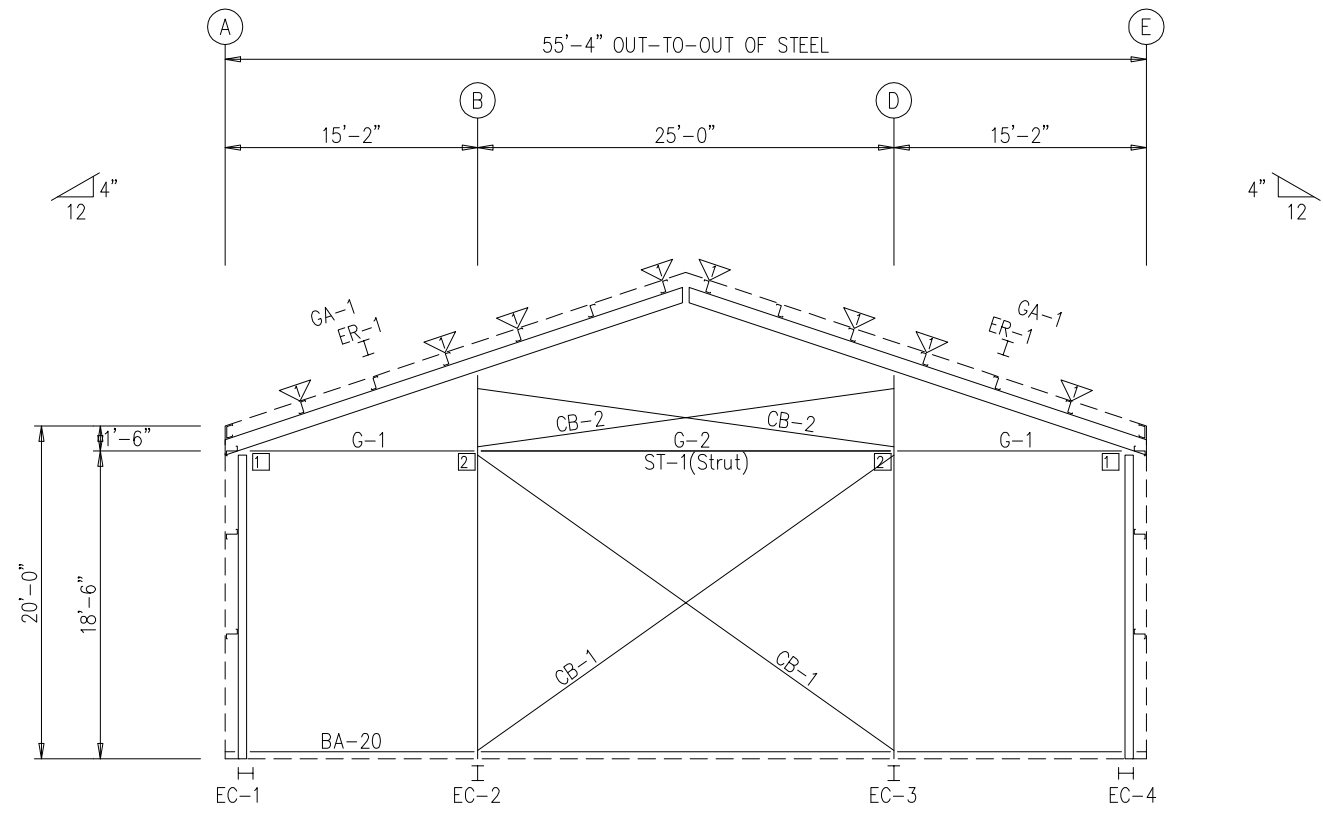

ENDWALL FRAMING: FRAME LINE 1

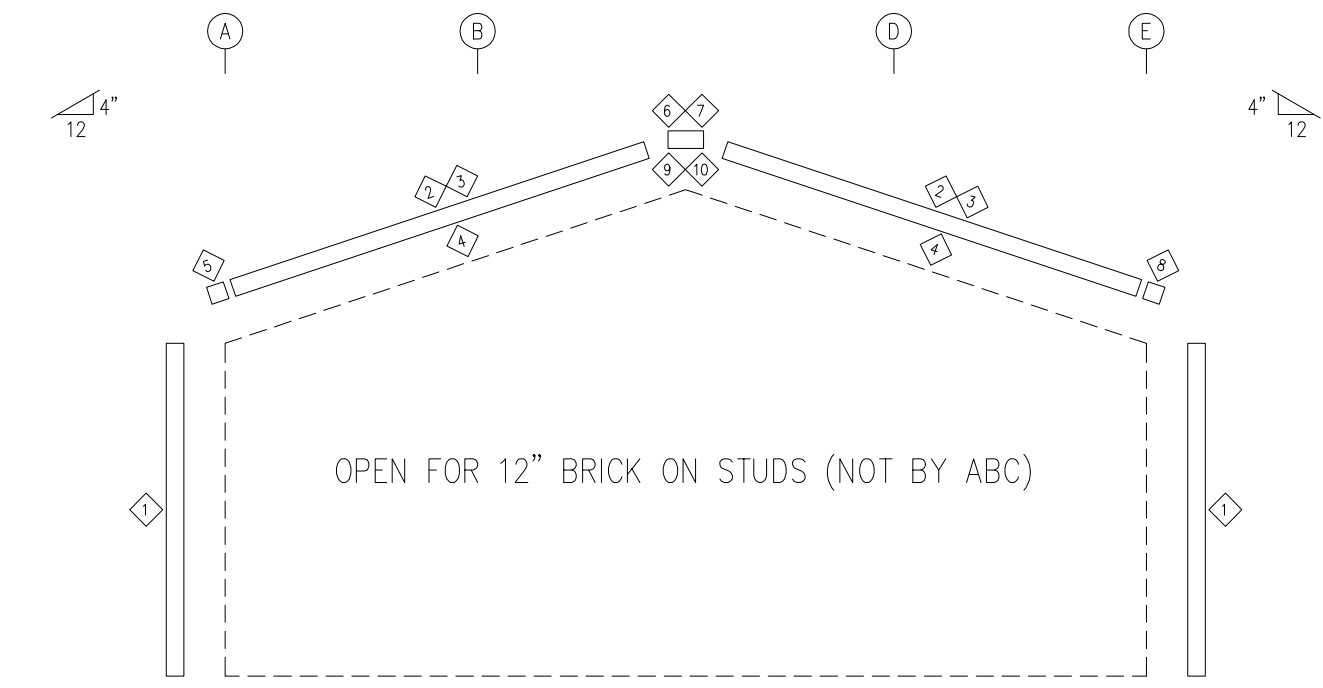

ENDWALL SHEETING & TRIM: FRAME LINE 1

OPEN FOR 12" BRICK ON STUDS (NOT BY ABC)

BOLT TABLE				
FRAME LINE 1				
LOCATION	QUAN	TYPE	DIA	LENGTH
ER-1/ER-1	8	A325	1/2"	2"
Columns/Raf	4	A325	1/2"	2"
Strut	2	A325	1"	3 1/4"

TRIM TABLE		
FRAME LINE 1		
◇ID	PART	LENGTH
1	FCRA2	182.000
2	RSF1	182.000
3	TRU1	182.000
4	MEC3	182.000
5	TRUECL	8.130
6	TRCU4	27.250
7	TRPBB4	7.500
8	TRUECR	8.130
9	ERECSSR	13.125
10	ERECSSL	13.125

MEMBER TABLE		
FRAME LINE 1		
MARK	PART	LENGTH
EC-1	W8x10	226.313
EC-2	W8x18	282.063
EC-3	W8x18	282.063
EC-4	W8x10	226.313
ER-1	W0915525	349.688
G-1	SW12x26	157.625
G-2	SW12x26	287.000
ST-1	W08SB075	294.750
CB-1	RD06-	374.000
CB-2	RD05-	313.000

FLANGE BRACE TABLE			
FRAME LINE 1			
▽ID	#	MARK	CLIP
1	1	FBC30	FBL&N01

CONNECTION PLATES	
FRAME LINE 1	
◇ID	MARK/PART
1	t1
2	t2



DATE	PREPARED BY	ENGINEER	CHECKED BY	DATE
3/17/20	RHB	JRF	TR	

7200 N. LAKE DRIVE STE. 200  
 COLUMBUS, GA 31909  
 PHONE: (706) 562-8020  
 FAX: (706) 562-8017

PROJECT NAME  
**NIELL'S CREEK CHURCH GYM**  
 ANGIER, NC 27501


CUSTOMER NAME  
**ALEXANDER DESIGN BUILD. LLC**  
 CLAYTON, NC 27520

JOB NUMBER  
**A20B0267A**


SHEET TITLE  
**EWDWG-L**

This seal pertains only to the materials designed and supplied by the Metal Building Manufacturers Association and the metal building work is the product of the Metal Building Manufacturer. The registered professional engineer whose seal appears on these drawings is employed by the Metal Building Manufacturer and does not serve as or represent the project engineer of record and shall not be construed as such.

SHEET  
**E-04**

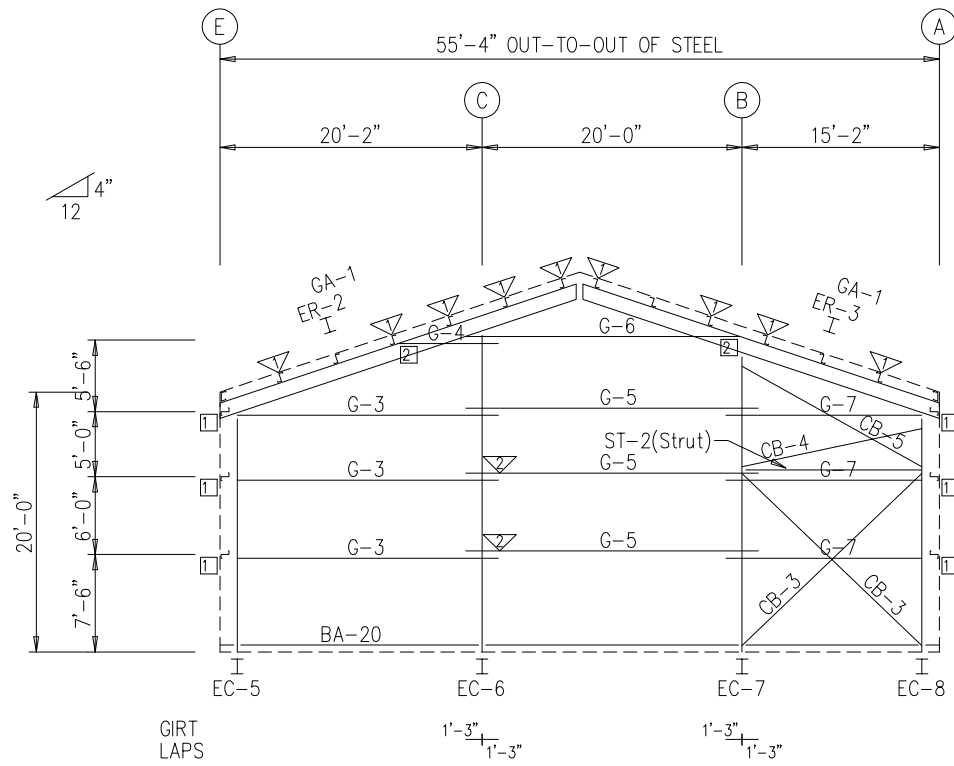

ENDWALL FRAMING: FRAME LINE 5

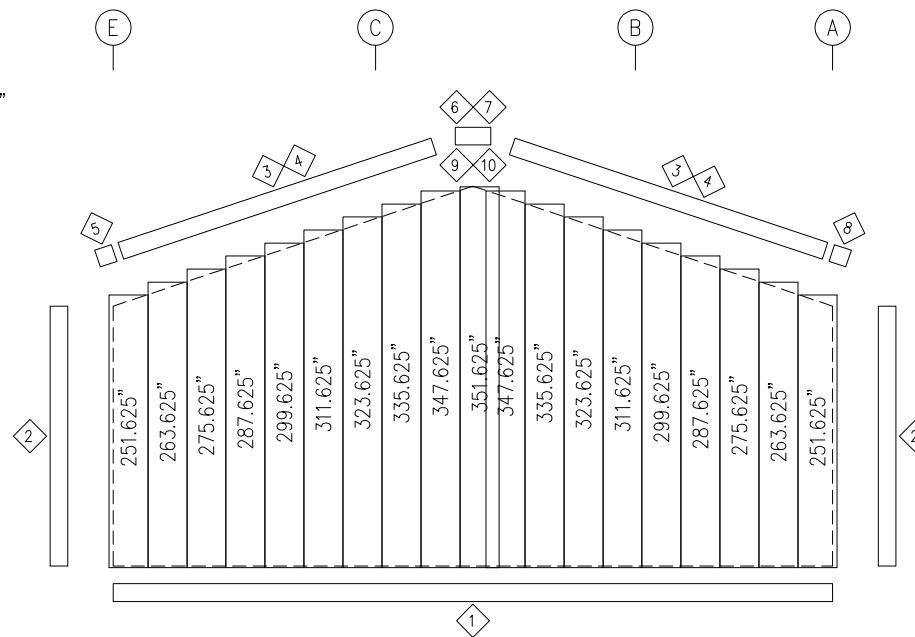

ENDWALL SHEETING & TRIM: FRAME LINE 5

PANELS: 26 Ga. A3P - GALVALUME PLUS

BOLT TABLE FRAME LINE 5				
LOCATION	QUAN	TYPE	DIA	LENGTH
ER-2/ER-3	8	A325	1/2"	2"
Columns/Raf	4	A325	1/2"	2"
Strut	2	A325	1"	3 1/4"

TRIM TABLE FRAME LINE 5		
ID	PART	LENGTH
1	BA-20	240.000
2	FCRA2	182.000
3	TRU1	182.000
4	RSF1	182.000
5	TRUECL	8.130
6	TRCU4	27.250
7	TRPBB4	7.500
8	TRUECR	8.130
9	ERECSSR	13.125
10	ERECSSL	13.125

MEMBER TABLE FRAME LINE 5		
MARK	PART	LENGTH
EC-5	W8x10	226.500
EC-6	W10x15	301.813
EC-7	W8x10	281.813
EC-8	W8x10	226.500
ER-2	W0915525	349.688
ER-3	W0915525	349.688
G-3	08Z054	247.000
G-4	08Z054	82.938
G-5	08Z054	270.000
G-6	08Z054	262.938
G-7	08Z054	187.000
ST-2	W08SB075	160.750
CB-3	RD05-	235.000
CB-4	RD05-	180.000
CB-5	RD05-	201.000

FLANGE BRACE TABLE FRAME LINE 5			
ID	# SIDES	MARK	CLIP
1	1	FBC30	FBL&N01
2	1	FBC30	

CONNECTION PLATES FRAME LINE 5	
ID	MARK/PART
1	GCC03
2	GCC12

ISSUE	DATE
RELEASE FOR PERMIT	3/17/20

7200 N. LAKE DRIVE STE. 200  
COLUMBUS, GA 31909  
PHONE: (706) 562-8020  
FAX: (706) 562-8017

PROJECT NAME  
**NIELL'S CREEK CHURCH GYM**  
ANGIER, NC 27501

CUSTOMER NAME  
**ALEXANDER DESIGN BUILD, LLC**  
CLAYTON, NC 27520


JOB NUMBER  
**A20B0267A**

SHEET TITLE  
**EWDWG-R**




This seal pertains only to the materials designed and supplied by the Metal Building Manufacturer. The drawings and the metal building work are the property of the Metal Building Manufacturer. The registered professional engineer whose seal appears on these drawings is employed by the Metal Building Manufacturer and does not serve as or represent the project engineer of record and shall not be construed as such.

SHEET  
**E-05**

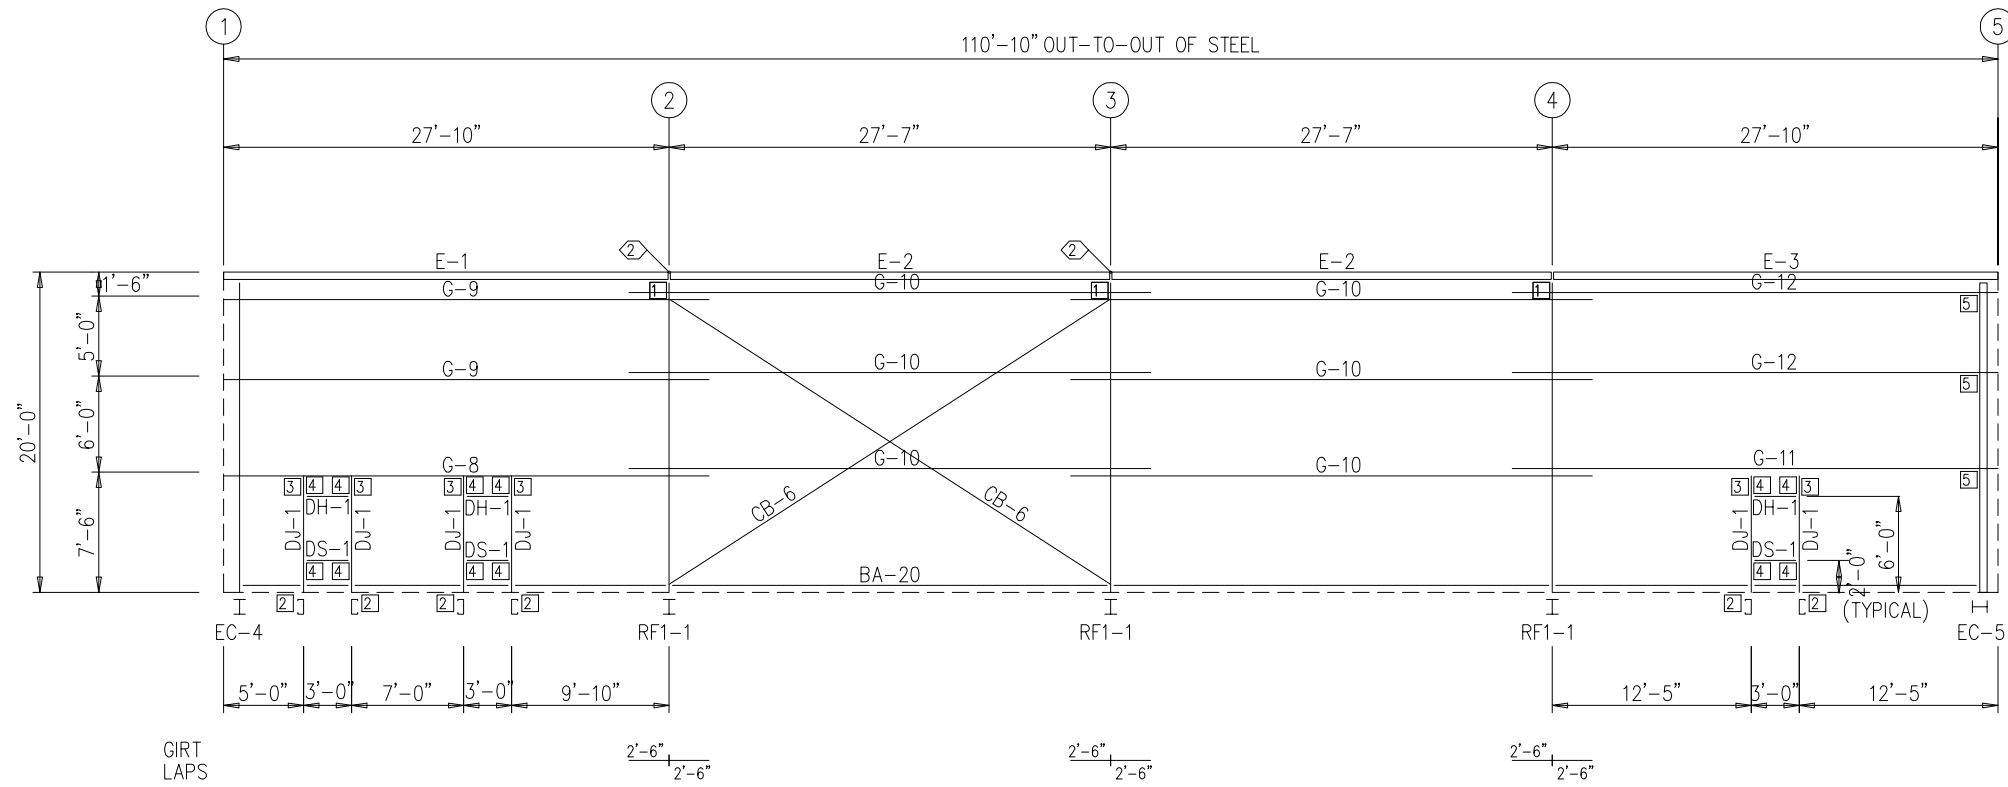

SIDEWALL FRAMING: FRAME LINE E

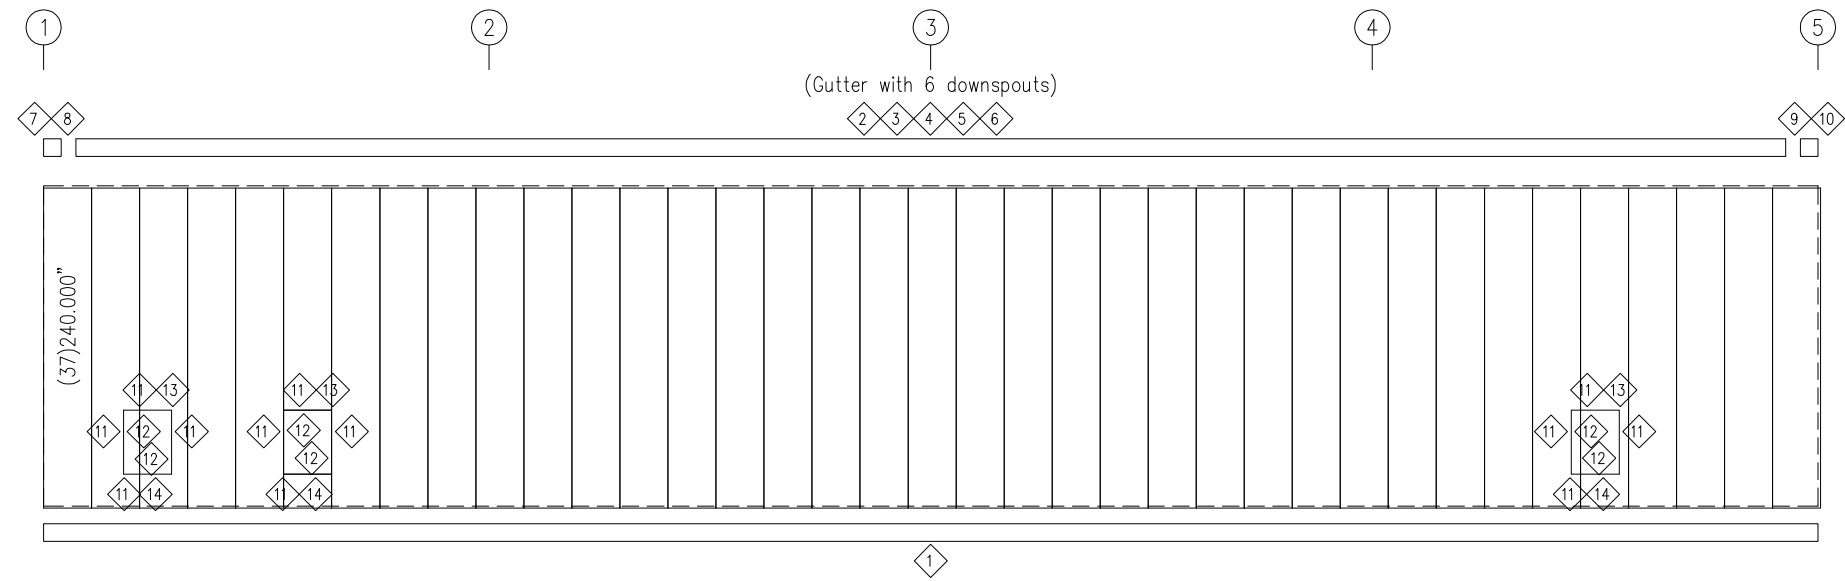

SIDEWALL SHEETING & TRIM: FRAME LINE E  
PANELS: 26 Ga. A3P - GALVALUME PLUS

TRIM TABLE		
FRAME LINE E		
ID	PART	LENGTH
1	BA-20	240.000
2	TGT1	182.000
3	TFEC4	182.000
4	CGB4	7.310
5	GC-A	9.940
6	TFSET	122.000
7	GE1R	9.250
8	TCB4R	15.940
9	GE1L	9.250
10	TCB4L	15.940
11	FOCF95	182.000
12	JTD087	87.000
13	HTA044	44.000
14	FJSJ1	182.000

SPECIAL BOLTS					
ID	QUAN	TYPE	DIA	LENGTH	WASH
2	4	A325	1/2"	2"	1


MEMBER TABLE		
FRAME LINE E		
MARK	PART	LENGTH
DJ-1	F95C060	85.750
DH-1	F95C060	36.000
DS-1	F95C060	36.000
E-1	95E3060	333.625
E-2	95E3060	330.750
E-3	95E3060	333.625
G-8	95Z067	363.750
G-9	95Z060	363.750
G-10	95Z060	391.000
G-11	95Z067	363.750
G-12	95Z060	363.750
CB-6	RD05-	408.000

CONNECTION PLATES	
FRAME LINE E	
ID	MARK/PART
1	ESCO2
2	HCJ01&bh
3	JCT01
4	HCJ01
5	GCC03




<p>PROJECT NAME <b>NIELL'S CREEK CHURCH GYM</b> ANGIER, NC 27501</p> <p>CUSTOMER NAME <b>ALEXANDER DESIGN BUILD, LLC</b> CLAYTON, NC 27520</p> <p>JOB NUMBER <b>A20B0267A</b></p>	<p>ISSUE RELEASE FOR PERMIT</p>	<p>DATE 3/17/20</p>	<p>7200 N. LAKE DRIVE STE. 200 COLUMBUS, GA 31909 PHONE: (706) 562-8020 FAX: (706) 562-8017</p>	<p>SHEET TITLE <b>SWDWG-F</b></p>	<p>SHEET <b>E-06</b></p>
---	-------------------------------------	-------------------------	---	---------------------------------------	------------------------------

This seal pertains only to the materials designed and supplied by the Metal Building Manufacturers Association and the metal building products manufactured by the Metal Building Manufacturer. The registered professional engineer whose seal appears on these drawings is employed by the Metal Building Manufacturer and does not serve as or represent the project engineer of record and shall not be construed as such.

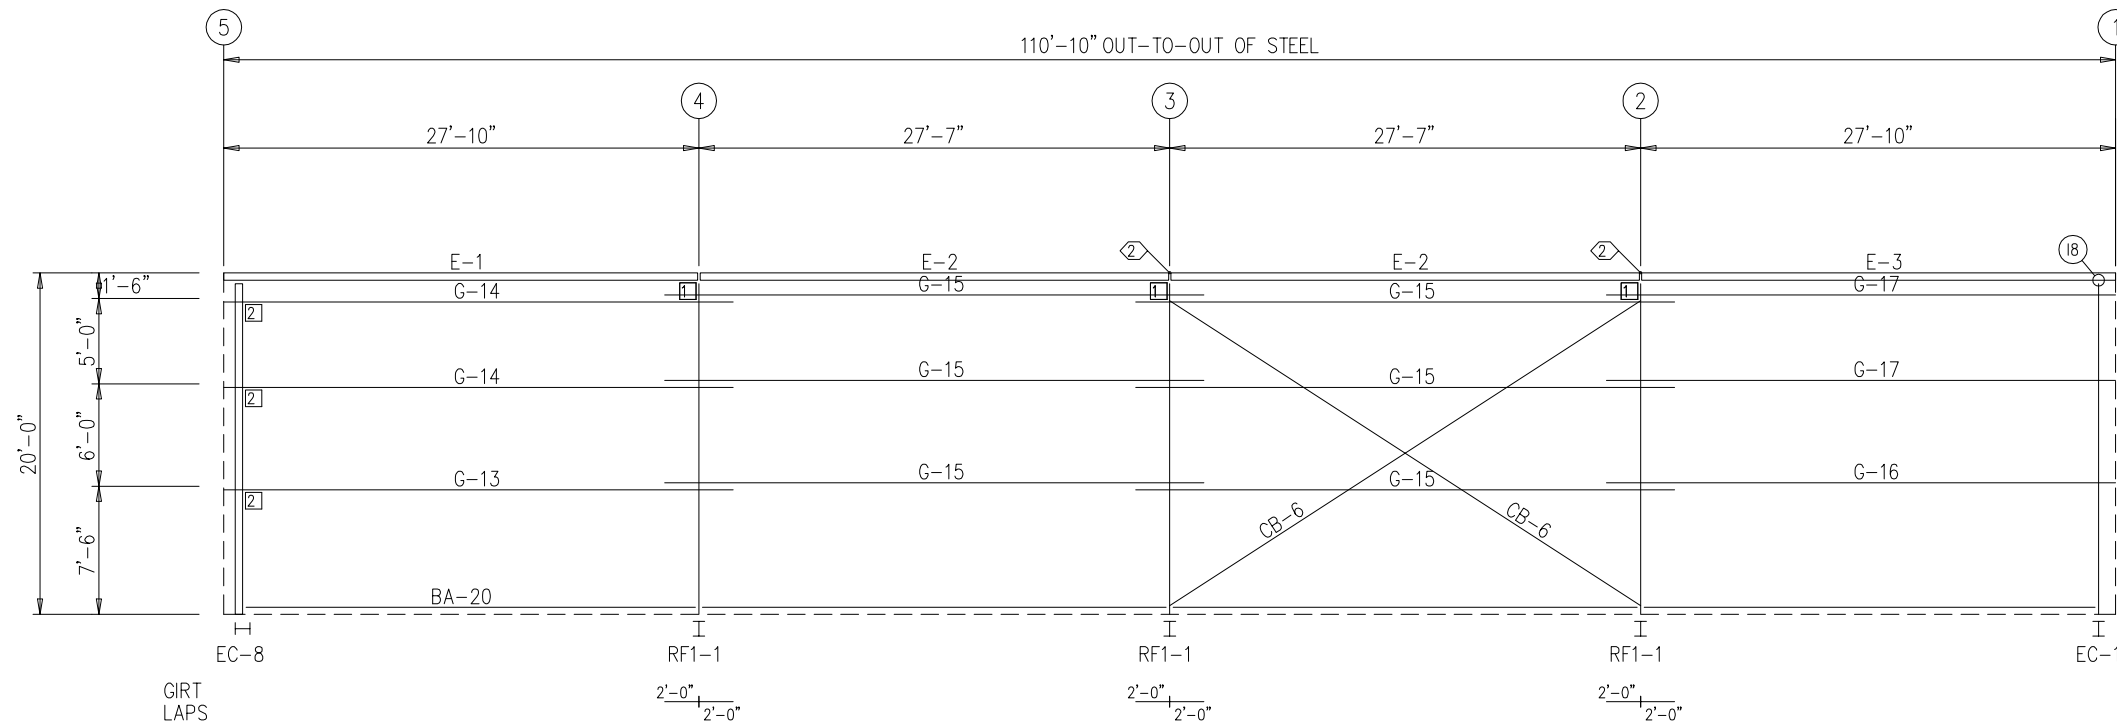

SIDEWALL FRAMING: FRAME LINE A

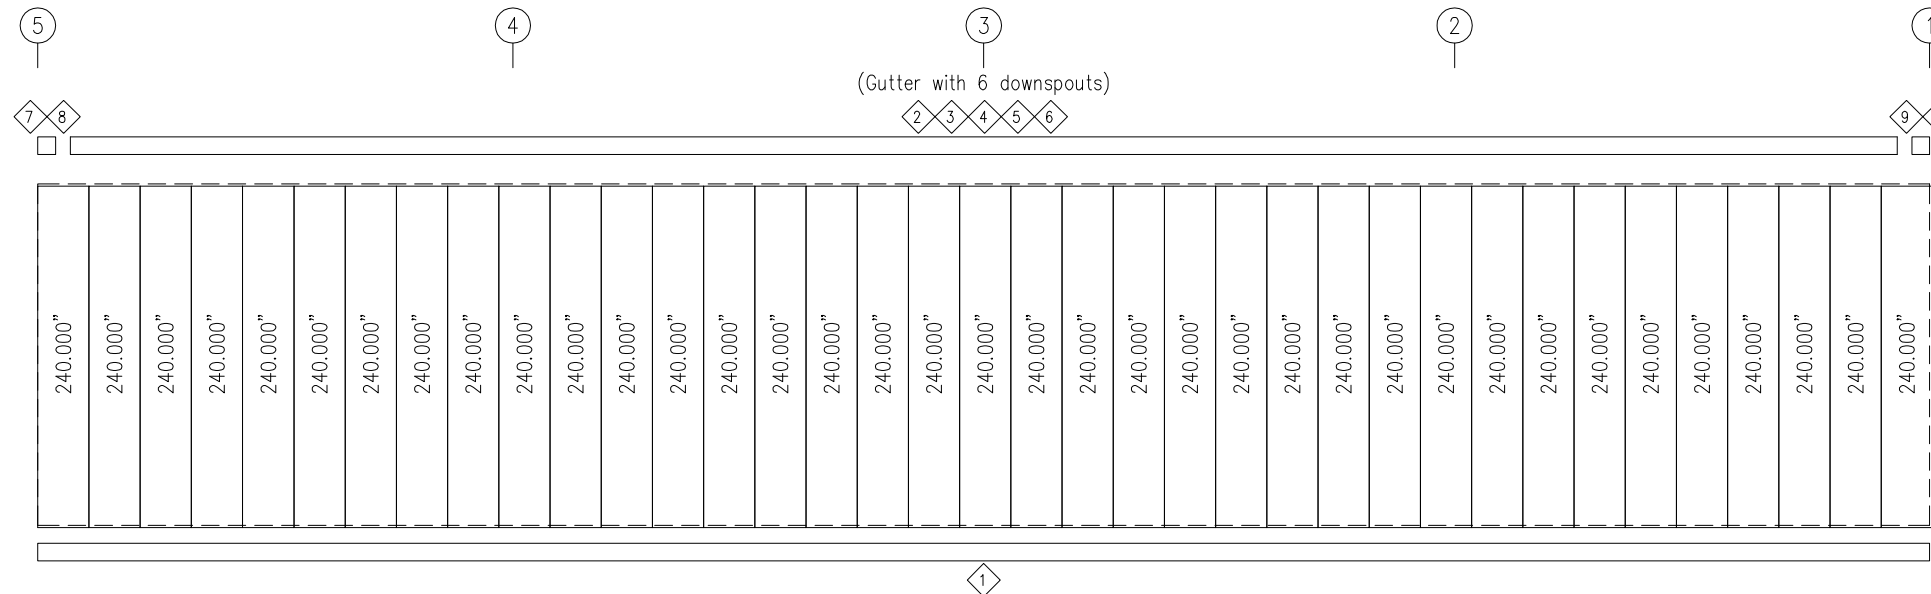

SIDEWALL SHEETING & TRIM: FRAME LINE A  
PANELS: 26 Ga. A3P - GALVALUME PLUS

TRIM TABLE		
FRAME LINE A		
◇ ID	PART	LENGTH
1	BA-20	240.000
2	TGT1	182.000
3	TFEC4	182.000
4	CGB4	7.310
5	GC-A	9.940
6	TFSET	122.000
7	GE1R	9.250
8	TCB4R	15.940
9	GE1L	9.250
10	TCB4L	15.940

SPECIAL BOLTS					
○ ID	QUAN	TYPE	DIA	LENGTH	WASH
2	4	A325	1/2"	2"	1

MEMBER TABLE		
FRAME LINE A		
MARK	PART	LENGTH
E-1	95E3060	333.625
E-2	95E3060	330.750
E-3	95E3060	333.625
G-13	95Z067	357.750
G-14	95Z060	357.750
G-15	95Z060	379.000
G-16	95Z067	357.750
G-17	95Z060	357.750
CB-6	RD05-	408.000

CONNECTION PLATES	
FRAME LINE A	
□ ID	MARK/PART
1	ESC02
2	GCC03

ISSUE	RELEASE FOR PERMIT	DRWN	CHK	ENG	PRE	DATE
		BR	TR	JRF	RHB	3/17/20


7200 N. LAKE DRIVE STE. 200  
COLUMBUS, GA 31909  
PHONE: (706) 562-8020  
FAX: (706) 562-8017

PROJECT NAME  
**NIELL'S CREEK CHURCH GYM**  
ANGIER, NC 27501

CUSTOMER NAME  
**ALEXANDER DESIGN BUILD. LLC**  
CLAYTON, NC 27520

JOB NUMBER  
**A20B0267A**

SHEET TITLE  
**SWDWG-B**

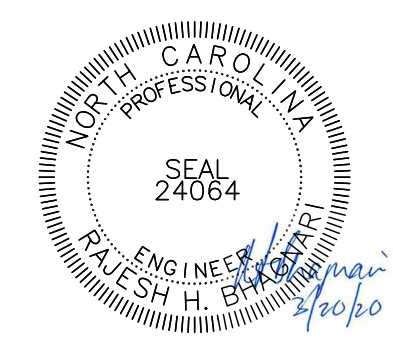

This seal pertains only to the materials designed and supplied by the Metal Building Manufacturers Association and the metal building products manufactured by the Metal Building Manufacturer. The registered professional engineer whose seal appears on these drawings is employed by the Metal Building Manufacturer and does not serve as or represent the project engineer of record and shall not be construed as such.

SHEET  
**E-07**



**GENERAL NOTES**

- THE GENERAL CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ARCHITECT AND THE ENGINEER OF ANY DISCREPANCIES WITHIN THE CONSTRUCTION DOCUMENTS.
- DESIGN AND CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE 2018 NORTH CAROLINA BUILDING CODE.
- DESIGN LOADS:  
**Importance Factor:** Wind (Iw) 1.0  
 Snow (Is) 1.0  
 Seismic (Ie) 1.0  
  
**Live Loads:** Roof 20 psf  
 Mezzanine N/A  
 Floor 125 psf  
  
**Ground Snow Load:** 15 psf  
  
**Wind Load:** Basic Wind Speed 115 mph (ASCE-7-10)  
 Exposure Category B  
 Wind Base Shears (for MWFRS) Vx = 21.0K Vy = 43.7K

**SEISMIC DESIGN CATEGORY B**  
 Provide the following Seismic Design Parameters:  
 Occupancy Category (Table 1604.5) II  
 Spectral Response Acceleration Ss 17.2%g S 8.3%g  
 Site Classification D (Field Test)  
 Basic structural system (check one)  
 Bearing Wall \_\_\_ Dual w/ Special Moment Frame \_\_\_  
 \_\_\_ X \_\_\_ Building Frame \_\_\_ Dual w/ Intermediate R/C or Special Steel \_\_\_  
 \_\_\_ Moment Frame \_\_\_ Inverted Pendulum \_\_\_  
 Seismic base shear Vx = 18.0K Vy = 18.0K  
 Analysis Procedure \_\_\_ Simplified X \_\_\_ Equivalent Lateral Force \_\_\_ Modal \_\_\_  
 Architectural, Mechanical, Components anchored? No

LATERAL DESIGN CONTROL: Earthquake \_\_\_ Wind X \_\_\_

**SOIL BEARING CAPABILITIES:**  
 Field Test (provide copy of test report) \_\_\_ psf  
 Presumptive Bearing Capacity 2000 \_\_\_ psf  
 Pile size, type and capacity \_\_\_

- ALL SAFETY REGULATIONS, METHODS OF CONSTRUCTION AND ERECTION OF STRUCTURAL MATERIAL SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR. IT SHALL BE THE GENERAL CONTRACTORS RESPONSIBILITY TO PROVIDE ADEQUATE SHORING, BRACING AND FORMWORK, ETC. AS REQUIRED.
- THE GENERAL CONTRACTOR PRIOR TO CONSTRUCTION SHALL VERIFY ALL DIMENSIONS, ELEVATIONS, THE SIZE AND LOCATION OF ALL SLEEVES, PADS, DEPRESSIONS, OPENINGS, ETC.
- DIMENSIONS ARE NOT TO BE DERIVED BY SCALING THESE DRAWINGS. IF THERE IS ANY QUESTION ABOUT DETAILS OR DIMENSIONS, CONTACT THE ARCHITECT AND ENGINEER FOR CLARIFICATION.
- IF ANY BIDDER IS IN DOUBT AS TO THE TRUE MEANING OF ANY PART OF THE DOCUMENTS, THEY SHALL REQUEST AN INTERPRETATION FROM THE ARCHITECT IN WRITING.

**SUBMITTALS**

- THE CONTRACT DOCUMENTS ARE THE STRUCTURAL ENGINEER'S INSTRUMENTS OF SERVICE TO CONVEY DESIGN INTENT. THEY ARE NOT TO BE CONSIDERED FABRICATION OR LAYOUT DRAWINGS.
- THE FOLLOWING ARE REQUIRED SUBMITTALS:  
 A. CONCRETE MIX DESIGNS  
 B. REINFORCING BAR DRAWINGS  
 C. ~~STRUCTURAL STEEL~~  
 D. ~~METAL STUDS~~  
 E. STEEL JOISTS  
 F. OTHER SUBMITTALS AS NOTED ON THE DRAWINGS AND SPECIFICATIONS
- FOR REVIEW OF EACH SUBMITTAL, THE SCHEDULE SHALL ALLOW FOR TEN BUSINESS DAYS FOLLOWING ENGINEER'S RECEIPT.
- SUBMITTALS TO BE REVIEWED BY THE ENGINEER SHALL BE SUBMITTED TO THE ARCHITECT. THE STRUCTURAL ENGINEER WILL NOT ACCEPT SUBMITTALS DIRECTLY FROM CONTRACTORS WITHOUT THE ENGINEER'S PRIOR APPROVAL.
- UPON COMPLETION OF THE ENGINEER'S REVIEW, SUBMITTALS WILL BE RETURNED TO THE ARCHITECT FOR THEIR REVIEW.
- ANY DEVIATION IN DESIGN, DETAILS, DIMENSIONS, ETC. FROM THE CONSTRUCTION DOCUMENTS SHALL BE CLOUDED ON THE SUBMITTAL AND VERIFICATION OF THE CHANGE SHALL BE REQUESTED. "VERIFY" MARKS NOT ADDRESSED SHALL NOT BE ASSUMED CORRECT AND SHALL BE RESUBMITTED TO THE ENGINEER OR CLARIFIED BY A REQUEST FOR INFORMATION. THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ANY DEVIATIONS UNLESS ENGINEER REVIEWS AND ACKNOWLEDGES THE CHANGES IN WRITING.
- THE ENGINEER WILL NOT REVIEW PARTIAL SUBMISSIONS OR THOSE FOR WHICH SUBMISSIONS OF CORRELATED ITEMS HAVE NOT BEEN RECEIVED.

**FOUNDATIONS**

- ALLOWABLE SOIL BEARING IS STATED ON THE FOUNDATION PLANS.
- BACKFILLING SHALL BE PERFORMED IN EQUAL LIFTS AROUND THE BUILDING PERIMETER TO BALANCE LATERAL EARTH PRESSURE ON THE BUILDING. WALK BEHIND COMPACTION EQUIPMENT IS REQUIRED WITHIN A DISTANCE OF TWO TIMES THE WALL HEIGHT.
- UTILITY LINES SHALL NOT BE PLACED THROUGH OR BELOW FOUNDATIONS WITHOUT THE STRUCTURAL ENGINEER'S APPROVAL IN WRITING. THE CONTRACTOR SHALL LOCATE ANY EXISTING UNDERGROUND UTILITIES PRIOR TO ANY CONSTRUCTION.

**CONCRETE**

- ALL CONCRETE WORK TO BE DONE IN ACCORDANCE WITH THE CODE REFERENCED EDITION OF ACI-318: "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE"
- CONCRETE MIX DESIGN REQUIREMENTS AND COMPRESSIVE STRENGTH AT 28 DAYS:

DESCRIPTION	28 DAY STRENGTH (PSI)	WEIGHT PER CUBIC FOOT (PCF)	SLUMP AT POINT OF PLACEMENT	AGGREGATE	% AIR
FOOTING AND FOUNDATION WALLS	3000	145	4" ± 1"	ASTM C33	3
SLAB ON GRADE	3000	145	4" ± 1"	ASTM C33	3
COMPOSITE FLOOR TOPPING (LIGHT WEIGHT)	3600	110	5" ± 1"	ASTM C630	3

FLY ASH SHALL BE LIMITED TO 20% OF THE TOTAL CEMENTITIOUS MATERIAL WEIGHT. WATER REDUCING ADMIXTURES MAY BE USED TO ACHIEVE SLUMP REQUIREMENTS.

- SEE ARCHITECTURAL DOCUMENTS FOR JOINT SIZES AND FILLER MATERIALS.
- LOCATION OF ALL CONSTRUCTION JOINTS, EXCLUDING SLABS ON GRADE, SHALL BE COORDINATED WITH STRUCTURAL ENGINEER.
- ALL EXPOSED CONCRETE CORNERS SHALL HAVE A 3/4" CHAMFER, UNLESS NOTED OTHERWISE BY THE ARCHITECT.
- SHOP DRAWINGS SHALL BE SUBMITTED TO THE STRUCTURAL ENGINEER SHOWING PROPOSED LOCATIONS OF ANY MATERIAL SUCH AS BUT NOT LIMITED TO CONDUITS, EMBEDMENTS, OR FIXTURES TO BE PLACED INSIDE ANY STRUCTURAL CONCRETE MEMBER SUCH AS BEAMS, WALLS, SLABS, COLUMNS OR FOOTINGS.
- UNLESS SPECIFIED OTHERWISE IN THE SPECIFICATION, TESTING OF CONCRETE SHALL BE IN CONFORMANCE WITH THE REQUIREMENTS OF ACI 318 SECTION 5.6 "EVALUATION AND ACCEPTANCE OF CONCRETE."
- THE FOLLOWING PROCEDURES SHALL MEET THE REQUIREMENTS OF THE REFERENCED CODE SECTIONS

PROCEDURE	REFERENCE SECTION
PREPARATION	ACI 304 - "GUIDE FOR MEASURING, MIXING, TRANSPORTING AND PLACING CONCRETE"
CONVEYING	ACI 318 SECTION 5.9 - "CONVEYING"
DEPOSITING	ACI 318 SECTION 5.10 - "DEPOSITING"
CONSOLIDATION	ACI 309 - "GUIDE FOR CONSOLIDATION OF CONCRETE"
CURING	ACI 308 - "STANDARD PRACTICE FOR CURING CONCRETE"
HOT WEATHER CONCRETING	ACI 305 - "HOT WEATHER CONCRETING"
COLD WEATHER CONCRETING	ACI 306 - "COLD WEATHER CONCRETING"

**REINFORCING STEEL**

- REINFORCING STEEL SHALL BE NEW BILLET STEEL, DEFORMED BARS CONFORMING TO ASTM A615, GRADE 60.
- WELDED WIRE FABRIC SHALL BE SHEETS OF NEW BILLET STEEL COLD DRAWN, CONFORMING TO ASTM SPECIFICATION A62, GRADE 60.
- BAR SUPPORTS, DESIGN, DETAILING, FABRICATION AND PLACING OF REINFORCING STEEL SHALL BE IN ACCORDANCE WITH ACI 318 AND "THE MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES" ACI 315.
- SPLICES FOR CONTINUOUS BARS SHALL BE CLASS B, UNLESS NOTED OTHERWISE. WELDED WIRE FABRIC SHALL BE LAPPED 12" MINIMUM.
- MINIMUM CONCRETE COVERAGE SHALL BE AS FOLLOWS. IF STIRRUPS, TIES OR SPIRALS ARE USED, COVERAGE SHALL BE THE OUTERMOST FACE OF THE ELEMENTS.  
 A. FOOTINGS, CAISSONS, AND OTHER MEMBERS WHERE CONCRETE IS DEPOSITED AGAINST SOIL (EXCEPT SLABS ON GRADE.) 3"  
 B. CONCRETE EXPOSED TO WEATHER OR SOIL  
 #6 BAR AND LARGER: 2"  
 #5 BAR AND SMALLER: 1 1/2"  
 C. CONCRETE NOT EXPOSED TO WEATHER OR SOIL (SLABS, WALLS, JOISTS)  
 #14 BAR AND LARGER: 1 1/2"  
 #11 BAR AND SMALLER: 1"  
 BEAMS AND COLUMNS 1 1/2"
- WALL FOOTING REINFORCEMENT SHALL BE CONTINUOUS THROUGH COLUMN FOOTING.
- PROVIDE DOWELS IN WALL FOOTING TO MATCH WALL VERTICALS UNLESS NOTED OTHERWISE ON DRAWINGS. PROVIDE CLASS B SPLICE. USE STANDARD ACI 90° HOOK WITH 3" CLEAR TO BOTTOM OF FOOTING UNLESS NOTED OTHERWISE.

**COLD-FORMED STEEL STUD FRAMING**

- ALL STRUCTURAL MEMBERS SHALL BE FORMED FROM CORROSION-RESISTANT STEEL CORRESPONDING TO THE REQUIREMENTS OF ASTM-A653. WELDS SHALL BE TOUCHED UP WITH A ZINC RICH PROTECTIVE PAINT FOR CORROSION RESISTANCE. STRUCTURAL STEEL STUDS SHALL HAVE A MINIMUM THICKNESS OF 33 MILS AND SHALL HAVE A MINIMUM YIELD STRENGTH 33 KSI

COLD-FORMED STEEL STRUCTURAL MEMBERS	
THICKNESS (MILS)	GAUGE
33	20
43	18
54	16
65	14
97	12
118	10

- UNLESS VERTICAL DEFLECTION CONNECTION WITH MECHANICAL ATTACHMENT TO THE WEB OF ALL STUDS WHICH PASS BY THE STRUCTURE (FLOOR AND ROOF) OR ATTACH TO THE BOTTOM OF THE STRUCTURE.
- UNLESS SUPERSEDED BY FINISH OR GLAZING SYSTEM MANUFACTURERS MORE STRINGENT REQUIREMENTS (GENERAL CONTRACTOR TO COORDINATE), STUDS HAVE BEEN DESIGNED TO THE FOLLOWING MINIMUM REQUIREMENTS:  
 A. BRICK VENEER 1/600  
 B. EXTERIOR INSULATION AND FINISH SYSTEM (EIFS) 1/240  
 C. STUCCO 1/240
- "C" SHAPED STUDS AND JOISTS SHALL HAVE A MINIMUM FLANGE WIDTH OF 1 1/2" WITH A MINIMUM RETURN UP OF 3/8". TRACKS SHALL HAVE A MINIMUM OUTSTANDING LEG OF 1 1/2".
- ALL STRUCTURAL MEMBERS SHALL BE CONTINUOUS FULL LENGTH, SPLICING OF MEMBERS IS NOT PERMITTED UNLESS SPECIFICALLY DETAILED BY ENGINEER.
- SCREWS SHALL BE SELF DRILLING WITH A LENGTH THAT ENSURES THREE EXPOSED THREADS BEYOND PENETRATION OF THE JOINED MATERIAL. MINIMUM SCREW SPACING SHALL BE 3", MINIMUM EDGE DISTANCE SHALL BE 3/8".
- METAL STUD BRIDGING IS REQUIRED @ 48" O.C. MAXIMUM UNLESS WALLS ARE SHEATHED ON BOTH SIDES.



Corp. License Number C-2550



NEILL'S CREEK  
 BAPTIST CHURCH  
 FELLOWSHIP HALL  
 ANGLIER, NC

issue date:  
 4-3-20


Copyright © 2020 by  
 Harris Structural  
 Design, PA.  
 All rights reserved.

All drawings and copies thereof are instruments of service and as such remain the property of Harris Structural Design, PA. They are produced for one-time use only with respect to this project. Harris Structural Design, PA reserves the right to use these plans at its own discretion. Approval from a licensed building inspector will be the responsibility of the consumer if required. Nominal dimensions may be used. Do not scale drawings.


project  
 dwg. by TBH  
 ckd. by

content  
 GENERAL NOTES


sheet  
 S0.0

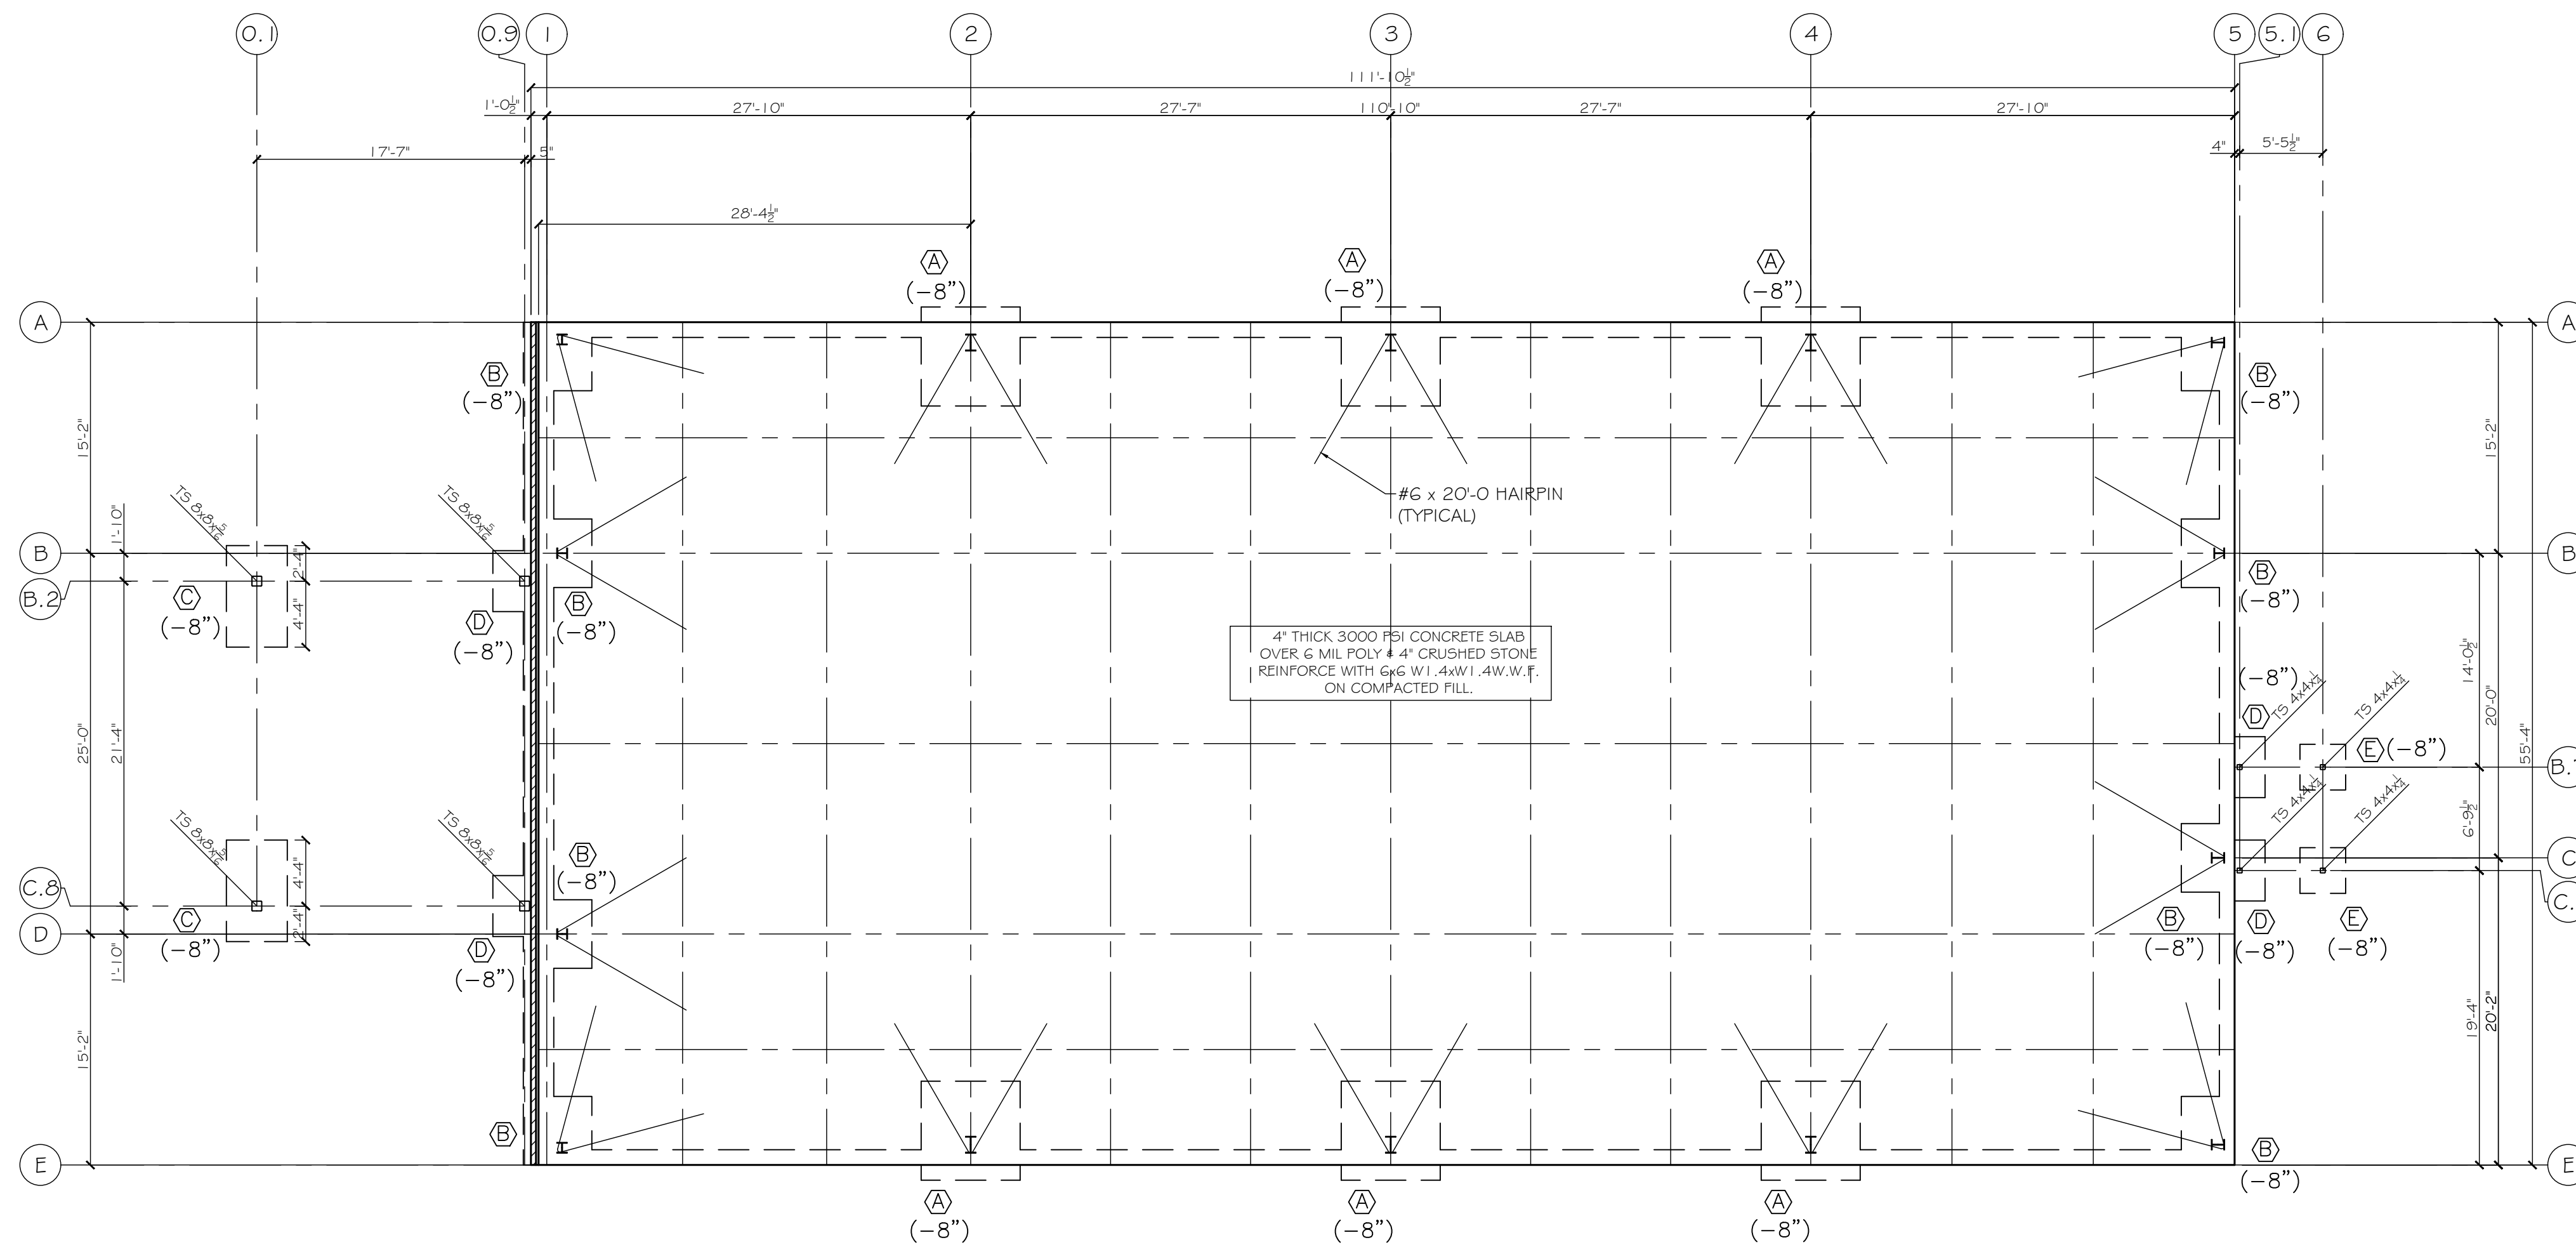


C1 BUILDING FOUNDATION PLAN  
SCALE: 1/8" = 1'-0"

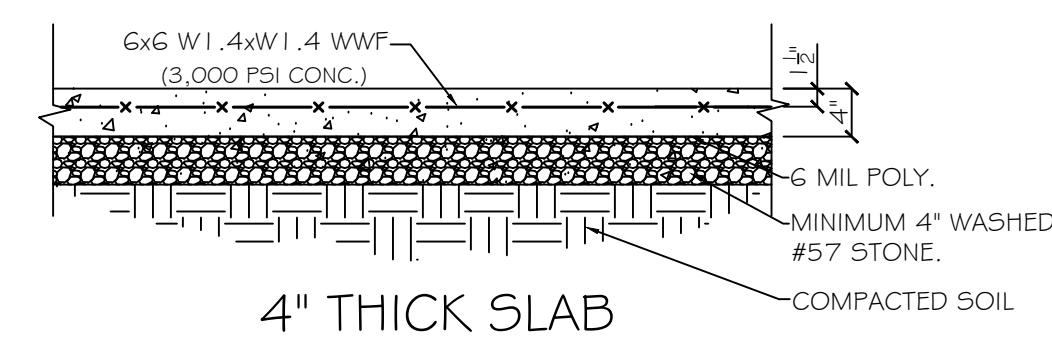


D1 SLAB REINFORCEMENT DETAILS  
SCALE: 3/4" = 1'-0"

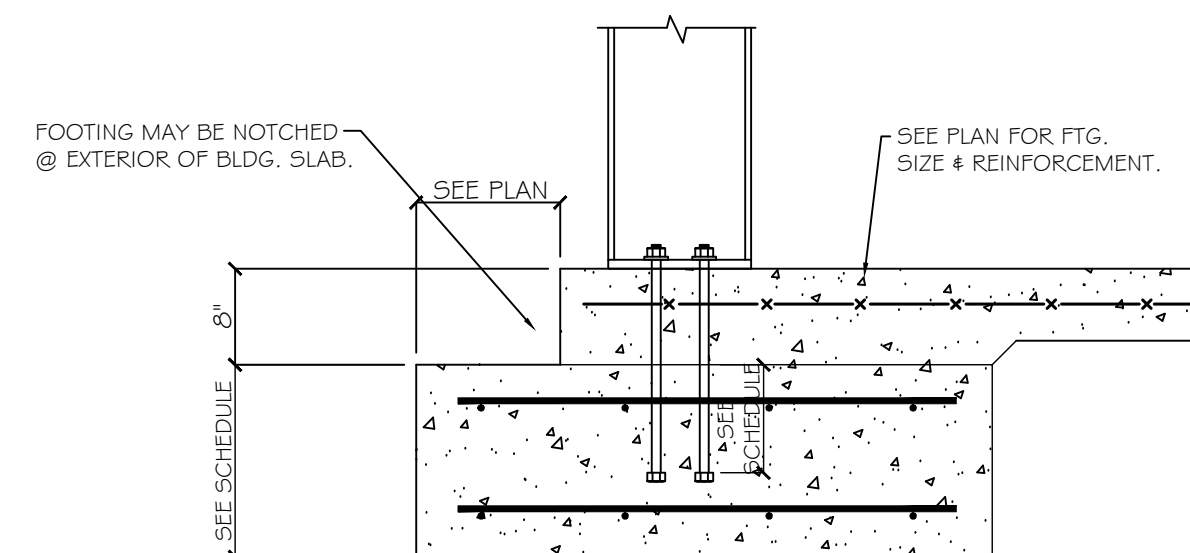


D2 EXTERIOR COLUMN FOOTING DETAIL  
SCALE: 3/4" = 1'-0"

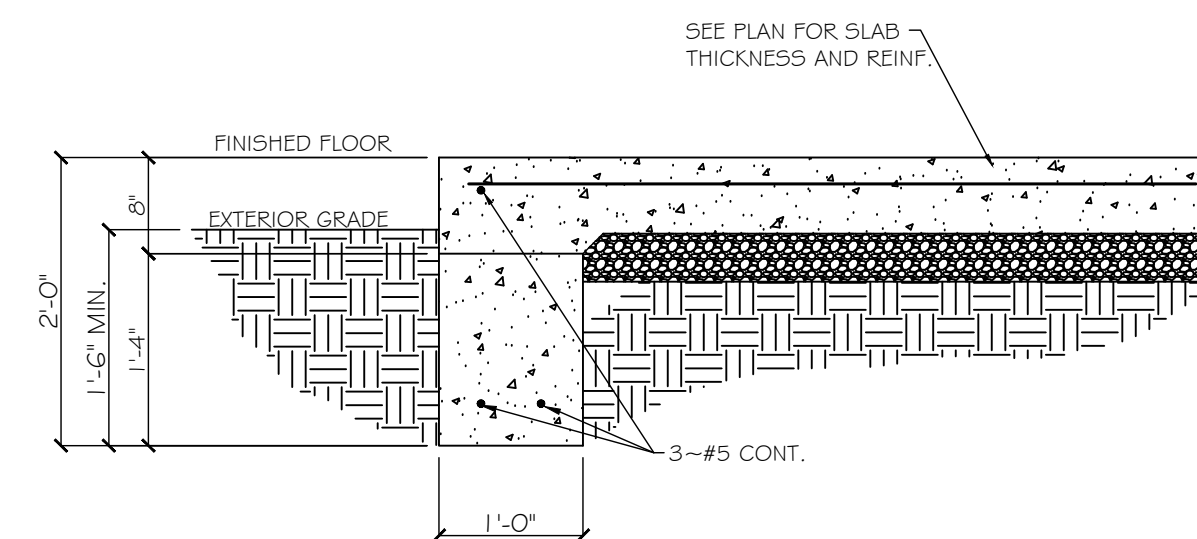

D3 PERIMETER FOOTING DETAIL  
SCALE: 3/4" = 1'-0"

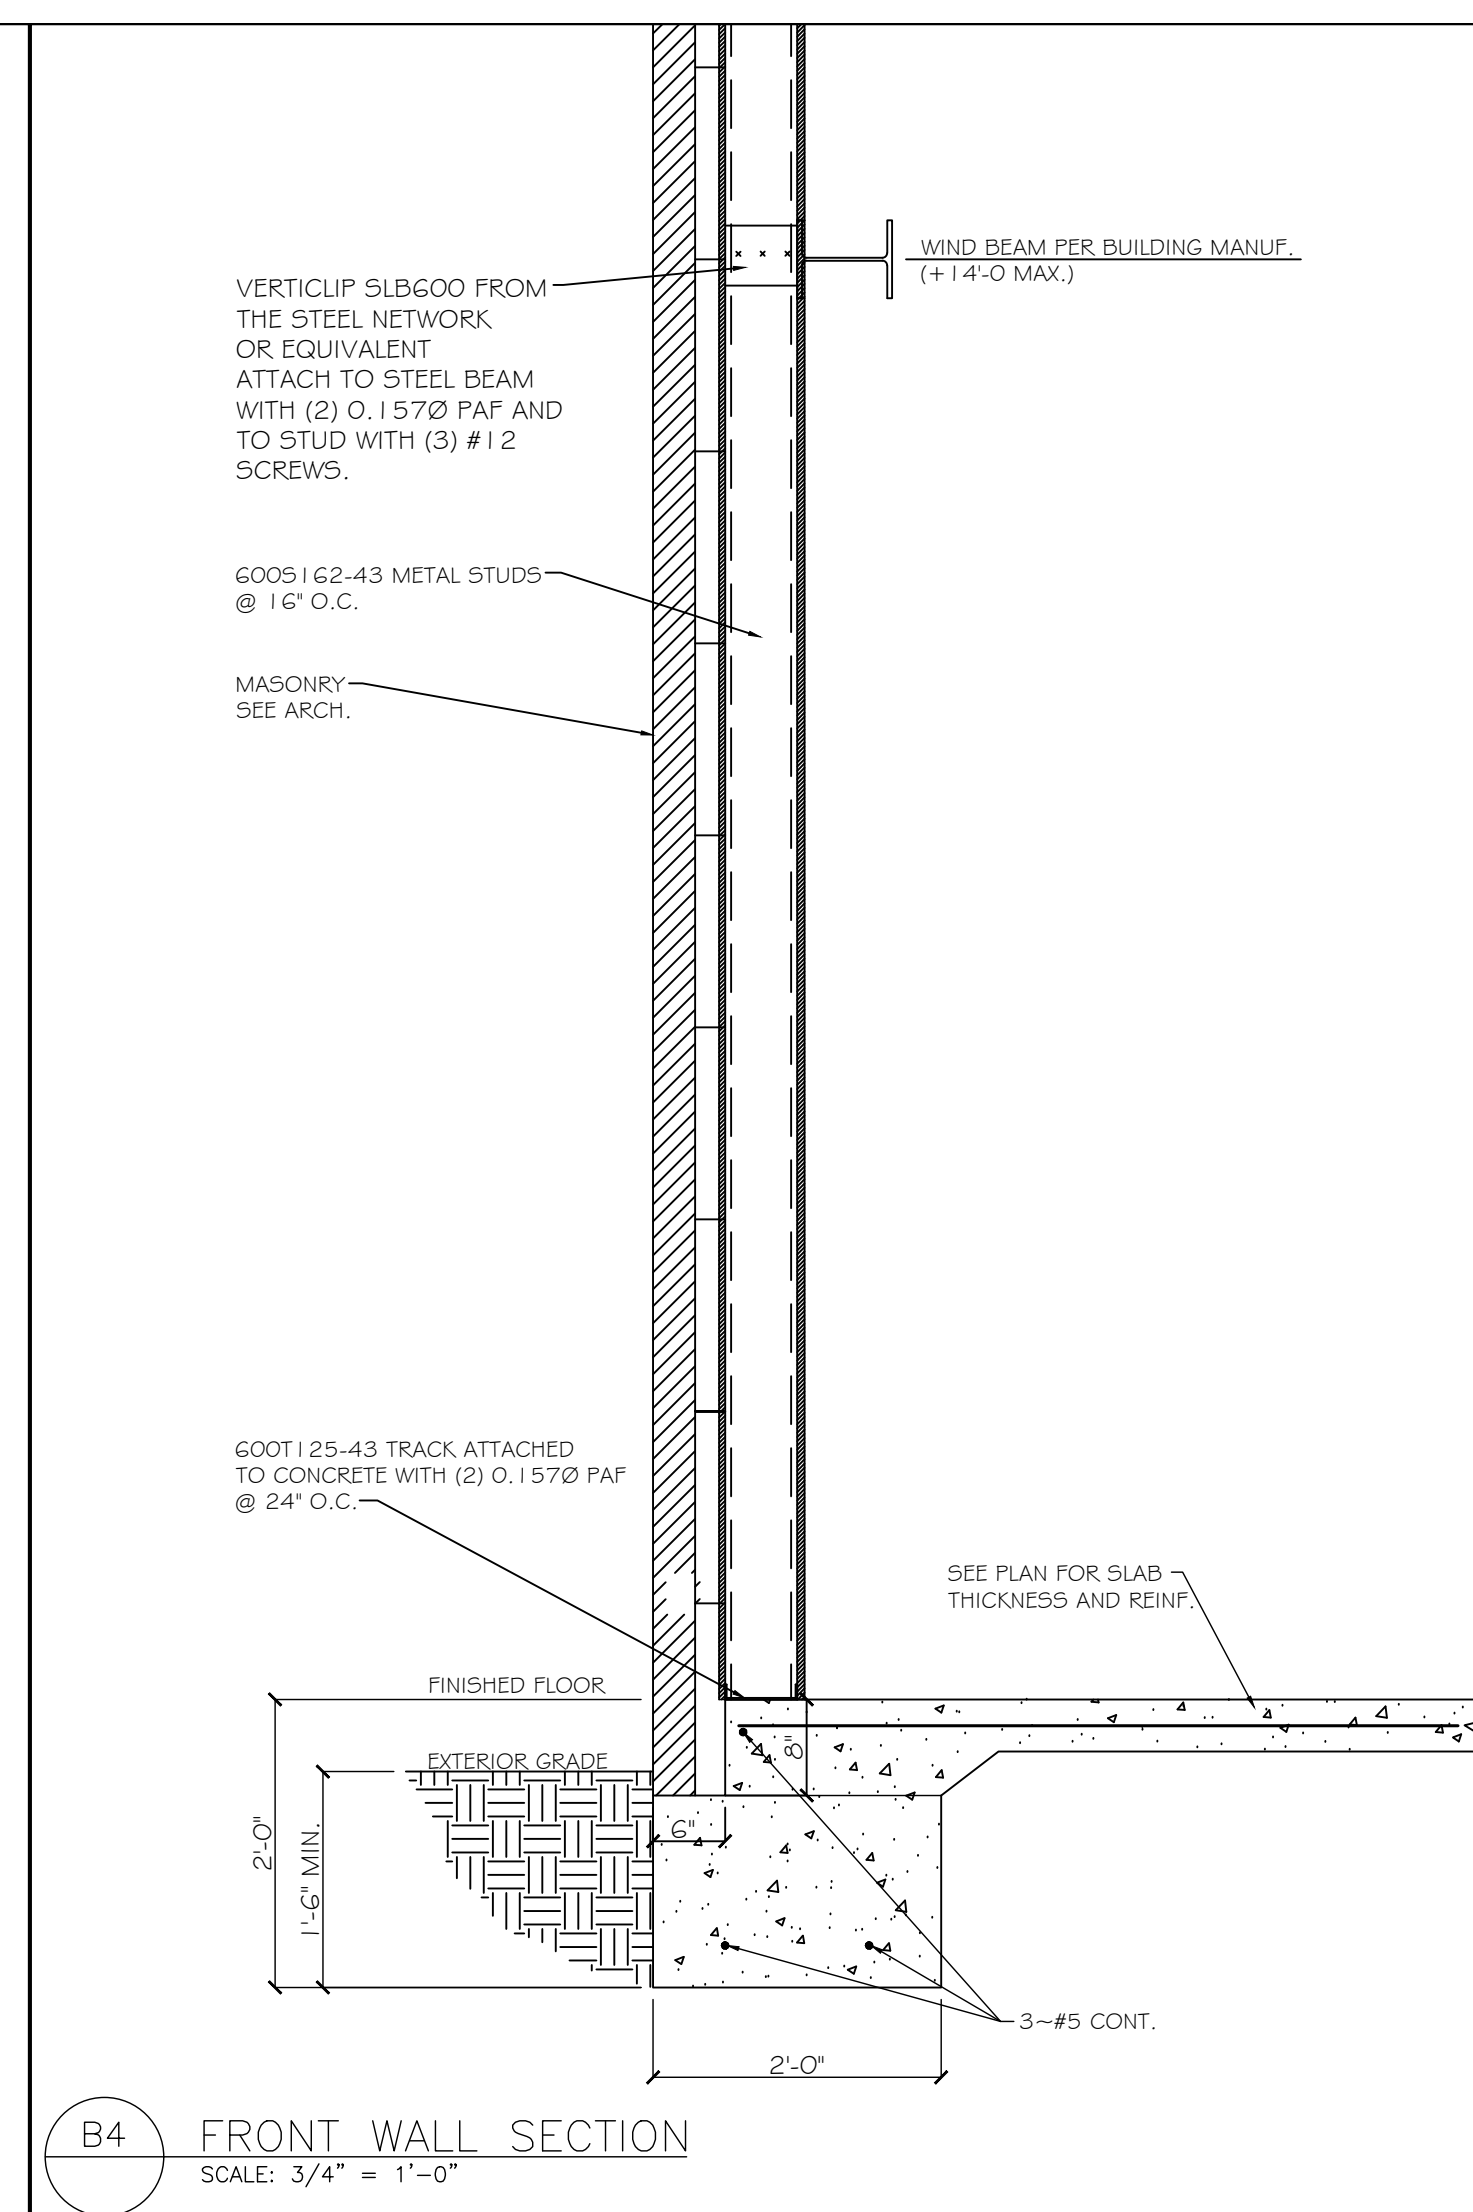


B4 FRONT WALL SECTION  
SCALE: 3/4" = 1'-0"

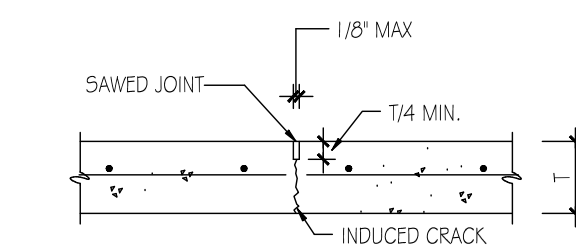


NOTES: 1) SAW JOINTS AS SOON AS CONCRETE WILL NOT RAVEL UNDER SAW BLADE.  
ALLOW SLAB TO CURE FOR 30 DAYS (MIN.) BEFORE FILING JOINTS W/ SEALANT.

DETAIL - BLDG. SLAB CONTROL JOINT

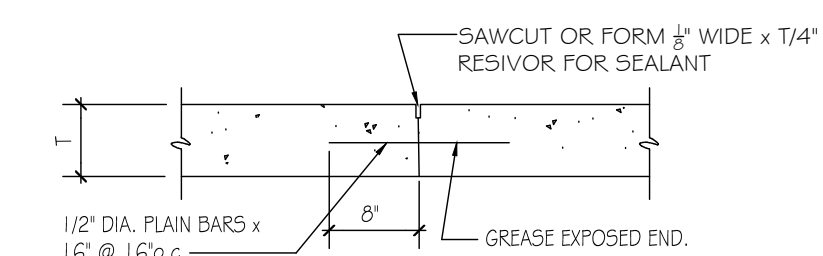

DETAIL - BLDG. SLAB CONST. JOINT

C4 SLAB JOINT DETAILS

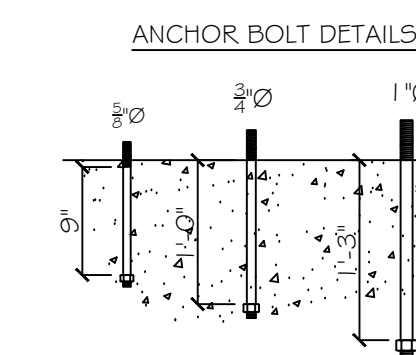

FOUNDATION PLAN

FOOTING SCHEDULE			2000 PSF
MARK	SIZE	REINFORCING	
(A)	6'-6" x 6'-6" x 16"	7 ~ #5 E.W. TOP & BOTT.	
(B)	4'-6" x 4'-6" x 16"	4 ~ #5 E.W. TOP & BOTT.	
(C)	6'-8" x 4'-0" x 12"	#5 @ 12" E.W. BOTT. ONLY	
(D)	4'-0" x 2'-0" x 16"	#5 @ 12" E.W. BOTT. ONLY	
(E)	3'-0" x 3'-0" x 12"	3 ~ #4 E.W. BOTT. ONLY	

- FOOTING DESIGN BASED ON ASSUMED SOIL BRG. CAPACITY OF 2000 PSF. NOTIFY ENGINEER IF TESTS SHOW OTHERWISE.
- ELEV. NOTED (- ) ARE BELOW F.F. (0.00) TO TOP OF FOOTING.
- FOUNDATION DESIGNED PER METAL BUILDING REACTIONS.

D4 FOUNDATION NOTES

**HARRIS**  
**STRUCTURAL DESIGN, PA**  
PH: (919) 556-6032  
FAX: (919) 556-6032  
CELL: (919) 946-0796  
3206 Heritage Trade Dr. Ste. 116  
Wake Forest, NC 27587  
EMAIL: thomas-hsd@nc.rr.com

Corp. License Number C-2550



**NEILL'S CREEK**  
**BAPTIST CHURCH**  
**FELLOWSHIP HALL**  
ANGIER, NC

issue date:  
4-3-20


Copyright © 2020 by  
Harris Structural  
Design, PA.  
All rights reserved.

All drawings and copies thereof are instruments of service and as such remain the property of Harris Structural Design, PA. They are produced for one-time use only with respect to this project. Harris Structural Design, PA reserves the right to use these plans at its own discretion. Approval from a licensed building inspector will be the responsibility of the consumer if required. Nominal dimensions may be used. Do not scale drawings.

project  
dwg. by TBH  
ckd. by  
content  
FOUNDATION PLAN & DETAILS

sheet

**S1.0**

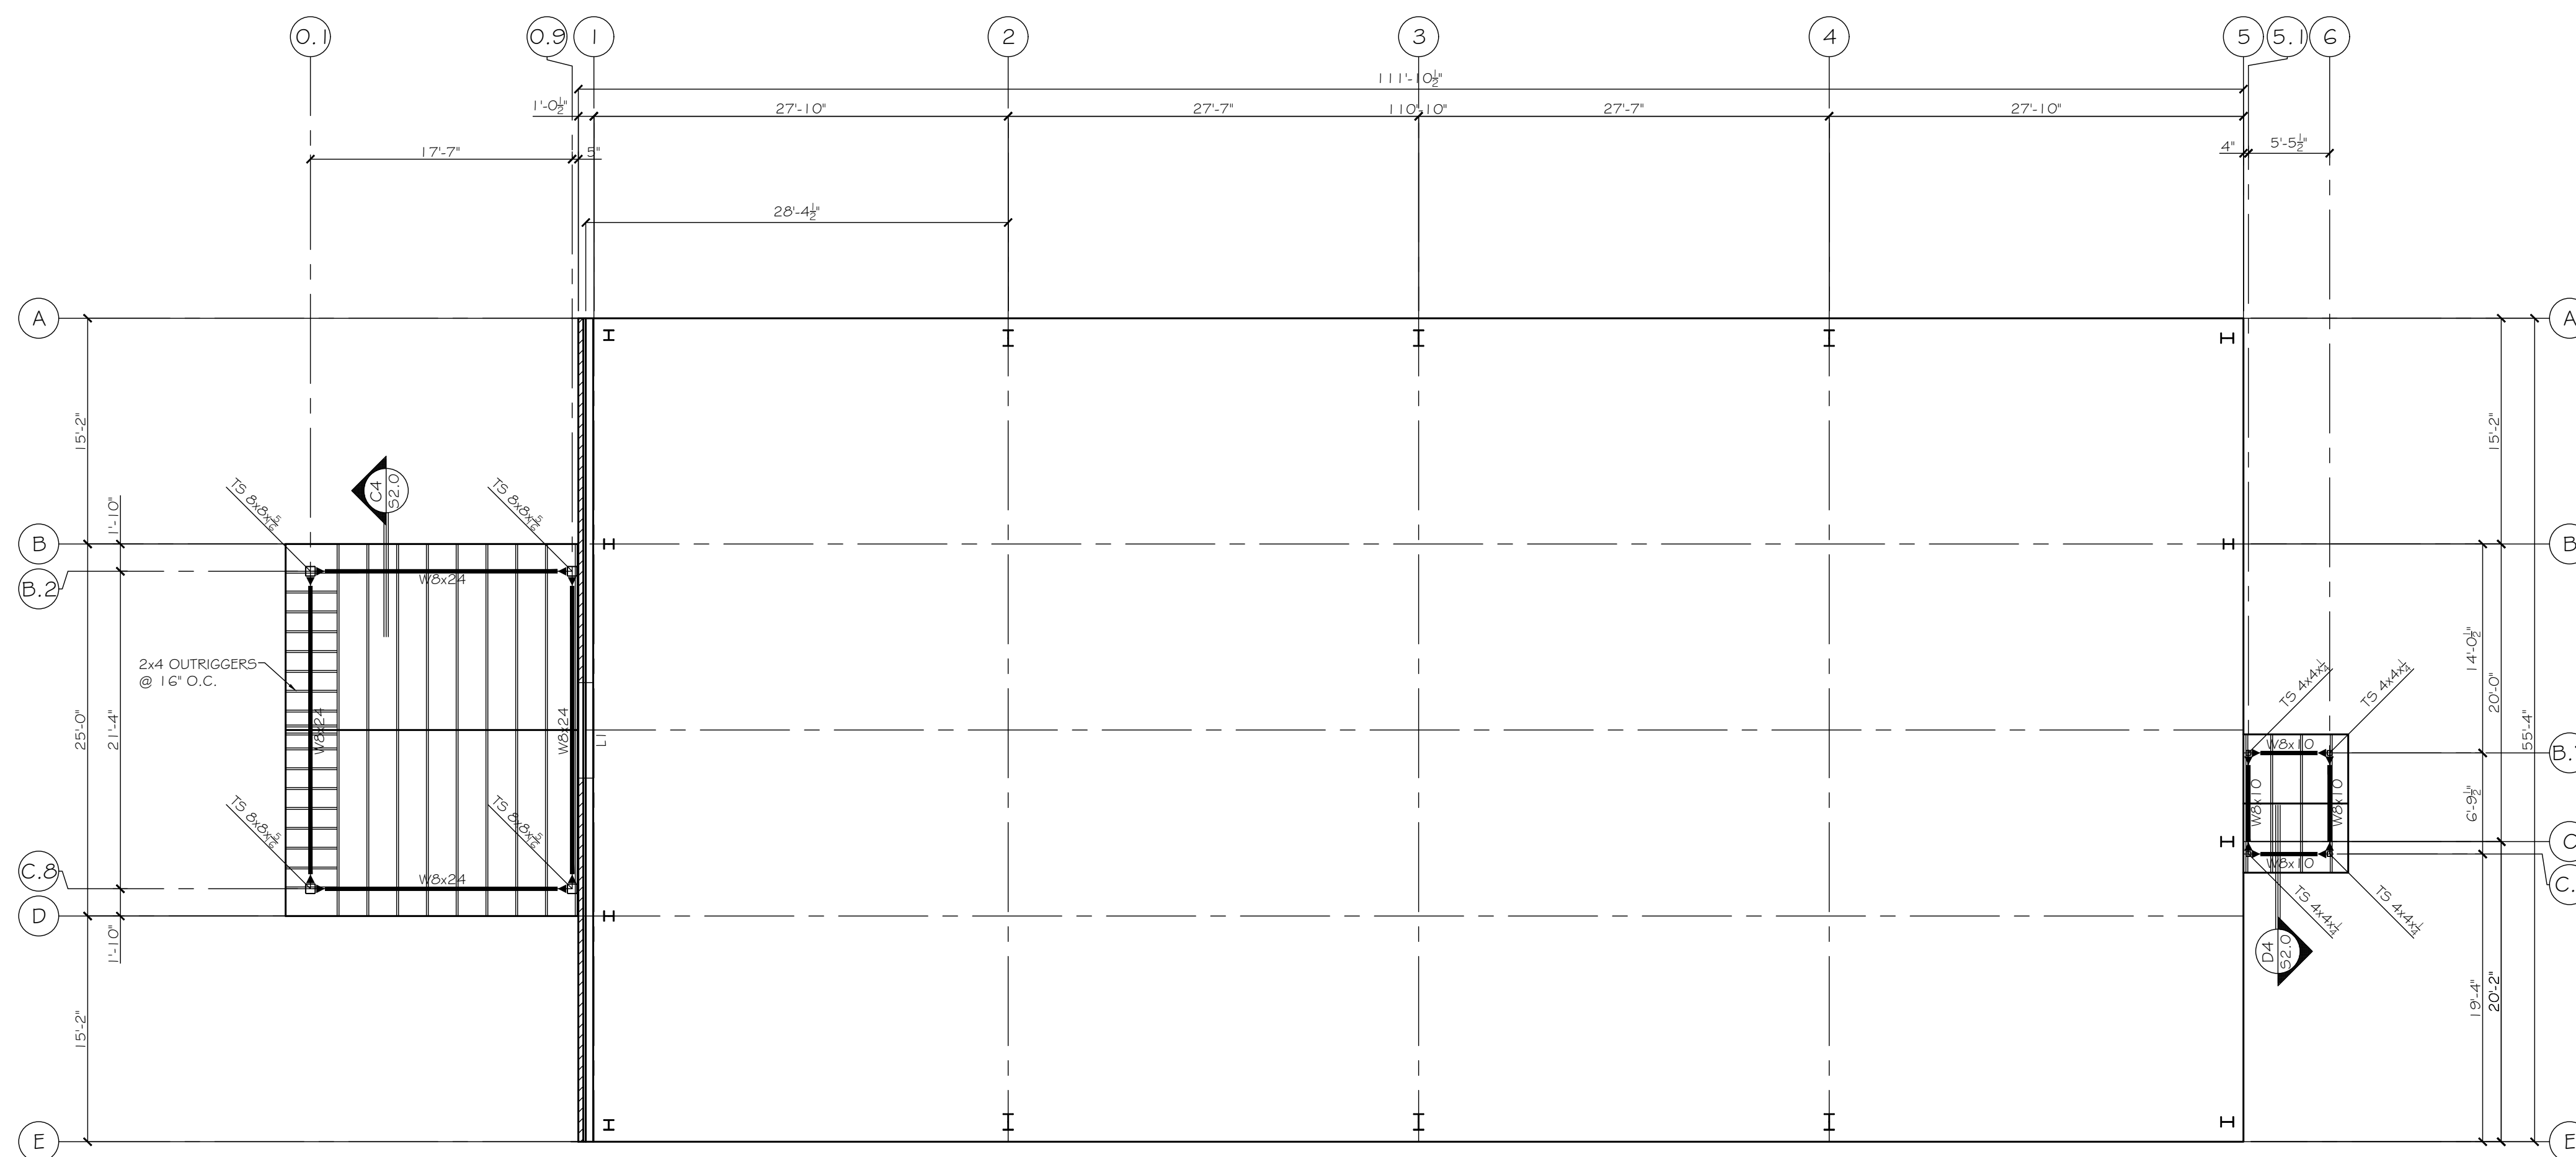

D1 CANOPY FRAMING PLAN  
SCALE: 1/8" = 1'-0"

### HEADER /LINTEL SCHEDULE

DESIGNATION	HEADER/LINTEL	HEADER SUPPORT
L1	2-6005 I 62-43 METAL STUDS WITH 600T I 25-43 TRACK TOP & BOTT. #16x6 3/8 BRICK LINTEL BEAR 8" MIN. ATTACH LINTEL TO HEADER WITH (2) #10 SCREWS AT 12" O.C. (BEAR LINTEL 8" EACH SIDE)	(2) 6005 I 62-43 JACKS (2) 6005 I 62-43 KINGS


A4 HEADER/LINTEL SCHEDULE

**HARRIS**  
**STRUCTURAL DESIGN, PA**


PH: (919) 856-6032  
FAX: (919) 856-6032  
CELL: (919) 946-0796

3206 Heritage Trade Dr. Ste. 116  
Wake Forest, NC 27587  
EMAIL: thomas-hds@nc.rr.com

Corp. License Number C-2550

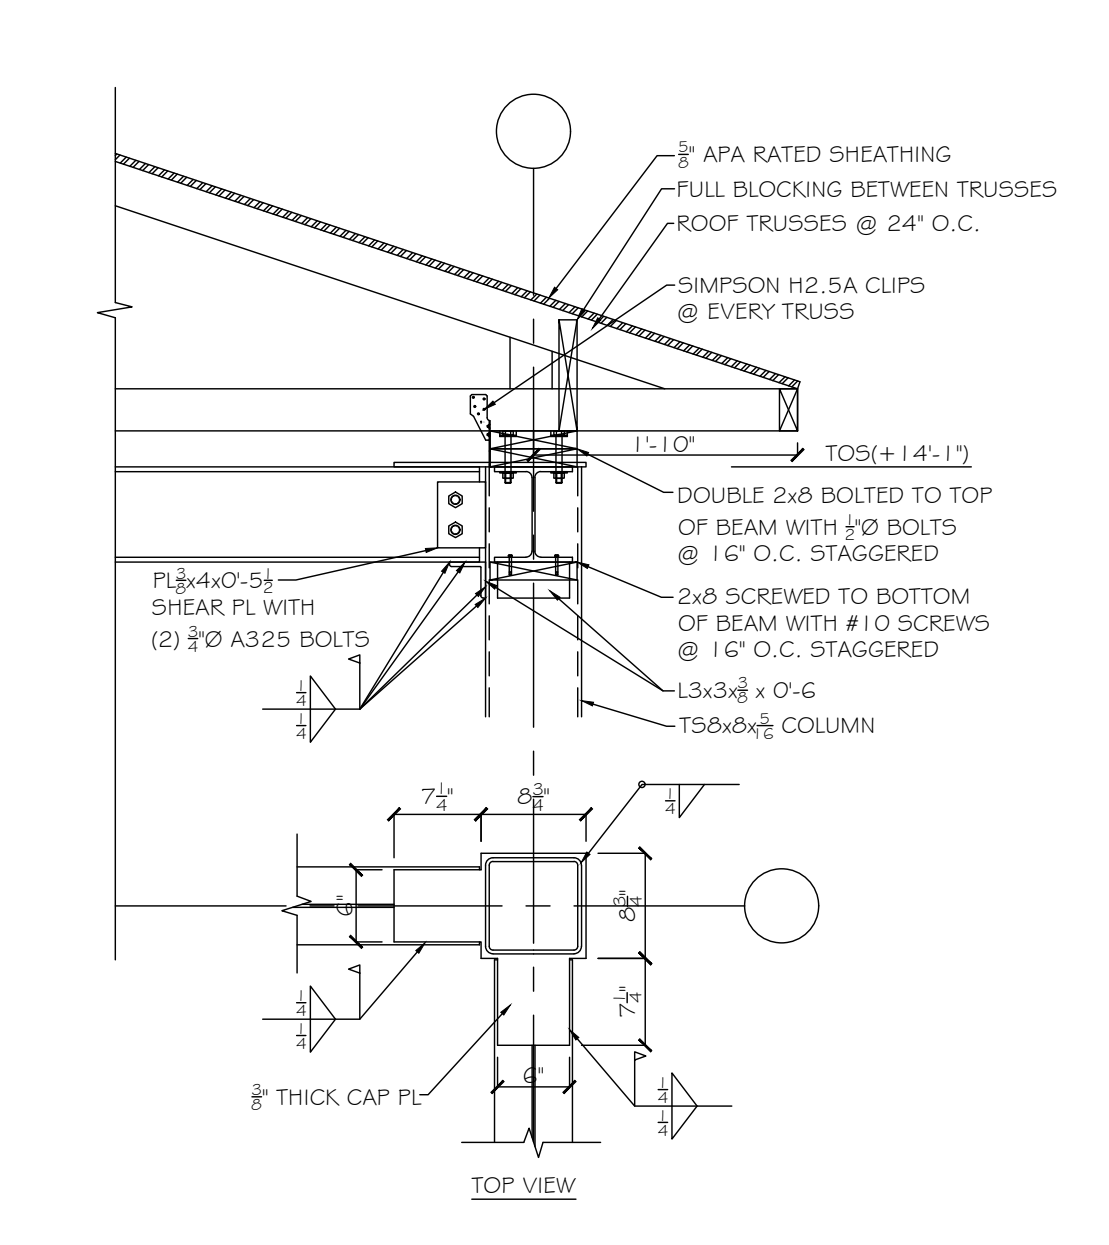

C4 CANOPY SECTION  
SCALE: 3/4" = 1'-0"

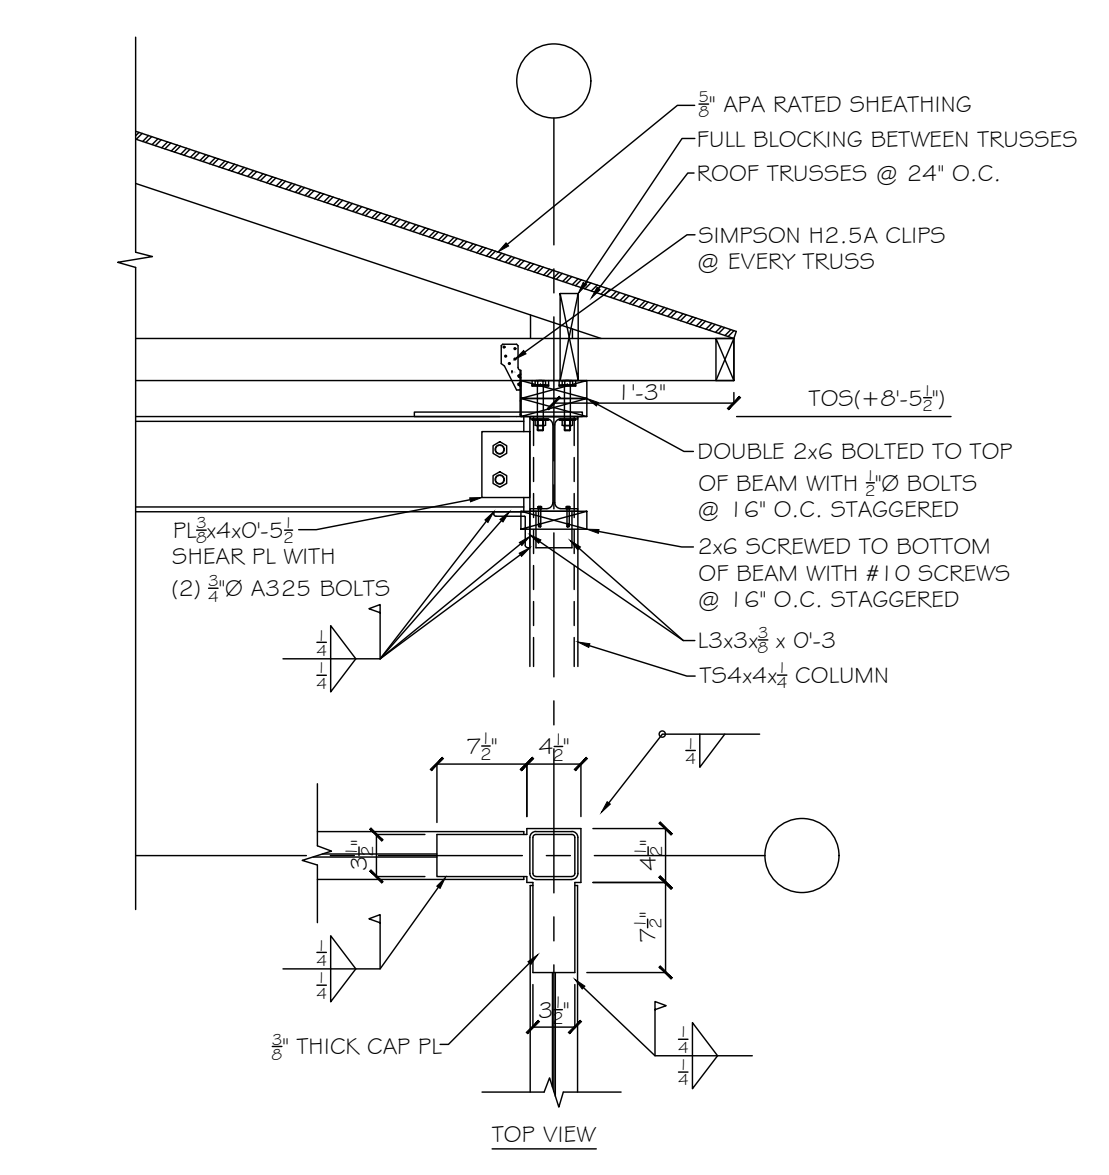

D4 CANOPY SECTION  
SCALE: 3/4" = 1'-0"

NEILL'S CREEK  
BAPTIST CHURCH  
FELLOWSHIP HALL  
ANGIER, NC

issue date:  
4-3-20

Copyright © 2020 by Harris Structural Design, PA. All rights reserved.  
All drawings and copies thereof are instruments of service and as such remain the property of Harris Structural Design, PA. They are produced for one-time use only with respect to this project. Harris Structural Design, PA reserves the right to use these plans at its own discretion. Approval from a licensed building inspector will be the responsibility of the consumer if required. Nominal dimensions may be used. Do not scale drawings.

project  
dwg. by TBH  
ckd. by  
  
content  
CANOPY PLAN

sheet

S2.0

GENERAL ELECTRICAL NOTES:

ADMINISTRATIVE:

- THE FOLLOWING ABBREVIATIONS SHALL APPLY TO NOTES AND PLANS:  
PC - PLUMBING CONTRACTOR, EC - ELECTRICAL CONTRACTOR,  
MC - MECHANICAL CONTRACTOR, GC - GENERAL CONTRACTOR,  
FASC - FIRE ALARM SYSTEM CONTRACTOR.
- "PROMPT" MEANS TURNSH AND INSTALL THE ELECTRICAL CONTRACTOR SHALL ALSO INSTALL MATERIALS AND EQUIPMENT FURNISHED BY OTHERS AND THE GENERAL CONTRACTOR AS REQUIRED.
- EC SHALL PROVIDE LABOR, MATERIALS, EQUIPMENT, AND SERVICES NECESSARY AND REASONABLY INCIDENTAL TO INSURE A COMPLETE AND OPERATIONAL ELECTRICAL SYSTEM IN ACCORDANCE WITH THESE PLANS AND SPECIFICATIONS. MAJOR ITEMS, ACCESSORIES, AND DEVICES REASONABLY INFERRABLE AS NECESSARY FOR THE COMPLETION AND PROPER OPERATION OF ANY ELECTRICAL SYSTEM SHALL BE PROVIDED BY THE ELECTRICAL CONTRACTOR.
- WORKMANSHIP SHALL BE IN ACCORDANCE WITH NECA 1 "STANDARD PRACTICE FOR GOOD WORKMANSHIP IN ELECTRICAL CONTRACTING."
- ALL MATERIALS AND EQUIPMENT SHALL BE DELIVERED TO THE SITE UNLOADED BY THE ELECTRICAL CONTRACTOR AT AN APPROVED LOCATION. THE ELECTRICAL CONTRACTOR SHALL PROTECT ALL MATERIALS AND EQUIPMENT FROM BREAKAGE, THEFT, AND THE ELEMENTS. ALL MATERIALS AND EQUIPMENT SHALL REMAIN THE PROPERTY OF THE ELECTRICAL CONTRACTOR UNTIL THE PROJECT HAS BEEN COMPLETED AND TURNED OVER TO THE OWNER.
- THE ELECTRICAL CONTRACTOR SHALL OBTAIN AND PAY FOR ALL PERMITS, FEES, AND INSPECTIONS NECESSARY FOR THE COMPLETION OF THE WORK UNDER THIS CONTRACT.
- DO NOT SCALE THESE DRAWINGS-REFER TO ARCHITECTURAL SHEETS FOR DIMENSIONS.
- TRADE NAMES AND MANUFACTURERS ARE SPECIFIED TO ESTABLISH A QUALITY STANDARD. SUBSTITUTIONS SHALL BE PERMITTED IF APPROVED BY THE ENGINEER PRIOR TO INSTALLATION. ALL LISTED MODEL NUMBERS SHALL BE VERIFIED WITH THE MANUFACTURER FOR PROPER APPLICATION OF EQUIPMENT.
- THE ELECTRICAL CONTRACTOR SHALL VISIT THE SITE PRIOR TO BIDDING TO BECOME FAMILIAR WITH EXISTING CONDITIONS. THE ELECTRICAL CONTRACTOR SHALL CONTACT THE ENGINEER TO RESOLVE ANY DISCREPANCIES BETWEEN EXISTING CONDITIONS AND THESE PLANS. THE ELECTRICAL CONTRACTOR SHALL COORDINATE WITH OTHER TRADES PRIOR TO THE START OF CONSTRUCTION.
- GROUNDING AND BONDING SHALL BE PER NEC ARTICLE 250. THE RACEWAY SYSTEM SHALL NOT BE RELIED UPON FOR GROUNDING CONTINUITY. A GREEN EQUIPMENT GROUNDING CONDUCTOR, SIZED PER NEC TABLE 250-122, SHALL BE RUN IN ALL POWER RACEWAYS. FOR NON-ISOLATED GROUND CIRCUITS PROVIDE ONE EQUIPMENT GROUNDING CONDUCTOR PER CONDUIT RUN FOR ISOLATED GROUND CIRCUITS, PROVIDE ONE NEUTRAL AND ONE ISOLATED GROUND WIRE FOR EACH CIRCUIT. IN ADDITION, PROVIDE ONE EQUIPMENT GROUNDING CONDUCTOR PER CONDUIT RUN MAIN BONDING JUMPERS AND SYSTEM BONDING JUMPERS SHALL BE INSTALLED IN ACCORDANCE WITH 250.28 OF THE NEC FOR BUILDINGS OR STRUCTURES SUPPLIED BY FEEDERS OR BRANCH CIRCUITS. GROUNDING AND BONDING SHALL BE IN ACCORDANCE WITH 250.32. SEPARATELY DERIVED AC SYSTEMS SHALL BE GROUNDING IN ACCORDANCE WITH 250.30. RESISTANCE TO GROUND SHALL NOT EXCEED 25 OHMS. ADDITIONAL GROUNDING ELECTRODES SHALL BE INSTALLED PER 250.36 AS NECESSARY. THE ELECTRICAL CONTRACTOR SHALL ALSO COORDINATE WITH THE GENERAL CONTRACTOR REGARDING THE BONDING OF THE FOOTING REBAR, SO THAT IT WILL BE IN PLACE AND READY AT TIME OF FOOTING INSPECTION.
- ALL MATERIALS AND EQUIPMENT SHALL COMPLY WITH THE UNDERWRITERS LABORATORIES, INC. STANDARDS OR HAVE UL APPROVAL, OR BEAR UL RE-EXAMINATION LISTING WHERE SUCH APPROVAL HAS BEEN ESTABLISHED FOR THE TYPE OF SERVICE.
- CONDUCTORS, FUSES, CIRCUIT BREAKERS, AND DISCONNECT SWITCHES SHOWN ON THESE PLANS HAVE BEEN SIZED FOR THE SPECIFIED EQUIPMENT. BEFORE ORDERING ELECTRICAL EQUIPMENT, THE ELECTRICAL CONTRACTOR SHALL COORDINATE WITH OTHER CONTRACTORS ON THE SITE AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES SHOULD CONDUCTOR, CIRCUIT BREAKER, OR FUSE SIZES REQUIRE CHANGE.
- THE ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE GENERAL CONTRACTOR TO ENSURE THE FOLLOWING MATERIALS ARE RECYCLED DURING THE CONSTRUCTION PHASE OF THE PROJECT: LIGHT FIXTURES, INCLUDING PROPER DISPOSAL OF BALLASTS, FLUORESCENT LIGHT BULBS, AND TRANSFORMERS, WIRING AND ELECTRICAL EQUIPMENT, AND INSULATION. WASTE MATERIALS CONTAINING LEAD, ASBESTOS, PCBs (FLUORESCENT LAMP BALLASTS), OR OTHER HARMFUL SUBSTANCES SHALL BE HANDLED AND DISPOSED OF IN ACCORDANCE WITH FEDERAL AND STATE LAWS AND REQUIREMENTS CONCERNING HAZARDOUS WASTE.
- ALL WORK SHALL CONFORM TO 2017 NATIONAL ELECTRIC CODE, 2018 STATE BUILDING CODE, AND ALL APPLICABLE LOCAL CODES.

MATERIALS:

- THE ELECTRICAL CONTRACTOR SHALL PROVIDE ALL NECESSARY DISCONNECTS, SWITCHES, RECEPTACLES, TERMINALS, ETC. UNDER THE ELECTRICAL BID AND SHALL INCLUDE ALL NECESSARY CIRCUITS AND CONNECTIONS TO THE EQUIPMENT PROVIDED BY ALL SUPPLIERS, UNLESS NOTED OTHERWISE BY OTHER DISCIPLINES.
- ELECTRICAL CONTRACTOR SHALL PROVIDE ALL SERVICE ENTRANCE EQUIPMENT, SUB PANELS, AND OTHER ELECTRICAL DISTRIBUTION EQUIPMENT AS NECESSARY FOR A COMPLETE INSTALLATION. ELECTRICAL CONTRACTOR SHALL COORDINATE WITH UTILITY REGARDING SERVICE AND METERING DETAILS. PRIOR TO ORDERING EQUIPMENT, THE ELECTRICAL CONTRACTOR SHALL OBTAIN THE AVAILABLE FAULT CURRENT OR TRANSFORMER SIZE AND IMPEDANCE FROM THE UTILITY AND CONTACT THE ENGINEER IF THE VALUE EXCEEDS THE EQUIPMENT SPECIFIED. PANEL BOARDS AND SWITCH BORDERS SHALL BE SQUARE D, CUTLER-HAMMER, SIEMENS, OR GE. BUSES SHALL BE COPPER UNLESS OTHERWISE APPROVED BY THE ENGINEER. RECESSED PANEL BOARDS SHALL BE INSTALLED FLUSH WITH THE WALL FINISH. METER BASES SHALL COMPLY WITH THE UTILITY'S SPECIFICATIONS AND SHALL BE MOUNTED AT A HEIGHT APPROVED BY THE UTILITY. ALL EQUIPMENT IDENTIFIED FOR SERVICE ENTRANCE USE SHALL BE SO LABELED AND UL LISTED FOR SUCH USE. ELECTRICAL CONTRACTOR SHALL INSTALL ALL ELECTRICAL EQUIPMENT WITH CLEARANCES PER NEC 110.26. ELECTRICIAN SHALL PERMANENTLY LABEL EQUIPMENT PER NEC 110.24.
- ENCLOSED SAFETY SWITCHES SHALL BE HEAVY DUTY TYPE BY SQUARE D, EATON, OR GE. ENCLOSED SWITCHES SHALL HAVE A HANDLE LOCKABLE IN THE OFF POSITION AND SHALL HAVE A HANDLE INTERLOCKED TO PREVENT OPENING THE FRONT COVER WHILE IN THE ON POSITION. ENCLOSED SWITCHES OF THE FUSIBLE TYPE SHALL BE FUSED IN ACCORDANCE WITH NAMEPLATE DATA WITH DUAL ELEMENT TYPE FUSES BY BUSSMAN, LITTELFUSE, OR MERSEN.
- OCCUPANCY SENSORS SHALL BE BY WATSTOPPER, LUTRON, LEVITON, SENSOR SWITCH, HUBBELL, OR APPROVED EQUAL.
- CIRCUIT BREAKERS SHALL BE MOLDED-CASE, THERMAL MAGNETIC TYPE WITH QUICK-BREAK, QUICK-BREAK MECHANISM, COMMON TRIP ON MULTI-POLE BREAKERS, AND UL LISTED FOR BOTH COPPER AND ALUMINUM CONDUCTORS. CIRCUIT BREAKERS IN PANELS SHALL BE SERIES RATED WITH THE BREAKER FEEDING THE PANEL FROM THE FACTORY.
- ALL WIRE, CONNECTORS, TERMINALS, AND LUSS SHALL BE PROVIDED BY THE ELECTRICAL CONTRACTOR. WHERE CONDUCTORS ARE RUN IN PARALLEL, LUSS SHALL BE LISTED FOR PARALLEL CONDUCTORS. PUSH WIRE CONNECTORS ARE NOT ALLOWED FOR BUILDING WIRE. PUSH CONNECTORS ARE ONLY ALLOWED, WHEN APPROVED, AS PART OF MANUFACTURED LISTED PRODUCTS. ALL WIRE SHALL BE INSTALLED IN CONDUIT UNLESS SPECIFICALLY NOTED OTHERWISE.
- THE INSULATION TYPE FOR INTERIOR WIRING SHALL BE DUAL RATED THIN/TWIM OR XHHW. ALL WIRING INSTALLED BELOW GRADE OR IN MOIST OR WET LOCATIONS SHALL HAVE TYPE THHN OR XHHW INSULATION. INSULATION VOLTAGE RATING SHALL BE 600 VOLTS AND A MINIMUM TEMPERATURE RATING OF 75C. CONDUCTORS SHALL BE SOLID OR STRANDED COPPER FOR #10 AWG AND #12 AWG, AND STRANDED COPPER FOR #8 AWG AND LARGER SIZES. ALL WIRING AND CABLE SHALL BE UL LISTED. ALL TERMINATIONS AND DEVICES SHALL BE RATED FOR USE WITH 75C CONDUCTORS. FINAL CONNECTIONS TO ALL MOTORS AND EQUIPMENT SUBJECT TO VIBRATION OR MOVEMENT SHALL BE MADE WITH STRANDED COPPER CONDUCTORS. CONDUCTORS SHALL BE BY CEROB WIRE, INC., INDUSTRIAL WIRE & CABLE, INC. OR SOUTHWIRE COMPANY. JOINTS IN SOLID CONDUCTORS SHALL BE SPLICED USING IDEAL "WIRE NUTS", 3M "SCOTCH LOCK", OR T&B "PIGGY" CONNECTORS IN JUNCTION BOXES, OUTLET BOXES, AND LIGHTING FIXTURES. JOINTS IN STRANDED CONDUCTORS SHALL BE SPLICED BY APPROVED MECHANICAL CONNECTORS AND GUM RUBBER TAPE OR FRICTION TAPE. SOLDERLESS MECHANICAL CONNECTORS FOR SPLICED AND TAPS, PROVIDED WITH UL APPROVED INSULATING COVERS, MAY BE USED INSTEAD OF MECHANICAL CONNECTORS PLUS TAPE. IN ALL CASES, CONDUCTORS SHALL BE CONTINUOUS FROM OUTLET TO OUTLET AND NO SPLICING SHALL BE MADE EXCEPT WITHIN OUTLET OR JUNCTION BOXES, TROUSERS, OR GUTTERS. WHERE CONCENTRIC, ECCENTRIC, OR OVERSIZED KNOCKOUTS ARE ENCOUNTERED, A GROUNDING TYPE INSULATED BUSHING SHALL BE PROVIDED.
- ALL LUMINAIRES SHALL BE LISTED. LUMINAIRES IN WET OR DAMP LOCATIONS SHALL BE MARKED AS SUITABLE FOR THE RESPECTIVE USE. EMERGENCY LIGHTING SHALL BE INSTALLED AS SHOWN. FINAL LOCATIONS OF ALL EXIT AND EMERGENCY LIGHTS SHALL BE VERIFIED WITH THE BUILDING INSPECTOR PRIOR TO INSTALLATION. ALL FLUORESCENT FIXTURES SHALL HAVE ELECTRONIC BALLASTS MEETING ANSI C82.11 FOR ELECTRONIC BALLAST PERFORMANCE. ALL BALLASTS SHALL BE UL LISTED AND MEET FEDERAL AND STATE EFFICIENCY REQUIREMENTS.
- ALL CONDUIT, FITTINGS, COUPLINGS, AND SUPPORTS SHALL BE PROVIDED BY THE ELECTRICAL CONTRACTOR. CONDUIT FITTINGS AND COUPLINGS SHALL BE BY APPLETON, RACO, OR O-2/GENEY. COUPLINGS SHALL BE THREADED, SET-SCREW, OR COMPRESSION TYPE. INDENTER OR CRIMP TYPE ARE NOT PERMITTED. CONDUIT FITTINGS IN ELECTRICAL BOXES INCLUDING PULL, JUNCTION, AND OUTLET BOXES, SHALL HAVE INSULATED THROATS TO PREVENT INSULATION SCORING. DIE CAST FITTINGS ARE NOT PERMITTED.
- EMT SHALL BE MANUFACTURED IN ACCORDANCE WITH AMERICAN NATIONAL STANDARDS INSTITUTE-AMERICAN NATIONAL STANDARD FOR STEEL ELECTRICAL METALLIC TUBING (EMT), ANSI C80.3 AND UL 797. RIGID METAL CONDUIT SHALL BE MANUFACTURED IN ACCORDANCE WITH ANSI-AMERICAN NATIONAL STANDARD FOR ELECTRICAL RIGID STEEL CONDUIT (ERSS), ANSI C80.1 AND UL 6. INTERMEDIATE METAL CONDUIT SHALL BE MANUFACTURED IN ACCORDANCE WITH ANSI-AMERICAN NATIONAL STANDARD FOR INTERMEDIATE METAL CONDUIT ANSI C80.6 AND UL 1242.
- METAL CONDUIT SHALL BE BY ALLOYED TUBING & CONDUIT, BECK MANUFACTURING, INC., OR WHEATLAND TUBE COMPANY. FLEXIBLE METAL CONDUIT SHALL BE BY AFC-CABLE SYSTEMS, INC. ELECTRO-FLEX COMPANY, OR INTERNATIONAL METAL HOSE.

- EC SHALL REVIEW THE MECHANICAL PLANS TO ESTABLISH POINTS OF CONNECTION AND THE EXTENT OF THE ELECTRICAL WORK TO BE PROVIDED IN THE CONTRACT.
- ALL CIRCUIT BREAKERS FEEDING HVAC EQUIPMENT SHALL BE HACR BREAKERS. ALL BRANCH CIRCUIT CONDUCTORS SHALL BE MINIMUM #12 AWG IN 3/4 IN CONDUIT. EACH MULTI-WIRE BRANCH CIRCUIT SHALL BE PROVIDED WITH A MEANS TO SIMULTANEOUSLY DISCONNECT ALL UNGROUNDED CONDUCTORS AT THE SOURCE PER NEC 210.4(B). GROUP ALL CONDUCTORS OF EACH MULTI-WIRE BRANCH CIRCUIT PER 210.4(D) WITH WIRE TIES OF SIMILAR MEANS. DO NOT EXCEED THREE WIRENAMES PER CONDUIT. DO NOT INSTALL ISOLATED GROUND AND NON-ISOLATED GROUND CIRCUITS IN THE SAME CONDUIT. INSTALL CONDUCTORS OF DIFFERENT VOLTAGES IN SEPARATE CONDUITS.
- COLOR CODE CONDUCTORS PER NEC. FEEDERS SHALL BE IDENTIFIED IN ACCORDANCE WITH NEC 215.12. USE BLACK, RED, AND BLUE FOR PHASES A, B, AND C RESPECTIVELY ON 208Y/120V, 3Ø, 4W SYSTEMS. WHITE FOR THE NEUTRAL. ISOLATED GROUND WIRES SHALL BE GREEN WITH YELLOW BANDS OR STRIPES. THIS IDENTIFICATION SHALL BE MADE AT EACH POINT WHERE A CONNECTION IS MADE. COLORS SHALL BE FACTORY APPLIED FOR CONDUCTORS #6 AWG AND SMALLER. ALL EQUIPMENT GROUNDING CONDUCTORS SHALL BE GREEN IN COLOR AND MINIMUM #12 AWG. THE EC SHALL PROVIDE PLENUM RATED CABLE FOR ANY ELECTRICAL, TELEPHONE, COMMUNICATION, OR OTHER CABLE THAT ENTERS CEILING RETURN PLenums.
- ALL LIGHT FIXTURES SHALL BE SUPPORTED INDEPENDENTLY OF THE SUSPENDED CEILING. COORDINATE LIGHTING LAYOUT WITH CEILING GRID, MECHANICAL EQUIPMENT, DUCTWORK AND SPRINKLER HEADS AS NECESSARY. SEE REFLECTED CEILING PLAN FOR DETAILS. FLUORESCENT FIXTURES UTILIZING DOUBLE-ENDED LAMPS MUST HAVE A DISCONNECTING MEANS COMPLYING WITH NEC 410.130(C).
- MOUNT LIGHT SWITCHES AT 48 IN AFF. MULTIPLE SWITCHES AT SAME LOCATION SHALL BE UNDER ONE WALL PLATE. VERIFY WALL PLATE COLOR AND MATERIAL WITH THE ARCHITECT/OWNER. INSTALL SWITCHES WITH OFF POSITION DOWN. ALL SWITCHES SHALL BE HEAVY DUTY, WIPY PLASTIC WITH TOGGLE HANDLE, RATED 120-277V AC, AND COMPLYING WITH NEMA WD 6 AND WD 1. SWITCHES SHALL BE BY COOPER WIRING DEVICES, LEVITON MANUFACTURING, PASS & SEYMOUR, OR HUBBELL. PROVIDE BOX DEVICE PARTITION/OWDERS FOR MULTI-GANG BOXES FOR COMPLIANCE WITH NEC 404.8(B).
- ELECTRICAL CONTRACTOR SHALL PROVIDE FIRE-STOPPING AT ALL ELECTRICAL PENETRATIONS OF RATED FLOORS AND WALLS TO PRESERVE OR RESTORE THE FIRE-RESISTANCE RATING. SEAL PENETRATIONS USING A UL LISTED SYSTEM FOUND IN THE UL DIRECTORY SPECIFIC TO THE UL LISTING OF THE ASSEMBLY BEING PENETRATED. SEE ARCHITECTURAL PLANS FOR UL RATED ASSEMBLIES SPECIFIC TO THIS PROJECT.
- ELECTRICAL CONTRACTOR SHALL PROVIDE GFCI RECEPTACLES IN KITCHENS, RESTROOMS, OUTDOORS, AND IN SHOP AREAS AS REQUIRED BY NEC. REFRIGERATORS AND WATER COOLERS MUST HAVE A DEDICATED GFCI BREAKER. EACH OUTDOOR HVAC UNIT MUST HAVE A GFCI RECEPTACLE WITHIN 25 FEET FOR SERVING. GFCI RECEPTACLES SHALL CONFORM TO UL 943 CLASS A AND UL 498 STANDARDS. SHOW WINDOW RECEPTACLES SHALL BE PROVIDED IN ACCORDANCE WITH 210.62 OF THE NEC. RECEPTACLES SHALL BE BY COOPER WIRING DEVICES, LEVITON MANUFACTURING, PASS & SEYMOUR, OR HUBBELL. ALL RECEPTACLES SHALL BE 125V RATED, HEAVY DUTY, AND COMPLY WITH NEMA WD 6 AND WD 1. LOCATIONS AND HEIGHTS OF ALL WALL-MOUNTED DEVICES SHALL BE COORDINATED WITH THE ARCHITECT PRIOR TO INSTALLATION.
- CONCEAL ALL CONDUIT EXCEPT IN MECHANICAL ROOMS OR UNFINISHED AREAS AS NOTED. USE EMT CONDUIT FOR ALL BRANCH CIRCUITS AND FEEDERS INSIDE THE BUILDING. TYPE MC CABLE AND TYPE AC CABLE MAY BE INSTALLED WITHIN WALLS IF ALL NEUTRAL WIRES, ISOLATED GROUND WIRES, AND EQUIPMENT GROUND WIRES AS LISTED ABOVE ARE CONTAINED IN THE CABLE. FLEXIBLE CONNECTIONS TO MOTORS AND OTHER EQUIPMENT SHALL BE MADE USING WEATHERPROOF FLEXIBLE CONDUIT. FOR LAY-IN LIGHT FIXTURES, USE MAXIMUM OF SIX (6) FEET OF FLEXIBLE MC CABLE (OR THE FLEXIBLE CONDUIT PROVIDED BY THE FIXTURE MANUFACTURER). SCHEDULE 40 PVC CONDUIT MAY BE USED FOR THE SECONDARY UNDERGROUND SERVICE, UNDERGROUND TELEPHONE SERVICE, AND BRANCH AND FEEDER CIRCUITS UNDER SLAB OR EXTERIOR TO THE BUILDING. EXPOSED EXTERIOR CONDUIT SHALL BE SCHEDULE 80 PVC. ALL UNDERGROUND RACEWAYS SHALL BE IDENTIFIED WITH UNDERGROUND LINE MARKING TAPE 6-8 IN BELOW GRADE DIRECTLY ABOVE THE RACEWAY. PROVIDE PULL WIRE IN EMPTY CONDUITS. UPSIZE CONDUIT FROM MINIMUM SIZE AS NECESSARY FOR LONGER PULLS. UNDERGROUND RACEWAYS THAT STUB INTO THE BOTTOM OF SWITCHBOARDS, OUTDOOR TRANSFORMERS, GENERATORS, ETC. SHALL RISE AT LEAST 2 IN ABOVE THE FINISHED SLAB TO PREVENT WATER FROM DRAINING INTO THE RACEWAYS. RACEWAYS THAT PENETRATE EXTERIOR WALLS OR INTERIOR PARTITIONS SEPARATING SPACES THAT WILL BE AT SIGNIFICANTLY DIFFERENT TEMPERATURES SHALL BE SEALED IN ACCORDANCE WITH 300.5(G), 300.7(A), AND 300.50(E) OF THE NEC. ROUTE CONDUIT IN AND UNDER SLAB FROM POINT-TO-POINT. ROUTE EXPOSED CONDUIT AND CONDUIT INSTALLED ABOVE ACCESSIBLE CEILINGS PARALLEL AND PERPENDICULAR TO WALLS COMPLETELY AND THOROUGHLY SMAR ALL RACEWAYS BEFORE INSTALLING WIRE. PULL ALL CONDUCTORS INTO EACH RACEWAY AT ONE TIME. USE A SUITABLE WIRE PULLING LUBRICANT FOR BUILDING WIRE #4 AWG AND LARGER.
- CABLES, RACEWAYS, OR BOXES, INSTALLED IN EXPOSED OR CONCEALED LOCATIONS UNDER METAL-CORRUGATED SHEET ROOF DECKING, SHALL BE INSTALLED AND SUPPORTED SO THERE IS NOT LESS THAN 1-1/2 IN MEASURED FROM THE LOWEST SURFACE OF THE ROOF DECKING TO THE TOP OF THE CABLE, RACEWAY, OR BOX. A CABLE, RACEWAY, OR BOX SHALL NOT BE INSTALLED IN CONCEALED LOCATIONS IN METAL-CORRUGATED SHEET ROOF DECKING-TYPE ROOF. SEE NEC 300.4(E). THE ELECTRICAL CONTRACTOR SHALL PROVIDE ALL OUTLET, JUNCTION, PULL BOXES, FITTINGS, AND SUPPORTS. ALL OUTLET AND JUNCTION BOXES SHALL BE GALVANIZED STEEL TYPE BY APPLETON, STEEL CITY, OR RACO. EXTERIOR BOXES SHALL BE TYPE FS. WAPORITE BOXES SHALL BE TYPE GS. WHERE SURFACE MOUNTED BOXES ARE USED, THOSE BOXES AND THEIR FACERATES SHALL HAVE ROUNDED CORNERS. BOXES INSTALLED IN FLOORS SHALL BE RATED FOR THE APPLICATION, MOUNT JUNCTION AND OUTLET BOXES FLUSH WITH FINISH SURFACES UNLESS OTHERWISE NOTED. WHERE MOUNTING HEIGHTS ARE GIVEN, THEY SHALL BE MEASURED FROM THE FINISHED FLOOR TO THE CENTER OF THE BOX. ALL BOXES SHALL BE SIZED PER NEC ARTICLE 314. ALL OUTLET AND JUNCTION BOXES SHALL HAVE A COVER PLATE, PROVIDED BY THE ELECTRICAL CONTRACTOR. OUTLET BOXES IN RATED WALLS SHALL BE INSTALLED IN ACCORDANCE WITH NORTH CAROLINA BUILDING CODE 712.3.2 (MAXIMUM BOX SIZE IS 16 SQUARE IN AND MAXIMUM OF SIX (6) BOXES PER 100 SQUARE FEET). INSTALL OUTLET BOXES IN RATED WALLS SUCH THAT OPENINGS OCCUR IN ONE SIDE ONLY WITHIN ANY GIVEN STUD SPACE. ALL CLEARANCES BETWEEN THE OUTLET BOX AND THE CEILING BOARD SHALL BE FILLED WITH JOINT COMPOUND OR OTHER APPROVED FIRE STOP MATERIAL. FLUSH MOUNTED JUNCTION BOXES IN ADJACENT ROOMS SHALL NOT BE MOUNTED BACK-TO-BACK. SURFACE MOUNTED FIXTURES SHALL BE FED THROUGH FLUSH MOUNTED 4X4 OCTAGONAL OR SQUARE BOXES.
- ALL CONDUIT, BOXES, AND ELECTRICAL EQUIPMENT SHALL BE FIRMLY AND SECURELY FASTENED TO OR SUPPORTED BY THE BUILDING STRUCTURAL MEMBERS OR EMBEDDED IN CONCRETE OR MASONRY. ELECTRICAL SUPPORTS SHALL NOT BE ATTACHED TO DUCTWORK, PIPING, OR THEIR SUPPORTS. HANGERS SHALL BE CATALOG ITEM COMPATIBLE WITH AND SUITABLE FOR THE INTENDED USE. FOR METAL ROOF DECK INSTALLATIONS, 1 IN EMT CONDUIT MAXIMUM AND 4 IN JUNCTION BOXES MAXIMUM MAY BE SUPPORTED BY DECKING. THE SUSPENDED CEILING SYSTEMS SHALL NOT BE USED FOR THE SUPPORT OF ELECTRICAL RACEWAY SYSTEMS OR SUPPORT OF COMMUNICATIONS DATA SYSTEMS WIRING. CONTRACTOR SHALL COMPLY WITH 1613 OF THE NORTH CAROLINA GENERAL CONSTRUCTION BUILDING CODE.
- IN ASSEMBLY AREAS EXCEEDING 100 PERSONS OCCUPANCY, WIRING METHODS SHALL COMPLY WITH NEC 518.
- ALL TELEPHONE AND COMMUNICATIONS OUTLETS AND RACEWAYS ARE ROUGH-IN ONLY. EACH TELEPHONE AND COMMUNICATIONS OUTLET SHALL BE A 4 IN SQUARE BY 2-1/8 IN DEEP BOX WITH 3/4 IN KNOCK-OUTS AND A 3/4 IN CONDUIT STUBBED FROM THE OUTLET BOX TO ABOVE THE CEILING. PROVIDE A NON-METALLIC INSULATING BUSHING ON ALL CONDUITS STUBBED ABOVE THE CEILING. PROVIDE A BLANK COVER PLATE ON ALL OUTLET BOXES.
- ELECTRICAL CONTRACTOR SHALL INSTALL DISCONNECT SWITCHES IN SIGHT OF ALL HARMORED EQUIPMENT AND APPLIANCES OR PROVIDE BREAKERS CAPABLE OF BEING LOCKED IN THE OPEN POSITION PER NEC 422.31. FOR MOTOR DRIVEN APPLIANCES, PROVIDE A DISCONNECTING MEANS PER NEC 422.31 AND 430 PART IX. WHERE AN INDIVIDUAL DISCONNECT SWITCH, CIRCUIT BREAKER, STARTER, ETC. IS SHOWN ON THE PLANS ADJUST TO ITS US LOAD AND NOT LOCATED ON A WALL, PROVIDE NECESSARY MATERIALS AND LABOR TO SUPPORT THE DEVICE.
- ELECTRICAL CONTRACTOR SHALL FIELD IDENTIFY ALL SWITCH BOARD, PANEL BOARDS, CONTROL PANELS, METER SOCKETS, ETC., TO WARN QUALIFIED PERSONS OF POTENTIAL ELECTRICAL ARC FLASH HAZARDS PER 110.16 OF NEC.
- ELECTRICAL CONTRACTOR SHALL PROVIDE NAMEPLATES FOR IDENTIFICATION OF ALL EQUIPMENT, SWITCHES, PANELS, ETC. THE NAMEPLATES SHALL BE LAMINATED PHENOLIC PLASTIC, BLACK FRONT, AND BACK WITH WHITE CORE. WHITE ENGRAVED LETTERS (1/4 IN MINIMUM) ETCHED INTO THE WHITE CORE. ELECTRICAL CONTRACTOR SHALL PROVIDE A TYPE WRITTEN DIRECTORY CARD THAT ACCURATELY IDENTIFIES CIRCUITS INSIDE EACH PANEL. HANDWRITTEN LABELS ARE NOT ACCEPTABLE.

METHODS:

- EC SHALL REVIEW THE MECHANICAL PLANS TO ESTABLISH POINTS OF CONNECTION AND THE EXTENT OF THE ELECTRICAL WORK TO BE PROVIDED IN THE CONTRACT.
- ALL CIRCUIT BREAKERS FEEDING HVAC EQUIPMENT SHALL BE HACR BREAKERS. ALL BRANCH CIRCUIT CONDUCTORS SHALL BE MINIMUM #12 AWG IN 3/4 IN CONDUIT. EACH MULTI-WIRE BRANCH CIRCUIT SHALL BE PROVIDED WITH A MEANS TO SIMULTANEOUSLY DISCONNECT ALL UNGROUNDED CONDUCTORS AT THE SOURCE PER NEC 210.4(B). GROUP ALL CONDUCTORS OF EACH MULTI-WIRE BRANCH CIRCUIT PER 210.4(D) WITH WIRE TIES OF SIMILAR MEANS. DO NOT EXCEED THREE WIRENAMES PER CONDUIT. DO NOT INSTALL ISOLATED GROUND AND NON-ISOLATED GROUND CIRCUITS IN THE SAME CONDUIT. INSTALL CONDUCTORS OF DIFFERENT VOLTAGES IN SEPARATE CONDUITS.
- COLOR CODE CONDUCTORS PER NEC. FEEDERS SHALL BE IDENTIFIED IN ACCORDANCE WITH NEC 215.12. USE BLACK, RED, AND BLUE FOR PHASES A, B, AND C RESPECTIVELY ON 208Y/120V, 3Ø, 4W SYSTEMS. WHITE FOR THE NEUTRAL. ISOLATED GROUND WIRES SHALL BE GREEN WITH YELLOW BANDS OR STRIPES. THIS IDENTIFICATION SHALL BE MADE AT EACH POINT WHERE A CONNECTION IS MADE. COLORS SHALL BE FACTORY APPLIED FOR CONDUCTORS #6 AWG AND SMALLER. ALL EQUIPMENT GROUNDING CONDUCTORS SHALL BE GREEN IN COLOR AND MINIMUM #12 AWG. THE EC SHALL PROVIDE PLENUM RATED CABLE FOR ANY ELECTRICAL, TELEPHONE, COMMUNICATION, OR OTHER CABLE THAT ENTERS CEILING RETURN PLenums.
- ALL LIGHT FIXTURES SHALL BE SUPPORTED INDEPENDENTLY OF THE SUSPENDED CEILING. COORDINATE LIGHTING LAYOUT WITH CEILING GRID, MECHANICAL EQUIPMENT, DUCTWORK AND SPRINKLER HEADS AS NECESSARY. SEE REFLECTED CEILING PLAN FOR DETAILS. FLUORESCENT FIXTURES UTILIZING DOUBLE-ENDED LAMPS MUST HAVE A DISCONNECTING MEANS COMPLYING WITH NEC 410.130(C).
- MOUNT LIGHT SWITCHES AT 48 IN AFF. MULTIPLE SWITCHES AT SAME LOCATION SHALL BE UNDER ONE WALL PLATE. VERIFY WALL PLATE COLOR AND MATERIAL WITH THE ARCHITECT/OWNER. INSTALL SWITCHES WITH OFF POSITION DOWN. ALL SWITCHES SHALL BE HEAVY DUTY, WIPY PLASTIC WITH TOGGLE HANDLE, RATED 120-277V AC, AND COMPLYING WITH NEMA WD 6 AND WD 1. SWITCHES SHALL BE BY COOPER WIRING DEVICES, LEVITON MANUFACTURING, PASS & SEYMOUR, OR HUBBELL. PROVIDE BOX DEVICE PARTITION/OWDERS FOR MULTI-GANG BOXES FOR COMPLIANCE WITH NEC 404.8(B).
- ELECTRICAL CONTRACTOR SHALL PROVIDE FIRE-STOPPING AT ALL ELECTRICAL PENETRATIONS OF RATED FLOORS AND WALLS TO PRESERVE OR RESTORE THE FIRE-RESISTANCE RATING. SEAL PENETRATIONS USING A UL LISTED SYSTEM FOUND IN THE UL DIRECTORY SPECIFIC TO THE UL LISTING OF THE ASSEMBLY BEING PENETRATED. SEE ARCHITECTURAL PLANS FOR UL RATED ASSEMBLIES SPECIFIC TO THIS PROJECT.
- ELECTRICAL CONTRACTOR SHALL PROVIDE GFCI RECEPTACLES IN KITCHENS, RESTROOMS, OUTDOORS, AND IN SHOP AREAS AS REQUIRED BY NEC. REFRIGERATORS AND WATER COOLERS MUST HAVE A DEDICATED GFCI BREAKER. EACH OUTDOOR HVAC UNIT MUST HAVE A GFCI RECEPTACLE WITHIN 25 FEET FOR SERVING. GFCI RECEPTACLES SHALL CONFORM TO UL 943 CLASS A AND UL 498 STANDARDS. SHOW WINDOW RECEPTACLES SHALL BE PROVIDED IN ACCORDANCE WITH 210.62 OF THE NEC. RECEPTACLES SHALL BE BY COOPER WIRING DEVICES, LEVITON MANUFACTURING, PASS & SEYMOUR, OR HUBBELL. ALL RECEPTACLES SHALL BE 125V RATED, HEAVY DUTY, AND COMPLY WITH NEMA WD 6 AND WD 1. LOCATIONS AND HEIGHTS OF ALL WALL-MOUNTED DEVICES SHALL BE COORDINATED WITH THE ARCHITECT PRIOR TO INSTALLATION.
- CONCEAL ALL CONDUIT EXCEPT IN MECHANICAL ROOMS OR UNFINISHED AREAS AS NOTED. USE EMT CONDUIT FOR ALL BRANCH CIRCUITS AND FEEDERS INSIDE THE BUILDING. TYPE MC CABLE AND TYPE AC CABLE MAY BE INSTALLED WITHIN WALLS IF ALL NEUTRAL WIRES, ISOLATED GROUND WIRES, AND EQUIPMENT GROUND WIRES AS LISTED ABOVE ARE CONTAINED IN THE CABLE. FLEXIBLE CONNECTIONS TO MOTORS AND OTHER EQUIPMENT SHALL BE MADE USING WEATHERPROOF FLEXIBLE CONDUIT. FOR LAY-IN LIGHT FIXTURES, USE MAXIMUM OF SIX (6) FEET OF FLEXIBLE MC CABLE (OR THE FLEXIBLE CONDUIT PROVIDED BY THE FIXTURE MANUFACTURER). SCHEDULE 40 PVC CONDUIT MAY BE USED FOR THE SECONDARY UNDERGROUND SERVICE, UNDERGROUND TELEPHONE SERVICE, AND BRANCH AND FEEDER CIRCUITS UNDER SLAB OR EXTERIOR TO THE BUILDING. EXPOSED EXTERIOR CONDUIT SHALL BE SCHEDULE 80 PVC. ALL UNDERGROUND RACEWAYS SHALL BE IDENTIFIED WITH UNDERGROUND LINE MARKING TAPE 6-8 IN BELOW GRADE DIRECTLY ABOVE THE RACEWAY. PROVIDE PULL WIRE IN EMPTY CONDUITS. UPSIZE CONDUIT FROM MINIMUM SIZE AS NECESSARY FOR LONGER PULLS. UNDERGROUND RACEWAYS THAT STUB INTO THE BOTTOM OF SWITCHBOARDS, OUTDOOR TRANSFORMERS, GENERATORS, ETC. SHALL RISE AT LEAST 2 IN ABOVE THE FINISHED SLAB TO PREVENT WATER FROM DRAINING INTO THE RACEWAYS. RACEWAYS THAT PENETRATE EXTERIOR WALLS OR INTERIOR PARTITIONS SEPARATING SPACES THAT WILL BE AT SIGNIFICANTLY DIFFERENT TEMPERATURES SHALL BE SEALED IN ACCORDANCE WITH 300.5(G), 300.7(A), AND 300.50(E) OF THE NEC. ROUTE CONDUIT IN AND UNDER SLAB FROM POINT-TO-POINT. ROUTE EXPOSED CONDUIT AND CONDUIT INSTALLED ABOVE ACCESSIBLE CEILINGS PARALLEL AND PERPENDICULAR TO WALLS COMPLETELY AND THOROUGHLY SMAR ALL RACEWAYS BEFORE INSTALLING WIRE. PULL ALL CONDUCTORS INTO EACH RACEWAY AT ONE TIME. USE A SUITABLE WIRE PULLING LUBRICANT FOR BUILDING WIRE #4 AWG AND LARGER.
- CABLES, RACEWAYS, OR BOXES, INSTALLED IN EXPOSED OR CONCEALED LOCATIONS UNDER METAL-CORRUGATED SHEET ROOF DECKING, SHALL BE INSTALLED AND SUPPORTED SO THERE IS NOT LESS THAN 1-1/2 IN MEASURED FROM THE LOWEST SURFACE OF THE ROOF DECKING TO THE TOP OF THE CABLE, RACEWAY, OR BOX. A CABLE, RACEWAY, OR BOX SHALL NOT BE INSTALLED IN CONCEALED LOCATIONS IN METAL-CORRUGATED SHEET ROOF DECKING-TYPE ROOF. SEE NEC 300.4(E). THE ELECTRICAL CONTRACTOR SHALL PROVIDE ALL OUTLET, JUNCTION, PULL BOXES, FITTINGS, AND SUPPORTS. ALL OUTLET AND JUNCTION BOXES SHALL BE GALVANIZED STEEL TYPE BY APPLETON, STEEL CITY, OR RACO. EXTERIOR BOXES SHALL BE TYPE FS. WAPORITE BOXES SHALL BE TYPE GS. WHERE SURFACE MOUNTED BOXES ARE USED, THOSE BOXES AND THEIR FACERATES SHALL HAVE ROUNDED CORNERS. BOXES INSTALLED IN FLOORS SHALL BE RATED FOR THE APPLICATION, MOUNT JUNCTION AND OUTLET BOXES FLUSH WITH FINISH SURFACES UNLESS OTHERWISE NOTED. WHERE MOUNTING HEIGHTS ARE GIVEN, THEY SHALL BE MEASURED FROM THE FINISHED FLOOR TO THE CENTER OF THE BOX. ALL BOXES SHALL BE SIZED PER NEC ARTICLE 314. ALL OUTLET AND JUNCTION BOXES SHALL HAVE A COVER PLATE, PROVIDED BY THE ELECTRICAL CONTRACTOR. OUTLET BOXES IN RATED WALLS SHALL BE INSTALLED IN ACCORDANCE WITH NORTH CAROLINA BUILDING CODE 712.3.2 (MAXIMUM BOX SIZE IS 16 SQUARE IN AND MAXIMUM OF SIX (6) BOXES PER 100 SQUARE FEET). INSTALL OUTLET BOXES IN RATED WALLS SUCH THAT OPENINGS OCCUR IN ONE SIDE ONLY WITHIN ANY GIVEN STUD SPACE. ALL CLEARANCES BETWEEN THE OUTLET BOX AND THE CEILING BOARD SHALL BE FILLED WITH JOINT COMPOUND OR OTHER APPROVED FIRE STOP MATERIAL. FLUSH MOUNTED JUNCTION BOXES IN ADJACENT ROOMS SHALL NOT BE MOUNTED BACK-TO-BACK. SURFACE MOUNTED FIXTURES SHALL BE FED THROUGH FLUSH MOUNTED 4X4 OCTAGONAL OR SQUARE BOXES.

- EC SHALL REVIEW THE MECHANICAL PLANS TO ESTABLISH POINTS OF CONNECTION AND THE EXTENT OF THE ELECTRICAL WORK TO BE PROVIDED IN THE CONTRACT.
- ALL CIRCUIT BREAKERS FEEDING HVAC EQUIPMENT SHALL BE HACR BREAKERS. ALL BRANCH CIRCUIT CONDUCTORS SHALL BE MINIMUM #12 AWG IN 3/4 IN CONDUIT. EACH MULTI-WIRE BRANCH CIRCUIT SHALL BE PROVIDED WITH A MEANS TO SIMULTANEOUSLY DISCONNECT ALL UNGROUNDED CONDUCTORS AT THE SOURCE PER NEC 210.4(B). GROUP ALL CONDUCTORS OF EACH MULTI-WIRE BRANCH CIRCUIT PER 210.4(D) WITH WIRE TIES OF SIMILAR MEANS. DO NOT EXCEED THREE WIRENAMES PER CONDUIT. DO NOT INSTALL ISOLATED GROUND AND NON-ISOLATED GROUND CIRCUITS IN THE SAME CONDUIT. INSTALL CONDUCTORS OF DIFFERENT VOLTAGES IN SEPARATE CONDUITS.
- COLOR CODE CONDUCTORS PER NEC. FEEDERS SHALL BE IDENTIFIED IN ACCORDANCE WITH NEC 215.12. USE BLACK, RED, AND BLUE FOR PHASES A, B, AND C RESPECTIVELY ON 208Y/120V, 3Ø, 4W SYSTEMS. WHITE FOR THE NEUTRAL. ISOLATED GROUND WIRES SHALL BE GREEN WITH YELLOW BANDS OR STRIPES. THIS IDENTIFICATION SHALL BE MADE AT EACH POINT WHERE A CONNECTION IS MADE. COLORS SHALL BE FACTORY APPLIED FOR CONDUCTORS #6 AWG AND SMALLER. ALL EQUIPMENT GROUNDING CONDUCTORS SHALL BE GREEN IN COLOR AND MINIMUM #12 AWG. THE EC SHALL PROVIDE PLENUM RATED CABLE FOR ANY ELECTRICAL, TELEPHONE, COMMUNICATION, OR OTHER CABLE THAT ENTERS CEILING RETURN PLenums.
- ALL LIGHT FIXTURES SHALL BE SUPPORTED INDEPENDENTLY OF THE SUSPENDED CEILING. COORDINATE LIGHTING LAYOUT WITH CEILING GRID, MECHANICAL EQUIPMENT, DUCTWORK AND SPRINKLER HEADS AS NECESSARY. SEE REFLECTED CEILING PLAN FOR DETAILS. FLUORESCENT FIXTURES UTILIZING DOUBLE-ENDED LAMPS MUST HAVE A DISCONNECTING MEANS COMPLYING WITH NEC 410.130(C).
- MOUNT LIGHT SWITCHES AT 48 IN AFF. MULTIPLE SWITCHES AT SAME LOCATION SHALL BE UNDER ONE WALL PLATE. VERIFY WALL PLATE COLOR AND MATERIAL WITH THE ARCHITECT/OWNER. INSTALL SWITCHES WITH OFF POSITION DOWN. ALL SWITCHES SHALL BE HEAVY DUTY, WIPY PLASTIC WITH TOGGLE HANDLE, RATED 120-277V AC, AND COMPLYING WITH NEMA WD 6 AND WD 1. SWITCHES SHALL BE BY COOPER WIRING DEVICES, LEVITON MANUFACTURING, PASS & SEYMOUR, OR HUBBELL. PROVIDE BOX DEVICE PARTITION/OWDERS FOR MULTI-GANG BOXES FOR COMPLIANCE WITH NEC 404.8(B).
- ELECTRICAL CONTRACTOR SHALL PROVIDE FIRE-STOPPING AT ALL ELECTRICAL PENETRATIONS OF RATED FLOORS AND WALLS TO PRESERVE OR RESTORE THE FIRE-RESISTANCE RATING. SEAL PENETRATIONS USING A UL LISTED SYSTEM FOUND IN THE UL DIRECTORY SPECIFIC TO THE UL LISTING OF THE ASSEMBLY BEING PENETRATED. SEE ARCHITECTURAL PLANS FOR UL RATED ASSEMBLIES SPECIFIC TO THIS PROJECT.
- ELECTRICAL CONTRACTOR SHALL PROVIDE GFCI RECEPTACLES IN KITCHENS, RESTROOMS, OUTDOORS, AND IN SHOP AREAS AS REQUIRED BY NEC. REFRIGERATORS AND WATER COOLERS MUST HAVE A DEDICATED GFCI BREAKER. EACH OUTDOOR HVAC UNIT MUST HAVE A GFCI RECEPTACLE WITHIN 25 FEET FOR SERVING. GFCI RECEPTACLES SHALL CONFORM TO UL 943 CLASS A AND UL 498 STANDARDS. SHOW WINDOW RECEPTACLES SHALL BE PROVIDED IN ACCORDANCE WITH 210.62 OF THE NEC. RECEPTACLES SHALL BE BY COOPER WIRING DEVICES, LEVITON MANUFACTURING, PASS & SEYMOUR, OR HUBBELL. ALL RECEPTACLES SHALL BE 125V RATED, HEAVY DUTY, AND COMPLY WITH NEMA WD 6 AND WD 1. LOCATIONS AND HEIGHTS OF ALL WALL-MOUNTED DEVICES SHALL BE COORDINATED WITH THE ARCHITECT PRIOR TO INSTALLATION.
- CONCEAL ALL CONDUIT EXCEPT IN MECHANICAL ROOMS OR UNFINISHED AREAS AS NOTED. USE EMT CONDUIT FOR ALL BRANCH CIRCUITS AND FEEDERS INSIDE THE BUILDING. TYPE MC CABLE AND TYPE AC CABLE MAY BE INSTALLED WITHIN WALLS IF ALL NEUTRAL WIRES, ISOLATED GROUND WIRES, AND EQUIPMENT GROUND WIRES AS LISTED ABOVE ARE CONTAINED IN THE CABLE. FLEXIBLE CONNECTIONS TO MOTORS AND OTHER EQUIPMENT SHALL BE MADE USING WEATHERPROOF FLEXIBLE CONDUIT. FOR LAY-IN LIGHT FIXTURES, USE MAXIMUM OF SIX (6) FEET OF FLEXIBLE MC CABLE (OR THE FLEXIBLE CONDUIT PROVIDED BY THE FIXTURE MANUFACTURER). SCHEDULE 40 PVC CONDUIT MAY BE USED FOR THE SECONDARY UNDERGROUND SERVICE, UNDERGROUND TELEPHONE SERVICE, AND BRANCH AND FEEDER CIRCUITS UNDER SLAB OR EXTERIOR TO THE BUILDING. EXPOSED EXTERIOR CONDUIT SHALL BE SCHEDULE 80 PVC. ALL UNDERGROUND RACEWAYS SHALL BE IDENTIFIED WITH UNDERGROUND LINE MARKING TAPE 6-8 IN BELOW GRADE DIRECTLY ABOVE THE RACEWAY. PROVIDE PULL WIRE IN EMPTY CONDUITS. UPSIZE CONDUIT FROM MINIMUM SIZE AS NECESSARY FOR LONGER PULLS. UNDERGROUND RACEWAYS THAT STUB INTO THE BOTTOM OF SWITCHBOARDS, OUTDOOR TRANSFORMERS, GENERATORS, ETC. SHALL RISE AT LEAST 2 IN ABOVE THE FINISHED SLAB TO PREVENT WATER FROM DRAINING INTO THE RACEWAYS. RACEWAYS THAT PENETRATE EXTERIOR WALLS OR INTERIOR PARTITIONS SEPARATING SPACES THAT WILL BE AT SIGNIFICANTLY DIFFERENT TEMPERATURES SHALL BE SEALED IN ACCORDANCE WITH 300.5(G), 300.7(A), AND 300.50(E) OF THE NEC. ROUTE CONDUIT IN AND UNDER SLAB FROM POINT-TO-POINT. ROUTE EXPOSED CONDUIT AND CONDUIT INSTALLED ABOVE ACCESSIBLE CEILINGS PARALLEL AND PERPENDICULAR TO WALLS COMPLETELY AND THOROUGHLY SMAR ALL RACEWAYS BEFORE INSTALLING WIRE. PULL ALL CONDUCTORS INTO EACH RACEWAY AT ONE TIME. USE A SUITABLE WIRE PULLING LUBRICANT FOR BUILDING WIRE #4 AWG AND LARGER.
- CABLES, RACEWAYS, OR BOXES, INSTALLED IN EXPOSED OR CONCEALED LOCATIONS UNDER METAL-CORRUGATED SHEET ROOF DECKING, SHALL BE INSTALLED AND SUPPORTED SO THERE IS NOT LESS THAN 1-1/2 IN MEASURED FROM THE LOWEST SURFACE OF THE ROOF DECKING TO THE TOP OF THE CABLE, RACEWAY, OR BOX. A CABLE, RACEWAY, OR BOX SHALL NOT BE INSTALLED IN CONCEALED LOCATIONS IN METAL-CORRUGATED SHEET ROOF DECKING-TYPE ROOF. SEE NEC 300.4(E). THE ELECTRICAL CONTRACTOR SHALL PROVIDE ALL OUTLET, JUNCTION, PULL BOXES, FITTINGS, AND SUPPORTS. ALL OUTLET AND JUNCTION BOXES SHALL BE GALVANIZED STEEL TYPE BY APPLETON, STEEL CITY, OR RACO. EXTERIOR BOXES SHALL BE TYPE FS. WAPORITE BOXES SHALL BE TYPE GS. WHERE SURFACE MOUNTED BOXES ARE USED, THOSE BOXES AND THEIR FACERATES SHALL HAVE ROUNDED CORNERS. BOXES INSTALLED IN FLOORS SHALL BE RATED FOR THE APPLICATION, MOUNT JUNCTION AND OUTLET BOXES FLUSH WITH FINISH SURFACES UNLESS OTHERWISE NOTED. WHERE MOUNTING HEIGHTS ARE GIVEN, THEY SHALL BE MEASURED FROM THE FINISHED FLOOR TO THE CENTER OF THE BOX. ALL BOXES SHALL BE SIZED PER NEC ARTICLE 314. ALL OUTLET AND JUNCTION BOXES SHALL HAVE A COVER PLATE, PROVIDED BY THE ELECTRICAL CONTRACTOR. OUTLET BOXES IN RATED WALLS SHALL BE INSTALLED IN ACCORDANCE WITH NORTH CAROLINA BUILDING CODE 712.3.2 (MAXIMUM BOX SIZE IS 16 SQUARE IN AND MAXIMUM OF SIX (6) BOXES PER 100 SQUARE FEET). INSTALL OUTLET BOXES IN RATED WALLS SUCH THAT OPENINGS OCCUR IN ONE SIDE ONLY WITHIN ANY GIVEN STUD SPACE. ALL CLEARANCES BETWEEN THE OUTLET BOX AND THE CEILING BOARD SHALL BE FILLED WITH JOINT COMPOUND OR OTHER APPROVED FIRE STOP MATERIAL. FLUSH MOUNTED JUNCTION BOXES IN ADJACENT ROOMS SHALL NOT BE MOUNTED BACK-TO-BACK. SURFACE MOUNTED FIXTURES SHALL BE FED THROUGH FLUSH MOUNTED 4X4 OCTAGONAL OR SQUARE BOXES.
- ALL CONDUIT, BOXES, AND ELECTRICAL EQUIPMENT SHALL BE FIRMLY AND SECURELY FASTENED TO OR SUPPORTED BY THE BUILDING STRUCTURAL MEMBERS OR EMBEDDED IN CONCRETE OR MASONRY. ELECTRICAL SUPPORTS SHALL NOT BE ATTACHED TO DUCTWORK, PIPING, OR THEIR SUPPORTS. HANGERS SHALL BE CATALOG ITEM COMPATIBLE WITH AND SUITABLE FOR THE INTENDED USE. FOR METAL ROOF DECK INSTALLATIONS, 1 IN EMT CONDUIT MAXIMUM AND 4 IN JUNCTION BOXES MAXIMUM MAY BE SUPPORTED BY DECKING. THE SUSPENDED CEILING SYSTEMS SHALL NOT BE USED FOR THE SUPPORT OF ELECTRICAL RACEWAY SYSTEMS OR SUPPORT OF COMMUNICATIONS DATA SYSTEMS WIRING. CONTRACTOR SHALL COMPLY WITH 1613 OF THE NORTH CAROLINA GENERAL CONSTRUCTION BUILDING CODE.
- IN ASSEMBLY AREAS EXCEEDING 100 PERSONS OCCUPANCY, WIRING METHODS SHALL COMPLY WITH NEC 518.
- ALL TELEPHONE AND COMMUNICATIONS OUTLETS AND RACEWAYS ARE ROUGH-IN ONLY. EACH TELEPHONE AND COMMUNICATIONS OUTLET SHALL BE A 4 IN SQUARE BY 2-1/8 IN DEEP BOX WITH 3/4 IN KNOCK-OUTS AND A 3/4 IN CONDUIT STUBBED FROM THE OUTLET BOX TO ABOVE THE CEILING. PROVIDE A NON-METALLIC INSULATING BUSHING ON ALL CONDUITS STUBBED ABOVE THE CEILING. PROVIDE A BLANK COVER PLATE ON ALL OUTLET BOXES.
- ELECTRICAL CONTRACTOR SHALL INSTALL DISCONNECT SWITCHES IN SIGHT OF ALL HARMORED EQUIPMENT AND APPLIANCES OR PROVIDE BREAKERS CAPABLE OF BEING LOCKED IN THE OPEN POSITION PER NEC 422.31. FOR MOTOR DRIVEN APPLIANCES, PROVIDE A DISCONNECTING MEANS PER NEC 422.31 AND 430 PART IX. WHERE AN INDIVIDUAL DISCONNECT SWITCH, CIRCUIT BREAKER, STARTER, ETC. IS SHOWN ON THE PLANS ADJUST TO ITS US LOAD AND NOT LOCATED ON A WALL, PROVIDE NECESSARY MATERIALS AND LABOR TO SUPPORT THE DEVICE.
- ELECTRICAL CONTRACTOR SHALL FIELD IDENTIFY ALL SWITCH BOARD, PANEL BOARDS, CONTROL PANELS, METER SOCKETS, ETC., TO WARN QUALIFIED PERSONS OF POTENTIAL ELECTRICAL ARC FLASH HAZARDS PER 110.16 OF NEC.
- ELECTRICAL CONTRACTOR SHALL PROVIDE NAMEPLATES FOR IDENTIFICATION OF ALL EQUIPMENT, SWITCHES, PANELS, ETC. THE NAMEPLATES SHALL BE LAMINATED PHENOLIC PLASTIC, BLACK FRONT, AND BACK WITH WHITE CORE. WHITE ENGRAVED LETTERS (1/4 IN MINIMUM) ETCHED INTO THE WHITE CORE. ELECTRICAL CONTRACTOR SHALL PROVIDE A TYPE WRITTEN DIRECTORY CARD THAT ACCURATELY IDENTIFIES CIRCUITS INSIDE EACH PANEL. HANDWRITTEN LABELS ARE NOT ACCEPTABLE.

SYSTEM COMMISSIONING PLAN


PURSUANT TO THE REQUIREMENTS OF SECTION 408 OF THE NC ENERGY CONSERVATION CODE, COMMISSIONING MAY BE REQUIRED BY THE A/E OR MECHANICAL, HOT WATER, AND LIGHTING CONTROLS SYSTEMS. A REPRESENTATIVE OF KILIAN ENGINEERING, INC. WOULD THEN BE REQUIRED TO PERFORM A SITE VISIT TO OBSERVE THE INSTALLED AND OPERATIONAL SYSTEMS AND VIEW ANY PRE-PERFORMED TESTS AS NOTED BELOW. KILIAN ENGINEERING SHALL BE CONTACTED NOT LESS THAN 3 BUSINESS DAYS PRIOR TO NECESSARY TESTING TO SCHEDULE A VISIT. COORDINATION BETWEEN THE A/E, EC, AND PC SHALL OCCUR SO THAT SYSTEM COMMISSIONING CAN BE DONE FOR ALL THREE PORTIONS OF THE APPROX C1 DOCUMENT IN A SINGLE VISIT.

**LIGHTING CONTROLS:**

- ELECTRICAL CONTRACTOR TO TEST ALL OCCUPANCY SENSORS FOR OPERATION ACCORDING TO MANUFACTURER'S INSTRUCTIONS AND SEQUENCE OF OPERATIONS. PROVIDE WRITTEN DOCUMENTATION OF ANY DISCREPANCIES FROM PLANS.
- ELECTRICAL CONTRACTOR TO TEST ALL TIME CLOCKS FOR OPERATION ACCORDING TO MANUFACTURER'S INSTRUCTIONS AND SEQUENCE OF OPERATIONS. TIME CLOCKS TO BE SET FOR ACCURATE DAY/TIME CALIBRATION AND SET TO OWNER'S PREFERRED SCHEDULE.
- ELECTRICAL CONTRACTOR MUST PROVIDE FULL DOCUMENTATION (SUBMITTALS, MANUALS, MAINTENANCE SCHEDULE, ETC.) TO OWNER AS REQUIRED IN 2018 NEC CC 408.2.5.2

**\*\*NOTE\*\*:** STATEMENT OF SYSTEM COMMISSIONING REFLECTS OPERATION OF EQUIPMENT PRIOR TO ISSUANCE OF CERTIFICATE OF OCCUPANCY AND DOES NOT CONSTITUTE A WARRANTY FOR CONTINUED OPERATION

MARK	DESCRIPTION	LOUVER/LENS	LED LIGHT FIXTURE SCHEDULE								
			LAMPS - SYLVANIA		VOLTAGE	INPUT WATTAGE	ALLOWANCE	MOUNTING	REMARKS	MFG	MODEL
			TYPE	CTT							
A	DIMMING LED HIGH BAY	0.125" ACRYLIC	LED	3500K	120	125	-	SUSPENDED	2	LITHONIA	1BL-15L-WD-WD-L1-LP85-MP16G-WG1BL
B	2X4 LED LENSED TROFFER DIMMING	0.125" ACRYLIC	LED	3500K	120	71	-	LAY-IN	2	LITHONIA	20TL-4-72L-EZ1-LP85
C	2X2 LED LENSED TROFFER DIMMING	0.125" ACRYLIC	LED	3500K	120	71	-	LAY-IN	2	LITHONIA	20TL-2-72L-EZ1-LP85
D	6" LED CAN	-	LED	3500K	120	15 MAX	-	RECESSED	2	OWNER TO SPECIFY	OWNER TO SPECIFY
EXH	LED EXIT/EMERGENCY COMBO	ACRYLIC	LED	N/A	120	3	-	VARIABLE	1,2	EELP	XE-LED-2-R-W-SD
OE	EXTERIOR DUAL LED EMERGENCY LIGHT	ACRYLIC	LED	-	120	9	-	SURFACE	1,2	EELP	DEL-LED-BR-ACEM
EM	DUAL HEAD EMERGENCY FIXTURE	ACRYLIC	LED	N/A	120	2	-	VARIABLE			

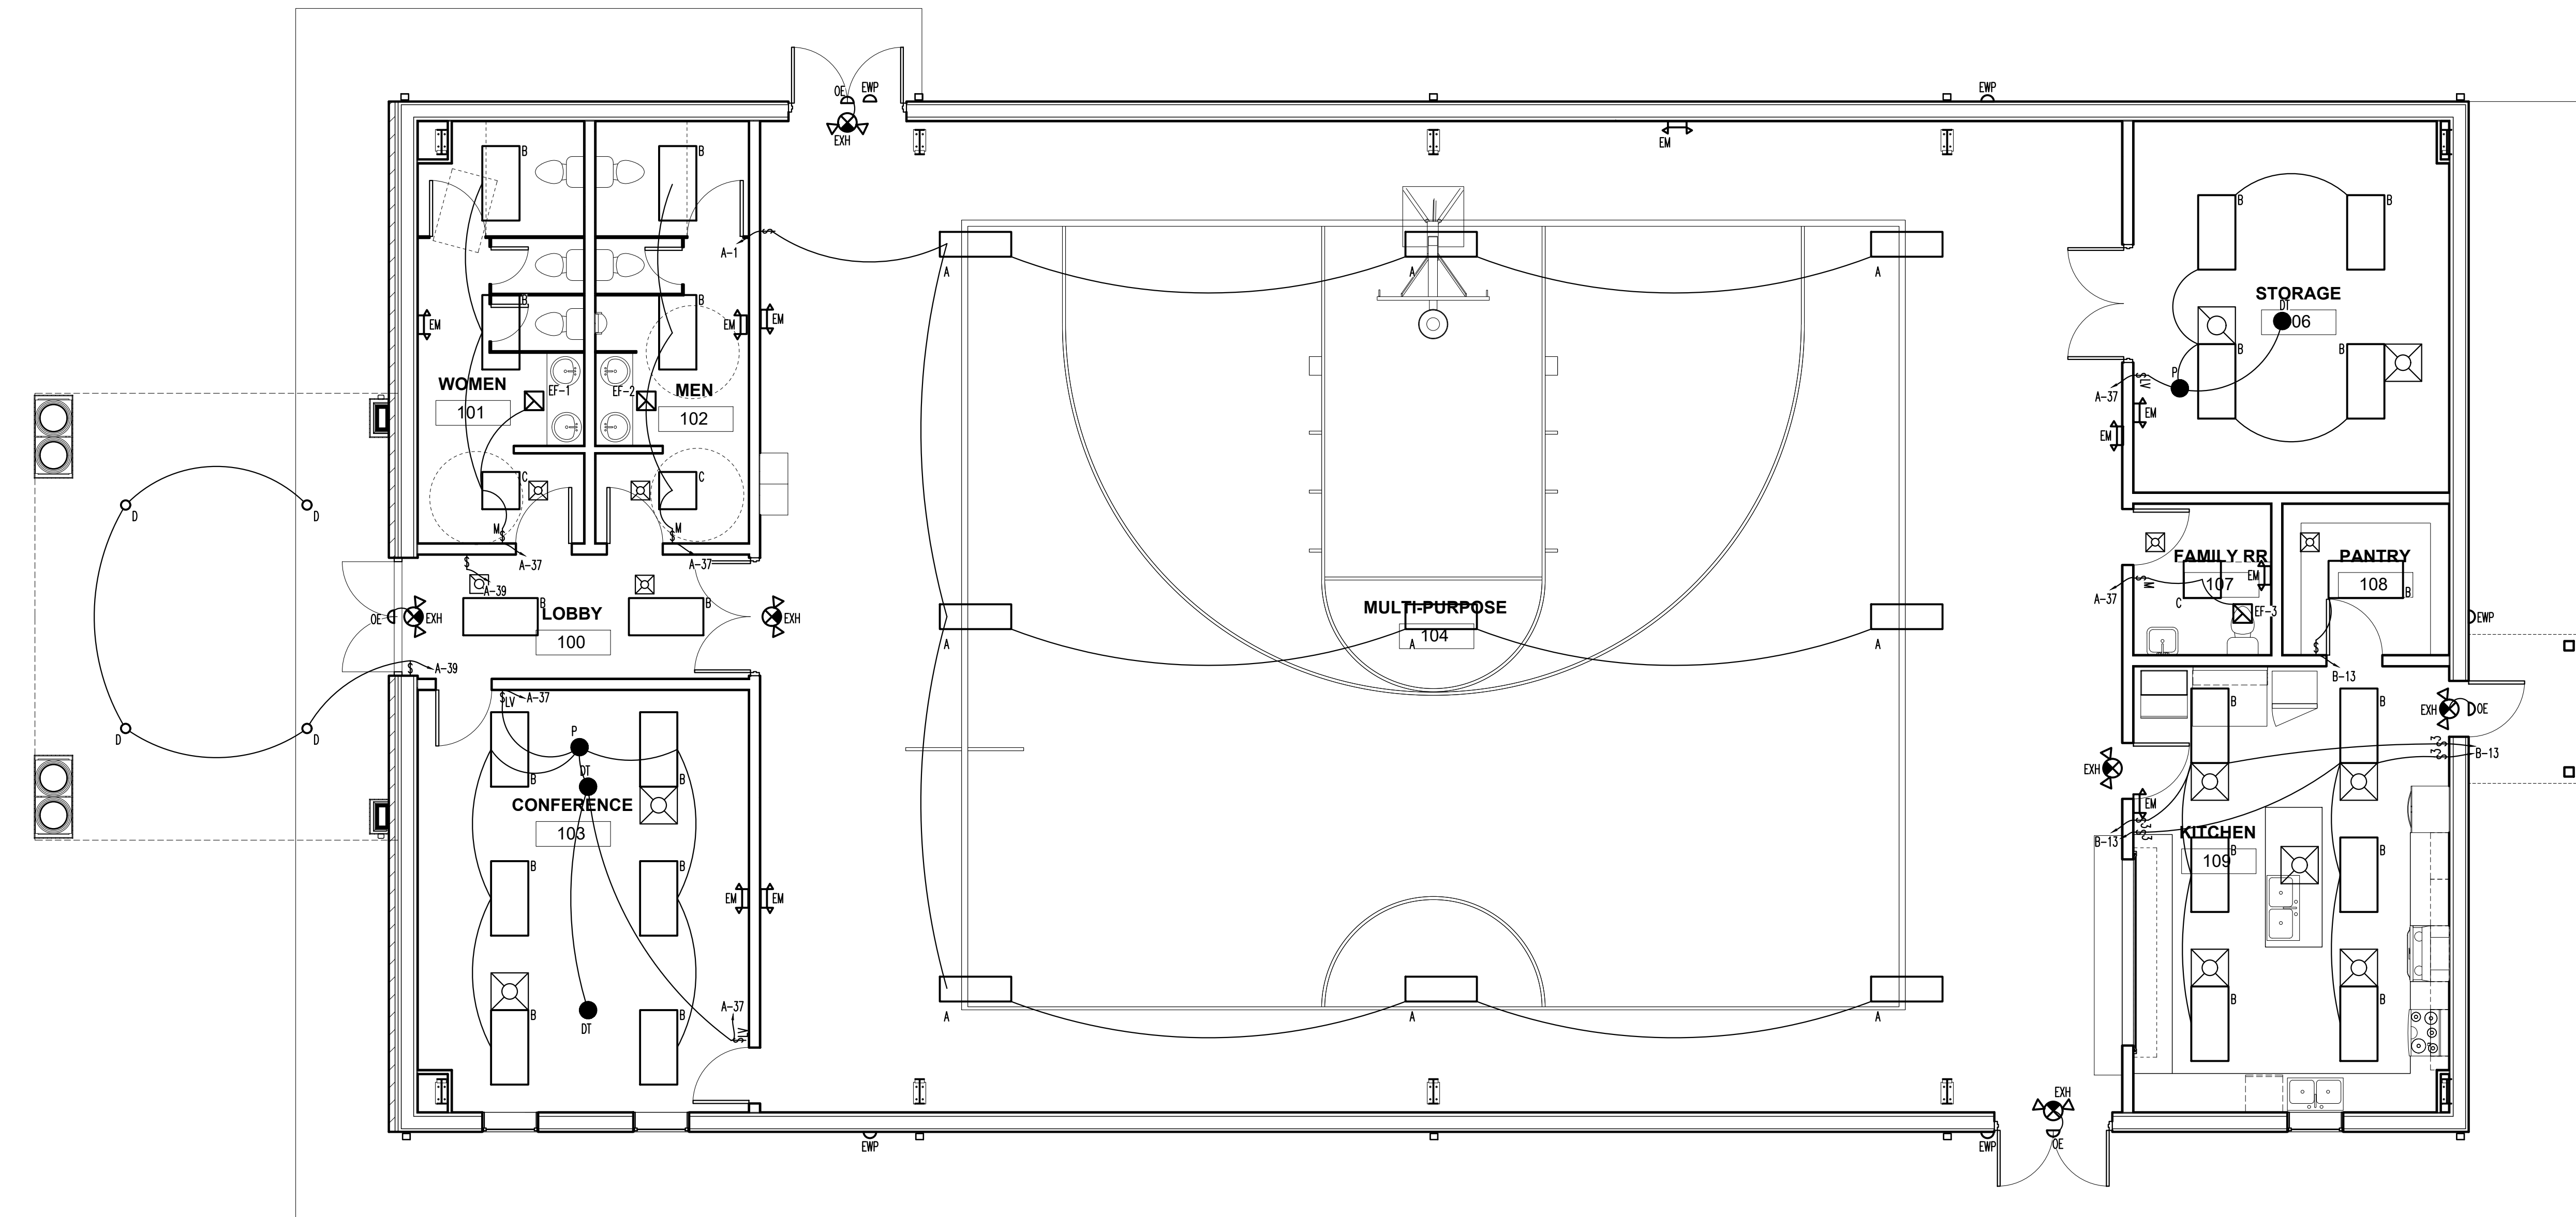

GENERAL LIGHTING SENSOR NOTES:


1. ALL SWITCHES AND SENSORS TO BE WHITE.
2. EC TO ORDER ALL WALL PLATES AND ACCESSORIES FOR COMPLETE INSTALLATION.
3. EC TO INCLUDE PRE-INSTALLATION MEETING IN BID.

LIGHTING DEVICE LEGEND

SYMBOL	DESCRIPTION	REMARKS
⌚	SINGLE POLE WALL SWITCH	HEAVY DUTY, AC ONLY, COMMERCIAL GRADE GENERAL USE SNAP SWITCH COMPLYING WITH NEMA WD 6 AND WD 1. IVORY PLASTIC BODY WITH TOGGLE HANDLE. 120-277V, 20A. MEET FEDERAL SPECIFICATION W-5-896.
⌚ <sub>2</sub>	DIMMER SWITCH	COMMERCIAL GRADE, 120V, 1500W
⌚ <sub>2</sub>	WIRELESS 2 BUTTON SWITCH	PLJ2-2B-GWH-L01(CV-1)-WH
⌚ <sub>2</sub>	WALL MOUNTED OCCUPANCY SENSOR	WATTSTOPPER DW-100 LOW VOLTAGE OCCUPANCY SENSOR. ULTRA SONIC AND INFRARED.
⌚ <sub>2</sub>	LOW VOLTAGE SWITCH	WATTSTOPPER LVS-1 LOW VOLTAGE MOMENTARY CONTROL SWITCH.
⌚ <sub>3</sub>	3 WAY SWITCH	3-WAY TYPE SWITCH WITH SAME CHARACTERISTICS AS SINGLE POLE SWITCH ABOVE.
⌚ <sub>2</sub>	2-SINGLE POLE SWITCHES	INDICATES BI-LEVEL SWITCHING. INNER LAMPS SWITCHED INDEPENDENTLY OF OUTER LAMPS.
⌚ <sub>2</sub>	CEILING OCCUPANCY SENSOR	WATTSTOPPER, DT-300 LOW VOLTAGE OCCUPANCY SENSOR. 360° ULTRA SONIC AND INFRARED.
⌚ <sub>2</sub>	CEILING OCCUPANCY SENSOR	WATTSTOPPER, WT-225S LOW VOLTAGE OCCUPANCY SENSOR. ULTRA SONIC, 90 LINEAR FT COVERAGE.
⌚ <sub>2</sub>	SWITCHING PHOTOSENSOR	WATTSTOPPER, LS-102, CONSULT OWNER FOR FOOT-CANDLE SET POINT.
⌚ <sub>2</sub>	POWER PACK	WATTSTOPPER, BZ-150 LOW VOLTAGE POWER PACK FOR CEILING PACK SENSORS.
⌚ <sub>2</sub>	JUNCTION BOX	GALVANIZED METAL BOX CONSTRUCTED IN ACCORDANCE WITH 314.40 OF THE NEC.
⌚ <sub>2</sub>	EXHAUST FAN	VENT FAN, 120V, CFM AS NOTED MC TO PROVIDE AND VENT, EC TO WIRE.

PLAN GENERAL NOTES

1. CONNECT ALL EM FIXTURES AHEAD OF SWITCHING IN EACH RESPECTIVE ROOM (CIRCUIT A-39 FOR EXTERIOR & LOBBY, CIRCUIT A-1 FOR GYMNASIUM, CIRCUIT B-13 FOR THE KITCHEN, AND CIRCUIT A-37 FOR ALL OTHER INTERIOR ROOMS). EC TO COORDINATE.
2. CONNECT ALL EXTERIOR WALL PACKS TO CIRCUIT A-39.
3. ALL EXTERIOR FIXTURES TO HAVE PHOTOCELL.


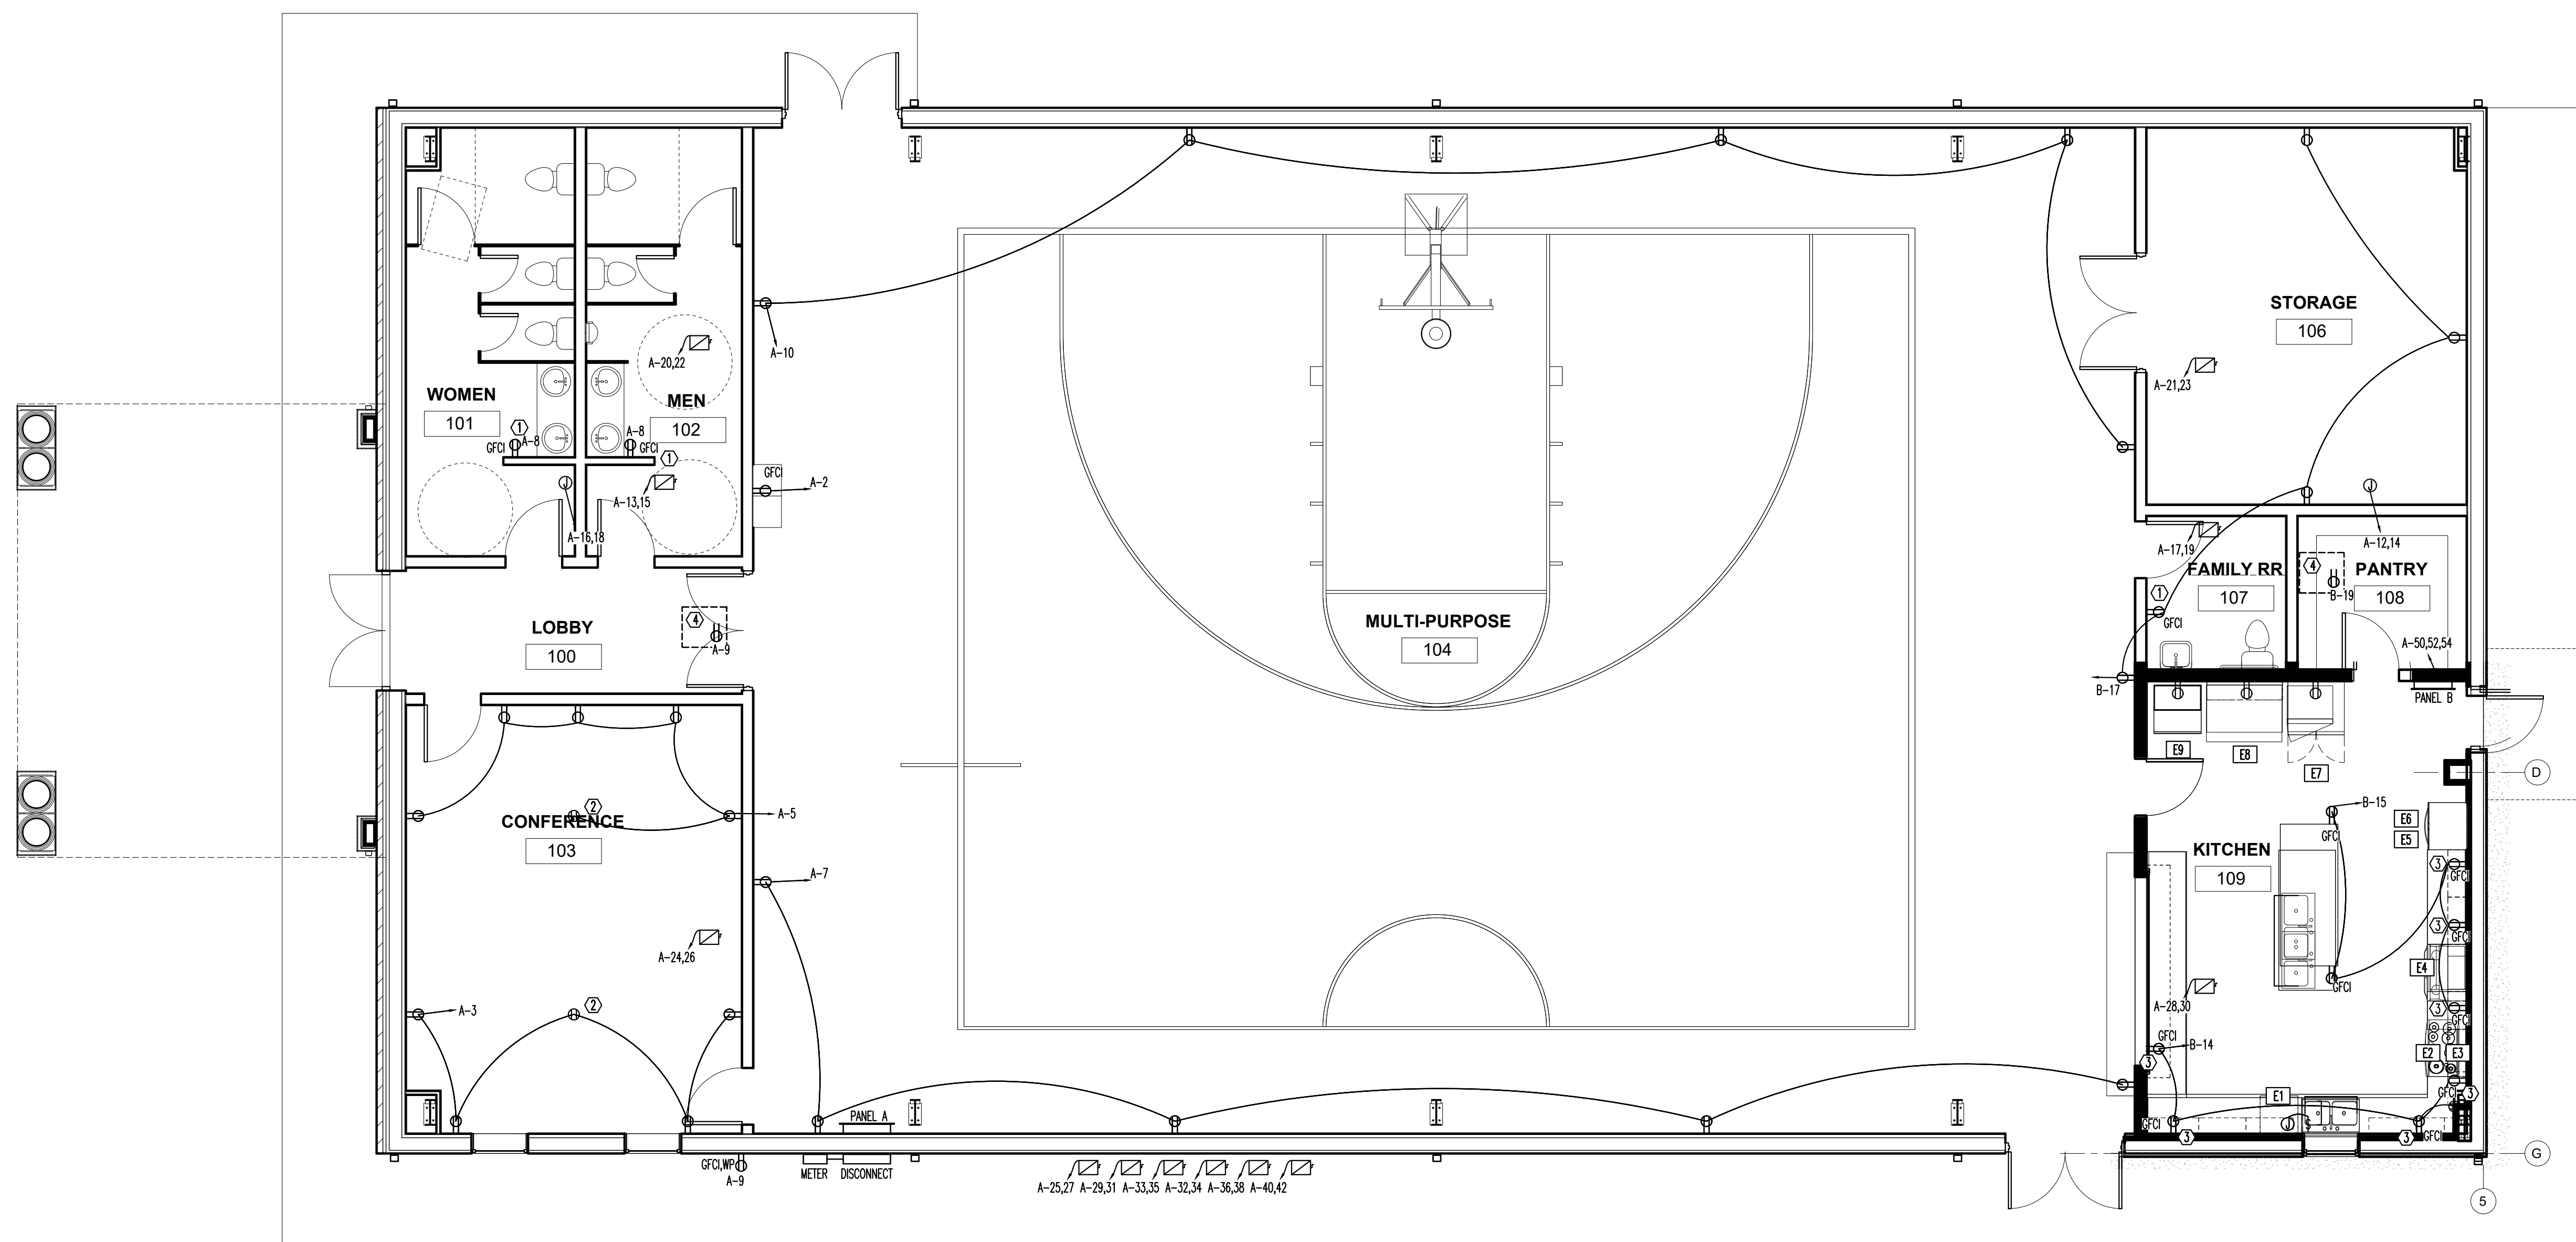


EQUIPMENT CONNECTION SCHEDULE						
SYMBOL	DESCRIPTION	MFG / MODEL	KVA	VOLT/PH	MCA	MCCP CIRCUIT
E1	DISHWASHER	WHIRLPOOL / WDT730P4HZ	1.2	120/1	15.0	20.0 B-2
E2	ELECTRIC COOKTOP	KITCHENAID / KCE606GRL	7.5	240/1	31.3	40.0 B-5,7
E3	MICROWAVE / EXHAUST FAN	WHIRLPOOL / WMH31017HZ	1.0	120/1	15.0	20.0 B-8
E4	WALL OVEN	KITCHENAID / KQSE500ESS	6.8	240/1	28.0	40.0 B-4,6
E5	DOUBLE WALL OVEN	GE / JTD3000	8.4	240/1	40.0	50.0 B-1,3
E6	WARMING DRAWER	BOSCH / HWD50S1UC	0.5	120/1	15.0	20.0 B-10
E7	REFRIGERATOR	WHIRLPOOL / WRF5355SHZ	1.8	120/1	15.0	20.0 B-9
E8	2 DOOR UNDER COUNTER FREEZERS	AUC48F	1.0	115/1	9.0	20.0 B-12
E9	EXISTING / ICE MAKER RELOCATED	-	1.0	115/1	15.0	20.0 B-11

- POWER PLAN HEX NOTES**
- MOUNT 6" ABOVE COUNTER HEIGHT. PROVIDE DEDICATED CIRCUIT.
  - MAINTAIN A MINIMUM CLEARANCE OF 6" FROM ANY WALL DURING FLOOR RECEPTACLE INSTALLATION.
  - MOUNT GFCI RECEPTACLE 6" ABOVE COUNTER HEIGHT.
  - SERVICE RECEPTACLE ABOVE CEILING FOR HVAC UNITS. COORDINATE LOCATION WITH OWNER PRIOR TO INSTALL.
  - SERVICE RECEPTACLE TO BE LOCATED WITHIN 25' OF HVAC UNIT.

POWER DEVICE LEGEND		
SYMBOL	DESCRIPTION	REMARKS
▶	DATA AND TELEPHONE JACK	PHONE/DATA OUTLET. EC TO INSTALL 3/4" C WITH PULL-STRING FROM OUTLET BOX TO ABOVE CEILING FOR FUTURE USE. JACKS AND COMMUNICATION CABLING BY OTHERS.
⊕	DUPLEX RECEPTACLE	NEMA 5-20R, HEAVY DUTY, COMMERCIAL GRADE, 125V, 20A COMPLYING WITH NEMA WD 6 AND WD 1. GFCI OR AFCI IF NOTED. 'WP' DENOTES WEATHERPROOF COVER. 'CH' DENOTES COUNTER HEIGHT. LISTED TAMPERPROOF IF NOTED. MEET FEDERAL SPECIFICATION V-C-596.
⊕⊕	QUAD RECEPTACLE	QUAD RECEPTACLE OF SAME CHARACTERISTICS AS DUPLEX TYPE ABOVE.
⊕	DEDICATED RECEPTACLE	NEMA 5-20R, HEAVY DUTY, COMMERCIAL GRADE, 125V, 20A COMPLYING WITH NEMA WD 6 AND WD 1 UNLESS OTHERWISE NOTED ON PLANS. VERIFY PLUG TYPE PRIOR TO PURCHASE & INSTALLATION. GFCI OR AFCI IF NOTED. 'WP' DENOTES WEATHERPROOF COVER. 'CH' DENOTES COUNTER HEIGHT. LISTED TAMPERPROOF IF NOTED. MEET FEDERAL SPECIFICATION V-C-596. MAY BE EITHER SIMPLEX, DUPLEX, OR QUAD.
⊕	DUPLEX FLOOR RECEPTACLE	DUPLEX RECEPTACLE OF SAME CHARACTERISTICS AS ABOVE WITH BRASS COVER. MOUNT IN FLOOR. ALL FLOOR BOXES MUST BE LISTED FOR FLOOR APPLICATION.
⊕⊕	QUAD FLOOR RECEPTACLE	QUAD RECEPTACLE OF SAME CHARACTERISTICS AS ABOVE WITH BRASS COVER. MOUNT IN FLOOR. ALL FLOOR BOXES MUST BE LISTED FOR FLOOR APPLICATION.
⊕	FUSIBLE DISCONNECT SWITCH	HEAVY DUTY TYPE. TYPE 1 ENCLOSURE IN INTERIOR APPLICATIONS, TYPE 3R ENCLOSURE IN EXTERIOR APPLICATIONS. FUSE ACCORDING TO NAMEPLATE DATA.
⊕	DISCONNECT SWITCH	HEAVY DUTY TYPE. TYPE 1 ENCLOSURE IN INTERIOR APPLICATIONS, TYPE 3R ENCLOSURE IN EXTERIOR APPLICATIONS.
⊕	JUNCTION BOX	GALVANIZED METAL BOX CONSTRUCTED IN ACCORDANCE WITH 314.40 OF THE NEC.



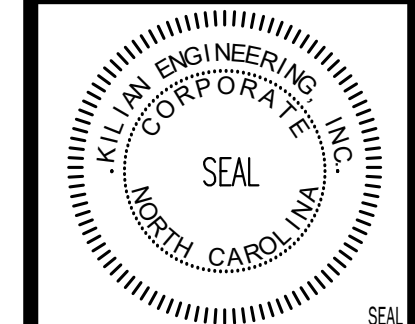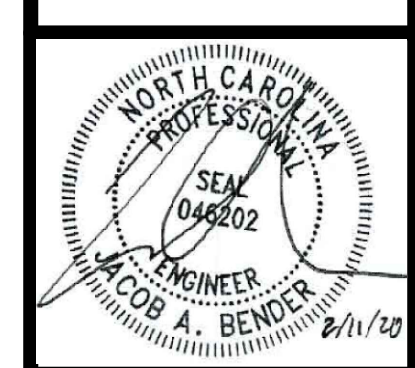


NEW FELLOWSHIP HALL FOR:  
**NEILLS CREEK BAPTIST CHURCH**  
 4200 NEILLS CREEK RD  
 ANGER, NC 27501

REVISION:


ISSUED:


DRAWN BY: JAM  
 CHECKED BY: MMK  
 MECHANICAL PLAN

SHEET NO.  
**M2**  
 PROJECT NO: 20015

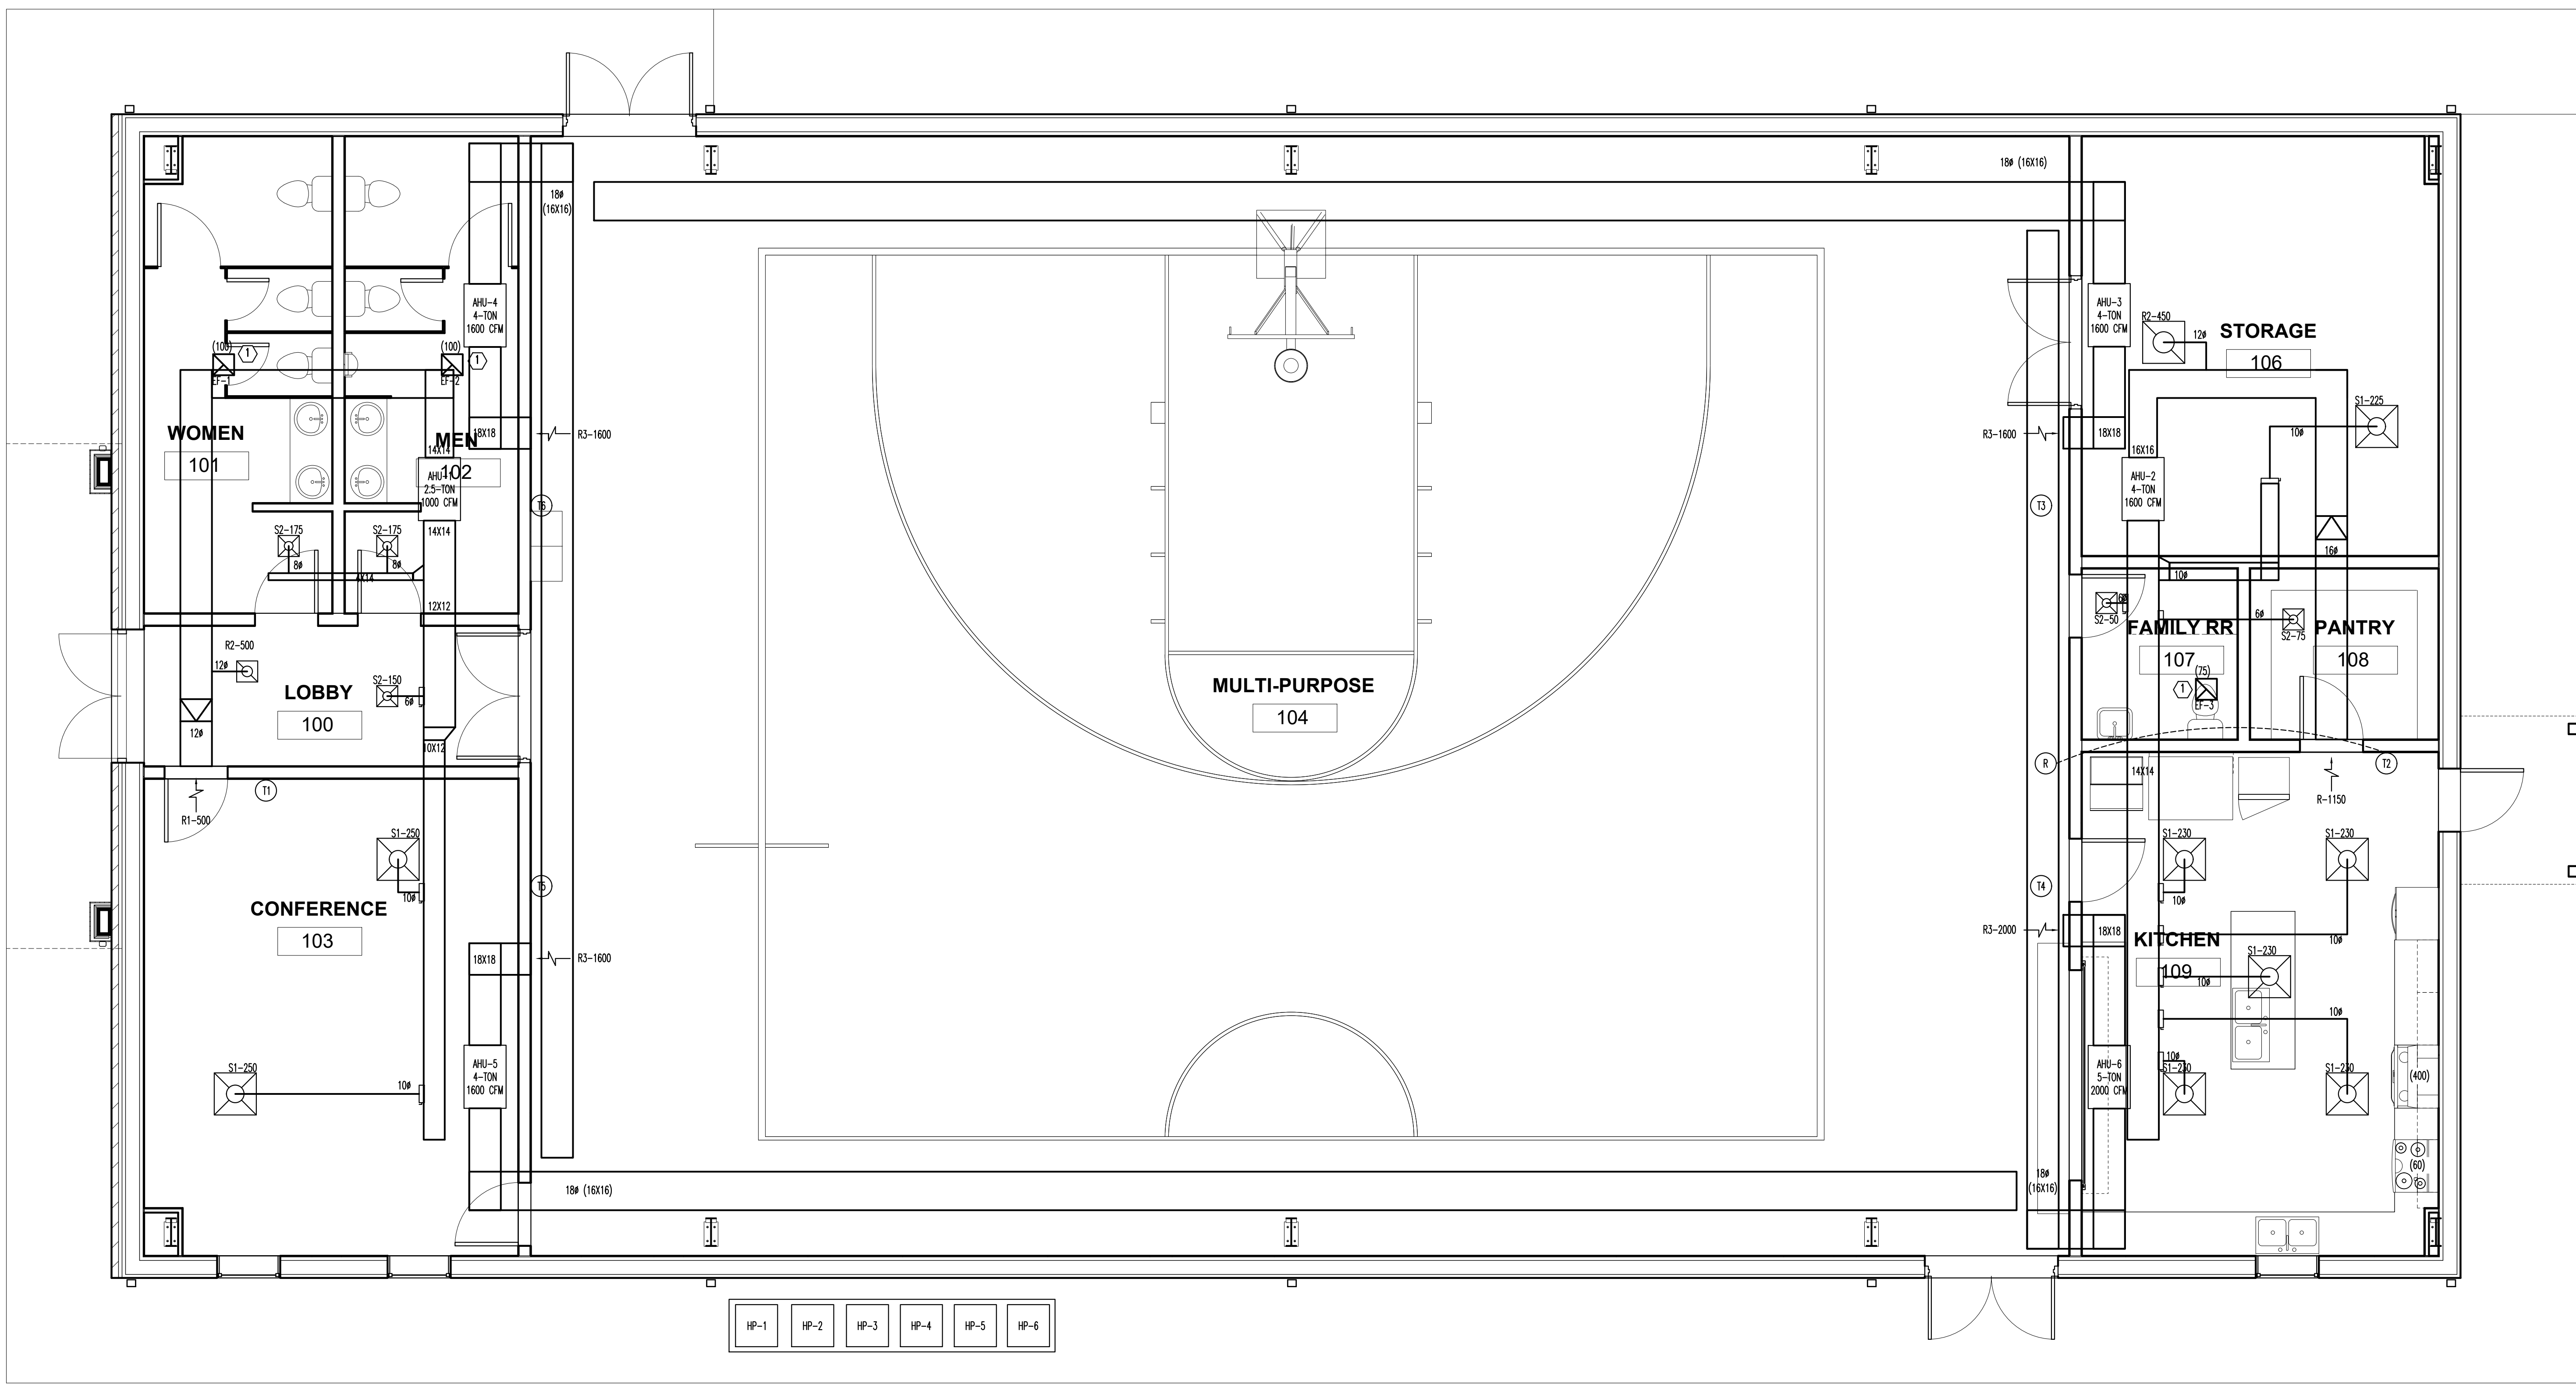

**HEX PLAN NOTES**

- PROVIDE 6" EXHAUST DUCT TO EXTERIOR WITH HOODED ROOF OR WALL CAP. COORDINATE TERMINATION POINT WITH GC PRIOR TO INSTALL.

REGISTER & GRILLE SCHEDULE


MARK	MFG	MODEL #	SIZE (WxH)	MOUNTING	DESCRIPTION	NOTES
S1	HART & CODLEY	HVS	24X24	LAY-IN	4-WAY DIFFUSER, BRIGHT WHITE	1
S2	HART & CODLEY	ARE	24X24	SURFACE	ALUMINUM, 4 WAY DIFFUSER, BRIGHT WHITE	1
R	HART & CODLEY	RHPD	36X14	SURFACE	ALUMINUM SURFACE MOUNT RETURN GRILLE	1
R1	HART & CODLEY	RHPD	18X14	SURFACE	ALUMINUM SURFACE MOUNT RETURN GRILLE	1
R2	HART & CODLEY	RHST	24X24	LAY-IN	ALUMINUM, LAY IN RETURN GRILLE	1
R3	HART & CODLEY	RHPD	36X36	SURFACE	ALUMINUM SURFACE MOUNT RETURN GRILLE	1

1. OR EQUAL BY PRICE, METAL-AIRE, CARNES, TITUS OR NAILOR.

- ① THERMOSTAT LOCATION MOUNT AT 48" A.F.F.
- ② AUDIO VISUAL ANNUNCIATOR WITH RESET FOR DUCT DETECTOR, WALL MOUNT.
- ③ --- DUCT DETECTOR
- ④ CO<sub>2</sub> SENSOR LOCATION. INSTALL NEXT TO THERMOSTAT





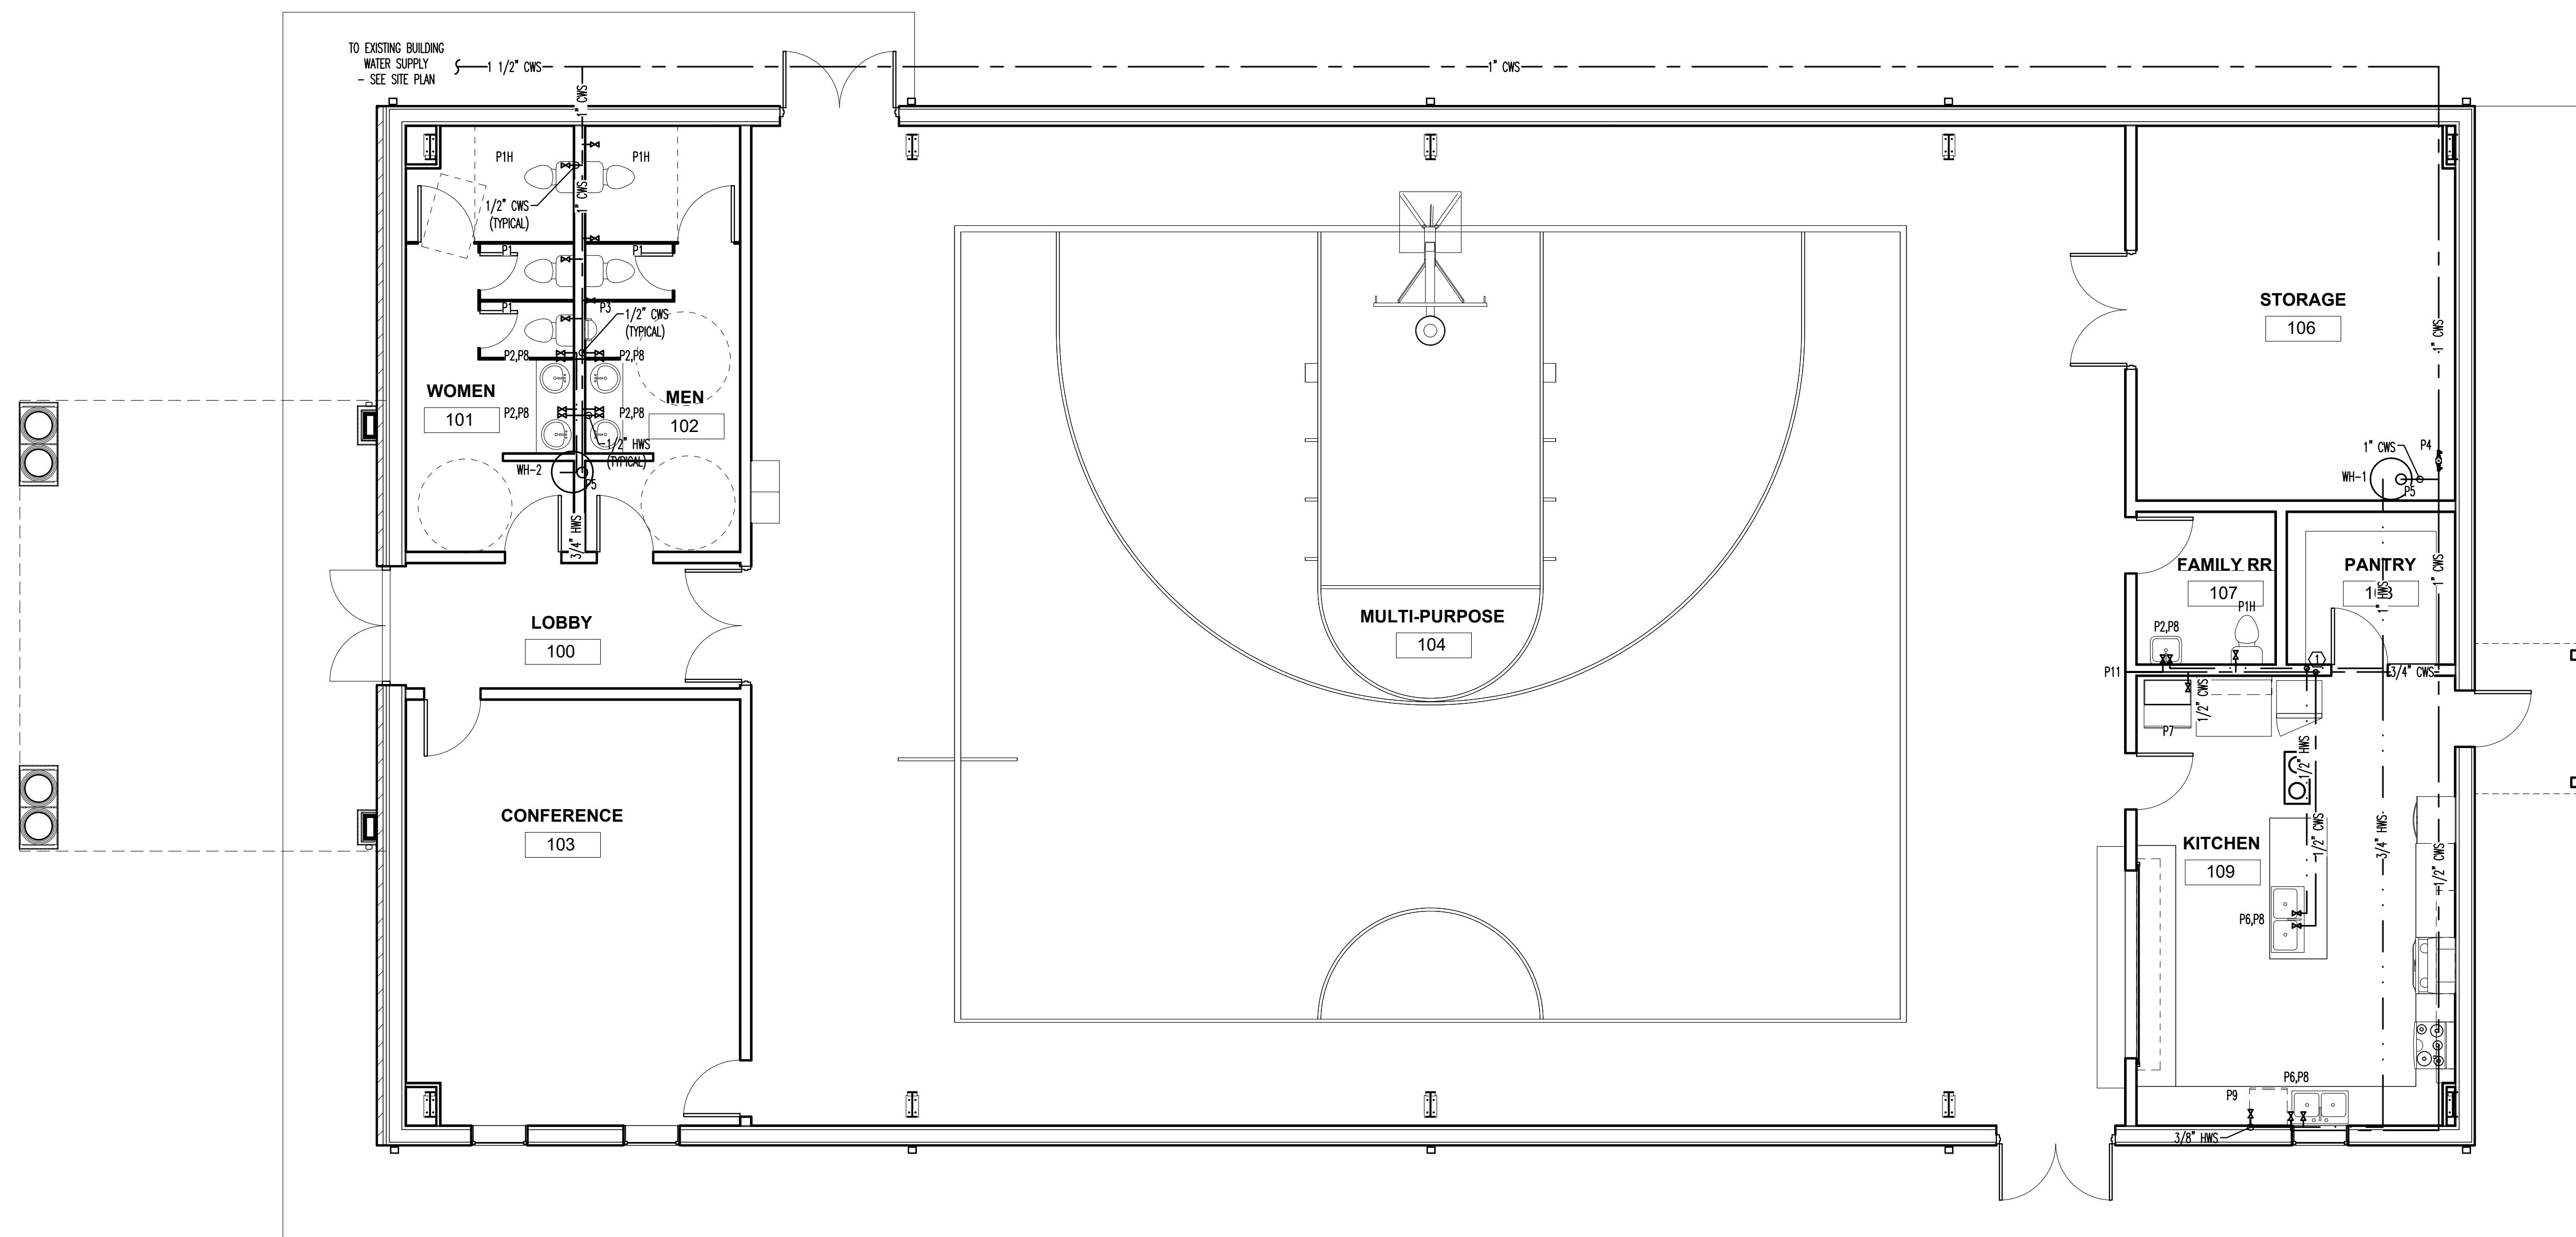


**⬡ SUPPLY PLAN HEX NOTES**

- HOT AND COLD WATER SOURCE DOWN WALL IN ORDER TO RUN BELOW FLOOR TO ISLAND SINK.

REVISION:




ISSUED:


DRAWN BY: JAM  
 CHECKED BY: MMW  
**PLUMBING SUPPLY PLAN**

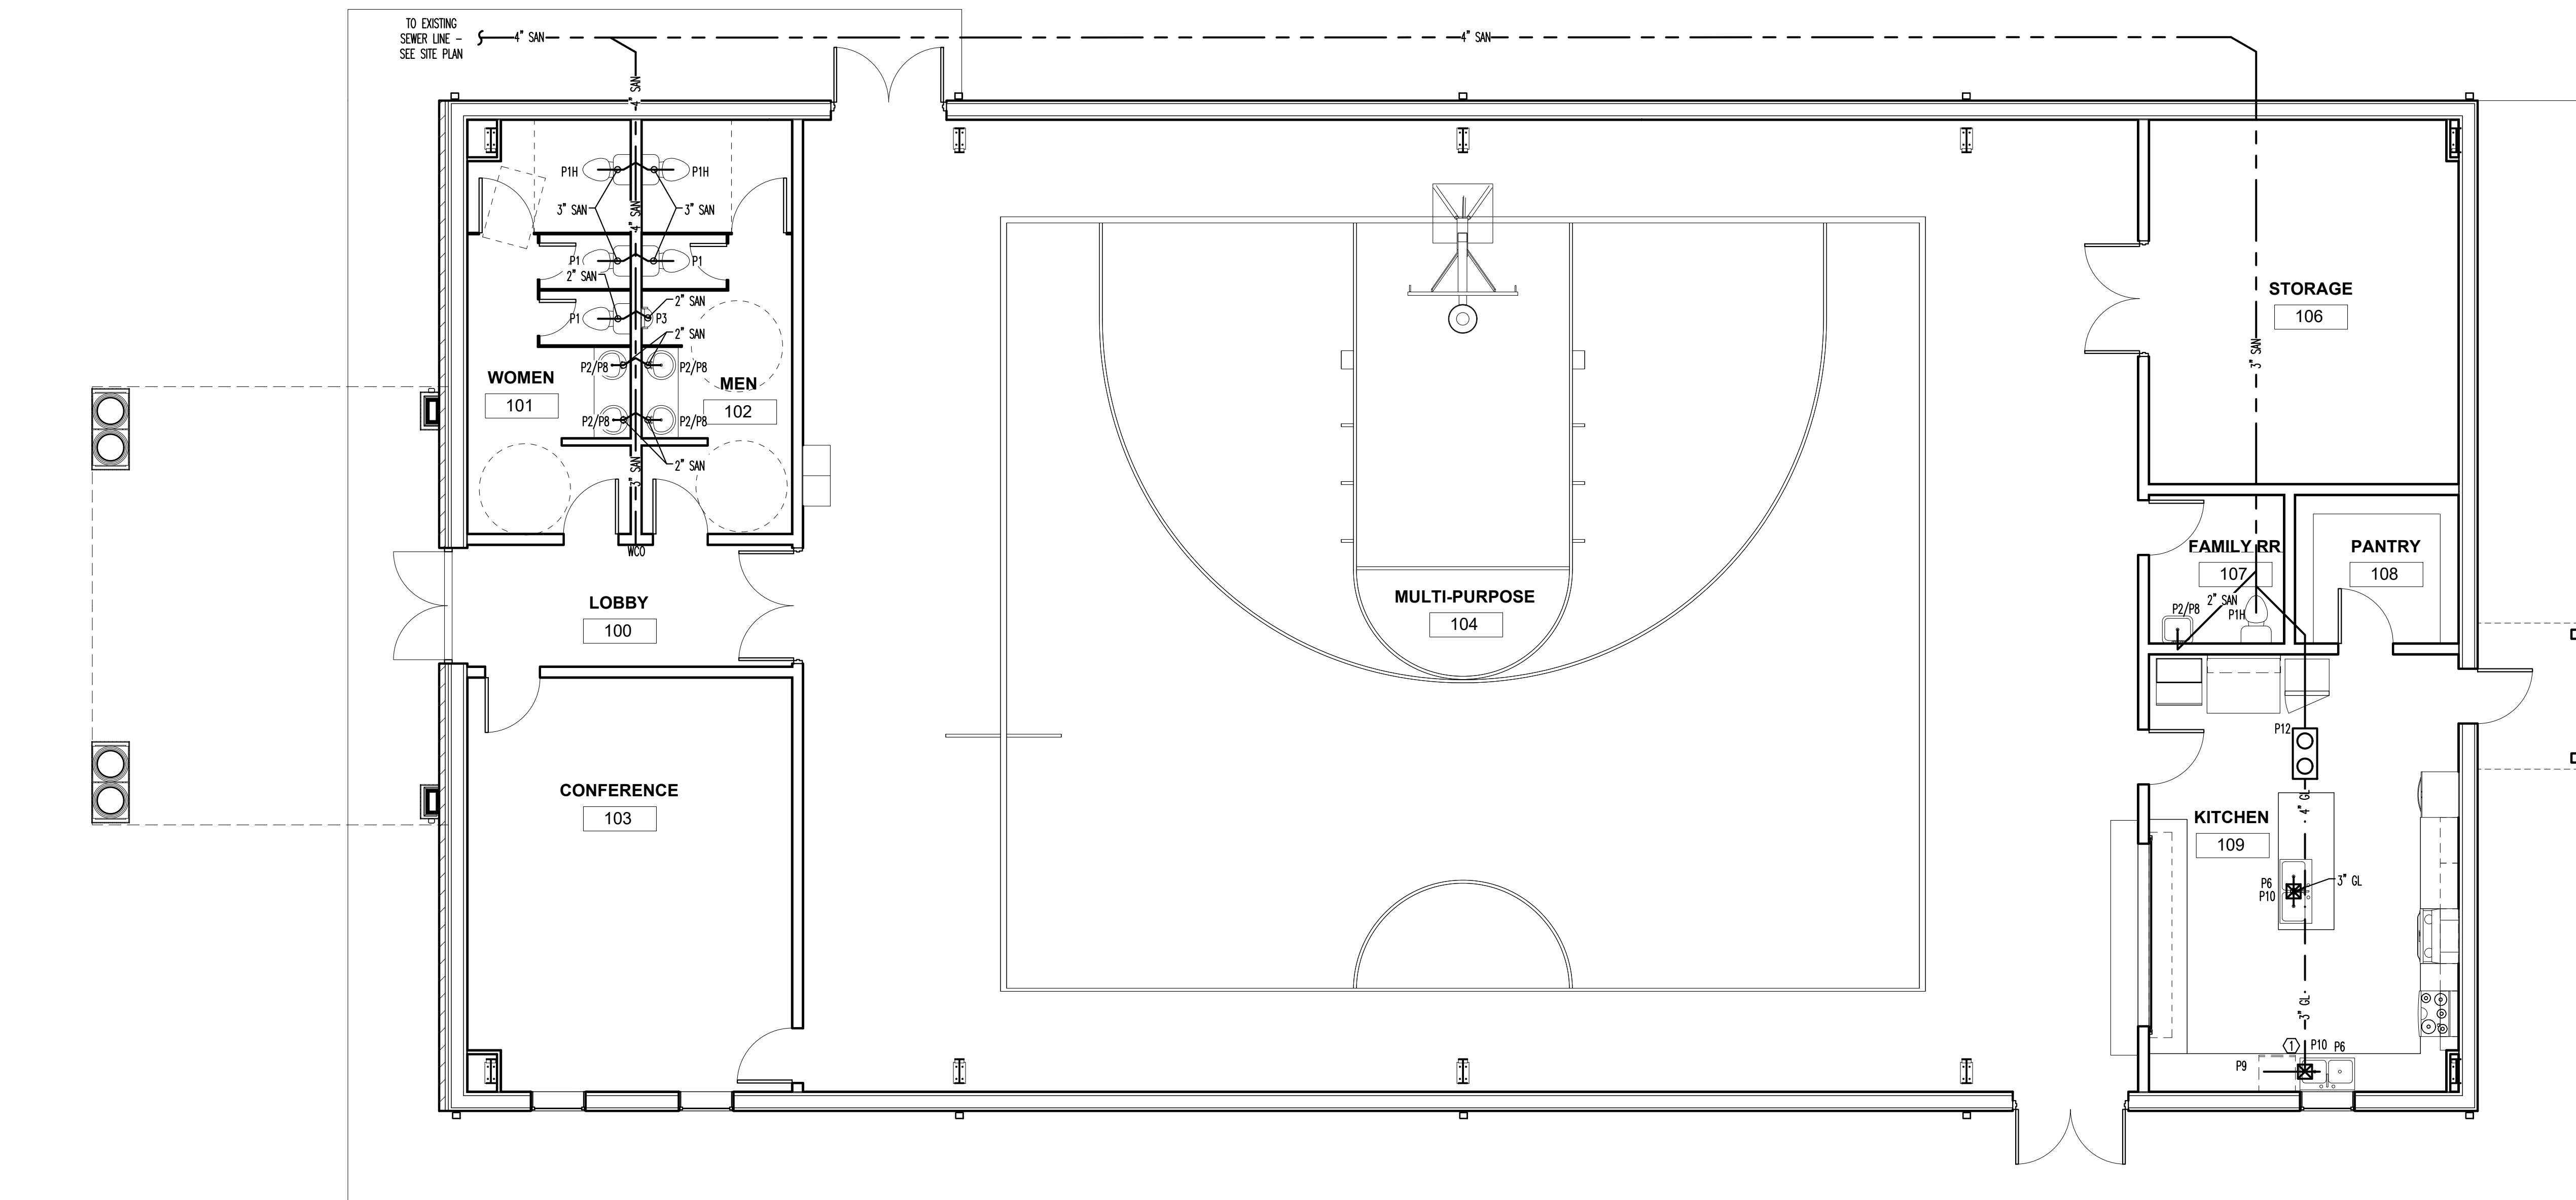

**□ SANITARY PLAN HEX NOTES**

1. DISHWASHER DRAINS TO SAME FLOOR SINK AS DOUBLE SINK.

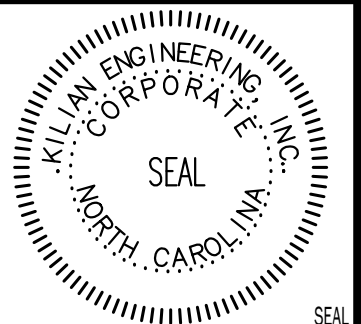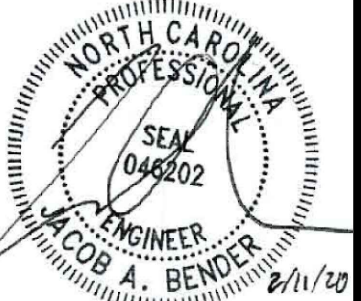

REVISION:

NO.	DESCRIPTION	DATE

ISSUED:


NO.	DESCRIPTION	DATE

DRAWN BY: JAW  
 CHECKED BY: MMW  
**PLUMBING WASTE PLAN**


SHEET NO.  
**P3**  
 PROJECT NO: 20015




P.O. Box 3301, Henderson, NC 27566 | www.kilianeengineering.com  
 (771) 252-8381 | (771) 252-8378 | CORPORATE LICENSE C2717

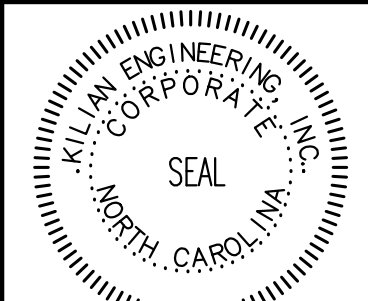

NEW FELLOWSHIP HALL FOR:  
**NEILLS CREEK BAPTIST CHURCH**  
 4200 NELLS CREEK RD  
 ANGLER, NC 27501

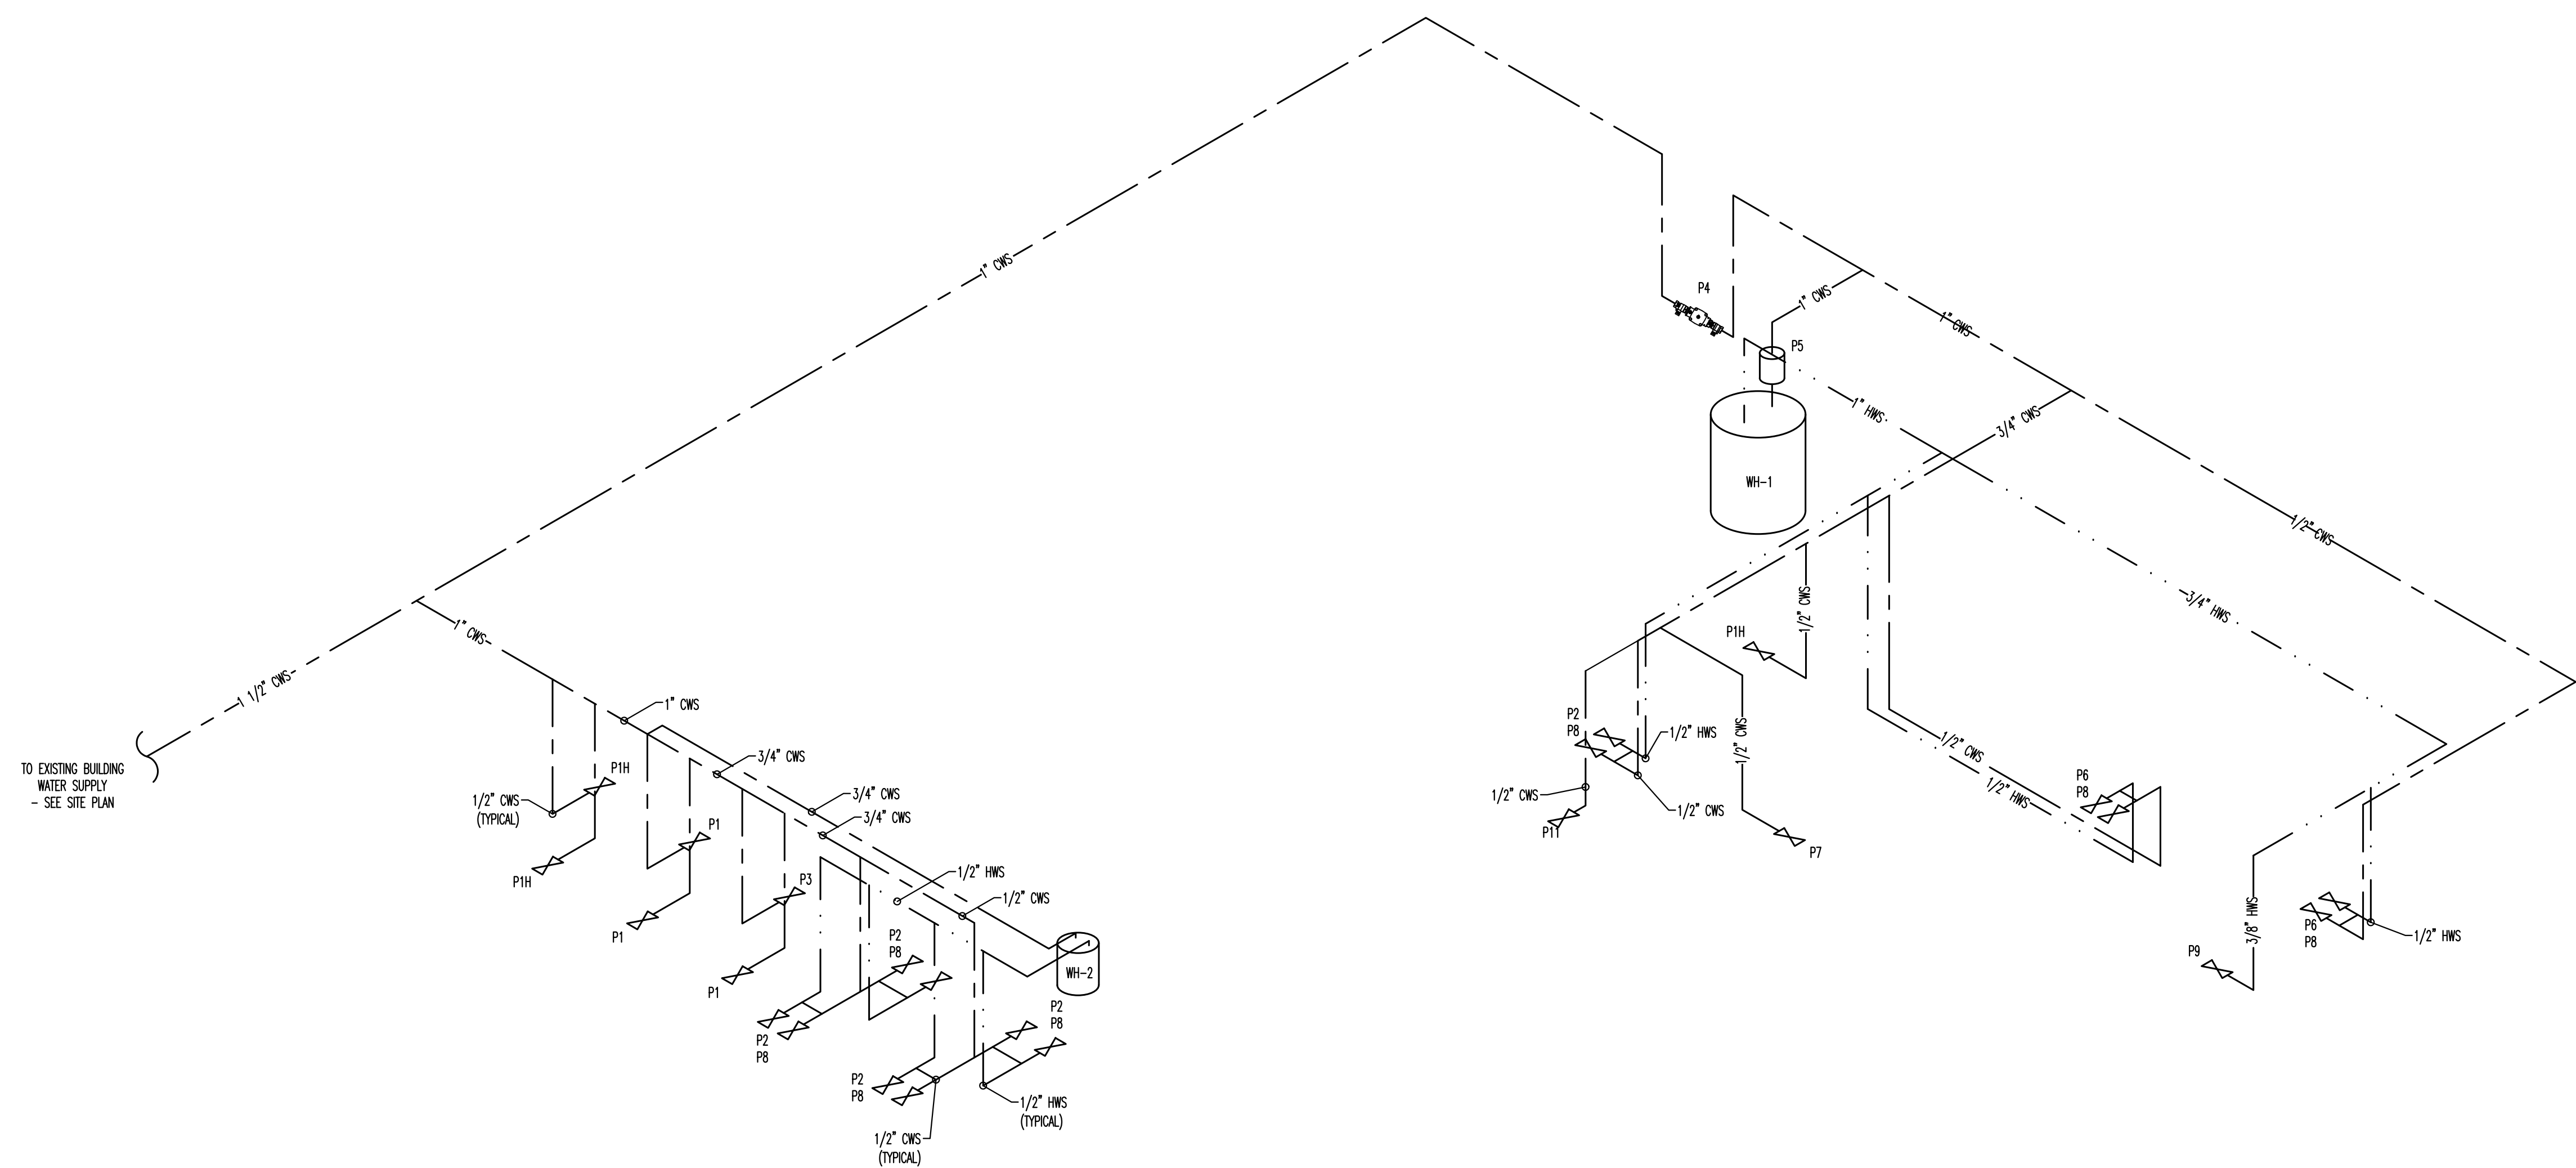

SUPPLY PLAN RISER - NOT TO SCALE 1

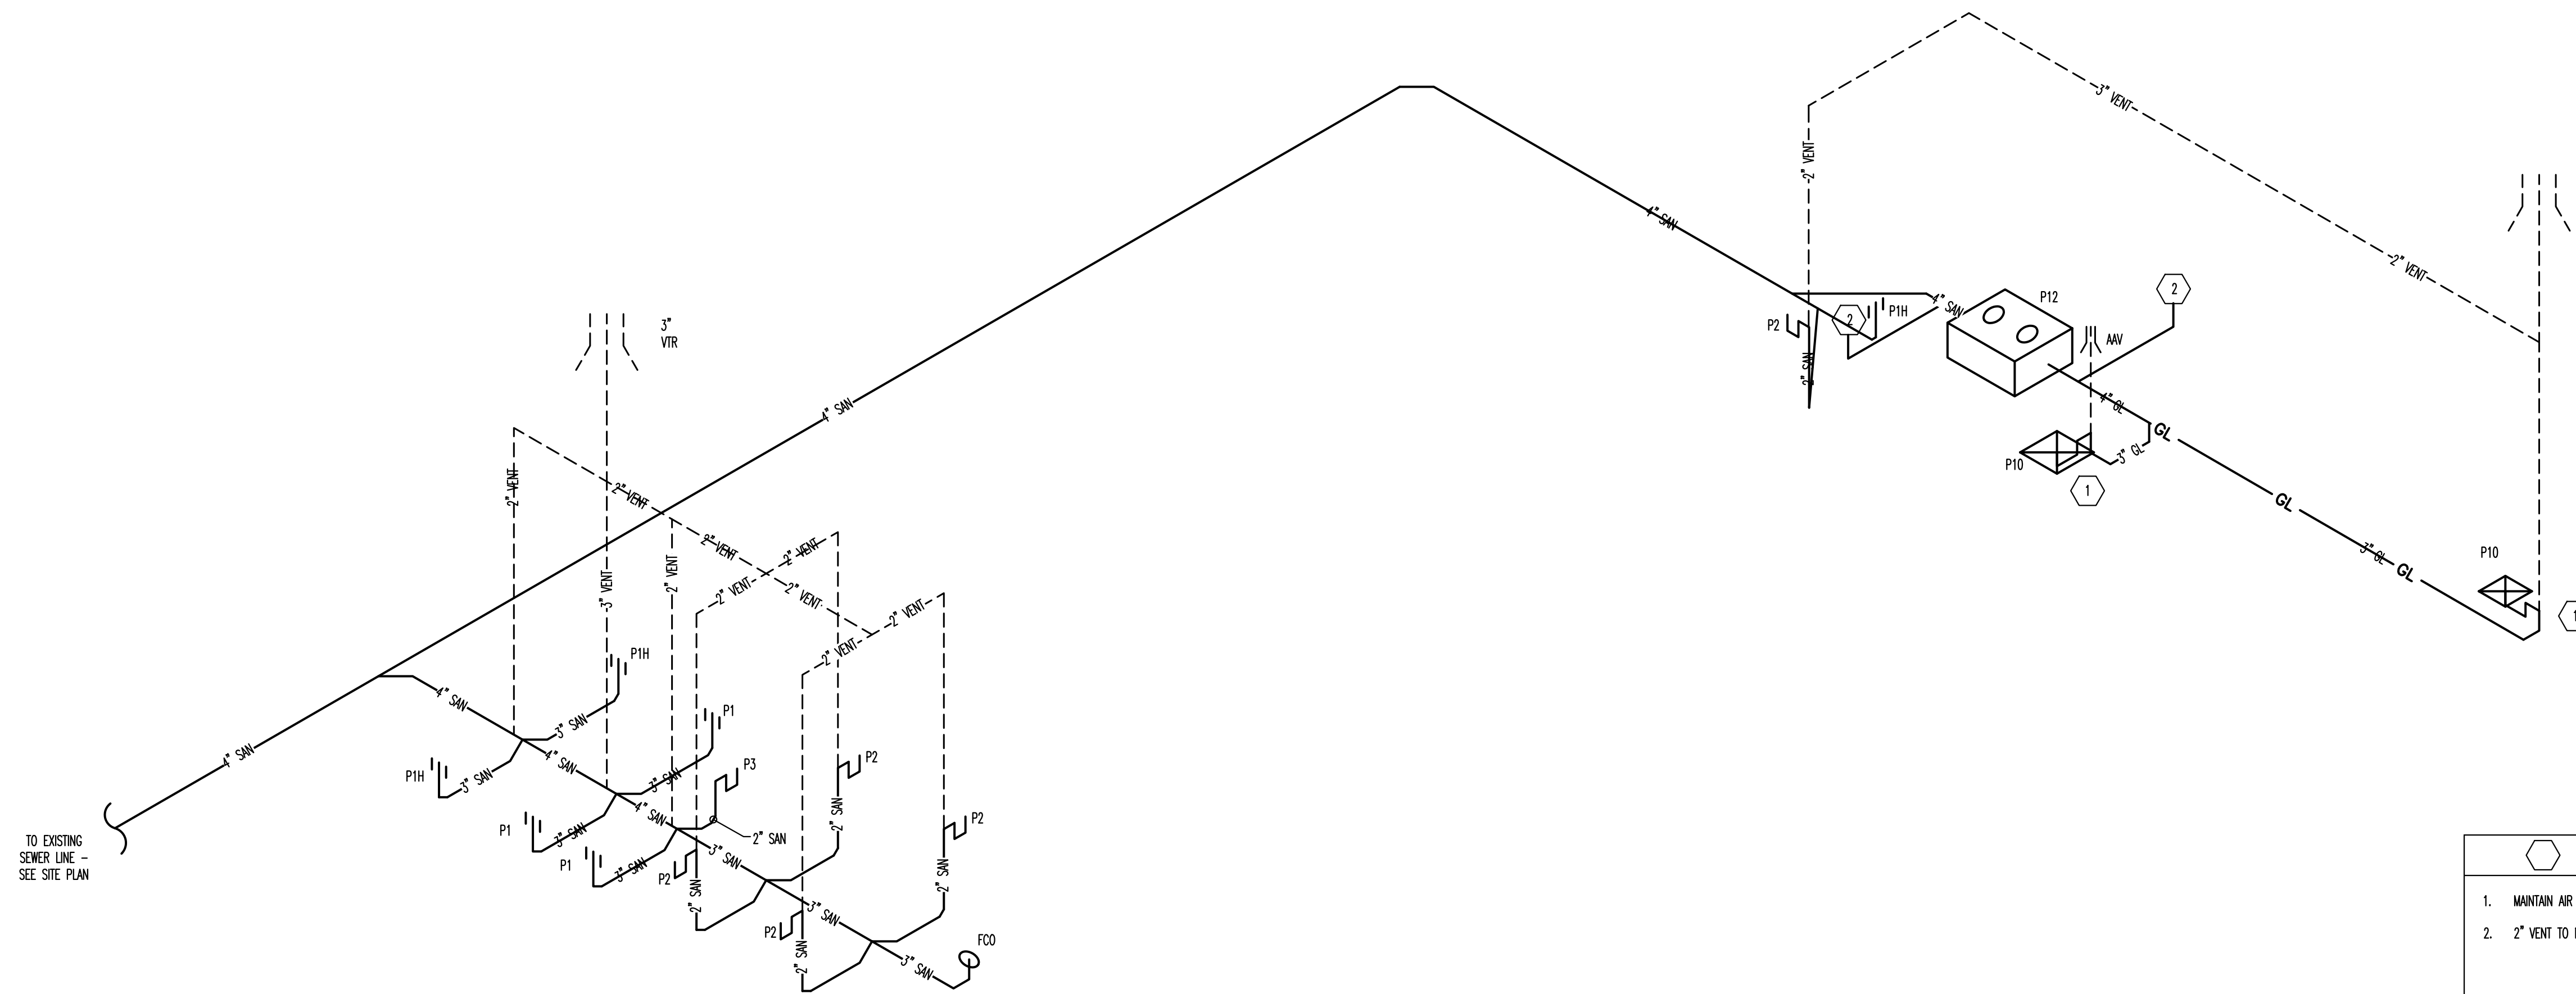

TO EXISTING  
 SEWER LINE -  
 SEE SITE PLAN

- HEX SANITARY PLAN HEX NOTES
1. MAINTAIN AIR GAP FROM FIXTURE TO FLOOR SINK
  2. 2" VENT TO NEAREST WALL AND CONNECT TO MAIN VENT ABOVE CEILING.

REVISION:


ISSUED:


DRAWN BY: JAM  
 CHECKED BY: MIM  
 PLUMBING PLAN RISERS

SHEET NO.

P4

WASTE PLAN RISER - NOT TO SCALE 2

PROJECT NO: 20015

**FIRE ALARM GENERAL NOTES**

- THE FOLLOWING ABBREVIATIONS SHALL APPLY TO NOTES AND PLANS:  
PC - PLUMBING CONTRACTOR, EC - ELECTRICAL CONTRACTOR, MC - MECHANICAL CONTRACTOR, GC - GENERAL CONTRACTOR, FASC - FIRE ALARM SYSTEM CONTRACTOR.
- "PROVIDE" MEANS TO FURNISH AND INSTALL.
- THE FIRE ALARM SYSTEM CONTRACTOR SHALL PROVIDE ALL MATERIALS, LABOR, ETC., AS NECESSARY FOR A COMPLETE AND OPERATIONAL FIRE ALARM SYSTEM.
- THESE DRAWINGS ARE DIAGRAMMATIC AND DO NOT SHOW ALL MINOR DETAILS AND EXACT LOCATIONS. THE FASC SHALL ALLOW FOR ADJUSTMENTS TO ACCOMMODATE INTERFERENCES BOTH PLANNED AND ENCOUNTERED AND SHALL INCLUDE SUCH CONTINGENCIES IN THEIR BID.
- THE SUCCESSFUL FIRE ALARM BIDDER SHALL PROVIDE CONSTRUCTION DOCUMENTS TO THE AUTHORITY HAVING JURISDICTION FOR APPROVAL, INCLUDING ALARM CONTROLS AND TROUBLE SIGNALING EQUIPMENT, ANNUNCIATION, POWER CONNECTIONS, BATTERY CALCULATIONS, VOLTAGE DROP CALCULATIONS, CONDUCTOR TYPES AND SIZES, LOCATIONS OF INITIATING AND NOTIFICATION APPLIANCES, AND MANUFACTURERS, MODEL NUMBERS, AND LISTING INFORMATION FOR ALL EQUIPMENT, DEVICES AND MATERIALS.
- ALL WORK SHALL BE IN ACCORDANCE WITH NFPA 72 AND APPLICABLE SECTIONS OF NFPA 70 AND 11.
- CONDUIT, CONDUCTORS, BOXES AND HANGERS SHALL BE THE SAME AS THOSE SPECIFIED IN THE ELECTRICAL SYSTEM.
- ALL MATERIALS AND EQUIPMENT SHALL BE NEW AND SHALL BEAR UL LABEL OR EQUIVALENT WHERE APPLICABLE.
- THE FIRE ALARM SYSTEM SHALL BE OF THE ADDRESSABLE TYPE WITH EACH INITIATING DEVICE REPORTING INDIVIDUALLY TO THE FIRE ALARM CONTROL PANEL. ONLY THE MANUFACTURER OR AN AUTHORIZED DISTRIBUTOR WHO STOCKS SPARE COMPONENTS FOR THE ENTIRE SYSTEM SHALL CONNECT, PROGRAM, OR TEST THE ADDRESSABLE FIRE ALARM SYSTEM. ALL TECHNICIANS PERFORMING SUCH WORK SHALL BE TRAINED AND INDIVIDUALLY CERTIFIED BY THE MANUFACTURER FOR THE MODEL OF SYSTEM BEING INSTALLED. COPIES OF THEIR CERTIFICATION SHALL BE AVAILABLE UPON REQUEST. THE MANUFACTURER OR AUTHORIZED DISTRIBUTOR SHALL STORE THE COMPLETE PROGRAMMING FOR THE ADDRESSABLE SYSTEM ON A COMPUTER DISK OR DISKETTE OR OTHER MEDIA AND ARCHIVE APPROPRIATELY. A COPY OF THE PROGRAM SHALL BE MADE AVAILABLE TO THE OWNER WHEN THE SYSTEM IS COMMISSIONED. THE MANUFACTURER OR AUTHORIZED DISTRIBUTOR SHALL MAINTAIN SOFTWARE VERSION RECORDS ON THE SYSTEM INSTALLED AND PROVIDE FREE UPGRADES IF THE MANUFACTURER RELEASES A NEW VERSION OF THE SOFTWARE DURING THE WARRANTY PERIOD. PROVIDE A SYSTEM FUNCTION MATRIX THAT GIVES THE FIRE ALARM CONTROL PANEL RESPONSE FOR EACH INITIATING DEVICE.
- THE SYSTEM SHALL BE NOMINAL 24VDC, NON-CODED, AND SUPERVISED (INCLUDING CONTROL CIRCUITS). ALL EQUIPMENT SUPPLIED MUST BE LISTED FOR ITS PARTICULAR USE AND INSTALLED IN ACCORDANCE WITH ANY INSTRUCTIONS APPLICABLE TO ITS LISTING.
- THE SYSTEM SHALL BE ELECTRICALLY SUPERVISED FOR OPEN OR GROUND FAULT CONDITIONS IN DETECTION, ALARM, AND CONTROL CIRCUITS. THE REMOVAL OF ANY DETECTION DEVICE, ALARM APPLIANCE, PLUG-IN RELAY, SYSTEM MODULE, OR STANDBY BATTERY CONNECTION SHALL ALSO ACTIVATE A TROUBLE SIGNAL. THE FIRE ALARM SIGNAL SHALL OVERRIDE TROUBLE SIGNALS, BUT THE PRE-ALARM TROUBLE SIGNAL SHALL REAPPEAR WHEN THE PANEL IS RESET.
- PROVIDE EACH SIGNALING LINE CIRCUIT WITH A MINIMUM OF 20 PERCENT SPARE ADDRESSES FOR FUTURE USE.
- THE CONNECTIONS BETWEEN INDIVIDUAL ADDRESSABLE MODULES AND THEIR CONTACT TYPE INITIATING DEVICES MUST BE SUPERVISED.
- THE FIRE ALARM CONTROL PANEL (FACP) POWER SUPPLY MUST HAVE A CONTINUOUS RATING ADEQUATE TO POWER ALL DEVICES AND FUNCTIONS IN FULL ALARM CONTINUOUSLY. BATTERIES MUST MEET THE APPROPRIATE NFPA CAPACITY REQUIREMENTS. THE FACP SHALL INCLUDE AN ALARM SILENCE SWITCH AND SHALL BE EQUIPPED WITH THE SUBSEQUENT ALARM RESOUND FEATURE. THE ALARM SILENCING AND RESET FEATURE SHALL NOT REVERSE AIR HANDLING UNITS SHUTDOWN. A SUPERVISED "HANG SYSTEM SHUTDOWN" SWITCH MUST BE PROVIDED IN THE FACP WITH ITS "NORMAL" POSITION INDICATED.
- ALL CONNECTIONS MADE AT THE FACP MUST BE BY THE MANUFACTURER'S AUTHORIZED FACTORY TRAINED PERSONNEL (NOT THE ELECTRICAL CONTRACTOR).
- PERMANENT WIRE MARKERS SHALL BE USED TO IDENTIFY ALL CONNECTIONS AND TERMINATIONS FOR EACH CIRCUIT. ALL FIRE ALARM JUNCTION BOXES SHALL BE SPRAYED RED AND LABELED "FIRE ALARM." TERMINAL BLOCKS SHALL BE PROVIDED IN ALL JUNCTION BOXES WHERE CONNECTIONS ARE MADE. IDENTIFICATION AT SPLICES SHALL INDICATE WHICH CONDUCTOR LEADS TO THE FACP.
- THE FOLLOWING COLOR SCHEME SHALL BE USED FOR SYSTEM CONDUCTORS:  
17.1. INITIATING CIRCUITS (OTHER THAN SMOKE) RED & WHITE  
17.2. INITIATING CIRCUITS (SMOKE DETECTION) VIOLET & GRAY  
17.3. NOTIFICATION APPLIANCE CIRCUITS BLUE & BLACK  
17.4. AIR HANDLING SHUT DOWN CIRCUITS YELLOW  
17.5. DOOR CONTROL CIRCUITS ORANGE  
17.6. ELEVATOR CIRCUITS BROWN
- LOW VOLTAGE WIRING SHALL NOT BE INSTALLED IN ANY RACEWAY CONTAINING POWER OR LINE VOLTAGE CONTROL WIRING. WITHIN THE FACP, ANY AC CONTROL WIRING SHALL BE PROPERLY SEPARATED FROM OTHER CIRCUITS AND THE ENCLOSURE SHALL BE LABELED TO ALERT SERVICE PERSONNEL TO THE HAZARD.
- DEVICES SHALL BE INSTALLED AS INDICATED ON THE PLANS AND AS DETAILED. WHENEVER POSSIBLE, DEVICES SHOULD BE CENTERED ON SPACES OR LOCATED ABOVE OTHER OUTLETS. SMOKE DETECTORS SHALL NOT BE LOCATED WITHIN THREE (3) FEET OF AN HVAC SUPPLY OR RETURN. INSTALL WALL MOUNTED SMOKE DETECTORS A MAXIMUM OF TWELVE (12) INCHES FROM CEILING.
- PROVIDE A PERMANENT MARKER ON EACH DEVICE INSTALLED INDICATING THE DEVICE NUMBER AND ADDRESSABLE LOOP NUMBER. PROVIDE THE SAME INFORMATION INSIDE THE BOX FOR EACH DEVICE.
- ALL HVAC EQUIPMENT SHALL SHUTDOWN UPON ACTIVATION OF ANY FIRE ALARM DEVICE.
- WATER FLOW SWITCHES, VALVE TAMPER SWITCHES, AND PRESSURE SWITCHES SHALL BE PROVIDED AND INSTALLED BY THE SPRINKLER CONTRACTOR, CONNECTED BY THE ELECTRICAL CONTRACTOR, AND SUPERVISED BY THE FACP.
- TESTING SHALL INCLUDE ALL TESTS REQUIRED FOR THE ELECTRICAL SYSTEMS IN ADDITION TO TESTING AND CERTIFICATION BY THE FIRE ALARM SYSTEM SUPPLIER. PROVIDE INSTRUCTION MANUALS TO OWNER PERSONNEL.
- FASC SHALL VERIFY THAT ALL VISIBLE NOTIFICATION DEVICES ARE SYNCHRONIZED PER NFPA 72.
- VERIFY DECIBEL LEVELS ARE MINIMUM 60 DBA AND MAXIMUM 120 DBA THROUGHOUT THE ZONE; ADJUST DEVICES AS NECESSARY. MAINTAIN MINIMUM 100 DBA IN EQUIPMENT AND MECHANICAL ROOMS. DEVICES MUST MEET SURVIVABILITY REQUIREMENTS OF THE NFPA AS APPLICABLE.
- THE AUDIBLE ALARM NOTIFICATION APPLIANCES SHALL PROVIDE A SOUND PRESSURE LEVEL OF 15 DECIBELS (DB) ABOVE THE AVERAGE AMBIENT SOUND LEVEL OR 5 DBA ABOVE THE MAXIMUM SOUND LEVEL HAVING A DURATION OF AT LEAST 60 SECONDS, WHICHEVER IS GREATER, IN EVERY OCCUPABLE SPACE WITHIN THE BUILDING.





**WIRE REQUIREMENTS**

NAC CIRCUITS - 16/2, SOLID, FPLP WIRE  
DATA CIRCUITS - 18/2, SOLID, FPLP WIRE

**OVERALL MATRIX**

FIRE ALARM SYSTEM INPUT/OUTPUT MATRIX	SYSTEM OUTPUTS																																					
	FACP ANNUNCIATION													NOTIFICATION													REQUIRED FIRE SAFETY CONTROL											
SYSTEM INPUTS	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	U	V	W	X	Y													
1 FIRE ALARM SYSTEM AC POWER FAILURE																																						
2 FIRE ALARM SYSTEM LOW BATTERY																																						
3 OPEN CIRCUIT																																						
4 GROUND FAULT																																						
5 NOTIFICATION APPLIANCE CIRCUIT SHORT																																						
6 BUILDING MANUAL PULL STATIONS																																						
7 CORRIDOR SMOKE DETECTORS																																						
8 AREA SMOKE DETECTORS																																						
9 HVAC AIR DUCT SMOKE DETECTORS																																						
10 AREA HEAT DETECTORS																																						
11 HOOD OR ROOM FIRE SUPPRESSION SYSTEM ALARM																																						
12 SPRINKLER TAMPER SWITCH																																						
13 SPRINKLER WATER FLOW IN BUILDING																																						
14 SPRINKLER WATER FLOW IN ELEV EQUIP RM OR SHAFT																																						
15 ELEV EQUIP RM AREA SMOKE DETECTOR																																						
16 ELEV SHAFT AND ELEV EQUIP RM HEAT DETECTORS																																						
17 ELEV LOBBY SMOKE DETECTORS - UPPER FLOORS																																						
18 ELEV LOBBY SMOKE DETECTOR - RECALL FLOOR																																						
19 ELEV CONTROLLER POWER SHUNT TRIP STATUS																																						
20 FIRE PUMP POWER FAILURE/PHASE REVERSAL																																						
21 FIRE PUMP RUNNING																																						
22 FIRE PUMP SYSTEM NOT IN AUTOMATIC																																						
23 LEGALLY REQUIRED GENERATOR SYSTEM LOW FUEL																																						
24 LEGALLY REQUIRED GENERATOR NOT IN AUTOMATIC																																						
25 AREA OF REFUGE TWO-WAY COMMUNICATIONS STATUS																																						
26																																						
27																																						

NFPA 170 SYMBOL GUIDE	
SYMBOL	DESCRIPTION
[FACP]	FIRE ALARM CONTROL PANEL
[FAA]	FIRE ALARM ANNUNCIATOR
[WF]	WATER FLOW SWITCH
[VS]	VALVE SUPERVISORY SWITCH (TAMPER SWITCH)
[H]	HEAT DETECTOR/SENSOR (RATE OF RISE)
[P]	PULL STATION / FIRE ALARM
[S]	SMOKE DETECTOR/SENSOR (DEFAULT PHOTOELECTRIC TYPE)
[SS]	SMOKE ALARM (SINGLE STATION/RESIDENCE)
[DS]	DUCT SMOKE DETECTOR (NFPA 72, SECTION 17.7.5.5)
[A]	AUDIBLE ONLY APPLIANCE (WALL MOUNTED) (BEL LOUDBSIDE SPRINK RM.)
[V]	VISUAL ONLY APPLIANCE (WALL MOUNTED)
[A/V]	AUDIBLE/VISUAL APPLIANCE (WALL MOUNTED)
[C/V]	VISUAL ONLY APPLIANCE (CEILING MOUNTED)
[A/C]	AUDIBLE ONLY APPLIANCE (CEILING MOUNTED)
[A/V/C]	AUDIBLE/VISUAL APPLIANCE (CEILING MOUNTED)
[R]	END OF LINE RESISTOR

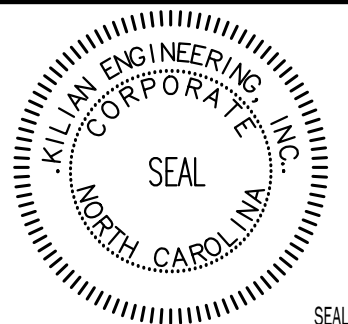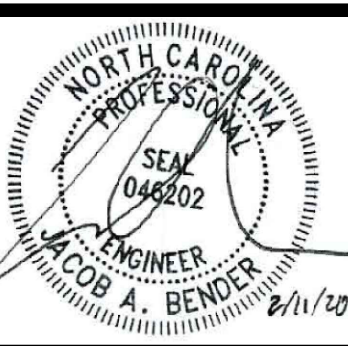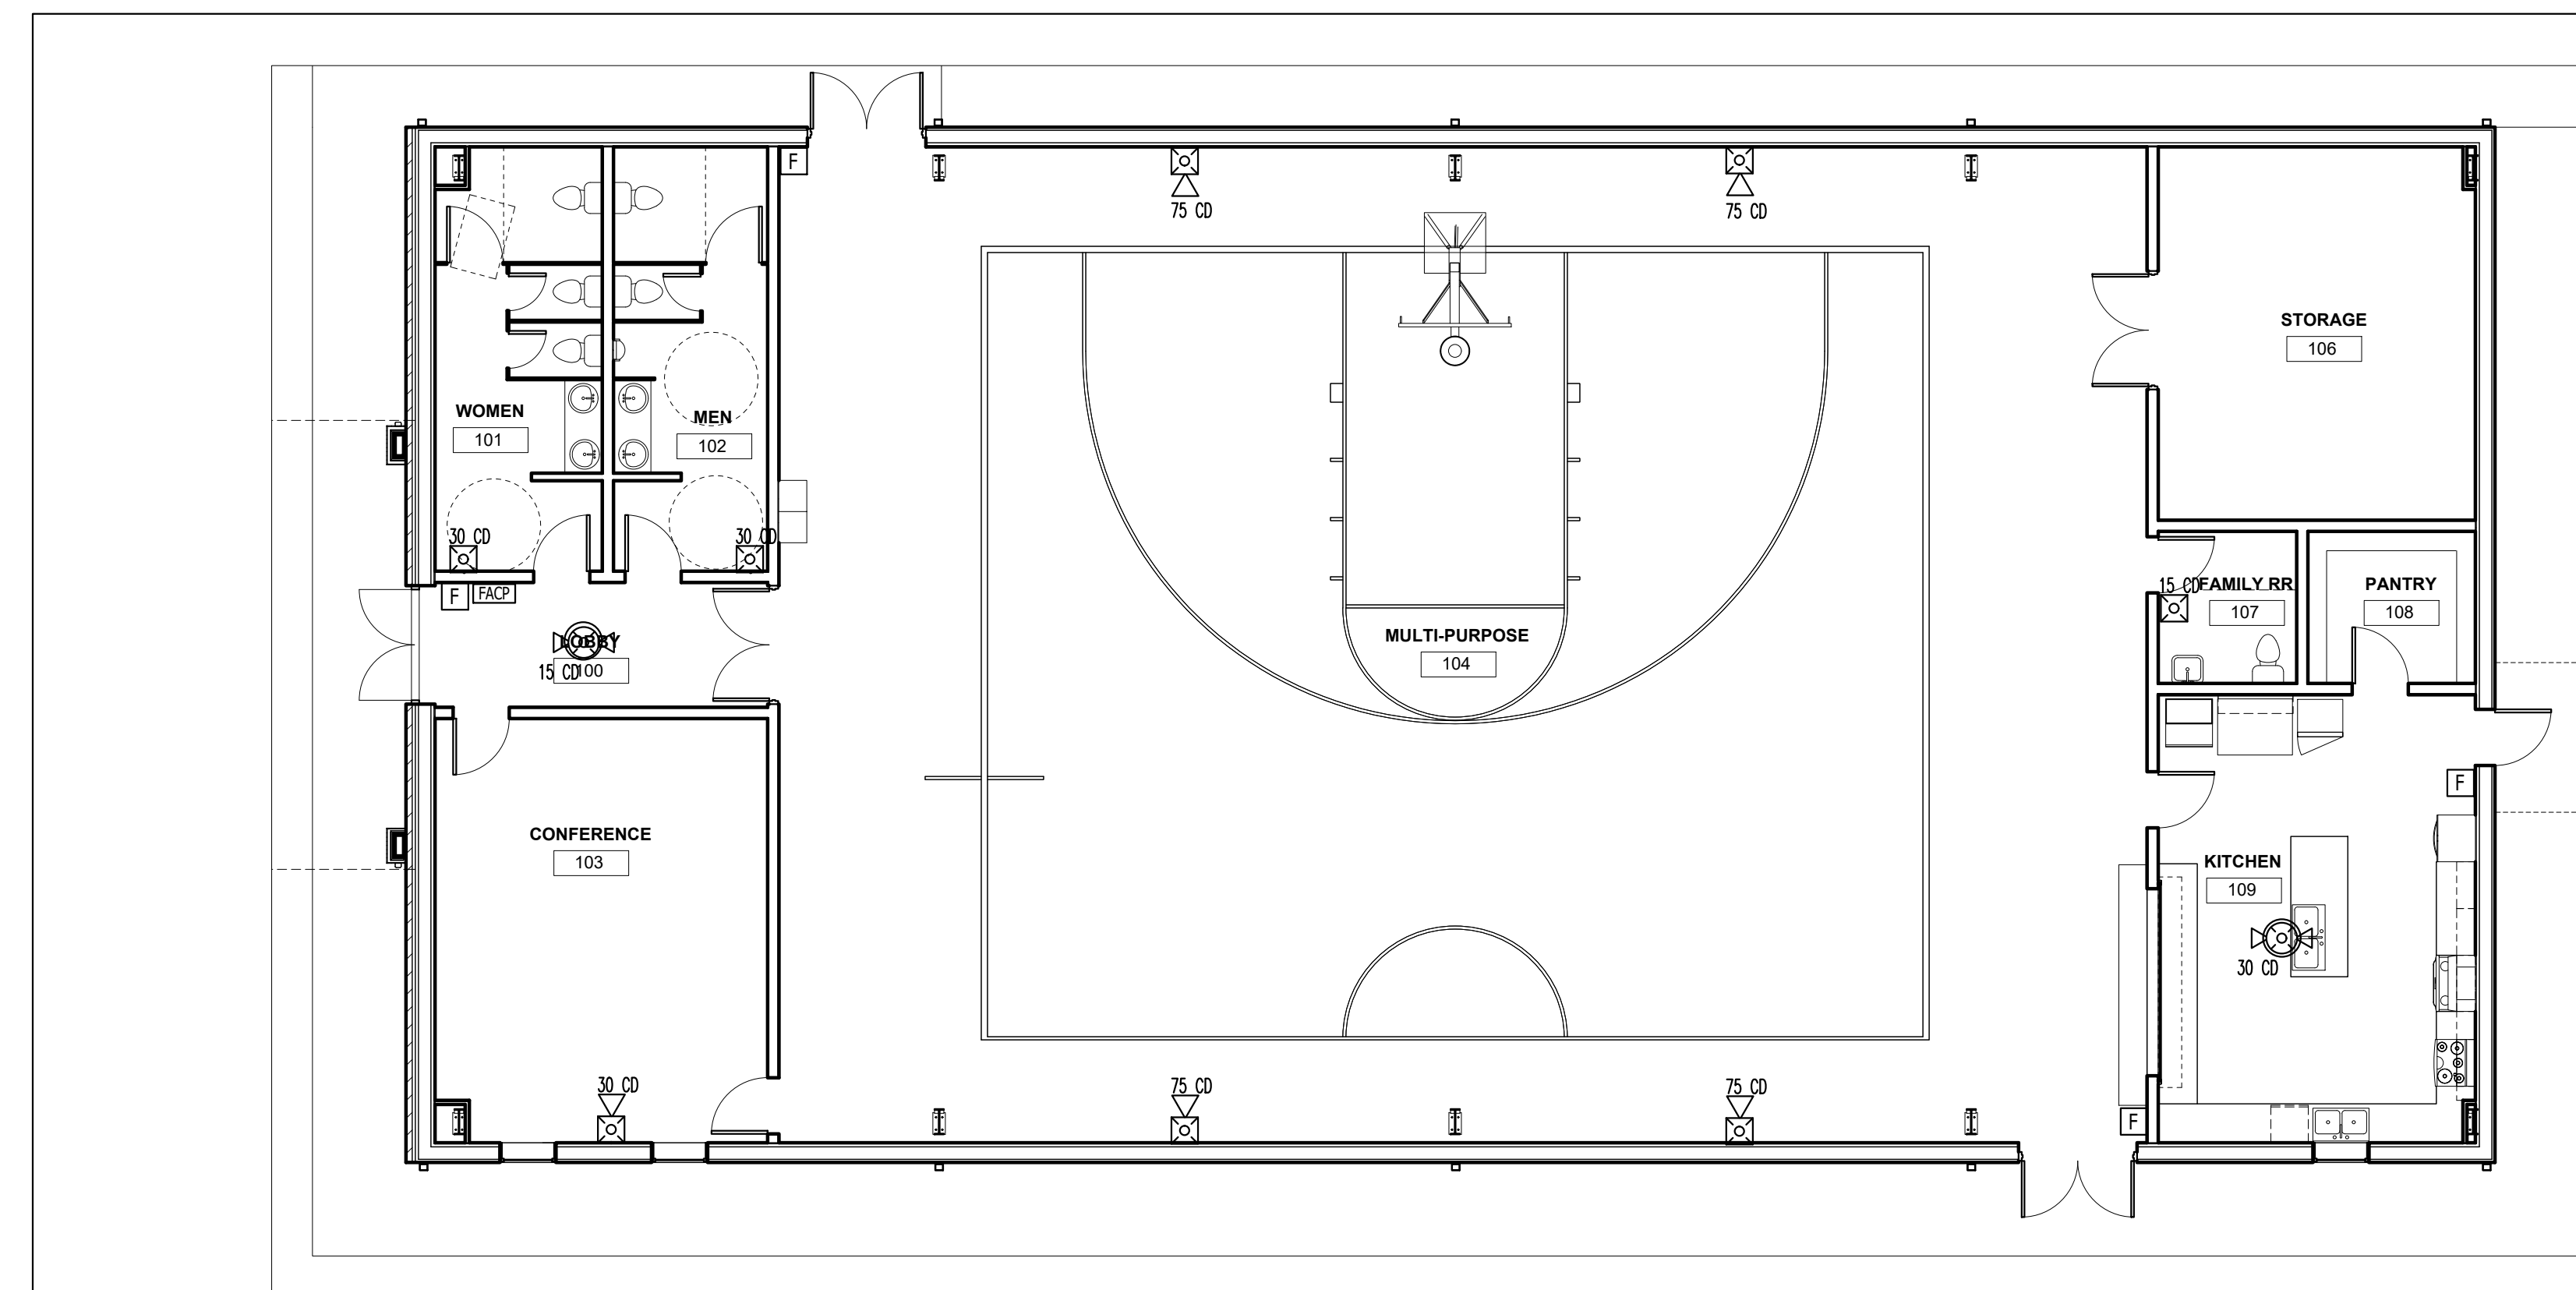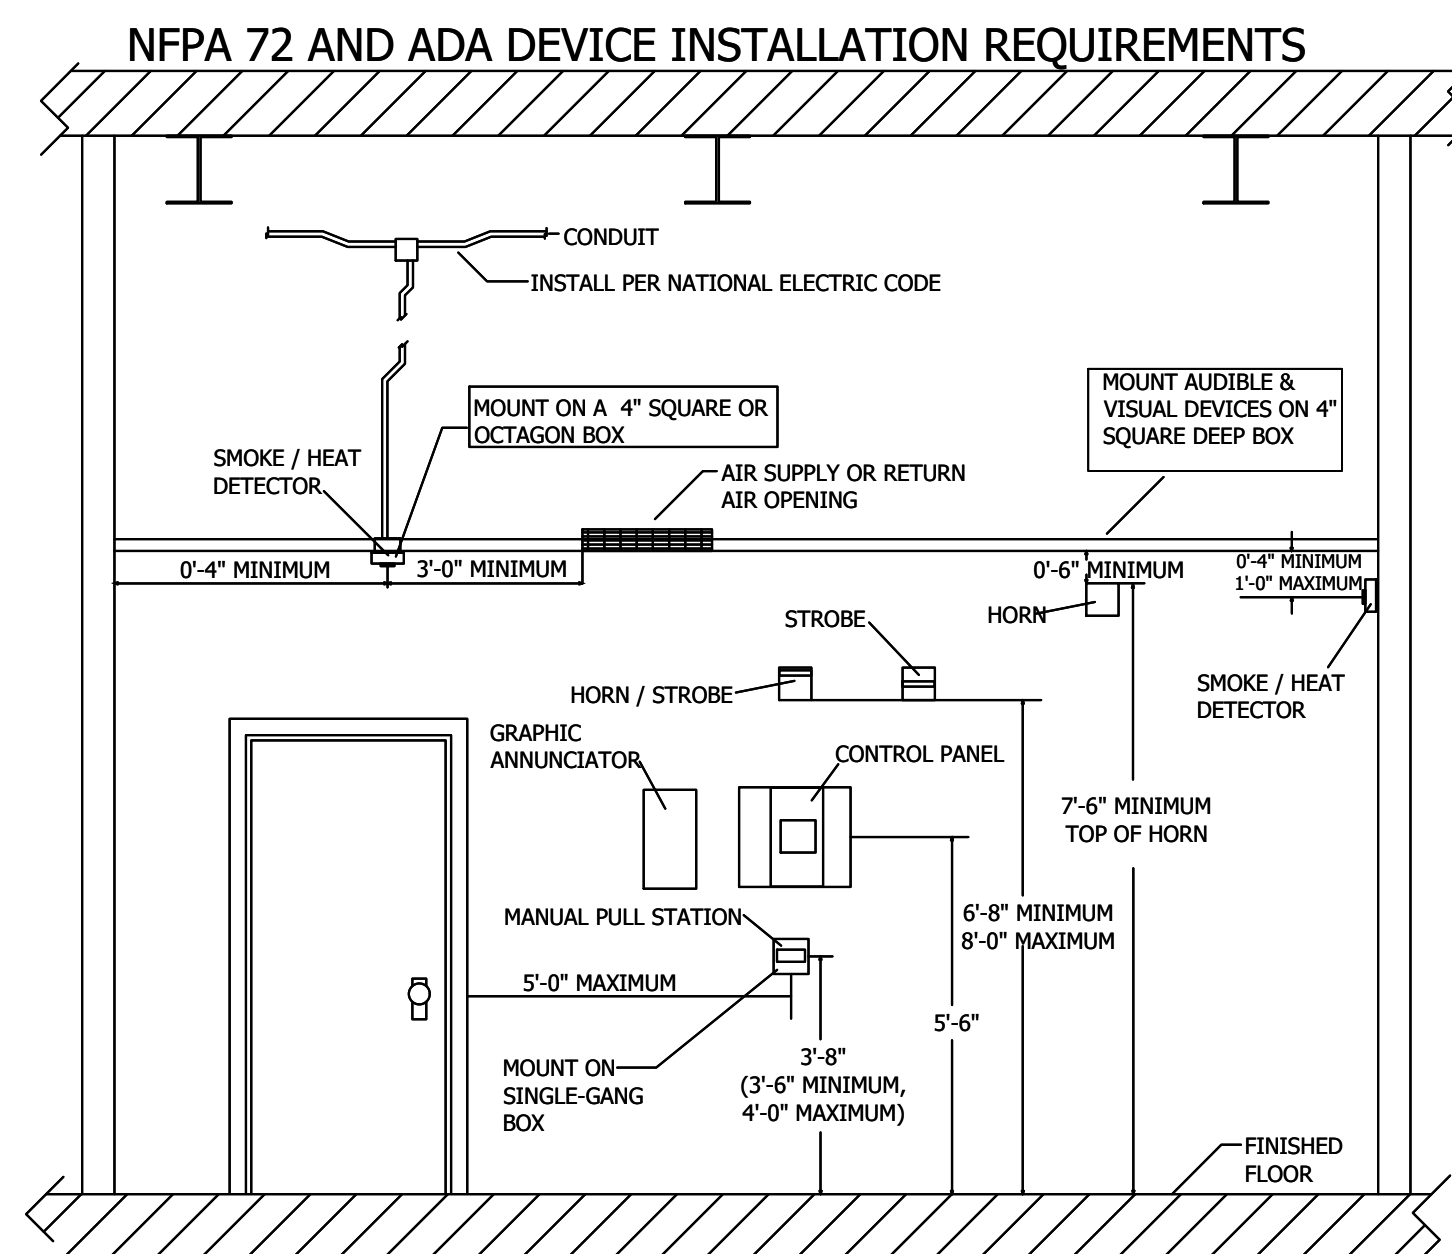

REVISION:	
ISSUED:	
DRAWN BY:	MMK
CHECKED BY:	MMK
FIRE ALARM NOTES, SCHEDULES, PLAN	
SHEET NO.	FA1