

# SEGMENTAL RETAINING WALL SPECIFICATIONS

## PART 1 - GENERAL NOTES

### 1.1 SCOPE OF WORK

FURNISHING AND INSTALLING SEGMENTAL RETAINING WALL UNITS, GEOGRID REINFORCEMENT, WALL FILL AND BACKFILL TO THE LINES AND GRADES SHOWN ON THE CONSTRUCTION DRAWINGS AND AS SPECIFIED HEREIN. THE CONTRACTOR SHALL ALSO BE RESPONSIBLE FOR THE FURNISHING AND INSTALLING ALL APPURTENANT MATERIALS, EQUIPMENT, AND LABOR REQUIRED FOR CONSTRUCTION OF THE GEOGRID REINFORCED, SEGMENTAL RETAINING WALL. ALL EXISTING AND PROPOSED CONSTRUCTION AND SITE GRADING INFORMATION WAS REFERENCED FROM AN ELECTRONIC VERSION OF THE GRADING AND DRAINAGE PLAN (SHEET C7.1) FOR CAMPBELL POINTE TOWNHOMES PH-6, DATED AUGUST 21, 2019, PREPARED BY DRAPER ADEN ASSOCIATES (DAA).

### 1.2 REFERENCE STANDARDS

- A. ASTM C90-75 (1981 REV.) - HOLLOW LOAD BEARING MASONRY UNITS.
- B. ASTM C140-75 (1981 REV.) - SAMPLING AND TESTING CONCRETE MASONRY UNITS.
- C. ASTM C145-75 (1981 REV.) - SOLID LOAD BEARING CONCRETE MASONRY UNITS.
- D. GEOSYNTHETIC RESEARCH INSTITUTE (GRI), GRI-GG4 - DETERMINATION OF LONG TERM DESIGN STRENGTH OF GEOGRIDS.
- E. ASTM D 638 - TEST METHOD FOR TENSILE PROPERTIES OF PLASTIC.
- F. ASTM D 1248 - SPECIFICATION OF POLYETHYLENE PLASTICS MOLDING AND EXTRUSION MATERIALS.
- G. ASTM D 4218 - TEST METHOD FOR CARBON BLACK CONTENT IN POLYETHYLENE COMPOUNDS BY THE MUFFLE FURNACE TECHNIQUE.
- H. ASTM D 3034 - SPECIFICATION FOR POLYVINYL CHLORIDE (PVC) PIPE.
- I. ASTM C 1372 - SPECIFICATIONS FOR SEGMENTAL RETAINING WALL UNITS.
- J. ASTM D 2487 - STANDARD PRACTICE FOR CLASSIFICATION OF SOILS FOR ENGINEERING PURPOSES (UNIFIED SOIL CLASSIFICATION SYSTEM)

### 1.3 DELIVERY, STORAGE AND HANDLING

- A. CONTRACTOR SHOULD CHECK THE MATERIALS UPON DELIVERY TO ASSURE THAT PROPER MATERIAL HAS BEEN RECEIVED.
- B. CONTRACTOR SHOULD PREVENT EXCESSIVE MUD, WET CEMENT, EPOXY, AND LIKE MATERIALS WHICH MAY AFFIX THEMSELVES, FROM COMING IN CONTACT WITH THE MATERIALS.
- C. GEOGRIDS SHOULD BE STORED ABOVE 20" F.
- D. CONTRACTOR SHOULD PROTECT THE MATERIALS FROM DAMAGE. DAMAGED MATERIAL SHOULD NOT BE INCORPORATED INTO THE REINFORCED RETAINING WALL.

### 1.4 SUBMITTALS/CERTIFICATION

THE CONTRACTOR SHALL SUBMIT A MANUFACTURER'S CERTIFICATION, PRIOR TO THE START OF THE WORK, THAT THE RETAINING WALL SYSTEM COMPONENTS MEET THE REQUIREMENTS OF ASTM C 1372 AND OTHER REQUIREMENTS SPECIFIED HEREIN. THIS CERTIFICATION SHOULD BE PROVIDED TO THE GEOTECHNICAL ENGINEER FOR REVIEW AND APPROVAL PRIOR TO WALL CONSTRUCTION.

## PART 2 - PRODUCTS

### 2.1 DEFINITIONS

- A. GEOGRID IS A HIGH DENSITY POLYETHYLENE OR POLYPROPYLENE GRID, SPECIFICALLY FABRICATED FOR USE AS A SOIL REINFORCEMENT.
- B. CONCRETE RETAINING WALL UNITS ARE AS DETAILLED ON THE DRAWINGS AND AS SPECIFIED HEREIN.
- C. GEOTECHNICAL DRAINAGE COMPOSITES ARE POLYETHYLENE NET STRUCTURE WITH NON-WOVEN GEOTEXTILES BONDDED TO BOTH SIDES.
- D. REINFORCED BACKFILL IS THE SOIL WHICH IS USED AS FILL FOR THE REINFORCED SOIL MASS.
- E. CONTROLLED FILL IS THE SOIL WHICH IS USED AS FILL IN AREAS OUTSIDE THE REINFORCED SOIL MALL.
- F. FOUNDATION SOIL IS THE IN-SITU SOIL OR CONTROLLED COMPACTED FILL PLACED BELOW THE BOTTOM OF THE RETAINING WALL AND GEOGRID ZONE.

### 2.2 MATERIALS

THE CONTRACTOR SHOULD SUBMIT MANUFACTURER'S CATALOG AND SAMPLES OF THE PROPOSED MATERIALS FOR APPROVAL BY THE PROJECT GEOTECHNICAL ENGINEER A MINIMUM OF SEVEN DAYS BEFORE THE START OF CONSTRUCTION. MATERIALS SHOULD BE TRANSPORTED TO THE SITE ONLY AFTER APPROVAL OF THE PROPOSED MATERIALS BY THE PROJECT GEOTECHNICAL ENGINEER.

#### A. CONCRETE UNITS

- 1. MASONRY UNITS SHOULD BE ANCHOR DIAMOND PRO PS RETAINING WALL UNITS. SUBSTITUTION OF OTHER CONCRETE UNITS OF SUBSTANTIALLY SIMILAR SIZE AND WEIGHT MAY BE ALLOWED WITH THE PRIOR APPROVAL OF THE GEOTECHNICAL ENGINEER.
- 2. CONCRETE WALL UNITS SHOULD HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI. IN ACCORDANCE WITH ASTM C-90. THE CONCRETE SHOULD HAVE ADEQUATE FREEZE/THAW PROTECTION WITH A MAXIMUM MOISTURE ABSORPTION OF 6 PERCENT.
- 3. MODULAR CONCRETE MATERIALS SHALL CONFORM TO THE REQUIREMENTS OF ASTM C 1372 - STANDARD SPECIFICATIONS FOR SEGMENTAL RETAINING WALL UNITS.
- 4. THE UNITS SHALL PASS 100 FREEZE/THAW CYCLES IN WATER WITH LESS THAN 1% WEIGHT LOSS IN ACCORDANCE WITH ASTM C 1372.
- 5. EXTERIOR DIMENSIONS MAY VARY. UNITS ARE REQUIRED TO HAVE A MINIMUM OF ONE SQUARE FOOT OF FACE AREA EACH.
- 6. UNITS SHOULD HAVE ANGLED SIDES AND BE CAPABLE OF ATTAINING CONCAVE AND CONVEX ALIGNMENT CURVES IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
- 7. UNITS SHOULD BE INTERLOCKED WITH NON-CORROSIVE REINFORCED FIBERGLASS PINS.
- 8. UNITS SHOULD BE INTERLOCKED TO PROVIDE 1 INCH OF SETBACK PER BLOCK (7:1 BATTER ANGLE).

#### B. LEVELING PAD

MATERIAL FOR LEVELING PAD/FOOTING SHOULD CONSIST OF COMPACTED COARSE GRADED AGGREGATES MEETING THE REQUIREMENTS OF AGGREGATE BASE COURSE (ABC) AS SPECIFIED IN THE 2018 NORTH CAROLINA DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR ROADS AND STRUCTURES. A MINIMUM OF 6 INCHES DEEP AND 30 INCHES WIDE COMPACTED LEVELING PAD IS REQUIRED.

#### C. FIBERGLASS CONNECTING PINS

- 1. THERMOSET ISOPHTHALIC POLYESTER RESIN PULTRUDED FIBERGLASS REINFORCEMENT RODS, A MINIMUM ONE-HALF INCH IN DIAMETER.
- 2. PINS SHOULD HAVE A MINIMUM FLEXURAL STRENGTH OF 128,000 PSI AND SHORT BEAM SHEAR OF 6,400 PSI.
- 3. FOR SUBSTITUTE CONCRETE UNITS, USE OF OTHER COMPATIBLE CONNECTOR SYSTEMS MAY BE ALLOWED WITH THE PRIOR APPROVAL OF THE GEOTECHNICAL ENGINEER.

#### D. GEOGRID

GEOGRID SHOULD CONSIST OF MIRAGRID 05XT, OR EQUIVALENT AS APPROVED BY THE GEOTECHNICAL ENGINEER. THE GEOGRID SHOULD HAVE A MINIMUM LONG-TERM DESIGN STRENGTH OF 2,768 POUNDS PER FOOT. THE LONG-TERM DESIGN STRENGTH IS DEFINED AS THE ULTIMATE STRENGTH DIVIDED BY REDUCTION FACTORS FOR CREEP, DURABILITY, AND INSTALLATION DAMAGE.

#### E. REINFORCED BACKFILL

REINFORCED BACKFILL SHOULD CONSIST OF CONTROLLED, COMPACTED GRANULAR SOILS MEETING THE REQUIREMENTS OF UNIFIED SOIL CLASSIFICATION SYSTEM (USCS) GW, GP, GM, SW, SP, SM IN ACCORDANCE WITH ASTM D2487, WITH MAXIMUM LIQUID LIMIT OF 40, MAXIMUM PLASTICITY INDEX OF 15, AND MINIMUM INTERNAL FRICTION ANGLE OF 30 DEGREES. ALTERNATE SOIL CLASSIFICATIONS MAY BE CONSIDERED ON A CASE-BY-CASE BASIS, PROVIDED THEY MEET THE LIQUID LIMIT, PLASTICITY INDEX, AND INTERNAL FRICTION ANGLE REQUIREMENTS SPECIFIED ABOVE. BASED ON THE AVAILABLE SUBSURFACE INFORMATION, SUITABLE MATERIALS MAY BE AVAILABLE FROM ON-SITE EXCAVATIONS. HOWEVER, SEGREGATION AND OCCUPYING OF SUITABLE MATERIALS WILL LIKELY BE REQUIRED. IF ADEQUATE QUANTITIES OF THESE MATERIALS ARE NOT AVAILABLE ON-SITE, IMPORTED BACKFILL SHOULD MEET THE ABOVE REQUIREMENTS, AND SHOULD BE APPROVED BY THE GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT. LABORATORY TESTING, INCLUDING CLASSIFICATION AND DIRECT SHEAR TESTING, WILL BE REQUIRED TO VERIFY THE DESIGN SOIL PROPERTIES. ALL FILL MATERIALS PROPOSED TO BE PLACED BEHIND THE REINFORCED BACKFILL ZONE SHOULD BE PLACED AS CONTROLLED FILL COMPACTED TO MINIMUM 95 PERCENT OF THE MAXIMUM DRY DENSITY IN ACCORDANCE WITH THE STANDARD PROCTOR (ASTM D-698) AT MOISTURE CONTENTS WITHIN 2 PERCENTAGE POINTS OF OPTIMUM.

#### F. CONTROLLED FILL

CONTROLLED FILL SOILS TO BE PLACED OUTSIDE THE REINFORCED BACKFILL AREA WITHIN 25 FEET OF THE RETAINING WALL FACE SHOULD CONSIST OF ON-SITE OR IMPORTED BORROW SOILS MEETING THE REQUIREMENTS OF UNIFIED SOIL CLASSIFICATION SYSTEM (USCS) GW, GP, GM, SW, SP, SM IN ACCORDANCE WITH ASTM D2487, WITH MAXIMUM LIQUID LIMIT OF 40, MAXIMUM PLASTICITY INDEX OF 15, AND MINIMUM INTERNAL FRICTION ANGLE OF 30 DEGREES. ALTERNATE SOIL CLASSIFICATIONS MAY BE CONSIDERED ON A CASE-BY-CASE BASIS, PROVIDED THEY MEET THE LIQUID LIMIT, PLASTICITY INDEX, AND INTERNAL FRICTION ANGLE REQUIREMENTS SPECIFIED ABOVE. LABORATORY TESTING, INCLUDING CLASSIFICATION AND DIRECT SHEAR TESTING, WILL BE REQUIRED TO VERIFY THE DESIGN SOIL PROPERTIES. ALL FILL MATERIALS PROPOSED TO BE PLACED BEHIND THE REINFORCED BACKFILL ZONE SHOULD BE PLACED AS CONTROLLED FILL COMPACTED TO MINIMUM 95 PERCENT OF THE MAXIMUM DRY DENSITY IN ACCORDANCE WITH THE STANDARD PROCTOR (ASTM D-698) AT MOISTURE CONTENTS WITHIN 2 PERCENTAGE POINTS OF OPTIMUM.

#### G. LOW-PERMEABILITY SOIL

LOW-PERMEABILITY SOILS TO BE PLACED AT THE TOP OF THE WALL WHERE SPECIFIED SHOULD CONSIST OF SANDY, SILTY OR CLAYEY SOILS MEETING THE REQUIREMENTS OF UNIFIED SOIL CLASSIFICATION SYSTEM (USCS) ML, CL, SM, OR SC IN ACCORDANCE WITH ASTM D2487, WITH A MINIMUM OF 25% PASSING THE #200 SIEVE.

#### H. DRAINAGE PIPE

THE DRAINAGE PIPES SHOULD BE PERFORATED OR SLOTTED PVC PIPE MANUFACTURED IN ACCORDANCE WITH ASTM D-3034.

#### I. FILTER FABRIC

FILTER FABRIC SHOULD BE NON-WOVEN, POLYPROPYLENE GEOTEXTILE, 140 N MANUFACTURED BY NICOLON MIRAFI GROUP OR APPROVED EQUIVALENT.


## PART 3 - EXECUTION

### A. EXCAVATION

- 1. THE CONTRACTOR SHOULD EXCAVATE TO THE LINES AND GRADES SHOWN ON THE CONSTRUCTION DRAWINGS. UNDER NO CIRCUMSTANCES SHOULD THE EXCAVATION LINES AND GRADES BE EXCEEDED, EXCEPT WITH THE GEOTECHNICAL ENGINEER'S APPROVAL. THE CONTRACTOR SHOULD PROTECT THE EXCAVATION FROM SLOUGHING BY PLACING A MEMBRANE OVER THE FACE OF THE EXCAVATION.
- 2. PRIOR TO RETAINING WALL CONSTRUCTION AND THE PLACEMENT OF FILL, ALL TOPSOIL SHOULD BE STRIPPED AND REMOVED FROM THE SITE.
- 3. EXCAVATIONS SHOULD BE SLOPED OR OTHERWISE SUPPORTED IN ACCORDANCE WITH OCCUPATION SAFETY AND HEALTH ADMINISTRATION (OSHA) AND OTHER LOCAL AND STATE REGULATIONS.

### B. FOUNDATION SUBGRADE PREPARATION

- 1. FOUNDATION SOIL SHOULD BE EXCAVATED AS REQUIRED FOR INSTALLATION OF LEVELING PAD, GEOGRID AND OTHER ELEMENTS AND AS SHOWN ON THE CONSTRUCTION DRAWINGS.
- 2. FOUNDATION SOIL SHOULD BE OBSERVED BY THE GEOTECHNICAL ENGINEER OR THEIR QUALIFIED REPRESENTATIVE TO VERIFY THAT THE ACTUAL FOUNDATION SOIL STRENGTH MEETS OR EXCEEDS ASSUMED DESIGN STRENGTH. SOILS NOT MEETING REQUIRED STRENGTH SHOULD BE REMOVED AND REPLACED WITH CONTROLLED, COMPACTED MATERIAL AS DIRECTED BY THE PROJECT GEOTECHNICAL ENGINEER OR THEIR QUALIFIED REPRESENTATIVE.
- 3. OVER-EXCAVATED AREAS SHOULD BE BACKFILLED WITH APPROVED MATERIAL AND COMPACTED TO 95 PERCENT OF MAXIMUM DRY DENSITY IN ACCORDANCE WITH THE STANDARD PROCTOR (ASTM D-698) AT MOISTURE CONTENTS WITHIN 2 PERCENTAGE POINTS OF OPTIMUM.
- 4. ALLOWABLE BEARING PRESSURE FOR NATURAL AND CONTROLLED, COMPACTED FILL SOILS SHOULD BE AS SPECIFIED IN PART 5.
- 5. THE EXPOSED FOUNDATION SUBGRADE SHOULD BE PROOF-ROLLED WITH A LOADED DUMP TRUCK. ANY SOFT OR UNSTABLE AREAS IDENTIFIED DURING PROOF-ROLLING SHOULD BE OVER-EXCAVATED AND BACKFILLED WITH CONTROLLED FILL OR STONE AS DIRECTED BY THE PROJECT GEOTECHNICAL ENGINEER OR THEIR QUALIFIED REPRESENTATIVE.
- 6. ANY FILLS REQUIRED TO ESTABLISH SLOPING SURFACES IN FRONT OF THE WALLS SHOULD CONSIST OF CONTROLLED FILL AND SHOULD BE PLACED, COMPACTED, AND FIELD TESTED IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED HEREIN.

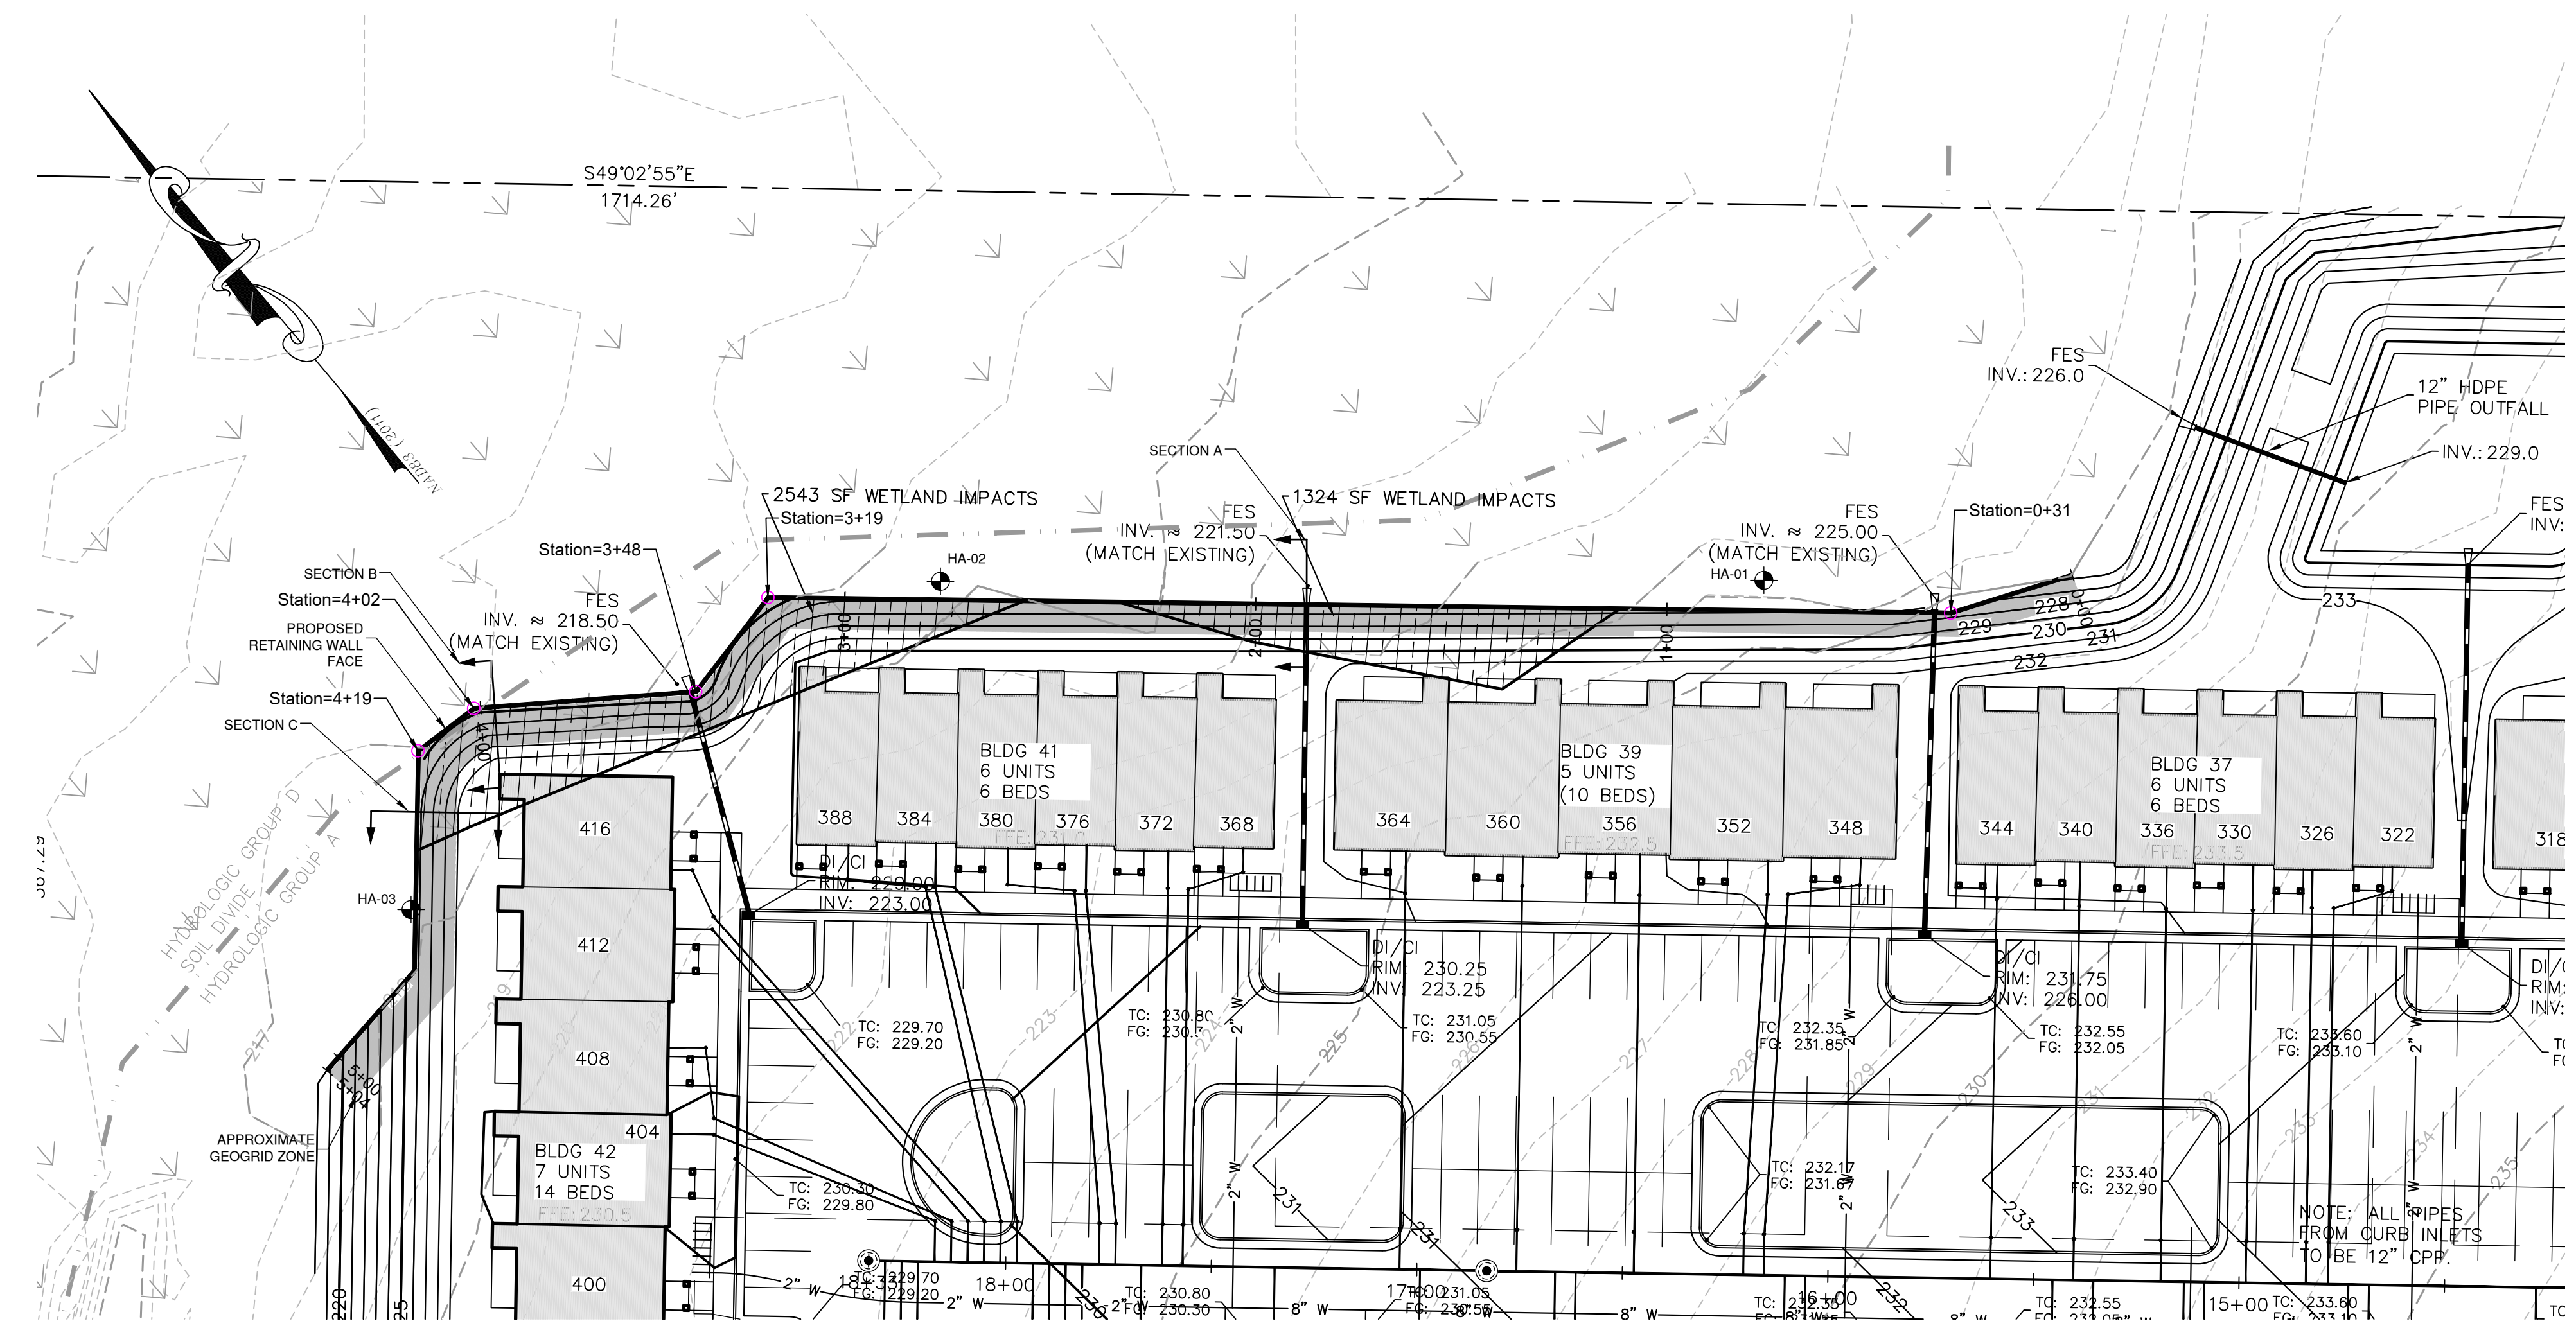

## RETAINING WALL LOCATION PLAN

SCALE: 1" = 30'

## LEGEND



HA-01 IDENTIFICATION AND APPROXIMATE LOCATION OF HAND AUGER BORINGS PERFORMED BY DRAPER ADEN ASSOCIATES (DAA) ON JUNE 10, 2019.

## NOTES

- 1. BASE MAP ADAPTED FROM AN ELECTRONIC VERSION OF THE GRADING AND DRAINAGE PLAN (SHEET C7.1) FOR CAMPBELL POINTE TOWNHOMES PH-6, DATED AUGUST 21, 2019, PREPARED BY DRAPER ADEN ASSOCIATES (DAA).
- 2. THE EXPLORATION LOCATIONS WERE SELECTED AND FIELD-LOCATED BY DAA PERSONNEL BY VISUAL ESTIMATIONS FROM EXISTING SITE FEATURES. THE EXPLORATION LOCATIONS SHOULD BE CONSIDERED ACCURATE TO THE DEGREE IMPLIED BY THE METHOD OF FIELD-LOCATION.

### G. DRAINAGE

- 1. DRAINAGE FILL SHOULD BE PLACED BEHIND THE WALL TO THE LIMITS SHOWN. THE DRAINAGE FILL SHOULD BE MINIMUM 12 INCHES THICK, AND SHOULD CONSIST OF AASHTO NO. 57 STONE. THE DRAINAGE FILL SHOULD BE WRAPPED IN FILTER FABRIC (MIRAFI 140N OR EQUAL) AS SHOWN ON THE DRAWINGS. THE FILTER FABRIC SHOULD BE TRIMMED NECESSARY TO FIT AROUND THE STORM DRAIN PIPES WHICH ARE PLANNED TO DAYLIGHT THROUGH THE WALL FACE.
- 2. POSITIVE DRAINAGE SHOULD BE MAINTAINED DURING AND AFTER CONSTRUCTION. SOILS WITHIN THE REINFORCED ZONE THAT BECOME WET DURING CONSTRUCTION SHOULD BE DRIED TO OPTIMUM MOISTURE AND RE-COMPACTED OR REMOVED AND REPLACED.
- 3. INSTALL THE PERFORATED DRAINAGE PIPES AND LATERAL DRAINAGE PIPES INCREMENTALLY ALONG WITH THE INSTALLATION OF CONCRETE UNITS AND PLACEMENT OF FILL. THE PLACEMENT OF THE LONGITUDINAL DRAINAGE PIPE WILL NEED TO BE COORDINATED WITH THE INSTALLATION OF THE STORM DRAIN PIPES TO AVOID POTENTIAL CONFLICTS.

## PART 4 - CONSTRUCTION OBSERVATION AND TESTING

- A. RETAINING WALLS SHOULD ONLY BE CONSTRUCTED UNDER THE OBSERVATION OF A REGISTERED PROFESSIONAL GEOTECHNICAL ENGINEER OR THEIR QUALIFIED REPRESENTATIVE. IT IS RECOMMENDED THAT DRAPER ADEN ASSOCIATES SHOULD PROVIDE CONSTRUCTION OBSERVATION AND TESTING SERVICES FOR THE PROPOSED RETAINING WALL CONSTRUCTION TO ENSURE CONTINUITY AND TO VERIFY THAT THE INTENT OF THIS RETAINING WALL DESIGN IS PROPERLY IMPLEMENTED DURING CONSTRUCTION.
- B. THE REQUIRED BEARING PRESSURE BENEATH THE FOOTING OF THE WALL SHOULD BE VERIFIED IN THE GEOTECHNICAL ENGINEER OR THEIR QUALIFIED REPRESENTATIVE TESTING DOCUMENTATION MUST BE PROVIDED TO THE GEOTECHNICAL ENGINEER PRIOR TO THE START OF WALL CONSTRUCTION. THE REQUIRED TEST PROCEDURE SHALL BE THE DYNAMIC CONE PENETROMETER (DCP) TEST ASTM STP-399.
- C. THE SUITABILITY OF FILL MATERIAL SHOULD BE CONFIRMED BY THE GEOTECHNICAL ENGINEER OR THEIR QUALIFIED REPRESENTATIVE.


## PART 5 - DESIGN CRITERIA

- 1. THE REQUIRED MINIMUM ALLOWABLE FOUNDATION BEARING PRESSURE IS 1,500 PSF.
- 2. ASSUMED DESIGN PARAMETERS FOR FOUNDATION SOILS:
  - 2.1. INTERNAL FRICTION ANGLE = 20 DEGREES
  - 2.2. COHESION = 100 PSF
  - 2.3. MOIST UNIT WEIGHT = 115 PCF
- 3. ASSUMED DESIGN PARAMETERS FOR RETAINED SOILS (WITHIN 25 FEET OF THE WALL FACE):
  - 3.1. INTERNAL FRICTION ANGLE = 30 DEGREES
  - 3.2. MOIST UNIT WEIGHT = 115 PCF
- 4. ASSUMED DESIGN PARAMETERS FOR REINFORCED SOILS:
  - 4.1. INTERNAL FRICTION ANGLE = 30 DEGREES
  - 4.2. MOIST UNIT WEIGHT = 115 PCF
- 5. A GLOBAL STABILITY ANALYSIS OF THE PROPOSED RETAINING WALL AND ASSOCIATED SLOPES BASED ON THE ASSUMED SOIL PARAMETERS YIELDED A FACTOR OF SAFETY AGAINST GLOBAL INSTABILITY OF GREATER THAN 1.3.
- 6. IT SHOULD BE NOTED THAT MODIFICATION OF THE RETAINING WALL DESIGN OR IMPROPER CONSTRUCTION PRACTICES, INCLUDING USE OF MATERIALS WHICH DO NOT MEET THE ASSUMED DESIGN PARAMETERS OUTLINED ABOVE, MAY REDUCE THE FACTOR OF SAFETY AGAINST GLOBAL INSTABILITY AND/OR IMPACT THE STABILITY OF THE PROPOSED RETAINING WALL.
- 7. THE SOIL PARAMETERS ASSUMED FOR DESIGN SHOULD BE VERIFIED BY LABORATORY TESTING PRIOR TO COMMENCEMENT OF CONSTRUCTION. SPECIFICALLY, CLASSIFICATION AND DIRECT SHEAR TESTING IS REQUIRED TO VERIFY THE SOIL PROPERTIES AND ASSUMED DESIGN FRICTION ANGLE OF THE REINFORCED BACKFILL AND RETAINED SOILS.
- 8. THIS RETAINING WALL IS NOT DESIGNED TO RESIST THE ACCUMULATION OF HYDROSTATIC PRESSURES BEHIND THE WALL.

NOTICE TO CONTRACTOR  
All construction must comply with current NC Building Codes and is subject to field inspection and verification.

APPROVED  
Permit holder responsible for full compliance with the code.

06/05/2020

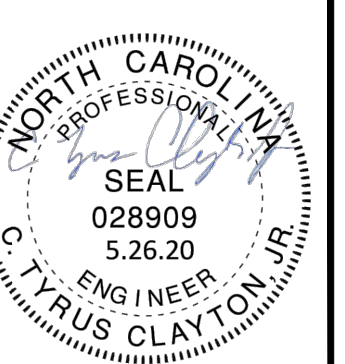

**Draper Aden Associates**  
Engineering • Surveying • Environmental Services  
114 Edinburgh South Drive, Suite 200  
City, NC 27511  
919-827-0864, Fax: 919-829-8138  
NC Firm License # C-0861

- Hampton Roads, VA
- Fayetteville, NC
- Northern Virginia
- Virginia Beach, VA
- Richmond, VA
- Blacksburg, VA
- Charlottesville, VA



RETAINING WALL 1 - LOCATION PLAN AND NOTES  
CAMPBELL POINTE TOWNHOMES PH 6  
HARNETT COUNTY, NORTH CAROLINA

## REVISIONS

1/8/2020: RE-DESIGN FOR ANCHOR DIAMOND PRO PS BLOCK UNITS.  
5/27/2020: RE-DESIGN FOR LAYOUT CHANGES.

RELEASED FOR PERMITTING AND CONSTRUCTION

DESIGNED BY: FDP  
DRAWN BY: FDP  
CHECKED BY: CTC Jr  
SCALE: 1" = 30'  
DATE: 09/03/2019  
PROJECT NUMBER: R14245N-08  
RW1

DATE PLOTTED: 10/20/2019 10:50:59 AM  
PLOT FILE: S:\14245N\CAD\DWG\14245N-08-RETAINING WALL PH 6.dwg  
PLOTTER: HP DesignJet 5000PS  
PLOT SCALE: 1" = 30'



**Draper Aden Associates**  
 Engineering • Surveying • Environmental Services

114 Edinburg South Drive, Suite 200  
 Cary, NC 27511  
 919-427-0864 Fax: 919-429-8138  
 NC Firm License # C-0861


• Hampton Roads, VA  
 • Fayetteville, NC  
 • Northern Virginia  
 • Virginia Beach, VA  
 • Richmond, VA  
 • Blacksburg, VA  
 • Charlottesville, VA

**RETAINING WALL 1 - PROFILE**  
**CAMPBELL POINTE TOWNHOMES PH 6**  
 HARNETT COUNTY, NORTH CAROLINA

REVISIONS	
1/8/2020:	RE-DESIGN FOR ANCHOR DIAMOND PRO PS BLOCK UNITS.
5/27/2020:	RE-DESIGN FOR LAYOUT CHANGES.


RELEASED FOR PERMITTING AND CONSTRUCTION

DESIGNED BY:	FDP
DRAWN BY:	FDP
CHECKED BY:	CTC Jr
SCALE:	(AS SHOWN)
DATE:	09/03/2019
PROJECT NUMBER:	R14245N-08
<b>RW2</b>	

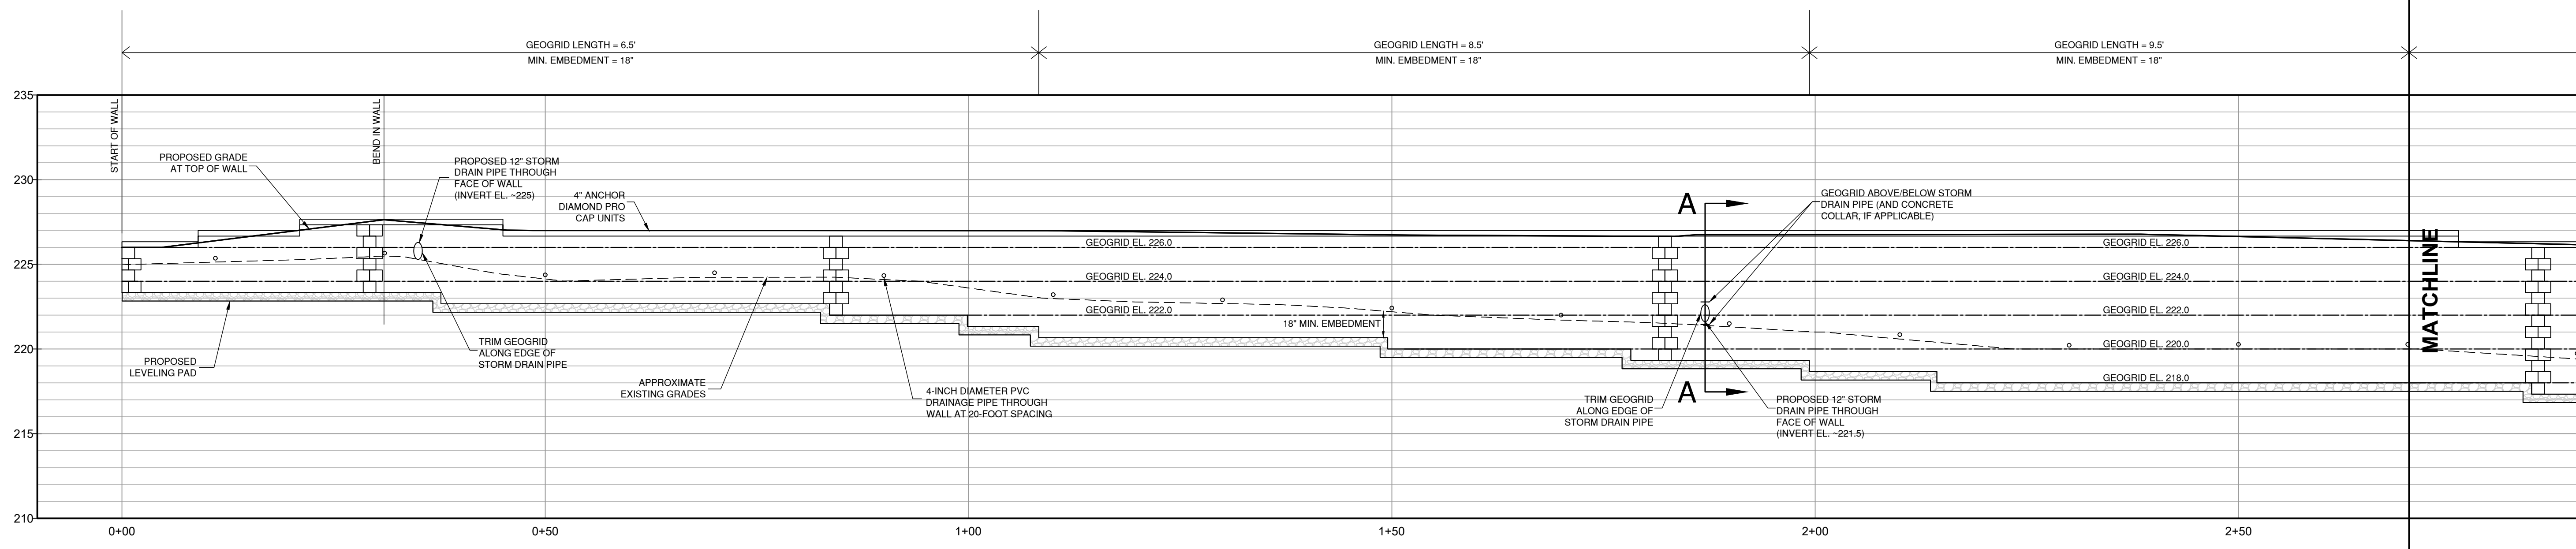


PV - (1) (1) - Scale: H: 1"=10', V: 2.00:1

**RETAINING WALL 1A - PROFILE**  
 VERTICAL SCALE: 1" = 10'  
 HORIZONTAL SCALE: 1" = 5'

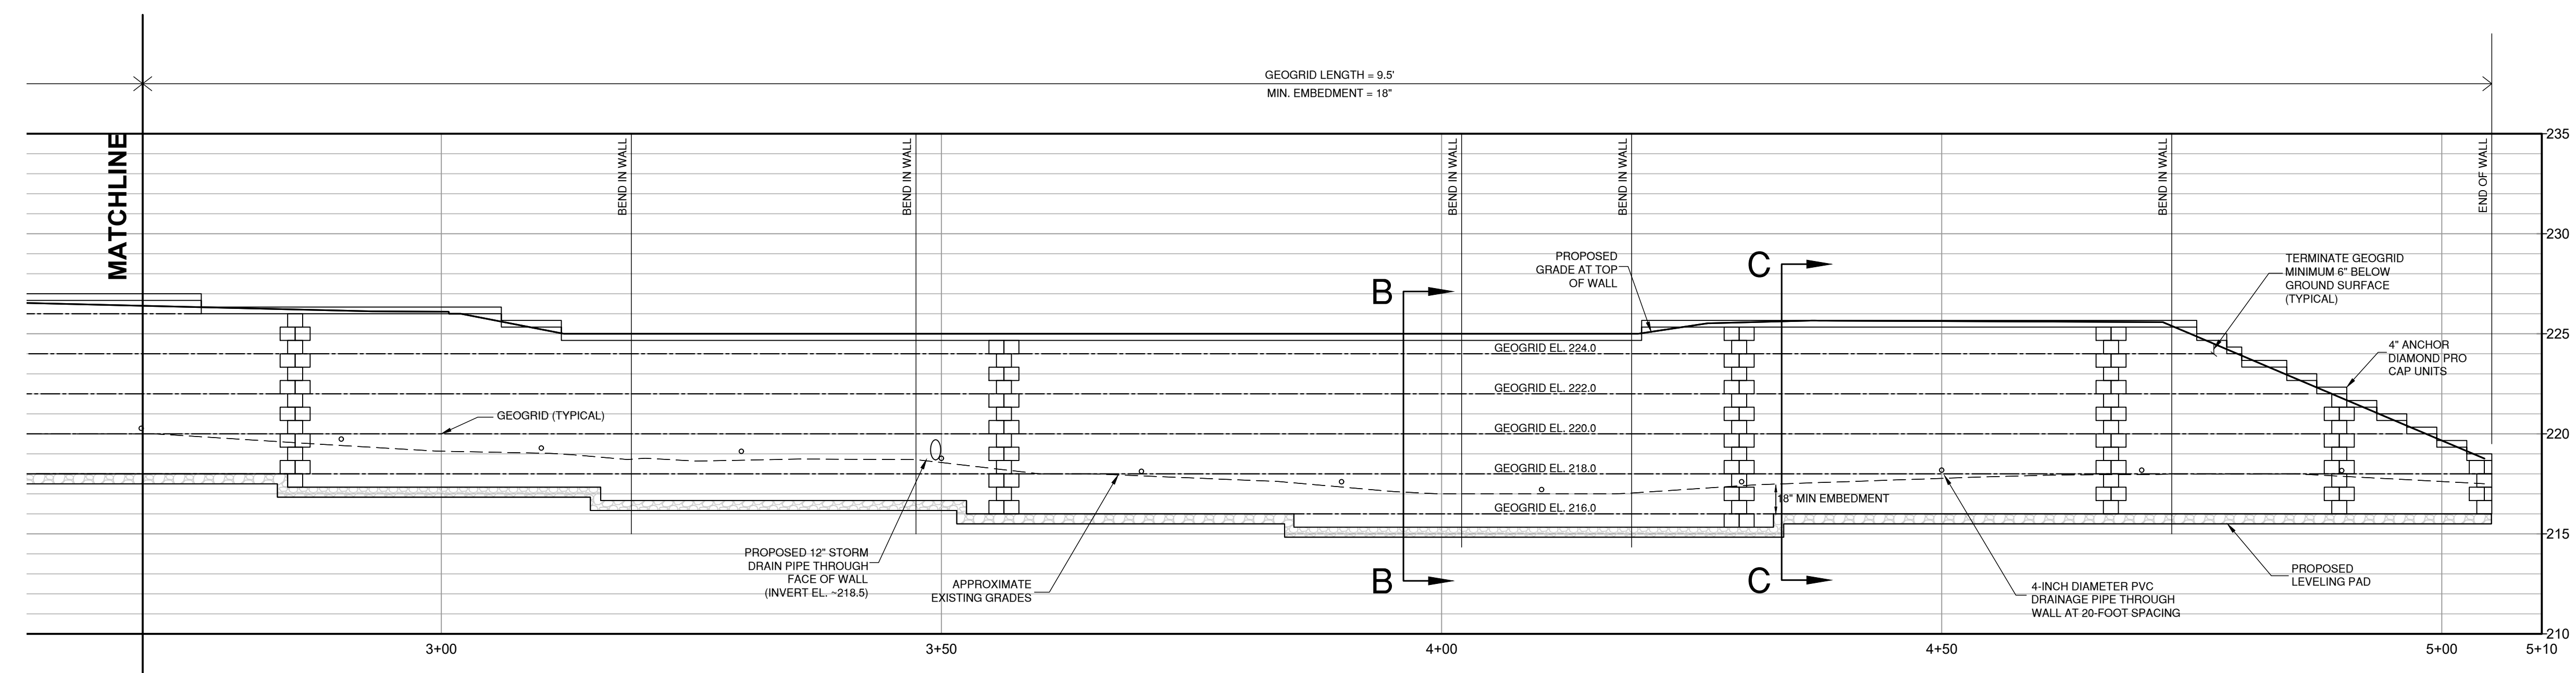


**RETAINING WALL 1B - PROFILE**  
 VERTICAL SCALE: 1" = 10'  
 HORIZONTAL SCALE: 1" = 5'

D:\PROJECTS\14245N\14245N-08\DWG\14245N-08-RW2.dwg (14245N-08-RW2) - Campbell Pointe PH 6 - Retaining Wall Profile - revised May 2020 (Rev. May 20, 2020 10:51:13 PM)

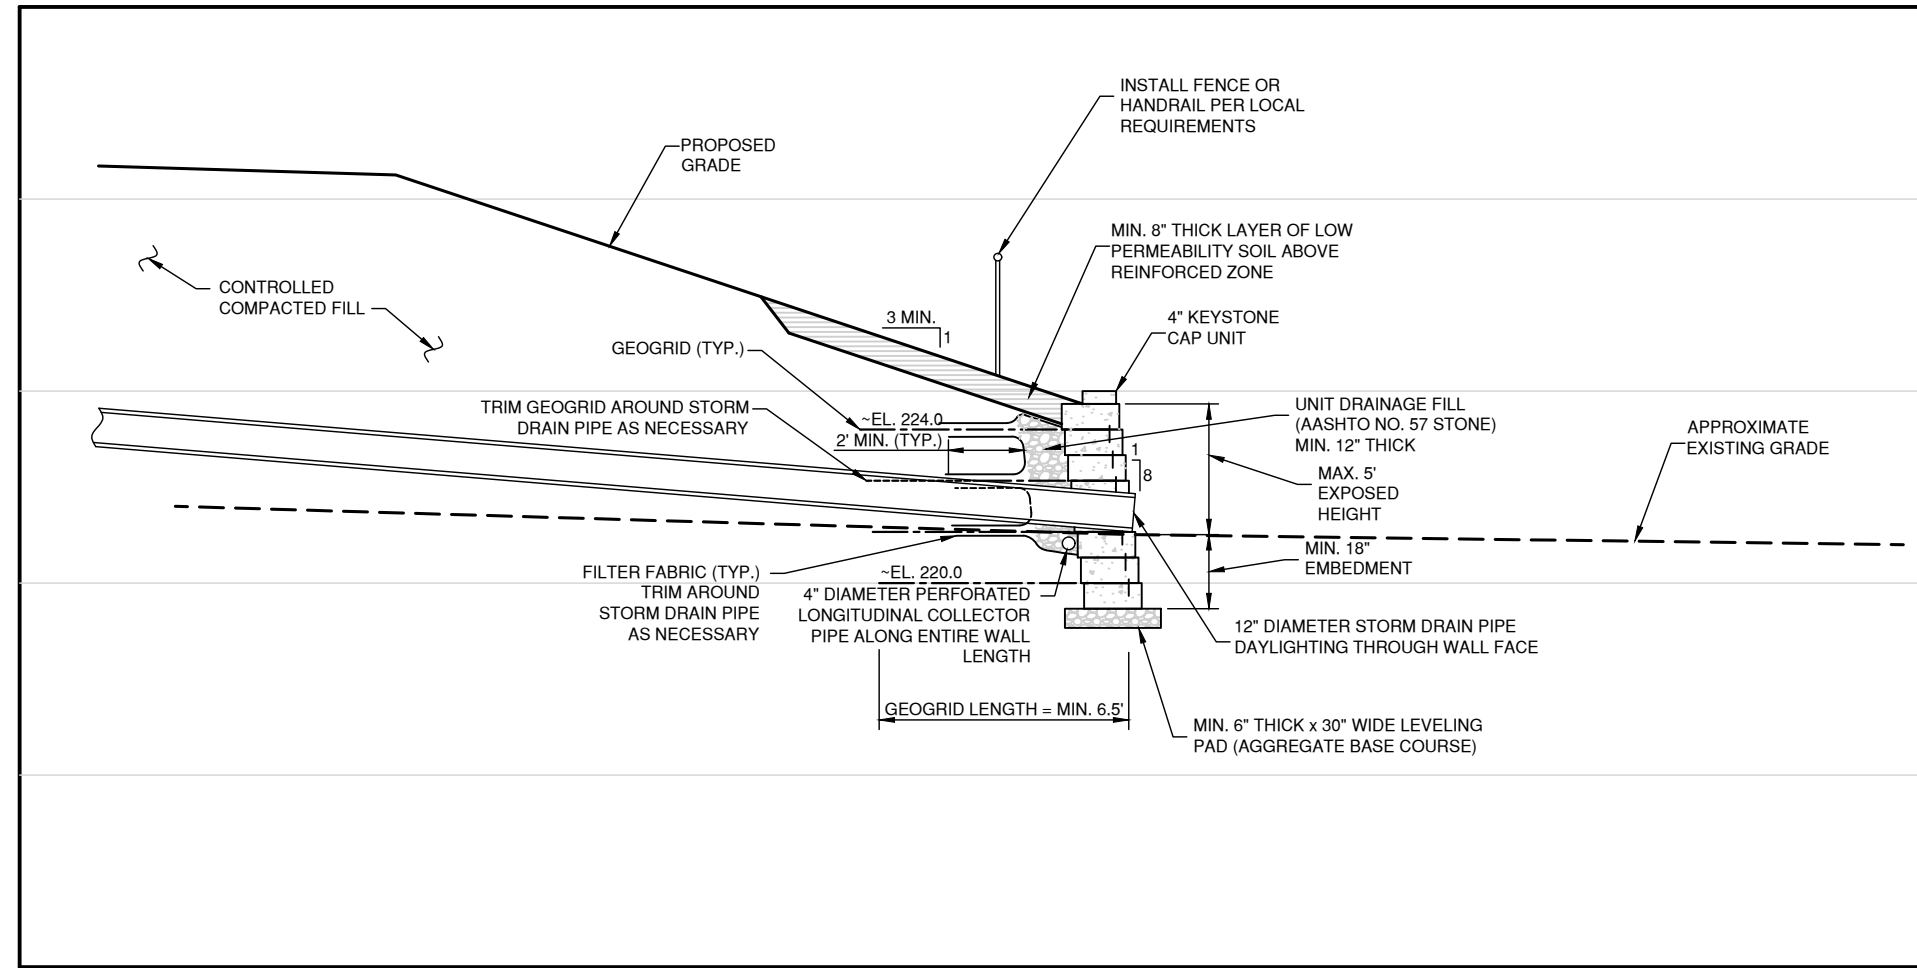


**RETAINING WALL 1 - SECTION A-A**

VERTICAL SCALE: 1" = 5"  
HORIZONTAL SCALE: 1" = 5"

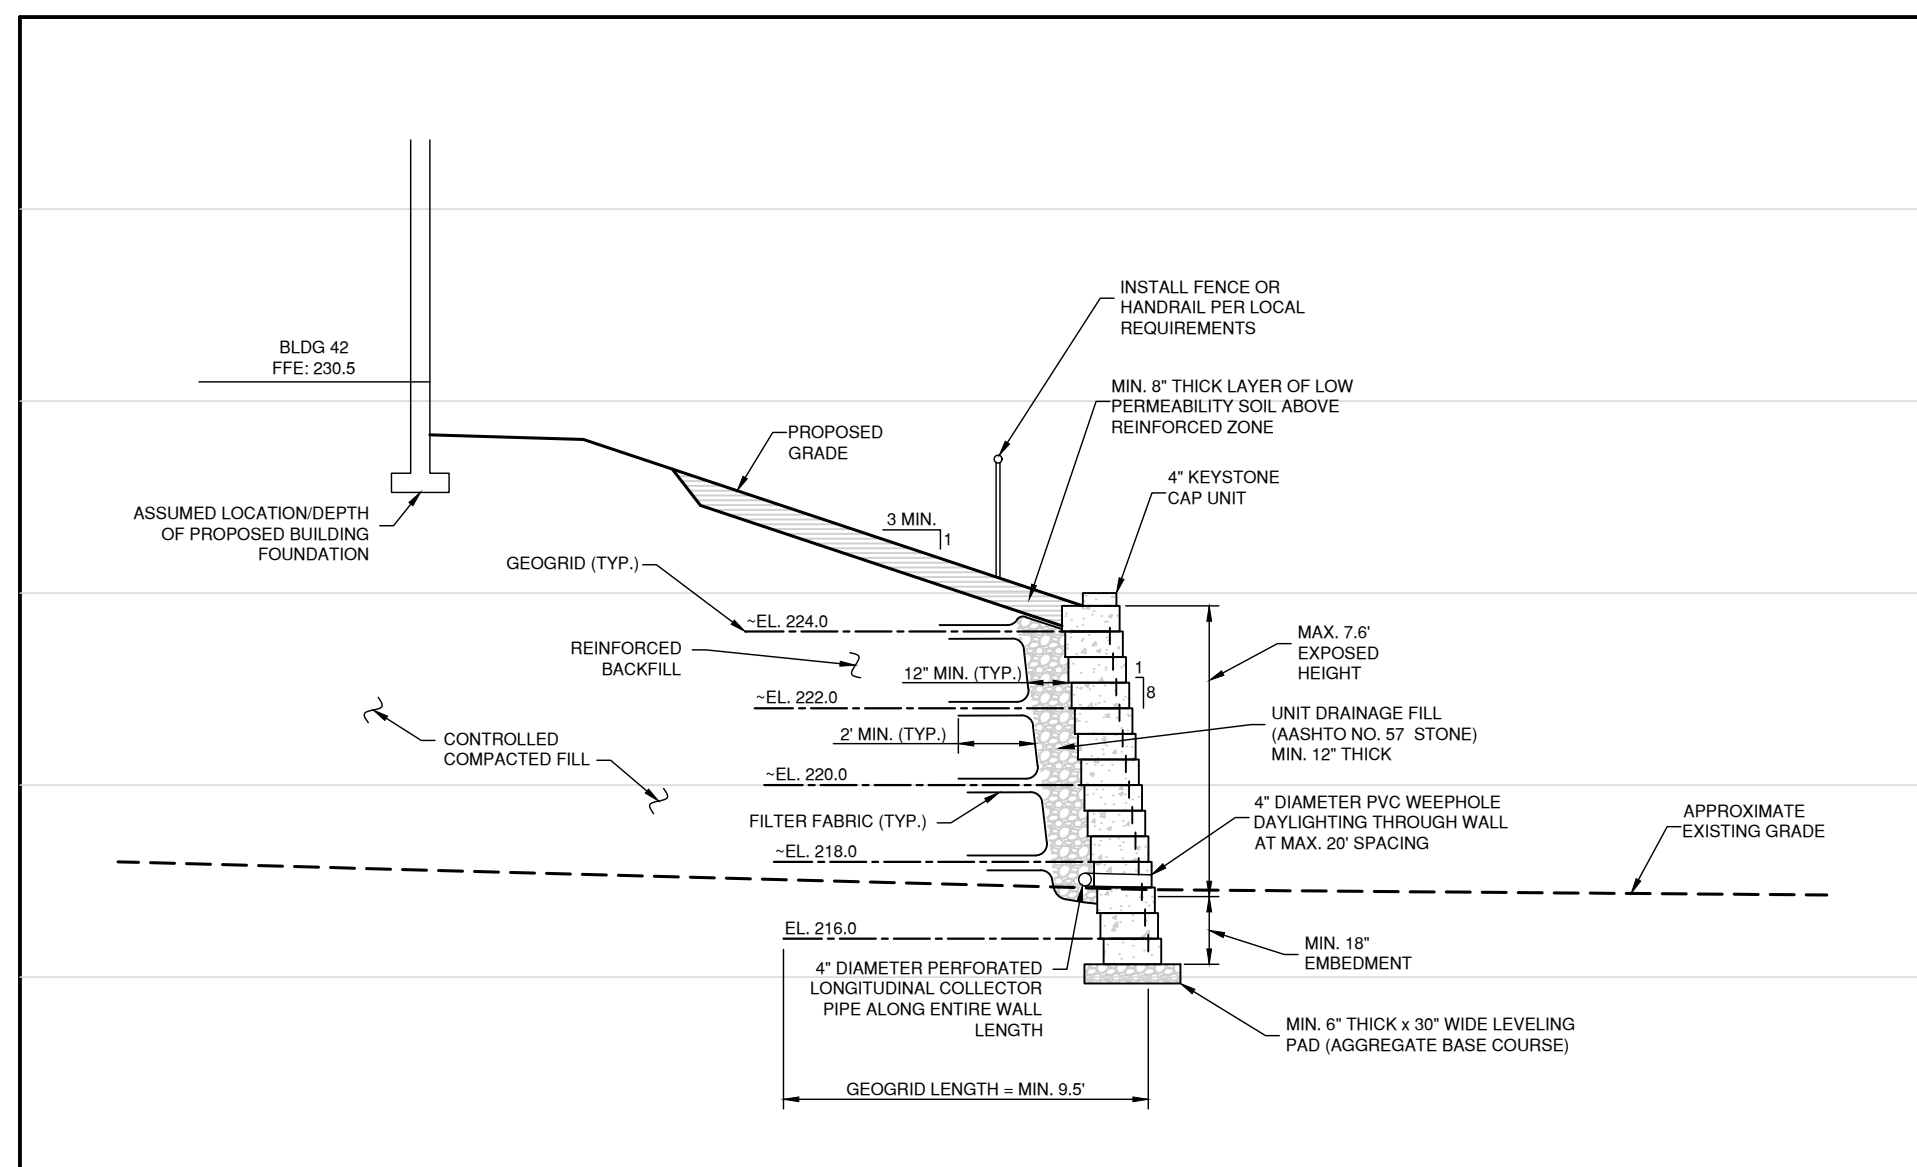


**RETAINING WALL 1 - SECTION B-B**

VERTICAL SCALE: 1" = 5"  
HORIZONTAL SCALE: 1" = 5"

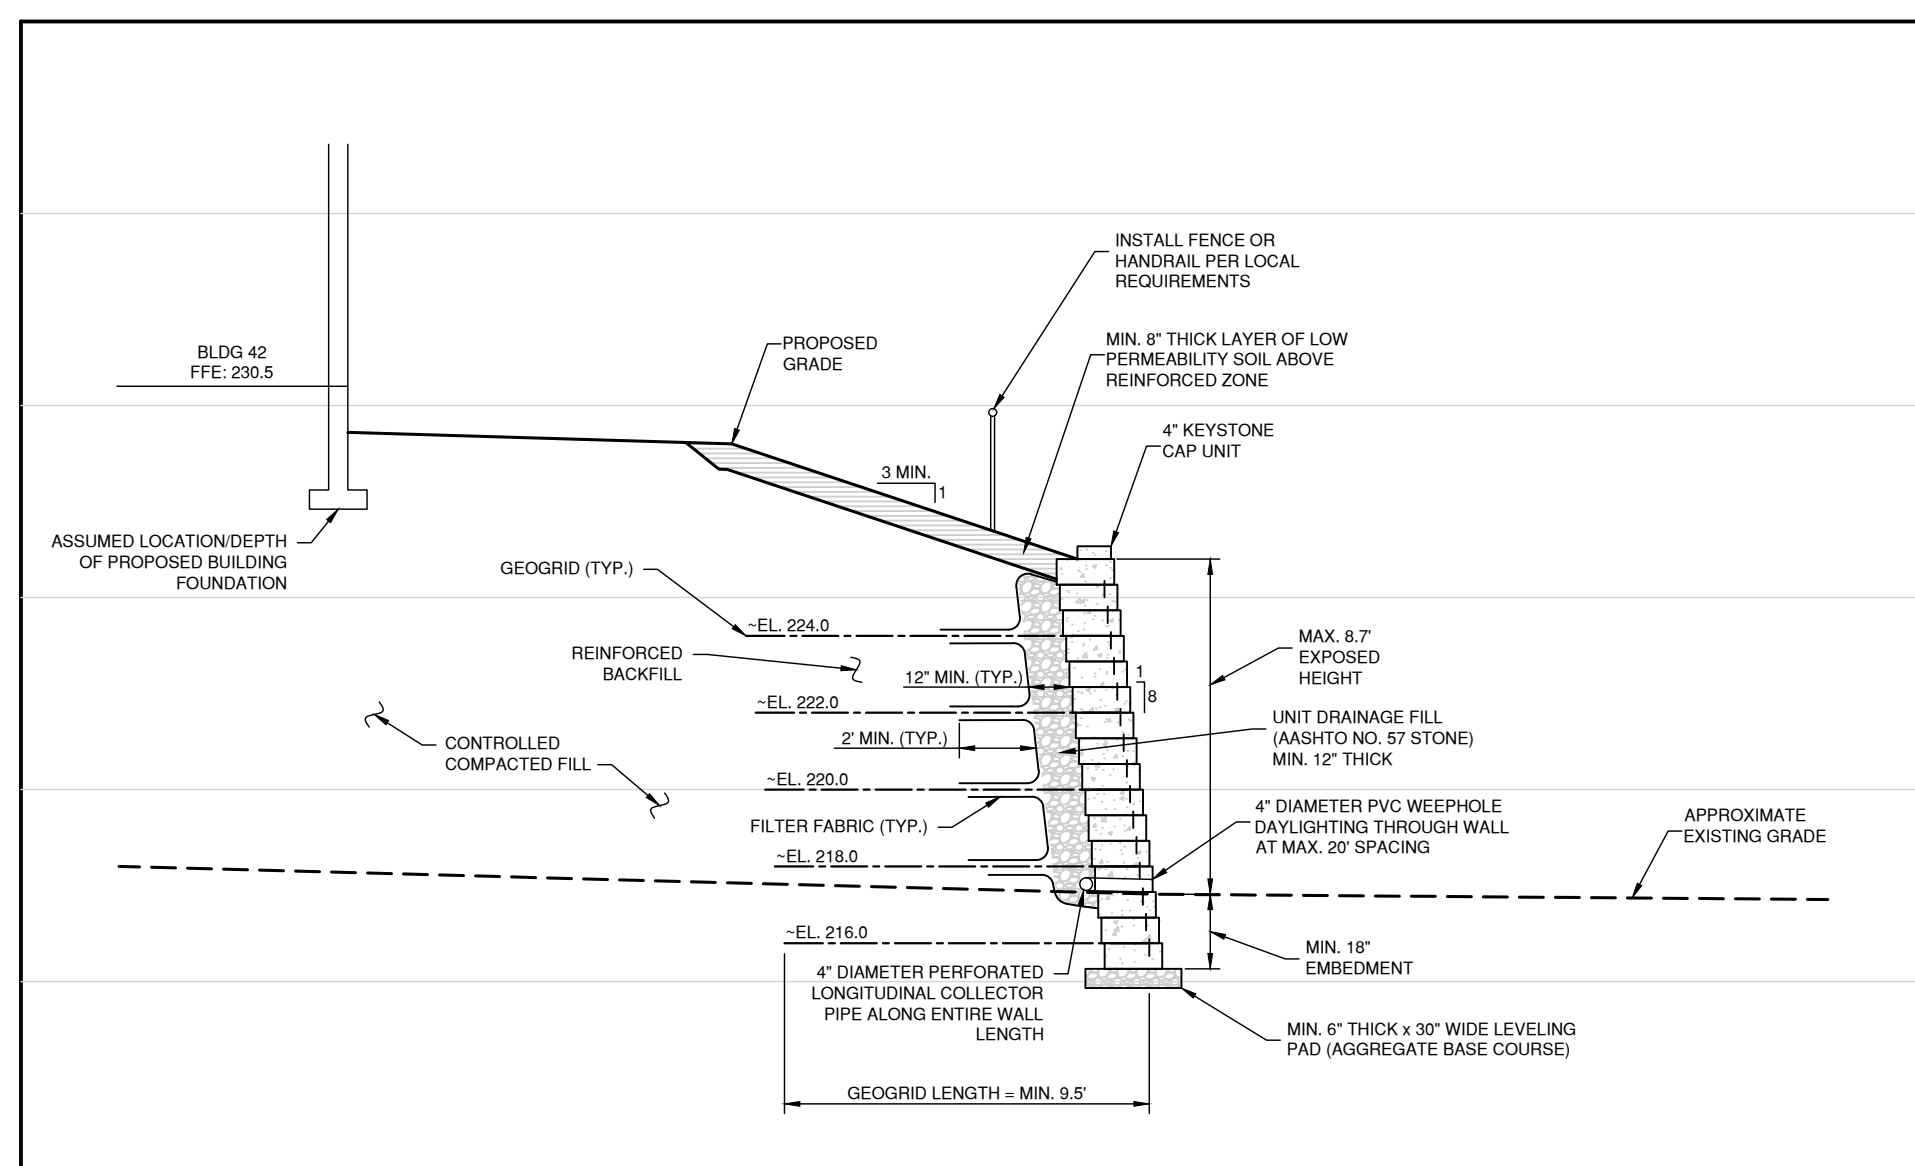


**RETAINING WALL 1 - SECTION C-C**

VERTICAL SCALE: 1" = 5"  
HORIZONTAL SCALE: 1" = 5"

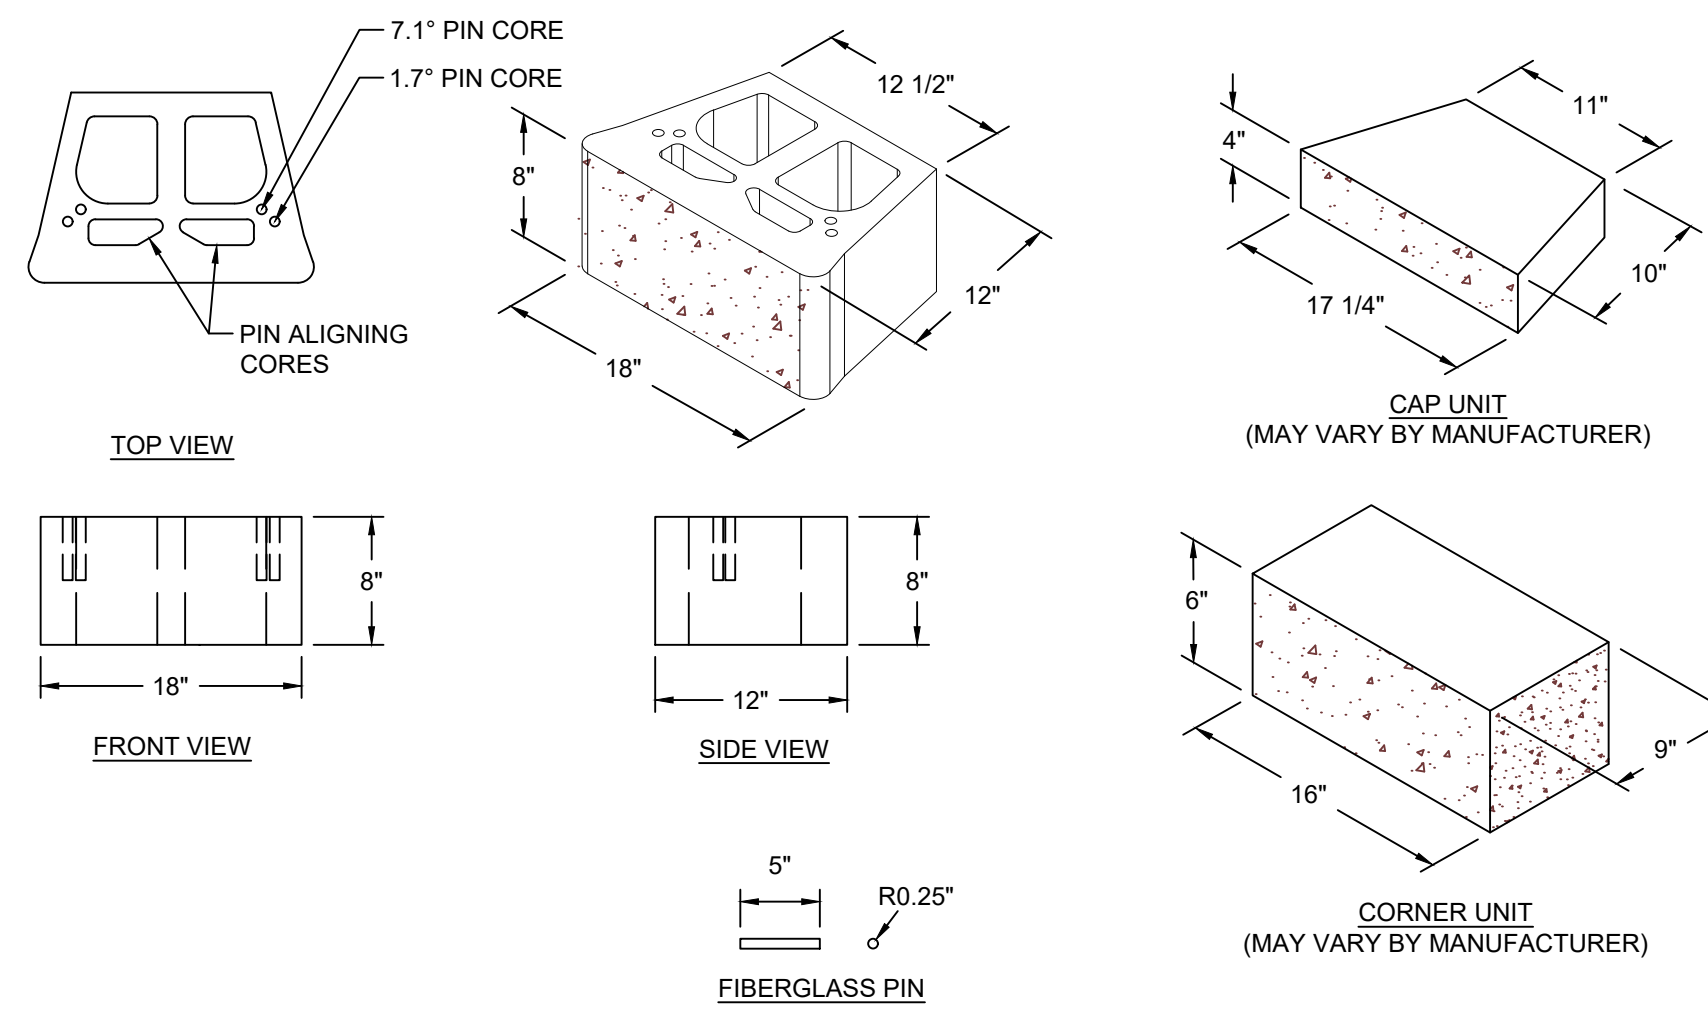


**INDIVIDUAL BLOCK DETAILS**

NOT TO SCALE

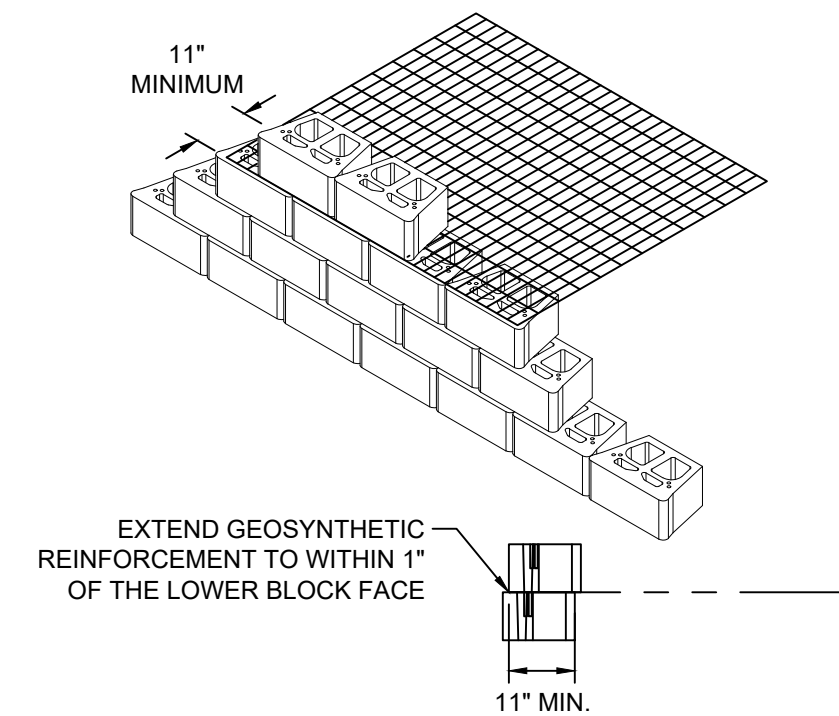


**REINFORCEMENT CONNECTION DETAIL**

NOT TO SCALE

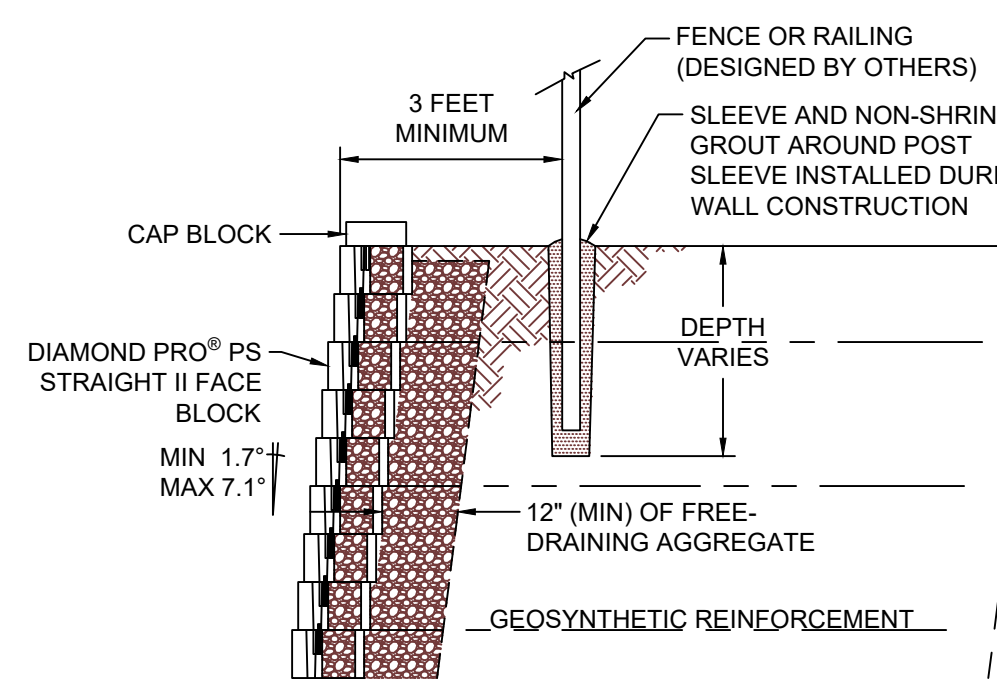

**TYPICAL FENCE/RAILING DETAIL**

NOT TO SCALE

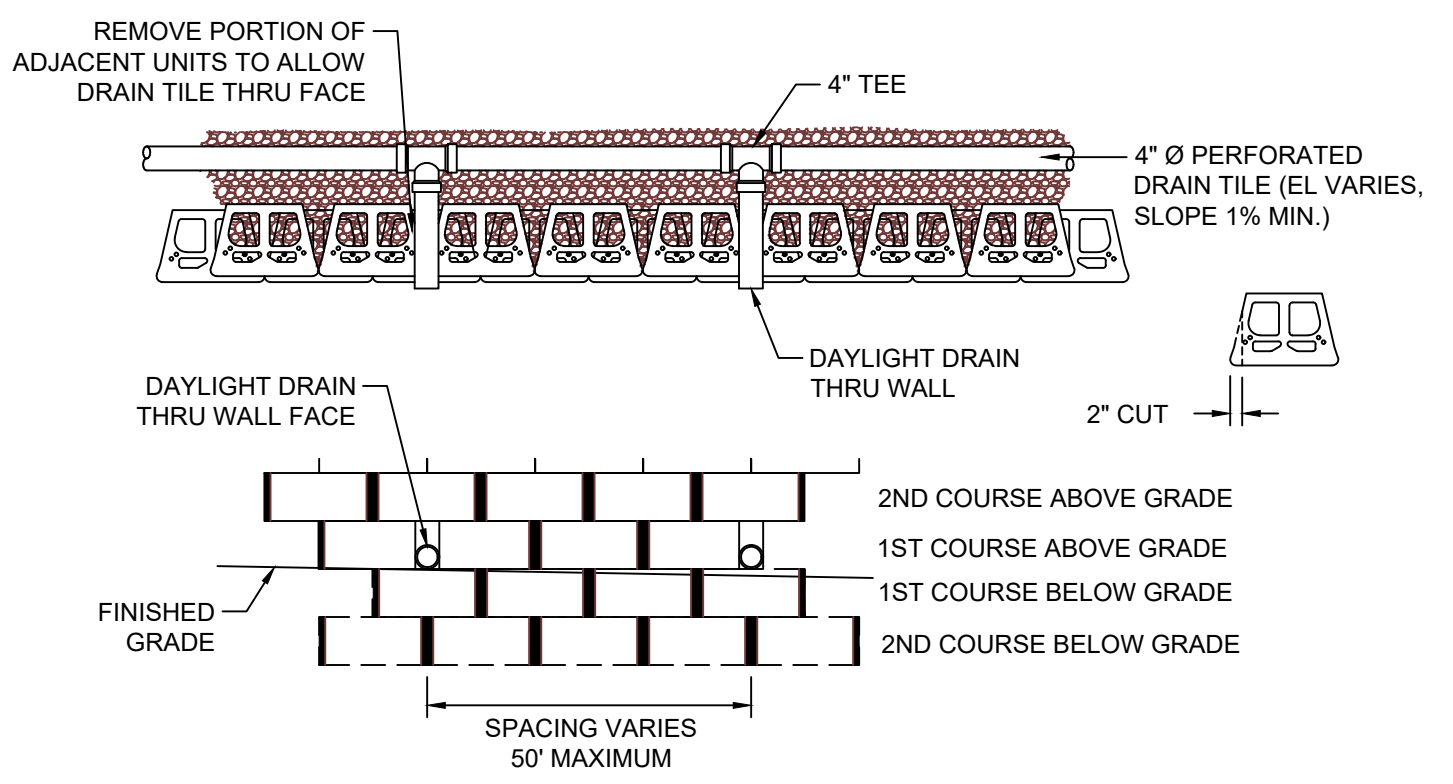


**TYPICAL DETAIL FOR DRAIN PIPE THROUGH WALL FACE**

NOT TO SCALE

FOR MORE INFORMATION CONTACT: STRATA GLOBAL SOLUTIONS 1-800-680-7750


\*FENCING SYSTEMS APPROVED FOR USE WITH SLEEVE-IT ARE LIMITED TO THE FOLLOWING HEIGHTS:

- A. CHAIN LINK UP TO 8 FEET ABOVE FINISHED GRADE WITH POST SPACING OF 8 FEET (MIN)
- B. ORNAMENTAL (STEEL, ALUMINUM, WROUGHT IRON) POST UP TO 6 FEET ABOVE GRADE WITH POST SPACING OF 10 FEET (MIN)
- C. OPEN BOARD / GAP BOARD (70% OPEN) POST UP TO 6 FEET ABOVE FINISHED GRADE WITH POST SPACING OF 6 FEET (MIN)

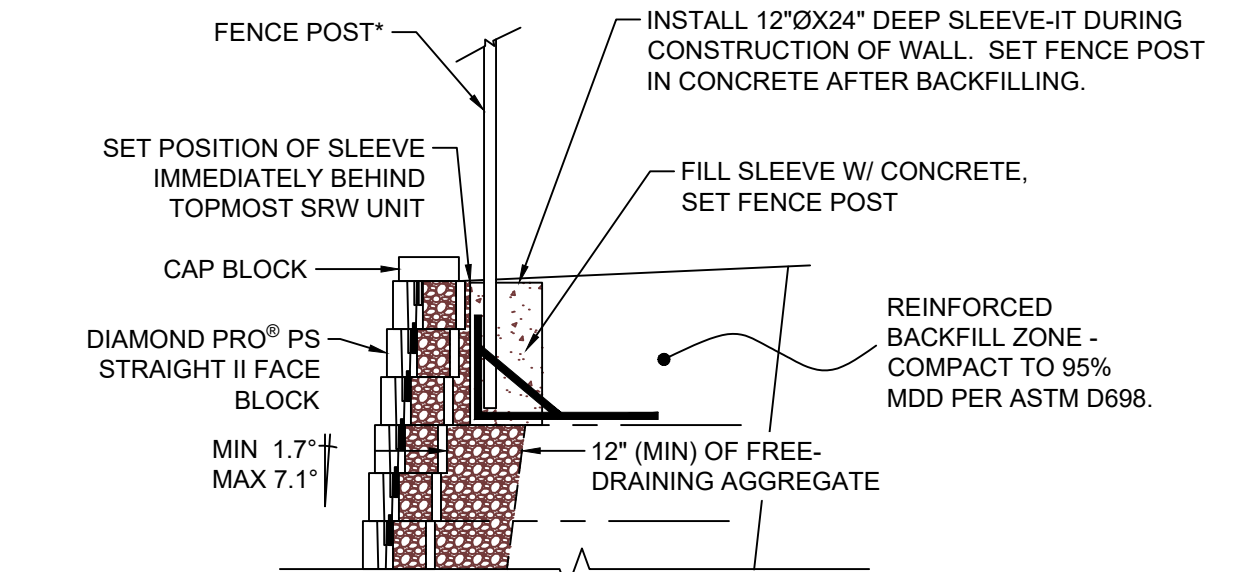


**TYPICAL FENCE/RAILING DETAIL WITH SLEEVE-IT**

NOT TO SCALE

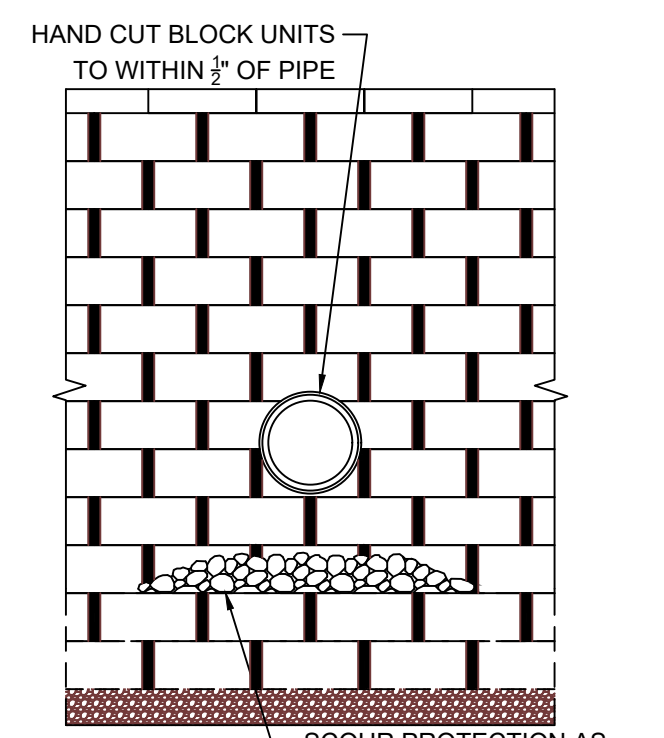


**TYPICAL DETAIL FOR SMALL UTILITIES THROUGH WALL**

NOT TO SCALE

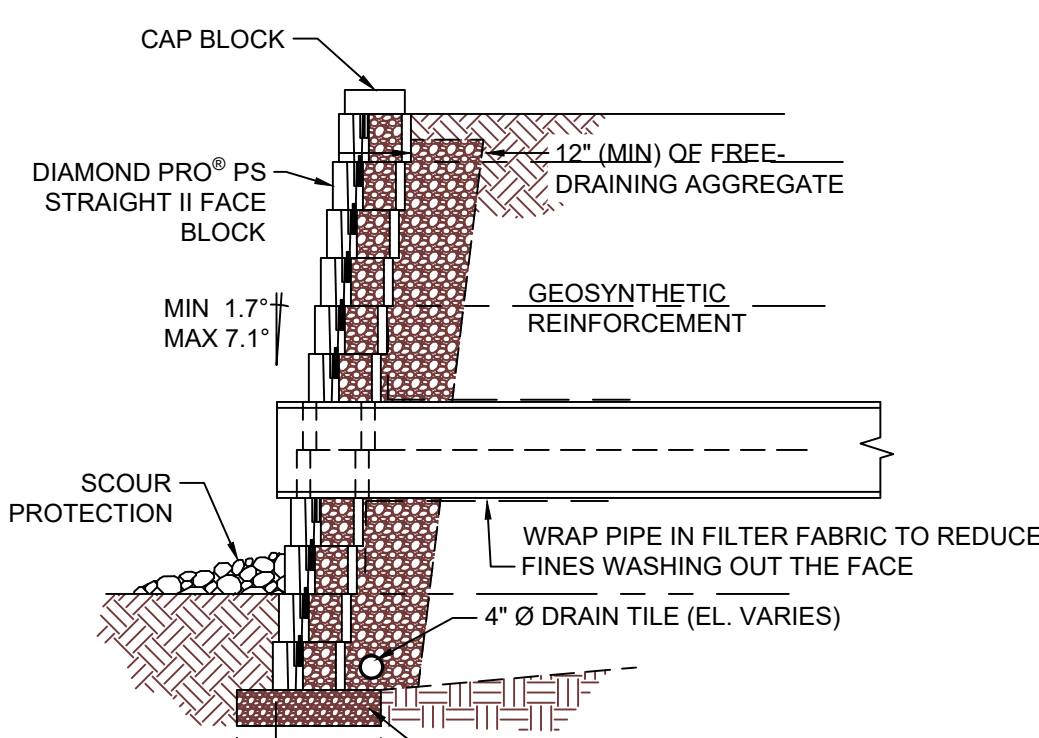

**TYPICAL DETAIL FOR LARGE UTILITIES THROUGH WALL**


NOT TO SCALE

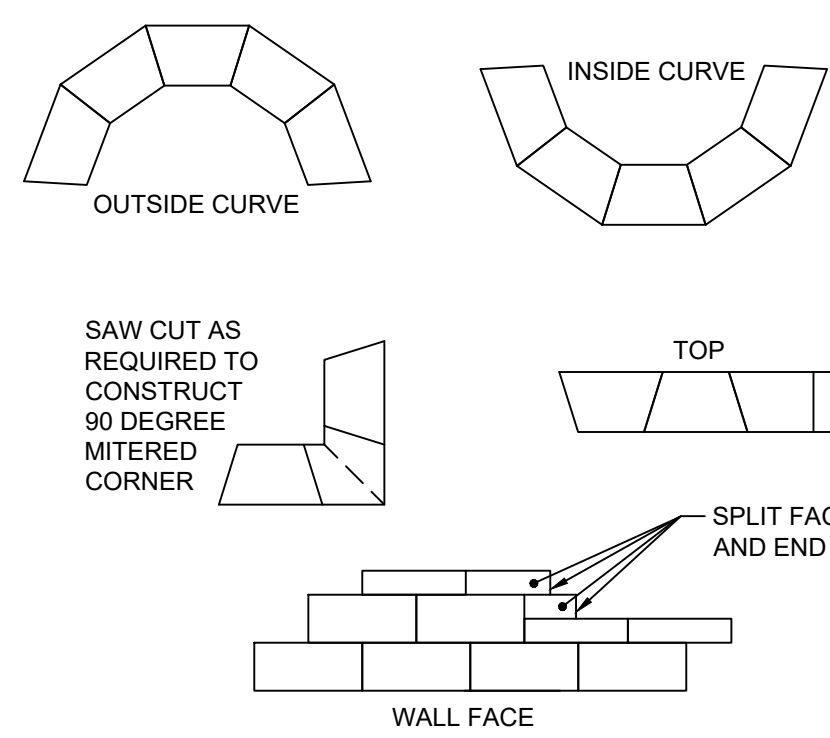

**CAPPING DETAILS**

NOT TO SCALE


1. ALWAYS START CAPPING WALL FROM THE LOWEST ELEVATION.
2. LAYOUT CAPS PRIOR TO USING ADHESIVE.
3. CUT CAPS TO FIT. VARIOUS COMBINATIONS OF LONG AND SHORT CAP FACES WILL BE NECESSARY FOR RADII GREATER THAN THE MINIMUM.
4. ALTERNATE SHORT AND LONG CAP FACES EVERY OTHER CAP TO ACHIEVE A STRAIGHT ROW OF CAPS.
5. USE EXTERIOR-GRADE CONSTRUCTION ADHESIVE TO SECURE CAPS.

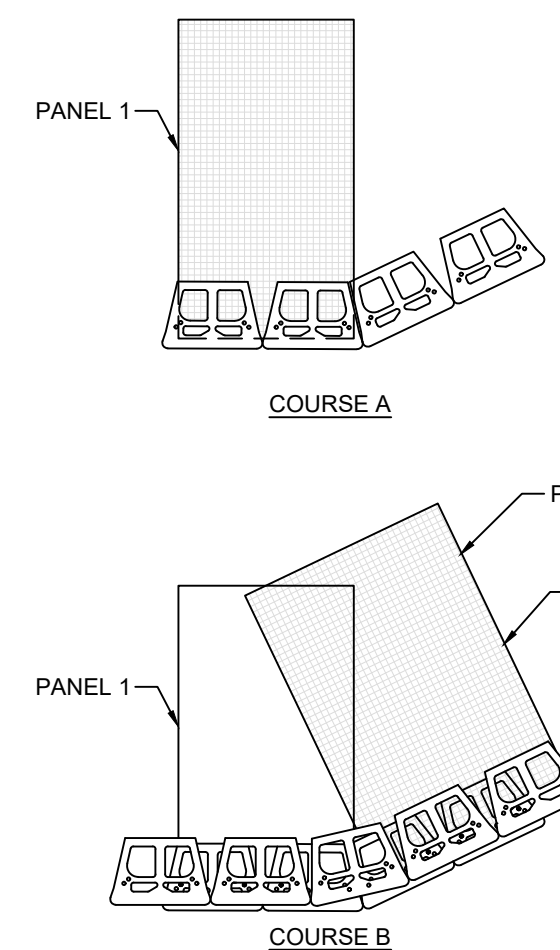

**TYPICAL DETAIL FOR OUTSIDE ANGLES**


NOT TO SCALE

- NOTES:
1. ALTERNATE COURSES "A" & "B" AS NEEDED TO FULL HEIGHT OF WALL.
  2. MODIFY UNITS AS NEEDED TO MAINTAIN RUNNING BOND.
  3. ADHERE ALL PARTIAL UNITS WITH CONSTRUCTION GRADE ADHESIVE.
  4. ADJUST PLACEMENT IN FIELD TO ACHIEVE DESIRED ANGLE.
  5. FREE-DRAINING AGGREGATE (NOT SHOWN) TO SPAN 10 FT. ALONG THE WALL FACE AND TO THE BACK OF THE REINFORCED ZONE.

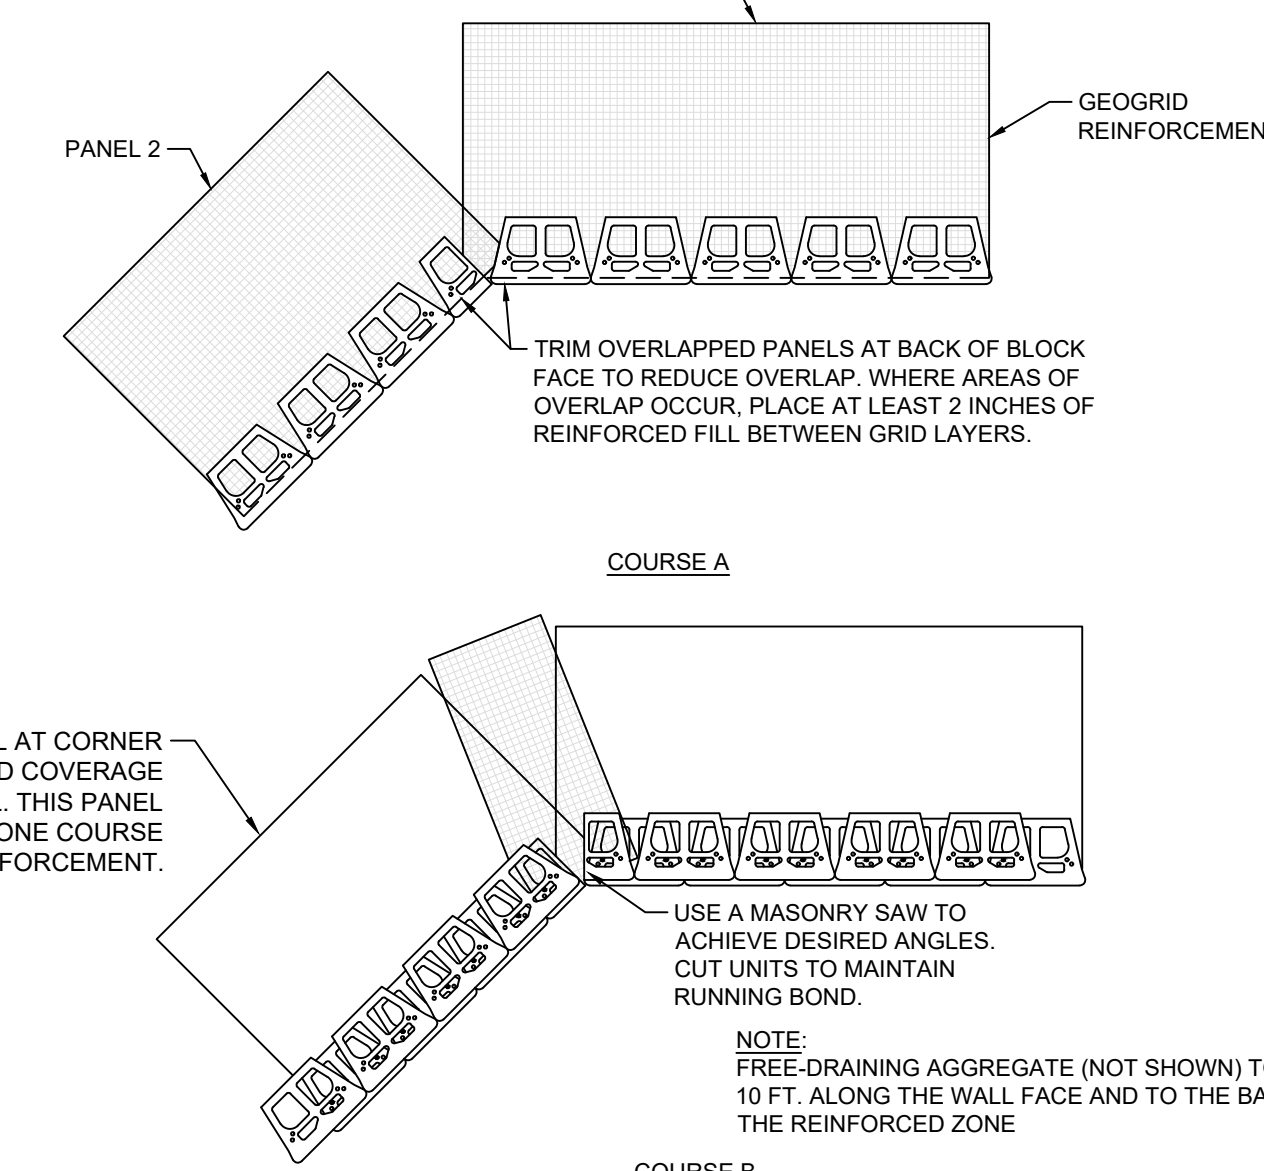

**TYPICAL DETAIL FOR INSIDE ANGLES**

NOT TO SCALE

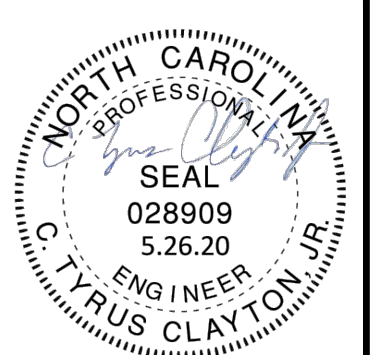

**Draper Aden Associates**  
Engineering • Surveying • Environmental Services

- Hampton Roads, VA
- Fayetteville, NC
- Northern Virginia
- Charlottesville, VA
- Virginia Beach, VA
- Richmond, VA
- Blacksburg, VA



**RETAINING WALL 1 - TYPICAL SECTIONS AND DETAILS**  
**CAMPBELL POINTE TOWNHOMES PH 6**  
HARRETT COUNTY, NORTH CAROLINA

**REVISIONS**

- 1/8/2020: RE-DESIGN FOR ANCHOR DIAMOND PRO PS BLOCK UNITS.
- 5/27/2020: RE-DESIGN FOR LAYOUT CHANGES.

DESIGNED BY: FDP  
DRAWN BY: FDP  
CHECKED BY: CTC Jr  
SCALE: (AS SHOWN)  
DATE: 09/03/2019  
PROJECT NUMBER: R14245N-08

RELEASED FOR PERMITTING AND CONSTRUCTION

**RW3**