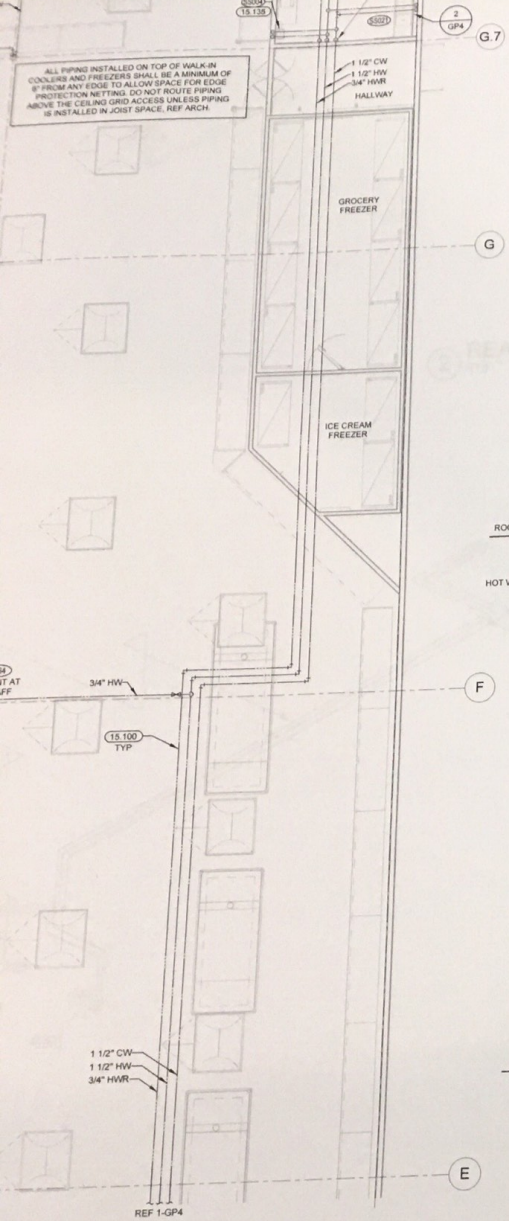

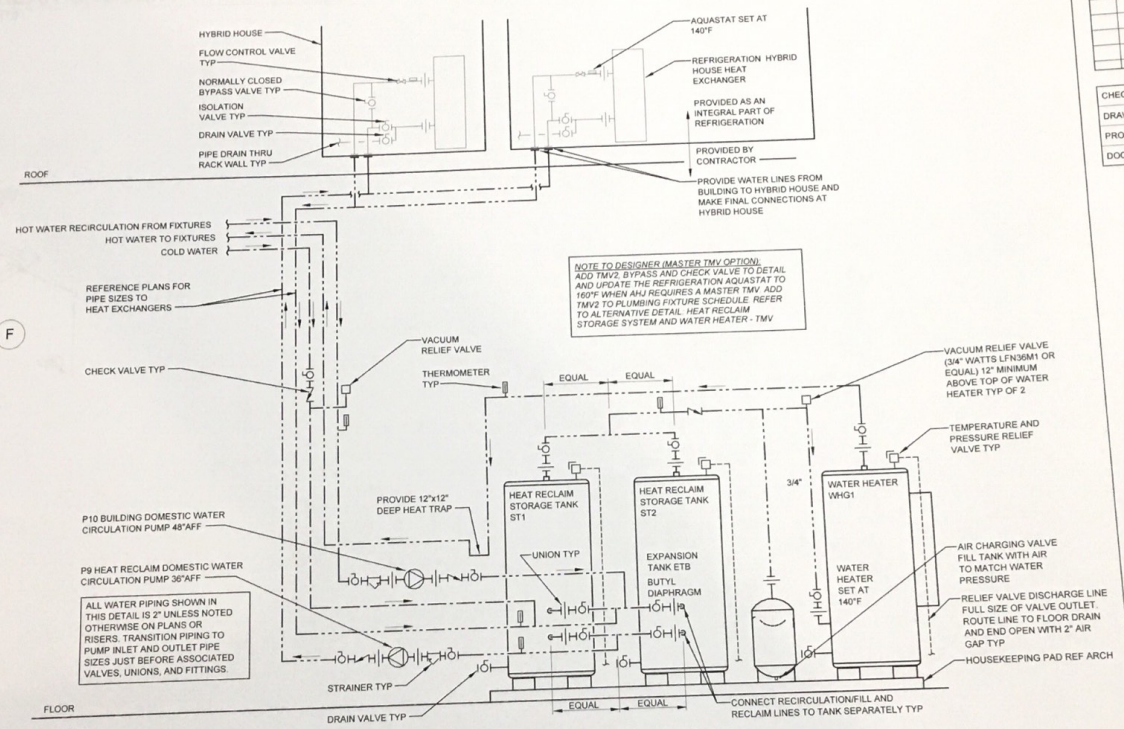

NOTES:

1. ALL EQUIPMENT, PIPING, VALVES, INSULATION, AND HEAT TAPE INSIDE THE HYBRID HOUSE ARE PROVIDED BY THE HYBRID HOUSE MANUFACTURER.
2. PLUMBING CONTRACTOR SHALL PROVIDE INSULATION AND HEAT TAPE ON ALL WATER PIPING FROM THE HYBRID HOUSE TO 12" BELOW THE ROOF.
3. ALL HEAT TAPE IS TO BE HARD WIRED TO A DEDICATED CIRCUIT IN THE HYBRID HOUSE. FINAL CONNECTIONS BY REFRIGERATION CONTRACTOR.
4. PLUMBING CONTRACTOR SHALL SET FLOW CONTROL VALVES IN THE HYBRID HOUSE TO GPM NOTED ON REFRIGERATION SCHEDULES. PROVIDE A PERMANENT LABEL OF THE GPM SETTING ON VALVE.

2 HEAT RECLAIM STORAGE SYSTEM AND WATER HEATER

NTS

Walmart

SPOUT SPRI

STORE NO. 66

22-13-2306

JOB NUMBER:

ISSUE BLOCK

CHECKED BY:	JKR
DRAWN BY:	CDRW
PROTO CYCLE:	04/24/15
DOCUMENT DATE:	07/03/15

NORTH CAROLINA PROFESSIONAL SEAL 030048 ENGINEER RYAN S. RAY

HARRISON, FRENCH AND ASSOCIATES, PLLC P-0402

JUL 09 2015

REAR GROCERY WATER PLAN AND DETAILS

SHEET: GP5