

HTE# _____

Harnett County Department of Public Health

No. 26407

PERMIT # BCOM 2103-0008

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 5545 Ray Rd (SR 1121)

Name: (owner) Rhetson Companies (Dollar General) SUBDIVISION _____ LOT # _____

System Installer: Eddie Garner Registration # _____


Basement with plumbing: Garage Number of Bedrooms 240 GPD

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Type III B Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

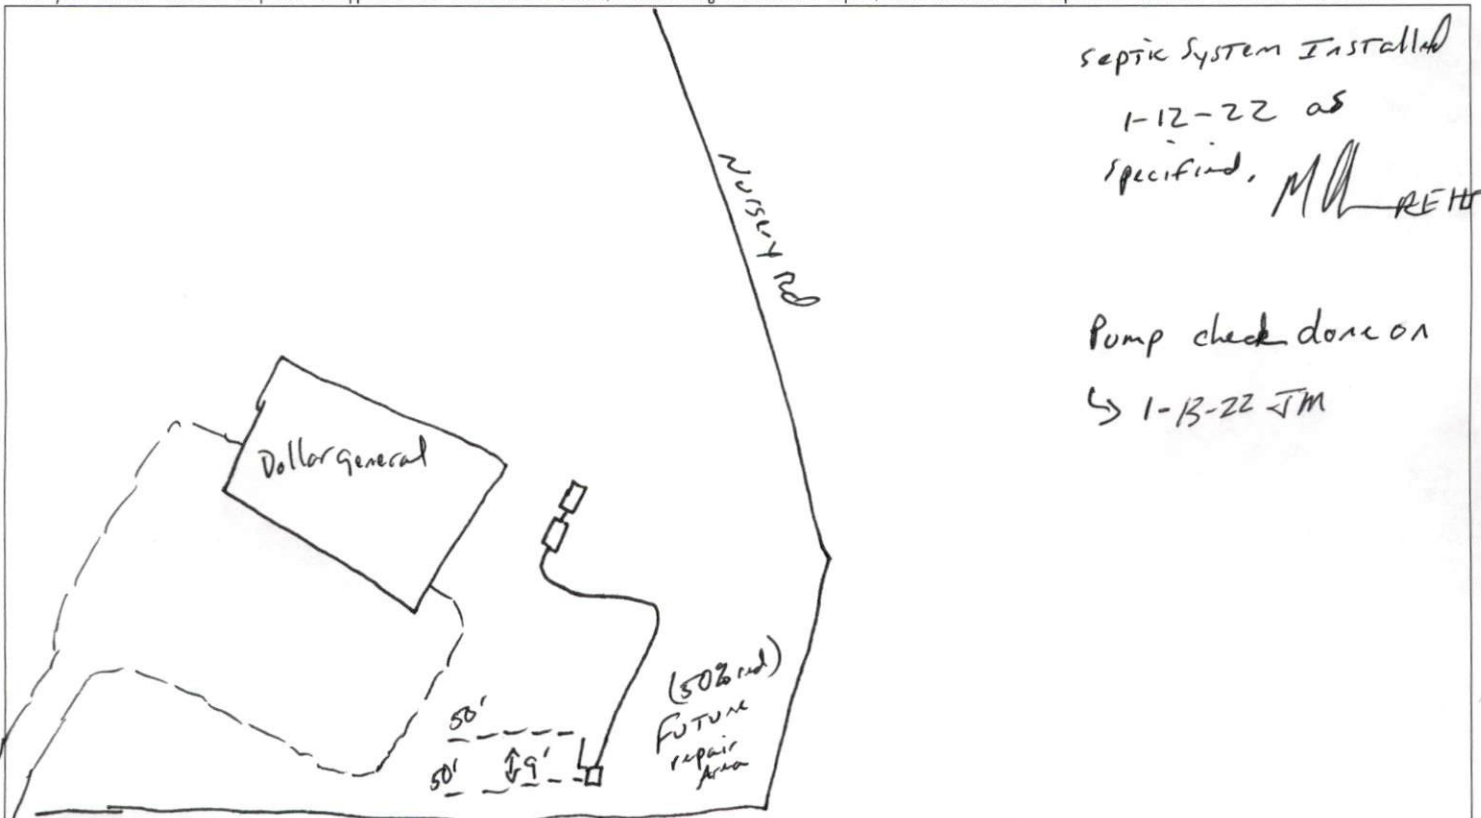

septic system installed
1-12-22 as
specified, M. A. RETH

Pump check done on
1-13-22 JIM

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 50% reduction PPB Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field: No. of ditches 2 exact length of each ditch 50 feet width of ditches 3 feet depth of ditches 14" inches

French Drain Required: _____ Linear feet

Authorized State Agent

James E. Markham JEM REAS

Date 1-14-22