

Harnett County Department of Public Health

Operation Permit

PERMIT # BCOM2104-0004

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 148 JALCO DRIVE (US 401 N.)

Name: (owner) NATURAL STONE DESIGN TRIANGLE HOME PROS SUBDIVISION TRI SOUTH INDUSTRIAL PARK LOT # 2


System Installer: ADLOCK ESCAPING

Basement with plumbing: Garage Number of Bedrooms NA Distance from well NA feet 500 GPD MAX
 Type of Water Supply: Community Public Well 10 EMPLOYEE MAX + 2,094 FE²

System Type: 25% REDUCTION SYSTEM IIIg Types V and VI Systems expire in 5 years. RETAIL SPACE

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

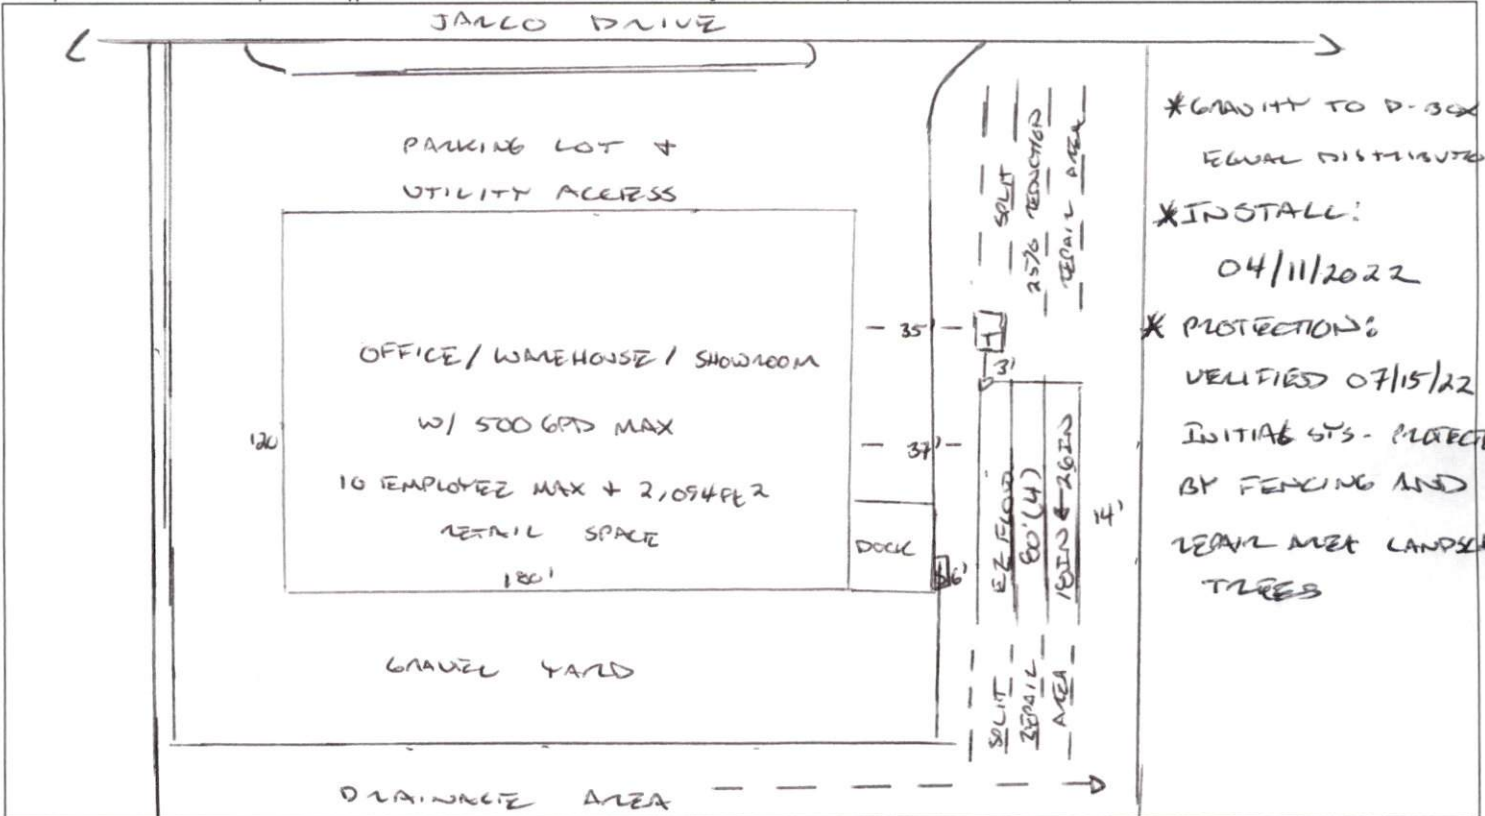

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961. LANDSCAPING BUFFER
- III. Maintenance: As required by Rule .1961. Other:
 Subsurface system operator required? Yes No
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZ FLOW IIIg Septic Tank: 1250 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 4 of each ditch 80 feet ditches 3 feet ditches 26 → 18 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 07/16/2022