

Harnett County Department of Public Health

Improvement Permit

A building permit cannot be issued with only an Improvement Permit

PROPERTY LOCATION: 1267 Stewart Road (SR 1810)

ISSUED TO: Rock Solid Farm LLC SUBDIVISION _____ LOT # _____

NEW REPAIR EXPANSION Site Improvements required prior to Construction Authorization Issuance: _____

Type of Structure: Farm Barn 50'x120'

Proposed Wastewater System Type: 25% Reduction Sys.

Projected Daily Flow: 250 (Max) GPD

Number of bedrooms: NA Number of Occupants: NA max


Basement Yes No

Pump Required: Yes No May be required based on final location and elevations of facilities

Type of Water Supply: Community Public Well Distance from well 50+ feet

Permit valid for: Five years No expiration

Permit conditions: _____

Authorized State Agent:  Date: 03/15/2022 SEE ATTACHED SITE SKETCH

The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: Rock Solid Farm LLC PROPERTY LOCATION: 1267 Stewart Road (SR 1810)

SUBDIVISION _____ LOT # _____

Facility Type: Farm Barn 50'x120' New Expansion Repair

Basement? Yes No Basement Fixtures? Yes No

Type of Wastewater System** 25% Reduction System (Initial) Wastewater Flow: 250 (Max) GPD

(See note below, if applicable 25% Reduction System (Repair))

Installation Requirements/Conditions Septic Tank Size <u>1000</u> gallons Pump Tank Size _____ gallons	Number of trenches <u>2</u> Exact length of each trench <u>100</u> feet Trenches shall be installed on contour at a Maximum Trench Depth of: <u>24</u> inches (Trench bottoms shall be level to +/-1/4" in all directions)	Trench Spacing: <u>9</u> Feet on Center Soil Cover: <u>12</u> inches (Maximum soil cover shall not exceed 36" above the trench bottom)
---	---	--

Pump Requirements: _____ ft. TDH vs. _____ GPM

Aggregate Depth: NA inches below pipe
NA inches above pipe
NA inches total

Conditions: Gravity to D-Box Equal Distribution

**WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA.
 NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.**

****If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.**

Owner/Legal Representative Signature: _____ Date: _____

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH

Authorized State Agent:  Date: 03/15/2022
ANDREW CURRAN Construction Authorization Expiration Date: 03/15/2027

Harnett County Department of Public Health Site Sketch

Property Location: 1267 Stewart Road (SR 1810)

Issued To: Rock Solid Farm LLC

Subdivision _____


Lot # _____

Authorized State Agent: _____

Andrew Collins
ANDREW COLLINS

Date: 03/15/2022

NON-RESIDENTIAL FARM-USE BUILDING ONLY - 250 GPD MAX

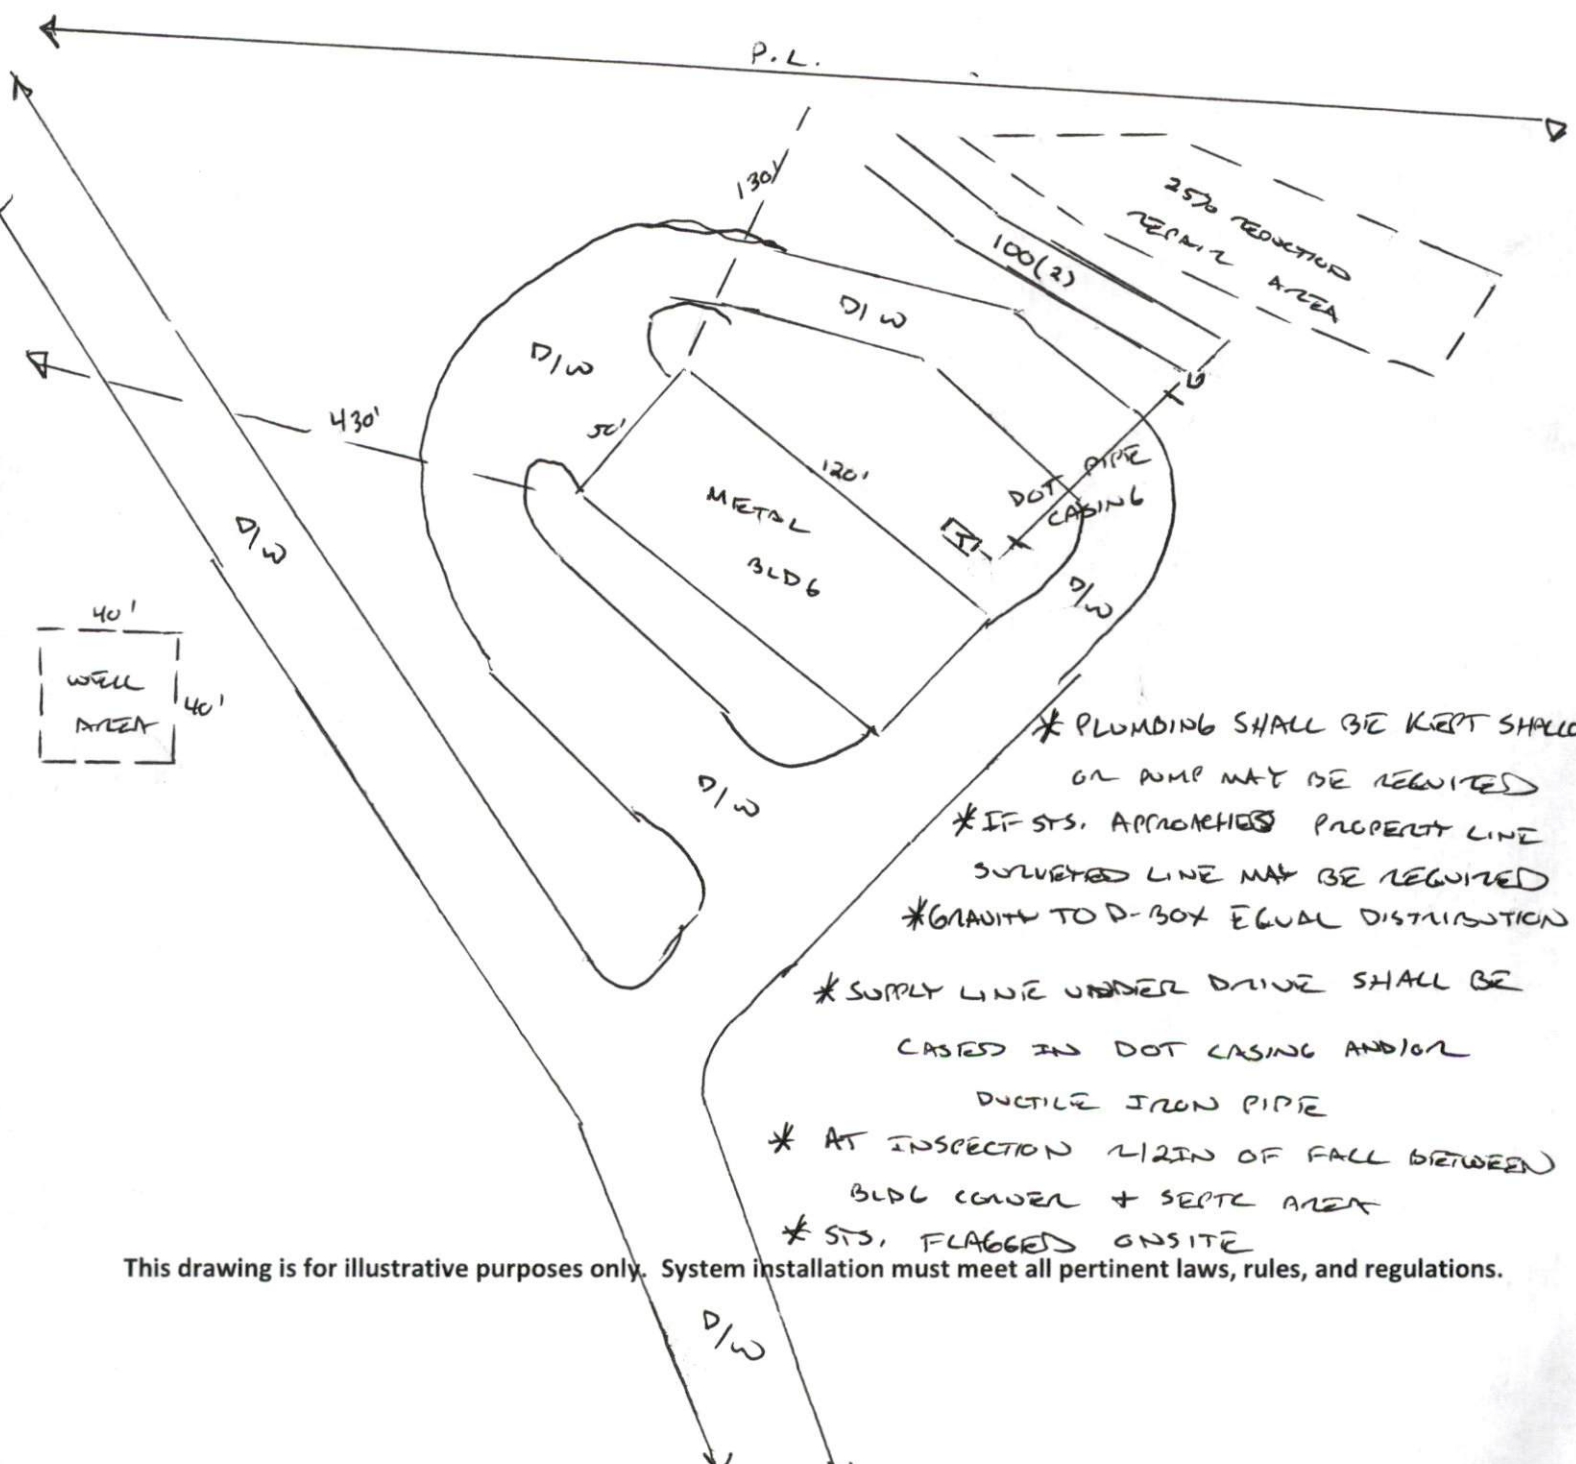

- * PLUMBING SHALL BE KEPT SHALLOW OR PUMP MAY BE REQUIRED
- * IF SYS. APPROACHES PROPERTY LINE SURVEYED LINE MAY BE REQUIRED
- * GRAVITY TO D-BOX EQUAL DISTRIBUTION
- * SUPPLY LINE UNDER DRIVE SHALL BE CASIED IN DOT CASING AND/OR DUCTILE IRON PIPE
- * AT INSPECTION 2" MIN OF FALL BETWEEN BLDG COVER + SEPTIC AREA
- * SYS. FLAGGED ONSITE

This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.