

8755 NC. 42

Brad Sutton

COMMERCIAL
BUILDING REVIEW

- ✓ 1. Need post spacing shown for deck and roof.
- ✓ 2. Need beam size shown for deck and roof.
- ✓ 3. Need floor joist size and spacing for deck and decking type
- ✓ 4. Roof must have ceiling joists in lower 1/3 of rafter span, or engineered trusses must be used. If using trusses, supply layout for truss supplier.


5/15/2023 2:46:37 PM

2 X 10 BEAM RAFTER

2 X 6 RAFTER

2 X 6 CEILING JOIST

6" O.C. RAFTERS

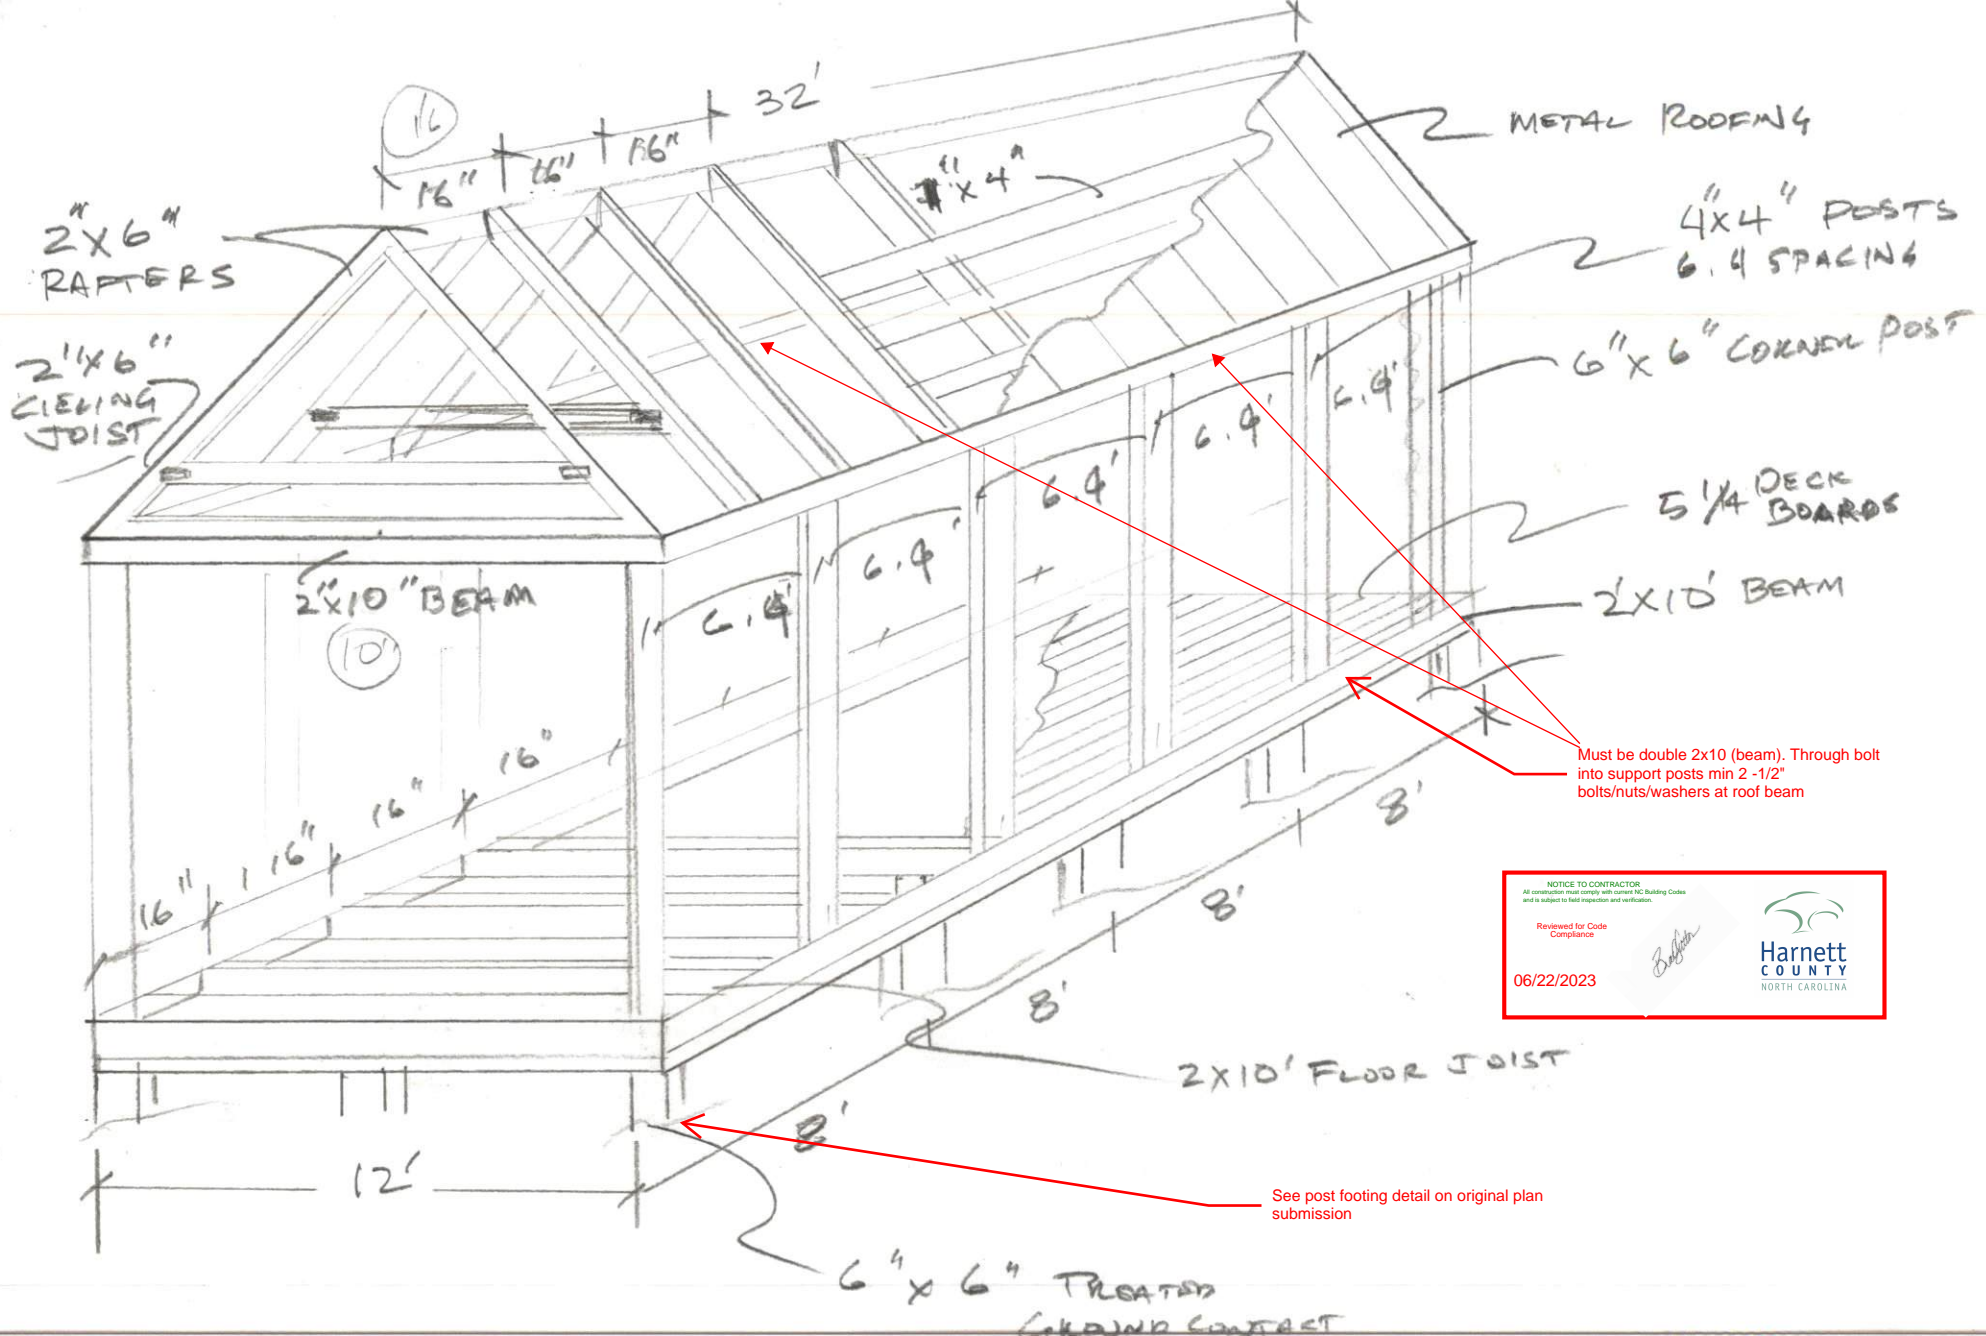

NOTICE TO CONTRACTOR
 All construction must comply with current NC Building Codes and is subject to field inspection and verification.
 Reviewed for Code Compliance
 06/22/2023



KIDD'S PLACE SHELTER

- ALL LUMBER TREATED

NOT TO SCALE