

OPERATIONS PERMIT


Name: (owner) Becker Minerals New Installation Septic Tank
 Property Location: SR# 210 Repairs Nitrification Line
 Subdivision - Lot # _____
 TAX ID# - Quadrant # _____
 Contractor: Ott's Truckload Registration # _____
 Basement with Plumbing: Garage:
 Water Supply: Well Public Community
 Distance From Well: 50 ft. +

Following are the specifications for the sewage disposal system on above captioned property.

Type of system: Conventional Other Pump to cover line
 Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons
 Subsurface Drainage Field No. of ditches 2 exact length of each ditch 110 ft. width of ditches 3 ft. depth of ditches 24 in.
 French Drain: _____ Linear feet

Date: 07-21-97
 Inspected by: [Signature]
 Environmental Health Specialist

PERMIT NO. 12383

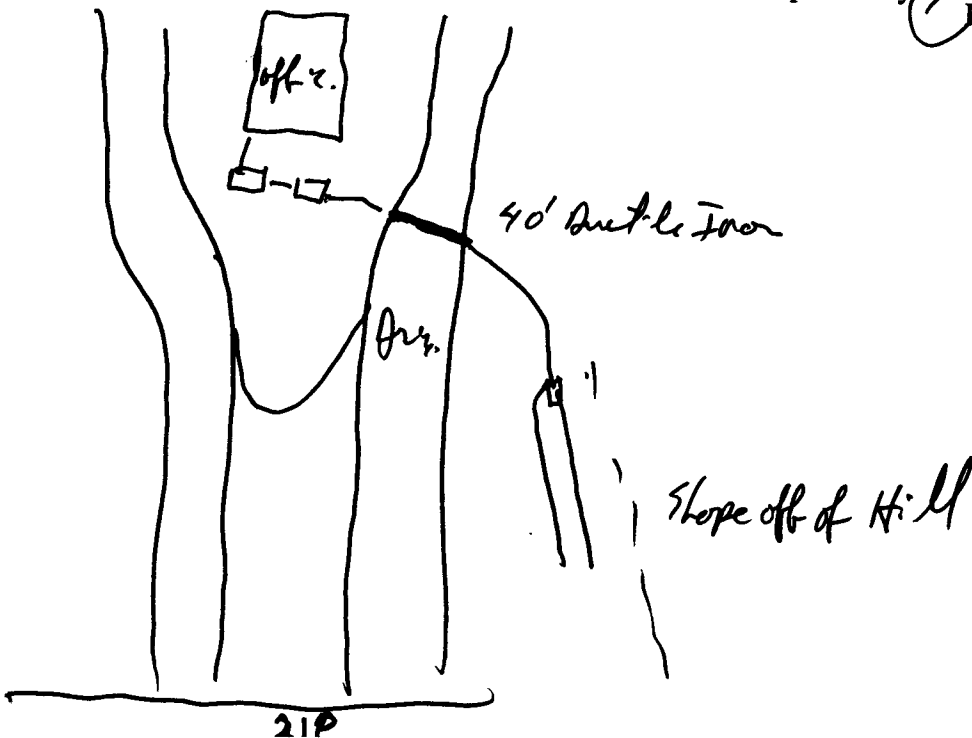

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Becker Minerals New Installation Septic Tank
 Property Location: SR# 210 Repairs Nitrification Line

Subdivision _____ Lot # _____

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: Office 4 employees 100sqft Lot Size: 103ac

Basement with Plumbing: Garage:

Water Supply: Well Public Community

Distance From Well: 50r ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other Pump to conventional lines

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons


Subsurface Drainage Field No. of ditches 1 exact length of each ditch 110 ft. width of ditches 3 ft. depth of ditches 24 in.

French Drain Required: _____ Linear feet

Date: 5-21-97

Signed: Thomas J. Boyer R.S.
 Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

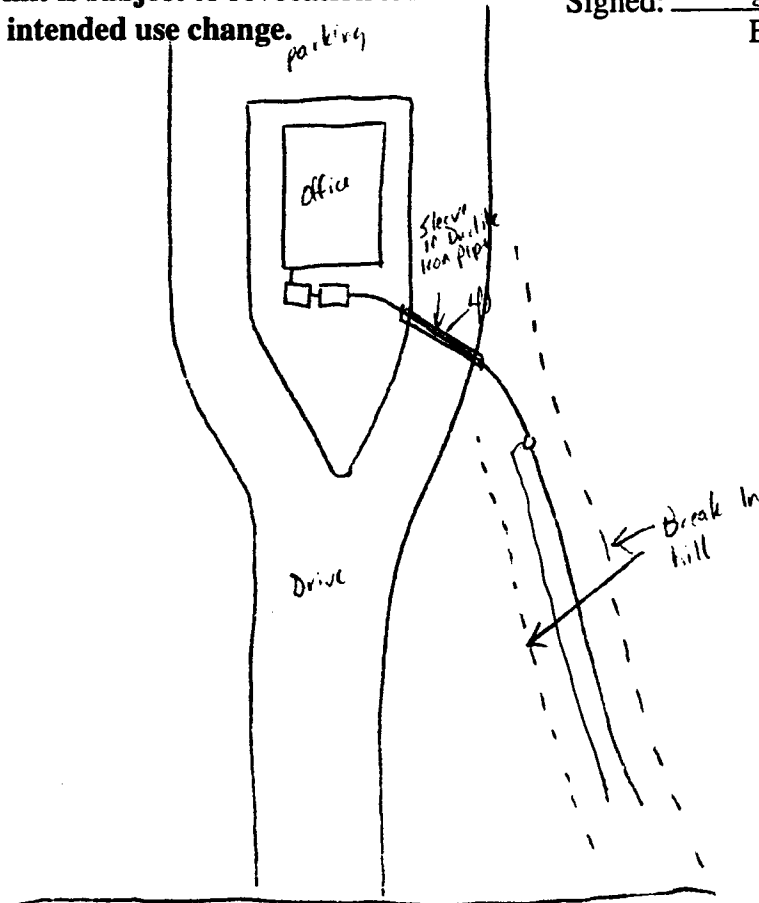

Maintain Setbacks
 Contractor to meet on site
 prior to installing
 Supply line must be at least
 36" deep and sleeved in
 ductile iron pipe
 Final layout may change
 D-Box may be on other end

H-117 210