

ANSUL R-102 DETAILS

- DETECTOR TEMP PER ANSUL MANUAL PAGE 3-11 REV 11, 4-71 TO 4-72 REV 11
- ALL PIPING 3/8" SCH. 40 BLACK STEEL PER ANSUL MANUAL PAGE 4-67 TO 4-69, REV 11
- ALL FITTINGS 3/8" 150# BLACK STEEL PER ANSUL MANUAL PAGE 4-67 TO 4-69, REV 11
- ALL NOZZLES POSITIONED PER ANSUL MANUAL, SECTION 4
- PULL STATION IN AISLE OF EGRESS
- ELECTRIC APPLIANCES W/ SHUT-OFF
- MICRO SWITCH FOR SHUT DOWNS & ALARM TIE IN

CERTIFICATE OF TRAINING

Johnson Controls

It is hereby certified that

Michael Edwards

BFPE INTERNATIONAL-CLAYTON

has successfully completed the training course for

ANSUL R-102 Restaurant Fire Suppression Systems - Online Recertification

Completed On 9/9/2022

This certificate is considered valid for a period of three years from completion date and linked to the attendee and the company mentioned above.

Training Hours:

ANSUL


Matt Boyle
Technical Training Manager - Fire Suppression

ANSUL R-102 3 GALLON UL 300

11 FLOW POINTS AVAILABLE
10 FLOW POINTS UTILIZED

APPLIANCE FLOW POINT TOTAL: 6
DUCT FLOW POINT TOTAL: 2
PLENUM FLOW POINT TOTAL: 2

SYSTEM FLOW POINT TOTAL: 10

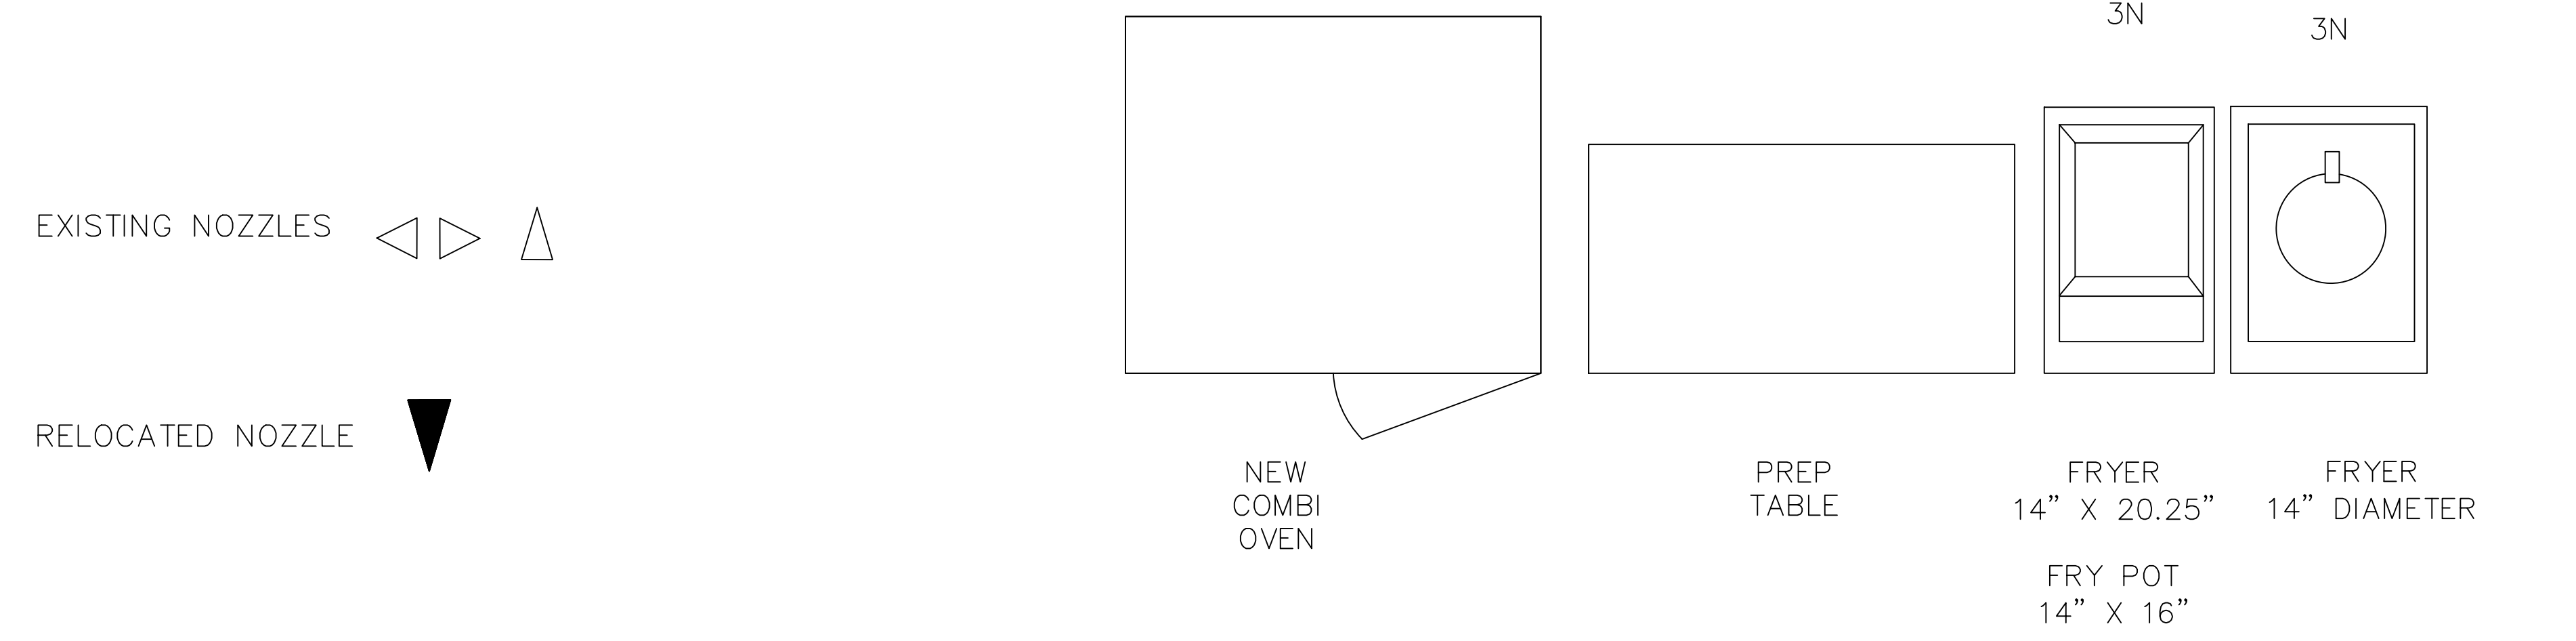

DATE	
BY	
REVISION	
MARK	

Seal

Pre-engineered Fire System Seal Not Required

SHOP DRAWINGS

BFPE INTERNATIONAL
FIRE SAFETY & SECURITY
1115 WESTWOOD DRIVE
CLAYTON, NORTH CAROLINA 27020
(919) 350-1000

DRAWN BY: MWE

CHECKED BY:

SCALE: N.T.S.

SHEET NO. 1 OF 1 SHEETS

DATE: February 23, 2024

PROJECT NO: N/A

Sheet Contents:
Delic Fire Suppression System

Food Lion #2594
3260 Ray Road
Spring Lake, NC 28390

DRAWING NO. :
FS100