


- ① DECKING 3"x16" @ 20GA
- ② PERIMETER GUTTER 7.250" x 7" x 4.250" with 1" lips @20GA
- ③ FASCIA TRIM 1.5" x 8" L Shape .040 Alum
- ④ 3mm ACM PANEL 36" to 45" tall
- ⑤ TOP FASCIA SUPPORT 1.5" x 1.750" L Shape .040 Alum
- ⑥ HAT SECTION .875 (25GA) @ 12" Sections
- ⑦ UPRIGHT BRACE (35.5" hat channel) 1.5" @ 24GA (32" on center)
- ⑧ ANGLE BRACE .875 (25GA) @ 4" (32" on center)
- ⑨ BOTTOM CHANNEL BRACE (16" hat channel) 1.5" @ 24GA (32" on center)
- ⑩ DOUBLE SIDED TAPE
- ⑪ 8x3/4 Hex Screw
- ⑫ 12x1 Hex Screw With Washer

FASCIA DETAIL

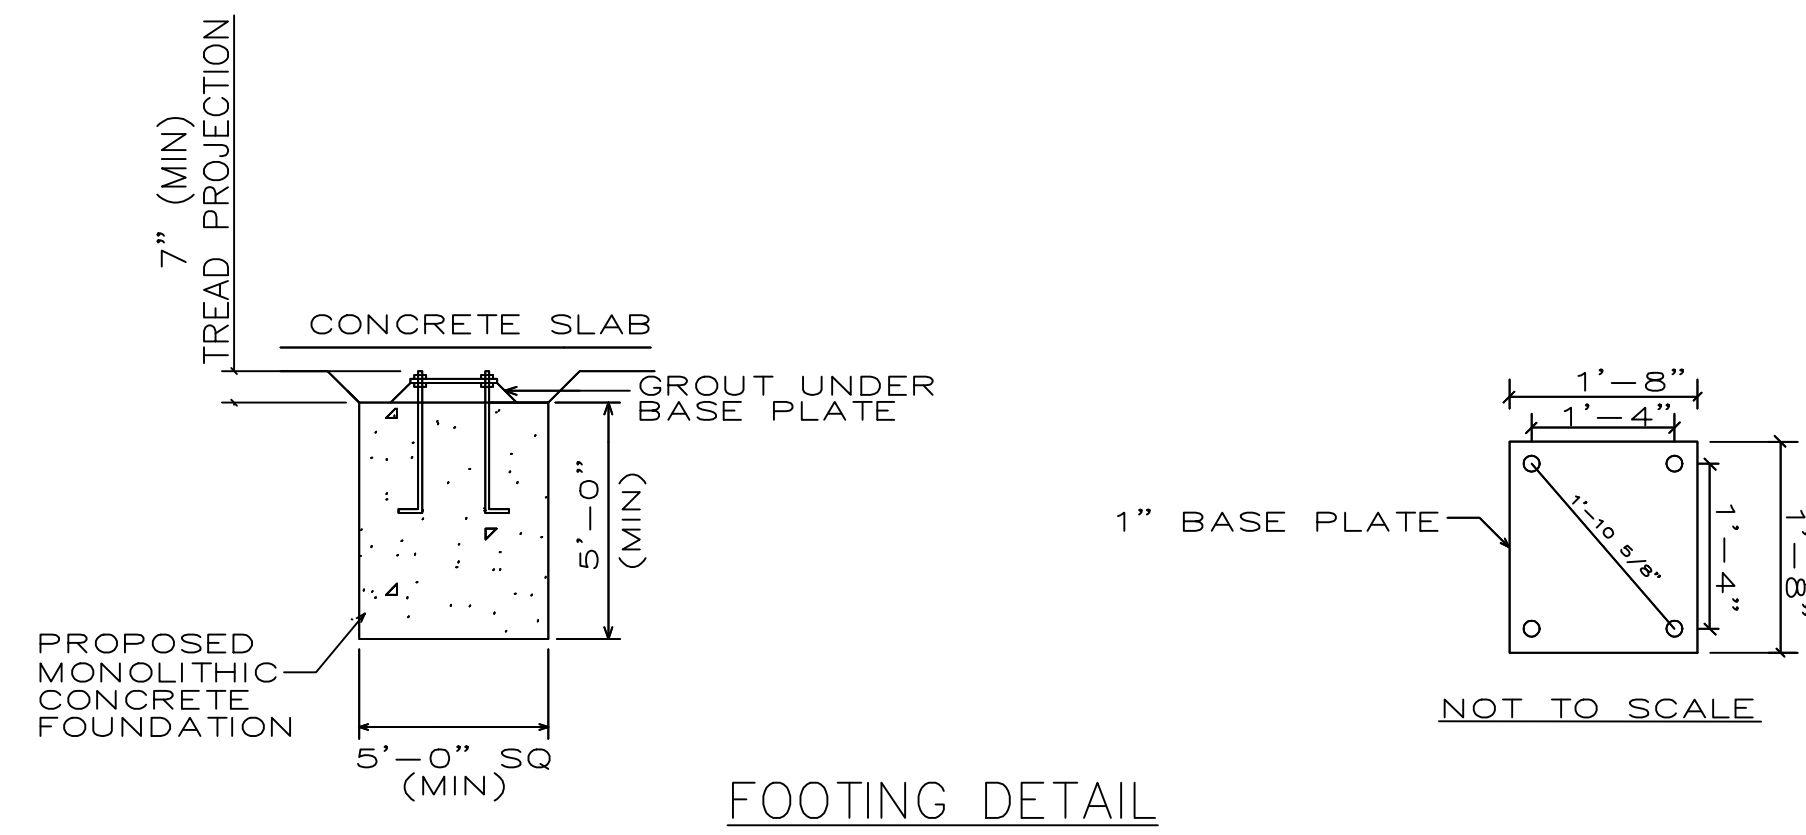

FOUNDATION NOTES

1. FOUNDATION DESIGN IS BASED ON PRESUMPTIVE LOAD BEARING VALUES PROVIDED IN THE INTERNATIONAL BUILDING CODE, TABLE 1806.2. AN ASSUMED ALLOWABLE SOIL BEARING PRESSURE OF 2000 PSF AND A LATERAL BEARING PRESSURE OF 100 PSF/FT WAS USED FOR DESIGN.
2. 1 1/4" Ø x 34" LG. A-307 GR. A ANCHOR BOLTS W/ HEAVY HEX NUT AND 7" (MIN) THRD. PROJECTION WITH DOUBLE NUTS FOR PLUMBING AND LEVELING TO BE USED. 27" CONCRETE EMBEDMENT (MIN) TO BE PROVIDED.
3. ANCHOR BOLT PATTERN IS TO BE 16" ON CENTER.
4. IF FILL IS USED IT SHALL BE GRANULAR, STRUCTURAL FILL COMPACTED TO TO 100% MODIFIED PROCTOR.

CODE SPECIFICATIONS

I.B.C. INTERNATIONAL BUILDING CODE (2018 EDITION) / 2018 NCBC
 ASCE 7-16 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES
 ANSI/AISC 341-16 SEISMIC PROVISIONS FOR STRUCTURAL STEEL BUILDINGS
 AISC SPECIFICATION FOR THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS (335-89S1)
 AISC CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES (2016 ED.)
 AISI SPECIFICATIONS FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS (2016 EDITION)
 AWS D1.1/D1.1M:2015 STRUCTURAL WELDING CODE

FRAMING SCHEDULE
 COL. - SEE PLAN
 BEAM - SEE PLAN
 PURLIN - SEE PLAN
 DESIGN LOADS: (IBC 2018)
 RISK CATEGORY: II
 USE GROUP: U
 CONSTRUCTION TYPE: II-B
 1603.1.1 FLOOR LIVE LOAD: N/A
 1603.1.2 ROOF LIVE LOAD: 20 PSF
 DEAD & COLLATERAL LOAD: 10 PSF
 TOTAL ROOF DESIGN LOAD: 30 PSF
 1603.1.3 ROOF SNOW LOAD:
 SNOW LOAD COEF. (Ce) = 1.0
 IMPORTANCE FACTOR (I) = 1.0
 GROUND SNOW LOAD (Pg) = 15 PSF
 FLAT ROOF SNOW LOAD (P_f) = 12.6 PSF
 THERMAL FACTOR (CT) = 1.2

1603.1.4 WIND LOAD:
 ULTIMATE DESIGN WIND SPEED, V_{ult} (3 SEC GUST): 116 MPH
 NOMINAL DESIGN WIND SPEED, V_{asd}: 90 MPH
 WIND EXPOSURE: C
 INTERNAL PRESSURE COEFFICIENT (GC_{pi}): 0.00
 COMPONENTS AND CLADDING DESIGN WIND PRESSURE (P_{net}): 21.0 PSF
 EARTHQUAKE LOAD DESIGN DATA
 SEISMIC IMPORTANCE FACTOR (I_e): 1.0
 MAPPED SPECTRAL RESPONSE ACCELERATIONS
 S_s=0.129 g S_{ms}=0.206 g
 S₁=0.064 g S_{m1}=0.154 g

SITE CLASS "D"
 SPECTRAL RESPONSE COEFFICIENTS
 S_{d1}=0.137 S_{d1}=0.102
 SEISMIC DESIGN CATEGORY: B
 BASIC SEISMIC FORCE RESISTING SYSTEM: CANTILEVERED COLUMN
 RESPONSE MODIFICATION FACTOR (R): 1.25
 SEISMIC RESPONSE COEFFICIENT (C_s): .110
 EQUIVALENT LATERAL FORCE ANALYSIS PROCEDURE USED
 DESIGN BASE SHEAR (V): 0.72 KIPS / COLUMN (MAX)
 (SEISMIC DOES NOT CONTROL)

FOOTING DESIGN:
 CONSTRAINED CONDITION
 LATERAL BEARING PRESSURE 100 PSF/ft
 MAX. END BEARING PRESSURE 2000 PSF
 EXTEND FOOTING BELOW FROST LINE

CONCRETE: (PER ACI 318-19) - 3000 PSI STRENGTH (MIN) @ 28 DAYS

BOLTS:
 BOLTS SHALL CONFORM TO ASTM A325 FOR STRUCTURAL STEEL CONNECTIONS. BOLTS SHALL BE TIGHTENED TO THE "SNUG-TIGHT CONDITION" PER AISC AND RCSC SPECIFICATIONS. THE "SNUG-TIGHT CONDITION" IS DEFINED AS THE TIGHTNESS REQUIRED TO BRING THE CONNECTED PILES INTO FIRM CONTACT. ALL OF THE BOLTS SHALL BE TIGHTENED SUFFICIENTLY TO PREVENT THE REMOVAL OF THE NUTS WITHOUT THE USE OF A WRENCH.



- STEEL**
1. ERECTION OF STEEL STRUCTURE SHALL BE PERFORMED PER ALL AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC) ERECTION PROVISIONS.
 2. STRUCTURAL STEEL SHALL CONFORM TO:
 Wide Flange Beams - ASTM A992, Grade 50, F_y = 50 KSI
 Structural Angles and Channel - ASTM A36, F_y = 36 KSI
 Structural Plate - ASTM A36, F_y = 36 KSI
 Structural Tubing - ASTM A500, Grade B, F_y = 42 KSI (ROUND) F_y = 46 KSI (SQ / RECT)
 Structural Pipe - ASTM A53, Grade B, F_y = 35 KSI
 REBAR - ASTM A615, GRADE 60, F_y = 60 KSI
 3. ALL STEEL FRAMING MEMBERS ARE TO BE PAINTED WITH A RED OXIDE PRIMER

WELDS
 ALL WELDED CONNECTIONS SHALL BE IN ACCORDANCE WITH LATEST AWS SPECIFICATIONS, USING E70XX ELECTRODES. ALL WELDING SHALL BE PERFORMED BY AN AWS CERTIFIED WELDER.

ROOF PANELS
 20 GA. ROLLED FORM STEEL DECKING INSTALLED W/ MAX CLIPS PER MFR. INSTRUCTIONS. U.N.O.


FOUNDATIONS
 SEE FOOTING PLANS FOR DETAILS.

GROUT
 Factory Package - ASTM 109
 Non-Corrosive and Non-Staining
 To be mixed with water for consistency suitable for application and 30 minute working time.

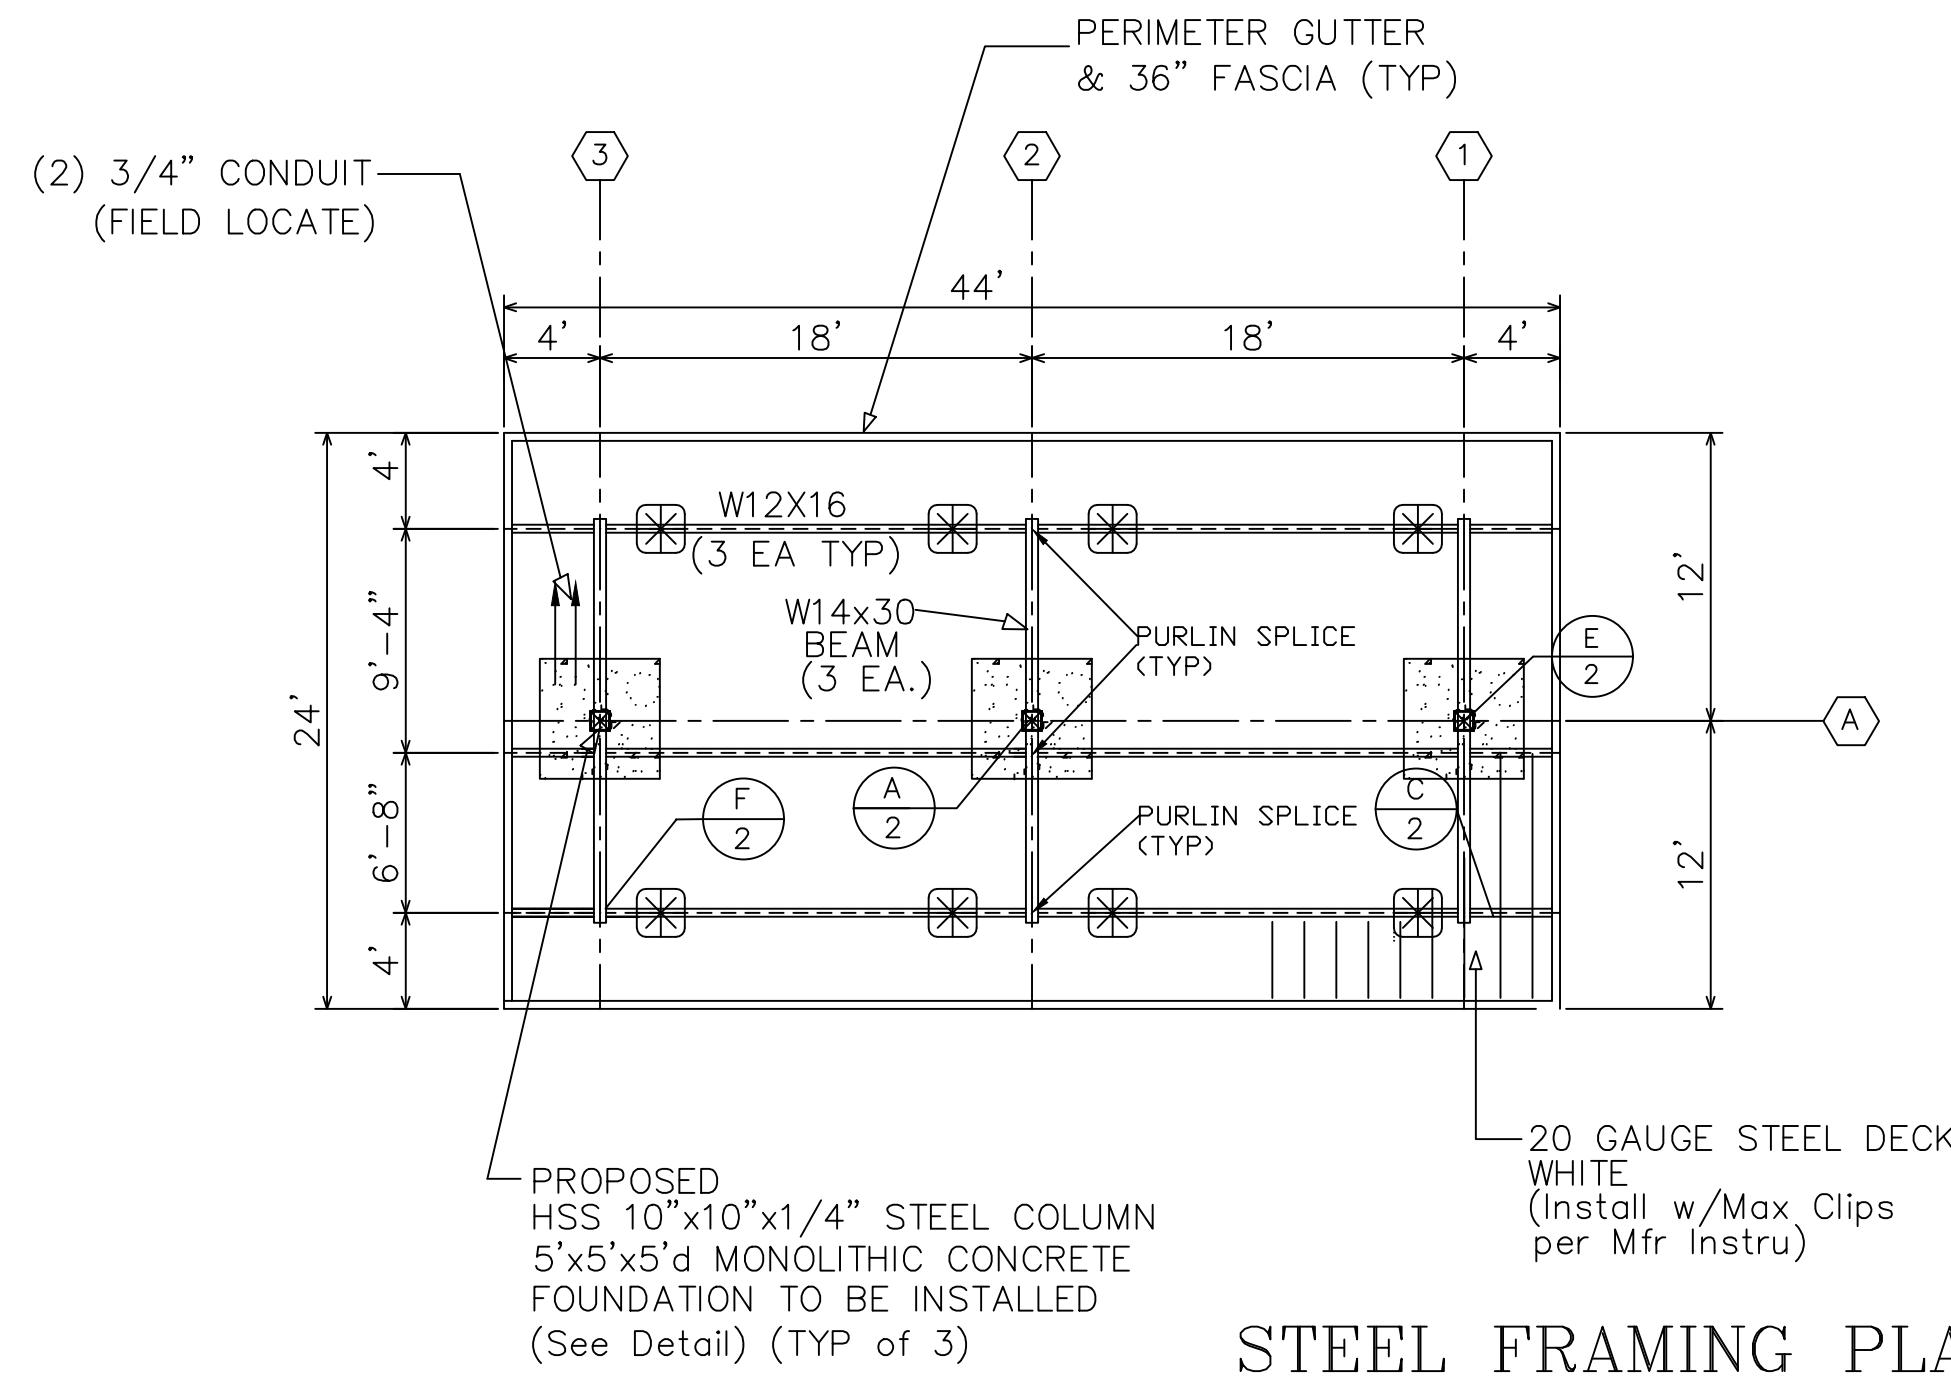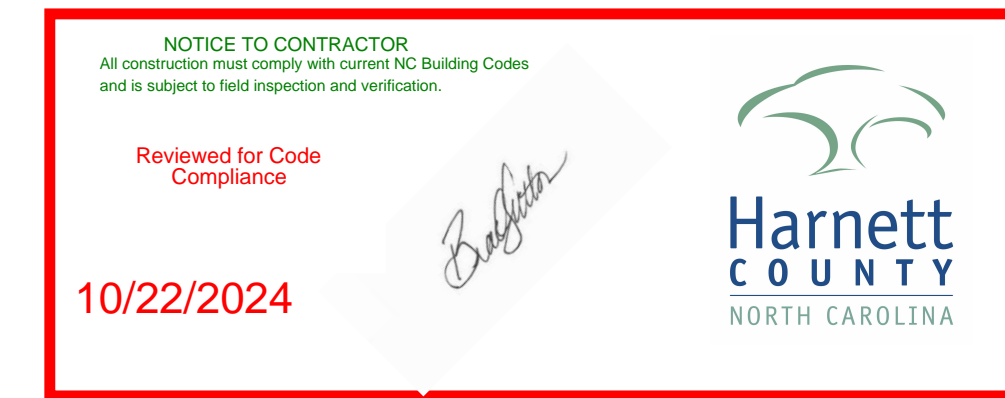

LEGEND

- ⊗ LSI LED CANOPY LIGHT FIXTURE TYP OF 8
- ⊗ FIXTURE BY OTHERS EXACT LOCATION TO BE FIELD DETERMINED (WIRING BY OTHERS)

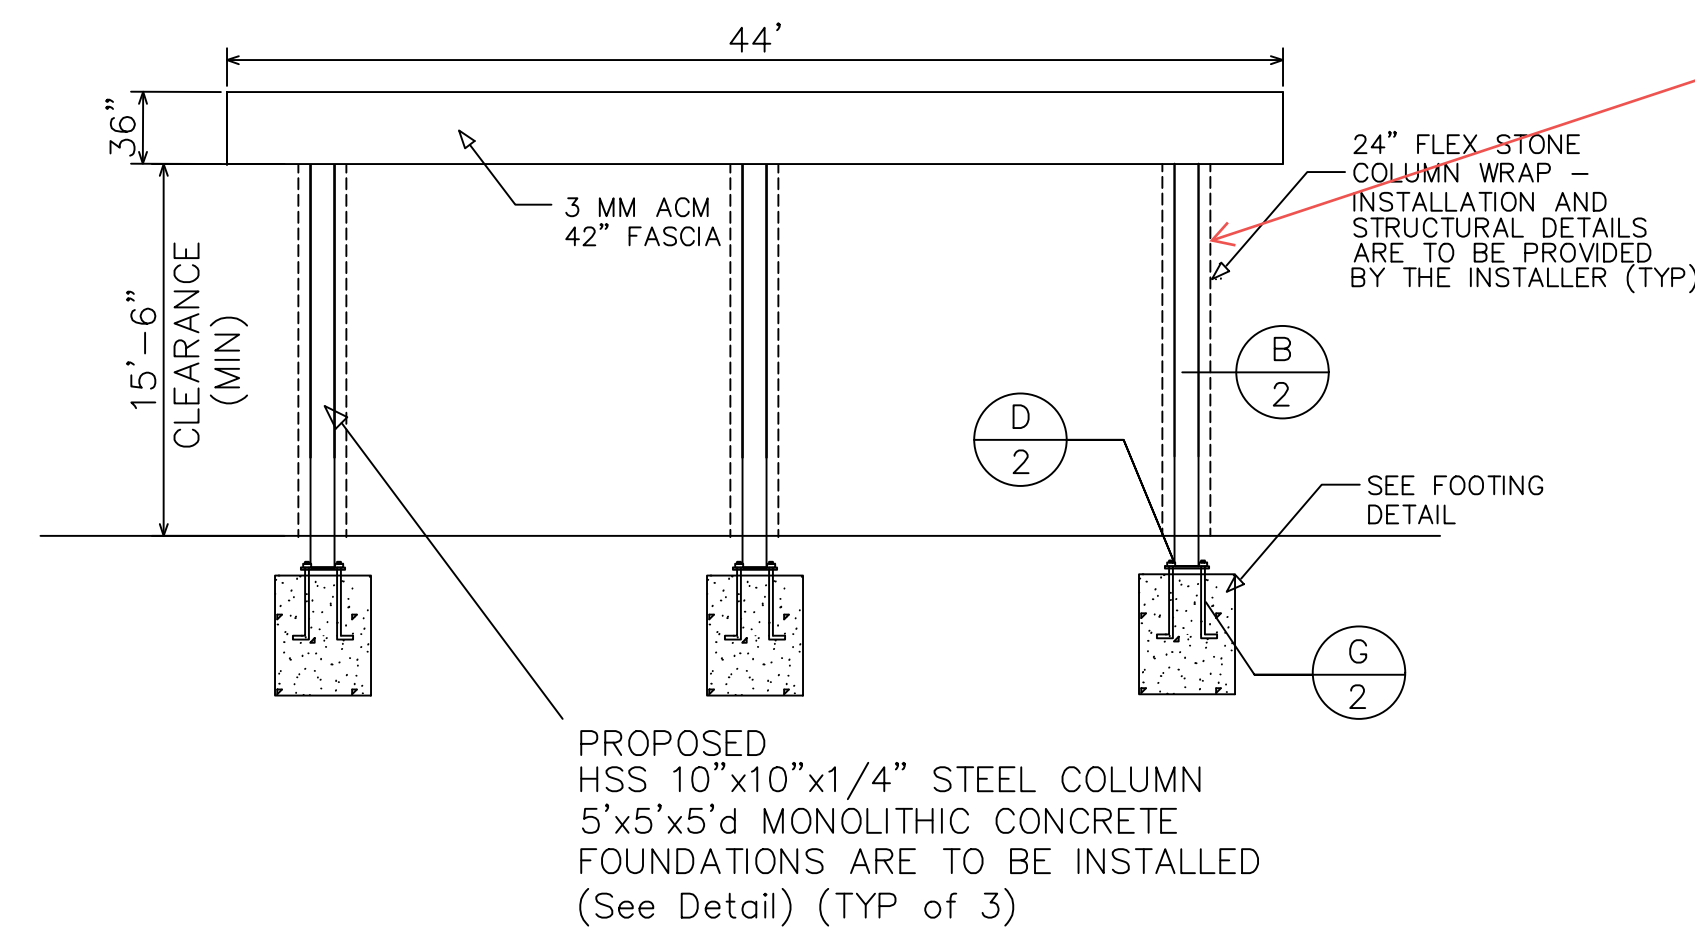

STRUCTURAL ENGINEER:

JEFF KEITH, PE - NC PE # 37194
 PO BOX 72692
 RICHMOND, VA 23235
 PH: (804) 909-3633
 E-MAIL: ADVENGRLLC@GMAIL.COM



NO.	DATE	BY	REVISION

ALL WORK TO BE IN ACCORDANCE WITH THE 2018 NCBC

SHEET TITLE	24' x 44' 3 COLUMN CANOPY	PROJECT NO.	AS SHOWN
SCALE	AS SHOWN	DATE	10-07-22
PROJECT	CHAMPS C-STORE CHALYBEATE SPRINGS RD & US 401 INT FUQUAY VARINA, NC 27526	DRAWN BY	JK
		CHECKED BY	JK
		DRAWING NO.	998
			1 of 3

