


- 1. MATERIALS AND INSTALLATION SHALL COMPLY WITH APPLICABLE NFPA CODES (NFPA 13 2013 EDITION), STATE BUILDING CODE, LOCAL AUTHORITY HAVING JURISDICTION.
- 2. ALL MATERIALS AND EQUIPMENT SHALL BE NEW, UL LISTED FOR THE INTENDED USE AND SHALL BE INSTALLED IN FULL COMPLIANCE WITH MANUFACTURER'S RECOMMENDATIONS.
- 3. ALL NEW AND EXISTING SPRINKLER PIPE 11/4" AND SMALLER IS SCHEDULE-40 BLACK STEEL WITH THREADED ENDS AND FITTINGS. ALL NEW AND EXISTING SPRINKLER PIPE 11/2" AND LARGER IS SCHEDULE-10 BLACK STEEL WITH GROOVED ENDS AND FITTINGS.
- 4. THE SCOPE OF WORK DOES NOT CREATE A MORE HYDRAULIC DEMANDING AREA. NO CALCULATION HAVE BEEN MADE.
- 5. LOCATIONS OF PIPING AS SHOWN ON THE DRAWINGS ARE APPROXIMATE AND SUBJECT TO MINOR ADJUSTMENTS IN THE FIELD.
- 6. THE SCOPE OF WORK: RELOCATE SPRINKLER HEADS TO NEW CEILING GRID LAYOUT.
- 7. THE SPRINKLER CONTRACTOR SHALL NOT BE RESPONSIBLE FOR ANY PRE-EXISTING CODE VIOLATIONS PERTAINING TO THE EXISTING SPRINKLER SYSTEM.

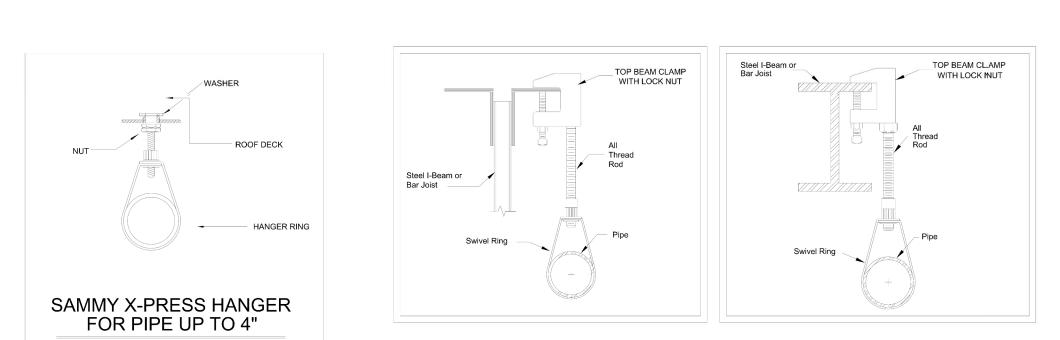

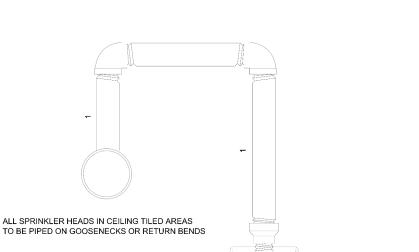


TYPICAL GOOSENECK DETAIL

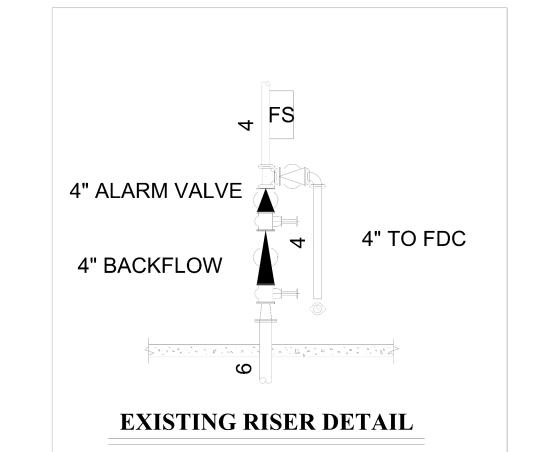



HANGER DETAIL

SCALE: NTS

Symbol	Manufacturer	SIN	Model	Quantity	K-Factor	Type	Size	Response	Orifice	Finish	Temperature	Note
	Existing				5.6	Upright	1/2	Standard	1/2"	Brass	155°F	EXISTING
	Victaulic	V2708	FL-QR	9	5.6	Pendent	1/2	Quick	0"	Chrome	155°F	NEW/CHROME PLATE
	Victaulic	V2708	FL-QR	4	5.6	Pendent	1/2	Quick	0"	Chrome	286°F	NEW/CHROME PLATE
	Globe	GL5680	GL-SR/DRY	3	5.6	Pendent	3/4	Standard	1/2"	Chrome	200°F	NEW/DRY CHROME
	Existing				5.6	Pendent	1/2	Standard	1/2"	Chrome	155°F	EXISTING
				Total = 16								

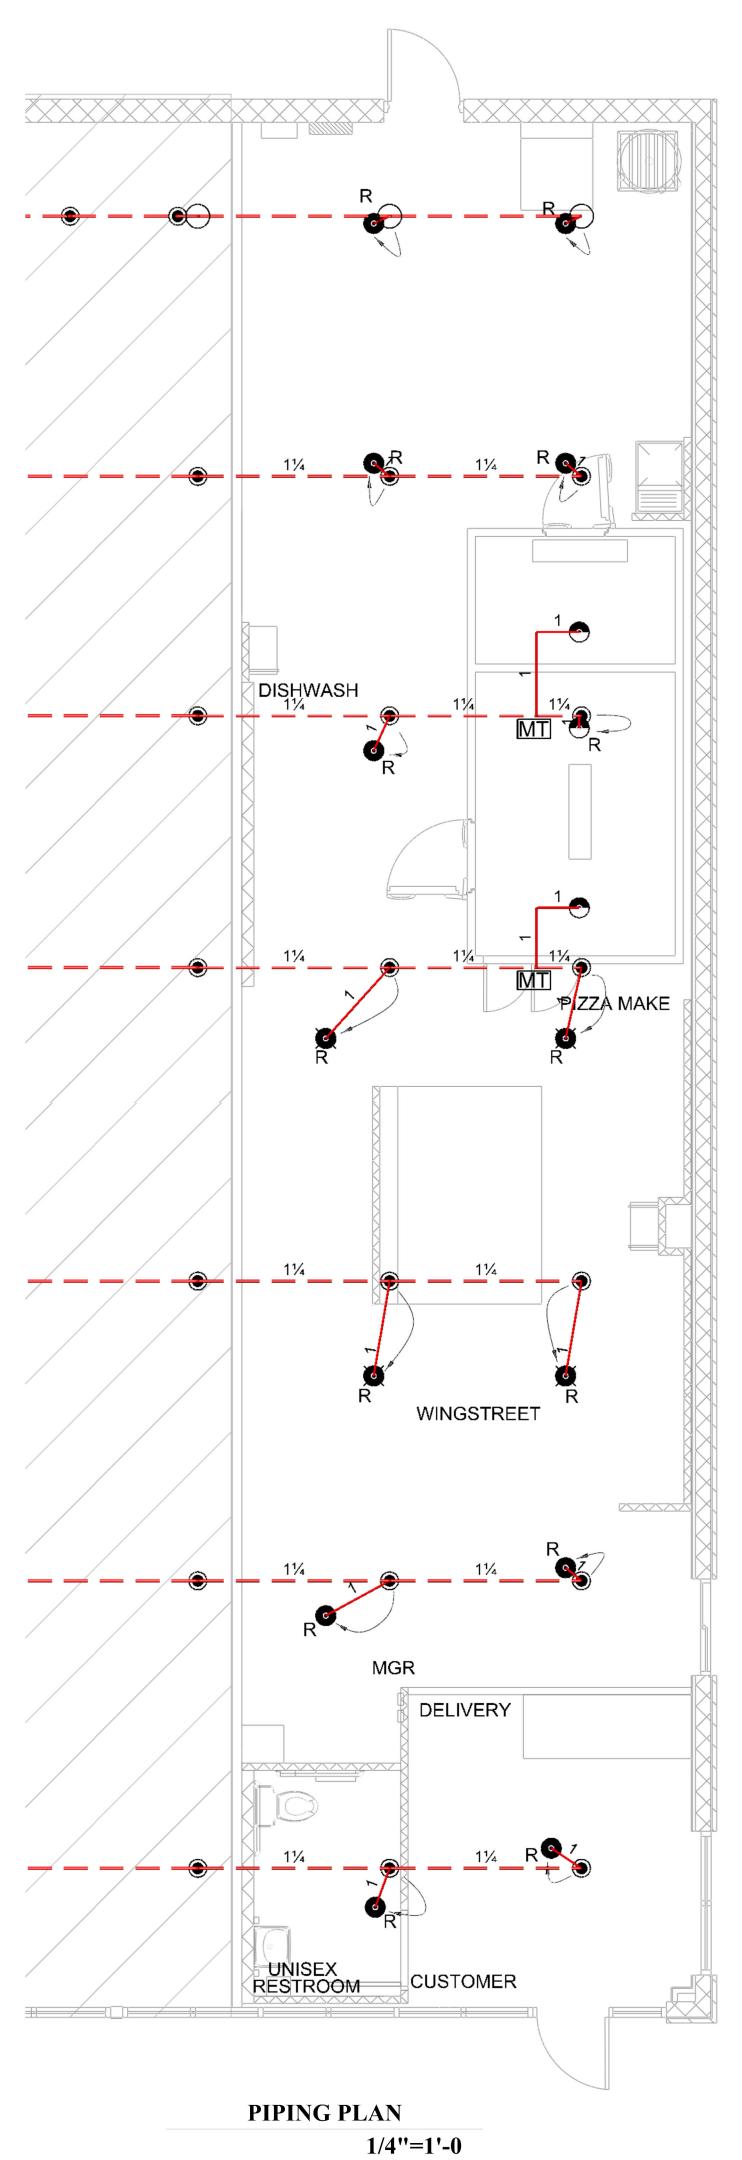

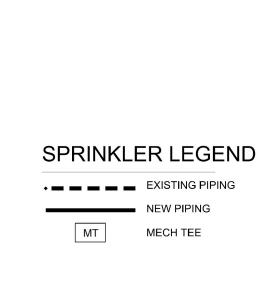

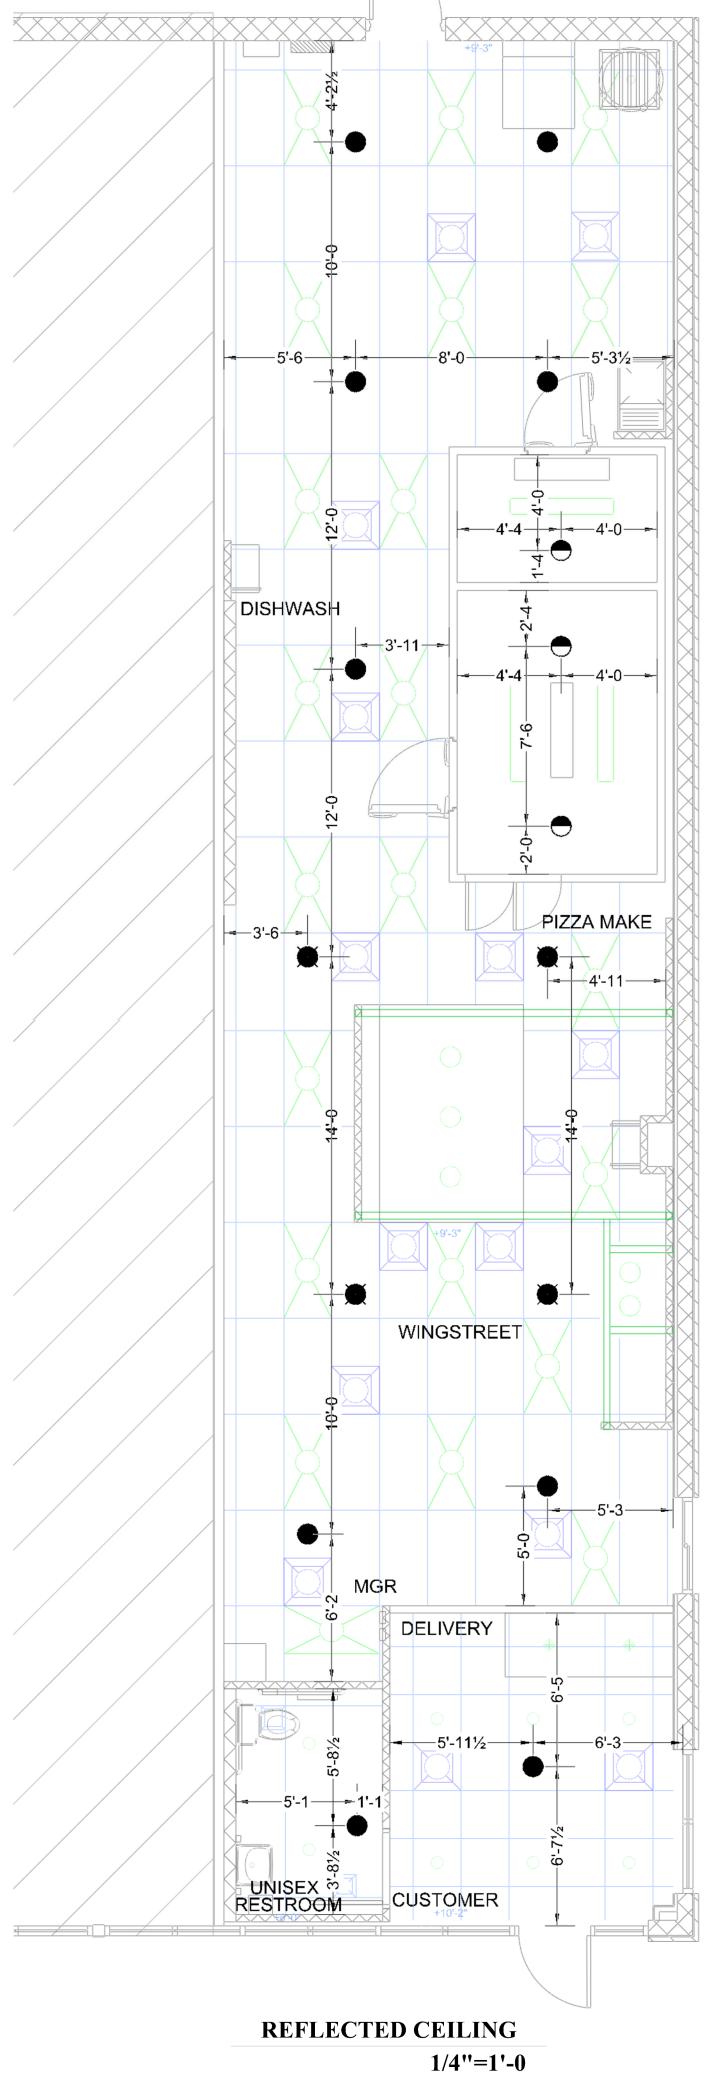

6-3-25 AS NOTED Job Number:

DANA GRAHAM NC # 16269FS CERT # 71075 NICET LEVEL III

REVISION: TITLE DATE

BW25141 Drawn By:

Sheet Number

FP 1 OF 1