

PROJECT GENERAL NOTES

A.

IN ADDITION TO THE GENERAL NOTES LISTED HEREIN, THE LATEST EDITION OF AIA DOCUMENT A201 GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION SHALL APPLY.

B.

WORK SHALL BE IN ACCORDANCE WITH FEDERAL, STATE AND LOCAL CODES, ORDINANCES, LAWS AND REQUIREMENTS.

C.

WORK, WHEN COMPLETED, SHALL CONFORM TO THE AMERICANS WITH DISABILITIES ACT AND LOCAL ACCESSIBILITY REQUIREMENTS.

D.

THE CONSTRUCTION DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ONE SHALL BE AS BINDING AS IF REQUIRED BY ALL. COORDINATE PORTIONS OF WORK AS DESCRIBED IN THE CONSTRUCTION DOCUMENTS.

E.

THE CONSTRUCTION DOCUMENTS, AS DEFINED BY THE DRAWING AND SPECIFICATION INDEX, ARE NECESSARY TO DEFINE THE TOTAL PROJECT. PARTIAL PLANS OR SPECIFICATIONS SHOULD NOT BE ISSUED BY ANY PARTIES FOR BIDDING OR CONSTRUCTION.

F.

IT IS THE INTENT OF THE CONSTRUCTION DOCUMENTS TO DESCRIBE A COMPLETE AND FINISHED PROJECT, OTHER THAN ITEMS NOTED "NIC" (NOT IN CONTRACT), ERRORS, OMISSIONS AND INCONSISTENCIES THAT MAY OCCUR BETWEEN THE CONSTRUCTION DOCUMENTS AND/OR EXISTING CONDITIONS SHALL BE BROUGHT IMMEDIATELY TO THE ATTENTION OF THE ARCHITECT IN WRITING AND WRITTEN INSTRUCTIONS SHALL BE OBTAINED PRIOR TO PROCEEDING WITH THE WORK. THE GENERAL CONTRACTOR SHALL BE HELD RESPONSIBLE FOR THE RESULTS OF ANY ERRORS, DISCREPANCIES AND/OR OMISSIONS WHICH THE GENERAL CONTRACTOR FAILED TO NOTIFY THE ARCHITECT PRIOR TO CONSTRUCTION AND/OR FABRICATION OF THE WORK.

G.

GENERAL CONTRACTOR SHALL INCLUDE AND PROVIDE ALL LABOR, MATERIALS, EQUIPMENT, TRANSPORTATION AND PAY EXPENSES INCURRED IN THE PROPER COMPLETION OF WORK UNLESS SPECIFICALLY NOTED TO BE THE WORK OF OTHERS. GENERAL CONTRACTOR SHALL PERFORM WORK NECESSARY FOR PRODUCTION OF A COMPLETE, HABITABLE PROJECT AS DEFINED BY THE SCOPE OF WORK.

H.

DO NOT SCALE DRAWINGS. BIDDER (CONTRACTOR) SHALL VERIFY CONDITIONS AND DIMENSIONS AT JOB SITE PRIOR TO START OF CONSTRUCTION. IF DISCREPANCIES ARE FOUND, WHETHER BUILT OR NOT, THE ARCHITECT SHALL BE NOTIFIED FOR CLARIFICATION BEFORE COMMENCING WORK.

I.

THE STATED DIMENSIONS SHALL TAKE PRECEDENCE OVER GRAPHIC. THE ARCHITECT SHALL BE NOTIFIED OF ANY DISCREPANCIES.

J.

NOTE THAT ERRORS IN THE TRANSMISSION OR REPRODUCTION OF THESE CONSTRUCTION DOCUMENTS COULD RESULT IN ALTERATIONS TO LINE TYPES, THICKNESSES, TONES, COLORS, HATCH PATTERNS AND SCALE. WILKUS ARCHITECTS IS NOT RESPONSIBLE FOR ANY CLAIMS, DAMAGES OR EXPENSES ARISING FROM THE UNAUTHORIZED USE OF THE INFORMATION CONTAINED WITHIN.

K.

IF THE CONSTRUCTION DOCUMENTS APPEAR TO BE UNCLEAR, AMBIGUOUS OR CONTRADICTORY, AND IN THE EVENT THAT THE CONTRACTOR, OR SUBCONTRACTOR, DETERMINES CLARIFICATION OR INTERPRETATION BY THE ARCHITECT IS REQUIRED, THE GENERAL CONTRACTOR SHALL SUBMIT A REQUEST FOR INFORMATION IN WRITING TO THE ARCHITECT PRIOR TO START OF THE WORK.

a. REQUESTS FOR INFORMATION MAY ONLY BE MADE BY THE GENERAL CONTRACTOR. THE GENERAL CONTRACTOR SHALL CLEARLY AND CONCISELY SET FORTH THE ISSUE FOR WHICH CLARIFICATION IS SOUGHT AND WHY A RESPONSE IS NEEDED FROM THE ARCHITECT AND/OR CONSULTANTS. IN THE REQUEST FOR INFORMATION, THE CONTRACTOR SHALL SET FORTH AN UNDERSTANDING OF THE REQUIREMENT, ALONG WITH A REASON WHY SUCH AN UNDERSTANDING WAS REACHED.

b. THE ARCHITECT WILL REVIEW THE REQUEST FOR INFORMATION TO DETERMINE IF IT IS WITHIN THE MEANING OF THIS TERM. IF THE ARCHITECT DETERMINES THAT IT IS NOT A REQUEST FOR INFORMATION, IT WILL BE RETURNED TO THE CONTRACTOR UNREVIEWED AS TO CONTENT OR FOR RE-SUBMITTAL IN THE PROPER FORM AND MANNER.

c. RESPONSES TO REQUESTS FOR INFORMATION SHALL BE ISSUED UPON RECEIPT, BUT NO LATER THAT FIVE WORKING DAYS OF RECEIPT, UNLESS IT IS DETERMINED THAT A LONGER PERIOD OF TIME IS NEEDED IN ORDER TO PROVIDE ADEQUATE RESPONSE. IF A LONGER PERIOD OF TIME IS NECESSARY, THE ARCHITECT WILL, WITHIN FIVE WORKING DAYS OF THE RECEIPT OF THE REQUEST FOR INFORMATION, NOTIFY THE GENERAL CONTRACTOR OF THE ANTICIPATED RESPONSE TIME.

d. IF THE REQUEST FOR INFORMATION IS SUBMITTED WITH FIVE WORKING DAYS OR LESS FLOAT ON THE PROJECT SCHEDULE, THE CONTRACTOR SHALL NOT BE ENTITLED TO ANY TIME EXTENSION DUE TO THE TIME REQUIRED TO REVIEW AND RESPOND. PROVIDED A RESPONSE IS GIVEN WITHIN THE FIVE WORKING DAYS AS SET FORTH ABOVE.

e. RESPONSES FROM THE ARCHITECT ARE NOT INTENDED TO CHANGE ANY OF THE REQUIREMENTS OF THE CONSTRUCTION DOCUMENTS. IN THE EVENT THAT THE CONTRACTOR BELIEVES A RESPONSE WILL CAUSE A CHANGE TO THE REQUIREMENTS OF THE CONSTRUCTION DOCUMENTS, THE CONTRACTOR SHALL IMMEDIATELY GIVE WRITTEN NOTICE TO THE ARCHITECT AND CLIENT STATING THAT THEY CONSIDER THE RESPONSE TO BE A CHANGE ORDER. FAILURE TO GIVE SUCH WRITTEN NOTICE IMMEDIATELY SHALL WAIVE THE CONTRACTORS RIGHT TO SEEK ADDITIONAL TIME AND/OR COST.

L.

ANY DIMENSIONS, DETAILS, NOTATIONS OR SYMBOLS THAT APPLY TO ONE UNIT, APPLY TO ALL UNITS IN LIKE SITUATIONS, UNLESS NOTED OTHERWISE.

M.

FOR THE PURPOSE OF THESE DOCUMENTS, "INSTALL" SHALL MEAN TO PROVIDE FASTENERS, MISCELLANEOUS HARDWARE, BLOCKING, ELECTRICAL CONNECTIONS, PLUMBING CONNECTIONS AND ANY OTHER ITEMS REQUIRED FOR A COMPLETE AND OPERATIONAL INSTALLATION, UNLESS NOTED OTHERWISE.

N.

FOR THE PURPOSE OF THESE DOCUMENTS, "BY GC" WILL REFER TO ITEMS PROVIDED AND INSTALLED BY THE GENERAL CONTRACTOR, THEIR SUBCONTRACTORS AND/OR AGENTS. THE TERM "BY CLIENT" WILL REFER TO ITEMS PROVIDED BY THE CLIENT AND INSTALLED BY THE GENERAL CONTRACTOR.

O.

PRODUCTS THAT HAVE BEEN USED IN PREPARING THESE DOCUMENTS, ARE TO ESTABLISH MINIMUM QUALITIES. PROPOSED SUBSTITUTIONS MUST MEET THESE QUALITIES, OR BETTER, TO BE CONSIDERED ACCEPTABLE. THE BURDEN OF PROOF OF EQUALITY RESTS WITH THE GENERAL CONTRACTOR. ADEQUATE SUPPORTING DOCUMENTATION MUST ACCOMPANY SUBSTITUTION REQUEST SUBMITTALS, WHICH MUST BE SUBMITTED TO THE ARCHITECT FOR APPROVAL PRIOR TO BIDDING.

P.

GENERAL CONTRACTOR SHALL VISIT THE PROJECT SITE PRIOR TO SUBMISSION OF BID AND BEGINNING OF ANY WORK TO EXAMINE AND COMPARE THE DRAWINGS AND SPECIFICATIONS TO THE EXISTING CONDITIONS AND BE KNOWLEDGEABLE OF WORK TO BE PERFORMED. NOTIFY ARCHITECT IMMEDIATELY OF ANY DISCREPANCIES.

Q.

NOTIFY ALL PARTIES IF HAZARDOUS MATERIALS ARE SUSPECTED OR FOUND TO BE PRESENT.

R.

NOTIFY ARCHITECT IMMEDIATELY OF EXISTING CONDITIONS THAT ARE EXPOSED DURING CONSTRUCTION THAT MAY IMPACT ANY PROPOSED NEW WORK.

S.

DO NOT ATTEMPT REMOVAL OF ANY STRUCTURE OR ELEMENT SUSPECTED OF BEING STRUCTURAL IN NATURE. STRUCTURAL MODIFICATIONS TO THE BUILDING OR STRUCTURAL SYSTEMS (OF ANY TYPE) REQUIRE APPROVAL FROM THE BUILDING OWNER AND AN APPROVED STRUCTURAL ENGINEER.

T.

GENERAL CONTRACTOR TO PROVIDE TEMPORARY BARRICADES, WINDOW BLACKOUTS AND DUST CONTROL AS REQUIRED BY CLIENT, LANDLORD OR AUTHORITY HAVING JURISDICTION FOR THE DURATION OF CONSTRUCTION. VEHICULAR ACCESS MUST BE PROVIDED AND MAINTAINED SERVICEABLE THROUGHOUT CONSTRUCTION.

U.

THROUGHOUT THE PROJECT, THE GENERAL CONTRACTOR SHALL CLOSELY SUPERVISE THE WORK OF SUBCONTRACTORS AND SHALL BE SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS AND TECHNIQUES, INCLUDING SAFETY PROCEDURES AND FOR COORDINATING/SEQUENCING TRADES.

V.

GENERAL CONTRACTOR SHALL TAKE OUT ANY NECESSARY TRADE-LEVEL PERMITS, INSURANCE, LICENSES, BONDS AND CERTIFICATES AND PAY ALL FEES CONNECTED TO THE WORK DESCRIBED HEREIN.

X.

ALL CONTRACTORS FOR THE WORK ARE REQUIRED TO HAVE INSURANCE OF ALL TYPES AND LIMITS AS REQUIRED FOR THIS PROJECT.

Y.

REFER TO ENGINEERED CONSTRUCTION DOCUMENTS BY OTHERS FOR ADDITIONAL PERTINENT INFORMATION.

Z.

REFER TO INDIVIDUAL DRAWINGS WITHIN THIS SET OF CONSTRUCTION DOCUMENTS FOR ADDITIONAL GENERAL NOTES.

AA.

GENERAL CONTRACTOR IS RESPONSIBLE TO CONTACT TENANT TO VERIFY, COORDINATE AND COMPLY, DURING THE BIDDING PHASE, WITH REQUIREMENTS INCLUDING, BUT NOT LIMITED TO BARRICADES, STAGING, CONSTRUCTION PROCEDURES, USE OF MANDATED SUBCONTRACTORS, DEBRIS REMOVAL, RESTRICTED HOURS OF CONSTRUCTION, SECURITY, UTILITIES, ETC.

BB.

GENERAL CONTRACTOR SHALL FURNISH AND INSTALL ITEMS WHICH ARE OBVIOUS AND NECESSARY TO ENSURE QUALITY WORKMANSHIP AND INSTALLATION, EVEN IF NOT SPECIFICALLY MENTIONED IN THE DRAWINGS, INCLUDING BUT NOT LIMITED TO BLOCKING AND BRACING.

CC.

ANY DEVIATION FROM THESE CONSTRUCTION DOCUMENTS ON THE PART OF THE GENERAL CONTRACTOR, ANY SUBCONTRACTOR, VENDOR AND/OR SUPPLIER, OR USE OF THESE CONSTRUCTION DOCUMENTS FOR USE AT ANY LOCATION OTHER THAN THAT FOR WHICH THEY WERE INTENDED, SHALL RELEASE WILKUS ARCHITECTS, AND ITS SUBSIDIARIES, AND THEIR OFFICERS, DIRECTORS, SHAREHOLDERS, AGENTS, EMPLOYEES, REPRESENTATIVES, SUCCESSORS AND ASSIGNEES, FROM ANY AND ALL LIABILITY INCURRED IN LITIGATION OR OTHERWISE WITH RESPECT TO THE CONSTRUCTION OF THIS PROJECT.

DD.

GENERAL CONTRACTOR IS RESPONSIBLE FOR THEIR WORK AND THAT OF THEIR SUBCONTRACTORS FOR THE LOSSES AND DAMAGES TO EQUIPMENT, EXISTING CONSTRUCTION, TOOLS AND MATERIALS USED IN CONJUNCTION WITH THE WORK, FOR THE ACTS OF THEIR EMPLOYEES AND SUBCONTRACT WORKERS.

EE.

GENERAL CONTRACTOR SHALL ADHERE AND COMPLY WITH FEDERAL, STATE AND LOCAL REGULATIONS REGARDING JOB SAFETY.

FF.

GENERAL CONTRACTOR IS RESPONSIBLE TO CARRY WORKER'S COMPENSATION AS REQUIRED BY LAW AND/OR GOVERNING AUTHORITY.

GG.

GENERAL CONTRACTOR IS RESPONSIBLE FOR THE SAFETY AND CARE OF ADJACENT PROPERTIES DURING CONSTRUCTION.

HH.

GENERAL CONTRACTOR IS RESPONSIBLE FOR MAINTAINING A COMPLETE AS-BUILT SET OF CONSTRUCTION DRAWINGS AT THE JOB SITE AND TURNING THE AS-BUILT DRAWINGS OVER TO THE CLIENT UPON COMPLETION OF THE PROJECT.

II.

THE APPROVED PLANS (FOR CONSTRUCTION SET) SHALL BE KEPT ON SITE AT ALL TIMES, INCLUDING ALL ADDENDA, SUPPLEMENTAL INSTRUCTIONS, CHANGE ORDERS, COPIES OF APPROVED SUBMITTALS, ETC.

JJ.

IF REQUIRED, THE GENERAL CONTRACTOR SHALL PROVIDE SCHEDULING AND/OR COORDINATION WITH THE APPROPRIATE REPRESENTATIVE FOR THE FOLLOWING INSTALLATIONS OR PROCEDURES:

a. INSTALLATION OF CONDUIT AND PIPING IN OR BELOW THE FLOOR SLAB.

b. CONNECTIONS TO DOMESTIC WATER, SANITARY AND GREASE WASTE, SANITARY VENT AND SMOKE/FIRE ALARMS.

c. INSTALLATION OF PRIMARY DUCTWORK, VAV BOXES AND CONTROLS.

d. PROGRAMMING OF THE VAV BOX CONTROL AND SENSORS.

e. ANY WORK REQUIRED AT THE BUILDING SWITCHGEAR.

f. HARDWARE AND SOFTWARE MODIFICATIONS TO COMPLETE THE INTERFACE WITH BASE BUILDING LIFE SAFETY SYSTEM.

g. UPON SUBSTANTIAL COMPLETION OF WORK IN THE PREMISES, CLIENT AND THE CONTRACTOR MUST SCHEDULE A FINAL INSPECTION AND PREPARE A PUNCHLIST WHICH ENUMERATES ANY AREAS OF CONSTRUCTION, FIXTURING, LIGHTING OR LAMPING, MERCHANDISING, ETC., THAT ARE NOT IN ACCORDANCE WITH THE CONSTRUCTION DOCUMENTS. ANY STOREFRONT BARRICADE MAY NOT BE REMOVED UNTIL THE INSPECTION AND REQUIRED CORRECTIONS HAVE BEEN COMPLETED.

h. PROVIDE LANDLORD REQUIRED PROOF OF BUILDERS RISK INSURANCE AND DAMAGE DEPOSIT PRIOR TO BEGINNING OF ANY SELECTIVE DEMOLITION OR CONSTRUCTION PROCEDURES.

KK.

GENERAL CONTRACTOR TO VERIFY REQUIREMENTS TO MAINTAIN ROOF WARRANTY. ANY ROOF PATCHING SHALL RETURN THE AFFECTED AREA TO A "LIKE NEW" CONDITION.

LL.

GENERAL CONTRACTOR ASSUMES COMPLETE RESPONSIBILITY WHEN CLIENT FURNISHED ITEMS ARE ACCEPTED AND RECEIVED BY THE GENERAL CONTRACTOR OR THEIR AGENTS.

MM.

PROVIDE PROTECTION FOR EXISTING OR NEWLY INSTALLED SYSTEMS AND FINISHES FOR THE DURATION OF CONSTRUCTION.

NN.

GENERAL CONTRACTOR TO INSTALL DUST PROOFING AND/OR RIGID BARRIERS AS APPROPRIATE TO PROTECT VARIOUS SEGMENTS, BARRIERS TO MAINTAIN EXITING, MECHANICAL, AND FIRE/LIFE SAFETY REQUIREMENTS FOR BUILDING OCCUPANTS.

OO.

GENERAL CONTRACTOR IS RESPONSIBLE FOR INSPECTION OF PORTIONS OF WORK ALREADY PERFORMED TO DETERMINE THAT SUCH PORTIONS ARE IN PROPER CONDITION TO RECEIVE SUBSEQUENT WORK.

PP.

MOLD AND MOISTURE MITIGATION - GENERAL CONTRACTOR TO COORDINATE AND ENSURE THAT ANY AREA OF THE BUILDING, MATERIAL, OR ASSEMBLY WITHIN THE BUILDING ENVELOPE IS THOROUGHLY CLEANED AND DRY BEFORE BEING COVERED BY CONSTRUCTION. ANY MOLD, MILDEW OR OTHER MOISTURE CONDITION DEVELOPED WITHIN THE SCOPE OF WORK OF THIS CONTRACT (DEMOLITION OR NEW CONSTRUCTION) SHALL BE CORRECTED AND/OR MITIGATED BY THE GENERAL CONTRACTOR PRIOR TO ADDITIONAL WORK. CONTACT BETWEEN DISSIMILAR METALS SHALL BE LIMITED. WHEN REQUIRED, THE CONTACT SHALL BE PROTECTED AS REQUIRED.

QQ.

VENDORS ARE RESPONSIBLE FOR DISPOSAL OF SHIPPING/CRATING MATERIALS. VERIFY WITH THE GENERAL CONTRACTOR THE USE OF THE DUMPSTER ON SITE. SUBCONTRACTORS MUST DISPOSE OF THEIR CONSTRUCTION DEBRIS. IF NOT COMPLETED, IT WILL BE COMPLETED AND BACK CHARGED FOR CLEANING. COORDINATE DISPOSAL WITH JOB SUPERINTENDENT.

SS.

AT THE TIME OF PROJECT COMPLETION, THE PROJECT LIMITS ARE TO BE THOROUGHLY CLEANED PRIOR TO TURNOVER TO CLIENT.

SYMBOL LEGEND

1

SP101

1

EXTERIOR ELEVATION MARKER

1

A101

1

INTERIOR ELEVATION MARKER

1

SIM

1

SECTION MARKER

1

SIM

1

SECTION / DETAIL

1

VIEW NAME

SCALE: 1/8" = 1'-0"

VIEW LABEL

X

KEYNOTE & WASHROOM ACCESSORIES NUMBER

WALL TAG

W1

LEVEL TARGET

LEVEL TARGET

0

COLUMN GRID LABEL

101

ROOM NAME

ROOM NAME & NUMBER

1

REVISION NUMBER

REVISION NUMBER

1

DOOR NUMBER

DOOR NUMBER

XXX

MISCELLANEOUS EQUIPMENT NUMBER

MISCELLANEOUS EQUIPMENT NUMBER

XXX

KITCHEN EQUIPMENT NUMBER

KITCHEN EQUIPMENT NUMBER

XXX

FURNITURE NUMBER

FURNITURE NUMBER

N

NORTH ARROW

NORTH ARROW

+

DIMENSION TARGET

DIMENSION TARGET

P1

FINISH TAG

FINISH TAG

UTILITY COORD.

NOTE TO GENERAL CONTRACTOR:
FOR ALL WATER, SEWER, NATURAL GAS, & ELECTRICITY UTILITIES CONTACT THE FOLLOWING

EBI CONSULTING
21 B ST.
BURLINGTON, MA 01803

CONTACT: JULIO VERA
E: jvera@ebiconsulting.com
T: (787) 344-1439

SIGNAGE VENDOR

ADCON
3725 CANAL DRIVE
FORT COLLINS, CO 80524

CONTACT: JULIA BARRETT
E: jbarrett@adcon-signs.com
T: (970) 227-3939

DEFERRED SUBMITTALS

GENERAL CONTRACTOR SHALL VERIFY DEFERRED SUBMITTALS AND SHOP DRAWINGS REQUIRED BY THE AUTHORITY HAVING JURISDICTION AND COORDINATE SUBMITTALS.

GENERAL CONTRACTOR SHALL COORDINATE CO2 PERMITS WITH TENANT AND TENANT'S CO2 MONITORING VENDOR.

SITE MAP

LOCATION MAP

UTILITY COORD.

SIGNAGE VENDOR

DEFERRED SUBMITTALS

CHIPOTLE

STORE NUMBER: 5644

LOCATION: "CAMERON NC"

ADDRESS: TBD NC 24-87
CAMERON, NC 28326

SCOPE OF WORK

TENANT INTERIOR FIT OUT OF A VACANT SHELL SPACE. WORK INCLUDES, BUT IS NOT LIMITED TO, INTERIOR FINISHES, TOILET ROOMS, EXTENSION OF UTILITIES, AND MODIFICATIONS TO ACCOMMODATE A NEW RESTAURANT. OUTDOOR PATIO FURNITURE WILL BE INSTALLED. SIGNAGE IS UNDER A SEPARATE COVER.

SITE MAP

LOCATION MAP

PROJECT TEAM

LANDLORD

PRIMAX PROPERTIES, LLC
1100 E. MOREHEAD STREET
CHARLOTTE, NC 28204

CONTACT: CHRIS NEILL
E: cneill@primaxproperties.com
T: (704) 954-7216

TENANT/CLIENT

CHIPOTLE MEXICAN GRILL
500 NEIL AVENUE, SUITE 400
COLUMBUS, OH 43215

CONTACT: HEATHER CONLEY
E: heather.conley@chipotle.com
T: (380) 222-7248
C: (614) 816-1382

ARCHITECT

WILKUS ARCHITECTS, P.A.
15 NINTH AVENUE NORTH
HOPKINS, MN 55343

CONTACT: DUSTY AUSTIN
E: dia@wilkusarch.com
T: (952) 843-5048

MECHANICAL ELECTRICAL PLUMBING ENGINEER

NATIONAL ENGINEERING, LTD.
4635 TRUMAN BLVD., SUITE 250
HILLARD, OH 43026

CONTACT: EDGAR PALMA
E: epalma@nationalengineering.com
T: (720) 629-5752

STRUCTURAL ENGINEER

VAA ENGINEERING
2300 BERKSHIRE LANE N, SUITE 200
PLYMOUTH, MN 55441

CONTACT: TERRY MAHR
E: tmahr@vaaeng.com
T: (763) 577-9119

REGULATORY AUTHORITIES

ZONING DEPARTMENT

HARNETT COUNTY PLANNING SERVICES
420 MCKINNEY PARKWAY
LILLINGTON, NC 27546
T: (910) 893-7525

CONTACT: JAY SIKES
E: jsikes@harnett.org
T: (910) 814-6418

BUILDING DEPARTMENT

HARNETT COUNTY PLANNING SERVICES
420 MCKINNEY PARKWAY
LILLINGTON, NC 27546
T: (910) 893-7525

CONTACT: DONNA JOHNSON
E: djohnson@harnett.org
T: (910) 814-6420

FIRE DEPARTMENT

HARNETT COUNTY FIRE MARSHALL
1005 EDWARDS BROTHERS DRIVE, SUITE A
LILLINGTON, NC 27546

CONTACT: RODNEY DANIELS
E: rdaniels@harnett.org
T: (910) 893-7580

SEWER UTILITY

HARNETT REGIONAL WATER
700 MCKINNEY PARKWAY
LILLINGTON, NC 27546
T: (910) 893-7575

ELECTRICAL UTILITY

DUKE ENERGY NC
253 PLANT ALLEN RD
BELMONT, NC
T: (800) 777-9898

HEALTH DEPARTMENT

NC DHHS ENVIRONMENTAL HEALTH
5605 SIX FORKS RD
RALEIGH, NC 27609

CONTACT: MONIQUE MORGAN
E: monique.morgan@dhhs.nc.gov
T: (910) 814-6418

TELEPHONE UTILITY

VERSION
T: 800.526.3178

SHEET INDEX

SHEET NO.	SHEET NAME	REVISION			
		1	2	3	4
GENERAL					
G000	COVER SHEET				
G001	CODE ANALYSIS - LIFE SAFETY PLAN				
G002	ACCESSIBILITY STANDARDS				
G003	APPENDIX A				
G004	APPENDIX B				
SPECIFICATIONS					
G010	ARCHITECTURAL SPECIFICATIONS				
G011	ARCHITECTURAL SPECIFICATIONS				
G012	ARCHITECTURAL SPECIFICATIONS				
G013	ARCHITECTURAL SPECIFICATIONS				
G014	ARCHITECTURAL SPECIFICATIONS				
G015	ARCHITECTURAL SPECIFICATIONS				
G016	ARCHITECTURAL SPECIFICATIONS				
G017	ARCHITECTURAL SPECIFICATIONS				
SITE PLAN					
SP100	SITE PLAN				
SP101	SITE DETAILS				
ARCHITECTURAL					
A101	SLAB WORK PLAN				
A110	ARCHITECTURAL FLOOR PLAN				
A111	ARCHITECTURAL WALL TYPES				
A120	FINISH PLAN				
A130	FF&E PLAN				
A131	FF&E SCHEDULES				
A140	ARCHITECTURAL ROOF PLAN				
A201	REFLECTED CEILING PLAN				
A210	CEILING DETAILS				
A211	LIGHTING DETAILS				
A301	EXTERIOR ELEVATIONS				
A502	INTERIOR SECTIONS				
A601	DOOR & HARDWARE SCHEDULE				
A701	ELEVATIONS - INTERIOR DINING				
A702	ELEVATIONS - INTERIOR KITCHEN				
A710	RESTROOM INFORMATION				
A801	GENERAL DETAILS				
A802	KITCHEN DETAILS				
A803	FINISH DETAILS				
STRUCTURAL					
S000	GENERAL STRUCTURAL NOTES				
S100	SLAB ON GRADE PLAN AND DETAILS				
S200	ROOF FRAMING PLAN				
HVAC					
M010	HVAC SPECIFICATIONS				
M100	HVAC PLAN				
M600	HVAC SCHEDULES				
M700	HVAC DETAILS				
M710	CAPTIVEAIRE SHOP DRAWINGS				
M711	CAPTIVEAIRE SHOP DRAWINGS				
M712	CAPTIVEAIRE SHOP DRAWINGS				
M713	CAPTIVEAIRE SHOP DRAWINGS				
M714	CAPTIVEAIRE SHOP DRAWINGS				
M715	CAPTIVEAIRE SHOP DRAWINGS				
M716	CAPTIVEAIRE SHOP DRAWINGS				
M717	CAPTIVEAIRE SHOP DRAWINGS				
M718	CAPTIVEAIRE SHOP DRAWINGS				
M719	CAPTIVEAIRE SHOP DRAWINGS				
PLUMBING					
P010	PLUMBING SPECIFICATIONS				
P100	PLUMBING PLAN WATER & GAS				
P110	PLUMBING PLAN WASTE & VENT				
P600	PLUMBING SCHEDULES				
P700	PLUMBING DETAILS				
ELECTRICAL					
E010	ELECTRICAL SPECIFICATIONS				
E100	ELECTRICAL LIGHTING PLAN				
E110	ELECTRICAL POWER PLAN				
E115	ELECTRICAL SITE POWER PLAN				
E600	ELECTRICAL SCHEDULES				
E700	ELECTRICAL INTERIOR ELEVATIONS				
E705	ELECTRICAL INTERIOR ELEVATIONS				
E710	ELECTRICAL DETAILS				

14006

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO: 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BAI - FINISH UPDATES

TITLE:
COVER SHEET

SHEET NUMBER:
G000

CLIENT:

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2682
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644

"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

MATTHEW M. WILKUS
REGISTERED ARCHITECT
14006
NORTH CAROLINA
HOPKINS, MN

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)


PROJECT NO: 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BAI - FINISH UPDATES

TITLE:
COVER SHEET

SHEET NUMBER:
G000

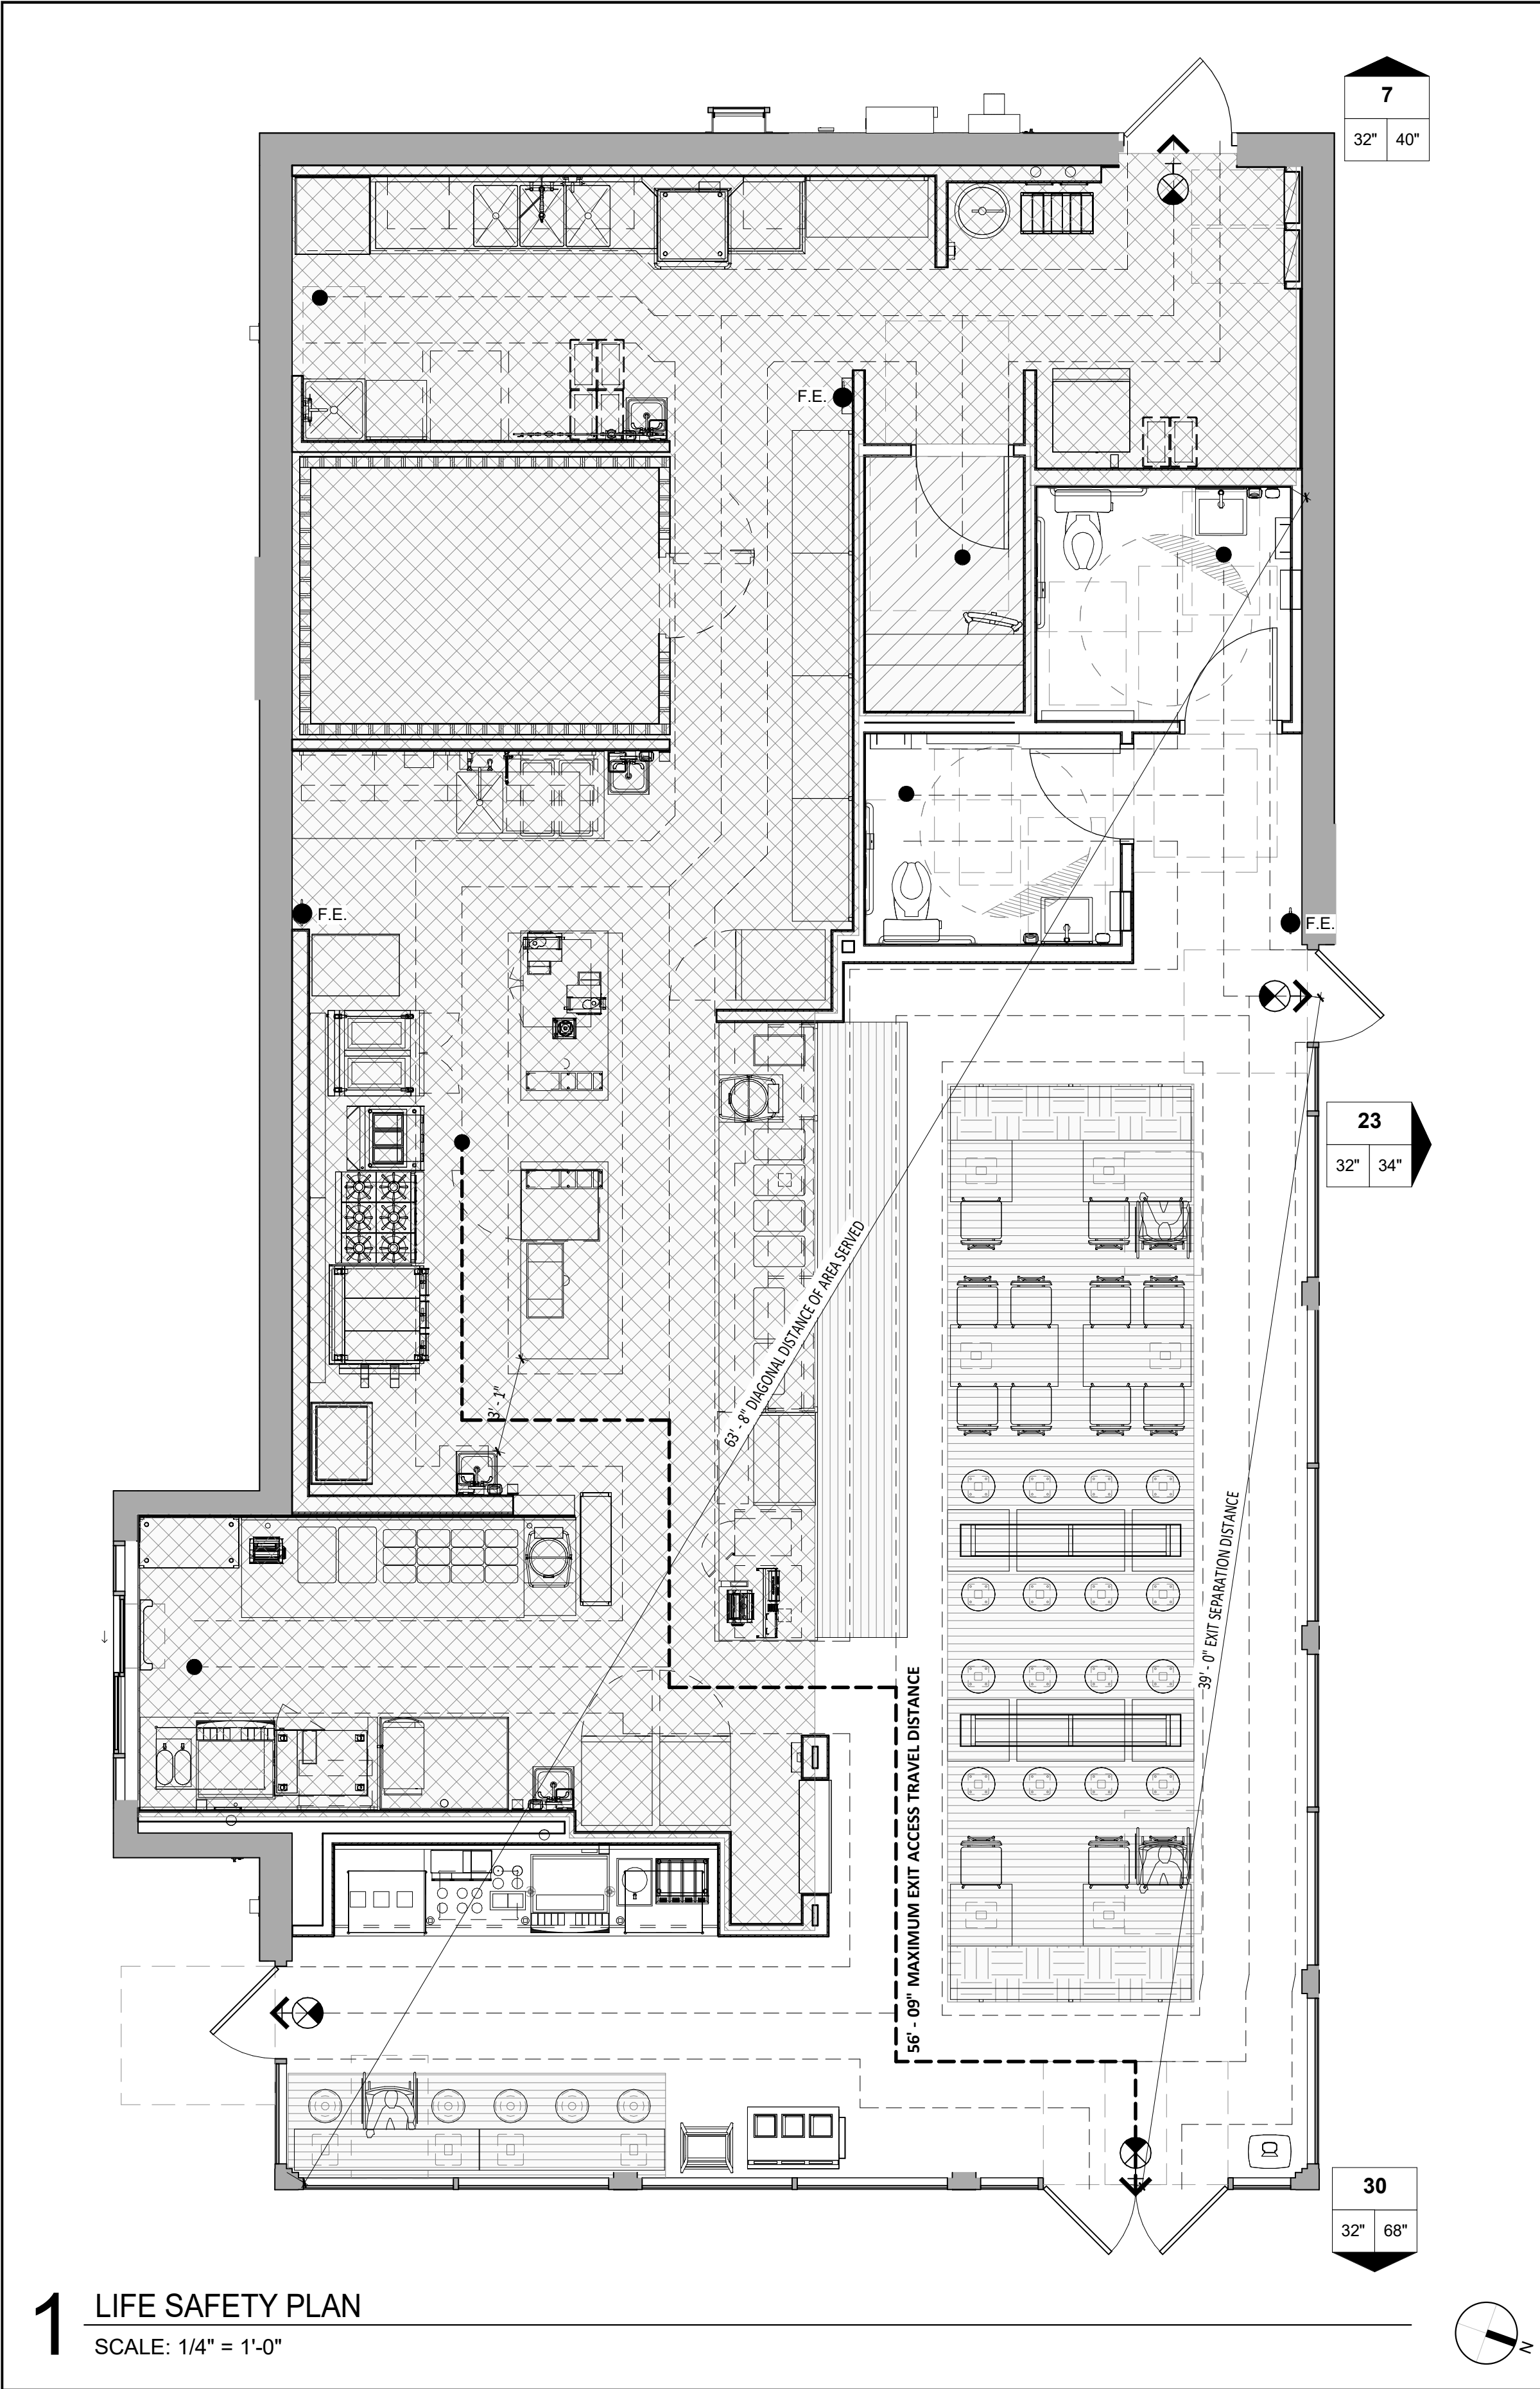

1 LIFE SAFETY PLAN
SCALE: 1/4" = 1'-0"

ABBREVIATIONS									
(E) EXISTING CONSTRUCTION	EL ELEVATION (VERTICAL HEIGHT)	HES TENANT'S HVAC EQUIPMENT SUPPLIER	MSS MUSIC SYSTEMS SUPPLIER	SS SODA POP SUPPLIER	THS TENANT'S HARDWARE SUPPLIER	TSS TENANT'S SMART SAFE SUPPLIER			
(N) NEW CONSTRUCTION	NIC NOT IN CONTRACT	SS SUPPORT SIGNAGE	NO NUMBER	T TENANT	TLs TENANT'S LIGHT/LAMP SUPPLIER	TSV TENANT'S SIGN VENDOR			
@ AT	ELEC ELECTRIC(AL)	HS HOOD SUPPLIER	OC ON CENTER	TAB TENANT'S TEST & BALLANCE VENDOR	TMB TENANT'S MENU BOARD SUPPLIER	TUV TENANT'S UV SUPPLIER			
AFF ABOVE FINISH FLOOR	ELEV ELEVATION	ICP INITIAL COST PROJECTION	OSB ORIENTED STRAND BOARD	TBD TO BE DETERMINED, SEE FIELD REFERENCE MANUAL	TMS TENANT'S MILLWORK SUPPLIER	TYP TYPICAL			
ARCH ARCHITECT(URAL)	EQ EQUAL	INT INTERIOR	PDC PROTECT DURING CONSTRUCTION	TCC TENANT'S CABLING CONTRACTOR	TP TENANT'S PHONE SUPPLIER	UNO UNLESS NOTED OTHERWISE			
ASS ALARM SYSTEM SUPPLIER	EXT EXTERIOR	KES KITCHEN EQUIPMENT SUPPLIER	POS POINT OF SALE PREPARATION	TEMS TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER	TPS TENANT PANELBOARD SUPPLIER	UPS UNINTERRUPTED POWER SUPPLY			
BD BOARD	FC FOR CONSTRUCTION	MAX MAXIMUM	PREP PREPARATION		TRS TENANT'S RAILING SUPPLIER	UPs UNINTERRUPTED POWER SUPPLY			
BLDG BUILDING	FRP FIBERGLASS REINFORCED PANEL	MECH MECHANICAL	QT QUARRY TILE		TS TENANT'S SAFE SUPPLIER	VER VERIFY IN FIELD			
CMU CONCRETE MASONRY UNIT	FRT FIRE RETARDANT-TREATED	MFR MANUFACTURER	R RADIUS			WCS TENANT'S WALK-IN COOLER SUPPLIER			
CO2 CO2 SUPPLIER	GA GAUGE	MIN MINIMUM	RTU ROOF TOP UNITS			WHS WATER HEATER SUPPLIER			
CO2AS CO2 ALARM SUPPLIER	GALV GALVANIZED	MISC MISCELLANEOUS				Ø DIAMETER OR ROUND			
DIM DIMENSION(S)	GC GENERAL CONTRACTOR								
EA EACH									

LIFE SAFETY GENERAL NOTES

- A. LIFE SAFETY SYSTEMS SHALL BE DESIGNED PER APPLICABLE FIRE PREVENTION CODE, ORDINANCE OR LAW.
- B. POST "NO PARKING - FIRE LANE" SIGNS ALONG APPROVED VEHICULAR ACCESS ROADS. COORDINATE LOCATIONS WITH LOCAL AUTHORITY HAVING JURISDICTION.
- C. AN ALL WEATHER FIRE ACCESS ROAD SHALL BE IN PLACE BEFORE ANY COMBUSTIBLE MATERIALS ARE PLACED ON SITE. COORDINATE WITH LOCAL AUTHORITY HAVING JURISDICTION.
- D. FIRE APPARATUS ACCESS ROADS SHALL BE UNOBSTRUCTED. ACCESS GATES SHALL BE APPROVED PRIOR TO INSTALLATION AND SHALL BE IN COMPLIANCE WITH O.S.H.A. GUIDELINES.
- E. COMMERCIAL DUMPSTERS OR CONTAINERS WITH A CAPACITY OF ONE AND A HALF CUBIC YARDS OR GREATER SHALL NOT BE STORED OR PLACED WITHIN FIVE FEET OF COMBUSTIBLE WALLS OR OPENINGS, UNLESS THESE AREAS ARE PROTECTED BY AN APPROVED AUTOMATIC FIRE SPRINKLER SYSTEM.
- F. BUILDING ADDRESS NUMBERS SHALL BE PROVIDED AT THE FRONT OF THE TENANT SPACE AND SHALL BE VISIBLE AND LEGIBLE FROM THE PUBLIC RIGHT-OF-WAY AND A MINIMUM OF 6" HIGH. NUMBERS SHALL CONTRAST WITH THEIR BACKGROUND. ADDRESS NUMBERS SHALL BE PROVIDED AND INSTALLED BY THE GENERAL CONTRACTOR.
- G. THE ADDRESS SHALL BE PERMANENTLY POSTED ON UTILITY SERVICE DISCONNECTS IN NUMBERS A MINIMUM OF 1" TALL AND ON THE SERVICE DOOR IN NUMBERS A MINIMUM OF 4" TALL.
- H. A KNOX BOX IS TO BE PROVIDED AND INSTALLED BY THE GENERAL CONTRACTOR. VERIFY WITH THE LOCAL AUTHORITY THIS REQUIREMENT AND COORDINATE LOCATION AS REQUIRED.
- I. COMPLETE PLANS AND SPECIFICATIONS FOR SPECIAL TYPES OF AUTOMATIC FIRE-EXTINGUISHING SYSTEMS AND OTHER FIRE PROTECTION SYSTEMS AND APPURTENANCES SHALL BE SUBMITTED TO AUTHORITIES HAVING JURISDICTION FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION.
- J. THE INSTALLATION OF THE ANSUL SYSTEM, SHALL COMPLY WITH THE BUILDING CODE AND N.F.P.A. INSTALLATION OF THE FIRE SUPPRESSION SYSTEM WILL BE PROVIDED, PERMITTED, INSTALLED AND INSPECTED UNDER A SEPARATE DEFERRED PERMIT APPLICATION.
- K. THE INSPECTION, HYDROSTATIC TESTING AND FLUSHING OF THE AUTOMATIC FIRE HYDRANTS SHALL BE WITNESSED BY THE PROPER FIRE DEPARTMENT REPRESENTATIVE AND NO UNDERGROUND PIPING SHALL BE COVERED OR HIDDEN FROM VIEW UNTIL THE PROPER FIRE DEPARTMENT REPRESENTATIVE HAS BEEN NOTIFIED AND GIVEN NO LESS THAN 48 HOURS IN WHICH TO INSPECT SUCH INSTALLATIONS.
- L. GENERAL CONTRACTOR TO FIELD VERIFY CONDITION OF EXISTING SPRINKLER SYSTEM PRIOR TO THE START OF SELECTIVE DEMOLITION. IF ITEMS ARE MISSING OR IN POOR REPAIR, GENERAL CONTRACTOR IS TO NOTIFY THE ARCHITECT AND CLIENT IMMEDIATELY.
- M. REQUIRED EGRESS DOORS SHALL BE OPENABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR EFFORT AND SHALL SWING IN THE DIRECTION OF EGRESS TRAVEL. SPECIAL LOCKING DEVICES SHALL BE OF AN APPROVED TYPE.
- N. EXITS HAVING AN INTENSITY OF NOT LESS THAN 11.0 LUX AT FLOOR LEVEL, OR AS DIRECTED BY LOCAL CODE.
- O. EXIT SIGNS TO BE PROVIDED AND INSTALLED AS REQUIRED BY APPLICABLE CODES, ORDINANCES AND LAWS.
- P. PROVIDE APPROVED EXITING ILLUMINATION AND ILLUMINATED EXIT SIGNS WHICH ARE POWERED FROM SEPARATE CIRCUITS AND COMPLY WITH THE BUILDING CODE.
- Q. OCCUPANT LOAD SIGN WITH MINIMUM 1" LETTERS AND NUMBERS SHALL BE POSTED NEAR MAIN EXIT.
- R. EXIT LIGHTING AND SIGNS SHALL HAVE 6" HIGH LETTERING IN ACCORDANCE WITH LOCAL CODES. PROVIDE LOW LEVEL EXIT SIGNS PER CODE REQUIREMENTS.
- S. FIRE DEPARTMENT FINAL INSPECTION REQUIRED.
- T. EXITS, EXIT SIGNS, FIRE ALARM PANELS, HOSE CABINETS, FIRE EXTINGUISHER LOCATIONS, AND STANDPIPE CONNECTIONS SHALL NOT BE CONCEALED BY CURTAINS, MIRRORS, OR OTHER DECORATIVE MATERIAL.
- U. FIRE EXTINGUISHER NOTES
- a. PROVIDE AND INSTALL FIRE EXTINGUISHERS AS DIRECTED BY AUTHORITY HAVING JURISDICTION. EXTINGUISHERS IN BACK OF HOUSE AREAS MAY BE IN BRACKETS. PUBLIC AREAS ARE TO BE ENCLOSED IN RECESSED CABINETS, PAINTED TO MATCH ADJACENT WALL FINISH.
- b. PROVIDE "K" TYPE FIRE EXTINGUISHER IN KITCHEN AREAS, WITHIN 30'-0" OF TRAVEL FROM ANY POINT WITHIN THE KITCHEN OR FOOD PREPARATION AREAS. VERIFY INSTALLATION LOCATIONS WITH LOCAL FIRE MARSHALL PRIOR TO INSTALLATION.
- c. 5LB, 'ABC' FIRE EXTINGUISHERS ARE REQUIRED WITHIN 75'-0" OF TRAVEL FROM ANY POINT IN PUBLIC AREAS. THEY MUST BE MOUNTED CONSPICUOUSLY, PREFERABLE ALONG NORMAL TRAVEL PATHS AND EXIT WAYS. VERIFY INSTALLATION LOCATIONS WITH LOCAL FIRE MARSHALL PRIOR TO INSTALLATION.

APPLICABLE CODES AND REGULATIONS

*INCLUDES STATE AND LOCAL PROVISIONS TO THE BUILDING CODE	
BUILDING CODE:	2018 NORTH CAROLINA BUILDING CODE
MECHANICAL CODE:	2018 NORTH CAROLINA MECHANICAL CODE
PLUMBING CODE:	2018 NORTH CAROLINA PLUMBING CODE
ENERGY CODE:	2018 NORTH CAROLINA ENERGY CONSERVATION CODE
FUEL GAS CODE:	2018 NORTH CAROLINA FUEL GAS CODE
ELECTRICAL CODE:	2020 NORTH CAROLINA ELECTRICAL CODE
FIRE CODE:	2018 NORTH CAROLINA FIRE CODE
FOOD CODE:	2017 NORTH CAROLINA FOOD CODE
ACCESSIBILITY CODE(S):	2009 NORTH CAROLINA ACCESSIBILITY CODE (2009 A117.1)

BASIS OF DESIGN

CONSTRUCTION TYPE	(EXISTING - UNCHANGED) TYPE V-B
OCCUPANCY TYPE	A-2
AREA FACTOR	NON SPRINKLERED, SINGLE STORY
BUILDING AREA	(EXISTING - UNCHANGED) 2,325 SQ FT
OCCUPANT LOAD	60 OCC.

CH3 - USE AND OCCUPANCY CLASSIFICATION

OCCUPANCY GROUP & FUNCTION	GENERAL DESCRIPTION OF SITE
A-2; RESTAURANT	FIRST TENANT WITHIN EXISTING SHELL FOR RESTAURANT T.I.

CH5 - GENERAL BUILDING HEIGHTS & AREAS

OCCUPANCY CLASSIFICATION	A-2
ALLOWABLE BUILDING HEIGHT	40'-0"
PROPOSED BUILDING HEIGHT (EXISTING - UNCHANGED)	14'-9"
At = BASIC ALLOWABLE AREA - BASED ON OCCUPANCY	At = 6,000 SQ FT.
EXISTING BUILDING AREA	2,325 SQ. FT.

CH6 - TYPES OF CONSTRUCTION

FIRE RESISTANCE RATING REQUIREMENTS FOR BUILDING ELEMENTS	
BUILDING ELEMENT	FIRE RATING REQUIRED
PRIMARY STRUCTURAL FRAME	0 HOUR
BEARING WALLS	EXTERIOR 0 HOUR INTERIOR 0 HOUR
NON-BEARING WALLS	EXTERIOR 0 HOUR
NON-BEARING WALLS AND PARTITIONS	INTERIOR 0 HOUR
FLOOR CONSTRUCTION	0 HOUR
ROOF CONSTRUCTION	0 HOUR

CH8 - INTERIOR FINISHES

TYPE OF SPACE	FINISH CLASSIFICATION
INTERIOR EXIT PASSAGEWAYS	A
CORRIDORS AND ENCLOSURE FOR EXIT ACCESS STAIRS	A
ROOMS AND ENCLOSED SPACES	C

CH9 - FIRE PROTECTION & LIFE SAFETY

SPRINKLER SYSTEM:	NON-SPRINKLERED
COMMENTS:	AUTOMATIC SPRINKLER SYSTEM NOT REQUIRED AS THE FIRE AREA DOES NOT EXCEED 5,000 SQ. FT. (464 M2).
FIRE ALARM & DETECTION SYSTEM:	NOT REQUIRED
FIRE EXTINGUISHERS:	REFER TO FIRE MARSHALL FOR FINAL LOCATIONS

CODE ANALYSIS

CH10 - MEANS OF EGRESS

FUNCTION OF SPACE	SQUARE FOOTAGE	LOAD FACTOR	OCCUPANT LOAD
STANDING SPACE	60	5 SF (NET)	12
FIXED SEATING	35 SEATS	1 SEAT/OCC.	35
FIXED SEATING - BOOTHS	144"	24" BOOTH LENGTH/OCC..	6
KITCHEN (COMM.)	1,162	200 SF (GROSS)	6
BUSINESS AREA	47	100 SF (GROSS)	1
POSTED OCCUPANT LOAD:			60

RESTAURANT SEATING COUNT	
INTERIOR SEATING COUNT	41
EXTERIOR (PATIO) SEATING COUNT	20
TOTAL SEATING COUNT	61

EGRESS REQUIREMENTS				
EXIT DOORS	FACTOR	OCC. LOAD	REQ'D WIDTH	PROP. WIDTH
EXITS PER OCC. LOAD	0.2	60	34"	36"
2 REQUIRED			4 PROVIDED (UNCHANGED)	
DIAGONAL DISTANCE OF AREA SERVED			63'-8"	
REQUIRED EXIT SEPARATION DISTANCE			31'-10"	
MAXIMUM TRAVEL DISTANCE ALLOWED			200'-0"	
MAXIMUM TRAVEL DISTANCE PROVIDED			56'-9"	
MAXIMUM COMMON PATH OF TRAVEL ALLOWED			75'-0"	
MAXIMUM COMMON PATH OF TRAVEL PROVIDED			15'-6"	
MINIMUM CLEAR EXIT WIDTH ALLOWED			36"	
CLEAR EXIT WIDTH PROVIDED			36"	

CH29 - PLUMBING SYSTEMS

PLUMBING FIXTURE REQUIREMENTS - BASED ON OCCUPANT LOAD = 60 + 20 = 80 OCC.						
USE GROUP		REQ'D WC	PROP. WC	PROP. URINALS	REQ'D LAVS	PROP. LAVS
A-2	MALE	0	0	0	0	0
	FEMALE	0	0	0	0	0
	NON-GENDER SPECIFIC *	2	2	2	2	2
				REQUIRED FIXTURES		PROPOSED FIXTURES
	DRINKING FOUNTAINS **	0			0	
	SERVICE SINK	1			1	

* WHERE THE CODE REQUIRES ONLY ONE TOILET FACILITY FOR EACH SEX, TWO UNISEX FACILITIES MAY BE SUBSTITUTED FOR SEPARATE SEX FACILITIES

** WHERE WATER IS SERVED IN RESTAURANTS, DRINKING FOUNTAINS SHALL NOT BE REQUIRED

ENERGY CODE

CLIMATE ZONE/ COUNTY:	4A / HARNETT COUNTY
-----------------------	---------------------

LIFE SAFETY LEGEND

FUNCTION OF SPACE	
	MAXIMUM EXIT ACCESS TRAVEL DISTANCE (MINIMUM WIDTH AS INDICATED IN CODE ANALYSIS)
	ACCESSIBLE PATH OF EGRESS
	EXIT ACCESS TRAVEL DISTANCE (COMMON PATH IF APPLIES)
	PROPOSED FIRE EXTINGUISHER LOCATION - GENERAL CONTRACTOR TO VERIFY THE EXACT TYPE, LOCATION(S) AND QUANTITIES WITH THE AUTHORITIES HAVING JURISDICTION PRIOR TO ORDERING AND INSTALLING FIRE EXTINGUISHERS
	WALL MOUNTED EXIT SIGN
EGRESS AT DOORS	
	EGRESS BREAKDOWN: OCCUPANTS SERVED EXIT WIDTH REQUIRED EXIT WIDTH PROVIDED
	ASSEMBLY, UNCONCENTRATED (STANDING ONLY)
	ASSEMBLY AREA WITH FIXED SEATS
	ASSEMBLY AREA WITH FIXED SEATS (BOOTHS)
	KITCHENS, COMMERCIAL AREA
	BUSINESS AREA
	UNOCCUPIED AREAS (RESTROOMS, UNOCCUPIABLE SPACES, MEANS OF EGRESS)

CONSULTANT:



CLIENT:




COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

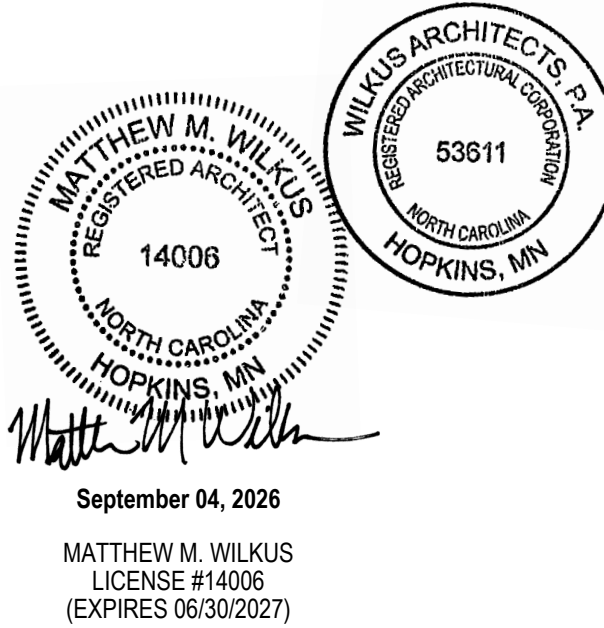

PROJECT NO: 2024-0362
DRAWN BY: JSB / KRJ
CHECKED BY: DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:

TITLE:
CODE ANALYSIS -
LIFE SAFETY PLAN

SHEET NUMBER:


G001

ICC A117.1-2009 : ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES


ALL INTERIOR CONSTRUCTION WITHIN THE SCOPE OF THIS PROJECT IS REQUIRED TO BE ACCESSIBLE AS SET FORTH IN THE "ICC A117.1-2009 ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES. SECTIONS INDICATED ON THIS SHEET REFERENCE THE "2010 ADA STANDARDS FOR ACCESSIBLE DESIGN, UNLESS NOTED OTHERWISE.

DOORS


- Doors, doorways, and gates that are part of an accessible route shall comply with 404.
- Door openings shall provide a clear width of 32 inches, unless the opening is more than 24 inches deep, in which case the clear width of the opening shall be 36 inches. For swinging doors, the clear width shall be measured between the face of the door and the stop, with the door open 90 degrees.
- There shall be no projections into the clear opening lower than 34 inches. Projections into the clear opening between 34 inches and 80 inches shall not exceed 4 inches.
- In accordance with 404.2.3 exception 2, door closers and stops shall be permitted to be a minimum of 78 inches above the floor or ground.
- Minimum maneuvering clearances at swinging doors shall comply with ICC A117.1-2009 Section 404.2.3, Table 404.2.3.2 and Figure 404.2.3.2.
- Fire doors shall have a minimum opening force allowable by the appropriate administrative authority.
- Hinged doors other than fire doors shall have an opening force of 5 pounds maximum.
- Sliding doors shall have an opening force of 5 pounds maximum.
- Door and gate surfaces shall comply with 404.2.10.
- Doors shall be permitted to swing into turning spaces, per 304.4.
- Two doors in a series shall comply with ICC A117.1-2009 Section 404.2.5 and Figure 404.2.5.

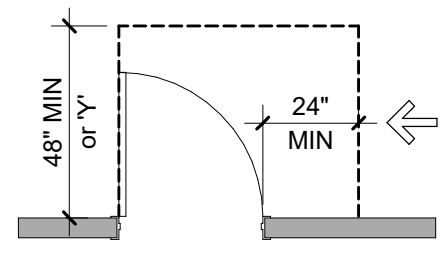


NOTE: Y = 54" MIN.
if door has a closer

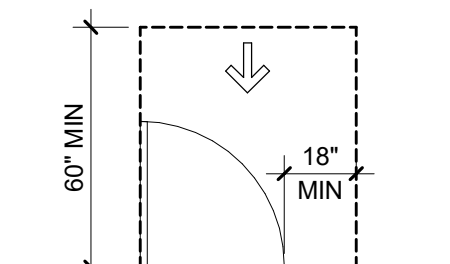


NOTE: X = 12" MIN.
if door has both a
closer and a latch

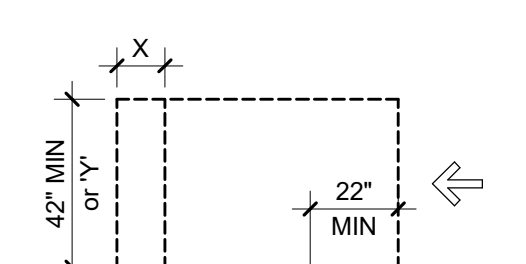


NOTE: Y = 48" MIN.
if door has
both a closer
and a latch

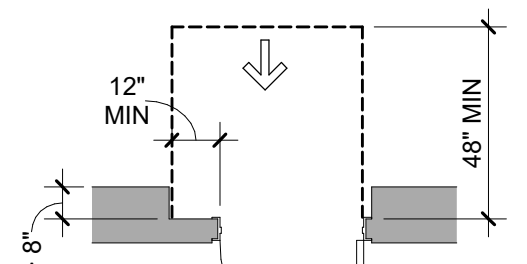


NOTE: Door has
both a closer
and a latch



NOTE: Door can have
either a latch
OR closer, but
not both

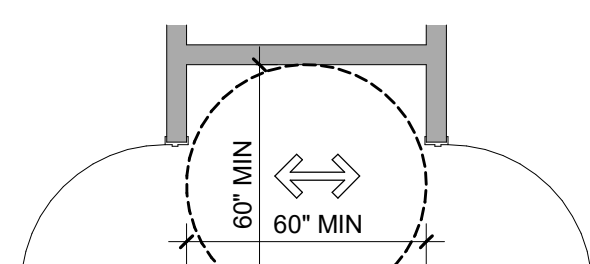

NOTE: Door can have
either a latch
OR closer, but
not both

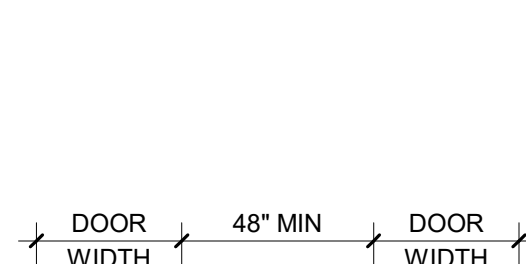

NOTE: Door can have
either a latch
OR closer, but
not both

Latch-Side Approaches - Swinging Doors

Front Approaches - Swinging Doors

Hinge-Side Approaches - Swinging Doors


Recessed Doors and Gates

Doors in Series and Gates in Series


2010 ADA STANDARDS FOR ACCESSIBLE DESIGN - RESTROOMS & DRINKING FOUNTAINS

- Where toilet facilities are provided, they shall comply with 213. Where toilet rooms are provided, each toilet room shall comply with 603.
- Where toilet compartments are provided, at least one toilet compartment shall comply with 604.8.1. In addition to the compartment required to comply with 604.8.1, at least one compartment shall comply with 604.8.2 where six or more toilet compartments are provided, or where the combination of urinals and water closets totals six or more fixtures.
- Mirrors located above lavatories or countertops shall be installed with the bottom edge of the reflecting surface 40 inches maximum above finish floor or ground. Mirrors not located above lavatories or countertops shall be installed with the bottom edge of the reflecting surface 35 inches maximum above the finish floor or ground.
- Coat hooks shall be located within one of the reach ranges specified in 308. Shelves shall be located 40 inches minimum and 48 inches maximum above the finish floor.


- Water closets shall comply with 604.2 through 604.8.
- Toilet paper dispensers shall comply with 309.4 and shall be 7 inches minimum and 9 inches maximum in front of the water closet measured to the centerline of the dispenser. The outlet of the dispenser shall be 15 inches minimum and 48 inches maximum above the finish floor and shall not be located behind grab bars. Dispensers shall not be of a type that controls delivery or that does not allow continuous paper flow.
- Grab bars shall be provided at water closets and shall comply with 609.
- Urinals shall comply with 605 and shall be either wall-hung or stall type urinals.
- Lavatories shall comply with 606. Faucets for lavatories shall comply with 606.4. Exposed pipes under lavatories shall be insulated or otherwise protected to prevent against contact.
- Drinking Fountains shall comply with sections 307 and 602.

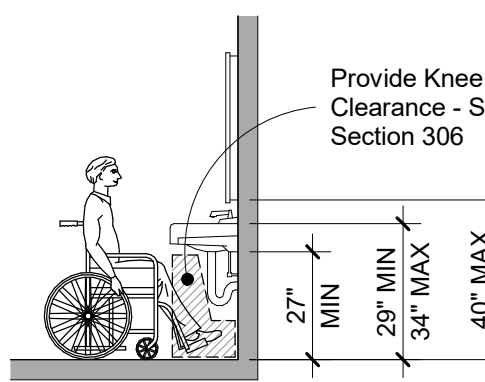


Clearances & Heights at Lavatory

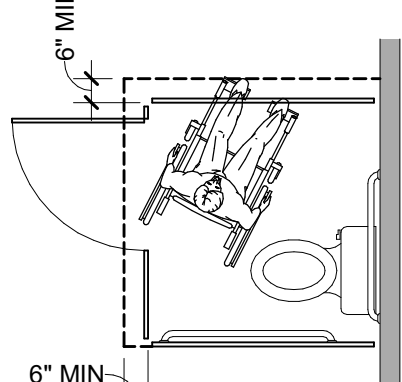


Stall Compartment Toe Clearance

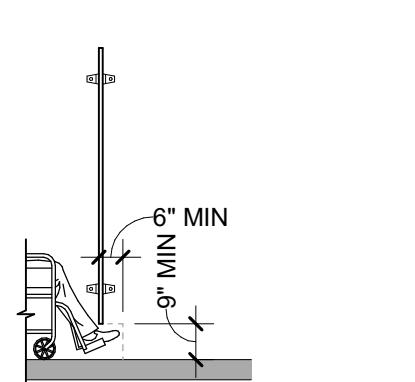


Drinking Fountain Clearance and Spout Location

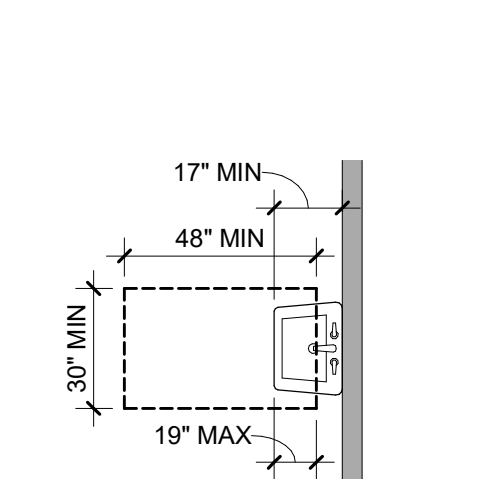


Lavatory Clearance

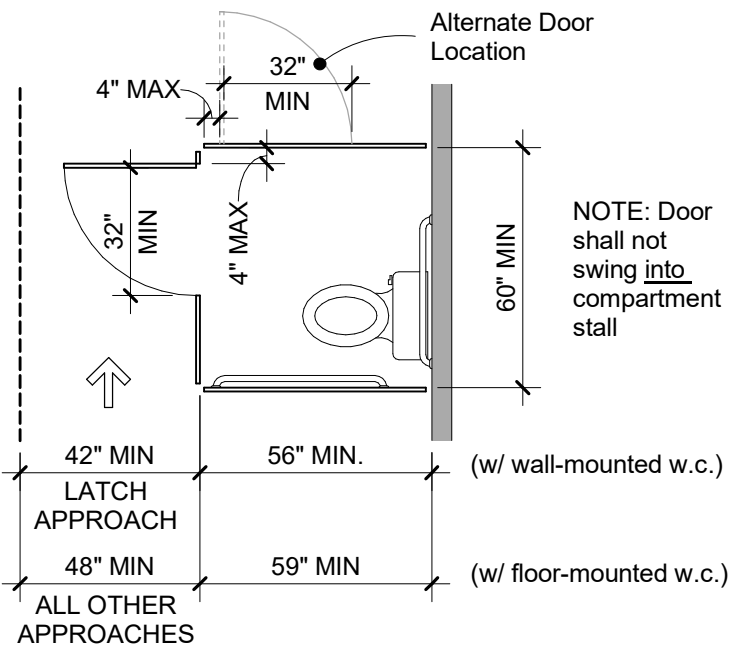


Standard Stall

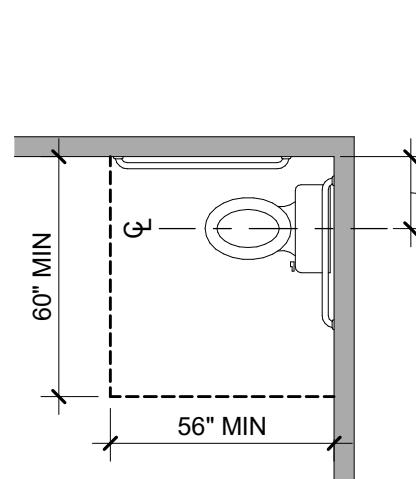


Clear Floor Space and Water Closet Location

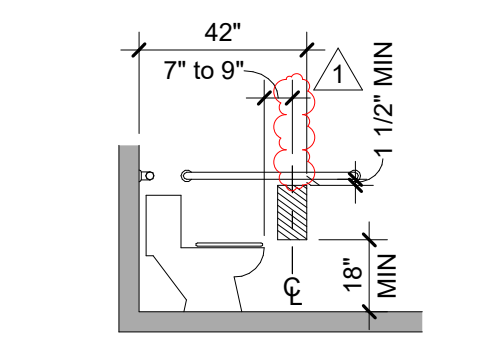

Toilet Paper Dispenser Location

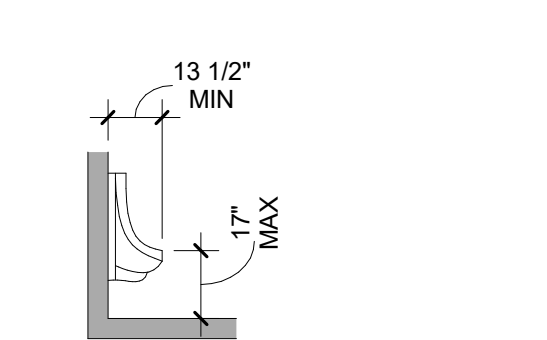


Height and Depth of Urinal

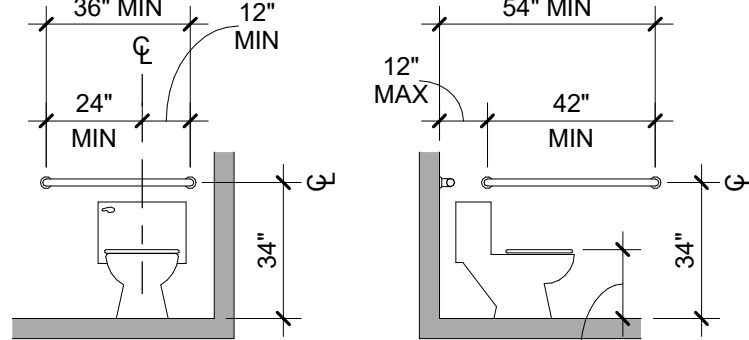

Grab Bars at Water Closets

SIGNAGE


- Signs shall comply with 703.
- Signs identifying permanent rooms and spaces shall comply with 703.1, 703.2, and 703.5. Where pictograms are provided as designations of permanent rooms and spaces, the pictograms shall comply with 703.6 and shall have text descriptors complying with 703.2 and 703.5.
- Signs that provide direction to or information about spaces and facilities shall comply with 703.5.
- Where more than one check-out aisle is provided, check-out aisles complying with 904.3 shall be identified by the International Symbol of Accessibility complying with 703.7.2.1. Where check-out aisles are identified by numbers, letters, or functions, signs identifying check-out aisles complying with 904.3 shall be located in the same location as the check-out aisle identification.

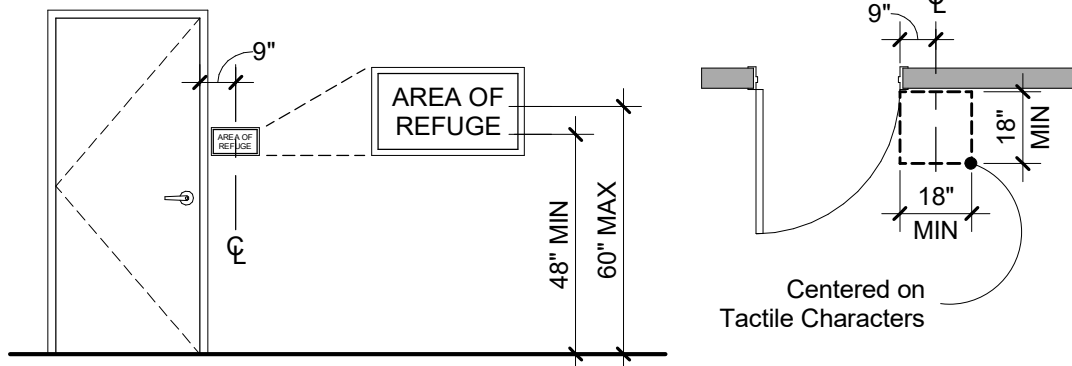

Centered on Tactile Characters

FOODSERVICE LINES, TABLEWARE AREAS & CHECKOUT AISLES


- Where check-out aisles are provided, check-out aisles shall comply with 904.3 and be dispersed.
- Where provided, at least one of each type of sales counter and service counter shall comply with 904.4. Where counters are dispersed throughout the building or facility, counters complying with 904.4 also shall be dispersed.
- Food service lines shall comply with 904.5. Where self-service shelves are provided, at least 50 percent, but no fewer than one, of each type provided shall comply with 308.
- Queues and waiting lines servicing counters or check-out aisles required to comply with 904.3 or 904.4 shall comply with 403.
- Check-out aisles and sales and service counters shall comply with the applicable requirements of 904.
- All points of counters required to comply with 904 shall be located adjacent to a walking surface complying with 403.

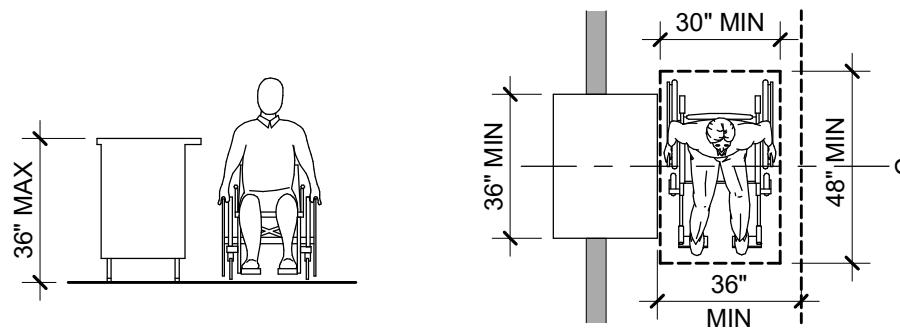


Parallel Approach at Sales & Service Counters

REACH RANGES, CONTROLS & OPERATING MECHANISMS


- Reach ranges shall comply with 308.
- Operable parts shall comply with 309 and shall be placed within one or more of the reach ranges specified in 308.
- In accordance with 309.4, operable parts shall be operable with one hand and shall not require tight grasping, pinching, or twisting of the wrist. The force required to activate operable parts shall be 5 pounds maximum.

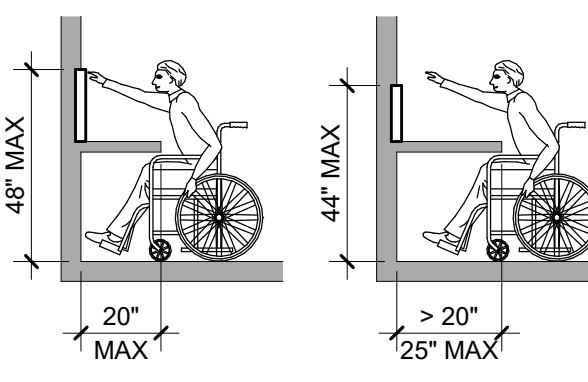


Obstructed Forward Reach

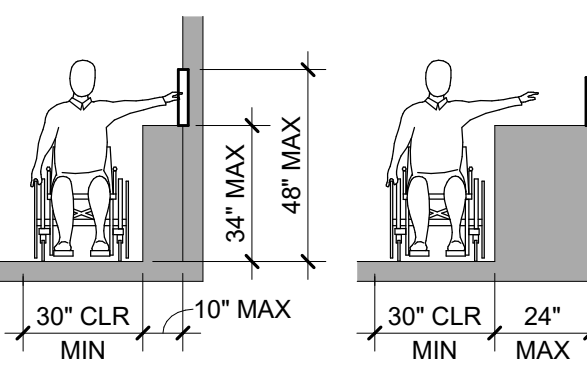

Obstructed Side Reach

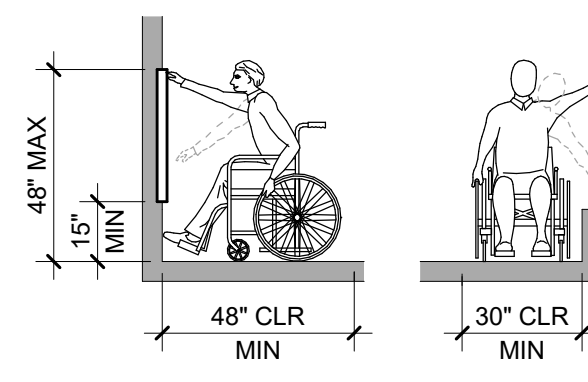


Unobstructed Forward Reach

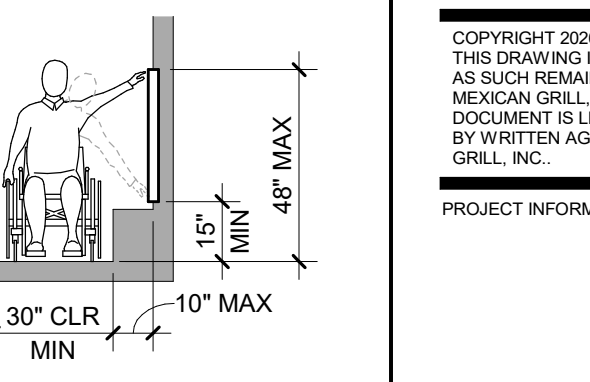


Unobstructed Side Reach

PATH OF TRAVEL


- The running slopes of walking surfaces that are part of an accessible route shall not be steeper than 1:20 with a cross slope that is not steeper than 1:48.
- Changes in level shall comply with ICC A117.1-2009 Section 303.
- The clear width of walking surfaces on an accessible route shall comply with 403.5.1.
- The clear width at turns along an accessible route shall comply with 403.5.2.
- In accordance with 403.5.3, an accessible route with a clear width of less than 60 inches shall provide passing spaces at intervals of 200 feet.

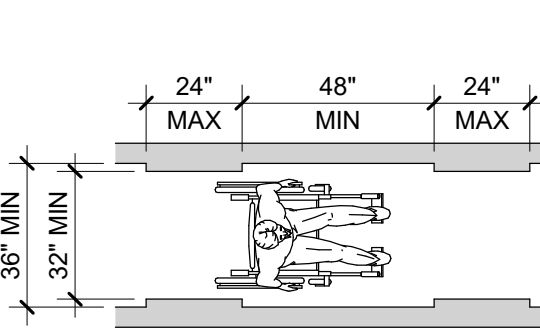

Clear Width of an Accessible Route

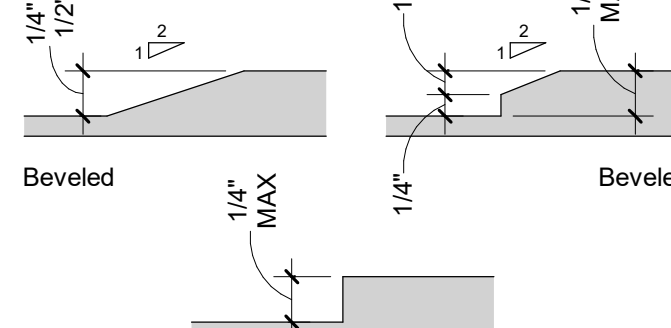


Changes in Level

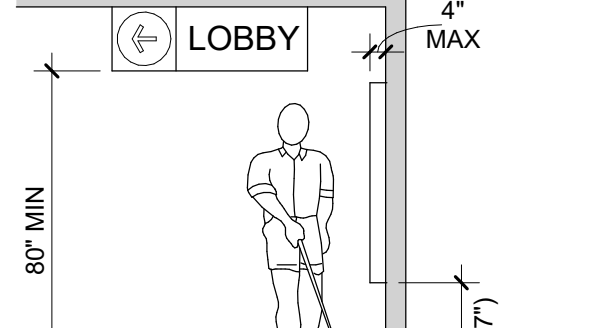


Walking Parallel To A Wall

SEATING AT TABLES & COUNTERS

- Where dining surfaces are provided for the consumption of food and drink, at least 5 percent of the seating spaces and standing spaces at the dining surfaces shall comply with 902. In addition, where work surfaces are provided for use by other than employees, at least 5 percent shall comply with 902. Confirm actual seat counts with Table 221.2.1.
- Dining surfaces and work surfaces required to comply with 902 shall be dispersed throughout the space or facility containing dining surfaces and work surfaces.
- Dining surfaces and work surfaces shall comply with 902.2 and 903.3.

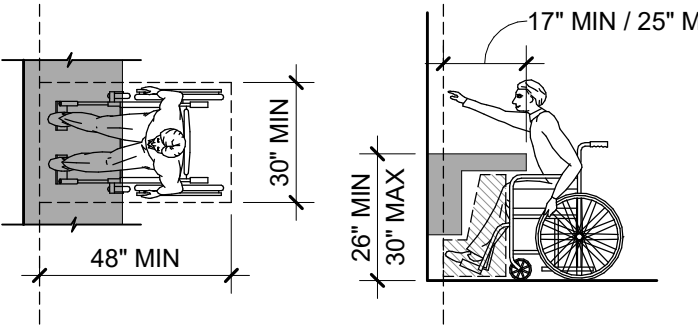

Toe and Knee Clearances

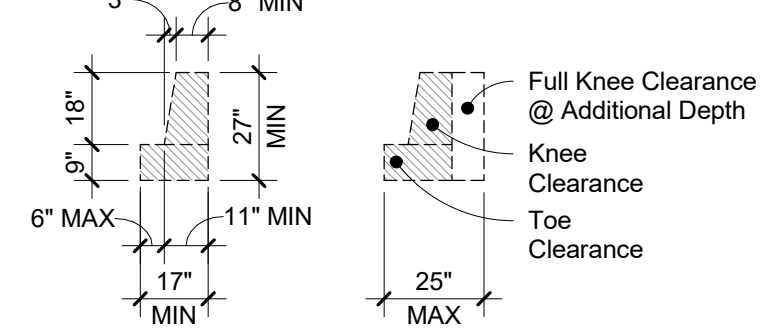

Full Knee Clearance @ Additional Depth

CONSULTANT:



CLIENT:



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 315-2652
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:


STORE NO.: 5644

"CAMERON NC"

TBD NC 24-87

CAMERON, NC 28326

SEAL:

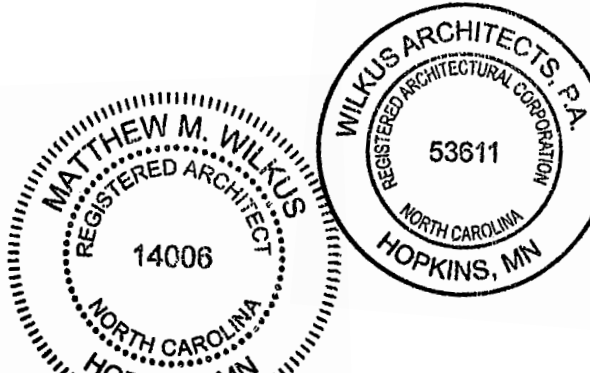

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES

TITLE:

ACCESSIBILITY
STANDARDS

SHEET NUMBER:

G002

2018 APPENDIX B
BUILDING CODE SUMMARY FOR ALL COMMERCIAL PROJECTS
(EXCEPT 1 AND 2-FAMILY DWELLINGS AND TOWNHOUSES)
(Reproduce the following data on the building plans sheet 1 or 2)

Name of Project: Chipotle Mexican Grill - "Cameron, NC"
Address: NC 24-87, Cameron, NC Zip Code 28326
Owner/Authorized Agent: Chipotle Mexican Grill Phone # (614) 816 - 1382 E-Mail: heather.conley@chipotle.com
Owned By: ☐ City/County ☒ Private ☐ State
Code Enforcement Jurisdiction: ☐ City ☒ County Harnett ☐ State

CONTACT:

DESIGNER	FIRM	NAME	LICENSE #	TELEPHONE #	E-MAIL
Architectural	Wilkus Architects, P.A.	Matt Wilkus	14006	(952) 592-6872	jts@wilkusarch.com
Civil	N/A	N/A	N/A	N/A	N/A
Electrical	National Engineering	Richard T. Jones	031346	(720) 629-5752	epalma@nationalengineering.com
Fire Alarm	N/A	N/A	N/A	N/A	N/A
Plumbing	National Engineering	Richard T. Jones	031346	(720) 629-5752	epalma@nationalengineering.com
Mechanical	National Engineering	Richard T. Jones	031346	(720) 629-5752	epalma@nationalengineering.com
Sprinkler-Standpipe	N/A	N/A	N/A	N/A	N/A
Structural	VAA Engineering	Keith W. Jacobson	034594	(507) 665-6255	tmahr@vaaeng.com
Retaining Walls >5' High	N/A	N/A	N/A	N/A	N/A
Other	N/A	N/A	N/A	N/A	N/A

(*Other* should include firms and individuals such as truss, precast, pre-engineered, interior designers, etc.)

2018 NC BUILDING CODE: ☐ New Building ☐ Addition ☐ Renovation
☒ 1st Time Interior Completion
☐ Shell/Core - Contact the local inspection jurisdiction for possible additional procedures and requirements
☐ Phased Construction - Shell/Core- Contact the local inspection jurisdiction for possible additional procedures and requirements

2018 NC EXISTING BUILDING CODE: EXISTING: ☐ Prescriptive ☐ Repair ☐ Chapter 14
Alteration: ☐ Level I ☐ Level II ☐ Level III
☐ Historic Property ☐ Change of Use

CONSTRUCTED: (date) Proposed 2025 CURRENT OCCUPANCY(S) (Ch. 3): Vacant
RENOVATED: (date) N/A PROPOSED OCCUPANCY(S) (Ch. 3): A-2 (Assembly) Restaurant
RISK CATEGORY (Table 1604.5): Current: ☐ I ☐ II ☐ III ☐ IV
Proposed: ☐ I ☒ II ☐ III ☐ IV

BASIC BUILDING DATA

Construction Type: ☐ I-A ☐ II-A ☐ III-A ☐ IV ☐ V-A
☐ I-B ☐ II-B ☐ III-B ☒ V-B
(check all that apply)
Sprinklers: ☒ No ☐ Partial ☐ Yes ☐ NFPA 13 ☐ NFPA 13R ☐ NFPA 13D
Standpipes: ☒ No ☐ Yes Class ☐ I ☐ II ☐ III ☐ Wet ☐ Dry
Fire District: ☒ No ☐ Yes Flood Hazard Area: ☒ No ☐ Yes
Special Inspections Required: ☐ No ☒ Yes (Contact the local inspection jurisdiction for additional procedures and requirements.)

2018 NC Administrative Code and Policies

Gross Building Area Table			
FLOOR	EXISTING (SQ FT)	NEW (SQ FT)	SUB-TOTAL
3 rd Floor	N/A	N/A	N/A
2 nd Floor	N/A	N/A	N/A
Mezzanine	N/A	N/A	N/A
1 st Floor	2,325 SF	0	2,325 SF
Basement	N/A	N/A	N/A
TOTAL	2,325 SF	0	2,325 SF

ALLOWABLE AREA

Primary Occupancy Classification(s):

Assembly ☐ A-1 ☒ A-2 ☐ A-3 ☐ A-4 ☐ A-5
Business ☐
Educational ☐
Factory ☐ F-1 Moderate ☐ F-2 Low
Hazardous ☐ H-1 Detonate ☐ H-2 Deflagrate ☐ H-3 Combust ☐ H-4 Health ☐ H-5 HPM
Institutional ☐ I-1 Condition ☐ 1 ☐ 2
☐ I-2 Condition ☐ 1 ☐ 2
☐ I-3 Condition ☐ 1 ☐ 2 ☐ 3 ☐ 4 ☐ 5
☐ I-4
Mercantile ☐
Residential ☐ R-1 ☐ R-2 ☐ R-3 ☐ R-4
Storage ☐ S-1 Moderate ☐ S-2 Low ☐ High-piled
☐ Parking Garage ☐ Open ☐ Enclosed ☐ Repair Garage
Utility and Miscellaneous ☐

Accessory Occupancy Classification(s): N/A

Incidental Uses (Table 509): N/A

Special Uses (Chapter 4 – List Code Sections): N/A

Special Provisions: (Chapter 5 – List Code Sections): N/A

Mixed Occupancy: ☒ No ☐ Yes Separation: N/A Hr. Exception:

☐ Non-Separated Use (508.3) - The required type of construction for the building shall be determined by applying the height and area limitations for each of the applicable occupancies to the entire building. The most restrictive type of construction, so determined, shall apply to the entire building.

☐ Separated Use (508.4) - See below for area calculations for each story, the area of the occupancy shall be such that the sum of the ratios of the actual floor area of each use divided by the allowable floor area for each use shall not exceed 1.

$$\frac{\text{Actual Area of Occupancy A}}{\text{Allowable Area of Occupancy A}} + \frac{\text{Actual Area of Occupancy B}}{\text{Allowable Area of Occupancy B}} \leq 1$$

2018 NC Administrative Code and Policies

STORY NO.	DESCRIPTION AND USE	(A) BLDG AREA PER STORY (ACTUAL)	(B) TABLE 506.2 ¹ AREA	(C) AREA FOR FRONTAGE INCREASE ^{1,3}	(D) ALLOWABLE AREA PER STORY OR UNLIMITED ^{2,3}
1	A-2 (RESTAURANT)	2,325 SF	6,000 SF	N/A	6,000 SF

- ¹ Frontage area increases from Section 506.3 are computed thus:
a. Perimeter which fronts a public way or open space having 20 feet minimum width = ____ (F)
b. Total Building Perimeter = ____ (P)
c. Ratio (F/P) = ____ (F/P)
d. W = Minimum width of public way = ____ (W)
e. Percent of frontage increase $f_f = 100[F/P - 0.25] \times W/30 = \text{____} (\%)$
² Unlimited area applicable under conditions of Section 507.
³ Maximum Building Area = total number of stories in the building x D (maximum³ stories) (506.2).
⁴ The maximum area of open parking garages must comply with Table 406.5.4.
⁵ Frontage increase is based on the unsprinklered area value in Table 506.2.

ALLOWABLE HEIGHT

	ALLOWABLE	SHOWN ON PLANS	CODE REFERENCE ¹
Building Height in Feet (Table 504.3) ²	40'-0"	14'-8"	504.3 & 504.4
Building Height in Stories (Table 504.4) ³	1	1	504.3 & 504.4

¹ Provide code reference if the "Shown on Plans" quantity is not based on Table 504.3 or 504.4.

² The maximum height of air traffic control towers must comply with Table 412.3.1.1.

³ The maximum height of open parking garages must comply with Table 406.5.4.

2018 NC Administrative Code and Policies

FIRE PROTECTION REQUIREMENTS						
BUILDING ELEMENT	FIRE SEPARATION DISTANCE (FEET)	REQ'D	RATING PROVIDED (W/ REDUCTION)	DETAIL # AND SHEET #	DESIGN # FOR RATED ASSEMBLY	SHEET # FOR RATED PENETRATION
Structural Frame, including columns, girders, trusses		0 HR	0 HR			
Bearing Walls						
Exterior						
North						
East						
West						
South						
Interior						
Nonbearing Walls and Partitions						
Exterior walls						
North						
East						
West						
South						
Interior walls and partitions						
Floor Construction Including supporting beams and joists						
Floor Ceiling Assembly		N/A	N/A			
Columns Supporting Floors						
Roof Construction, including supporting beams and joists						
Roof Ceiling Assembly						
Columns Supporting Roof						
Shaft Enclosures - Exit						
Shaft Enclosures - Other						
Corridor Separation						
Occupancy/Fire Barrier Separation						
Party/Fire Wall Separation						
Smoke Barrier Separation						
Smoke Partition						
Tenant Dwelling Unit/Sleeping Unit Separation						
Incidental Use Separation						

* Indicate section number permitting reduction

2018 NC Administrative Code and Policies

PERCENTAGE OF WALL OPENING CALCULATIONS			
FIRE SEPARATION DISTANCE (FEET) FROM PROPERTY LINES	DEGREE OF OPENINGS PROTECTION (TABLE 705.8)	ALLOWABLE AREA (%)	ACTUAL SHOWN ON PLANS (%)
	N/A - PER TABLE 705.8 - AS LONG AS THE BUILDING IS 30'-0" OR MORE FROM ANOTHER STRUCTURE, THERE IS NO LIMIT ON OPENINGS		

LIFE SAFETY SYSTEM REQUIREMENTS

Emergency Lighting: ☐ No ☒ Yes
Exit Signs: ☐ No ☒ Yes
Fire Alarm: ☒ No ☐ Yes
Smoke Detection Systems: ☐ No ☒ Yes ☐ Partial DUCT DETECTORS
Carbon Monoxide Detection: ☒ No ☐ Yes

LIFE SAFETY PLAN REQUIREMENTS

Life Safety Plan Sheet #: G001

- ☐ Fire and/or smoke rated wall locations (Chapter 7)
☐ Assumed and real property line locations (if not on the site plan)
☐ Exterior wall opening area with respect to distance to assumed property lines (705.8)
☒ Occupancy Use for each area as it relates to occupant load calculation (Table 1004.1.2)
☒ Occupant loads for each area
☒ Exit access travel distances (1017)
☒ Common path of travel distances (Tables 1006.2.1 & 1006.3.2(1))
☐ Dead end lengths (1020.4)
☒ Clear exit widths for each exit door
☒ Maximum calculated occupant load capacity each exit door can accommodate based on egress width (1005.3)
☒ Actual occupant load for each exit door
☐ A separate schematic plan indicating where fire rated floor/ceiling and/or roof structure is provided for purposes of occupancy separation
☒ Location of doors with panic hardware (1010.1.10)
☐ Location of doors with delayed egress locks and the amount of delay (1010.1.9.7)
☐ Location of doors with electromagnetic egress locks (1010.1.9.9)
☐ Location of doors equipped with hold-open devices
☐ Location of emergency escape windows (1030)
☒ The square footage of each fire area (202)
☐ The square footage of each smoke compartment for Occupancy Classification I-2 (407.5)
☐ Note any code exceptions or table notes that may have been utilized regarding the items above

2018 NC Administrative Code and Policies

ACCESSIBLE DWELLING UNITS (SECTION 1107)							
TOTAL UNITS	ACCESSIBLE UNITS REQUIRED	ACCESSIBLE UNITS PROVIDED	TYPE A UNITS REQUIRED	TYPE A UNITS PROVIDED	TYPE B UNITS REQUIRED	TYPE B UNITS PROVIDED	TOTAL ACCESSIBLE UNITS PROVIDED
N/A							

ACCESSIBLE PARKING (SECTION 1106)						
LOT OR PARKING AREA	TOTAL # OF PARKING SPACES REQUIRED	PROVIDED	# OF ACCESSIBLE SPACES PROVIDED			TOTAL # ACCESSIBLE PROVIDED
			REGULAR WITH 5' ACCESS AISLE	VAN SPACES WITH 13'2" ACCESS AISLE	8' ACCESS AISLE	
N/A	23	31				2 BY OTHERS
TOTAL						2 BY OTHERS

PLUMBING FIXTURE REQUIREMENTS (TABLE 2902.1)									
USE	WATERCLOSETS			URINALS			LAVATORIES		
	MALE	FEMALE	UNSEX	MALE	FEMALE	UNSEX	MALE	FEMALE	UNSEX
EXIST'G	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
NEW	0	0	2	N/A	0	0	2	N/A	*See Below
REQ'D	0	0	2	N/A	0	0	2	N/A	N/A

SPECIAL APPROVALS

Special approval: (Local Jurisdiction, Department of Insurance, OSC, DPI, DHHS, etc., describe below)

*Exception: Per 2018 NCPC section 410.4
Where restaurants, night clubs, taverns or bars provide drinking water in a container free of charge, drinking fountains shall not be required in those establishments

2018 NC Administrative Code and Policies

CONSULTANT:



CLIENT:




CHIPOTLE MEXICAN GRILL, INC.
PO BOX 18266
COLUMBUS, OH 43218-2666
TELEPHONE: (614) 318-2662
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

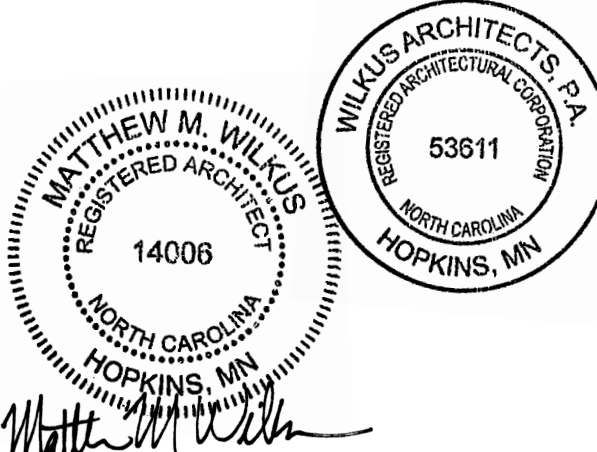

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362

DRAWN BY JSB / KRJ

CHECKED BY DLA

ISSUE RECORD:

03/07/2025 PERMIT SET

05/29/2025 BID SET

REVISIONS:

TITLE:

APPENDIX B

SHEET NUMBER:

G003

SECTION 07512 - ROOFING SYSTEM REPAIR

1.1 General: When penetration of the existing roofing system is required to accommodate new construction, perform necessary roofing system repair.

- A. Coordination: Before starting work, verify with the Tenant's Construction Manager and the Owner the following:
- Existing roof system materials and installation methods.
 - Repair work responsibilities and warranty requirements. To maintain original warranty, where provided use original roof contractor.
- B. Qualifications: Repair work shall be performed only by an experienced roofing installer approved or licensed by the existing roofing system materials manufacturer; with not less than five years of successful experience installing and repairing roofing systems similar to this projects existing roofing system.

2.1 Materials:

- A. Provide and install only materials approved and recommended by the roofing manufacturer for repairing the existing roofing system.

3.1 Installation:

- A. Preparation: Inspect roof surface conditions with roof manufacturer's representative to verify extent and location of any other repairs required to ensure a watertight roofing system upon completion of the repair work.
- B. Make necessary repairs. Match existing roof slope, insulation materials and roofing membrane materials, except as otherwise approved by the existing roofing system manufacturer to accommodate new construction and repair work.
- C. Install curb flashing furnished by mechanical and electrical trades for new roof top equipment.

SECTION 07540 - THERMOPLASTIC MEMBRANE (PVC) ROOFING

1.1 General: Provide the thermoplastic membrane (PVC) roofing system as shown and specified.

- A. Standards: Materials and construction shall conform to following:
- ASTM D5036 "Application of Adhered Poly(Vinyl Chloride) Sheet Roofing."
 - FM 1-29 Loss Prevention Data Adhered or Mechanically Attached Single Ply Membrane Roof Systems."
 - NRCA "Single-Ply Roofing Membrane."
 - UL "790 - Tests for Fire Resistance of Roof Covering Materials."
- B. Installer Qualifications: An experienced roofing installer approved by roofing system manufacturer and with not less than five years of successful experience installing membrane roofing systems similar to those required for this project.
- C. Deliver, store and handle roof system materials in accordance with manufacturer's recommendations to avoid damage and deterioration.
- Comply with manufacturer's recommendations for protection during installation.
- D. Install roofing work only when weather conditions ensure compliance with manufacturer's specific environmental requirements and conditions will permit work to be performed in accordance with manufacturer's recommendations and warranty requirements.
- Protect adjacent materials and surfaces from damage and soiling during roofing system installation.
 - Provide special protection on completed roofing work.
 - Protect paving and structure walls adjacent to hoists before starting work.
 - Do not overload the building structure with storage of materials or installation equipment on the substrate decking.
- E. Warranty
- Contractor and roof system installer shall jointly warrant roofing materials and installation for a period of two years from the date of Substantial Completion. Warranty shall include roofing membrane, flashing, roof insulation, roofing accessories and sheet metal work provided under Section 07600.
 - Manufacturer's warranty: Submit executed copy of roofing system manufacturer's 15 year total system warranty, including labor and materials for the entire roof system. Including perimeter edge metal, Section 07600 Flashing & Sheet Metal

2.1 Materials

- A. Manufacturer: Duro-Last Roofing, Inc. (800)248-0280, Austin Russell, austin.russell@hclm.com, www.duro-last.com
- Basic of Design Product Roofing System
 - Thermoplastic single ply membrane roofing system: DL Membrane (PVC) fully adhered, smooth surface, UL Class A fire-rated single ply membrane roofing system.
 - Thermoplastic fiber reinforced PVC membrane, not less than 40 mils (.040), complying with ASTM D4434 and membrane manufacturer's published physical properties.
- B. Comparable Alternate Roof Manufacturers:
- Versico Roofing Systems, (480) 528-6923, Jeff Kelly, jeff.kelly@versico.com
 - VersiFlex PVC Adhered System
 - Other comparable alternates can be considered when approved by Arch PM and Chipotle DM/CM.
- C. The roof covering design must resist a wind load of 100 mph, Exposure C and shall resist impact damage based on results of tests based on the results of tests conducted in accordance with ASTM D 3746, ASTM D 4272, CGSB 37-GP-52M or FM 4470
- Insulation cover board: Georgia-Pacific Corp. (800) 284-5347, internet www.gp.com, "Dens-Deck" nonstructural fiberglass-faced, silicone-treated gypsum core panels, 1/2" thickness.
 - Roof insulation: Rigid closed cell polyisocyanurate boards approved by the membrane manufacturer; complying with ASTM C1289, Type II, minimum 20 psi compressive strength, aged R-value equal 5.6 per inch of thickness.
 - Provide a double layer installation. Minimum total R-value as indicated on plans.
 - Specified perimeter edge metal shall be compliant with International Building Code ANSI / SPRI ES-1, ER2 testing requirements.
 - Flashing: Roof system manufacturer's standard sheet flashing of same material, type, and color as sheet membrane. Specified perimeter edge metal will be compliant with International Building Code ANSI / SPRI ES-1, RE2 testing requirements.
 - Membrane Bonding Adhesive: Roof system manufacturer's standard membrane bonding adhesive.
 - Insulation and Cover Board Adhesive: Dow Chemical Company, (888) 868-1183, internet www.flexibeproducts.com, "INSTA-STIK Professional Roof Insulation Adhesive", a single component, moisture cured polyurethane adhesive.
 - Fasteners: Roof system manufacturer's standard fasteners for project conditions indicated.
 - Accessories: Roof system manufacturer's recommended pourable sealant for preformed penetration flashing, preformed corner flashing, seam caulk, termination bars and drainage required for substrate surfaces and installation conditions indicated.
 - Traffic walkways: Duro-Last Roof Track II with 1/2" x 3/4" x 1/4" aluminum

3.1 Installation

- A. Preparation:
- Clean substrate surfaces of debris and other substances detrimental to roofing installation.
 - Correct unsatisfactory conditions before starting roofing. Roof deck surface conditions shall comply with manufacturer's requirements and be acceptable to the roofing system installer.
- B. Installation:
- General: Provide roofing system materials and installation complying with roofing system manufacturer's instructions and governing codes and regulations.
 - Mix and apply roof insulation and cover board adhesive in strict accordance with the adhesive manufacturer's installation instructions. Dispense adhesive at manufacturer's recommended application rate using approved dispensing equipment.
 - Roof insulation
 - Extend insulation full thickness over entire surface to be insulated. Cut and fit around obstructions; fill all voids with insulation. Provide saddles and tapered edges as required to provide positive proper drainage.
 - Install and secure in place with insulation adhesive, a double layer of insulation units of the required thickness. Run long joints of insulation in continuous straight lines, perpendicular to roof slope, with end joints staggered between rows. Stagger joints of each layer of insulation. Butt edges to moderate contact. Limit joints between adjacent units to maximum 1/4".
 - Insulation cover board: Install and secure in place with insulation adhesive a single layer of insulation cover board on installed roof insulation. Secure cover board in accordance with membrane manufacturer's recommendations. Stagger joints with joints of roof insulation.

- Thermoplastic membrane: Comply with membrane manufacturer's instructions and recommendations for handling and installing single ply membrane roofing.
- Unroll and position roofing sheet membrane without stretching. Align top sheet with pr-measured lines on bottom sheet. Allow membrane to "relax" for at least 30 minutes before adhering, flashing and flashing.
- Adhere membrane to insulation cover board with bonding agent. Bonded membrane to achieve maximum contact.
- Join membrane seams using approved heat welding equipment. Check all splices for voids and repair voids with heat gun and roller.
- When required, mechanically fasten membrane at roof perimeter, curb flashing and similar penetrations in accordance with manufacturer's installation instructions.
- Flash and make weathertight all equipment curbs, pipes, conduits, drains and other penetrations or projections through sheet roofing using roofing system manufacturer's recommended flashing materials, accessories and procedures.
- Install roof accessories and traffic walkways in accordance with manufacturer's instructions.
- Install sheet metal work furnished under section 07600.

SECTION 07600 - FLASHING AND SHEET METAL

General:

- A. Standards: Materials and construction shall conform to following:
- SMACNA "Architectural sheet Metal Manual- 1993."
 - Installation: Performed under Section 07540 work.

1.1 Pre-manufactured perimeter edge metal and accessories

- Manufacturer: Duro-Last Roofing / Exceptional Metals, Inc. (800) 248-0280, Jason Dark, www.Duro-Last.com
- Duro-Last / Exceptional Metals Snap Coping made of 24-gauge galvalume, cover provided with Kynar architectural finish providing a 35 year finish warranty. Meets ANSI/SPRI ES-1 2003 method RE-2 testing requirements. (Color - Refer to Exterior Elevations)
 - Duro-Last / Exceptional Metals Vinyl backed scupper. Scupper profile & size indicated Fig 1-20.

1.2 General: Miscellaneous sheet metal

- A. Standards: Materials and construction shall conform to following:
- SMACNA "Architectural sheet Metal Manual- 1993."
 - Installation: Performed under Section 07540 work.

2.1 Materials:

- A. Galvanized steel: ASTM A653 commercial quality sheet steel with 0.2% copper, G90 hot-dip galvanized. Gage indicated.
- Scuppers: Minimum 16 gage.
 - Coping/Wall caps: Minimum 18 gage.
- B. Aluminum sheet: ASTM B209 alloy 3003, temper as required for forming and performance. Thickness indicated.
- Conductor Boxes: Minimum 0.040" thickness.
 - Downspouts: Minimum 0.025" thickness.
- C. Joint sealers: One-component silicone elastomeric joint sealant complying with ASTM C920. Color matched to sheet metal finish.
- D. Metal accessories: Provide sheet metal fasteners, clips, straps, anchoring devices and similar accessory units as required for installation of work, matching or compatible with material installed, non-corrosive, size and gage as required for performance and acceptable to the Architect.
- E. Fabrication: Shop fabricate sheet metal work to comply with profiles and sizes indicated and to comply with standard industry standards as shown by SMACNA in the "Architectural Sheet Metal Manual."
- Conductor boxes: SMACNA Chapter 1 - Roof Drainage Systems. Profile and size indicated Fig 1-25.
 - Scuppers: SMACNA Chapter 1 - Roof Drainage Systems. Profile and size indicated Fig 1-20.
 - Downspouts: SMACNA Chapter 1 - Roof Drainage Systems. Profile and size indicated. Installation Fig. 1-31 with strap hanger Fig. 1-35.
 - Formed coping/wall caps: SMACNA Chapter 3 - Copings. Design Fig 3-1. Profile and size indicated with Fig. 3-3 butt joints and concealed back-up plates. Install formed copings with continuous cleat fasteners similar to Fig 3-1 at exposed face and screw fasteners with washers space maximum 24" on center at roof side.

3.1 Installation:

- A. Preparation: Coordinate sheet metal work with other work for the correct sequencing of items which make up the entire roof system of weatherproofing and rain drainage:
- B. Installation: Comply with SMACNA "Architectural Sheet Metal Manual" recommendations, drawing details and approved shop drawings for installation of the work.
- Anchor sheet metal items securely in place by methods indicated, providing for thermal expansion. Conceal fasteners and expansion provisions whenever possible. Install joint sealants where required.
 - Set units true to lines and levels indicated. Install work with sealed laps, joints and seams that will be permanently watertight and weathertight. Bed flanges of sheet metal work in thick coat of roofing cement or sealant compatible with roofing membrane.
 - Separate sheet metal work from dissimilar metals and treated wood materials. Provide rosin-sized paper slip sheet over treated wood.
 - Fabricate, support and anchor conductor boxes and downspouts to withstand thermal expansion, stresses and full loading by ice or water without damage, deterioration or leakage.

SECTION 076113 - SHEET METAL WALL PANELS

1.1 General:

- A. Standards:
- Furnish all labor, material, tools, equipment and services for all preformed fascia and wall panels as indicated, in accord with provisions of Contract Documents.
 - Completely coordinate with work of all other trades.
 - Although such work is not specifically indicated, furnish and install all supplementary or miscellaneous items, appurtenances and devices incidental to or necessary for a sound, secure and complete installation.
- B. Related work specified elsewhere:
- Structural steel: Section 05100
 - Steel joists: Section 05200 or 05400
 - Flashing and sheet metal: Section 07600

1.2 Quality Assurance:

- A. Applicable standards:
- SMACNA "Architectural Sheet Metal Manual" Sheet Metal and Air Conditioning Contractors National Association, Inc.
 - AISC "Steel Construction Manual" American Institute of Steel Construction.
 - AISI "Cold Form Steel Design Manual: American Iron and Steel Institute
 - ASTM A792-83-AZ50: Specifications for steel sheet, aluminum-zinc-coated (galvanized) by the hot dip process, general requirements (Galvalume).
- B. Manufacturer's qualifications:
- Manufacturer has a minimum of three years experience in manufacturing metal wall systems of this nature. Panels specified in this section shall be produced in a factory environment (not job site roll formed) with fixed base roll forming equipment assuring the highest level of quality control. A letter from the manufacturer certifying compliance will accompany the product material submittals.

1.3 Product Delivery, Storage and Handling

- A. Delivery: Deliver metal wall system to job site properly packaged to provide protection against transportation damage.
- B. Handling: Exercise extreme care in unloading, storing and erecting metal wall system to prevent bending, warping, twisting and surface damage.
- C. Storage: Store all materials and accessories above ground on well skidded platforms. Store under waterproof covering. Provide proper ventilation of metal wall system to prevent condensation build up between each panel or trim/ flashing component.

2.1 Materials

- A. Metal wall system profile:
- Shadow Rib: 3 inch deep x 16 inch width with 1 1/2 inch deep x 5 1/4 inch wide fluting
- B. Metal wall system style:
- Fluted face
 - Concealed fasteners
- C. Gauge: 24 gauge
- D. Substrate: Per Plans
- E. Texture: Smooth
- F. Finish: Premium thermoset silicone polyester (20 year warranty)
- G. Color: Polar White, to be painted per Exterior Elevations
- H. Acceptable Manufacturer: MBCI Houston, Texas (281) 445-8555.

3.1 Surface Conditions

A. Examination:

- Inspect installed work of other trades and verify that such work is complete to a point where this work may continue.
- Verify that installation may be made in accordance with approved shop drawings and manufacturer's instructions.

3.2 Installation

- A. Install metal wall system system so that it is weathertight, free of wrinkles, warps, buckles, fastening stresses or distortion.
- B. Install metal wall system in accordance with manufacturer's instructions and shop drawings.
- C. Provide concealed anchors at all panel attachment locations.
- D. Install panels plumb, level and straight with seams parallel, conforming to design as indicated.

3.3 Cleaning, Protection

- A. Dispose of excess materials and remove debris from site.
- B. Clean work in accordance with manufacturer's recommendations.
- C. Protect work against damage until final acceptance. Replace or repair to the satisfaction of the architect and work that becomes damaged prior to final acceptance.
- D. Touch up minor scratches and abrasions.

3.4 Field Painting

- A. Refer to section 09900 on G017
- B. Follow manufacturer's technical bulletin for Precoated Signature 200 MBCI wall panels.

Section 07900 – JOINT SEALERS

1.1 General: Provide joint sealers as shown and specified.

- A. Standards: Comply with ASTM C 920 requirements.

- B. Application: Performed by skilled, experienced joint sealer applicators.

2.1 Materials:

- A. Poly urethane sealants:
- Tremco Commercial Sealants (800) 321-7906, internet www.tremcosealants.com,
 - "Dymonic FC" One component, fast skinning, Low Modulus Polyurethane.
 - "Dymeric 240 FC" Multi Component, gun grade, chemically curing, tintable fast setting polyurethane sealant.
 - Sonneborn, (724) 756-9582, internet www.sonneborn.com
 - Color pack for polyurethane multi component, gun grade chemically curing sealant.
- B. Silicone Sealants:
- General Electric Silicones, (800) 295-2392, internet www.gesilicones.com
 - "SCS1700 Sanitary – Mold/Mildew Resistant Silicone", one component 100% silicone, fungicidal based sealant.
 - "SCS2700 Silpruf Silicone" one component medium modulus, natural cure silicone all purpose sealant.
 - "Silglaze II SCS2800- Glazing Sealant" one component, 100% silicone based sealer.
 - "GE Paintable Silicone" one component paintable silicone.
 - "SCS1009 Silicone Sealant" one-component acetoxly silicone for general purpose sealing and bonding
 - Dow Corning Silicones, (989)496-4000, www.dowcorning.com
 - "Dow 795" – one component, medium modulus, natural cure silicone.
- C. Firestopping Sealants: 3M Fire Protection Products, (800) 328-1687, internet www.3M.com/firestop
- "3M Fire Barrier CP 25WB+ Caulk" or approved equal
- D. Joint backing: Non-absorptive, non-staining compressible, non-gassing, polyethylene foam backer rod compatible with joint sealants.

3.1 Installation:

- A. Preparation: Clean and prepare joints prior to installing sealers:
- Wipe shipping oils from surfaces to be sealed. Remove protective films and/or install joint backer rod if joint is larger than 1/2" in width.
- B. Installation: Install joint sealant materials in strict accordance with manufacturer's installation instructions.
- Apply sealants in a uniform, continuous bead without gaps or air pockets. Hand tool and finish all joints so that a smooth, slip free uniform line is created along the substrate being shot. Remove any excess materials from tooled edges and ends of joint.
 - Install joint sealants to a depth no more than 1/2 the width of the joint.
 - Install sealants by proven techniques that result in sealants directly contacting and fully wetting joint substrates, completely filling recesses provided for each joint configuration, and providing uniform, cross-sectional shapes and depths relative to joint widths which allow optimum sealant movement capability.
 - Immediately, after sealant application, and prior to time skinning or curing begins, tool sealants to form smooth, uniform beads of configuration indicated to eliminate air pockets, and to ensure contact and adhesion of sealant with sides of joint. Remove excess sealants from surfaces adjacent to joint. Do not use tooling agents which discolor sealants or adjacent surfaces or are not approved by sealant manufacturer.
 - Clean off excess sealants or sealant smears adjacent to joints as work progresses by methods and with cleaning materials approved by manufacturers of joint sealers and of products in which joints occur.

4.1 Sealant Schedule:

A. Kitchen Area:

- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
- Ceiling grid to FRP wall panels
 - Base of FRP wall panels to T.O. specified base material.
 - Walk in cooler walls to FRP wall panels.
 - Stainless closure pieces at cooler walls to FRP wall panels.
 - FRP/stainless corner guards to FRP wall panels.
 - Ceiling tile pipe penetrations.
 - Wall pipe penetrations and/or escutcheons perimeters. (water & gas lines).
 - Mop sink stainless surround perimeter to walls.
 - FRP closure panel, at top of cooler, to cooler walls.
 - FRP wall panels to hollow metal door frames.
 - Coke line bundle to PVC cap.
 - FRP inside corner pieces to FRP wall panels. Both sides of corner piece.
 - Battery backup cover panel to FRP.
 - Faucet's to FRP wall panels.
 - FRP wall panels to quarry tile cove base.
 - FRP to aluminum plate at walk thru.
 - Menu board light bracket to ceiling.
 - Mop sink base at quarry tile.
 - All sinks (multi-compartment, hand, mop and prep) to FRP/tile walls.
 - Paper towel dispensers & soap dispensers to FRP/tile walls.

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
- Stainless closer pieces, at sides of cooler walls - to cooler walls.
 - Stainless or aluminum plate closure pieces to diamond plate at cooler walls.
 - Diamond plate panel seam joints.
 - Diamond plate perimeter to cooler walls.
 - Base of diamond plate to quarry tile cove base.
 - Stainless closure panel, at top of cooler walls, to cooler walls.
 - Top of quarry tile cove base to cooler walls at inside of cooler.
 - Cooler wall/diamond plate penetrations.
 - Cooler door hinges and handles to diamond plate. DO NOT caulk door locking unit.
 - Stainless wrap at hollow metal door frame.
 - Stainless mop surround to stainless corners on mop sink.
 - Base of stainless corner pieces to schluter strip at base.
 - Exit door threshold perimeters. To frame and floor, interior and exterior.

- Provide a continuous bead of dark gray GE SCS2000 silicone at the following locations:
- Base of hollow metal door jambs to quarry tile floor.

B. Managers Office:

- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
- Ceiling grid to FRP wall panels.
 - Perimeter of manager's desk to FRP wall panels.
 - Hollow metal door frame to FRP wall panels.
 - Top and ends of coat hanger bracket to FRP walls.
 - Base of FRP wall panels to quarry tile base.
 - Ceiling tile wire/pipe penetrations.
 - FRP inside corners to FRP wall panels. Both sides of corner piece.
 - Base of FRP wall panels to quarry tile.

- Provide a continuous bead of black or light bronze (use color of safe) GE SCS2000 silicone at the following locations:
- Base of safe to floor.

C. Cooking Area:

- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
- Top of wall tile to sheetrock ceiling.
 - Ceiling diffusers perimeters to sheetrock ceiling.
 - Ceiling pipe penetrations.
 - Wall tile to aluminum walk thru surround.
 - Tile wall penetrations/escutcheons perimeters.
 - FRP wall panels to sheetrock ceilings.
 - FRP wall panels to aluminum end wall plates.
 - FRP inside corners to FRP wall panels. Both sides of corner piece.
 - Sink to white wall tile.
 - Paper towel dispenser/soap dispenser to white tile.
 - POS/Serving counter to wall tile.
 - Stainless shelf behind grill to wall tile.
 - Faucets to ceramic wall tile.

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
- Joint between hood and closure skirt.
 - Joint between hood support and hood. Both sides.
 - Connection joint between stainless shelf behind grill.
 - Hood to tile walls & sheetrock ceiling.
 - Hood gusset to wall tile on both sides.
 - Sink to bronze wall tile.
 - Paper towel dispenser/soap dispenser to bronze tile.
 - DML counter to bronze tile.

- Provide a continuous bead of dark gray GE SCS2000 at the following locations:
- Base of equipment to concrete curbs/quarry tile.

- Provide a continuous bead of bronze GE SCS2097 at the following locations:
- Ceramic tile inside corners.
 - Ceramic tile to aluminum end wall plates.

D. Restrooms:

- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
- Top of FRP to sheetrock ceiling or top of FRP trim to sheetrock wall.
 - Perimeter of toilets/urinals to floor or FRP.
 - Perimeter of mirror to FRP.
 - Sink to wall.
 - Perimeter of paper towel/garbage unit to wall.
 - Toilet paper/napkin disposals units to walls.
 - Stainless shelf to wall.
 - Wall penetrations under sink and or escutcheons to perimeters.
 - Hollow metal door frames to FRP.
 - Base of FRP wall panels to top of wall base.
 - FRP inside corners to FRP wall panels.

- Provide a continuous bead of black GE SCS2000 silicone at the following locations:
- Base of black rubber wall base to floor.

- Provide a continuous bead of dark gray GE SCS2000 silicone at the following locations:
- Base of hollow metal door frames to floor.

E. Dining area:

- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
- Wall tile to sheetrock walls.
 - Perimeter of aluminum storefront/windows/entrances to sheetrock walls.
 - Wainscot wall panels (Stonewood or other) to painted walls.
 - Diffuser/louvers perimeters to sheetrock walls.
 - Hollow metal door frames to painted walls - if needed.
 - Frame of service line counter to tile (joint to be caulked behind front face panels of counter).
 - Wall tile at serving line wall to POS counter.

- Provide a continuous bead of black GE SCS2000 silicone at the following locations:
- Base of black rubber wall to floor (concrete or quarry tile) and gyp. bd. wall.
 - Wainscot (Stonewood or other) wall panels to sill of aluminum storefront/ windows.
 - Vertical joints of wainscot (Stonewood or other) wall panels to frames/painted walls/tile (ONLY if joint is uneven or plywood is showing).
 - Stonewood panels at serve line.

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
- Base of garbage surround to floor.

- Provide a continuous bead of Dow 795 silicone at the following locations:
- Sill of aluminum storefronts to concrete or tile floor. Color to be determined per store to match storefront (Charcoal/Anodized Aluminum/Dark Bronze).

F. Utensil Counter:

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
- Stainless countertop to backsplash. Horizontal & vertical joints.
 - Base of Coke machine to countertop.
 - Perimeter of tea drain tray to countertop.
 - Stainless backsplash to white tile walls/painted walls.

- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
- Coke line bundle to PVC cap.

G. Fire Rated Walls:

- Provide a continuous bead of 3M 25WB+ at the following locations:
- Wall/ceiling penetrations in rated walls.

H. Exterior Joints:

- Provide a continuous bead of Tremco Dymeric limestone urethane sealant at the following locations:
- Sidewalk/concrete expansion joints.

- Provide a continuous bead of Dow 795 silicone or Tremco Dymeric 240 FC at the following locations:
- Hollow metal door frames.
 - EIFS to abutting services.
 - Penetrations in EIFS.
 - Face brick or block control joints.
 - Perimeter of Aluminum Storefronts.
- *Colors to be determined per store to match adjacent material colors. Verify with Chipotle Construction Manager and Architect.

- For "Fog" EIFS use Tremco - "Natural White"
- For "Knight's Armor" EIFS use Sonneborn - "Charcoal Gray" #276-U
- For white brick use Tremco - "China White"
- Provide a continuous bead of aluminum GE SCS1009 silicone at the following location:
- CO2 fill port stainless box.
 - Faucet for hose. (Please note: color to be determined per store. Verify with Chipotle Construction Manager and Architect).

CONSULTANT:



CLIENT:



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2492
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2008
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:



September 04, 2026
MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:

TITLE:

ARCHITECTURAL
SPECIFICATIONS

SHEET NUMBER:

G013

2.2 In-Line Side Sliding Automatic Window and Air Curtain

A. GC to use specification called out on storefront details sheet and/or as directed by Tenant Arch PM.

* Quikserv Custom Automatic Side Sliding Window (Model: SST-4035E-CHIPOTLE): 45'-1/2"W x 41-3/4"H window with 17-3/4" tall transom and (2) sidelights at 29 1/4"W x 41-3/4"H; Complete Unit Size 104"W x 59-1/2"H

- Service Opening: 19"W x 29-3/4"H
- Finish: Dark Bronze Anodized
- Glass: 1" Clear Tempered unit + Low E (Solarban 60e) for fixed & moving panel, sidelights and transom
- 'CHIPOTLE' package includes pre-wired air curtain with relay to sync operation with window.
 - Arch PM to verify if heated or ambient air curtain is required per Tenant assignment. Air Curtain mounts to transom.
 - Heated Air Curtain: Model: QSV1025E1-0401
 - Ambient Air Curtain: Model: QSV1025AA-BK
- Refer to interior elevations (A300s) for direction of opening for ordering.

* ReadyAccess Automatic Side Sliding Window: 47'-1/2"W x 43-1/2"H window with 16" tall transom and (2) sidelights at 28 1/4"W x 59-1/2"H; Complete Unit Size 104"W x 59-1/2"H

- Service Opening: 19"W x 35"H
- Finish: Dark Bronze Anodized
- Glass: 3/4" Clear Tempered unit + Low E (Solarban 70XL) for fixed & moving panel, sidelights and transom
- Arch PM to verify if heated or ambient air curtain is required per Tenant assignment.
 - Heated Air Curtain: Model: RAC-E-22
 - Ambient Air Curtain: Model: RAC-22
- Refer to exterior elevations (A300s) for direction of opening for ordering.

B. Alternate California Code Option

- ReadyAccess: Window 47'-1/2" W x 35'-4"H with double-split transom for air curtain and 10" and (2) sidelights at 28-1/4"W x 59-1/2"H; Complete Unit Size 104"W x 59-1/2"H
 - Service Opening: 15-1/4"W x 28"H, limited to meet CA code.
 - Ambient Air Curtain, AA100, and relay switch kit included with the West Coast Window package.

- Quikserv Model: SS-4035-E-CHIPOTLE-CAL, same as above except as noted.
 - Service Opening: 28"W x 15-3/8"H, limited to meet CA code.
 - 'CHIPOTLE' package includes pre-wired ambient air curtain with relay to sync operation with window Model: QSK1025AA-BK. Air curtain mounts to transom.

C. Alternate Impact-Resistant and Florida Product Approved Option, Miami Dade Horizontal Bi-Parting Impact Slider

- Quikserv Model: BP-7241E-IP-CHIPOTLE, Complete Unit Size: 72"W x 41"H.
 - Service Opening: 29-1/2"W x 27"H
 - Rough Opening: 72-1/2"W x 41-1/2"H
 - Glass: Impact Resistant Glass
 - 'CHIPOTLE' package includes ambient air curtain
 - Ambient Air Curtain: Model: QSK1025AA-BK, Part Number: 9345.
 - Do not mount directly to window, mount on wall above.
 - Miami-Dade NOA #18-0814.02

2.3 Electrical Requirements

A. Quikserv Electrical Windows: 120V / 60 Hz, 20-amp branch circuit, single phase. Power supplied through base of window. Conforms to UL Standard 325 -- Certified to CAN/CSA C22.2 NO. 247. Confirm with Electrical Drawings.

- Heated Air Curtain for Custom Side Sliding Window (Model: SS-4035-E-CHIPOTLE)
 - Separate 230V circuit and Power Supply required for heated air curtain. Air curtain pre-wired through window frame with power supply routed to base of window. See Electrical Drawings.
- Ambient Air Curtain for Custom Side Sliding Window (Model: SS-4035-E-CHIPOTLE) and Alternate California Code Option: Model: SS-4035-E-CHIPOTLE-CAL
 - Separate circuit not required. Air curtain pre-wired to power and sync operation with air curtain.
- Ambient Air Curtain for Alternate Impact-Resistant and Florida Product Approved Option (Model: BP-7241E-IP-CHIPOTLE):
 - Connect to main control board on window to power and synchronize operation with opening and closing of window.

B. ReadyAccess Electrical Windows: 115V / 60 Hz, 15-amp dedicated circuit required. Run power to header on fixed panel side.

- AA300 Heated Air Curtain
 - Separate 208V / 60 Hz / 40-amp single phase circuit required.
- AA100 Ambient Air Curtain (Standard and CA window)
 - Separate 120V / 60Hz / 15-amp single phase circuit required. Run power to center of window above header.

3.1 Installation

- Install in accordance with manufacturer's instructions.
- Install pass-thru windows plumb, level, square, true to line, and without warp or rack. Maintain dimensional tolerances and alignment with adjacent Work.
- Install thermal isolation where components penetrate or disrupt building insulation. Pack fibrous insulation in shim spaces at perimeter of assembly to maintain continuity of thermal barrier.
- Install pass-thru window components weathertight.
- Anchor pass-thru windows securely in place to supports. Use attachment methods permitting adjustment for construction tolerances, irregularities, alignment, and expansion and contraction.
- Separate aluminum from other metal surfaces with bituminous coatings or other means approved by Architect.
- Coordinate installation of related sheet metal flashing as specified in Section 07 62 00 - Sheet Metal Flashing and Trim.
- Install perimeter joint sealants as specified in Section 07 91 23 - Backer Rods.

SECTION 08710 - DOOR HARDWARE

1.1 General: Provide door hardware as shown and specified.

- Standards: Materials and installation shall conform to the following:
 - ANSI A117.1-2009 Accessible and Usable Buildings and Facilities.
 - ANSI/BHMA A156 Series Builders Hardware

- Quality Assurance:
 - Codes and standards: Provide hardware complying with local Building Code requirements and the Tenant's standards for keying and security systems.
 - Project scheduling: Performed by an Architectural Hardware Consultant (AHC).
 - Package each item of hardware and each lockset, complete with all screws, anchors, installation instructions and templates. Identify package indexing with corresponding item number of the hardware schedule.
 - After hardware schedule acceptance, provide necessary templates or physical hardware to required trades for cutting, reinforcing, or preparing their products to receive hardware. Furnish templates to metal door manufacturer's.

2.1 Materials:

- No substitutions allowed. Requirements for manufacturer, design, grade, function, finish, size and other distinctive qualities of each type of door hardware are indicated on the drawings.

- Review the keying system with the Tenant and provide the type required.

3.1 Installation

- Install each hardware item in strict accordance with manufacturer's installation instructions and recommendations. Securely fasten all attached parts. Fit faces of mortised parts snug and flush. Verify operating parts move freely and smoothly without binding or sticking, without excessive clearance.

- Set units level, plumb and true to line and location. Adjust and reinforce attachment substrate as required for proper installation and operation. Drill and countersink units that are not factory prepared for anchorage fasteners. Space fasteners and anchors in accordance with industry standards.

C. Mount hardware units at heights indicated in DHI "Recommended Locations for Builders Hardware", unless otherwise required to comply with requirements of governing codes and regulations. Conform to ANSI A117.1 and ADAGG guidelines for accessibility.

- Top Butts: 5 inches; top of butt from head of frame.
- Middle Butts: 3'-2", centerline from finish floor.
- Bottom Butts: 5 inches; finish floor to bottom of butt.
- Locks: centerline from finish floor per hardware schedule.
- Knobs: 3'-2", centerline from finish floor.
- Pulls: centerline from finish floor per hardware schedule.
- Pushes: centerline from finish floor per hardware schedule.

SECTION 08800 - GLAZING

1.1 General: Provide glass and glazing as shown and specified.

- Standards: Materials and installation shall conform to the following:
 - CPSC 16 CFR Part 1201 (1-91)"Safety Standard for Architectural Glazing Materials."
 - GANA "Glazing Manual - 1990."

B. Quality Assurance:

- Codes and standards: Provide type of glass and glazing products that comply with ANSI Z97.1 and testing requirements of 16 CFR Part 1201 for category III materials. Comply with all applicable codes, standards and regulations that control safety glazing materials and installation.
- System Performance: Provide glass and glazing that has been produced, fabricated and installed to withstand normal thermal movement, wind loading and, where applicable, impact loading, without failure including loss or breakage of glass, failure of glazing sealants or gaskets to remain watertight and airtight, deterioration of glass and glazing materials and other defects in the work.
- Installation: Performed only by experienced glaziers.

C. Warranty:

- Insulating glass: Five years from date of installation against defects that materially obstruct vision through the glass or affect thermal and physical integrity.

2.1 Materials:

- Glass:
 - Float Glass (FG): 1/4" thick clear float glass.
 - Tempered Glass (TG): 1/4" and 1/2" thick clear, tempered safety glass, free-of-tong marks.
 - Insulating Glass (IGL): 1" thick clear, low-e tempered sealed glass; 1/4" thick interior and exterior glass lites with 1/2" aluminum desicated dual sealed air space; with the following characteristics:
 - Low-emissivity coating on #2 surface.
 - Visible Light Transmittance: 64% - 70%
 - Visible Light Reflectance - Outdoors: 9%-11%
 - Solar Energy Transmittance: 32%-34%
 - Solar Energy Reflectance-Outdoors: 30%
 - U-Value - Winter Night: 0.29
 - U-value - Summer days: 0.28
 - Solar Heat gain Coefficient: 0.25-0.39
 - Shading Coefficient: 0.43-0.45
 - Manufacturers/Products:
 - AGC/Comfort Ti-AC40, or similar to meet code
 - Sun Guard/SN-68, or similar to meet code
 - PPG/Solarban 60, or similar to meet code
 - Viracore/VE1-2M, or similar to meet code
- Spandrel Glass (SG) 1/4" thick, Spandrel Ceramic Glass, (Color: GrayBlack or as noted on drawings) by Old Castle Building Envelope (419) 666-2000, Contact: Doug Dewar
- Frosted Window Film, 3M Dusted Crystal Translucent Window Film. Apply on the interior side of glazing.

B. Glazing Materials:

- Glazing Sealants: Provide elastomeric glazing sealants suitable for applications indicated; compatible with one another and with other materials they will contact, complying with ASTM C920.
- Glazing Tape: Provide preformed, non-staining and non-migrating elastomeric tape, as recommended by tape and glass manufacturers for application indicated, complying with ASTM C 1281.
- Glazing gaskets: Provide manufacturer's standard snap-on aluminum stops and neoprene, vinyl or EPDM glazing gaskets.
- Provide setting blocks, spacers and edge blocks of material, size, and shape complying with referenced glazing standard, and compatible with surfaces contacted in installation.

C. Fabrication: Factory fabricate and size all glass.

3.1 Installation

- Preparation:
 - Field verify measurements and conditions of installation.
 - Examine all details. Provide proper fitting to details indicated.
 - Glazing channel dimensions shown are intended to provide for necessary bite on glass, minimum edge clearance and adequate glazing materials thickness, with reasonable tolerances. Adjust as required by job conditions at time of installation.
- Install glass and glazing in accordance with the GANA "Glazing Manual" and glass manufacturer's recommendations.
 - Install insulating glass units to comply with recommendations by Sealed Insulating Glass Manufacturers Association (SIGMA).
- Install setting blocks of proper size at quarter points of sill rabbet. Provide spacers as required.
- Install glazing sealants, tapes and gaskets in accordance with manufacturer's recommendations. Set glass without springing and install securely to prevent rattling or breakage.
- Protect glass from breakage during remaining construction. Do not remove non-permanent labels until final acceptance.

DIVISION 9 -- FINISHES

SECTION 09260 - GYPSUM BOARD SYSTEMS

1.1 General: Provide gypsum board systems as shown and specified.

- Standards: Materials and installation shall conform to the following:
 - GA 214-90 "Levels of Gypsum Board Finish."
 - GA-216 "Specifications for Application and Finishing of Gypsum Board."
 - USG "SA923 Drywall/Steel Framed Systems."

2.1 Materials:

- Manufacturer: United States Gypsum Co. (USG), (800) 874-4968, internet www.usg.com.

B. Metal framing: Comply with ASTM C 754 and ASTM C 645 for materials and sizes.

- Partition metal framing:
 - Studs: Galvanized steel, C-shaped, sizes indicated, 20 gage "ST20"
 - Runners: Match studs, type recommended by stud manufacturer for floor and ceiling support of studs. Provide flexible ceiling runners for full height metal stud framed partitions continuous from floor to underside of structural members or deck above.

C. Ceiling and Soffit metal framing/suspension systems:

- Small areas: Metal stud framing of appropriate size and gage for spans indicated.
- Large areas: Furring channel "Grillage" or "Direct Suspension System" designed for concealed support of gypsum board ceilings, of proper type for use indicated.
- Furring members: 20 gage, galvanized steel screw type, hat-shaped furring.

- Gypsum board panels: USG "Sheetrock" complying with ASTM C1396, tapered edge face panels, 48" wide, in maximum lengths available to minimize end joint conditions, 5/8" thick.
 - General use panels: Sheetrock Regular panels.
 - Fire rated panels: Sheetrock Firecode Core panels.
 - Water-resistant: panels: Sheetrock HUMITEK panels.

- Cement board: USG DUROCK Cement Board, 5/8" thick x manufacturer's standard width, complying with ANSI A118.9, and in maximum lengths available to minimize end-to-end butt joints.

F. Fasteners: USG Type "S" bugle head screws for metal framing, USG Type "W" bugle head screws for wood framing, manufacturer's recommended length for panel thickness indicated.

G. Trim: Galvanized steel with knurled and perforated flanges. USG Dur-A-Bead corner bead, No. 2008 casing bead metal trim, No. 093 Control Joint.

H. Joint treatment: USG Joint Treatment System, utilizing "Sheetrock Brand Joint Tape", and "Sheetrock Brand Setting-Type (DURABOND)" compound for tape bedding and topping.

I. Adhesives: USG "Sheetrock Brand Setting-Type (DURABOND)" 210 or 90" compound for tape bedding and topping.

J. Acoustical sealant: USG Sheetrock Acoustical Sealant, water-base type, gunnable sealant for sealing sound-rated gypsum board systems.

K. Sound attenuation insulation: USG Thermafiber unfaced 3-1/2" thick, mineral fiber insulating batts/blankets; standard lengths and widths required to coordinate with spaces insulated.

3.1 Installation

- Install metal wall and partition framing and ceiling suspension/ support systems in accordance with USG Bulletin SA 923 and complying with ASTM C754.
 - Ceiling suspension/ support systems: Metal furring system/direct suspension or steel stud framing system.
 - Wall and partition framing:
 - Install steel studs per schedule or at spacing indicated between bottom and top runner tracks anchored to substrates. Provide flexible ceiling runner tracks at full height partitions.
 - Terminate partition stud system 4" above ceilings, except where indicated to be extended to structural support or roof deck above. Brace tops of partition framing to structure or roof deck at maximum 4'-0" on center spacing.
 - Frame openings more than 2'-0" wide with two 20 gage studs at each jamb.
 - Coordinate the installation of supplementary blocking and nailers, provided under Section 06100 work, to support shelving, millwork, toilet accessories, and similar work that cannot be adequately supported by gypsum board alone.

- Application and Finishing: Install and finish gypsum board to comply with ASTM C 840 and Gypsum Association GA 216 "Recommended Specifications for the Application and Finishing of Gypsum Board."
 - Screw fasten all gypsum board panels.
 - Metal Trim: Install metal corner beads at external corners of gypsum board work and metal trim wherever edge of gypsum board would be exposed. Use longest practical lengths.
 - Control Joints: Locate and install control joints in accordance with USG Bulletin SA923 "Good Design Practice" recommendations.

C. Acoustical Treatment:

- Where sound-attenuation insulation is indicated, seal gypsum board construction at perimeters, control joints, junction boxes, openings and penetrations with a continuous bead of acoustical sealant including a bead at both faces of partitions.
- Install sound attenuation insulation at scheduled partitions and ceilings. Install insulation in single layer of required thickness. Extend full thickness over entire area to be insulated. Cut and fit tight around obstructions. Fill all voids.
- At openings and cutouts, fill open spaces between edges of gypsum board and fixtures, cabinets, ducts, and other flush or penetrating items, with continuous bead of acoustical sealant.
- Seal sides and backs of electrical boxes to completely close up openings and joints with a bead of acoustical treatment.

D. Finishing:

- Comply with manufacturer's instructions for mixing, handling, and application of materials. Apply treatment at joints both directions, at flanges of trim accessories, penetrations of gypsum board (electrical boxes, piping, and similar work), fastener heads, surface defects, and elsewhere as indicated. Apply in manner that will result in each of these items being concealed when applied decoration has been completed.
- Apply joint tape at joints between gypsum boards, except where trim accessories are indicated.
- Interior Exposed Gypsum Board Finish: Level 5 Finish.
 - Locations: Typical for all walls and ceilings, unless otherwise indicated
 - Interior gypsum board by applying the following joint compounds in four coats (not including prefill of openings in base), and sand between coats and after last coat:
 - Embedding and First Coat: Setting-type joint or taping compound.
 - Fill (Second) Coat: Setting-type topping compound.
 - Fill (Third) Coat: Setting-type topping compound.
 - Finish (Fourth) Coat: Skim coat entire surface.
- Interior Concealed Gypsum Board: Level 3 Partial Finishing.
 - Finish concealed gypsum board construction that requires finishing same as exposed gypsum board construction, except the third coat and sanding can be omitted.

E. Cement Board: Install cement board as a 16" high base at all kitchen and kitchen cook line wall types as indicated on drawings.

SECTION 092816 - GLASS-MAT FACED GYPSUM BACKING BOARDS

1.1 General: Provide Fiberglass-mat faced, moisture resistant gypsum backer board as shown and specified.

- Standards: Materials and installation shall conform to the following:
 - ASTM C840 Standard Specification for Application and Finishing of Gypsum Board.
 - ASTM C1002 Standard Specification for Steel Self Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs
 - ASTM C1178 Standard Specification for Glass Mat Water-Resistant Gypsum Backing Panel
 - ASTM D3273 Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber
 - ASTM D6329 Standard Guide for Developing Methodology for Evaluating the Ability of Indoor Materials to Support Microbial Growth Using Static Environmental Chambers.
 - ASTM E96 Standard Test Methods for Water Vapor Transmission of Materials
 - Tile Council of North America, Inc. (TCNA): TCA Handbook for Ceramic Tile Installation, Current Edition.

2.1 Materials:

- Manufacturer: Georgia-Pacific Gypsum LLC, (800) 225-6119, internet: www.buildgp.com

B. Fiberglass-Mat Faced Gypsum Backing Board: DensShield Fireguard Tile Backing Board complying with ASTM C1178, Type X, Square edges, 4" wide in maximum lengths available to minimize end joint conditions, 5/8" thick. Surfacing: Coated fiberglass mat on face, back and long edges.

- General use panels: 5/8" DensShield Fireguard Tile Backer, Georgia-Pacific Gypsum.

C. Fasteners: Screws meeting ASTM C1002, with corrosion resistant treatment. Size and type per manufacturer's recommendations:

- Walls (Steel Frame): Bungle head, fine thread, sharp point rust resistant drywall screw
- Walls (Walls Frame): Bungle head, coarse thread, sharp point rust resistant screw

D. Metal Framing, Trim, joint treatment, adhesives, acoustical sealant, and sound attenuation insulation: Refer to Section 09260 Gypsum Board Systems

3.1 Installation

- Install DenShield at all tile walls excluding hood area as indicated on drawings.

B. General: Install in accordance with ASTM C840, manufacturer's recommendations and TCA Handbook for Ceramic Tile Installation.

- Manufacturers Recommendations: refer to Current "Product Catalog", Georgia Pacific Gypsum.
 - Attach DensShield Tile Backer with grey side facing the interior. Tile should be applied on the grey coated side of DensShield Tile Backer. Cut panel to required size and make cutouts. Fit ends and edges closely. Do not leave gaps between panels.
 - DensShield Tile Backer may be cut by using a utility knife to score, then snap, working from the grey face side.
 - For walls, when used as a tile substrate a minimum 20-gauge steel or wood framing should be spaced no greater than 24" o.c. for 5/8" DensShield Tile Backer. Board can be applied horizontally or vertically.
 - Fasteners shall be spaced 6" o.c. for walls for wood and steel framing. Do not countersink. Drive fasteners flush with grey coated surface. See manufacturer installation Fastener Guide for proper selection.
 - In all corners, imbed with a bead of flexible sealant when installing panels into corner. Apply self-adhesive 2" wide fiberglass mesh tape and bed tape on all joints and corners with material used to set tiles.
 - Caulk or seal fixture/plumbing penetrations and abutments to dissimilar materials.
 - Do not use all purpose joint compound or tape in wet areas.
 - Do not apply DensShield Tile Backer directly to concrete or masonry block. Framing or furring of the walls is necessary.
 - DensShield Tile Backer should not be used for exterior installations.
 - DensShield Tile Backer panels should not be used as a base for nailing and mechanical fastening.
 - DensShield Tile Backer has a built in moisture barrier. Never install vapor retarders directly behind DensShield Tile Backer panels. In retrofit applications, some paints or other wall coverings may constitute a vapor barrier; remove or effectively penetrate these coverings prior to installing DensShield Tile Backer panels.

C. Refer to Section 09260 Gypsum Board Systems for additional installation and sound treatment instructions

SECTION 09330 - QUARRY TILE

1.1 General: Provide quarry tile flooring and base as shown and specified.

- Standards: Materials and installation shall conform to the following:
 - ANSI A137.1 "Ceramic Tile."
 - TCA "Handbook for Ceramic Tile Installation."

2.1 Materials:

- Manufacturers:
 - Quarry Tile: Daltile, (877) 556-5728, internet: http://daltile.com
 - For ordering purposes, email all orders to chipotle@daltile.com
- Waterproofing, Setting and Grouting Materials:
 - Setting and Grouting Materials and Tile Base Membrane: Mapei
 - For ordering purposes, email all orders to chipotle@daltile.com
 - For technical questions, contact Mapei, (800) 992-6273, internet: www.mapei.com

- Quarry Tile: Daltile 6" x 6" x 1/2" Quarry Textures with 5" base as scheduled on finish plan and appropriate trim; Color: "Ashen Gray" OT03
 - Entire Kitchen Area: Provide non-abrasive finish quarry tile.
 - Rest Rooms: Provide non-abrasive finish quarry tile.
 - Outside Corner Cove Base (Kitchen): HQC (L or R) 3565 5" x 6"
 - Inside Corner Cove Base: #QB-3565 1" x 5"
 - Bullnose Coveless Base: HQ-1665, 6" x 6".
 - Bullnose Corner Coveless Base: #QCR1-1665, 6" x 6".

- Waterproofing for elevated floor slabs: Mapei, Mapelastic AquaDefense, Premium Waterproofing and Crack Isolation Membrane
- Setting Adhesive: Mapei, Ultraflex 3, Color: Gray
- Grout: Mapei, Kerapoxy IEG CQ, Color: #9, "Gray", 1/4" grout joints.
- Quarry Tile Base Membrane: Mapei, Mapelastic AquaDefense, Premium Waterproofing and Crack Isolation Membrane

3.1 Installation

- Preparation: Clean substrate surfaces, scheduled to receive quarry tile, thoroughly and remove all coatings that may impair bond.
 - Center tile fields both directions in each floor area. Adjust layout to minimize tile cutting. Avoid tile less than one-half size. Locate cuts to be least conspicuous.
 - Maintain units uniformly "in plane." Provide straight, uniform joint widths and grout lines.

- Elevated Floor Slabs: Install waterproofing membrane at elevated floor slab surfaces scheduled to receive quarry tile floor finish. Install membrane materials in accordance with manufacturer's installation instructions to produce a waterproof membrane of uniform minimum 30 mil thickness bonded securely to substrate.
 - Extend waterproofing up vertical wall surfaces minimum 10" high.
 - Extend membrane down into floor drain flanges to assure continuous waterproofing at drainage points.

- Wet Areas: Install waterproofing membrane at all quarry tile wall base. Install membrane materials in accordance with manufacturer's installation instructions to produce a waterproof membrane of uniform minimum 30 mil thickness bonded securely to substrate.
 - Extend waterproofing up all vertical wall surfaces receiving quarry tile base minimum 10" high. Extend waterproofing membrane 10" minimum horizontally from all vertical wall surfaces receiving quarry tile base.

- Installation: Install, grout and clean ceramic tile in accordance with referenced TCA installation details and ANSI standard specifications for setting methods scheduled.
 - Latex-portland cement mortar on concrete; TCA detail F113 and ANSI A108.5, grout ANSI A108.10.
 - Base: Latex-portland cement mortar on cement board.

SECTION 09340 - CERAMIC TILE

1.1 General: Provide ceramic wall tile as shown and specified.

- Standards: Materials and installation shall conform to the following:
 - ANSI A137.1 "Ceramic Tile."
 - TCA "Handbook for Ceramic Tile Installation."

2.1 Materials:

- Manufacturers:
 - Ceramic Tile and Accent Tile: Daltile, P: (877) 556-5728, internet: http://daltile.com
 - For ordering purposes, email all orders to chipotle@daltile.com

B. Ceramic Tile:

- Kitchen Tile, or as noted in plans, Series - Finish Line Glazed Ceramic Tile:
 - Color - White FL90, Semi-Gloss, Size - 4 x 16, Pattern - Stacked Bond
- Accent Tile, Series - Color Wheel Glazed Ceramic:
 - Accent Tile only when approved by Arch PM and Chipotle DM
 - Series - Remedy, Color - Alchemy RD25, Size - 2 x 9, Pattern - Stacked Bond
 - Series - Marrazzi, Color - Artesen AT25, Size - 2 x 4, Pattern - Brickpoint Mosaic

C. Setting Adhesive: Thinset Mortar, Mapei, Ultraflex LFT - Gray

D. Grout:

- Kitchen Tile or as noted in plans
 - Mapei, Series - Flexcolor CQ - Chocolate #5007, 1/8" grout joints.
- Accent Tile
 - Mapei, Series - Flexcolor CQ - Chocolate #5007, 1/8" grout joints.

3.1 Installation

- Preparation: Clean substrate surfaces scheduled to receive ceramic tile thoroughly and remove all coatings that may impair bond.
 - Protect surrounding work from damage.
 - Remove any curing compounds or other contaminates.
 - Vacuum clean surfaces and damp clean.
 - Install cementitious backer board or glass-mat faced gypsum backing board as indicated in drawings in accordance with ANSI A108.11 and board manufacturer's instructions. Tape joints and corners, cover with skim coat of dry-set mortar to a feather edge.
 - Prepare substrate surfaces for adhesive installation in accordance with adhesive manufacturer's instructions.

- Kitchen:
 - Install, grout and clean ceramic tile in accordance with referenced TCA installation details and ANSI standard specifications for setting methods scheduled.
 - Lay tile in horizontal stack bond, following detail drawings for layout considerations. Horizontal rows of tile shall be full-height courses, unless noted otherwise.
 - Arrange pattern so that a full tile or joint is centered on each wall horizontally and that no tile less than 1/2 width is used at the ends of the wall. Exception: when one end of the wall is a tile-to-gypsum board transition. Do not interrupt tile pattern through openings.
 - Use specified stainless steel corner guards at tile-to-tile and tile-to-FRP outside corners.
 - Use corner bead of 100% silicone sealant, color to match grout, at inside corners where tile meets tile.
 - Use corner bead of 100% silicone sealant, white, at inside corners where tile meets paint gyp. board, tile meets FRP or tile meets aluminum.
 - Cut and fit tile to penetrations through tile, leaving sealant joint space. Place tile joints uniform in width, subject to variance in tolerance allowed in the size. Make joints watertight, without voids, cracks, excess mortar, or excess grout.
 - Sound tile after setting. Replace hollow sounding units.
 - Keep expansion joints free of adhesive or grout. Allow tile to set for a minimum of 48 hours prior to grouting. Apply sealant to junction of tile and dissimilar materials and junction of dissimilar planes. Refer to section 07900 Joint Sealers.
 - Clean tile and grout surfaces.

CONSULTANT:



CLIENT:



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2492
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2028
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:


STORE NO.: 5644

"CAMERON NC"

TBD NC 24-87

CAMERON, NC 28326

SEAL:

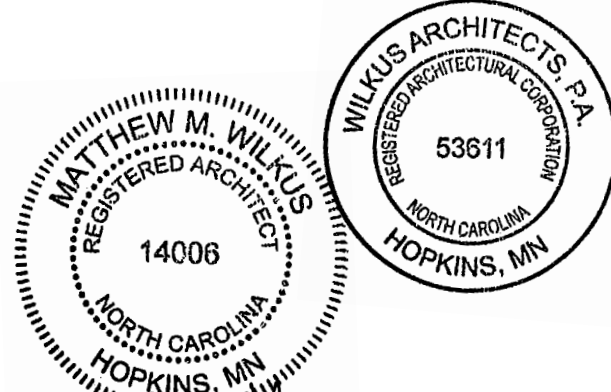

SECTION 09510 - SUSPENDED CEILING SYSTEMS

1.1 General: Provide acoustical ceiling systems as shown and specified.

- A. Standards: Materials and installation shall conform to the following:
1. CISC "Acoustical Ceilings - Use and Practice."
 2. ASTM C635.
 3. ASTM C636.
- B. Related Sections:
1. 09515 Cementitious Wood Fiber Acoustical Panels: Suspension system.

2.1 Materials:

- A. Manufacturer:
1. USG Interiors, Inc., (800) 950-3839, www.usg.com
 2. Pittcon Industries, (800) 637-7638, www.pittconindustries.com
- B. Ceiling Panels: USG "Sheetrock Lay-In ClimaPlus No. 3270" ceiling panels with white, stipple texture, vinyl facing, 24" x 48" x 1/2".
- C. Light Pocket: Pittcon "LP-700-800", White, Height of cove should be field verified by GC to end on a full tile height.
1. Light pocket can have up to 6 week lead time and should be ordered as soon as possible.
 2. Light pocket endcap should only be installed when the end of the cove is not against a wall.
- D. Suspension System: Provide intermediate duty, structural class, direct hung systems adequate to support light fixtures, ceiling diffusers and other normal accessories.
1. Exposed "Tee" Grid System for use with Lay-In Ceiling panels: USG "Donn DX System" non-fire rated with 15/16" exposed face, cold-rolled galvanized steel with aluminum face cap, white paint finish on exposed surfaces. Provide hemmed edge aluminum wall angles, 15/16" exposed leg, white paint finish matching exposed grid.
 2. Concealed "Tee" Grid System for use with Painted Gypsum Board Ceilings & Soffits or with Cementitious Wood Fiber Acoustical Panels (Tectum): USG "DGLW" Heavy Duty Drywall Suspension System with 1 5/8" deep by 1 1/2" wide main tees and 1 1/2" deep by 1 1/2" wide cross tees.
 3. Hanger Wire: No. 12 SWG galvanized steel wire.
 4. Heavy Duty "Tee" Grid System for use with Felt Baffle Ceiling System: USG Donn Brand DX/L with 15/16" wide face tees, color: black

3.1 Installation

- A. Install acoustical ceiling materials and suspension systems in strict accordance with manufacturer's recommendations, complying with governing regulations and industry standards applicable to the work.
- B. Suspension system installation shall be laser leveled with a maximum surface leveling tolerance of 1/8" in 12'-0".
- C. Install exposed Tee suspension systems with main tees nominally 12 ft long spaced 48 in O.C. and cross tees nominally 4 feet long spaced 24 in O.C.
- D. Install concealed Tee suspension systems with main tees nominally 12 ft long spaced 24 inches O.C. and cross tees nominally 2 ft long spaced 48 in O.C.
- E. Hanger wire shall be spaced 48" O.C. along main tees, at all four corners of light fixtures (where applicable), at midpoint of cross tees adjacent to light fixtures and duct outlets, and adjacent to main tee splices.
- F. Secure wire hangers by looping and wire-tying either directly to building structure or to hangers that are secure and appropriate for substrate.
- G. Provide edge trim molding at perimeter of acoustical ceiling installation and intermediate vertical surfaces. Use maximum lengths. Miter trim corners to Provide tight, accurate joints. Connect moldings securely to substrate surfaces.

SECTION 09653 - RUBBER WALL BASE

1.1 General: Provide resilient rubber wall base as shown and specified.

- A. Standards: Materials and installation shall conform to the following:
1. ASTM D 2240 Rubber - 85 Shore A

2.1 Materials:

- A. Manufacturer: Johnsonite, Inc., (800) 899-8916, Internet: www.johnsonite.com
1. Basis-of-Design Product Rubber Wall Base:
 - a. Resilient Rubber:
 1. .125" (3.17 mm) Thickness
 2. "Black" color
 3. Straight (toeless) or coved as specified on finish plan
 4. Inside and outside corners with 4" returns.
 - B. Alternate Wall Base only when approved by Arch PM and Chipotle DM.
 1. Vinyl Wall Base
 - a. .125" (3.17 mm) Thickness
 - b. "Black" color
 - c. Straight (toeless) or coved as specified on finish plan
 - d. Inside and outside corners with 4" returns.
 - C. Setting Adhesive:
 1. For porous surface applications: Johnsonite 960 Acrylic Cove Base Adhesive.
 2. For non-porous surface applications: Johnsonite 946 Contact Bond Adhesive or polymer based alternative.

3.1 Installation:

- A. Preparation: Clean substrate surfaces scheduled to receive resilient rubber and vinyl wall base thoroughly and remove all coatings that may impair bond. A uniform temperature of at least 65 degrees Fahrenheit shall be maintained for 24 hours before, during and after the installation is completed. The wall base and adhesives shall be conditioned in the same manner. Coiled wall base shall be uncoiled and lay flat for at least 24 hours at 65 degrees Fahrenheit prior to installation. Floor and walls shall be clean, dry, and free of dust, all paints, wallpaper, and all other foreign material, which may affect proper adhesive bonding. Wall base may be installed on interior plaster, gypsum wall board, concrete, masonry, mineral-reinforced cement board or similar porous surfaces. Wall base shall not be installed on surfaces that will be exposed to drastic temperature changes or moisture.
- B. Application: Use a 1/8" square notch trowel to apply adhesive. Allow adhesive to set up and then apply wall base in accordance with manufacturer's instructions.

SECTION 09770 - SPECIAL WALL SURFACING - PHENOLIC INTERIOR WALL PANELS

1.1 General: Provide Stonewood solid phenolic panels and accessories for interior walls and millwork as shown and specified.

1.2 Related Sections:

- A. Section 05400 - Cold Formed Metal Framing
- B. Section 06210 - Finish Carpentry and Millwork
- C. Section 07900 - Joint Sealers
- D. Section 09260 - Gypsum Board Systems
- 1.3 Standards: Materials and construction shall conform to the following:
- A. ASTM D638 - 10 Standard Test Method for Tensile Properties of Plastics.
- B. ASTM D790 - 10 Standard Test Methods for Flexural Properties of Unreinforced and Reinforced Plastics and Electrical Insulating Materials.
- C. ASTM E84 - 12 Standard Test Method for Surface Burning Characteristics of Building Materials.
- D. NEMA Standards Publication LD3-2005. High pressure decorative laminates.

1.4 Design/Performance Requirements:

- A. Design and size of wall panel assemblies including wall panels, mounting system to support weight of panels.
- B. Allow for thermal movements from ambient and surface temperature changes by preventing bucking, opening of joints, overstressing of components, failure of joint sealants, failure of connections, and other detrimental effects. Base calculations on expected movement of material as defined in fabrication guidelines.

1.5 Quality Assurance:

- A. Manufacturer's Qualifications:
1. Sufficient plant facilities to provide quality and quantity of materials as required without delaying progress of work.
 2. Minimum of 40 years of experience in paper saturation of phenolic resin, and producing phenolic paper laminate.
- B. Fabricator:
1. Fabricated by the manufacturer, and/or;
 2. Contracted by the customer, minimum 5 years' experience in fabrication work for the size and complexity of the projects.
- C. Installer
1. Proven professional installer with a minimum of 5 years of documented experience.
 2. Approved by the manufacturer.

1.6 Delivery, Storage and Handling:

- A. Refer to Section 01400 Quality Requirements.
- B. Delivery: Deliver materials in manufacturer's original unopened containers/packages, with labels clearly identifying product name, manufacturer, color/texture and weight.
- C. Storage:
1. Keep panels dry and stored indoors in original packaging until installation.
 2. Store Stonewood panels on a smooth, dry, flat surface, making sure there are no bends or bowing in the load.
 3. Do not store directly on cold concrete floors as moisture may migrate.
 4. Do not store under heating units or air conditioning units.
 5. Keep load stored within outer wrap until use. Remove pallet straps once load is moved to storage area.
 6. Reseal plastic wrap if partial load is used.
 7. Keep foam dividers in place.
- D. Handling:
1. Handle materials in accordance with manufacturer's instructions.
 2. Protect materials during handling to prevent damage.
 3. When moving sheets, lift evenly to avoid dragging panels across each other and scratching the surface. PLEASE TAKE CARE NOT TO SCRATCH THE SURFACE OF THE PANEL DURING HANDLING, MACHINING AND INSTALLATION.

1.7 Warranty:

- A. Limited Warranty: Fibbers warrants Stonewood for a period of 10 years. Refer to www.stonewoodpanels.com for details.

1.8 Project Conditions:

- A. Environmental Limitations: Buildings are to be fully enclosed prior to installation with sufficient heat (70 degrees) and ventilation consistent with good working conditions for finish work.
- B. Maintain environmental conditions (temperature, humidity, and ventilation) within limits recommended by manufacturer for optimum results. Do not install products under environmental conditions outside manufacturer's absolute limits.
- C. Field Measurements: Verify locations of structural members and wall opening dimensions by field measurements before composite wall panel fabrication and indicate field measurements on Shop Drawings.

2.1 Manufacturer:

- A. Fibersen Industries, Inc. PO Box 808, Oconomowoc, WI. 53066. Phone: (262) 567-4427, Fax: (262) 567-4814, Web Site: www.stonewoodpanels.com Email: info@fibersen.com
- B. Made in the United States from materials sourced in the USA.

2.2 Application:

- A. Apply Solid Phenolic Laminate Wall Panels at walls and other surfaces as indicated on the Drawings. Phenolic Wall Panels are architectural wall panels applied over a sheathed stud wall or other solid blocking per Drawings.

2.3 Interior Stonewood:

- A. Material: Solid phenolic laminate panel w/o overlay.
- B. Color: Black ND
- C. Finish: Matte
- D. Standard Size: 48"x96", fabricator to trim height to 47"
- E. Panel Thickness: 5/16", 1/2"
- F. Panel Core: HR Black

2.4 Minimum Material Properties

NEMA Requirements:		NEMA Requirements	
Description	3.11		
Dimensional Change:	3.11		
Length (Machine Direction)	0.3% Maximum	0.25%	
Width (Cross Direction)	0.7% Maximum	0.50%	
Density (PCF)	82		

Mechanical Properties:	NEMA Requirements	
Property		
Flexural Strength ASTM D-790		
MD (psi)	18,000	20,000
CD (psi)	12,000	16,000
Flexural Modulus ASTM D-790		
MD (psi)	1.6x10 ⁶	2.0 x10 ⁶
CD (psi)	1.4x10 ⁶	1.5x10 ⁶
Tensile Modulus ASTM D-638		
MD (psi)	18,000	18,000
CD (psi)	12,000	13,000

Fire Resistance:	Class A (0.250")	Class B (0.250")
Flame Spread Index - ASTM E-84 (BLDG):	5	30
Smoke Developed Values - ASTM E-84 (BLDG):	5	105
Fire Rating (Standard Product is Class B):	A	B

Manufacturing Tolerance:	
Thickness (156 to .375)	+/- .020
Thickness (above .375 to 1.000)	+/- .030
CNC Shaped Size (Length - Width)	+/- .020
Drill Diameter	+/- .003
Drill Depth	+/- .020
CNC Hole to Hole	+/- .020
CNC Hole to Edge (1 Oper)	+/- .020
CNC Hole to Edge (2 Oper)	+/- .030
Routing - (Slots Width and Length)	+/- .015
Routing - (Slots Depth)	+/- .020

2.5 Accessories (Fasteners):

- A. Panel Fasteners: #10 x 1-1/4" flat Phillips head black oxide wood screws to be used with wood blocking and #10 x 1-1/4" flat Phillips head black oxide sheet metal screws to be used with sheet metal blocking as recommended by the manufacturer.
- B. Provide exposed fasteners with heads matching color of composite wall panels by means of factory-applied coating.
- C. Fasteners shall be designed to withstand effects of dead load and accommodate hydrothermal expansion/contraction of panel.
- D. Wall Panel Accessories: Provide components required for a complete composite wall panel assembly including trim, flashings, sealants, gaskets, fillers, closure strips, and similar items. Match material and finish of composite wall panels unless otherwise indicated.

3.1 Manufacturer's Execution Instructions:

- A. Compliance: Comply with manufacturer's/fabricator's/supplier's product data, handling and installation instruction/manual, shop drawings, shipping container/package ticket identification, etc.

3.2 Examination:

- A. Verify correct panels received including dimension, tolerance, color/texture.
- B. Verify correct attachment system received for the specific project/job.
- C. Verify all the documents including shop drawing and installation guidelines.
- D. Verify installation conditions are satisfactory to receive work of this section before the commencement
- E. Verify substrate installation is complete, flat, and true to plane.
- F. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.3 Preparation:

- A. Field Measurements: Verify prior to fabrication and installation of the cladding panel.
- B. Protect surrounding areas and surfaces to preclude damage during work of this section.
- C. Lay out work before beginning installation as necessary for true, plumb and aligned panel installations.
- D. Verify locations of joints and panel lengths.

3.4 Installation:

- A. Conform to manufacturer's instructions and provisions of shop drawings.
- B. Install to allow hydro-thermal expansion/contraction.
- C. Use appropriate techniques/tools to work with the panel.
- D. Do not force to fit, do not bend, stretch/compress.
- E. Make cutting and fitting neat, square, and true. Where required cut, de-burr edges, and clean fillings from adjacent surfaces.
- F. Do not install damaged or questionable panels.
- G. Install solid phenolic wall panels plumb and level and accurately spaced.
- H. Anchor panels and other components of the work securely in place, with provisions for thermal and structural movement.
- I. Shim or otherwise plumb substrates receiving composite wall panels.
- J. Do not use construction adhesives to apply wall panels directly to substrates or wall board. Use mechanical fasteners only.

3.5 Erection Tolerances:

- A. Shim and align composite wall panel units within installed tolerance of 1/4 inch in 20 feet, non-accumulative, on level, plumb, and location lines as indicated and within 1/8 inch offset of adjoining faces and of alignment of matching profiles.

3.6 Field Quality Control:

- A. Manufacturer's Field Service: Provide field services to ensure product installation is in accordance with manufacturer's/fabricator's/supplier's instructions and installation manual, shop drawings etc.

3.7 Adjusting:

- A. Correct identified defects and irregularities.
- B. Replace damaged soiled, and discolored work.

3.8 Cleaning:

- A. Leave installation clean and free from residue and debris from work of this Section.
- B. Panels best cleaned with warm soapy water and rinsed with clear water; allowed to dry fully.

SECTION 09900 - PAINTS AND COATINGS

1.1 General: Provide paints and coatings as shown and specified.

- A. Provide surface preparation, prime, intermediate and finish coatings for interior and exterior and existing scheduled surfaces and items.
- B. Provide Tenant-selected finishes and colors for all exposed surfaces, unless otherwise indicated.

1.2 Related Documents:

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this section.

1.3 Summary:

- A. This section includes surface preparation and field painting of the following:
1. Exposed exterior items and surfaces.
 2. Exposed interior items and surfaces.
 3. Surface preparation, priming, and finish coats specified in this Section are in addition to shop priming and surface treatment specified in other Sections.

1.4 Quality Assurance:

- A. Applicator Qualifications: Engage an experienced applicator that has completed painting system applications similar in material and extent to that indicated for this Project with a record of successful in-service performance.
- B. Source Limitations: Obtain block fillers, primers and undercoat materials for each coating system from the same manufacturer as the finish coats.
- C. Provide lead free prime and finish coatings. All top coatings shall be mold and mildew resistant.

1.5 Delivery, Storage and Handling:

- A. Deliver materials to the Project Site in manufacturer's original, unopened packages and containers bearing manufacturer's name and label, and the following information:
1. Product name or tile of material.
 2. Product description (generic classification or binder type).
 3. Manufacturer's stock number and date of manufacture.
 4. Contents by volume, for pigment and vehicle constituents.
 5. Thinning instructions.
 6. Application instructions.
 7. Color name and number.
 8. VOC content
- B. Store materials not in use in tightly covered containers in a well-ventilated area at a minimum ambient temperature of 45 degrees F (7 degrees C). Maintain containers used in storage in a clean condition, free of foreign materials and residue.
1. Protect from freezing. Keep storage area neat and orderly. Remove oily rags and waste daily. Take necessary measures to ensure that workers and work areas are protected from fire and health hazards resulting from handling, mixing and application.

1.6 Project Conditions

- A. Apply water-based paints only when the temperatures of surfaces to be painted and surrounding air temperatures are between 50 and 90 degrees F (10 and 32 degrees C) unless otherwise stated on the technical data bulletin.
- B. Apply solvent-thinned paints only when the temperature of surfaces to be painted and surrounding air temperatures are between 45 and 95 degrees F (7.2 and 35 degrees C).
- C. Do not apply paint in snow, rain, fog, or mist, or when the relative humidity exceeds 85 percent, or at temperatures less than 5 degrees F (3 degrees C) above the dew point, or to damp or wet surfaces.
1. Painting may continue during inclement weather if surfaces and areas to be painted are enclosed and heated within temperature limits specified by manufacturer during application and drying periods.

2.1 Manufacturers:

- A. Products: Subject to compliance with requirements, provide one of the products in the paint schedules.
- B. Manufacturers Names: The following manufacturer is referred to in the paint schedule by use of shortened versions of the name, which is shown below:
1. PPG Industries, Inc.
 2. Materials - No substitutions allowed.

2.2 Paint Materials, General

- A. Material Compatibility: Provide block fillers, primers, undercoats, and finish-coat materials that are compatible with one another and the substrates indicated under conditions of service and application, as demonstrated by manufacturer based on testing and field experience.
- B. Material Quality: Provide manufacturer's best-quality "professional" paint material of the various coating types specified. Paint-material containers not displaying manufacturer's product identification will not be acceptable.

Colors: Color guided selected by owner and will be strictly adhered too, unless otherwise noted.

C. Exterior Coatings:

Exterior Ferrous Metals:

Preparation: Remove all visible oil, grease, soil, rust and all other soluble contaminates from steel surface. Uniformly roughen surface with 150-grit paper. Remove all dust before solvent cleaning by the use of stiff bristle brush.

Prime: (1) Coat PPG: 4020PF Series Pitt-Tech Plus Int/Ext DTM Acrylic Industrial Primer (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Finish: (2) coats PPG: 4216 Plus HP Series Pitt-Tech Plus Semi-Gloss DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Application: Conventional or HVLP (high volume low pressure)

Exterior and Interior Gas Piping:

Preparation: Remove all visible oil, grease, soil, rust and all other soluble contaminates from pipe surface. Remove all dust before solvent cleaning by the use of stiff bristle brush.

Prime: (1) Coat PPG: 4020PF Series Pitt-Tech Plus Int/Ext DTM Acrylic Industrial Primer (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Finish: (2) Coats PPG: 4216 Plus HP Series Pitt-Tech Plus Semi-Gloss DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils

Application: Conventional or HVLP (high volume low pressure)

Exterior Patio Railings:

Preparation: Remove all visible oil, grease, soil, loose paint, rust and all other soluble contaminates from steel surface. Remove all dust before solvent cleaning SSPC-SP1 by the use of stiff bristle brush. SSPC-SP3 may be required as a more aggressive preparation to remove loose mill scale, loose rust, loose paint and other loose detrimental foreign matter from the surface. Performance is better with more aggressive preparation.

Prime: (1) coat PPG: 95-3300 Durathane DTM Urethane Mastic (250 g/L VOC): Applied at a dry film thickness of not less than 3.0 to 5.0 mils.

Finish: (1) coat PPG: 95-3300 Durathane DTM Urethane Mastic (250 g/L VOC): Applied at a dry film thickness of not less than 3.0 to 5.0 mils.

Application: Conventional or HVLP (high volume low pressure) be done with conventional spray or airless equipment or brush or roller.

Exterior Prefinished Metal Wall Panels:

Preparation: Before applying primer or other surface treatments, clean galvanized metal surface to SSPC-SP1 that could impair bond of the various coatings. Remove oil, grease and soap film before priming use of Krud Kutter Metal Clean & Etch may be required on bare or new galvanized. Surface must be clean, dry and free of contaminants, including salt deposits. Additional prep may be needed to SSPC-SP2. Schedule cleaning and painting so dust and other contaminants from the cleaning process will not fall on wet, newly painted surfaces.

Note: Some selected areas of bare concrete surfaces will require (1) coat of Perma Crete 4-603XI Alkali Resistant Concrete Primer before steel installation over all concrete surfaces.

Owner Option 1:

Prime: (1) coat XIM Primer Bond - Applied at a dry film thickness of not less than 1.5 to 2.0 mils.

Finish: (2) coats PPG: 90-1110 Series Pitt-Tech Satin DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 2:

Prime: (1) coat PPG: 97-245 Pitt-Guard DTR Epoxy Mastic Primer (263 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 7.0 mils.

Finish: (2) coats PPG: 95-3300 Durathane Urethane Mastic (240 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 3 (Low VOC):

Prime: (1) coat PPG: Amerlock 2 Fast Dry VOC Compliant Epoxy (84 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 6.0 mils.

Finish: (2) coats PPG: Amershield VOC Aliphatic Urethane (84 g/L VOC): Applied at a dry film thickness of not less than 5.0 to 8.0 mils.

Application: Conventional or HVLP (high volume low pressure) be done with conventional spray or airless equipment or brush or roller.

Exterior Galvanized Metal:

Preparation: Before applying primer or other surface treatments, clean galvanized metal surface to SSPC-SP1 that could impair bond of the various coatings. Remove oil, grease and soap film before priming use of Krud Kutter Metal Clean & Etch may be required on bare or new galvanized. Surface must be clean, dry and free of contaminants, including salt deposits. Additional prep may be needed to SSPC-SP2. Schedule cleaning and painting so dust and other contaminants from the cleaning process will not fall on wet, newly painted surfaces.

Note: Some selected areas of bare concrete surfaces will require (1) coat of Perma Crete 4-503 Concrete Primer before steel installation over all concrete surfaces.

Owner Option 1:

Prime: (1) coat PPG: 6-209 SpeedHide Galvanized Metal Primer (400 g/L VOC): Applied at a dry film thickness of not less than 3.0 to 5.0 mils.

Finish: (2) coats PPG: 4216 Plus HP Series Pitt-Tech Plus Semi-Gloss DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 2:

Prime: (1) coat PPG: 97-245 Pitt-Guard DTR Epoxy Mastic Primer (263 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 7.0 mils.

Finish: (2) coats PPG: 95-3300 Durathane Urethane Mastic (240 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 3 (Low VOC):

Prime: (1) coat PPG: Amerlock 2 Fast Dry VOC Compliant Epoxy (84 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 6.0 mils.

Finish: (2) coats PPG: Amershield VOC Aliphatic Urethane (84 g/L VOC): Applied at a dry film thickness of not less than 5.0 to 8.0 mils.

Application: Conventional or HVLP (high volume low pressure) be done with conventional spray or airless equipment or brush or roller.

CONSULTANT:



CLIENT:




CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2492
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

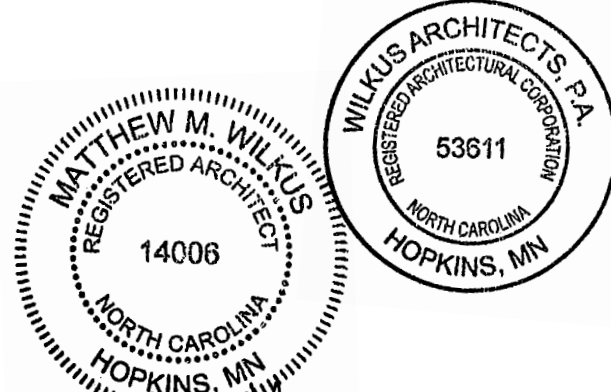

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362

DRAWN BY JSB / KRJ

CHECKED BY DLA

ISSUE RECORD:

03/07/2025 PERMIT SET
05/29/2025 BID SET



REVISIONS:

TITLE:

ARCHITECTURAL
SPECIFICATIONS

SHEET NUMBER:

G016

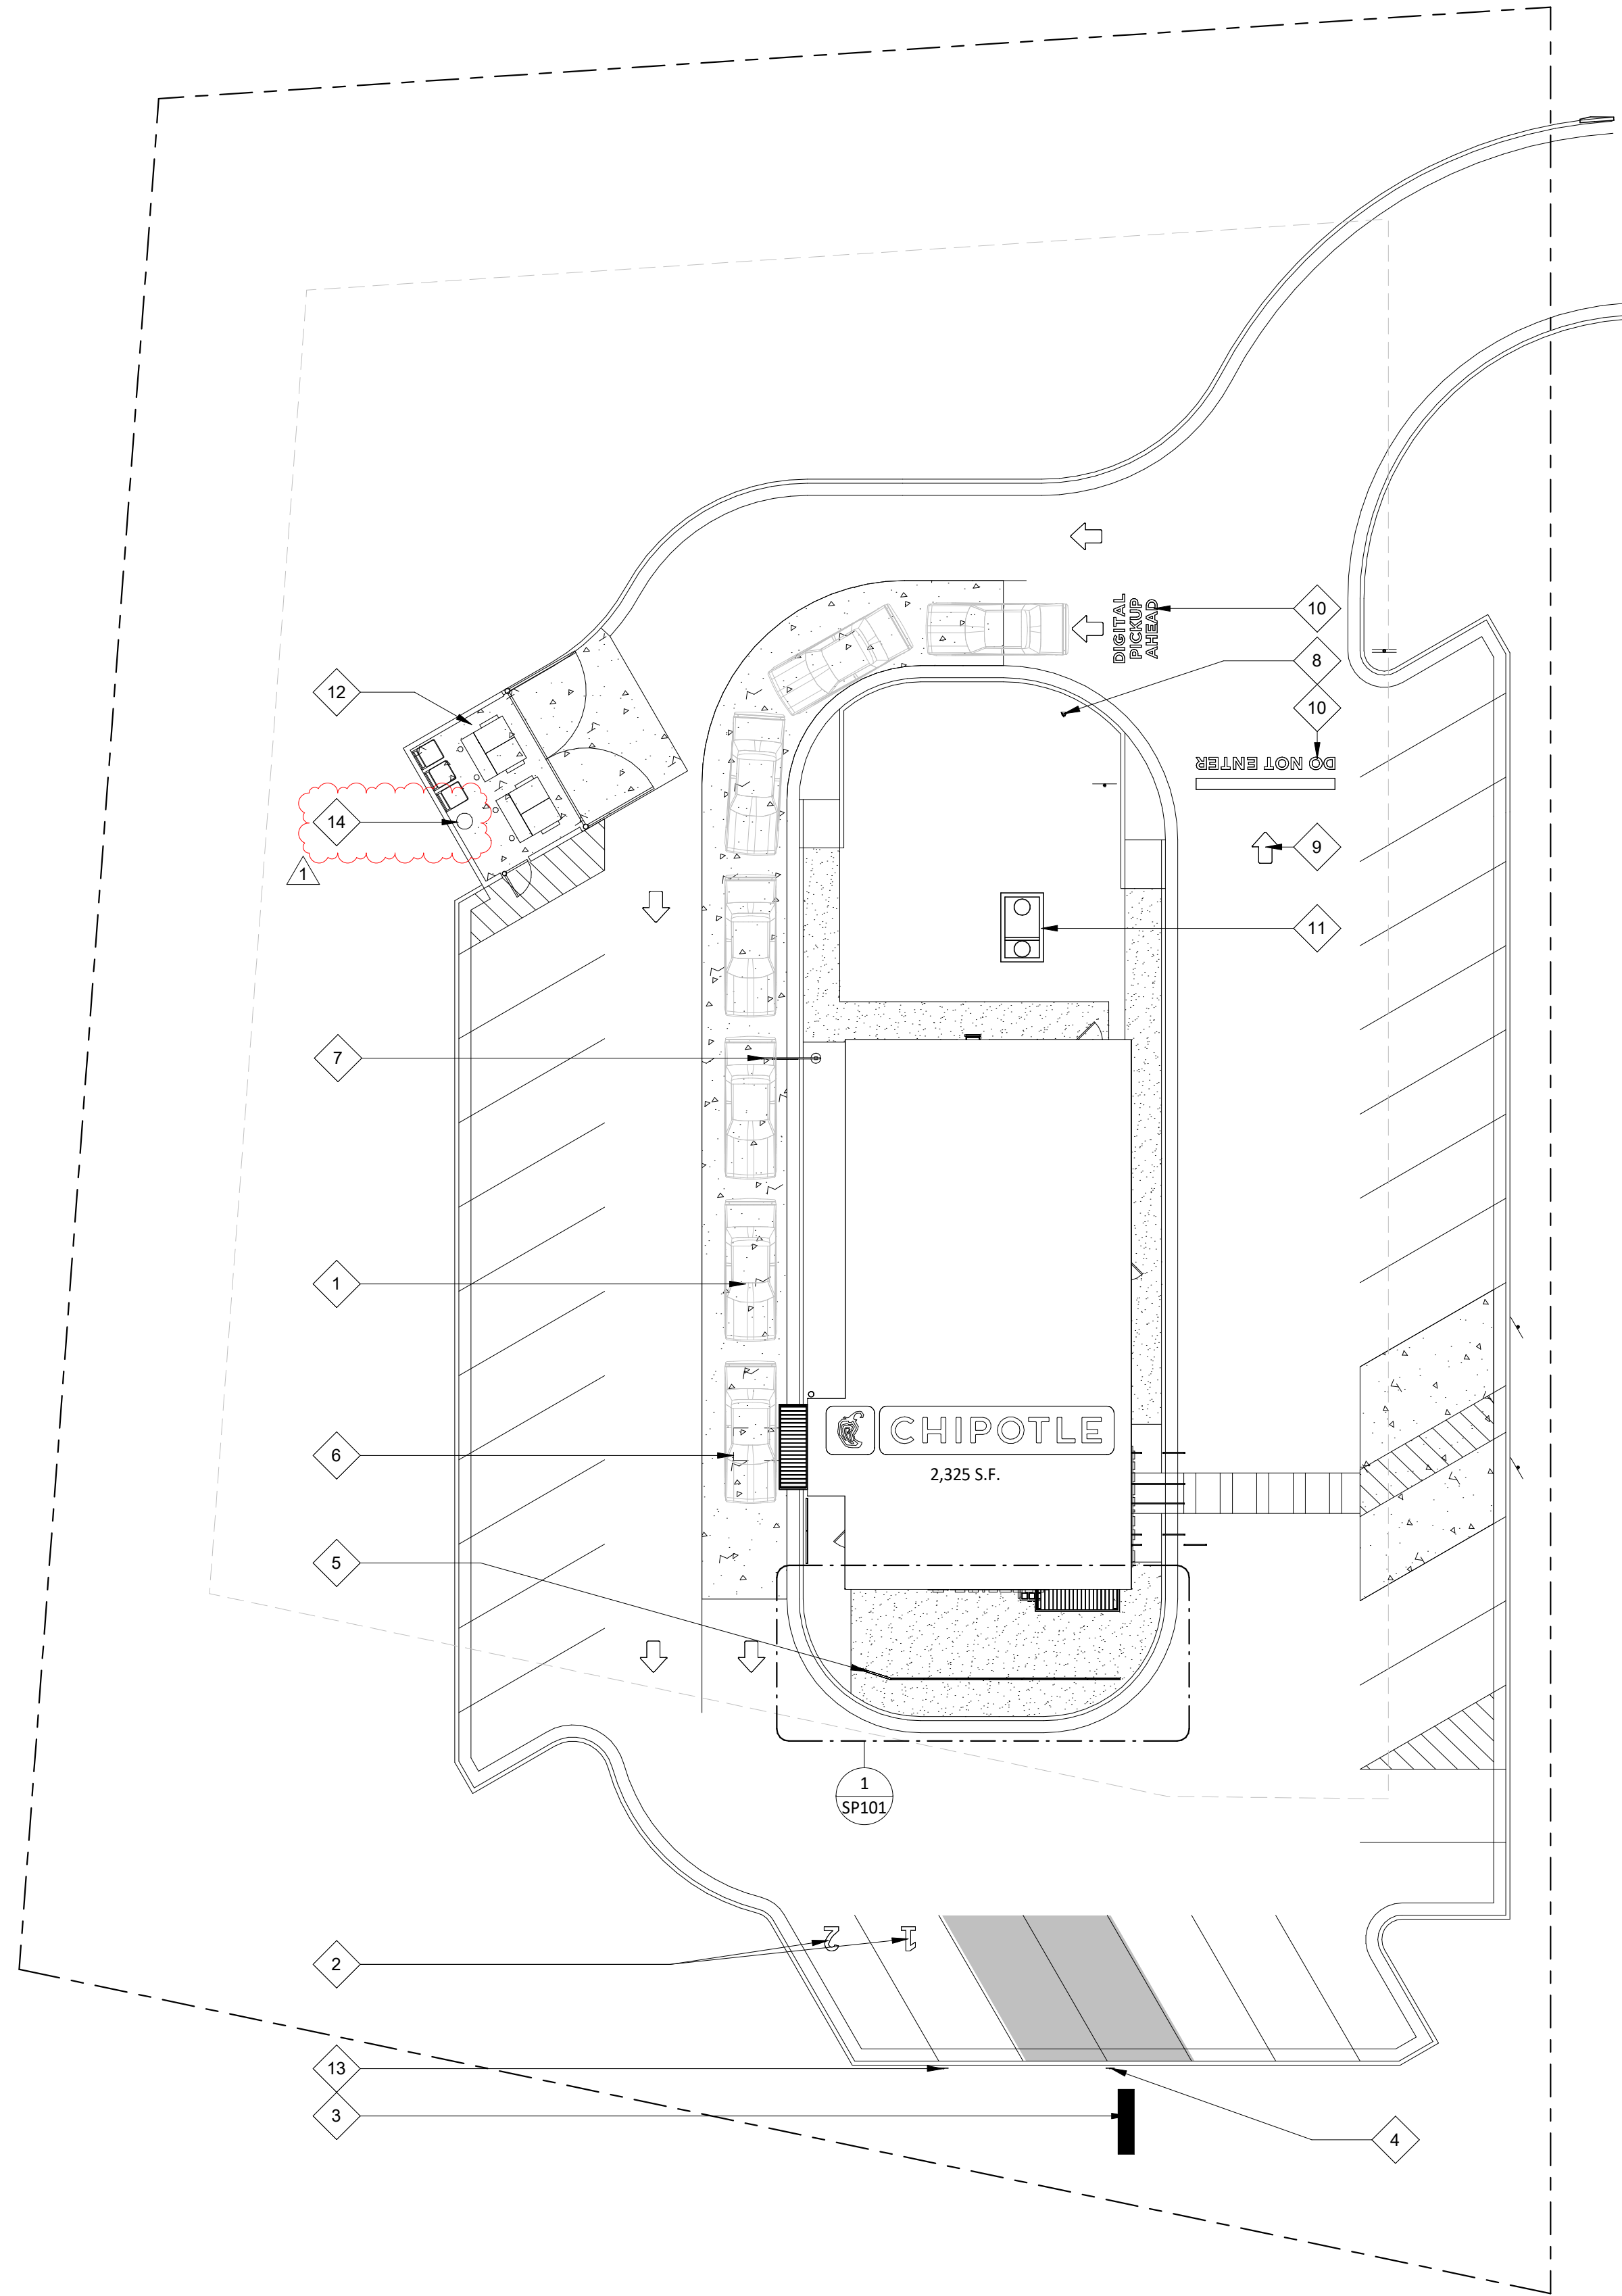

GENERAL NOTES - SITE PLAN

- ALL SITE WORK INCLUDING PAVING, CURBING, PARKING, PARKING LOT LIGHTING, SIDEWALKS, LANDSCAPING, BOLLARDS AND DUMPSTER ENCLOSURE ARE EXISTING UNLESS NOTED OTHERWISE.
- FOR STENCIL INFORMATION, REFER TO DIVISION 2 - SITE CONSTRUCTION FOR ADDITIONAL INFORMATION.
- PROVIDED ARCHITECTURAL SITE PLAN IS FOR REFERENCE PURPOSES ONLY. GENERAL CONTRACTOR TO VERIFY LANDLORD PROVIDED ITEMS MATCH THE INDICATED NOTING BELOW AS REQUIRED. IF GENERAL CONTRACTOR OCCURS ANY DISCREPANCIES, CONTACT THE ARCHITECT IMMEDIATELY.

KEYNOTE LEGEND

- | | |
|----|---|
| 1 | 12' - 0" WIDE HIGH DENSITY CONCRETE DRIVE AISLE - BEGIN POUR 12' - 0" PRIOR TO CENTER OF CLEARANCE BAR AND END 12' - 0" PAST CENTERLINE OF PICK-UP WINDOW. |
| 2 | TWO (2) PULL-AHEAD PARKING SPACES MARKED WITH WHITE NUMBERS PARALLEL TO STRIPING AND CENTERED IN SPACE - OFFSET NUMBERS INTO PARKING SPACE 12" MAX. FROM FRONT EDGE OF STRIPING. |
| 3 | MONUMENT SIGNAGE BASE LOCATION PROVIDED BY LANDLORD - SIGN CABINET AND POWER HOOK-UPS ARE TO BE PROVIDED BY THE SIGNAGE VENDOR. |
| 4 | TWO (2) SPACES MARKED FOR 'BURRITO LOADING ZONE' PARKING - FOUNDATION AND POLE PROVIDED BY GENERAL CONTRACTOR - SIGN PROVIDED BY THE SIGNAGE VENDOR AND INSTALLED BY GENERAL CONTRACTOR |
| 5 | PATIO RAILING PROVIDED BY LANDLORD. |
| 6 | LOOP DETECTOR INSTALLED BY CHIPOTLE'S GENERAL CONTRACTOR - REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION - EXISTING CONDUIT STUB-UP PROVIDED BY LANDLORD. |
| 7 | CLEARANCE BAR - FOUNDATION AND CLEARANCE BAR ASSEMBLY PROVIDED AND INSTALLED BY THE SIGNAGE VENDOR |
| 8 | "DIGITAL PICK-UP SIGNAGE" - FOUNDATION AND SIGNAGE ASSEMBLY AND PROVIDED AND INSTALLED BY THE SIGNAGE VENDOR. |
| 9 | DIRECTIONAL PAVEMENT MARKINGS PROVIDED BY CHIPOTLE |
| 10 | "DO NOT ENTER" AND "DIGITAL PICKUP AHEAD" AND DIRECTIONAL ARROWS PROVIDED BY LANDLORD. |
| 11 | 1,500 GALLON GREASE INTERCEPTOR LOCATION - CHIPOTLE'S GENERAL CONTRACTOR TO REFER TO PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION. |
| 12 | TRASH ENCLOSURE, BY LANDLORD. |
| 13 | ONE (1) POLE SIGN FOR PULL-AHEAD PARKING SPACES - FOUNDATION AND POLE PROVIDED BY GENERAL CONTRACTOR - SIGN PROVIDED BY THE SIGNAGE VENDOR AND TO BE INSTALLED BY GENERAL CONTRACTOR. |
| 14 | GREASE DRUM BARREL LOCATION BY TENANT. |

CONSULTANT:



CLIENT:




CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2026
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5044
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

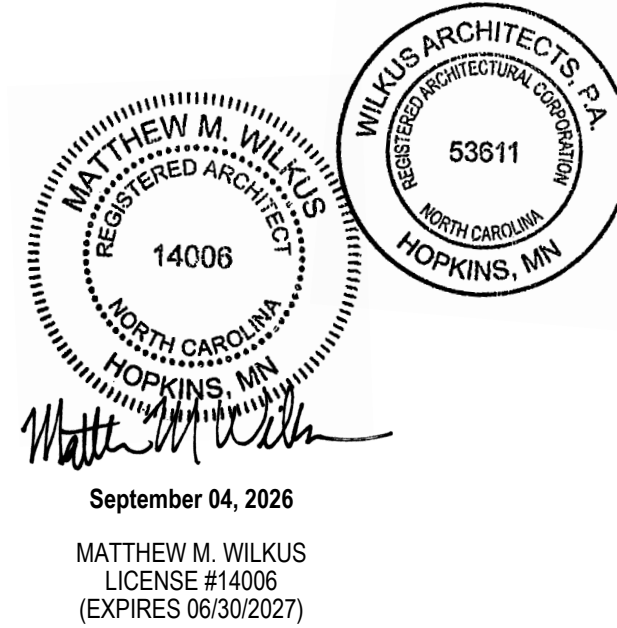

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA


ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES


TITLE:
SITE PLAN

SHEET NUMBER:


SP100

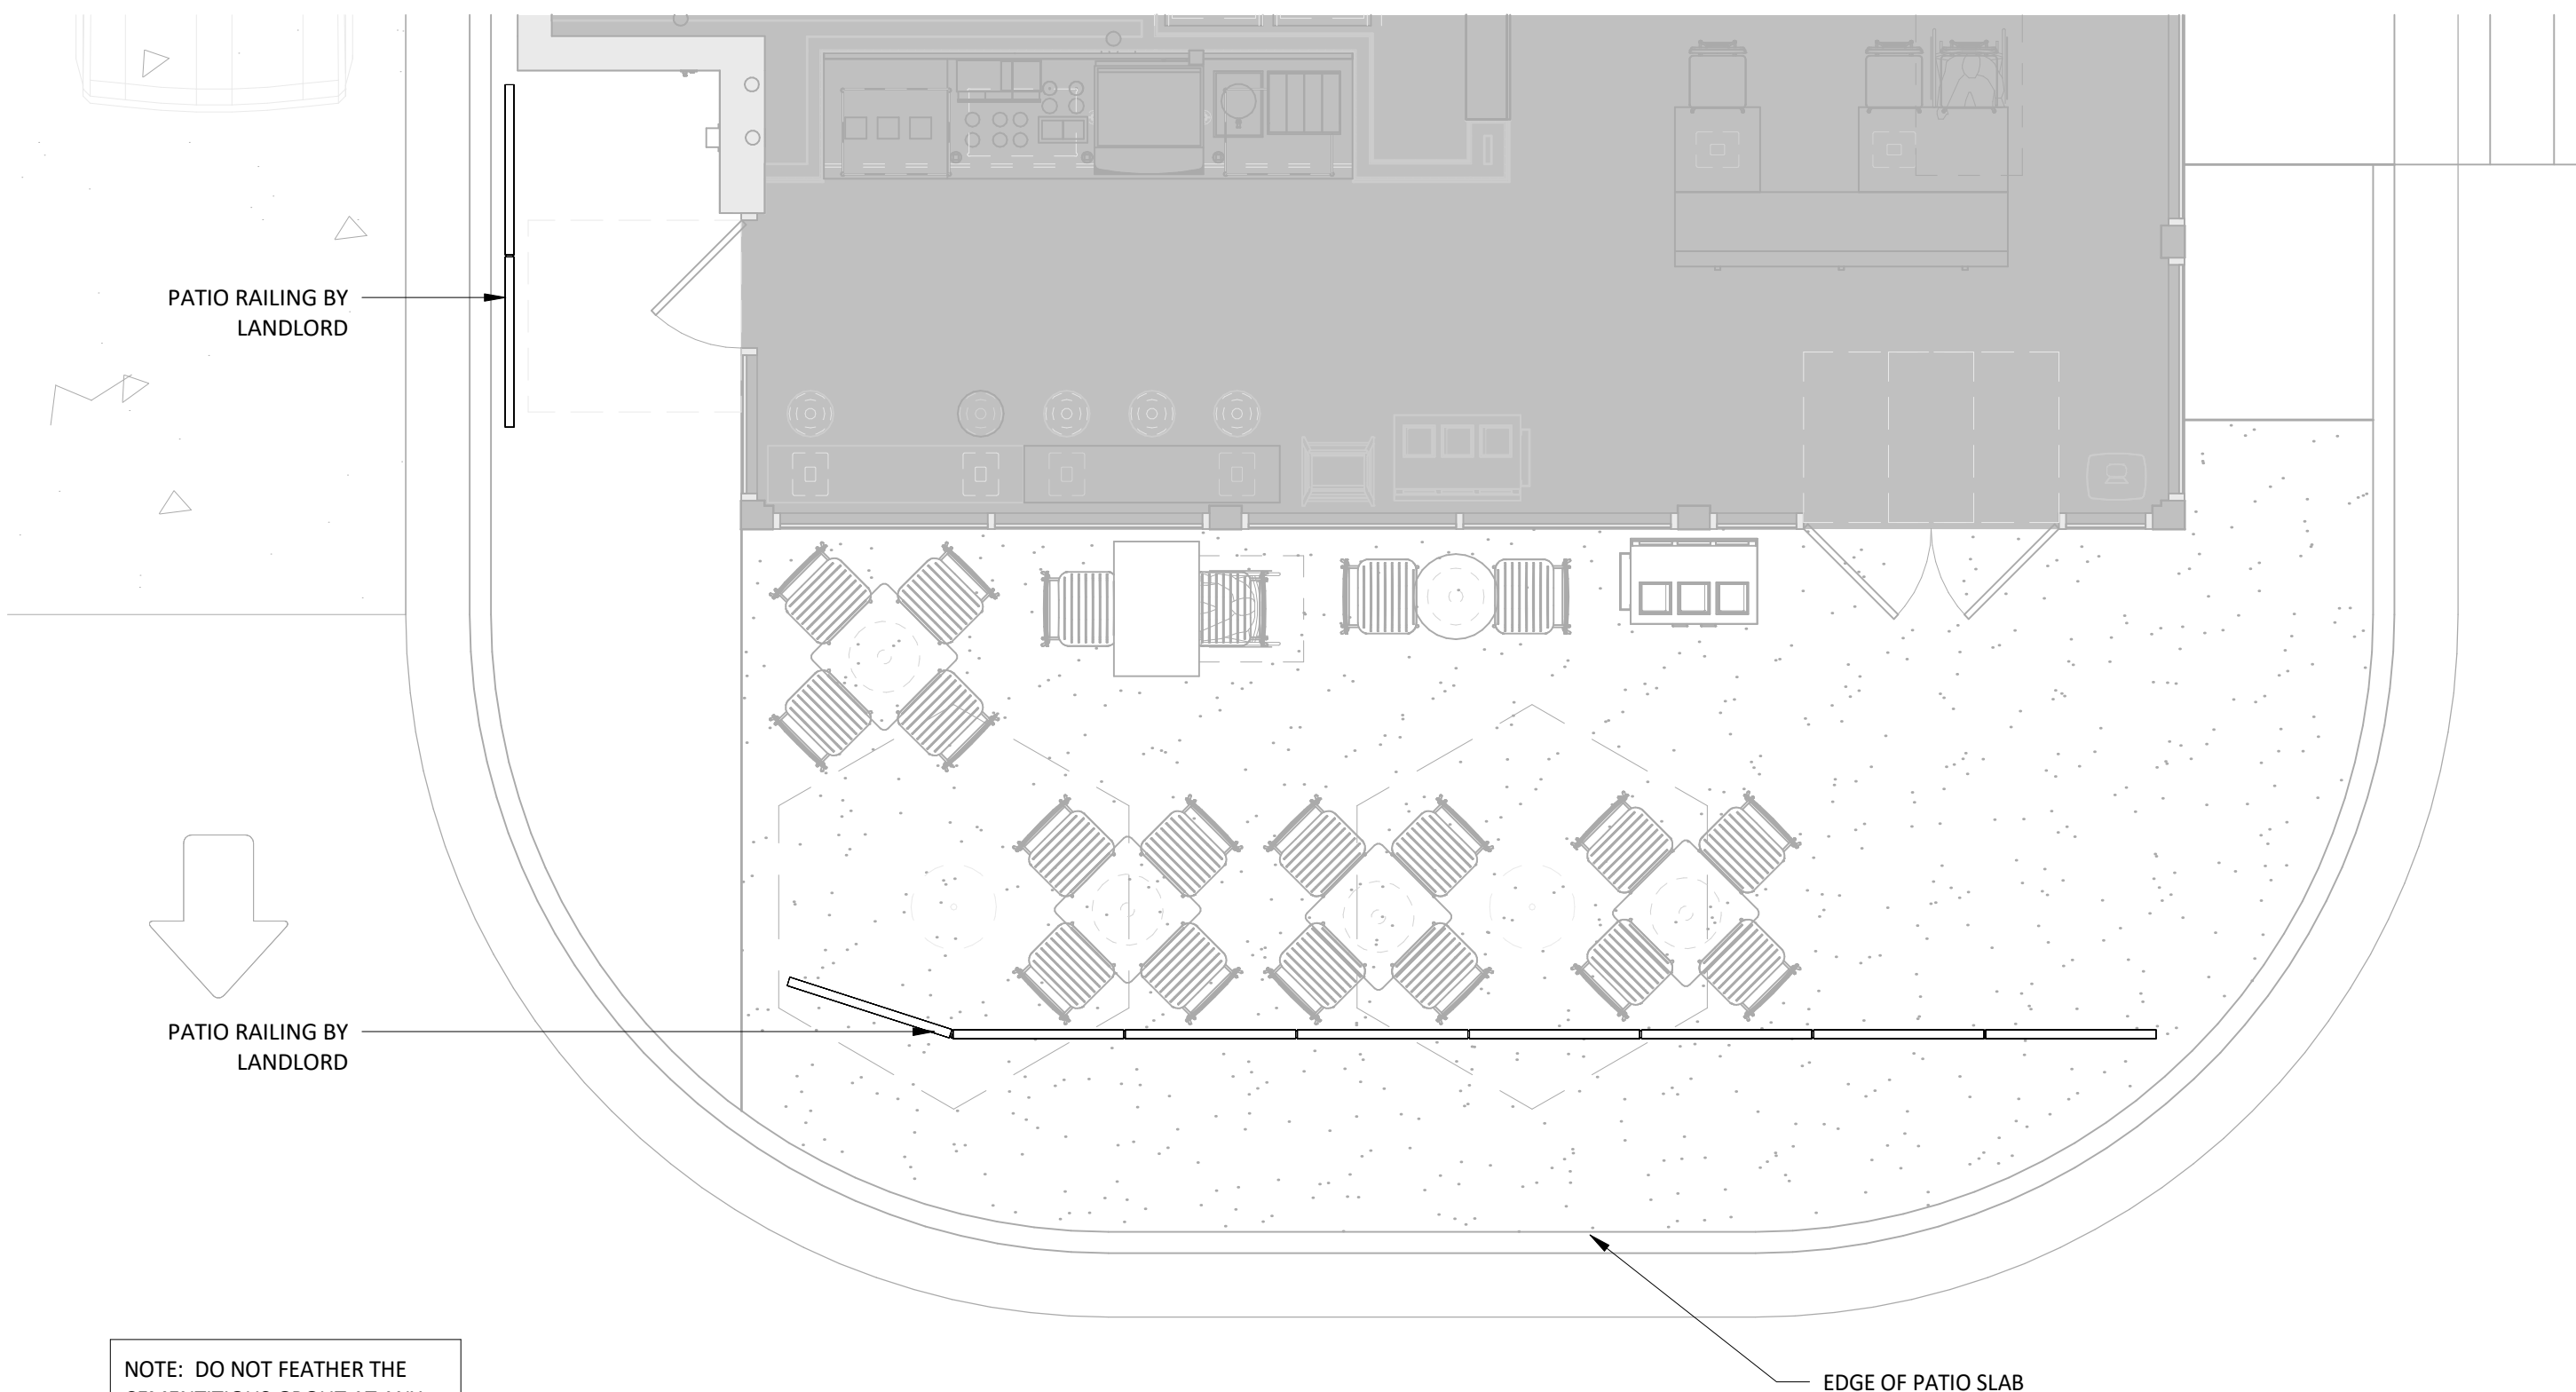

1 PATIO PLAN
SCALE: 1/4" = 1'-0"

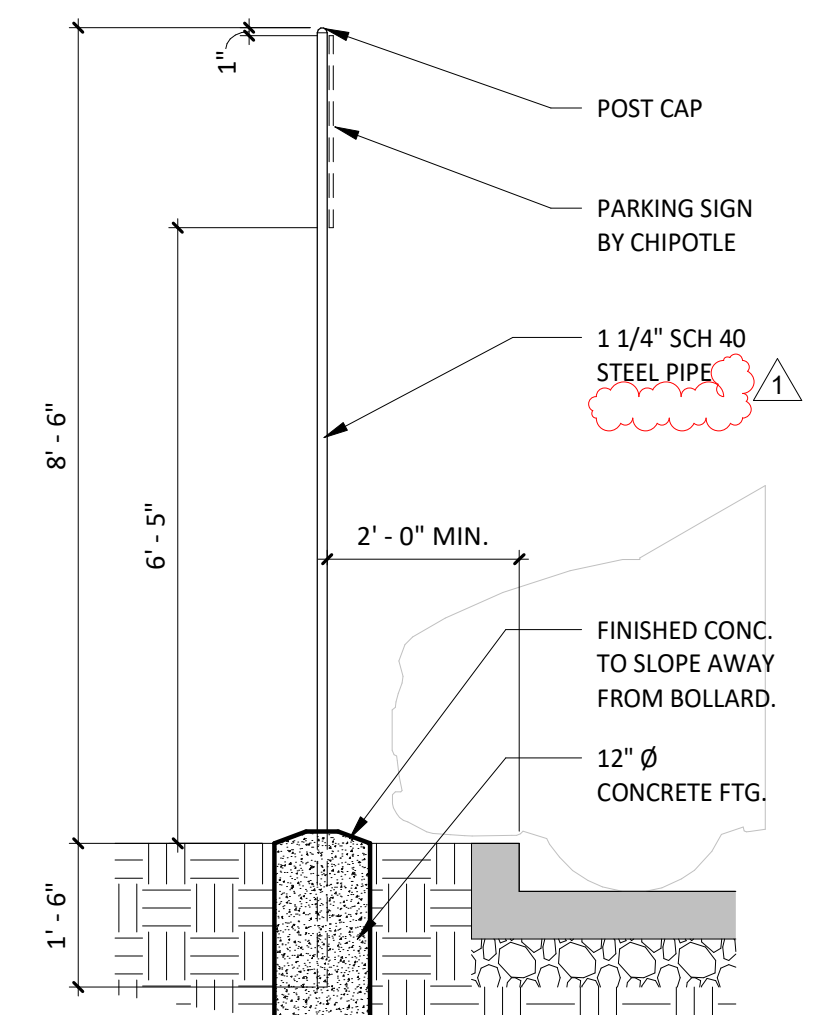

2 TYP. SIGN POST DETAIL
SCALE: 1/2" = 1'-0"

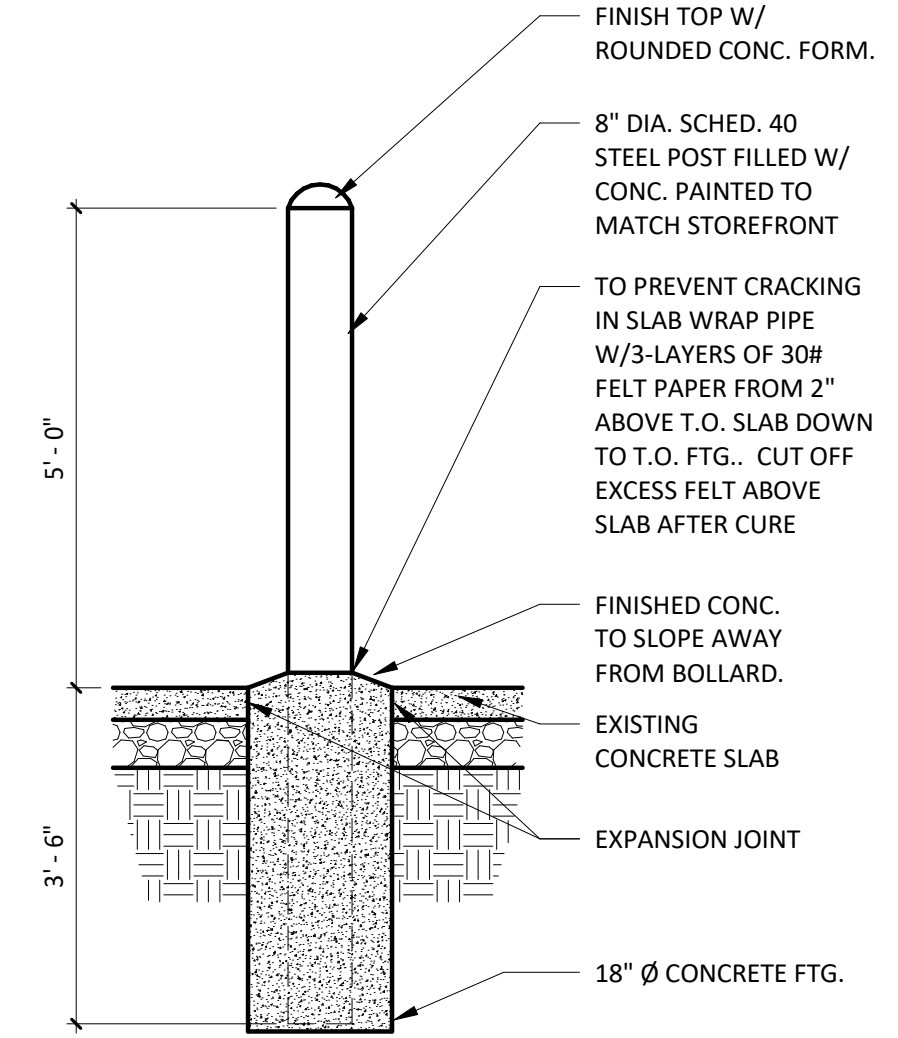

3 TYP. BOLLARD DETAIL
SCALE: 1/2" = 1'-0"

CONSULTANT:

CLIENT:

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 335-2652
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5044
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)


PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET


REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES

TITLE:
SITE DETAILS


SHEET NUMBER:
SP101

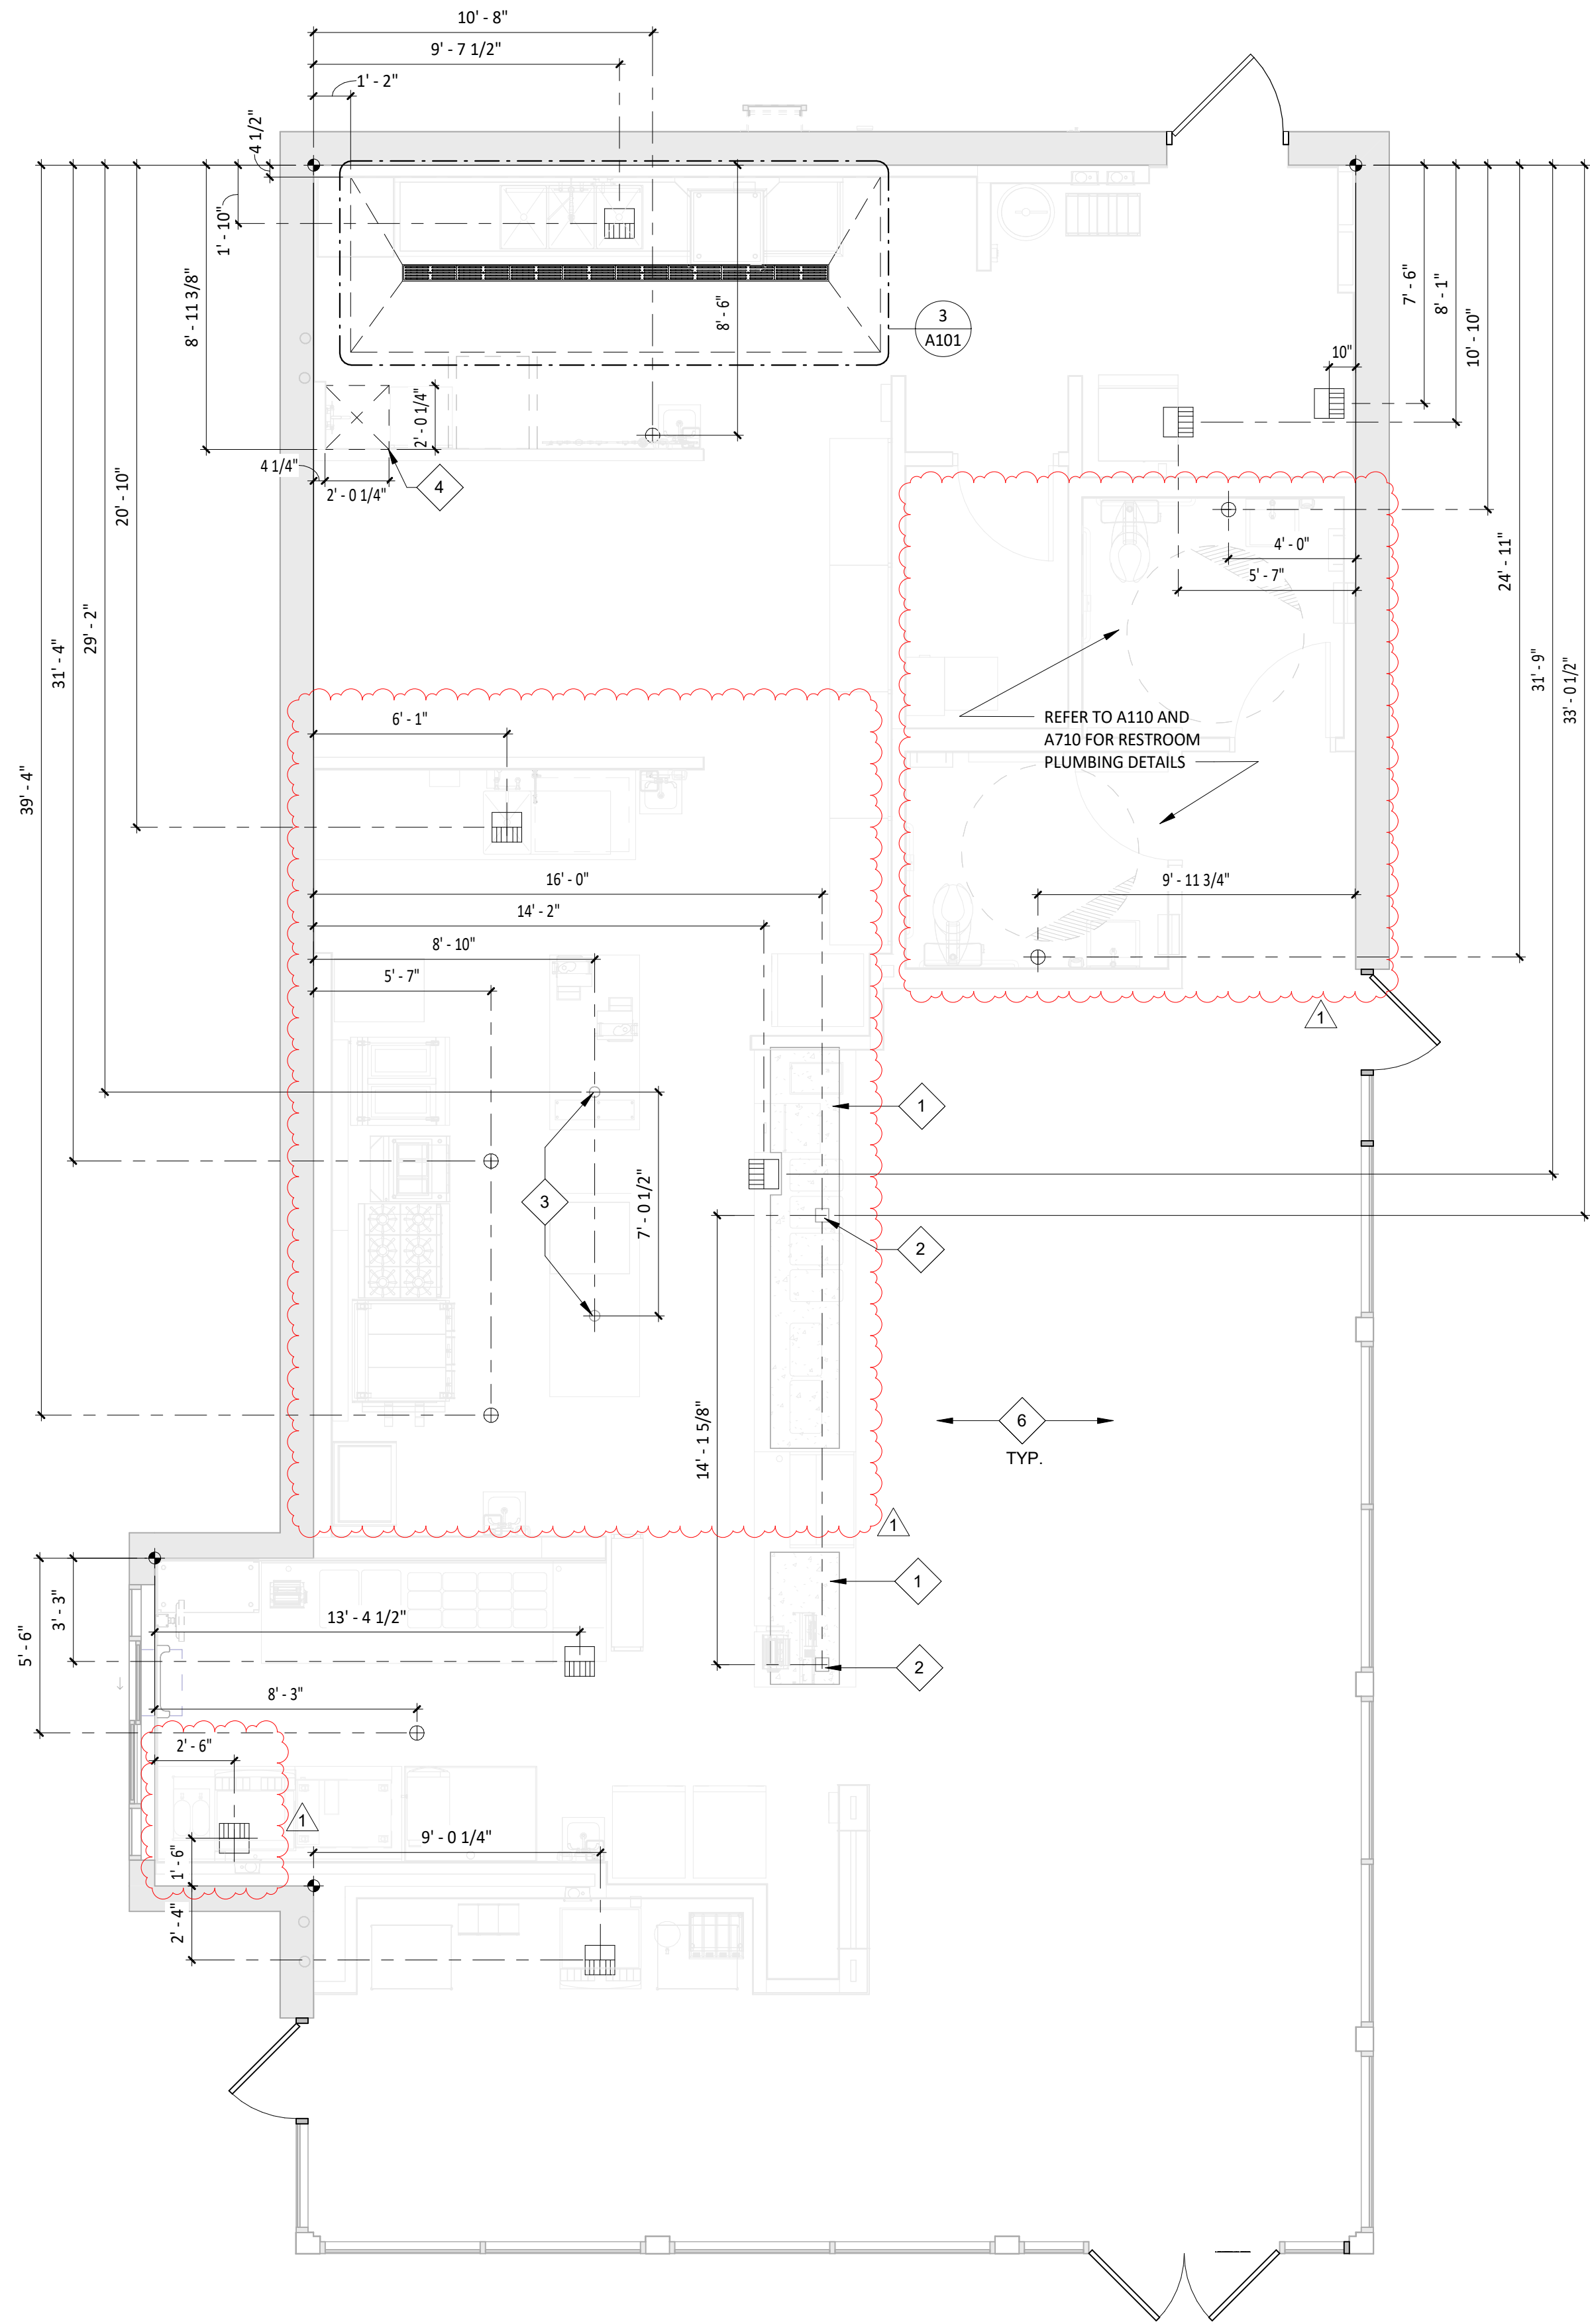


1 SLAB WORK PLAN
SCALE: 1/4" = 1'-0"

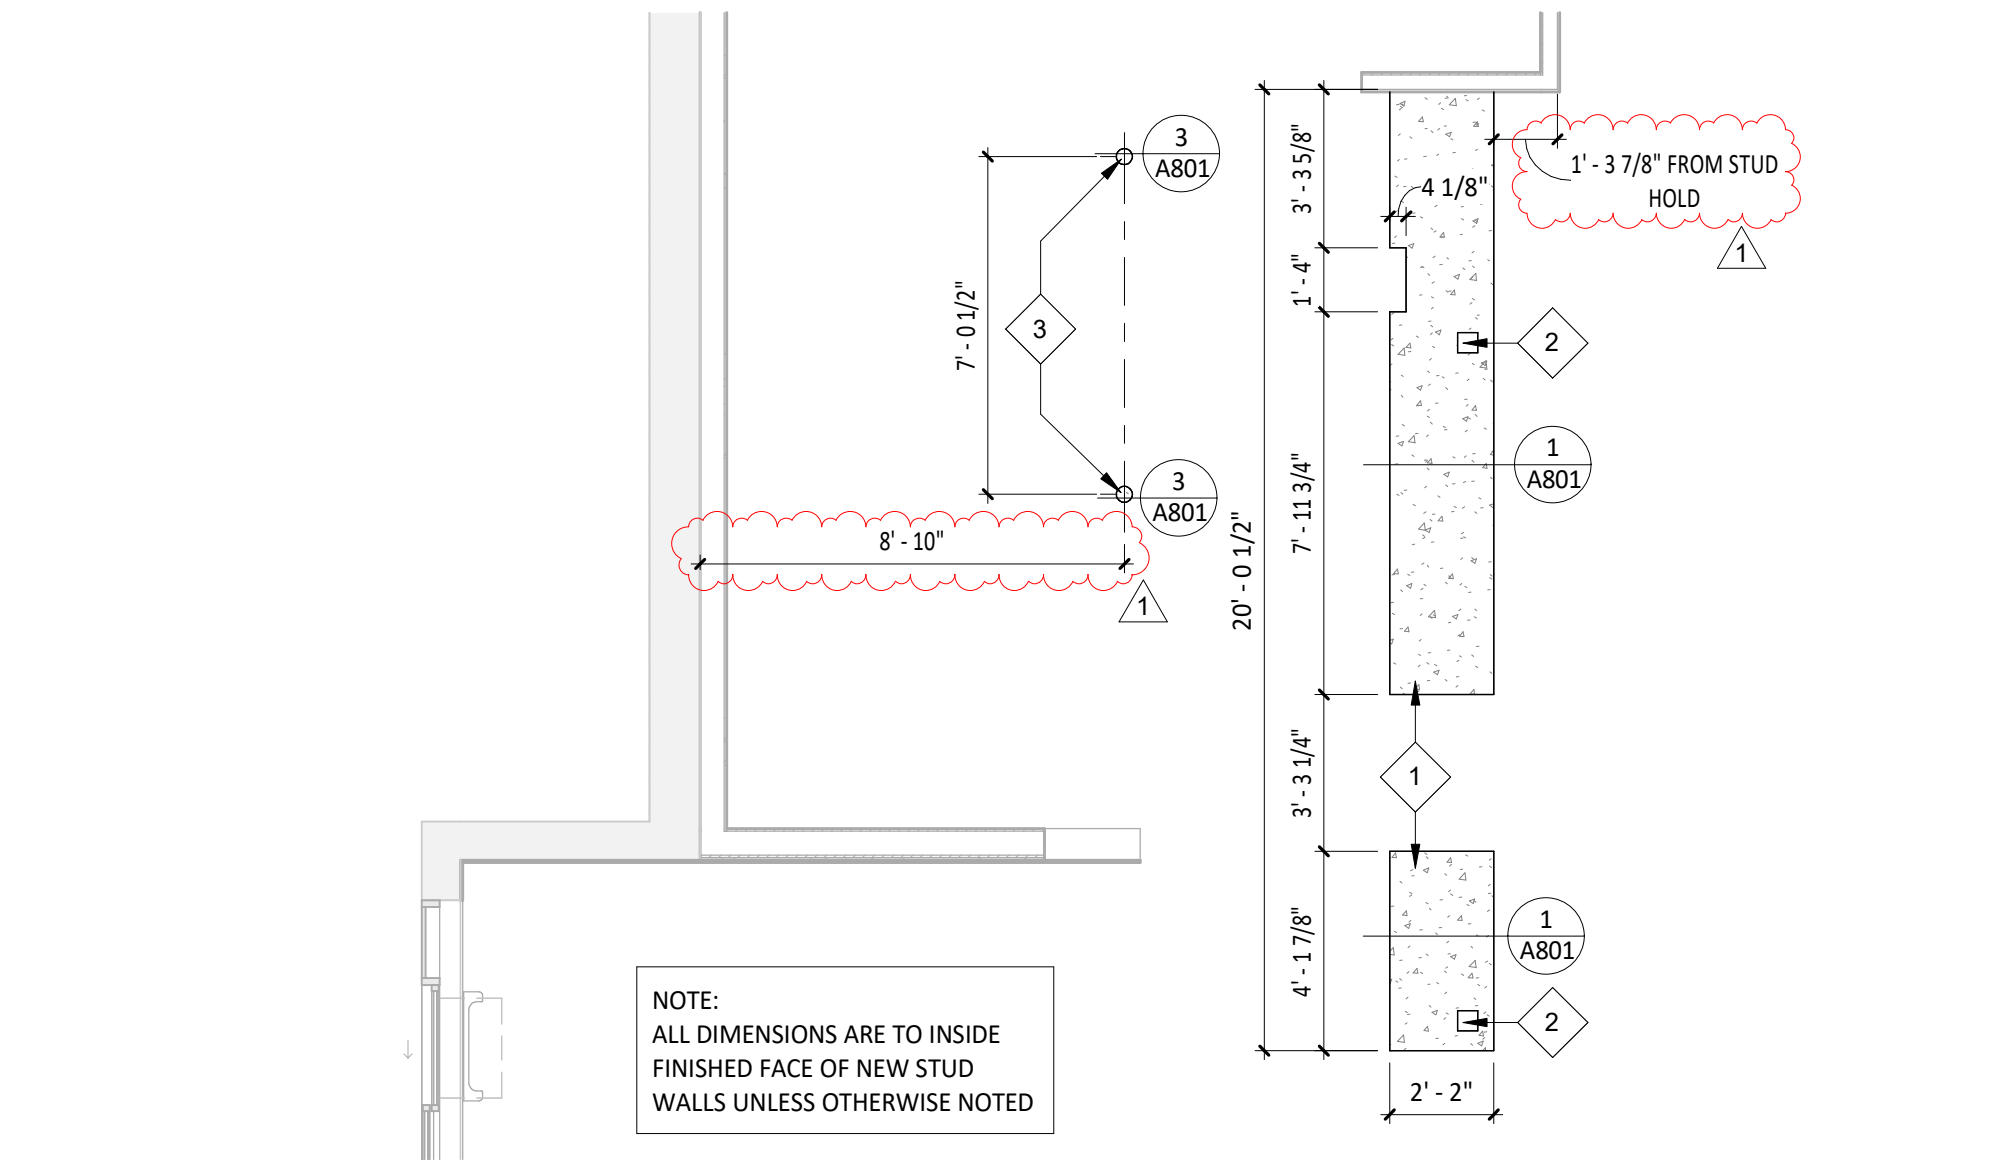

2 CURB PLAN
SCALE: 1/4" = 1'-0"

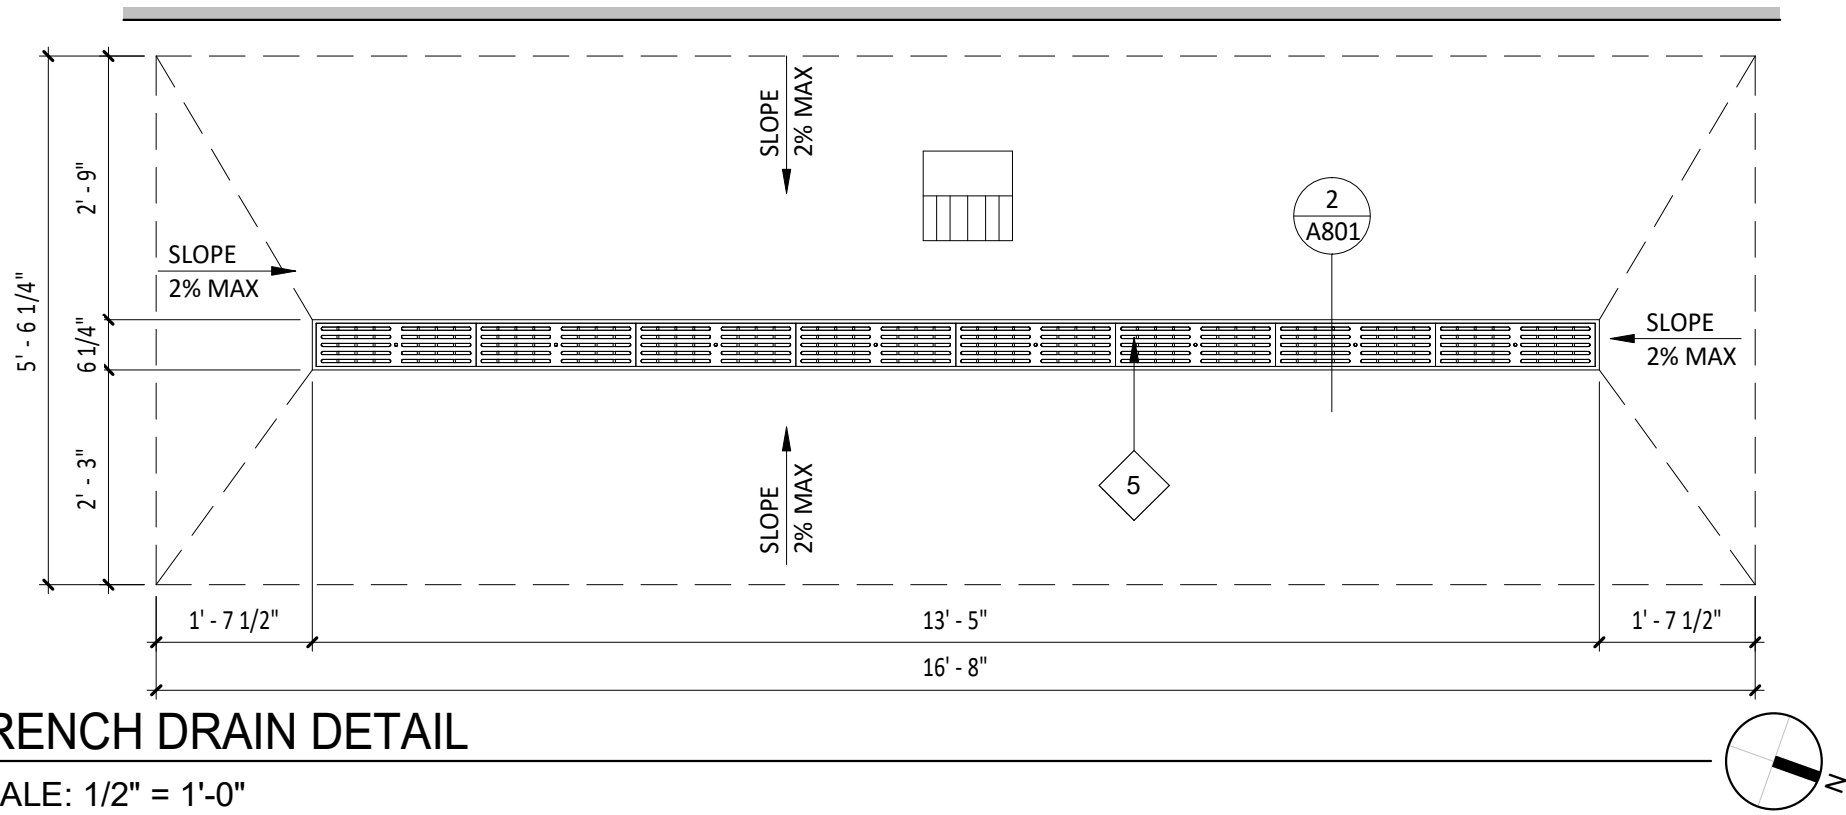

3 TRENCH DRAIN DETAIL
SCALE: 1/2" = 1'-0"

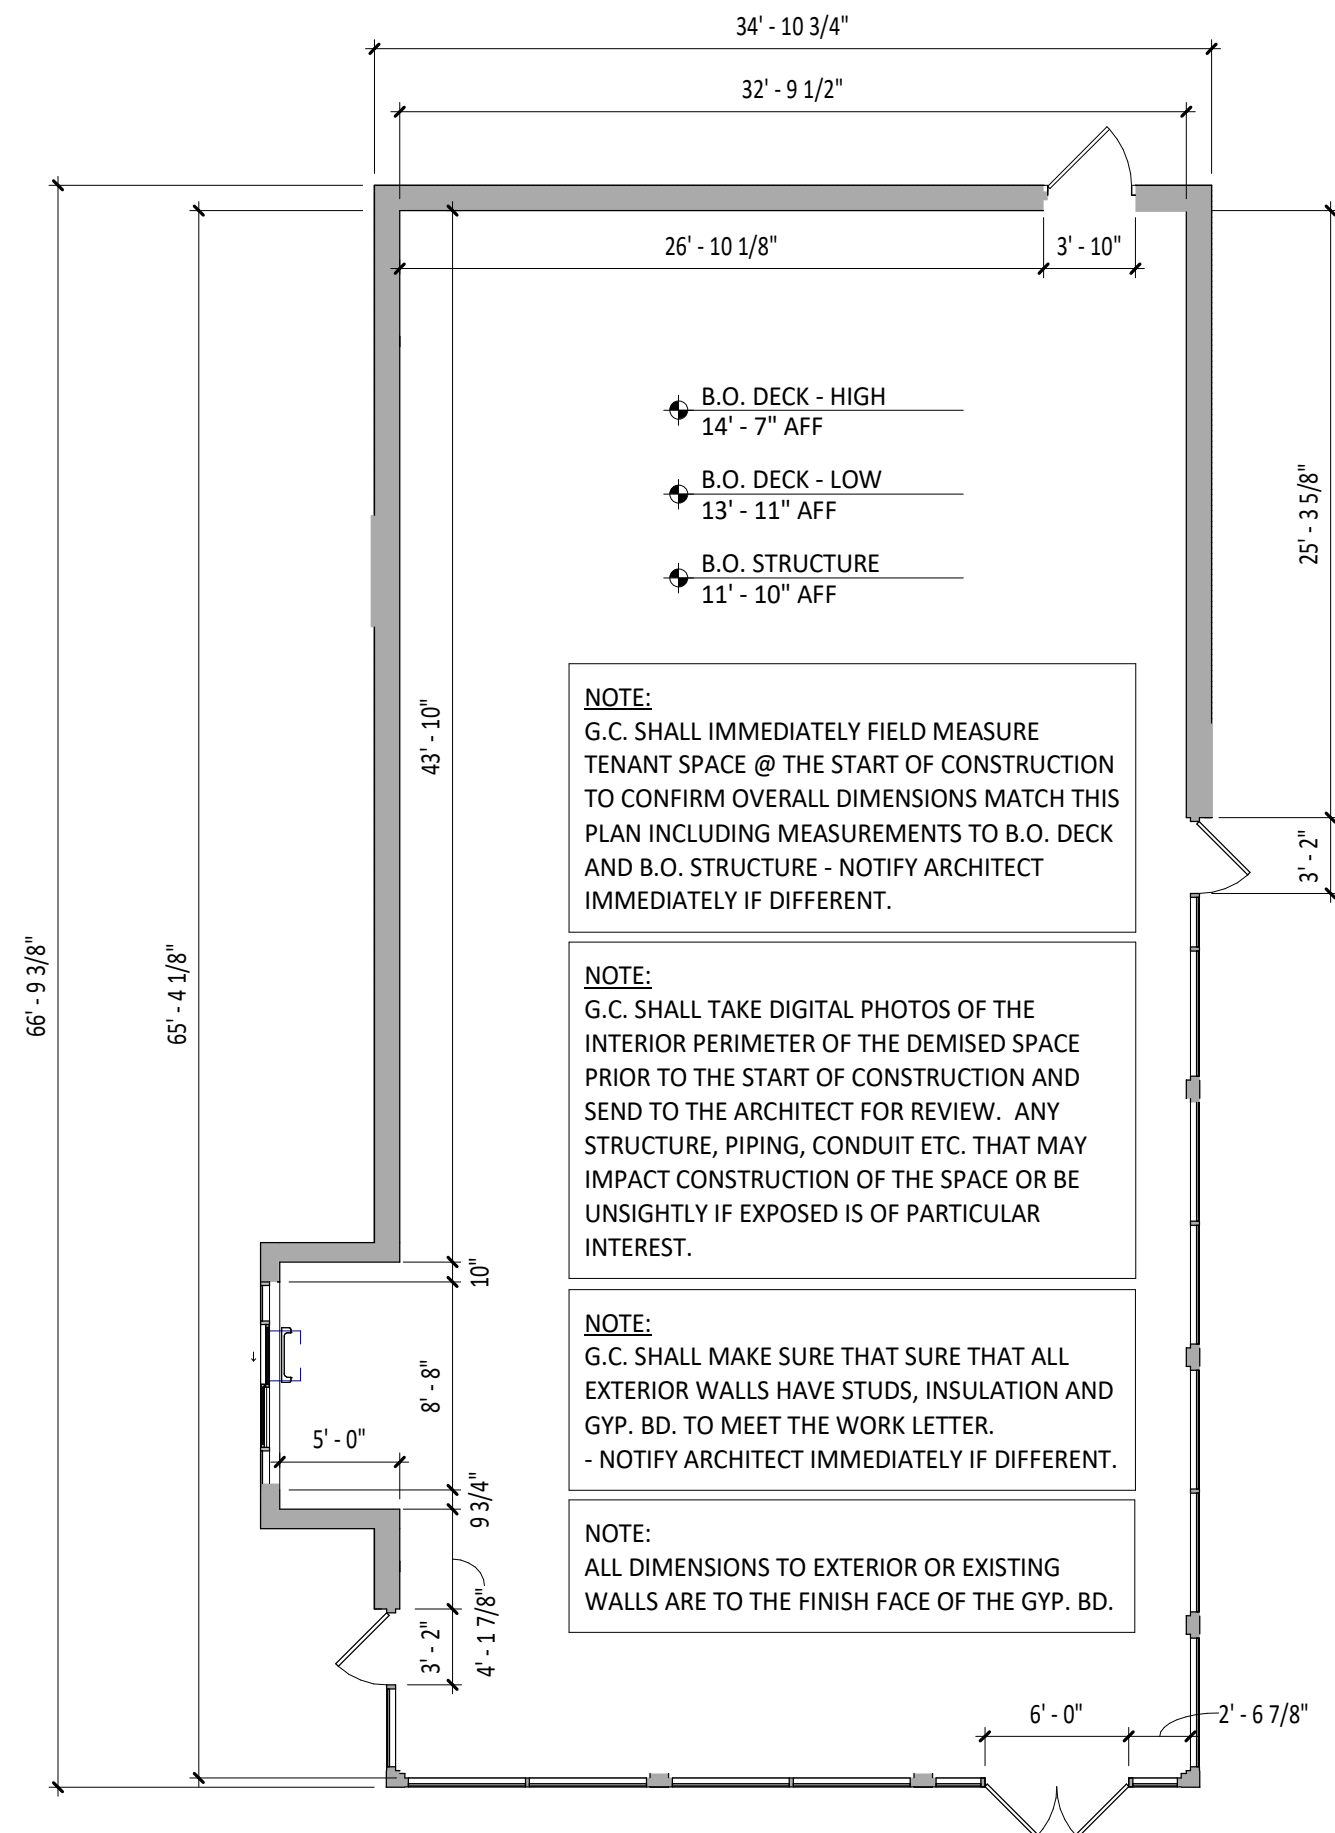

4 DEMISED PREMISES PLAN
SCALE: 1/8" = 1'-0"

GENERAL NOTES - SLAB PLAN

- ALL INTERIOR DIMENSIONS ARE TO FACE OF FRAMING, OR CENTERLINE OF STRUCTURE UNLESS NOTED OTHERWISE. ALL DIMENSIONS TO EXTERIOR OR EXISTING WALLS ARE TO FINISH FACE OF EXISTING GYPSUM BOARD. ALL DIMENSIONS TAKEN FROM TARGET POINT U.N.O.
- ALL DIMENSIONS ARE TO THE CENTERLINE OF FIXTURE UNLESS OTHERWISE NOTED.
- GC TO REVIEW ELECTRICAL PLANS FOR LIGHTING OR POWER STUB LOCATIONS PRIOR TO POURING SLAB.
- REFER TO "03300 - CAST-IN-PLACE CONCRETE" IN SPECIFICATIONS FOR CONCRETE PATCHING OR INSTALLATION INFORMATION.
- VERIFY PERIMETER FOUNDATION INSULATION IS EXISTING IN FIELD AND NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF CONSTRUCTION.
- ALL TILED FLOORS TO MAINTAIN POSITIVE SLOPE TO ALL FLOOR DRAINS OF NOT GREATER THAN 2% SLOPE FOR A 4'x4' AREA U.N.O.
- EXISTING SLAB TO BE TRENCHED AS NEEDED PER PLUMBING AND ARCHITECTURAL PLANS


PLUMBING LEGEND

- FLOOR SINK LOCATION FLOOR DRAIN LOCATION TRENCH DRAIN LOCATION

KEYNOTE LEGEND

- 4" CONCRETE CURB - COORDINATE EXACT LOCATION WITH FINAL EQUIPMENT LOCATIONS - SEE DETAILS 1/A801 FOR ADDITIONAL INFORMATION.
- 5" X 5" POWER STUB LOCATION - COORDINATE WITH ELECTRICAL PLANS FOR ADDITIONAL INFORMATION.
- 4" PVC PIPE WITH 2" HIGH CONCRETE INFILL FOR POWER STUBS - TYPICAL OF TWO (2) - REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- OUTLINE OF MOP SINK AS INDICATED.
- TRENCH DRAIN TO BE RECESSED INTO SLAB A MINIMUM OF 8" THICK CONCRETE SLAB WITH 4" MINIMUM CONCRETE BED BELOW - REFER TO MANUFACTURERS INSTALLATION INSTRUCTIONS - SLOPE FLOOR IN THIS AREA ONLY TOWARDS DRAIN 1/40.
- NEW CONCRETE SLAB-ON-GRADE WITH 10 MIL POLY VAPOR BARRIER OVER POROUS FILL - REFER TO STRUCTURAL DRAWINGS FOR ADDITIONAL INFORMATION.

CONSULTANT:

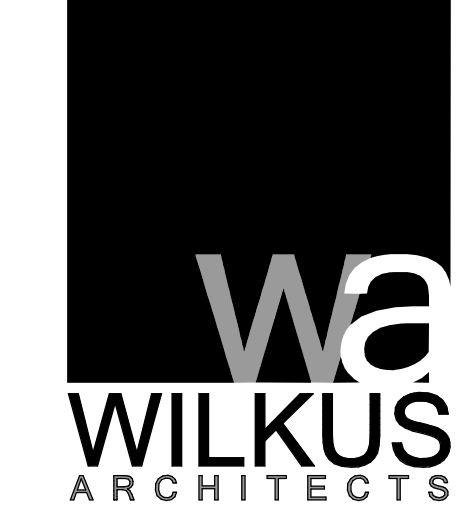

CLIENT:




CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2682
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2026
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

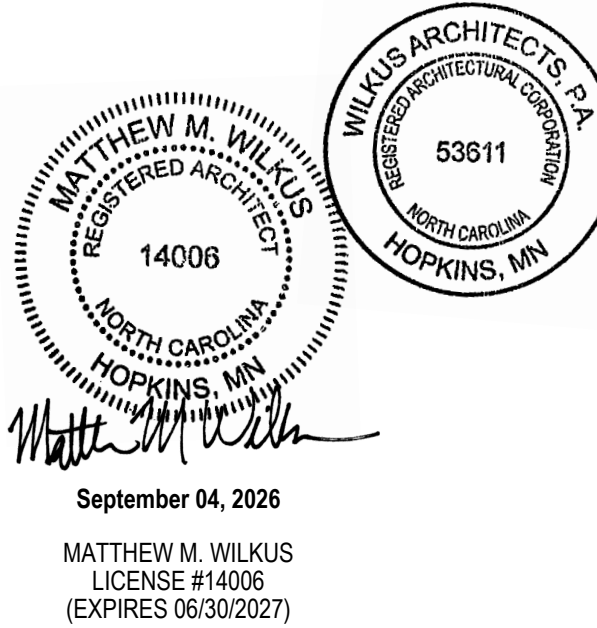

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES


TITLE:
SLAB WORK PLAN

SHEET NUMBER:


A101

GENERAL NOTES - FLOOR PLAN

- A. ALL INTERIOR DIMENSIONS ARE TO FACE OF FRAMING, OR CENTERLINE OF STRUCTURE UNLESS NOTED OTHERWISE. ALL DIMENSIONS TO EXTERIOR OR EXISTING WALLS ARE TO FINISH FACE OF EXISTING GYPSUM BOARD. ALL DIMENSIONS TAKEN FROM TARGET POINT U.N.O.
- B. DASHED CIRCLE IN RESTROOM INDICATE TURNING DIAMETER REQUIRED BY ADA.
- C. REFER TO WALL FINISH LEGEND ON A120.
- D. ALL STUDS ARE 3 5/8" METAL STUDS UNLESS NOTED OTHERWISE ON PLAN.
- E. ALL INTERIOR DOORS ARE 4" OFF OF PERPENDICULAR WALL UNLESS NOTED OTHERWISE.
- F. IN SITUATIONS WHERE TENANT'S G.C. IS TO PROVIDE TYPE 'X' GYP. BD. FOR A RATED ASSEMBLY, THE TYPE 'X' GYP. BD. IS REQUIRED TO GO BENEATH THE SHEATHING AND FINISHES.
- G. SEE SHEET A801 FOR ADDITIONAL SHEATHING BEHIND CERTAIN WALL FINISHES.
- H. SEE A601 FOR DOOR TYPES.
- I. TENANT'S GENERAL CONTRACTOR TO LAYOUT OF ENTIRE SPACE PRIOR TO STARTING FRAMING AND REPORT ANY DESCREPANCIES IN NOTED DIMENSIONS TO ARCHITECT AND CHIPOTLE MEXICAN GRILL'S CM PRIOR TO PROCEEDING. FAILURE TO ADHERE TO THESE REQUIREMENTS RESULTING IN ANY REMEDIATION REQUIRED TO MEET DESIGN INTENT WILL BE AT CONTRACTOR'S COST.
- J. SEE A110 FOR WALL TYPE INFORMATION.
- K. PROVIDE DEFLECTION TRACK AT ALL WALLS WHICH GO TO THE UNDERSIDE OF DECKING, REFER TO SHEET A110.
- L. PROVIDE FULL HEIGHT BLOCKING IN WALL FOR ALL SHELVING, TYP.
- M. DENSSHIELD TILE BACKER BOARD SHALL NOT BE INSTALLED OVER VAPOR BARRIERS AT EXTERIOR WALLS.
- N. MOISTURE RESISTANT GYP. BD. SHALL BE USED IN RESTROOMS.

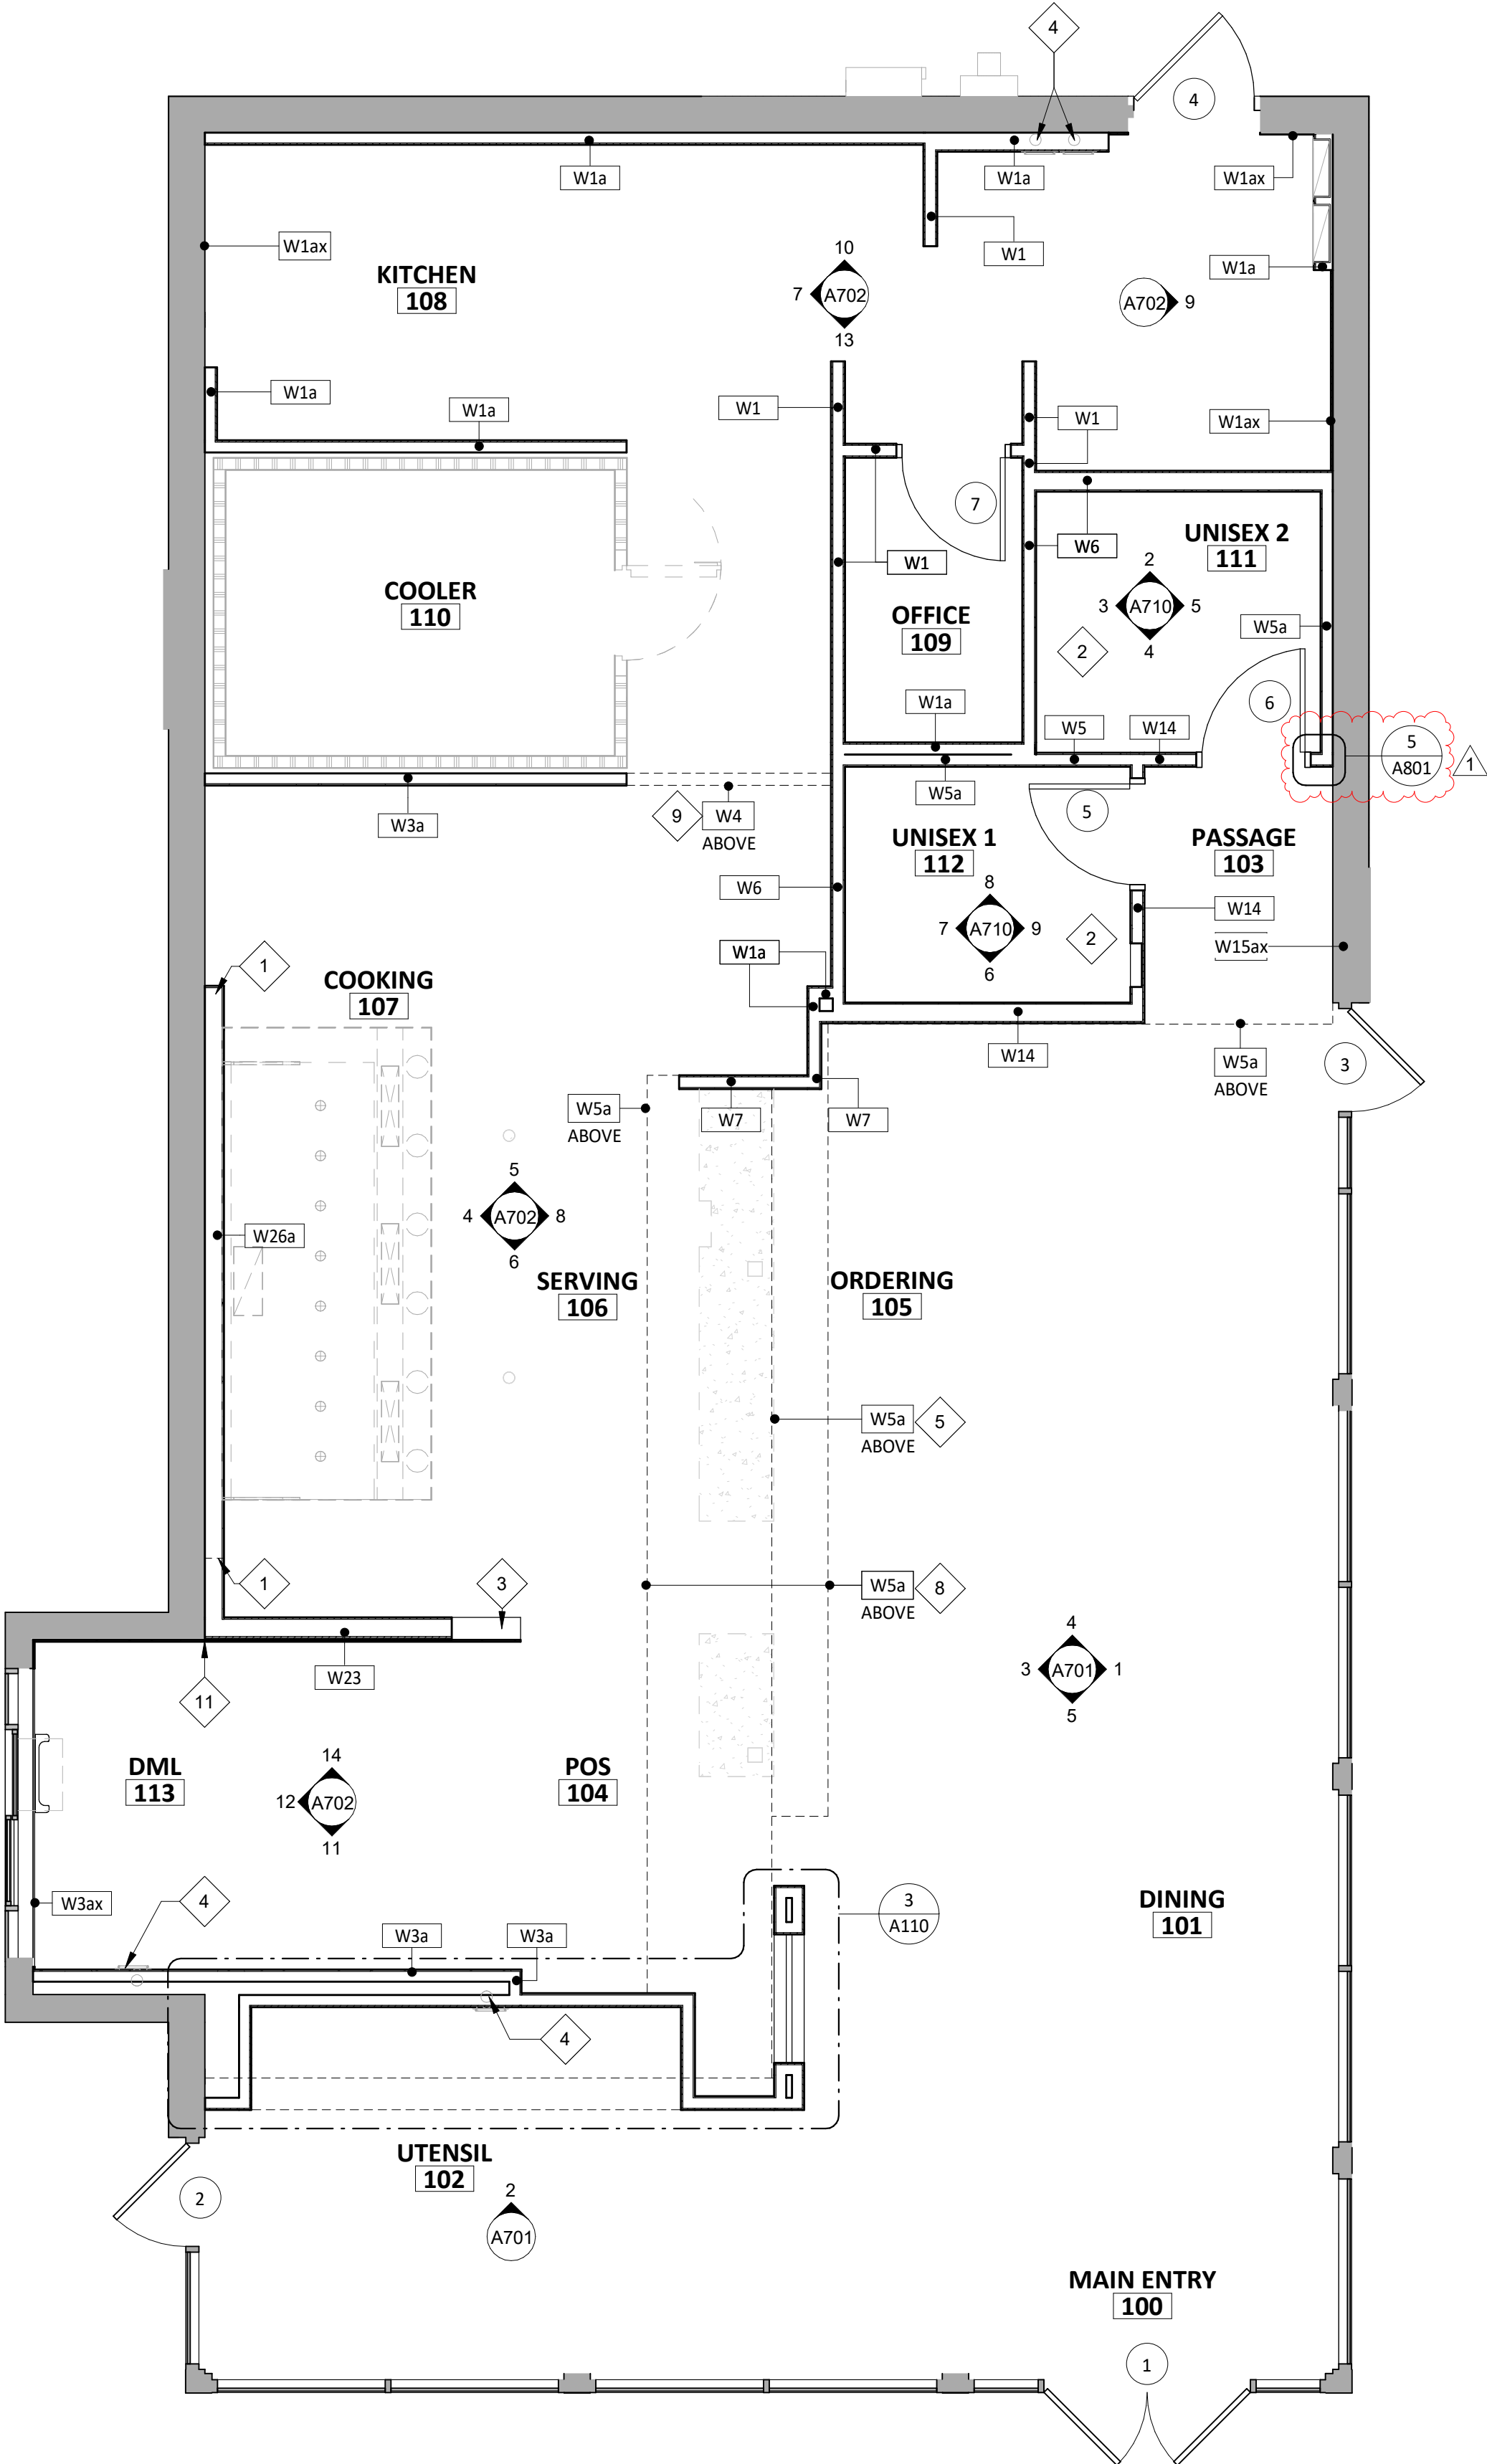

1 ARCHITECTURAL FLOOR PLAN
SCALE: 1/4" = 1'-0"

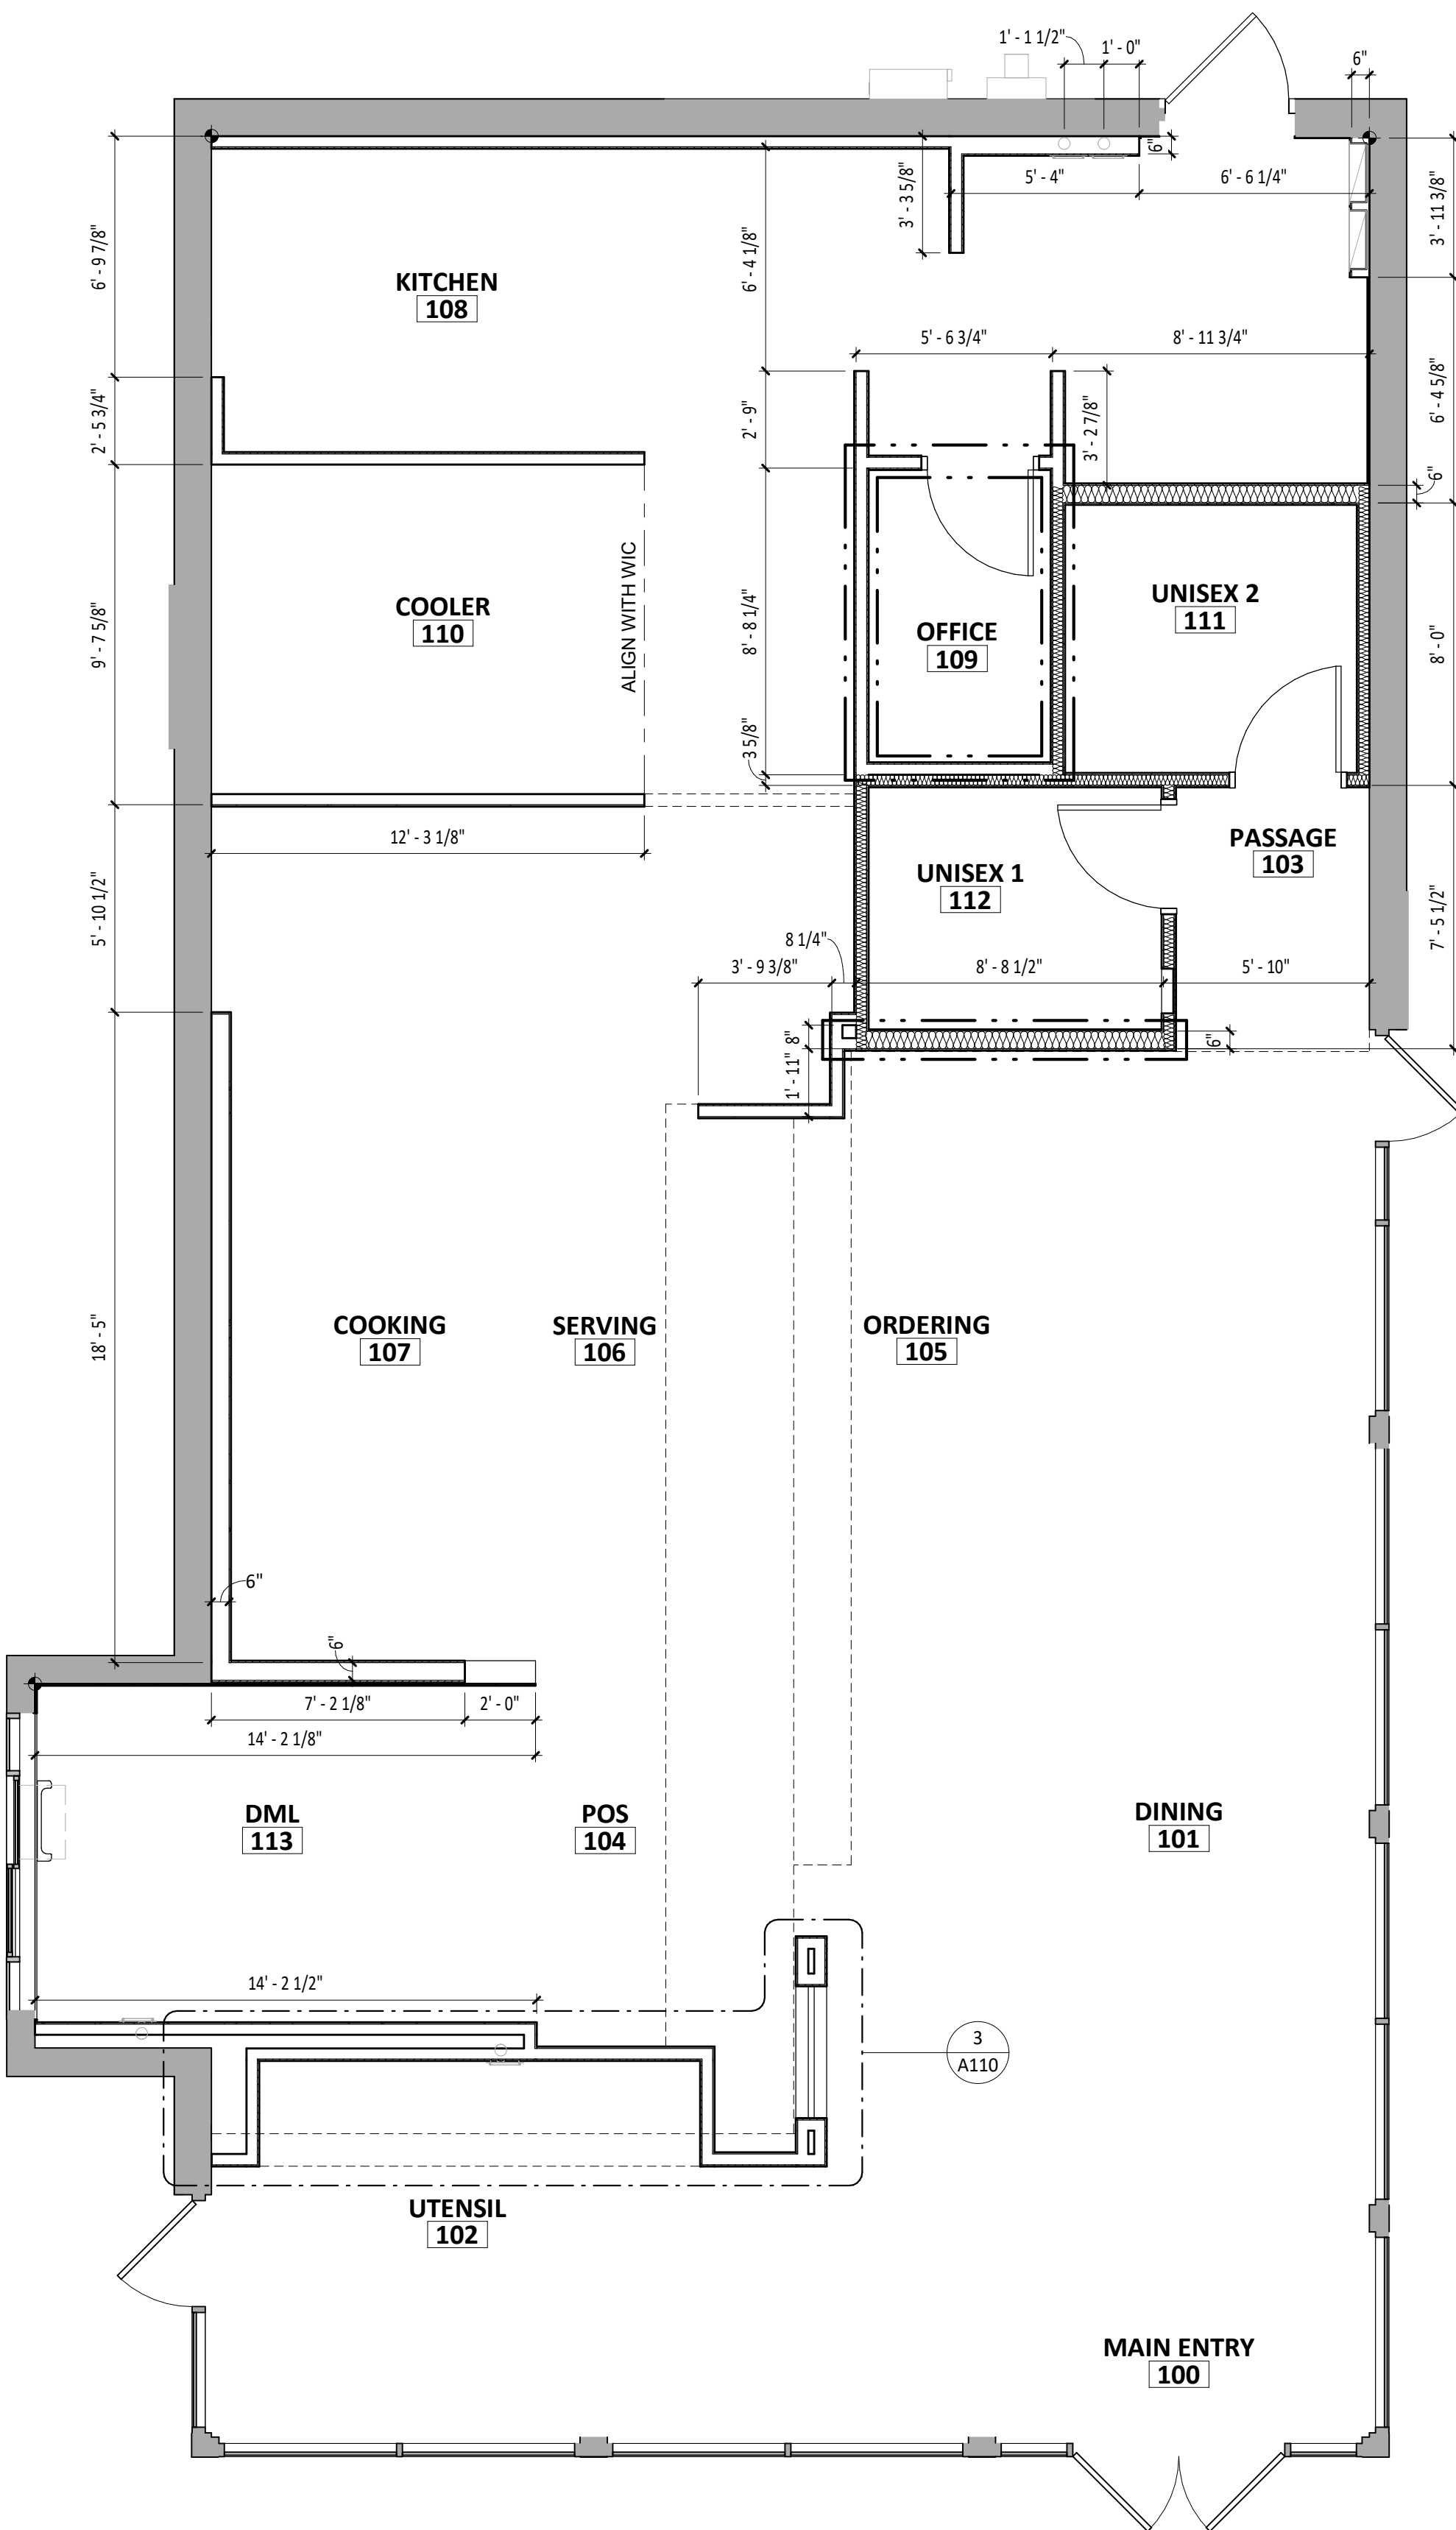


2 DIMENSIONED FLOOR PLAN
SCALE: 1/4" = 1'-0"

WALL TYPE LEGEND

NEW CONSTRUCTION		INDICATES LOCATION OF ITEMS ABOVE	
EXISTING CONSTRUCTION		DESIGNATES WALLS & SHEATHING TO EXTEND TO DECK	
NEW CONSTRUCTION WITH SOUND BATT INSULATION			
WALK-IN COOLER			

KEYNOTE LEGEND

- 1 WHERE GREASE EXHAUST HOOD INTERSECTS WALLS. PROVIDE 24 GAUGE GALVANIZED METAL FROM TOP OF WALL TO 18" PAST HOOD IN ALL DIRECTIONS.
- 2 FOR ALL REQUIRED BLOCKING LOCATIONS, REFER TO ELEVATIONS ON A710.
- 3 LOCATION OF WALL PASS-THROUGH OPENING, REFER TO A702.
- 4 DRYER VENTS IN WALL FOR SODA LINES ROUTED ABOVE 4" PVC PIPES. REFER TO A801 FOR ADDITIONAL INFORMATION.
- 5 DASHED LINES INDICATE LOCATION OF SOFFIT WALL TO DECK ABOVE. REFER TO A201 FOR ADDITIONAL INFORMATION.
- 6 HATCH LOCATED WITHIN WALLS AS SHOWN INDICATES THAT TOP OF FRAMING IS TO NOT EXCEED 10'-0" AFF.
- 7 LOCATION OF UTENSIL COUNTER BY MILLWORK SUPPLIER, PROVIDE 18" BAND OF CONCEALED BLOCKING AND REFER TO A701
- 8 DASHED LINES INDICATE LOCATION OF SOFFIT ABOVE, REFER TO A201 FOR ADDITIONAL INFORMATION.
- 9 DASHED LINES INDICATE LOCATION OF HEADER ABOVE, REFER TO A201 FOR ADDITIONAL INFORMATION.
- 10 FOR LOCATION OF LOW-WALL CONDITION AT MOPUS, REFER TO A502, A701 AND A702.
- 11 ALIGN SUBSTRATE.

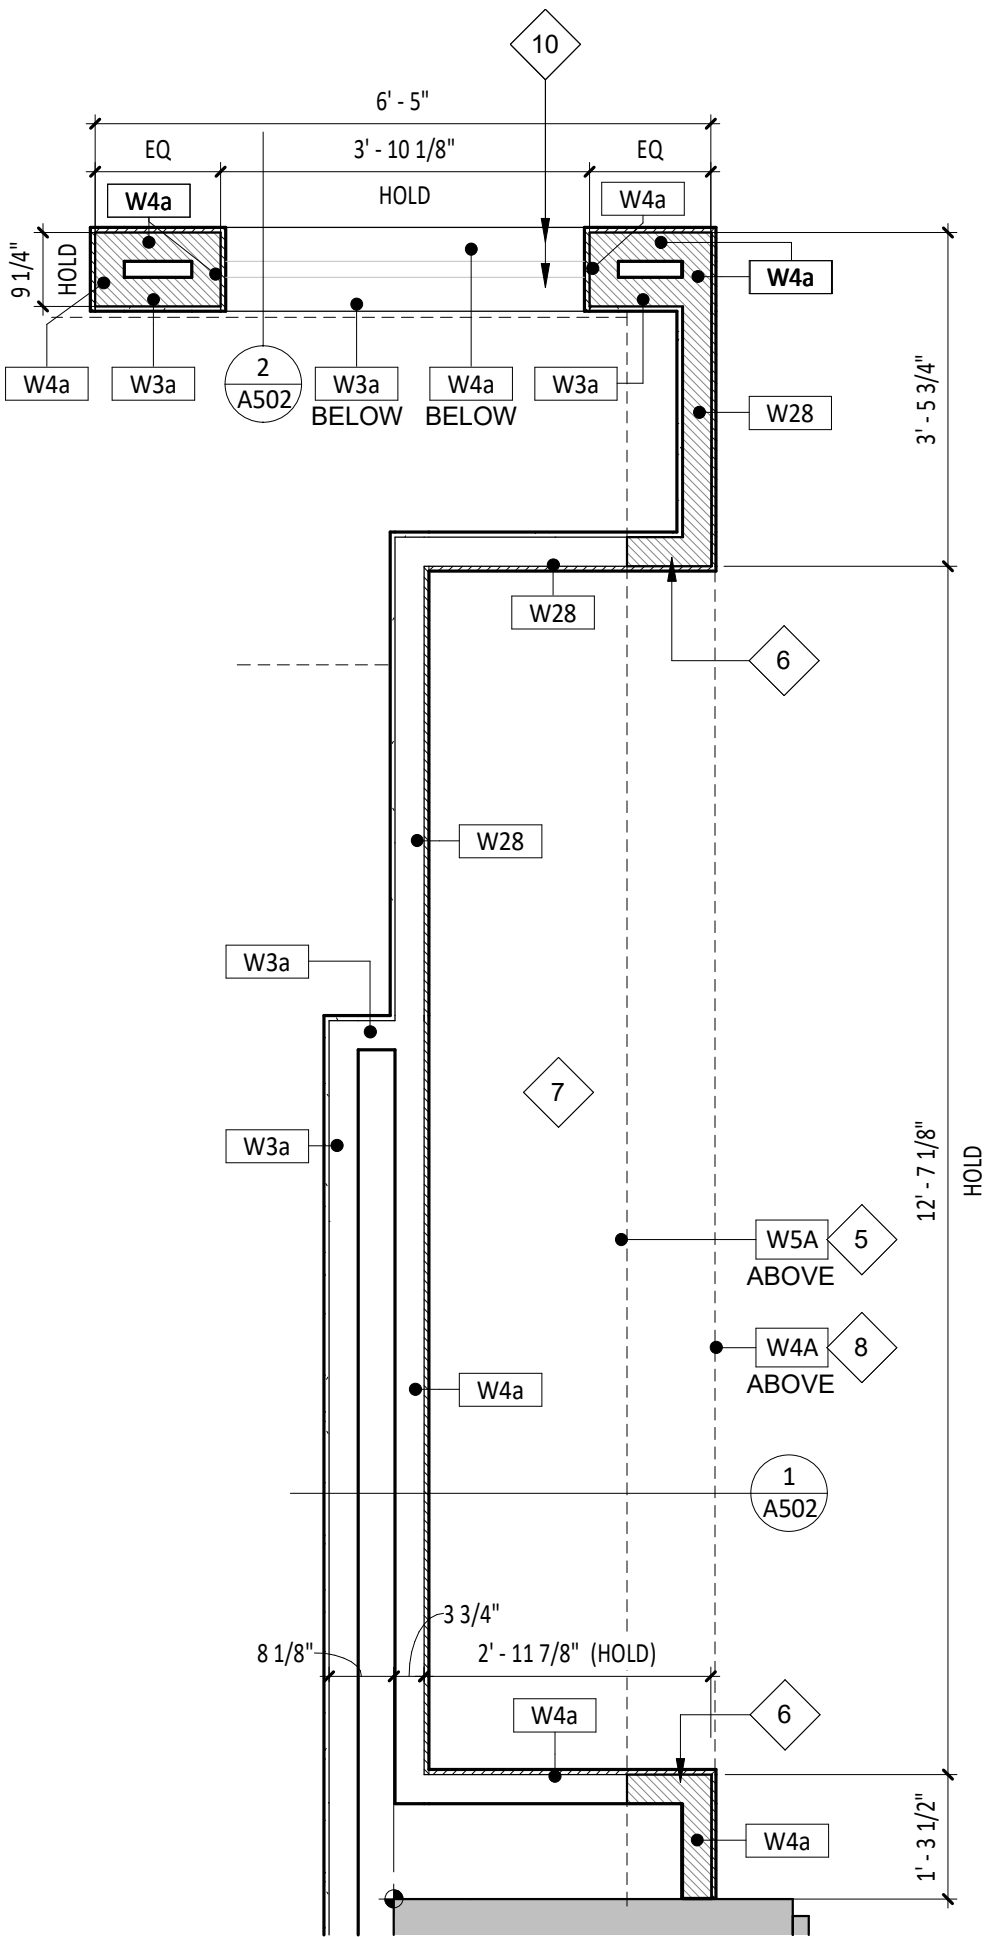

3 ENLARGED UTENSIL/MOPUS PLAN
SCALE: 1/2" = 1'-0"




COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

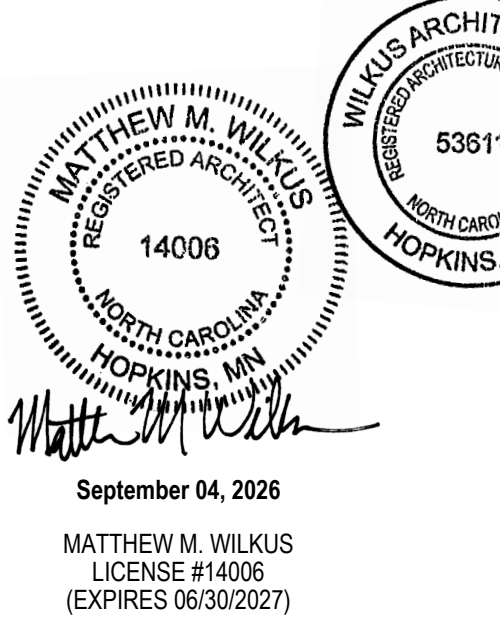


PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET


REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES

TITLE:
ARCHITECTURAL
FLOOR PLAN

SHEET NUMBER:
A110

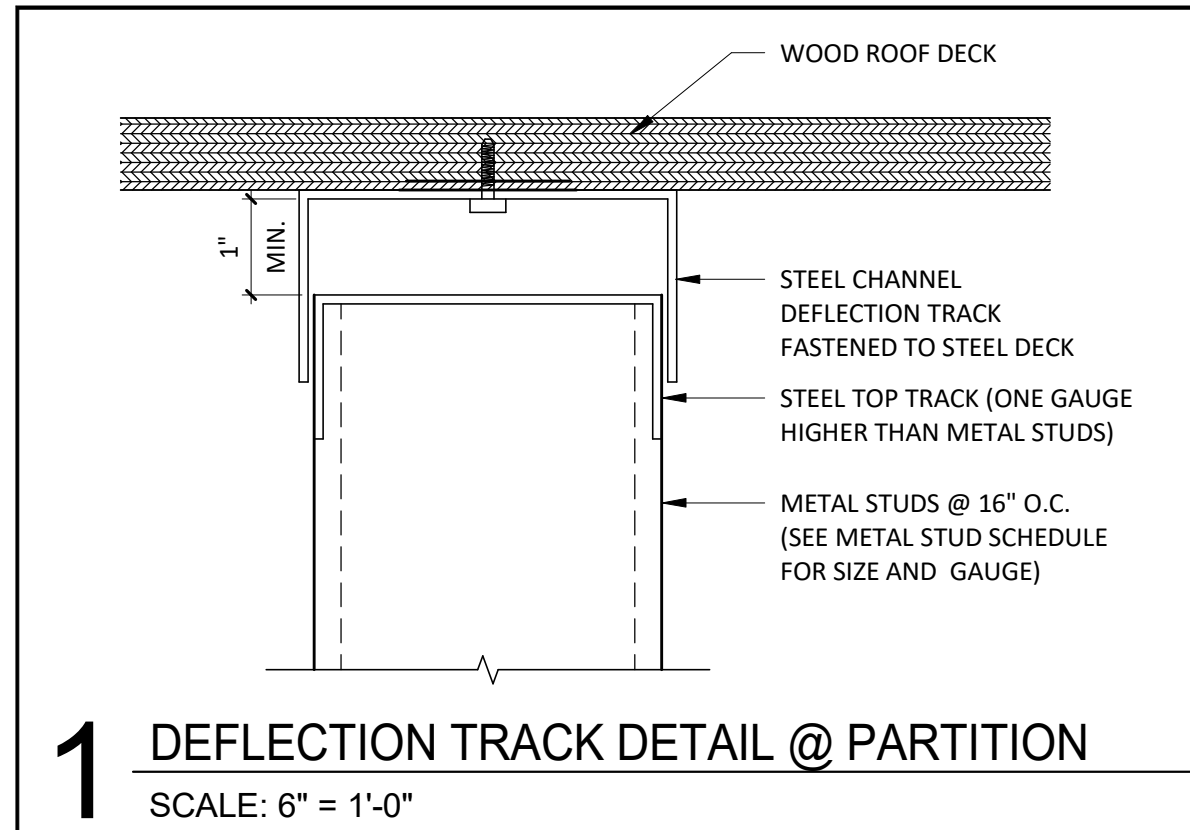


1 DEFLECTION TRACK DETAIL @ PARTITION
SCALE: 6" = 1'-0"

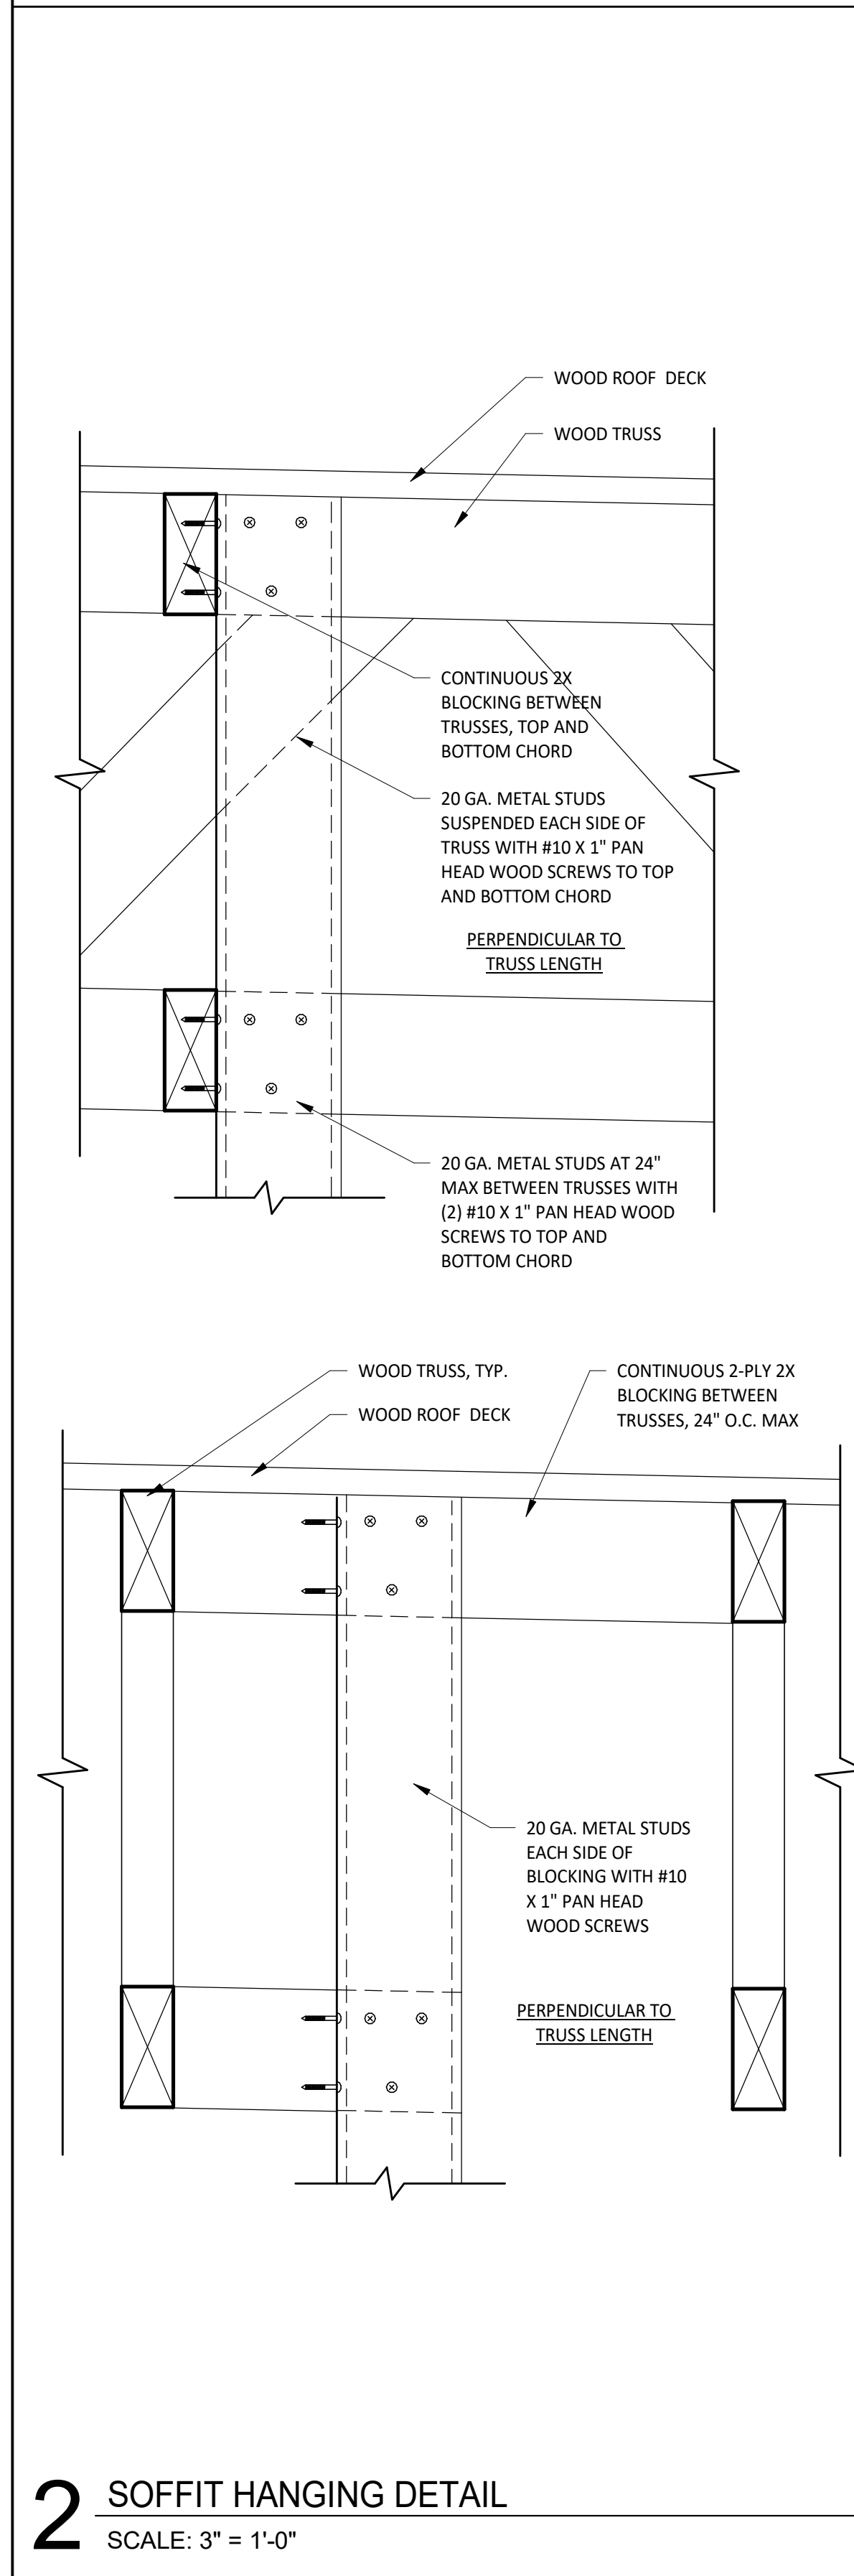

2 SOFFIT HANGING DETAIL
SCALE: 3" = 1'-0"

WALL TYPES

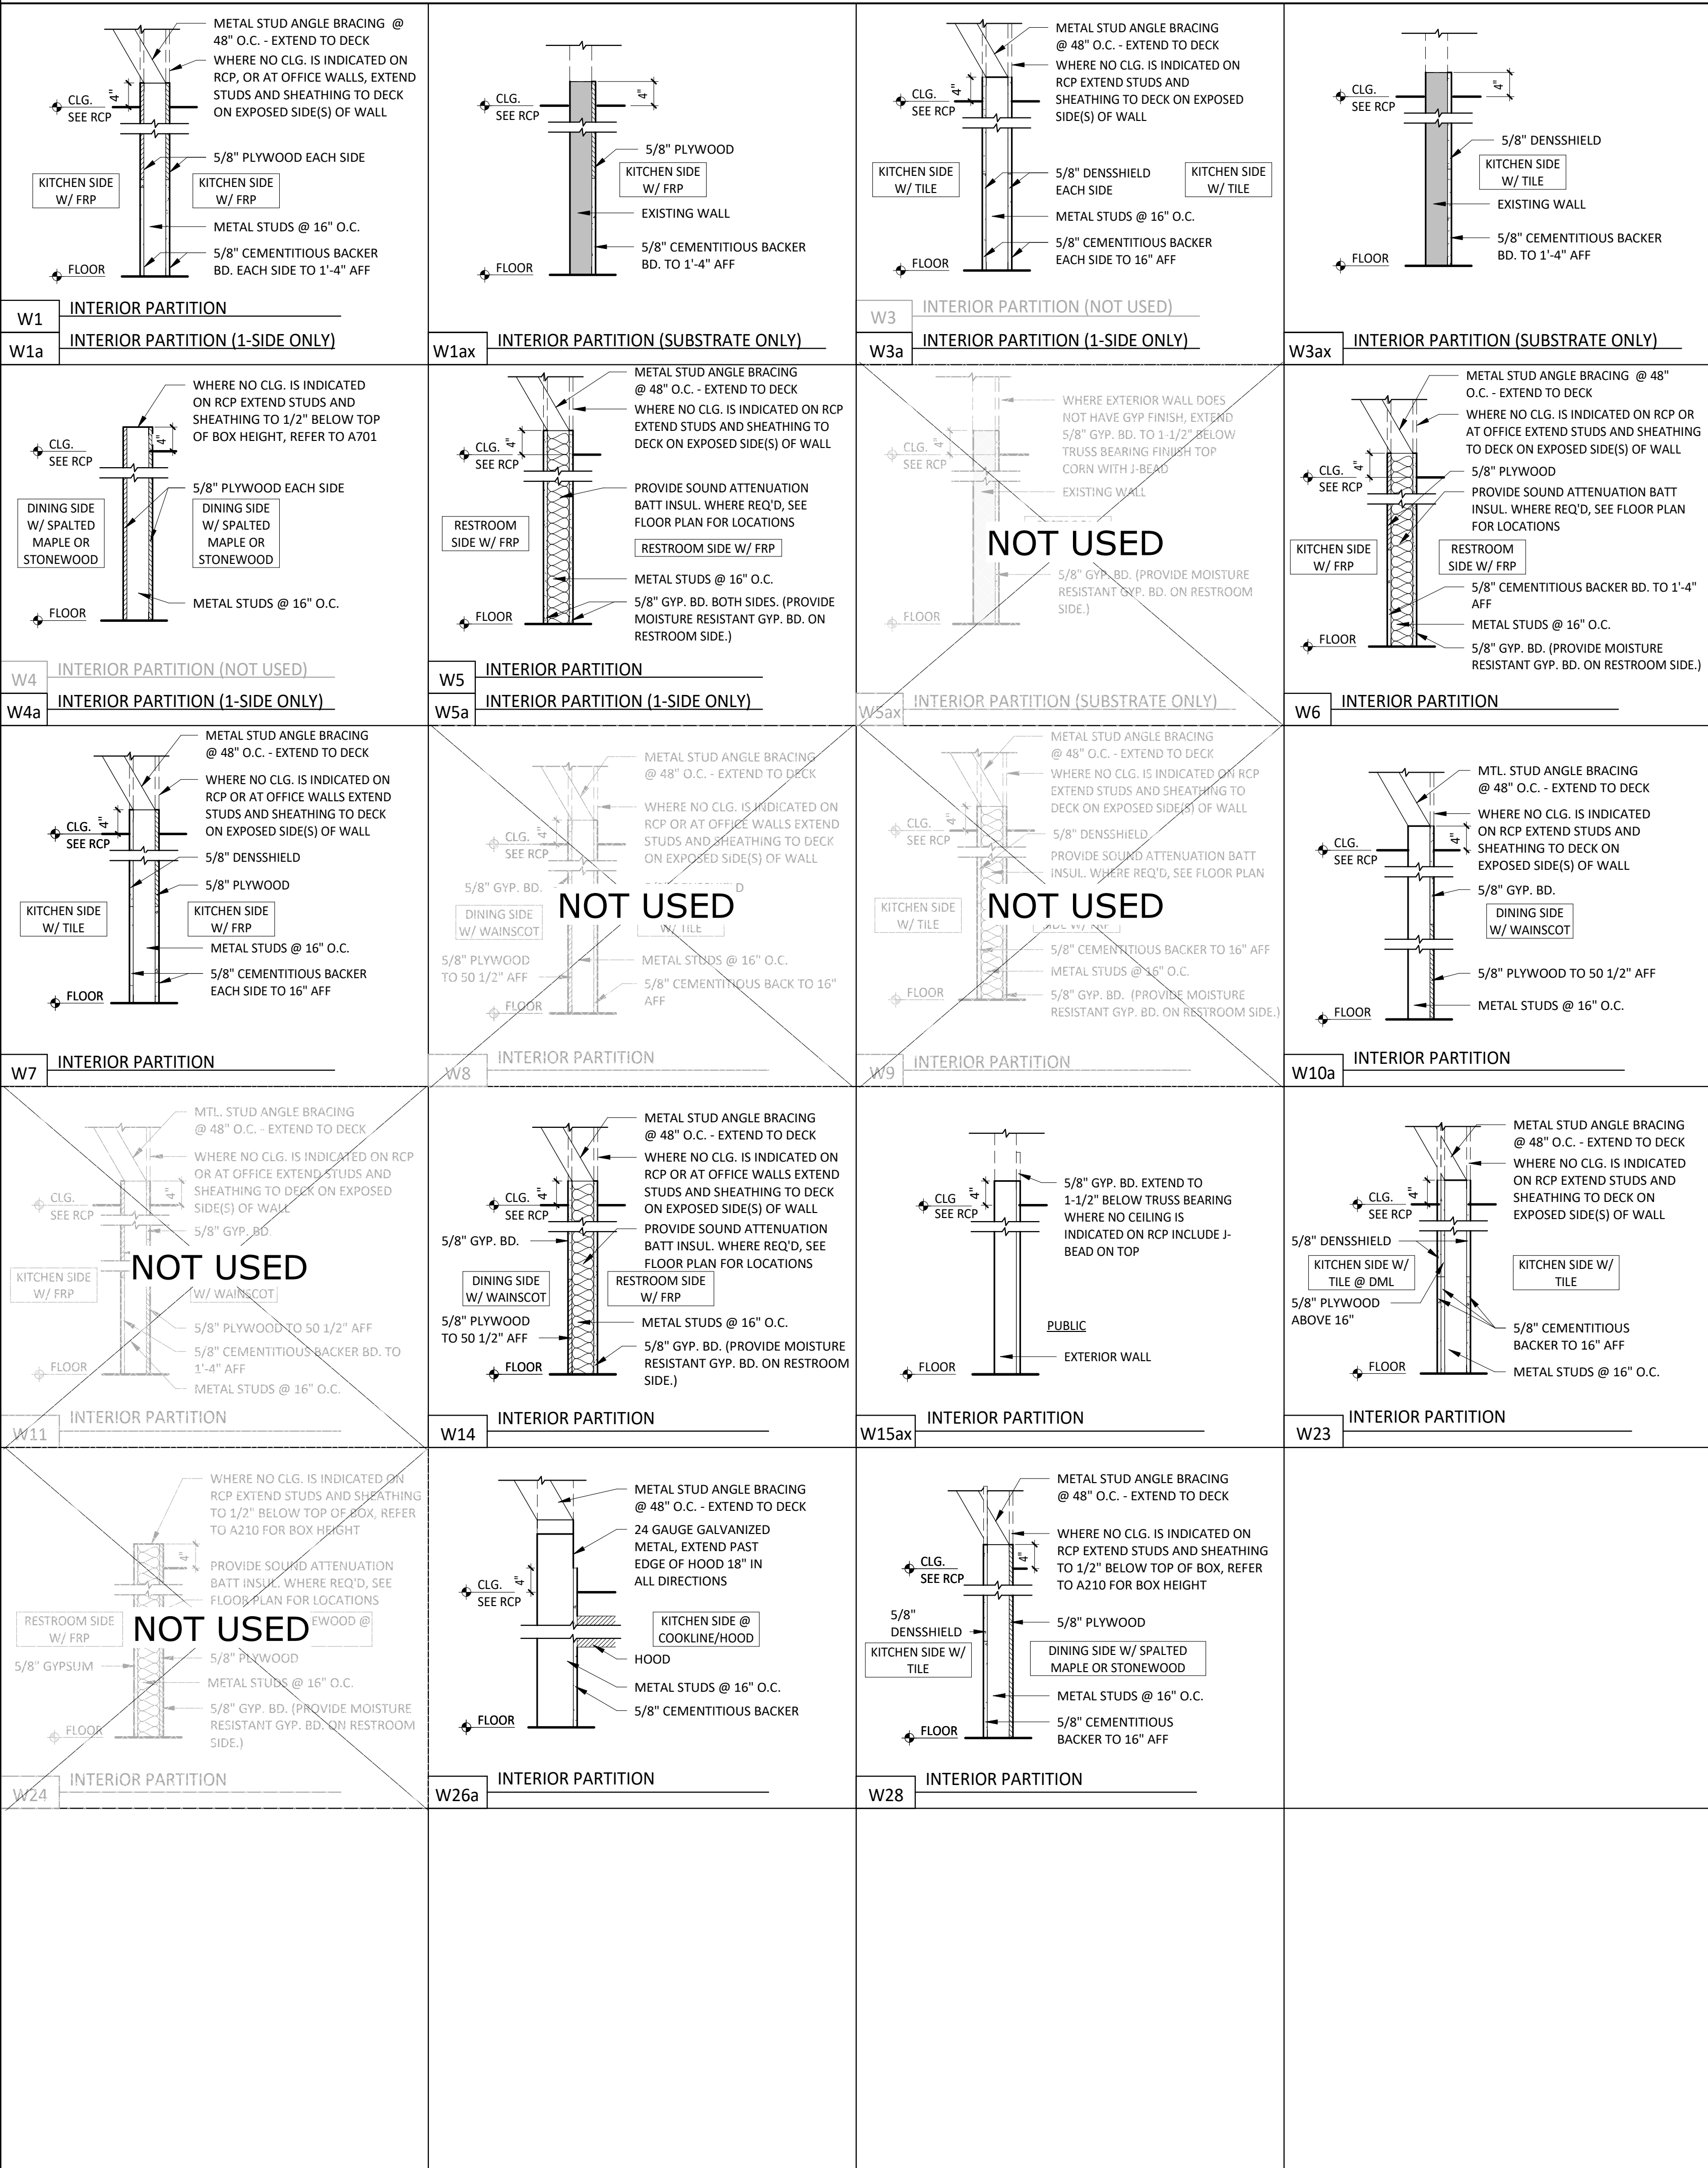

GENERAL NOTES - WALL TYPES


- REFER TO FINISH SCHEDULE AND CERAMIC TILE WALL FINISHES KEY PLAN ON SHEET A120 FOR WALL FINISHES, REFER TO FLOOR PLAN ON A110 FOR METAL STUD SIZE.
- G.C. SHALL PROVIDE SOLID BLOCKING IN WALLS AS REQUIRED OR AS NEEDED.
- STUDS ARE 3 5/8" METAL STUDS UNLESS OTHERWISE NOTED ON PLAN.

STUD SCHEDULE & NOTES

1. ALL HEIGHTS REFER TO UN-BRACED HEIGHTS.	
2. ALL HEIGHTS BASED ON 16" O.C. SPACING.	
3. BOTTOM TRACK TO BE SAME GAUGE AS STUD.	
4. TOP TRACK TO BE ONE GAUGE HIGHER.	
SIZE/TYPE	W/O HUNG SHELVING
3625125-18	UP TO 12'-0"
3625137-33	UP TO 16'-0"
6005137-33	UP TO 22'-0"
6005162-43	UP TO 26'-0"
	W/ HUNG SHELVING
	UP TO 12'-0"
	UP TO 16'-0"
	UP TO 22'-0"

PARTITION NOTES

- ALL METAL STUDS TO CONFORM TO LOCAL BUILDING CODES.
- ALL STUD WALLS AND PARTITIONS REQUIRE GYP. BOARD ON BOTH SIDES FOR THE FULL HEIGHT OF THE STUDS UNLESS SPECIFICALLY DETAILED OTHERWISE.
- ALL SUSPENDED WALLS SHALL HAVE GYP. BOARD WHICH EXTENDS 4" ABOVE THE SUSPENDED CEILING UNLESS SHOWN AND/OR NOTED OTHERWISE BY THE ARCHITECT.
- FIRE RETARDANT PLYWOOD MAY SUBSTITUTE FOR GYP. BOARD WHERE SO DIRECTED BY THE ARCHITECT.
- ALL STUD WALLS AND PARTITIONS SHALL HAVE CONTINUOUS LINES OF BRIDGING SPACED AT 4'-0" MAXIMUM ON CENTER. THE BRIDGING SHALL BE SECURELY FASTENED TO THE STUDS WITH EITHER SCREWS OR WELDS. REFER TO DETAILS THIS SHEET.
- ALL STUDS SHALL BE "CEE" STUDS WITH FLANGE STIFFENERS.
- THE MATERIALS AND DETAILS SHOWN ARE FOR TYPICAL INSTALLATIONS. WHERE THE STUD MANUFACTURER'S RECOMMENDATIONS OR LOCAL ORDINANCES ARE MORE RESTRICTIVE, THEY SHALL APPLY.
- TYPICAL FASTENER:
A: STEEL STUDS TO STEEL STUDS OR TRACKS:
20 GAUGE - #8 - 18 X 1 1/2" TEKS WITH PHILIPS PAN HEAD - MIN. 2 PER CONNECTION
18/16 GAUGE - #10 - 16 X 3/4" TEKS WITH PHILIPS PAN HEAD - MIN. 3 PER CONNECTION
B: STEEL STUDS OR TRACKS TO WOOD PURLINS, GIRDERS AND BEAMS:
#14 - 10 X 1 1/2" H.W.H. TYPE "S" METAL-TO-WOOD TEKS AT 12" O.C., 2" FROM EACH END
C: STEEL STUDS OR TRACKS TO STRUCTURAL STEEL (TUBE/WIDE FLANGE COL'S, BM'S, GIRDER'S, ETC.)
0.145" DIA. HILTI X-EDNI FASTENERS, 5/8" MIN. LENGTH AND MIN. OF 2 PER CONNECTION, OR 2 ROWS AT 16" O.C. FOR CONTINUOUS APPLICATIONS SUCH AS TRACKS, U.N.O.
D: PLYWOOD TO STEEL STUDS:
#10 - 24 X 1 1/4" TEKS/3 (PLYMETALTEKS) WITH THIN WAFER HEAD - 24" O.C. FILED, 12" O.C. PERIMETER
E: GYPSUM BOARD TO STEEL STUDS:
#7 X 1-1/4" HI-LOW TYPE "S" BUGLE HEAD SCREWS FOR 3/8" TO 5/8" GYPSUM BOARD TO 25 GAUGE OR 20 GAUGE STUDS
#6 X 1-1/4" TYPE S-12 BUGLE HEAD SCREWS FOR 3/8" TO 5/8" TO 18 GAUGE OR 16 GAUGE STUDS OR TRACKS
FIELD - 12" O.C. CEILINGS, 24" O.C. WALLS
BUTT JOINTS 12" O.C.
F: STEEL STUDS OR TRACKS TO CONCRETE:
0.145" DIA. HILTI X-DNI FASTENER, 1" MIN. LENGTH, 2 ROWS AT 16" O.C.

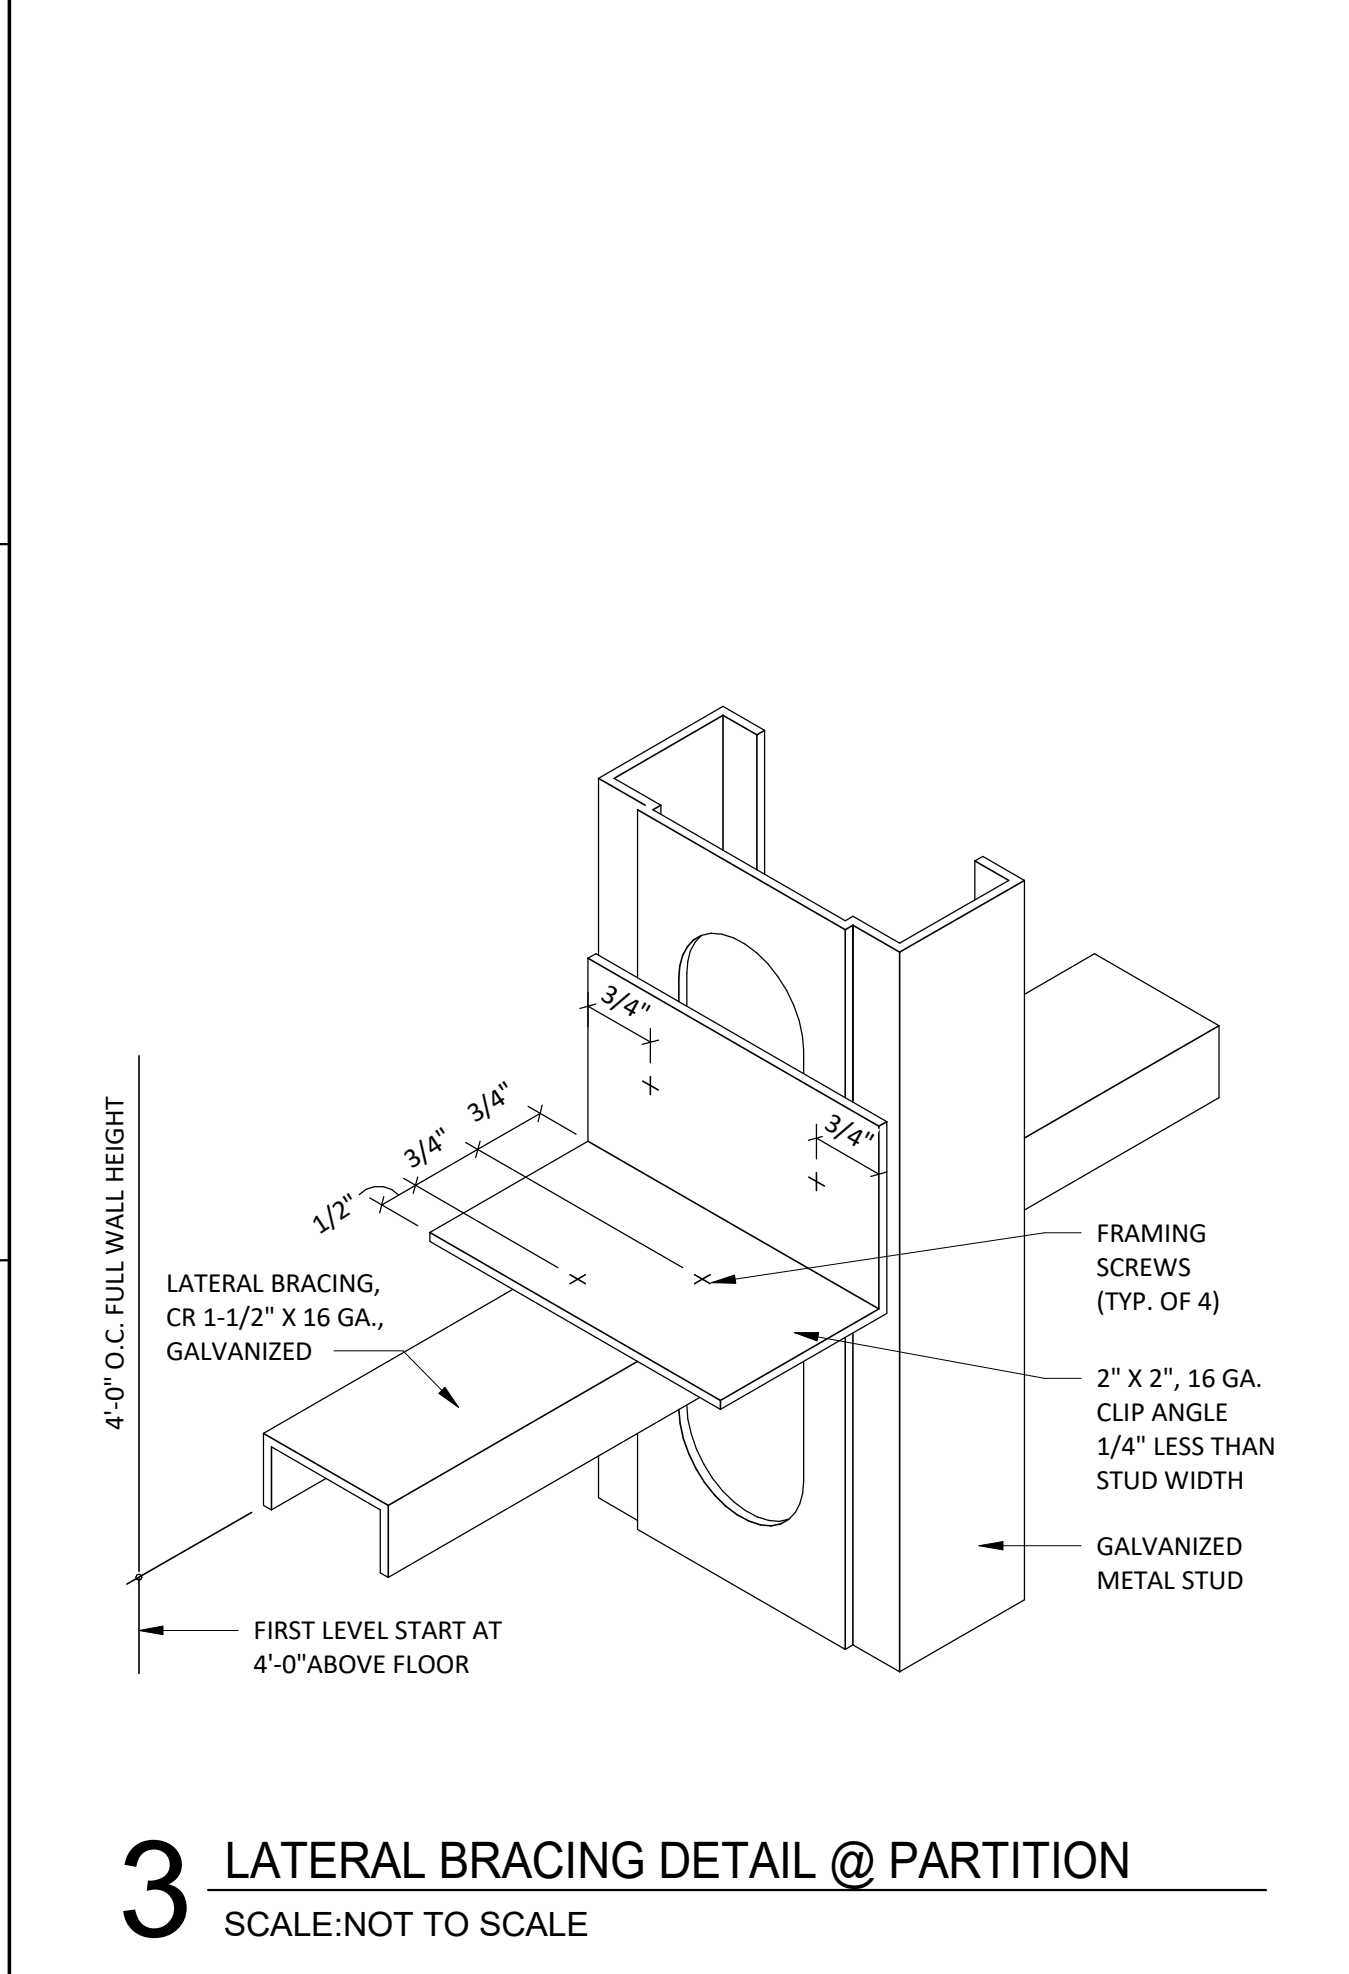

3 LATERAL BRACING DETAIL @ PARTITION
SCALE: NOT TO SCALE

CONSULTANT:

WILKUS ARCHITECTS

CLIENT:

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2682
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

MATTHEW M. WILKUS
REGISTERED ARCHITECT
14006
NORTH CAROLINA
HOPKINS, MN

September 04, 2026
MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)


PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:

TITLE:
ARCHITECTURAL WALL TYPES


SHEET NUMBER:
A111

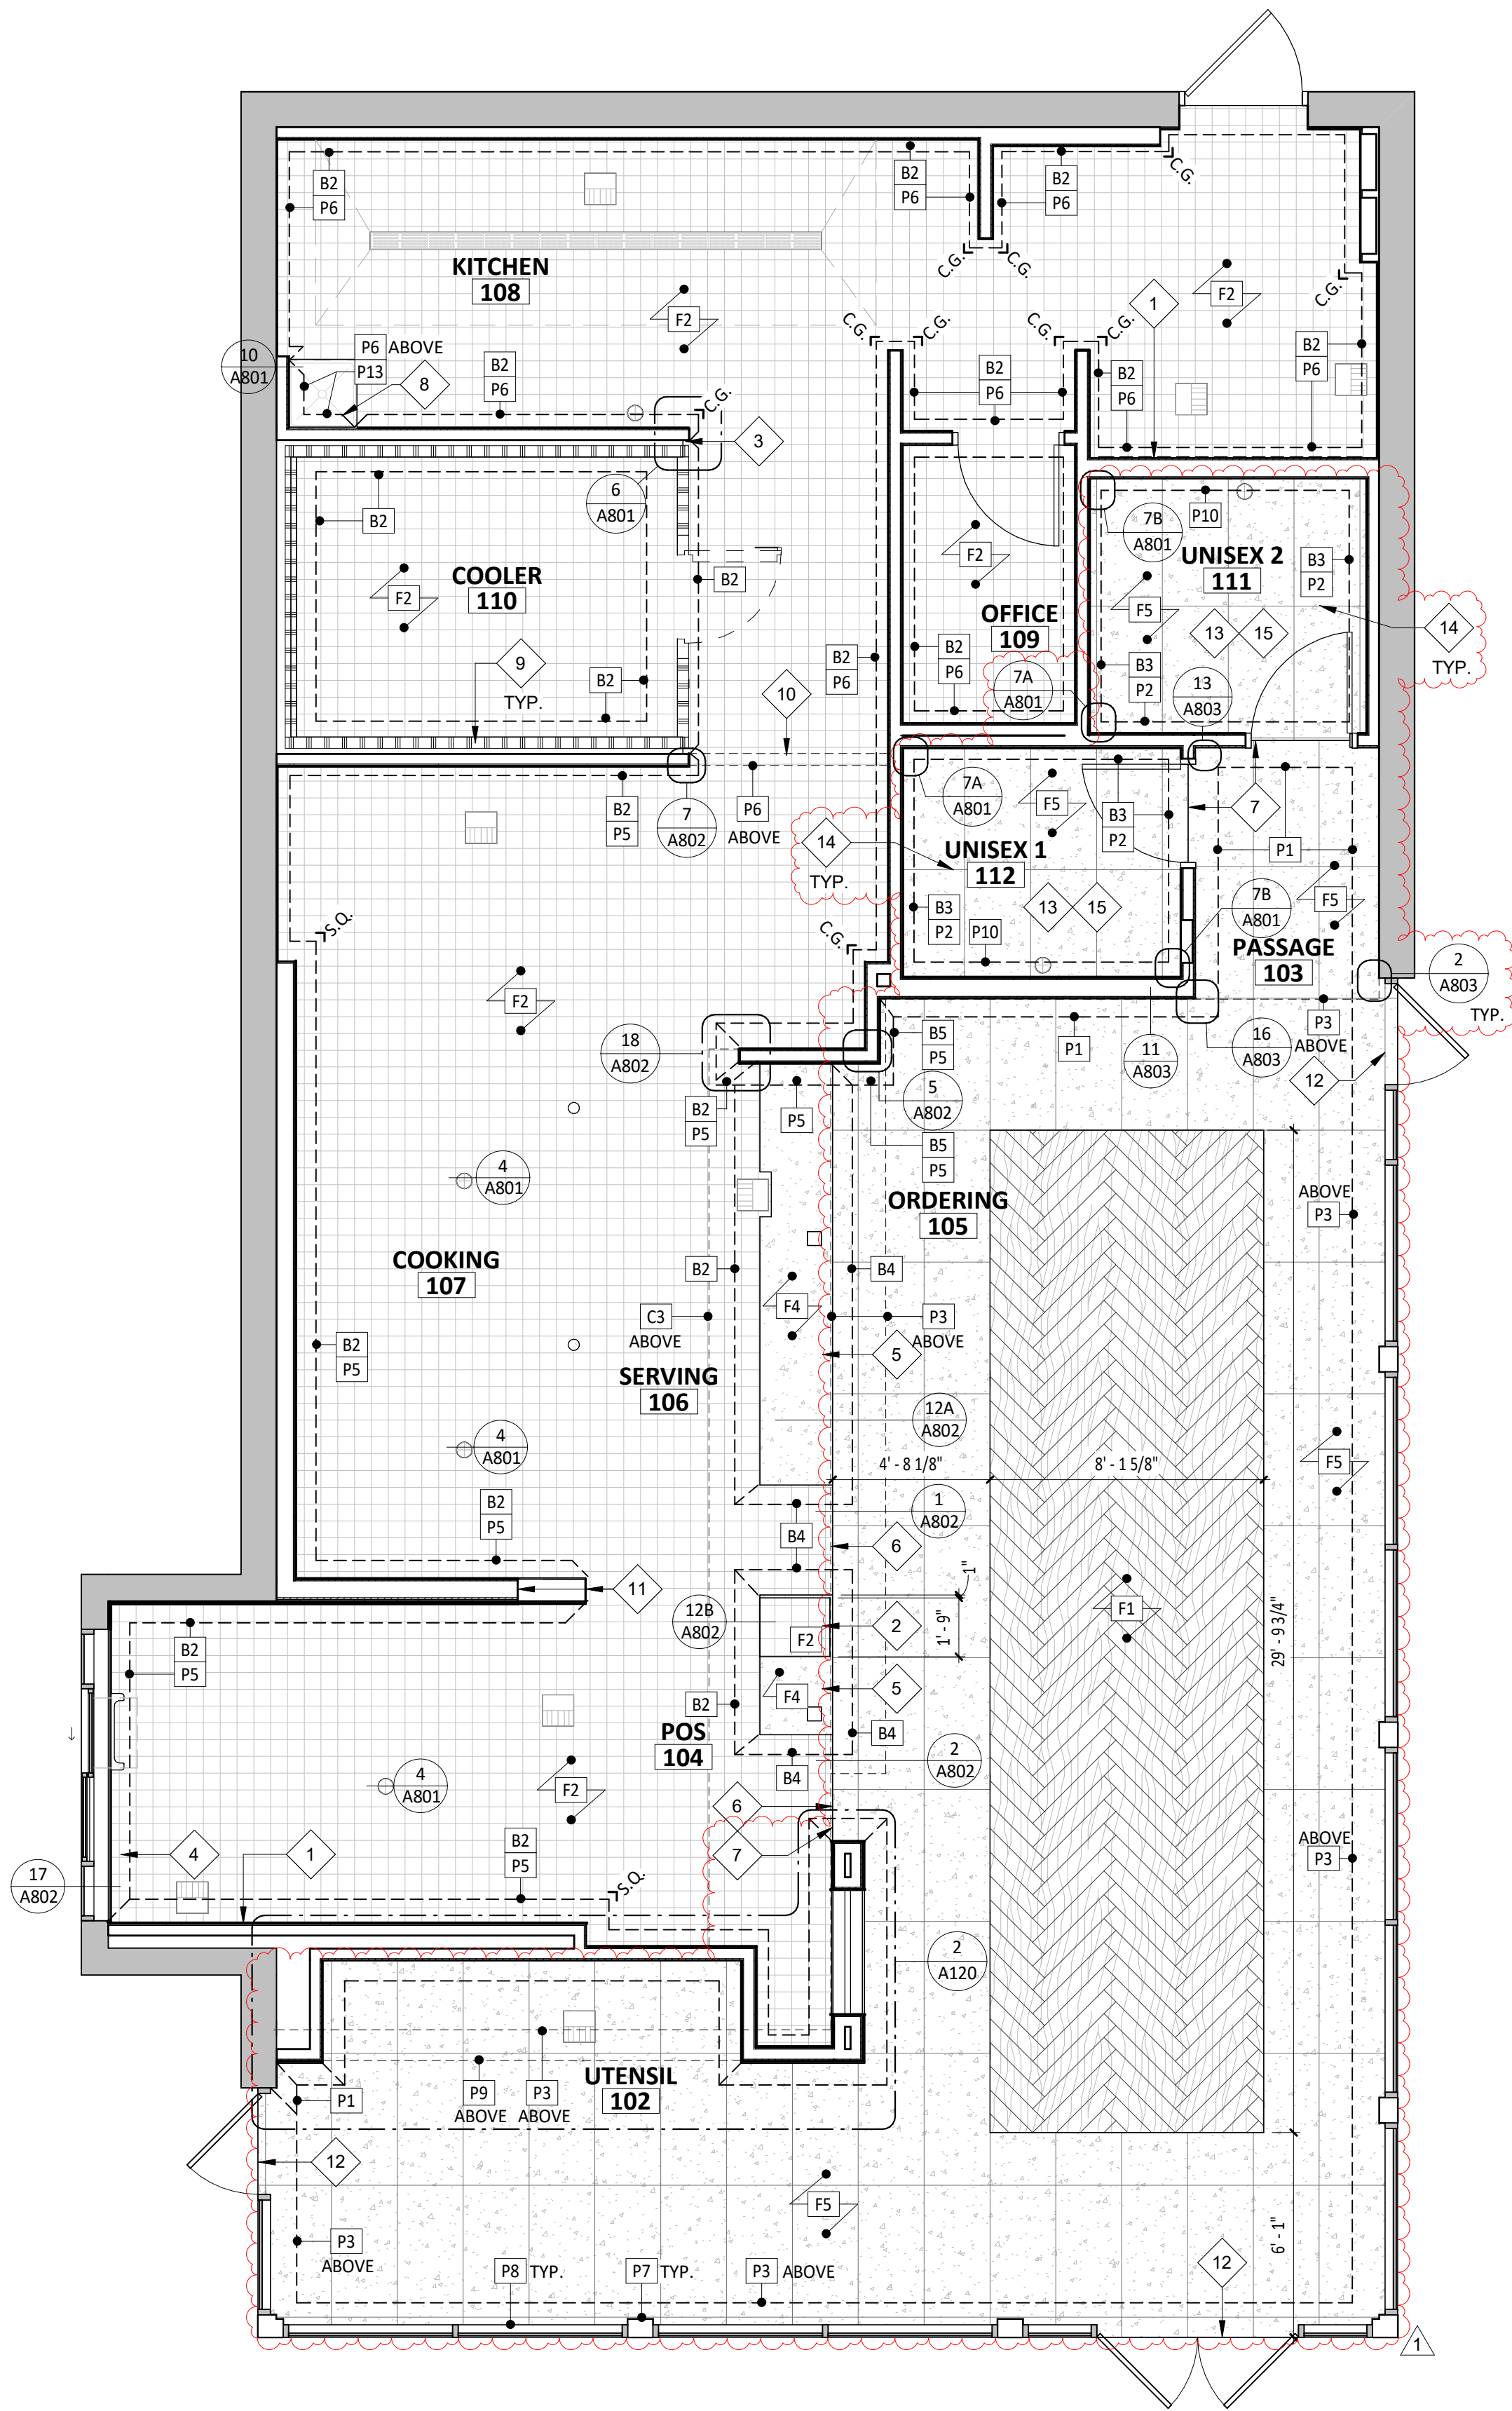

1 FINISH PLAN
SCALE: 1/4" = 1'-0"

FINISH LEGEND

LGD. #	FLOOR FINISHES	LGD. #	WALL BASE FINISHES	LGD. #	CEILING/DECK FINISHES
F1	PORCELAIN TILE - SEATING AREA	B1	BLACK RUBBER, COVELESS	C1	OPEN TO STRUCTURE, UNPAINTED
F2	QUARRY TILE	B2	QUARRY TILE, COVE	C2	STONEWOOD
F3	EXISTING EXTERIOR CONCRETE	B3	PORCELAIN TILE BASE (CUT F5)	C3	GYP BD; PAINT "MOONLIT SNOW"
F4	SEALED CONCRETE	B4	QUARRY TILE, COVELESS	C4	2X4 VINYL-FACED LAY-IN
F5	PORCELAIN TILE - QUEUE	B5	CERAMIC TILE	C5	NOT USED
LGD. #	DOOR FINISHES	LGD. #	WALL FINISHES		
D1	PAINT "BLACK"	P1	FLUTED TILE - GRAY		
D2	PAINT "KNIGHTS ARMOR"	P2	FIBERGLASS REINFORCED PANELS (SMOOTH FINISH)		
		P3	GYP BD; PAINT PPG "PEGASUS", EGG SHELL		
		P4	NOT USED		
		P5	CERAMIC TILE - WHITE		
		P6	FIBERGLASS REINFORCED PANELS (PEBBLED FINISH)		
		P7	EXISTING PREFINISHED BRAKE METAL		
		P8	EXISTING STOREFRONT		
		P9	SPALTED MAPLE WALL PANEL, HORIZONTAL GRAIN		
		P10	PORCELAIN TILE, SEE F5		
		P11	STONEWOOD WALL PANEL		
		P12	NOT USED		
		P13	STAINLESS STEEL		

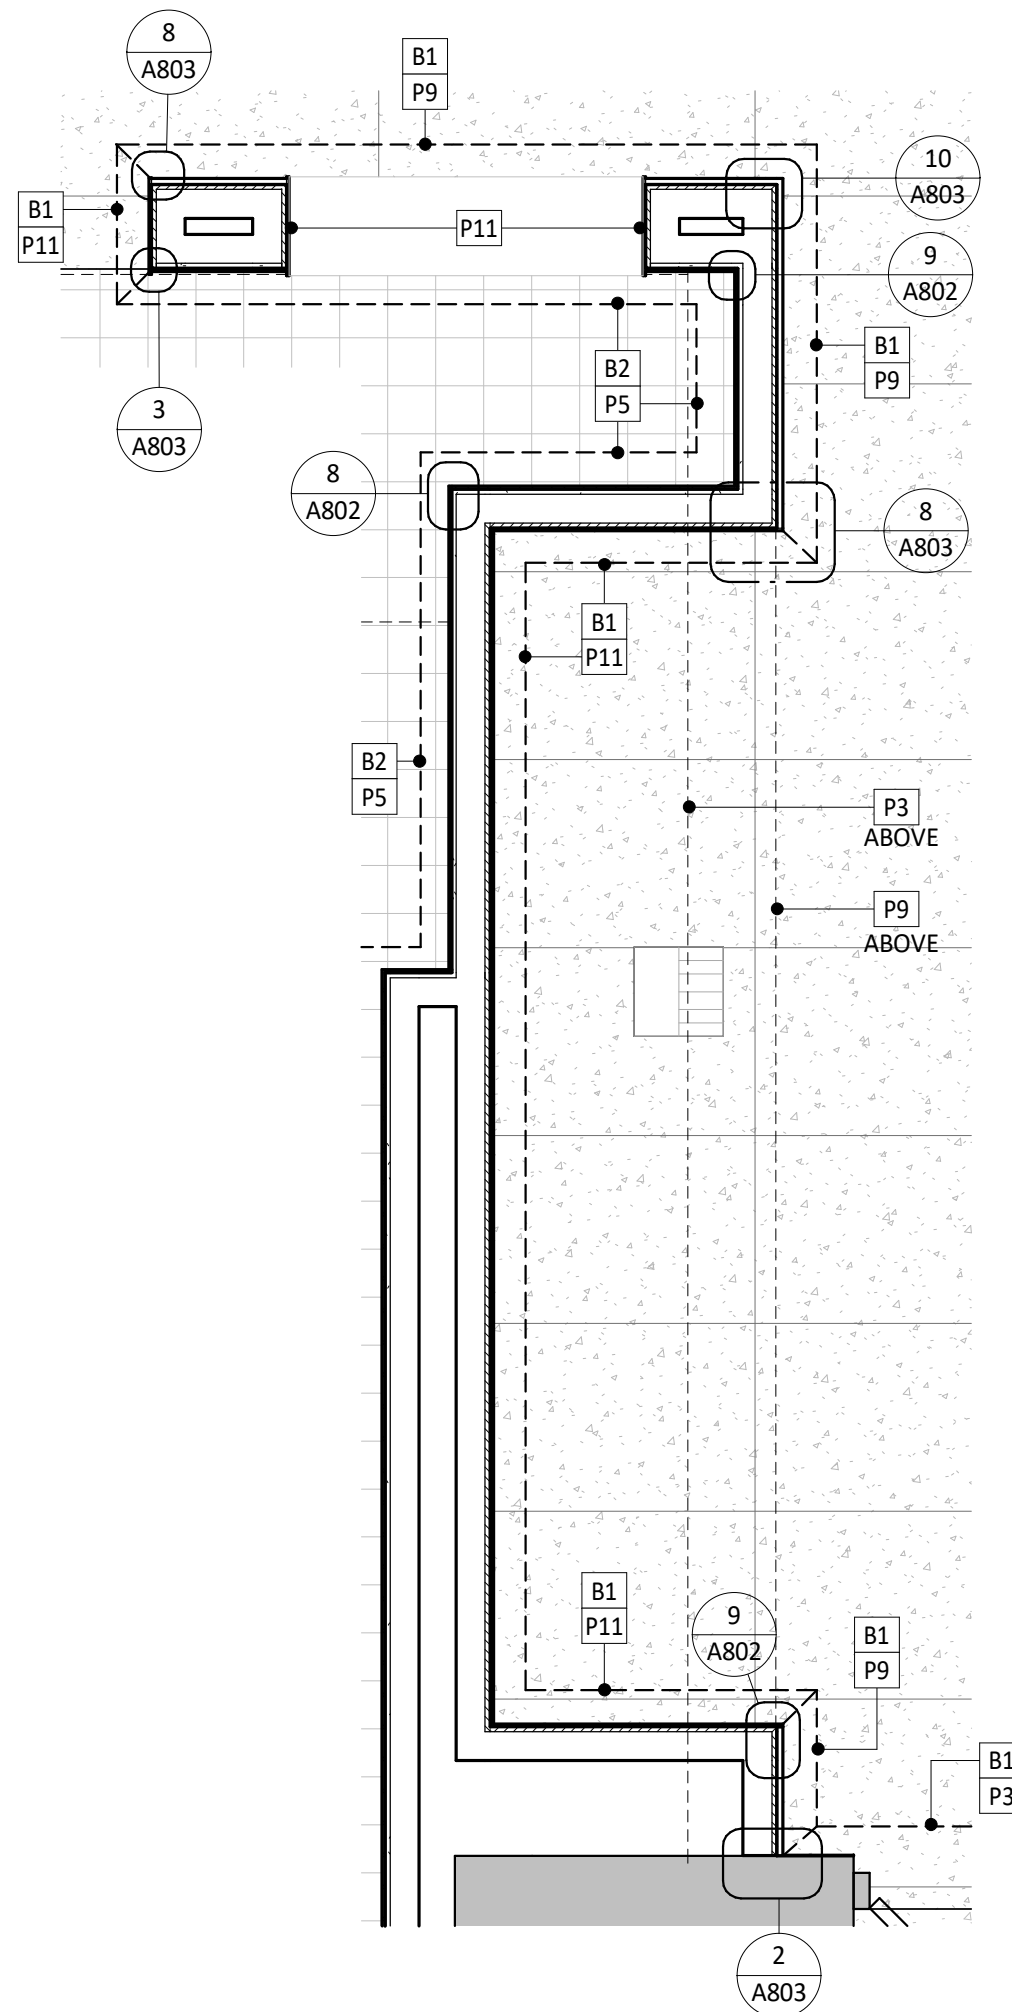

2 ENLARGED FINISH PLAN
SCALE: 1/2" = 1'-0"

GENERAL NOTES - FINISH PLAN

- A. STONEWOOD WALL PANELS AND WAINSCOTS PROVIDED BY TMS, INSTALLED BY GC.
B. SPALTED MAPLE PANELS PROVIDED BY TMS, INSTALLED BY GC.
C. GC IS RESPONSIBLE FOR SEQUENCING OF PREWIRING WITH COMPLETION OF INTERIOR FINISHES (GYP. BD. FINISHES).
D. PROVIDE WATER PROOFING MEMBRANE, REFER TO A802 DETAILS. PROVIDE ON INTERIOR OF ALL RESTROOM WALLS, REFER TO A801 DETAILS.
E. REVIEW CONDITION OF EXPOSED WOOD ROOF STRUCTURE WITH AOR, DM, AND CM. IF NEEDED, APPLY CRUSHED WALNUT (20/30-20/40 CUT) BLASTING AT 100-120 PSI WITH GRADUAL SWEEPING. SURFACE TO BE REFINISHED UNTIL APPEARANCE IS ACCEPTABLE TO CMG.

FINISH PLAN SYMBOL LEGEND

- = PROVIDE A SCHLUTER QUADEC METAL CORNER AT ALL TILED CORNERS - REFER TO A802 FOR ADDITIONAL INFORMATION
 = PROVIDE 1 1/2" X 1 1/2" STAINLESS STEEL CORNER GUARD UP TO 5'-0" A.F.F. - 1 1/2" X 1 1/2" FRP CORNER GUARD FROM TOP TO CEILING - REFER TO A802 FOR ADDITIONAL INFORMATION
 = PROVIDE END GUARD - REFER TO A802 FOR ADDITIONAL INFORMATION

KEYNOTE LEGEND

- 1 GENERAL CONTRACTOR TO PROVIDE 18 GAUGE STAINLESS STEEL SHROUD AROUND EXPOSED LINES AT ICE MAKER.
2 PROVIDE QUARRY TILE ON TOP OF CURB FOR SMART SAFE - PROVIDE BULLNOSE TILE TO LAP OVER TOP CUT EDGE OF BASE TILE - REFER TO A802 FOR ADDITIONAL INFORMATION - GENERAL CONTRACTOR TO COORDINATE EXTENT OF QUARRY TILE WITH KES PRIOR TO INSTALLATION
3 FRP ENCLOSURE PANEL AT COOLER GAP - REFER TO A801 FOR ADDITIONAL INFORMATION.
4 ALUMINUM ENDCAPS ALL SIDES AT DRIVE-THRU WINDOW - REFER TO A802 FOR ADDITIONAL INFORMATION.
5 CONCRETE CURB FOR EQUIPMENT WITH QUARRY TILE BASE AT ALL EXPOSED EDGES.
6 EXTENT OF QUARRY TILE FROM KITCHEN.
7 SCHLUTER TRANSITION STRIP BETWEEN TILE FLOORS AS INDICATED, REFER TO A801.
8 PROVIDE STAINLESS STEEL ON WALL TO 24" ABOVE TOP OF MOP SINK - FLASH BOTTOM EDGE OVER MOP SINK RIM - BEND STAINLESS STEEL AT INSIDE CORNER SO THERE IS NO JOINT - REFER TO A801 FOR ADDITIONAL INFORMATION.
9 COOLER WALL PANELS AS PROVIDED BY THE COOLER MANUFACTURER HAVE A 26-GAUGE COATED AND EMBOSSED STEEL FINISH.
10 PROVIDE TOP CORNER AT TRANSITION FROM GYPSUM BOARD CEILING TO FRP WALL - REFER TO A210 FOR ADDITIONAL INFORMATION.
11 ALUMINUM ENDCAP - REFER TO A802 FOR ADDITIONAL INFORMATION.
12 EXTENT OF TILE FROM INTERIOR - ALIGN WITH EDGE OF DOOR THRESHOLD.
13 COVED SCHLUTER BASE AT ALL RESTROOM WALLS, REFER TO A803.
14 CENTER F5 PATTERN WITHIN RESTROOM, TYP.
15 PROVIDE WATERPROOFING MEMBRANE AT ALL FLOOR-TO-WALL TRANSITIONS IN AREAS WITH QUARRY TILE FLOORING AND BASE AND PROVIDE ON INTERIOR OF ALL RESTROOM WALLS - REFER TO A803.

CONSULTANT:



CLIENT:




CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2682
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2026
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. - PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

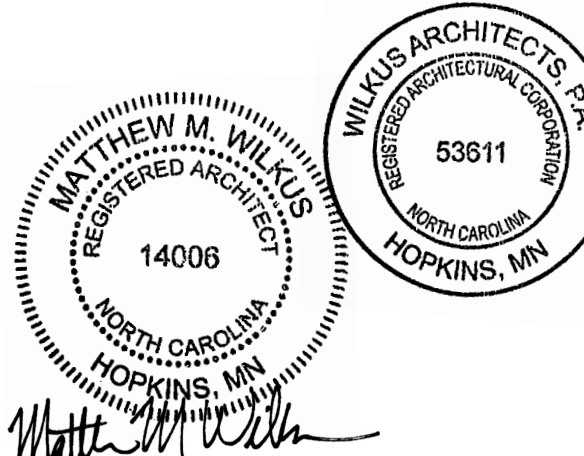

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:

03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:

1 08/21/2026 BA1 - FINISH UPDATES


TITLE:

FINISH PLAN

SHEET NUMBER:

A120

1 FURNITURE, FIXTURE, & EQUIPMENT PLAN
SCALE: 1/4" = 1'-0"

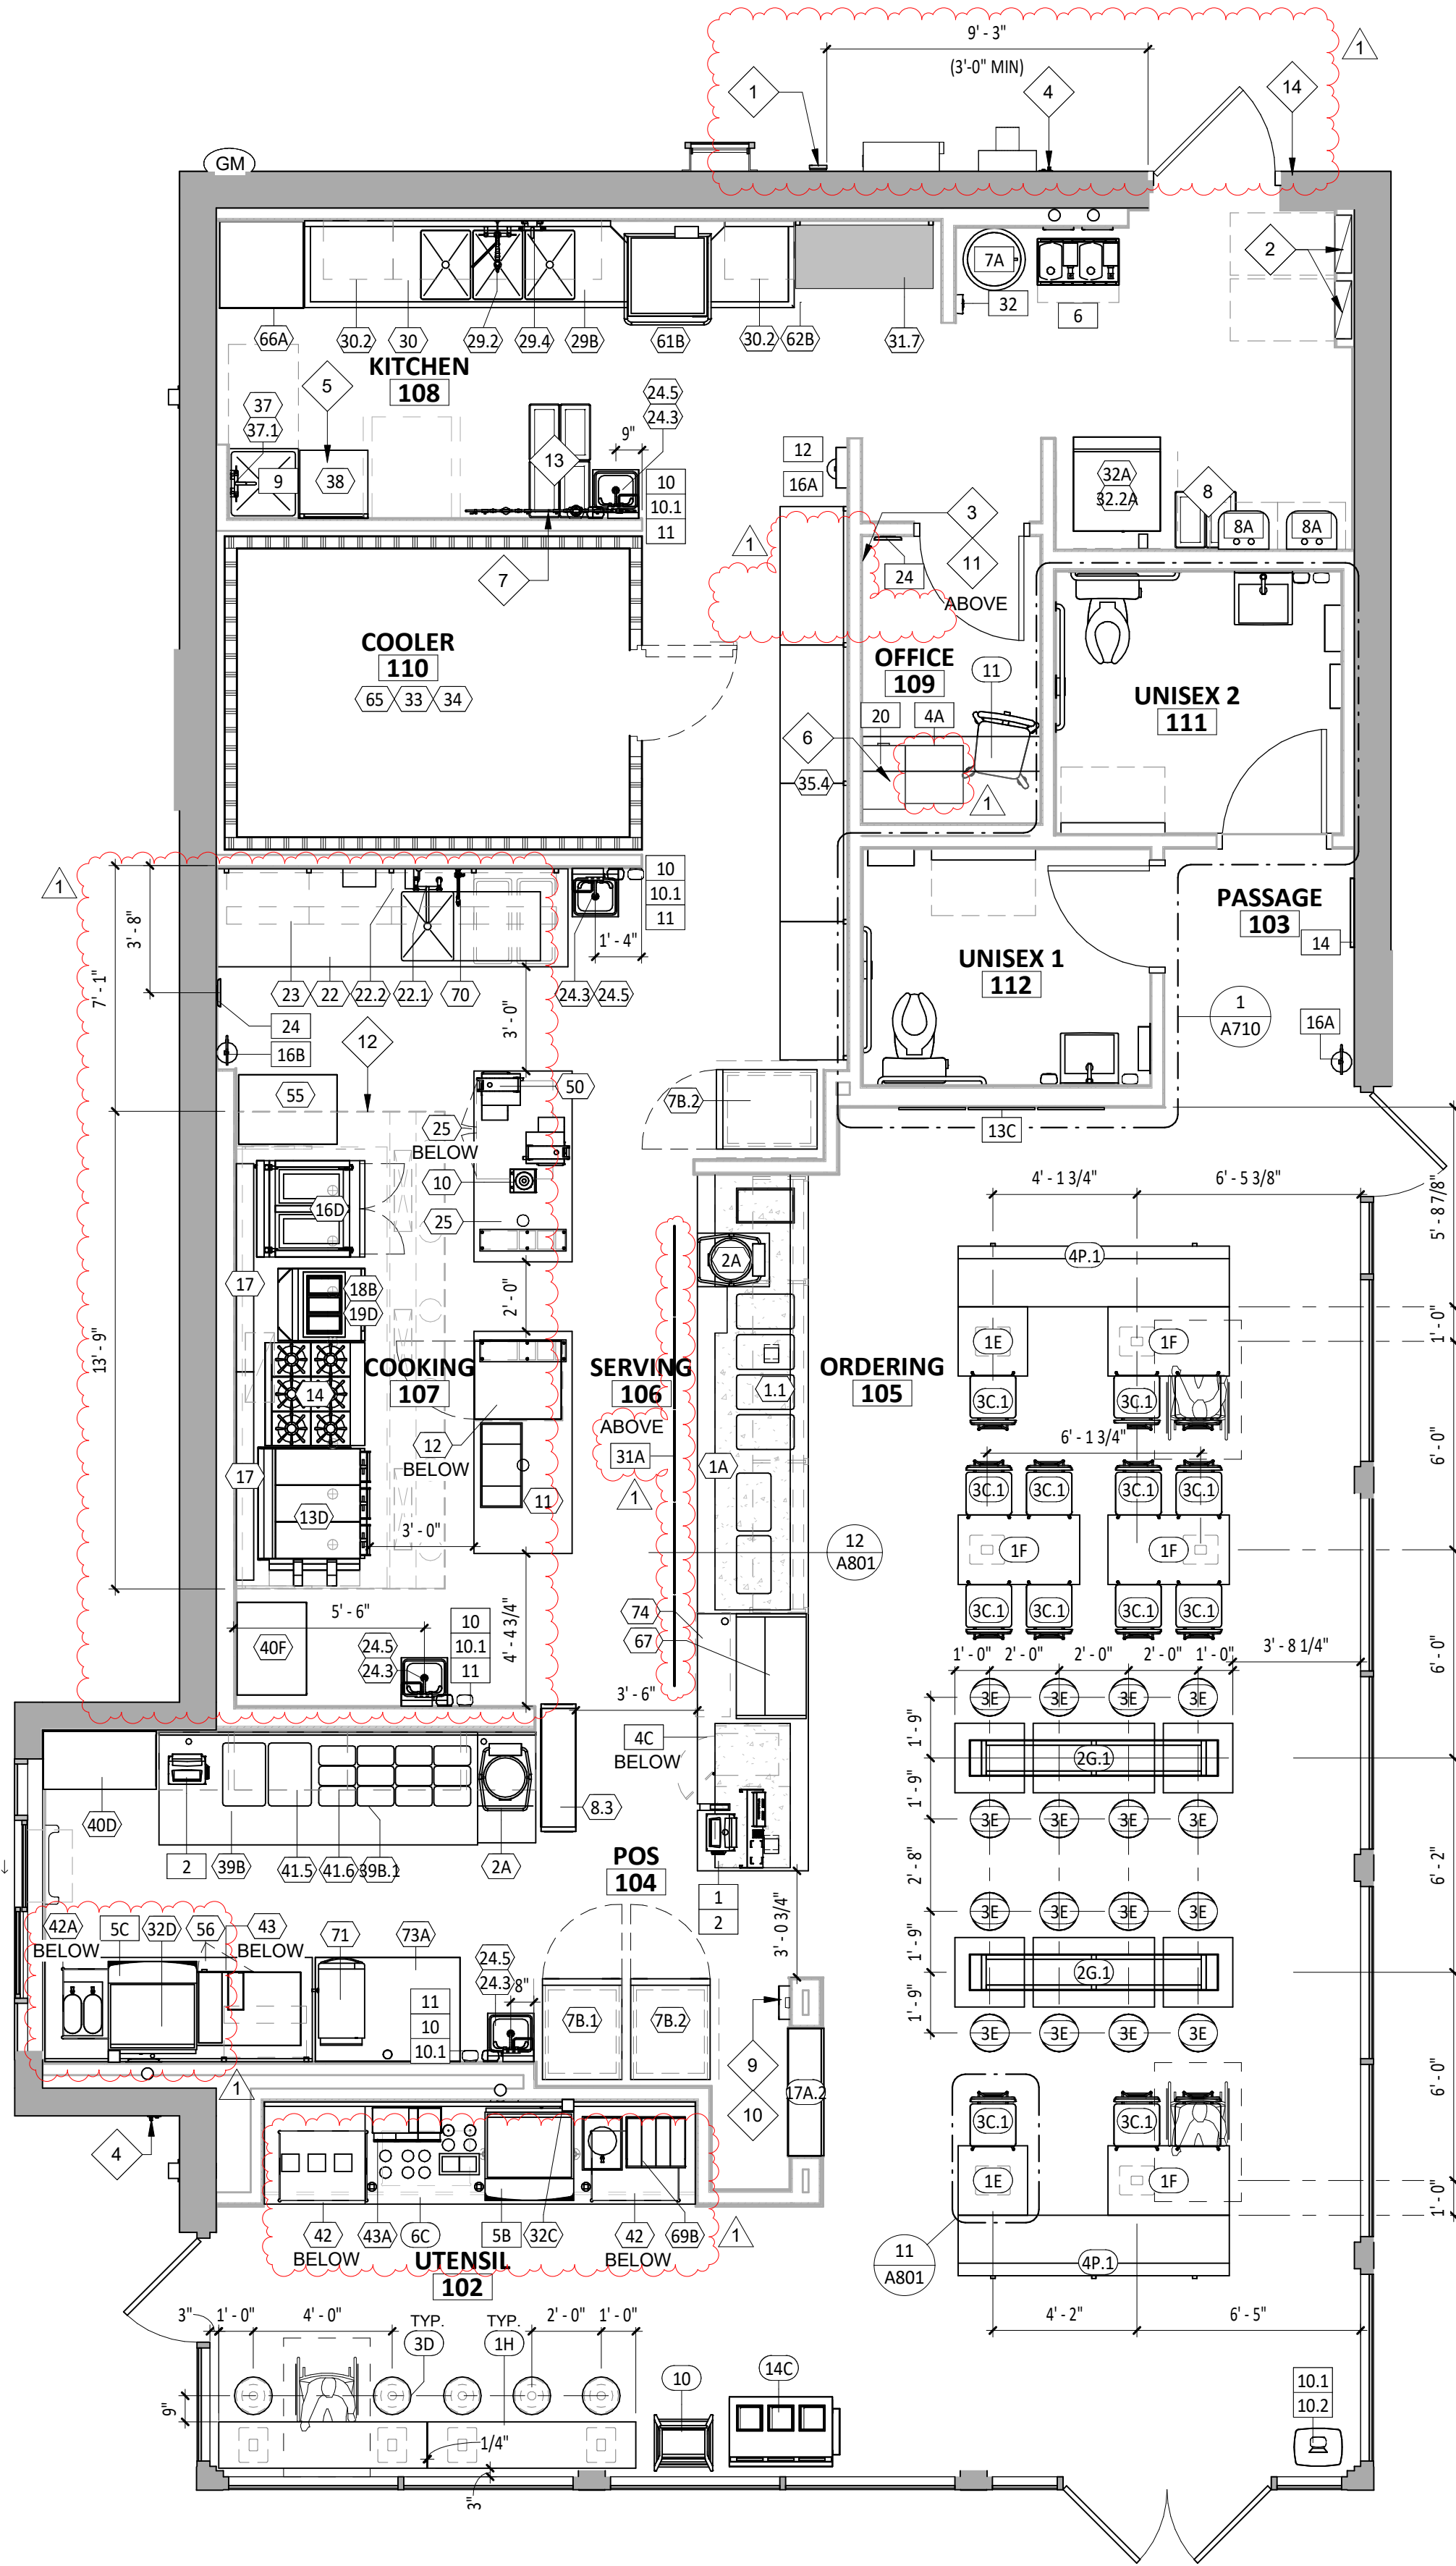

2 FURNITURE, FIXTURE & EQUIPMENT PATIO PLAN
SCALE: 1/4" = 1'-0"



GENERAL NOTES - FF& E

- A. REFER TO SHEET A131 FOR EQUIPMENT LIST AND FURNITURE SCHEDULE.
B. ALL DIMENSIONS TO EXTERIOR OR EXISTING WALLS ARE TO THE FINISH FACE OF THE EXISTING GYP. BD.
C. ALL DIMENSIONS ARE TO FACE OF FRAMING, EDGE OF EQUIPMENT, OR CENTERLINE OF EQUIPMENT UNLESS NOTED OTHERWISE.
D. ALL FURNITURE TO BE SQUARE/PARALLEL TO TENANT SPACE/WALLS AS SHOWN ON PLANS.

KEYNOTE LEGEND

- 1 C02 REMOTE FILLER - MINIMUM 3' - 0" FROM REAR ACCESS DOOR - FINAL LOCATION WITH CHIPOTLE'S CONSTRUCTION MANAGER.
2 ELECTRICAL PANEL LOCATION - SEE ELECTRICAL PLANS FOR ADDITIONAL INFORMATION.
3 BYPASS DISTRIBUTION PANEL ABOVE - SEE ELECTRICAL PLANS FOR ADDITIONAL INFORMATION.
4 HOSE BIBB - REFER TO PLUMBING PLANS FOR ADDITIONAL INFORMATION.
5 CHEMICAL CLEANING DISPENSING SYSTEM WITH INTEGRAL AIR GAP - REFER TO PLUMBING PLANS FOR ADDITIONAL INFORMATION.
6 OFFICE DESK AND SHELVING - REFER TO SHEET A702 AND ELECTRICAL PLANS FOR ADDITIONAL INFORMATION.
7 WATER FILTER ABOVE - REFER TO PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.
8 MOVEABLE BACK-UP TRASH BINS FOR DINING AREA TRASH SURROUNDS - TYPICAL OF TWO (2).
9 KRONOS TIMECLOCK WILL BE LOCATED 40" A.F.F. TO THE TOP OF UNIT - CENTER KRONOS UNIT IN WALL - REFER TO ELECTRICAL DRAWINGS.
10 ANSUL PULL TO BE LOCATED 48" A.F.F. TO THE CENTER OF UNIT ABOVE THE TIMECLOCK LOCATION.
11 TELEPHONE BOARD ABOVE - REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
12 DASHED LINE INDICATES LOCATION OF HOOD ABOVE.
13 MOVEABLE LINEN BINS WITH LID - TYPICAL OF FOUR (4).
14 DOORBELL LOCATION - INSTALL BETWEEN 36" AND 48" A.F.F. - REFER TO ELECTRICAL PLANS FOR ADDITIONAL INFORMATION.

CONSULTANT:



CLIENT:




CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2682
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2026
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

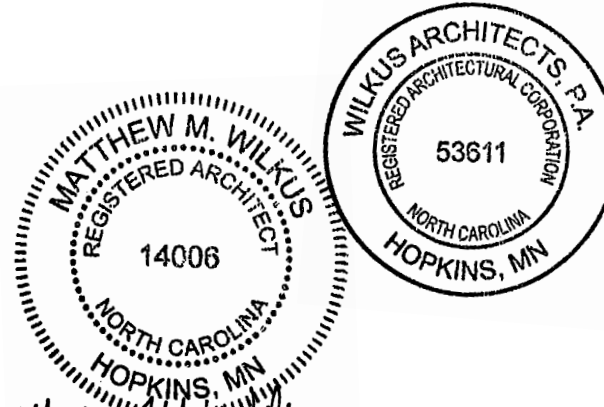

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:

03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:

1 08/21/2026 BA1 - FINISH UPDATES

TITLE:

FF&E PLAN

SHEET NUMBER:

A130

KITCHEN EQUIPMENT LIST

TAG	DESCRIPTION	MANUFACTURER	MODEL NO.	QTY	FURNISHED BY	INSTALLED BY	UTILITY				REMARKS
							ELEC	PROPANE	WATER	SEWER	
1.1	Sneeze Guard Serve Line 12 Pan (Right)	BSI	Custom-R	1	TMS	TMS/GC					
1A	M4.0 - Front Serve Line - 12 Pan - RTD - POS Right	Defield	12 Pan Serve Line POS RTD_241x38.Sin (Right)	1	KES	KES, GC	•			•	Installed On Concrete Curb
2A	Tortilla Warmer	Caliente Industries	A2	2	KES	KES	•				GC To Store In Walk-in Cooler Until Final Installation
6	Cup Dispenser	Dispense-Rite	CHIP-ECL-3B	1	KES	KES, GC					Installed At POS Counter
7B.1	Upright Beverage Cooler, Single Door, Hinge Left	Varies	Varies - Solid Door	1	KES	KES	•				
7B.2	Upright Beverage Cooler, Single Door, Hinge Right	Varies	Varies - Solid Door	2	KES	KES	•				
8.3	M4.5 Chip Shelf	Trimark	Custom	1	KES	KES					
10	Blender	Vitamix	62828 ¹ △	1	T	T	•				GC To Store In Walk-in Cooler Until Final Installation
11	Carving Station - 77x34in - Horizontal Well - Right	Defield	77x34in Carving Station-RT	1	KES	KES	•				
12	Undercounter Refrigerator	Hoshizaki	CRM27-LP	1	KES	KES	•				
13D	3 Platen Electric Double Sided Grill ¹ △	Varies	Varies	1	KES	KES					
14	Range 6 Burner - Natural Gas	Garland	U36-6S	1	KES	KES		•			
16D	Fryer - Gas - Dual ¹ △	Varies	Varies	1	KES	KES	•	•			
17	Cook Line Stand Off - 72x6	Nationwide Fab; Marlo Mfg	CHP-6WS-6	2	KES	KES					Mount Top of Flat Surface at 33" AFF, Install Screws at Each Stud Location, Provide Blocking To Mount To Wall
18B	Gas Rice Cooker	Woodstone	WS-GR-C-6D	1	KES	GC	•	•			Final Connection by GC. RE:Mechanical Drawings
19D	Rice Cooker Stand - 25x30	EMI Industries	MCHPE2530 ¹ △	1	KES	KES					
22	Prep Sink - Corner - Left	Trimark	S1-122x34-US-FF-L	1	KES	GC				•	
22.1	Prep Sink Faucet Big Flow Faucet	T&S	B-0293-01	1	KES	GC			•		
22.2	Prep Sink Vegetable Wash Faucet	T&S	B-0730	1	KES	GC			•		GC To Provide Connection For Chemical Dispensing Equipment
22.3	Prep Sink Drain Assembly	T&S	B-3950	1	KES	KES, GC				•	
23	4 Shelves - 120in Prep Sink	Amco	CHPPS120	1	KES	KES					Mount Bottom Of Standard At 50" AFF. Provide Plywood Blocking To Mount To Wall.
23A	2 Shelves - 30in	Amco	Custom	1	KES	KES					Mount Bottom Of Standard At 50" AFF. Provide Plywood Blocking To Mount To Wall.
24.3	Hand Sink Wall Mounted - Splash Both	Universal Stainless	EHS-1RL-NF	4	KES	GC				•	Provide Plywood Blocking To Mount To Wall
24.5	Kitchen Hand Sink Faucet Splash Mount	T&S	B-1146-04-CR-VF10	4	KES	GC			•		Provided with B-0199-06-F10, 1.0 GPM Aerator
25	Rice Prep Table Island 66x34	Nationwide Fabrication; Marlo Mfg	Custom Table 66x34in	1	KES	KES					
26	Hot Holding Cabinet - Double Door (Rice)	Food Warming Equipment (FWE)	HLC-1220-8-8-CHP	1	KES	KES	•				
29.2	Dish Sink Add-A-Faucet w/ Pre-Rinse	T&S	B-1033-12CRBJSK Substitute Sprayer B-0107-J-SWV	1	KES	GC			•		
29.3	Dish Sink Drain Assembly	T&S	B-3950	3	KES	KES, GC				•	
29.4	Dish Sink Chemical Faucet	T&S	B-2345-01-XX	1	KES	GC			•		GC To Provide Connection For Chemical Dispensing Equipment
29B	3 Comp Sink - 18x24in Bowls - 111 3/4in	Nationwide Fabrication; Marlo Mfg	S3-30x111.75x36.5-FF	1	KES	GC				•	
30	Shelving System - 3 Comp Sink	Amco	WST18795	1	KES	KES					Mount bottom of Standard At 56"AFF. Provide Plywood Blocking
30.2	Shelving System - Dish Table	Amco	WST18795	2	KES	KES					Mount bottom of Standard At 56"AFF. Provide Plywood Blocking. Mount Tight To Dish Machine
31.7	Drying Racks 23x48x85in - With Vented Aluminum Covers	Varies	Custom	1	KES	KES					Mount Bottom Of Standard At 12" AFF. Provide Plywood Blocking To Mount To Wall
32.1A	Ice Maker - Remote Condenser	Hoshizaki	URC-5FZ	1	KES	KES	•				Condensing Units To Be Secured To The Roof Per Code By GC
32.1B	Ice Maker - Remote Condenser	Hoshizaki	URC-9FZ	1	KES	KES	•				Condensing Units To Be Secured To The Roof Per Code By GC
32.2A	Ice Maker - Storage Bin	Hoshizaki	B500SF	1	KES	KES				•	
32.3	Icemaker- Filter	Cuno	Bev 190	3	KES	KES			•		
32.4	Ice Maker - Scale Inhibitor	Cuno	CFS440-HT	3	KES	KES			•		
32A	Ice Maker For B.O.H. Ice Bin (Shorter)	Hoshizaki	KML-700MRIZ	1	KES	KES	•		•		Drain Ice Maker to Floor Sink, RE: Mech. Refrigeration By Tenant.
32C	Ice Maker Mounted On Soda Machine - Air Cooled	Hoshisaki	KMD-530MAJ	1	KES	KES	•		•		Drain Ice Maker to Floor Sink, RE: Mech. Refrigeration By Tenant.
32D	Ice Maker Mounted On Soda Machine - Remote Air Cooled	Hoshisaki	KMD-530MRIZ	1	KES	KES	•		•		Drain Ice Maker to Floor Sink, RE: Mech. Refrigeration By Tenant.
33	Walk In Cooler 9x12x9 -6ft 3in - Standard	Manitowoc	KAMC46-141-1EC-PCL-4	1	WCS	GC	•			•	Refer To Plumbing and Mechanical Drawings; Refrigeration By Tenant; Remote Exterior Compressor Unit To Be Secured To Roof Per Code By GC
34	Walk-In Cooler Shelving System - 9x12x10	Cambro (Cams shelving)	CHP912ER	1	KES	KES					
35.4	Dry Storage Racks 23x192x85in	Varies	Custom	1	KES	KES					Mount Bottom Of Standard At 12" AFF. Provide Plywood Blocking To Mount To Wall.
37	Mop Sink Faucet	T&S	B-0660-BSTR	1	KES	GC			•		
37.1	Mop Sink Chemical Faucet	T&S	B-2345-01-XX	1	KES	GC			•		GC To Provide Connection For Chemical Dispensing Equipment
38	6 Shelves - Chemical Storage Rack	Varies	Custom	1	KES	KES					Mount Bottom Of Standard At 12" AFF. Provide Plywood Blocking To Mount To Wall.
39B	DML 2.0 130in – Right – W/POS & Cash Drawer	Franke/Delfield	DML 2.0_RT-130x39	1	KES	KES	•			•	
39B.1	DML 2.0 Wall Trim Package	Franke/Delfield	DML 2.0 Trim Kit	1	KES	KES					
40D	Holding Shelf	Trimark	TG5-39X20X80-B	1	KES	KES	•				
40F	M4.5 - Filler Stand At Range	Select Stainless	24x32x36	1	KES	KES					
41.5	DML 2.0 Shelving - 130in - Top Shelf	Franke/Delfield	CH000A32	1	KES	KES					Mount Bottom Of Shelf At 74 1/2" AFF. Provide Plywood Blocking To Mount To Wall.
41.6	DML 2.0 Shelving - 130in - Bottom Shelf	Franke/Delfield	CH000A34	1	KES	KES					Mount Bottom Of Lowest Portion Of Shelf At 54 1/2" AFF. Provide Plywood Blocking To Mount To Wall.
42	Shelving System Under Counter Beverage Station	ISS	WST1810CLR	1	KES	KES					Mounted on (4) casters, All casters to be swivel type, Front (2) casters to have brake, Located under utensil counter
42A	Shelving System Under Counter Beverage Station - 24x42x21in Mobile	ISS	Custom	1	KES	KES					Mounted on (4) casters, All casters to be swivel type, Front (2) casters to have brake, Located under utensil counter
43	Beverage Cooler Backbar 36in	Glasstender	LP36X-SS(X)	1	KES	KES	•				
50	Food Processor	Sammic	CA-31	1	KES	KES	•				
53	Veggie Slicer	Sammic	CA-31 CP	1	KES	KES	•				
55	Filler Table - 24x34in	Trimark	TS-24x34x36-US-C	1	KES	KES					
56	Beverage Table - Chipotlane	Trimark	TS-36x92.5x36	1	KES	GC	•			•	
61B	Dish Machine (w/Pump)	Hobart	AM16SCB	1	KES	KES	•		•	•	
62B	Dish Table 30x30	Babington Technology	CDT-30X30X36.5-B-L	1	KES	GC					
65	Utility Cart (Not Shown)	Select Stainless	30SU-22-14-C4-TUBS-CUSTOM	1	KES	GC					Provided As Part Of The WIC Shelving
66A	Drop-Off Table - 29x30in	Trimark	TS-29x30x31-US-C	1	KES	KES					
67	Refrigerated Counter Case, Self-Serve	Structural Concepts	C03324R-UC	1	KES	KES					
69B	M4.0 - Simplicity Bubbler Mini-Quad	Crathco	CS-4E-16	1	KES	GC	•			•	
70	Speed Fill Faucet	T&S	B-0432 MOD	1	KES	GC			•		
71	Quesadilla Press	Turbochef	Sota Touch	1	KES	KES	•				
73A	50" TurboChef Table	Trimark	50X36X36	1	KES	KES					
74	Shelving - Under Counter - 12x36x29in	Metro	Custom	1	KES	KES					

MISC. EQUIPMENT LIST

TAG	DESCRIPTION	QTY	FURNISHED BY	INSTALLE D BY	UTILITY				REMARKS
					ELEC	PROPANE	WATER	SEWER	
1	Point of Sale Display	1	TMS	GC					Installed at POS Station
2	Point-Of-Sale System	2	T	TCC					Coordinate Requirements With Tenant and Elec. Drawings
4A	B-Rate (Standard Safe)	1	TS	GC					Install in Office, Bolt to Office Floor Slab
4C	Smart Safe	1	TSS	TSS	•				To Be Installed On Curb Under Serveline, Bolt to Curb Under Serveline POS
5B	Soda Dispenser - With Air-Cooled Ice Maker	1	SPS	SPS	•			•	Drain to Floor Sink, Tenant Millwork Supplier to Provide (2) Adjustable Legs to Support Dispenser From Under The Utensil Counter
5C	Soda Dispenser - With Remote Air-Cooled Ice Maker	1	SPS	SPS	•			•	Drain to Floor Sink, Tenant Millwork Supplier to Provide (2) Adjustable Legs to Support Dispenser From Under The Utensil Counter
6	Soda System Syrup Rack with Carbonator on Stainless Steel Shelf	1	SPS	SPS	•		•		
7A	Bulk CO2 Tank	1	CO2	CO2	•				GC To Secure Cylinders To Wall With Grade 30 Galvanized Steel Chain At 2/3 The Height Of The Cylinder. Attach To Wall With Stainless Steel Quick Link And Screw Eye.
8A	Gas Tankless Water Heater	2	GC	GC		•	•	•	Refer to MEP Drawings
9	Mop Sink, See Plumbing Drawings	1	GC	GC			•	•	See Plumbing Drawings
10	Touch-Free Soap Dispenser	4	WA	GC					
10.1	Hand Sanitizer Dispenser	5	WA	GC					
10.2	Hand Sanitizer Stand	1	WA	GC					
11	Paper Towel Dispenser, Bobrick B262	4	WA	GC					Provide Plywood Blocking to Mount to Wall
12	First Aid Kit	1	T	GC					Confirm Location With Chipotle CM Prior To Installation
13C	M4.0 - Artwork Panel - Carved Rice Board	1	TAS	GC					Provide Plywood Blocking to Mount to Wall
14	License Frame	1	T	GC					Provide Plywood Backing In Wall At License Frame Location, Refer To Arch. Floor Plans And Elevations For License Frame Location.
16A	Fire Extinguisher Type ABC - B456	2	GC	GC					Mount in locations specified by the Fire Marshal. Provide plywood backing at specified locations.
16B	Fire Extinguisher Type K	1	GC	GC					Mount in locations specified by the Fire Marshal. Provide plywood backing at specified locations.
19	Hat & Coat Strips (Not Shown)	1	WA	GC					Provide Plywood Blocking to Mount to Wall
20	2-Drawer File Cabinet, By Tenant	1	T	T					By Tenant
24	iPAD Wall Station	2	T	GC	•				Tablet By Tenant, Refer to Electrical Drawings
28	Mop Strip (Not Shown)	1	T	GC					Provide Plywood Backing To Mount To Wall, 2 Hole At Mop Basin and 6 Hole In Kitchen
31A	21inx31in Menu System	1	TMB	GC					
32	CO2 Alarm & Strobe	1	CO2AS	GC	•				Refer to Electrical Drawings for Additional Details
33A	M4.0 - Pick-Up Sign - Single Faced - Flush Mounted - Face	1	TSV	GC					

FURNITURE LIST

TAG	DESCRIPTION	QTY	FURNISHED BY	INSTALLED BY	UTILITY				REMARKS
					ELEC	PROPANE	WATER	SEWER	
1E	M4.0 - Table 24x24in - Rectangular Base	2	TMS	GC					
1F	M4.0 - Table 24x42in, Rectangular Base (Accessible)	4	TMS	GC					See Detail On A130
1H	M4.0 - Community Table - Low - Window - Length Varies	2	TMS	GC					
2G.1	M4.0 - Bar Height Table 8-Top, With Footrest	2	TMS	GC					One Coat Hook Per Two Seats, Confirm Mounting Location With Shop Drawings
3C.1	M4.0 - Dining Room Chair	14	TMS	GC					
3D	M4.0 - Marshmallow Stool - Fixed	5	TMS	GC					Align Seat With Seam Perpendicular To Table Edge
3E	M4.0 - Bar Stool - Fixed	16	TMS	GC					Align Seat With Seam Perpendicular To Table Edge
4P.1	Banquette Bench (Black) - Floor Mount	2	TMS	GC					
6C	M4.0 - Beverage Counter - With Trash - 4" Splash - 149"	1	TMS	GC				•	Coordinate Floor Drain Installation with Utensil Counter Installation, Bins and Sign Hooks Provided by Tundra in Smallwares Package, Install Hooks on Back of Doors
10	Child's High Chair	1	T	GC					
11	Office Chair, By Tenant	1	T	T					By Tenant
12	Patio Chair - ¹ △	20	KES	GC					Provided by EMU America, Contact: Carol Hughes (303-744-3200)
13A	24in Round Bistro Table	1	KES	GC					Provided By EMU America, Contact: Carol Hughes (303-744-3200)
13B	30in Square Bistro Table	4	KES	GC					Provided By EMU America, Contact: Carol Hughes (303-744-3200)
14A	HA8 - 3 Bin Trash/Recycling Surround - Exterior ¹ △	1	TMS	GC					Bins Provided by Tundra in Smallwares Package
14C	M4.0 - 3 Bin Trash/Recycling Surround - Interior	1	TMS	GC					Bins Provided by Tundra in Smallwares Package
15	Patio Umbrella	2	KES	GC					
16	Accessible Patio Table	1	KES	GC					Provided By EMU America, Contact: Carol Hughes (303-744-3200)
17A.2	MOPUS Shelving - 44"	1	TMS	GC					GC To Provide Blocking In Walls At The Ends Of The MOPUS Shelf To Secure Shelves, Wood Edge Of The Shelves To Face The Dining Room

ADDITIONAL EQUIPMENT

GREASE RECEPTACLE	
☒	BARREL
☐	CADDY (UNDERSHELF)

CONSULTANT:



CLIENT:



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2682
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2026
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:



September 04, 2026
MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:

03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:

1 08/21/2026 BA1 - FINISH UPDATES


TITLE:

FF&E SCHEDULES

SHEET NUMBER:

A131

SCALE: 1/4" = 1'-0'




DESCRIPTION	FURNISHED BY	INSTALLED BY	UTILITY				REMARKS
			ELEC	PROPANE	WATER	SEWER	
Exhaust Fans & Curbs	HS	GC	●	●	●	●	Curb furnished by HS, installed by GC
Make Up Air Unit & Curbs	HS	GC	●	●	●	●	Curb furnished by HS, installed by GC
Roof Top Units & Curbs	HES	GC	●	●	●	●	Curb furnished by HS, installed by GC
Test & Balance System	TAB	-					Furnish HVAC Test & Balance per Tenant's National Account Program.



- ## 2 BOOT DETAIL
- SCALE: 1/2" = 1'-0"

SCALE: 1/2" = 1'-0"



- ### 3 CURB FLASHING
- SCALE: 1/2" = 1'-0"

SCALE: 1/2" = 1'-0"

- A. SEE STRUCTURAL DRAWINGS FOR LOCATIONS AND SIZE OF STRUCTURAL ROOF REINFORCEMENTS.
- B. SEE MECHANICAL PLANS FOR ROOF TOP EQUIPMENT.
- C. COORDINATE ALL ROOF PENETRATIONS, FLASHING, AND REPAIR W/ CHIPOTLE CONSTRUCTION MANAGER PRIOR TO COMMENCEMENT OF WORK.
- D. DIMENSIONS FOR ROOF TOP EQUIPMENT WITH CURBS IS TO THE OUTSIDE FACE OF CURB. DIMENSIONS FOR EQUIPMENT WITHOUT CURBS ARE TO THE CENTER OF THE UNIT. ALL DIMENSIONS ARE FOR REFERENCE ONLY. ROOFING CONTRACTOR TO ADJUST AS NECESSARY IN FIELD. CONTACT ENGINEERING CONSULTANTS FOR ANY MAJOR MODIFICATIONS TO LAYOUT.
- E. JOISTS FOR SHELL BUILDING WERE DESIGNED FOR THE RTU WEIGHTS AND PLACEMENT EXHIBITED. IF LOCATION OR ORIENTATION OF A UNIT MUST CHANGE, NOTIFY ARCHITECT IMMEDIATELY.
- F. SEE M700 FOR PENETRATION DETAILS AT RTUS AND THE EXHAUST FAN.
- G. PROVIDE INSULATED CURBS FOR ALL EQUIPMENT IN EXPOSED DECK AREA ONLY.
- H. PROVIDE TAPERED INSULATED CRICKET AT ALL EQUIPMENT CURBS.
- I. LOCATE ALL UNITS SO DUCT DROPS BETWEEN TRUSS JOISTS. NOTIFY ARCHITECT IMMEDIATELY IF ANY UNITS NEED TO SHIFT FROM PLAN LOCATION SHOWN.

1	OVERFLOW ROOF DRAIN LOCATION - GENERAL CONTRACTOR IS RESPONSIBLE OF SNAKE CLEANING PRIOR TO BUILDING TURNOVER.
2	PRIMARY ROOF DRAIN LOCATION - GENERAL CONTRACTOR IS RESPONSIBLE OF SNAKE CLEANING PRIOR TO BUILDING TURNOVER.
3	ROOF HYDRANT - REFER TO PLUMBING FOR ADDITIONAL INFORMATION.
4	INSTALL ROOF TOP WALKING PADS AROUND RTU'S AND EF-1. FOLLOW ROOF MANUFACTURER REQUIREMENTS, TYP.
5	10'-0" RADIUS CLEARANCE FOR FRESH AIR INTAKES - REFER TO MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION.
6	EXISTING ROOF LADDER LOCATION.
7	CANOPY BELOW - REFER TO EXTERIOR ELEVATIONS.
8	SIGNAGE BY TENANT'S VENDOR - GENERAL CONTRACTOR TO PATCH AND REPAIR ADJACENT WALL AS REQUIRED FOR SIGN INSTALLATION - GENERAL CONTRACTOR TO COORDINATE SIGNAGE PENETRATIONS WITH SIGNAGE VENDOR.
9	EXISTING FULLY ADHERED PVC ROOFING SYSTEM AND RIGID INSULATION - PATCH AND REPAIR AS REQUIRED - REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
10	EXISTING WOOD JOISTS BELOW SHOWN FOR REFERENCE ONLY - REFER TO STRUCTURAL DRAWINGS FOR ADDITIONAL INFORMATION.
11	ALL ROOF PENETRATIONS, INCLUDING MINOR ROOF VENTS AND SIMILAR ITEMS, MAY NOT BE INDICATED ON PLAN - GENERAL CONTRACTOR TO VERIFY AND COORDINATE SCOPE SO AS TO INDICATE ALL ROOFING AND FLASHING WORK SO AS TO OBTAIN AND/OR MAINTAIN EXISTING ROOFING WARRANTIES.
12	LOCATIONS OF ALL ROOF PENETRATIONS ARE TO BE VERIFIED WITH APPROPRIATE SUBCONTRACTOR.
13	GENERAL CONTRACTOR TO CLEAN ROOF OF ALL CONSTRUCTION DEBRIS AT PROJECT COMPLETION.
14	PLYWOOD DECK (A/C X EXTERIOR FINISH GRADE) AND WOOD TRUSSES ARE EXPOSED IN TENANT'S DINING AREA AND NEED TO BE FREE AND CLEAR OF MARKINGS.

CONSULTANT: _____



COPYRIGHT 2026
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND
AS SUCH REMAINS THE PROPERTY OF CHIPOTLE
MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS
DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY
BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN
GRILL, INC..

PROJECT INFORMATION:

STORE NO.: 5644

"CAMERON NC"
TBD NC 24-87

CAMERON, NC 28326

REAL:



MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO.	2024-0362
DRAWN BY	JSB / KRJ
CHECKED BY	DLA

ISSUE RECORD:	
03/07/2025	PERMIT SET
05/29/2025	BID SET

REVISIONS:


1 08/21/2026 BA1 - FINISH UPDATES

TITLE:

ARCHITECTURAL
ROOF PLAN

SHEET NUMBER:

A140

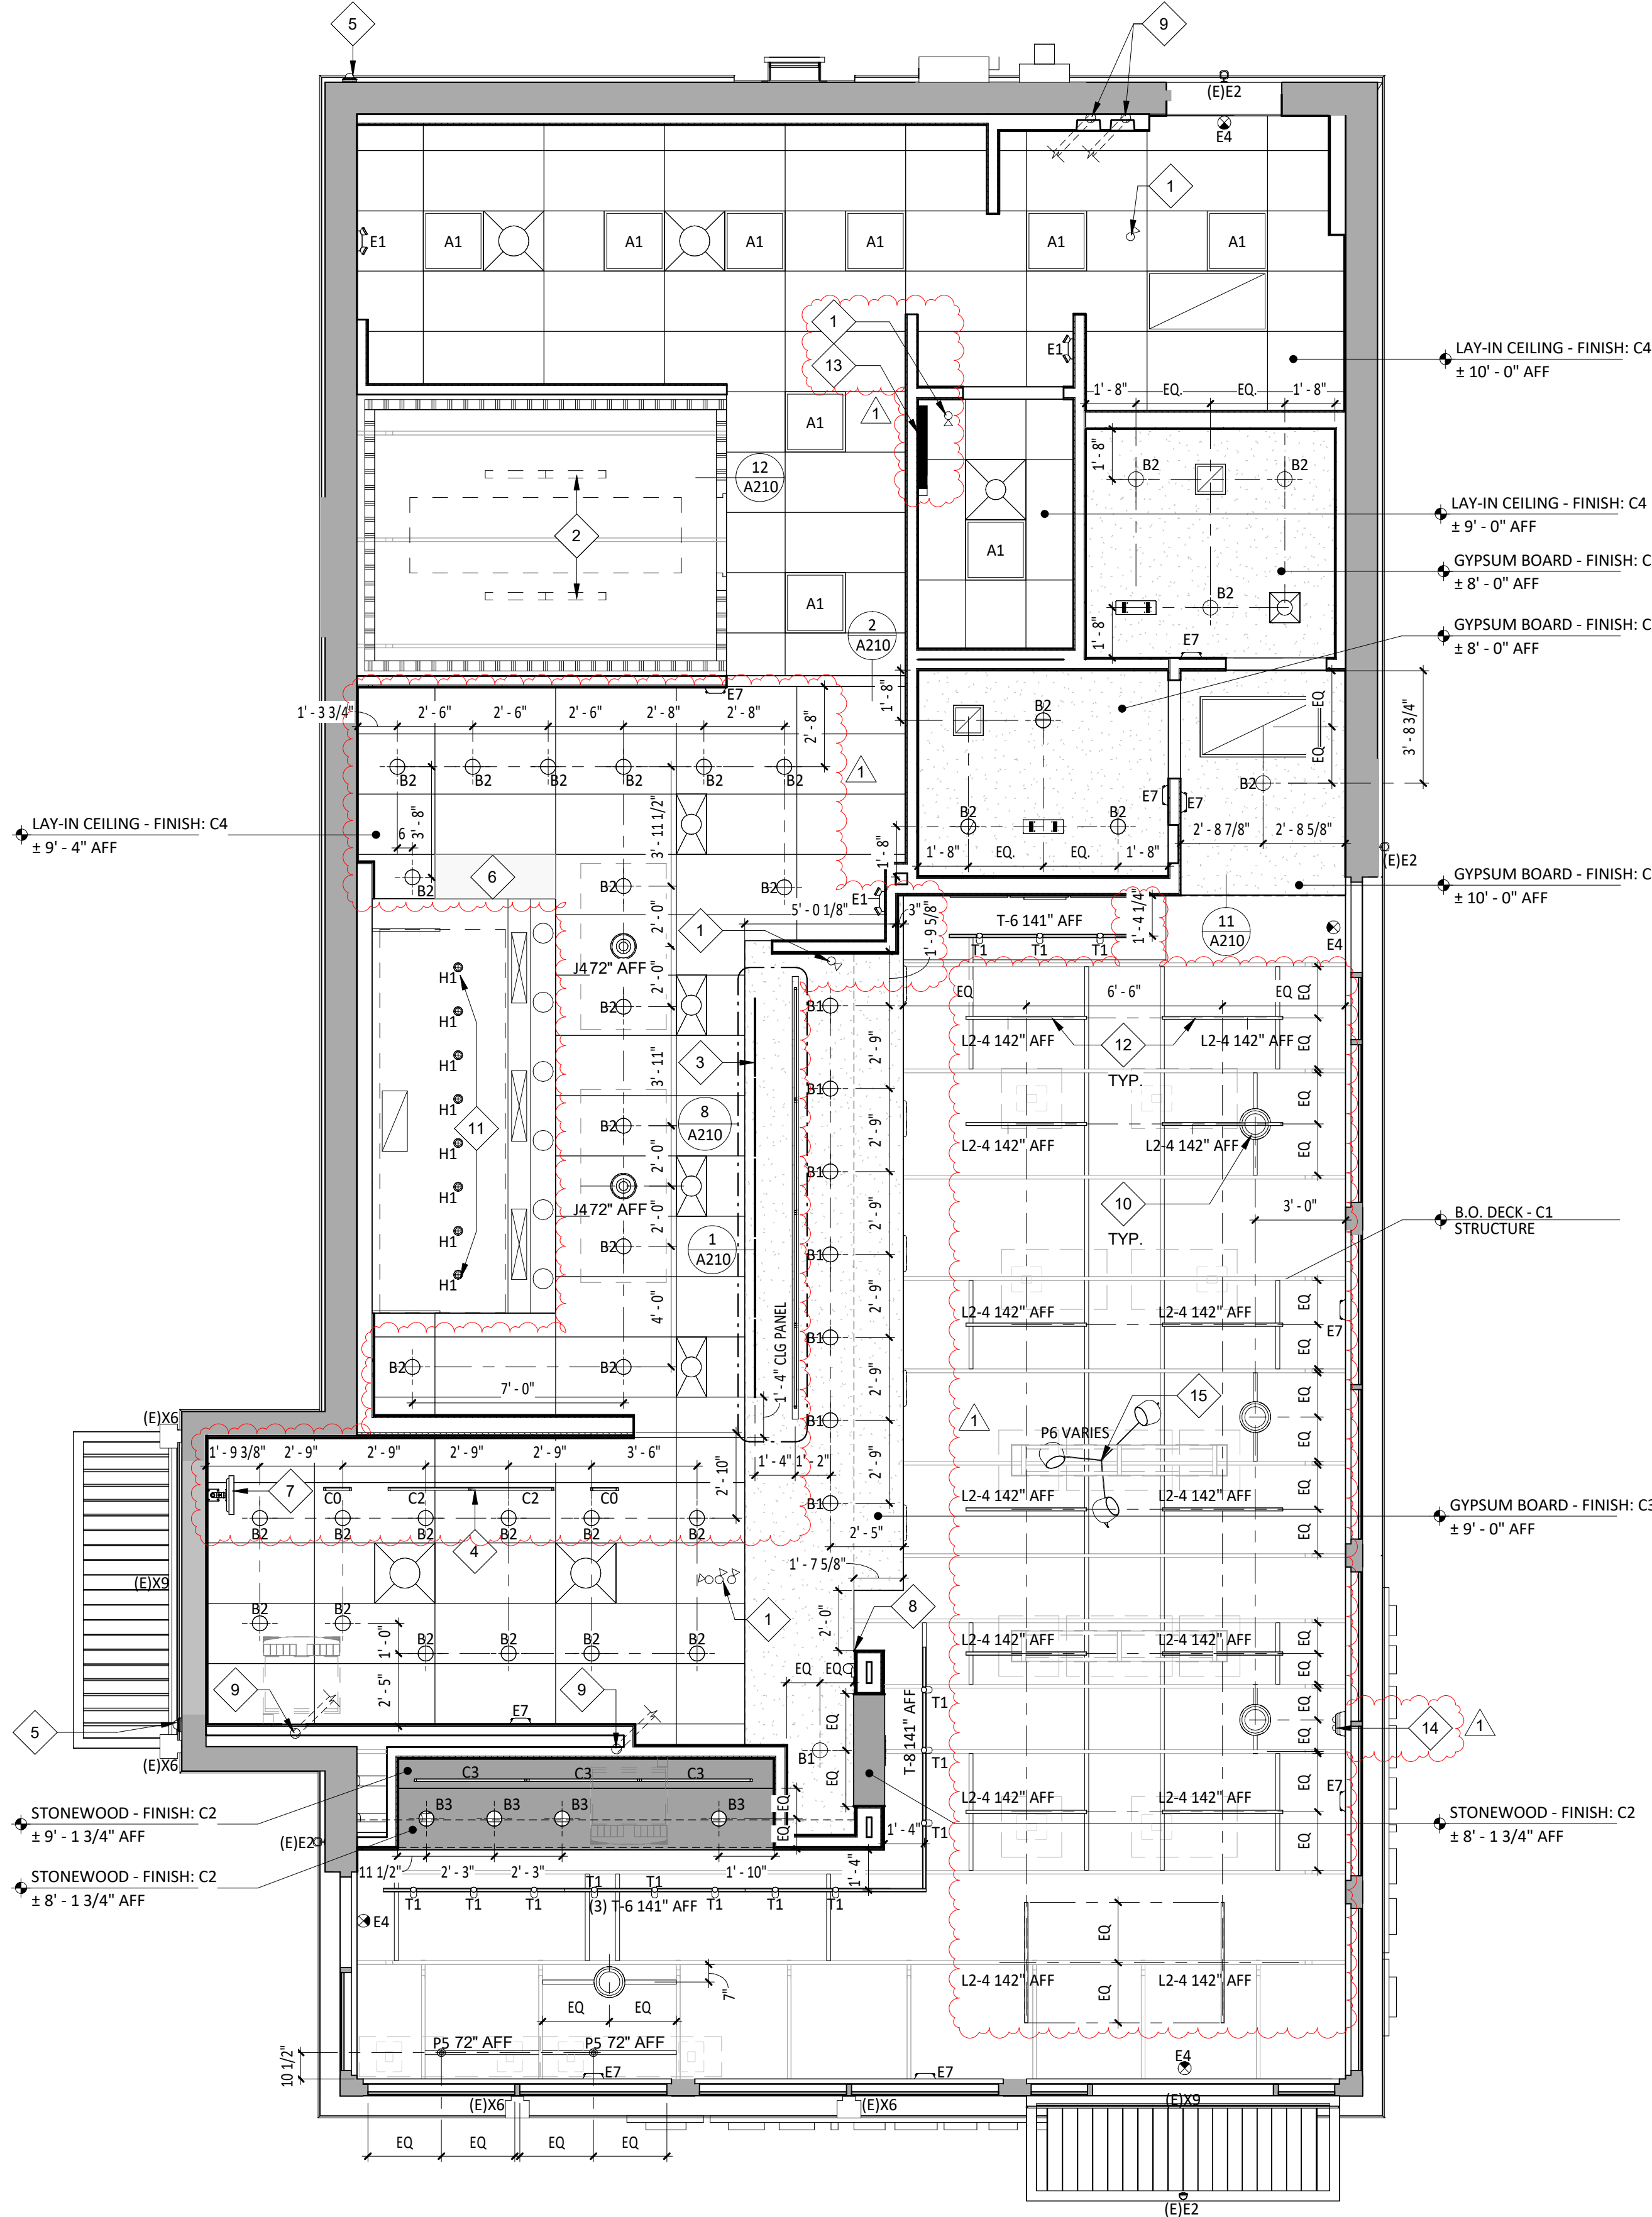

1 REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"

LIGHTING FIXTURE SCHEDULE

ITEM #	MOUNT	DESCRIPTION	REMARKS
EXISTING			
(E)E2	VARIOUS	EMERGENCY LIGHT - SINGLE HEAD	SEE SHEET E100
(E)X9	SURFACE	LED CHANNEL LIGHT BY LANDLORD	SEE SHEET E100
NEW			
(E)X6	WALL	WALL PACK BY LANDLORD	SEE SHEET E100
A1	LAY-IN	2x2 LED LENSED TROFFER	SEE SHEET E100
B1	CEILING	RECESSED 6IN CAN LIGHT	SEE SHEET E100
B2	CEILING	RECESSED 6IN CAN LIGHT	SEE SHEET E100
B3	CEILING	M4.0 - RECESSED 6IN CAN LIGHT (BLACK)	SEE SHEET E100
C0	SURFACE	LOW PROFILE LED 1FT	SEE SHEET E100
C2	SURFACE	LOW PROFILE LED 3FT	SEE SHEET E100
C3	SURFACE	LOW PROFILE LED 4FT	SEE SHEET E100
E1	VARIOUS	EMERGENCY LIGHT - DUAL HEAD	SEE SHEET E100
E4	VARIOUS	WHITE EXIT LIGHT - STANDARD RED LETTERS	SEE SHEET E100
E7	VARIOUS	EMERGENCY LIGHT - DUAL HEAD	SEE SHEET E100
H1	SURFACE	VAPOR PROOF HOOD LIGHT	SEE SHEET E100
J4	PENDANT	M4.0 - PENDANT LIGHT	SEE SHEET E100
L2-4	SUSPENDED	LINEAR INDIRECT	SEE SHEET E100
P5	PENDANT	PENDANT LIGHT	SEE SHEET E100
P6	PENDANT	M4.0 - MULTI-PENDANT LIGHT	SEE SHEET E100 & A701
T1	TRACK	TRACK LIGHTING HEAD	SEE SHEET E100
T-6	SUSPENDED	M4.0 - TRACK 6"	SEE SHEET E100
T-8	SUSPENDED	M4.0 - TRACK 8"	SEE SHEET E100

GENERAL NOTES - RCP

- ALL INTERIOR LIGHT FIXTURES AND LAMPS PROVIDED BY TENANT'S LIGHT/LAMP SUPPLIER.
- ALL INTERIOR LIGHT FIXTURES AND LAMPS INSTALLED BY GC. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
- KITCHEN EXHAUST HOOD PROVIDED BY HS AND INSTALLED BY GC. GC TO COORDINATE PRESSURE TEST AND VIRO GUARD WITH ENVIROMATIC, INC.
- ANSUL BOX & FIRE SUPPRESSION SYSTEM PROVIDED BY AND INSTALLED BY HS. HOOD INTERLOCK BY GC. ELECTRICAL CONNECTION BY GC. RE: ELEC.
- MENU BOARD ASSEMBLY PROVIDED BY TMB, INSTALLED BY G.C.
- PROVIDE BLOCKING ABOVE MENU BOARD ASSEMBLY FOR INSTALLATION.
- REFER TO "09900 PAINTING - GENERAL" IN SPECIFICATIONS FOR FINISHES AT EXPOSED CEILING AREAS IN ADDITION TO NOTES LISTED ON THIS SHEET AND A120
- UNISTRUT TO BE LEFT UNPAINTED. PROVIDE MATCHING CLOSER STRIPS AND END CAPS. CLOSER STRIP TO BE APPLIED TO THE UNDERSIDE OF THE UNISTRUT.
- ALL HEIGHTS ARE TO BOTTOM OF FIXTURE UNLESS NOTED OTHERWISE.
- LIGHT DETAILS ARE LOCATED ON SHEET A210. FIXTURE AND LAMP SPECIFICATIONS ARE LOCATED ON E100.
- ALL UNISTRUT SUPPORTING CEILING ELEMENTS AND/ OR DUCT WORK SHALL NOT CONTAIN ANY ELECTRICAL CONDUIT. ALL ELECTRICAL CONDUIT MUST RUN IN SEPARATE UNISTRUT.
- ALL UNISTRUT, CONDUIT, SPRINKLER & WATER LINES SHALL BE INSTALLED TO THE BOTTOM OF THE DECK OR AS SHOWN IN DETAILS & LEFT UNPAINTED.
- ALL DIMENSIONS ARE TO FACE OF FRAMING, OR CENTERLINE OF FIXTURE UNLESS NOTED OTHERWISE.
- SEE ELECTRICAL DRAWINGS FOR SHATTER RESISTANT LAMP LOCATIONS.
- ALL EMERGENCY FIXTURES, LIGHTS AND STROBES SHALL BE ALIGNED OR CENTERED ON WALLS.
- FULL CERAMIC TILE COURSING SHALL TAKE PRECEDENT OVER ANY CEILING/HEADER DIMENSION INDICATED IN THE PLAN, REFER TO A120.
- ALL CONDUIT AND PIPE PENETRATIONS OF THE SERVING LINE SOFFIT ARE TO BE HELD TIGHT TO THE DECK. PLEASE CONSULT WITH THE CHIPOTLE CM SHOULD ANY CONFLICTS ARISE.
- BATT INSULATION TO BE INSTALLED ABOVE THE RESTROOM CEILING.
- ALL LAY-IN CEILING PENETRATIONS TO BE HELD TIGHT TO WALLS. REFER TO DETAIL ON SHEET A210 AND PLUMBING DRAWINGS FOR DETAILS.
- REFER TO STRUCTURAL DRAWINGS FOR HOOD SUSPENSION DETAILS.
- ALL EXTERIOR BUILDING MOUNTED AND PATIO LIGHT FIXTURES AND LAMPS PROVIDED BY TENANT'S LIGHT/LAMP SUPPLIER, U.N.O.
- ALL EXTERIOR PARKING LOT LIGHT FIXTURES AND LAMPS PROVIDED BY AND INSTALLED BY G.C. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
- ALL EXTERIOR BUILDING MOUNTED AND PATIO LIGHT FIXTURES AND LAMPS INSTALLED BY G.C. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
- SECURITY CAMERA LOCATIONS ARE ONLY APPROXIMATE LOCATIONS. FOR GUIDANCE ON THE SPECIFIC LOCATION/ORIENTATION OF THESE CAMERAS, REFER TO THE ENVYISION INSTALLATION GUIDE
- REFER TO A120 FOR FINISH LEGEND.

KEYNOTE LEGEND

1	INTERIOR SECURITY CAMERA LOCATIONS - TYPICAL SIX (6) - CENTER IN CEILING TILE WHERE APPLICABLE.
2	LIGHTING FOR COOLER PROVIDED BY COOLER MANUFACTURER - GENERAL CONTRACTOR TO PROVIDE ROUGH-IN AND FINAL HOOK-UP.
3	LINE OF SUSPENDED MENU BOARD SYSTEM.
4	UNDERSHELF TASK LIGHTING - REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION.
5	EXTERIOR SECURITY CAMERA LOCATIONS - TYPICAL OF TWO (2).
6	PROVIDE FREE AND CLEAR ACCESS TO HOOD AS REQUIRED - GENERAL CONTRACTOR TO COORDINATE WITH ALL TRADES TO MAINTAIN.
7	LOCATION OF MONITOR BY TENANT'S VENDOR.
8	HOLD SOFFIT FRAMING SO GYPSUM SOFFIT FINISH DOESN'T OVERLAP WALL FINISH ON BOX BELOW - REFER TO FINISH PLAN FOR ADDITIONAL INFORMATION.
9	4" PVC PIPES STUBBED ABOVE CEILING FOR SODA BUNDLE - REFER TO PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.
10	FOUR (4) SPEAKERS - CENTER BETWEEN TRUSSES - REFER TO SHEET A210 FOR ADDITIONAL INFORMATION.
11	LIGHTS BY EXHAUST HOOD MANUFACTURER.
12	CENTER LIGHT FIXTURES BETWEEN STRUCTURAL MEMBERS.
13	BYPASS DISTRIBUTION SYSTEM - REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
14	DUAL HEAD INTERIOR SECURITY CAMERA LOCATION.
15	CENTER LIGHT FIXTURE OVER TABLE BELOW.

SECURITY DEVICE SCHEDULE

DESCRIPTION	QTY	FURNISHED		INSTALLED	ELEC	UTILITIES			REMARKS
		BY	SSS			GAS	SEWER	WATER	
SECURITY MONITOR	1	SSS	SSS						
SECURITY ALARM - MOTION DETECTORS	1	T.B.D.	T.B.D.						GC RESPONSIBLE FOR COORDINATING SEQUENCING OF PREWIRING WITH COMPLETION OF INTERIOR FINISHES (GYP. BD. FINISHES)
72 HR SECURITY DVR	1	SSS	SSS						
CLOSED CIRCUIT T.V. CAMERA - OUTDOOR	2	SSS	SSS						INSTALL AT 9'-6" U.N.O.
CLOSED CIRCUIT T.V. CAMERA - INDOOR - DUAL	1	SSS	SSS						
CLOSED CIRCUIT T.V. CAMERA - INDOOR	6	SSS	SSS						

SPEAKER SCHEDULE

ITEM #	QTY	DESCRIPTION	COLOR/FINISH	MOUNT	REMARKS
SP1	4	DINING ROOM SPEAKER	BLACK	SUSPENDED	REFER TO A201 & E110 FOR DETAILS

CONDUIT GUIDELINES


SEE ELECTRICAL DRAWINGS FOR CONDUIT REQUIREMENTS. METAL CLAD CABLE AND FLEXIBLE METAL CONDUIT SHALL NOT BE INSTALLED IN AREAS EXPOSED TO VIEW UNLESS SPECIFICALLY NOTED OTHERWISE



COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

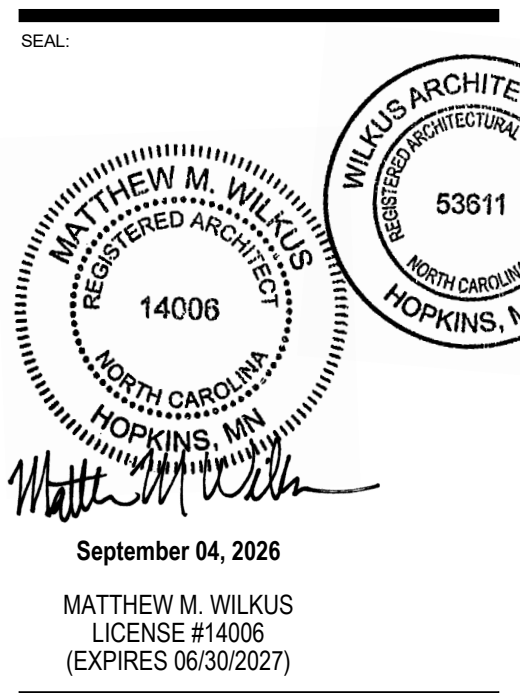


PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET


REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES

TITLE:
REFLECTED
CEILING PLAN


SHEET NUMBER:
A201

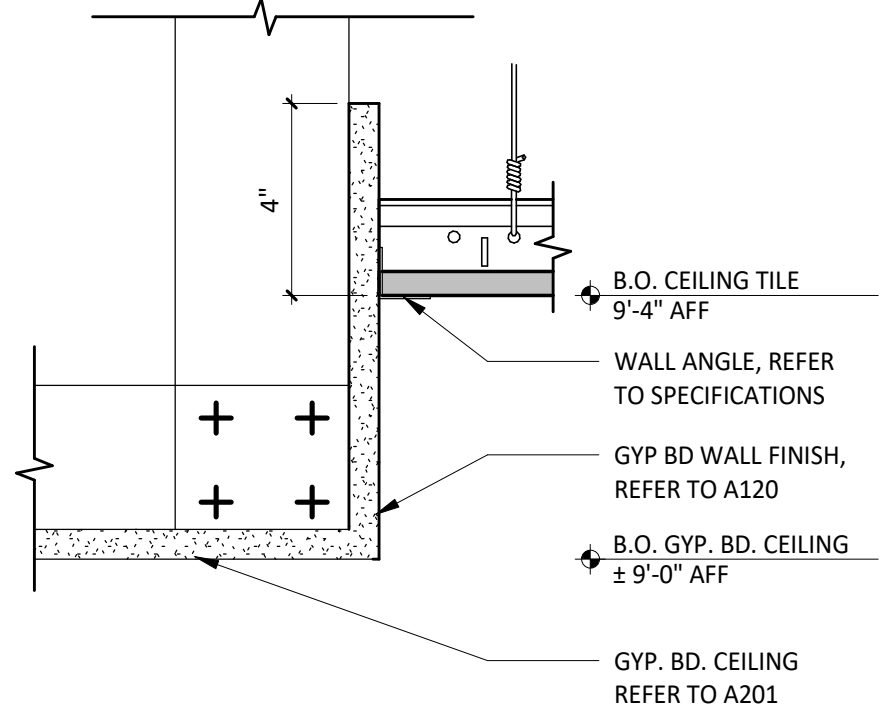


1 KITCHEN CEILING TRANSITION
SCALE: 3" = 1'-0"

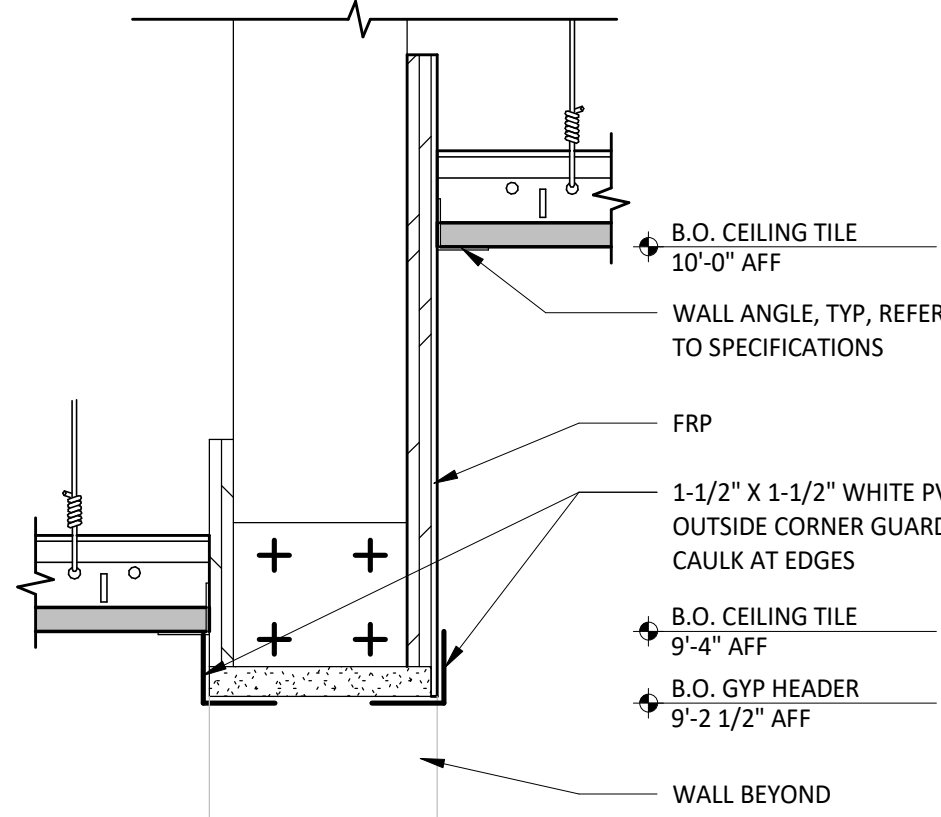


2 KITCHEN CEILING TRANSITION
SCALE: 3" = 1'-0"

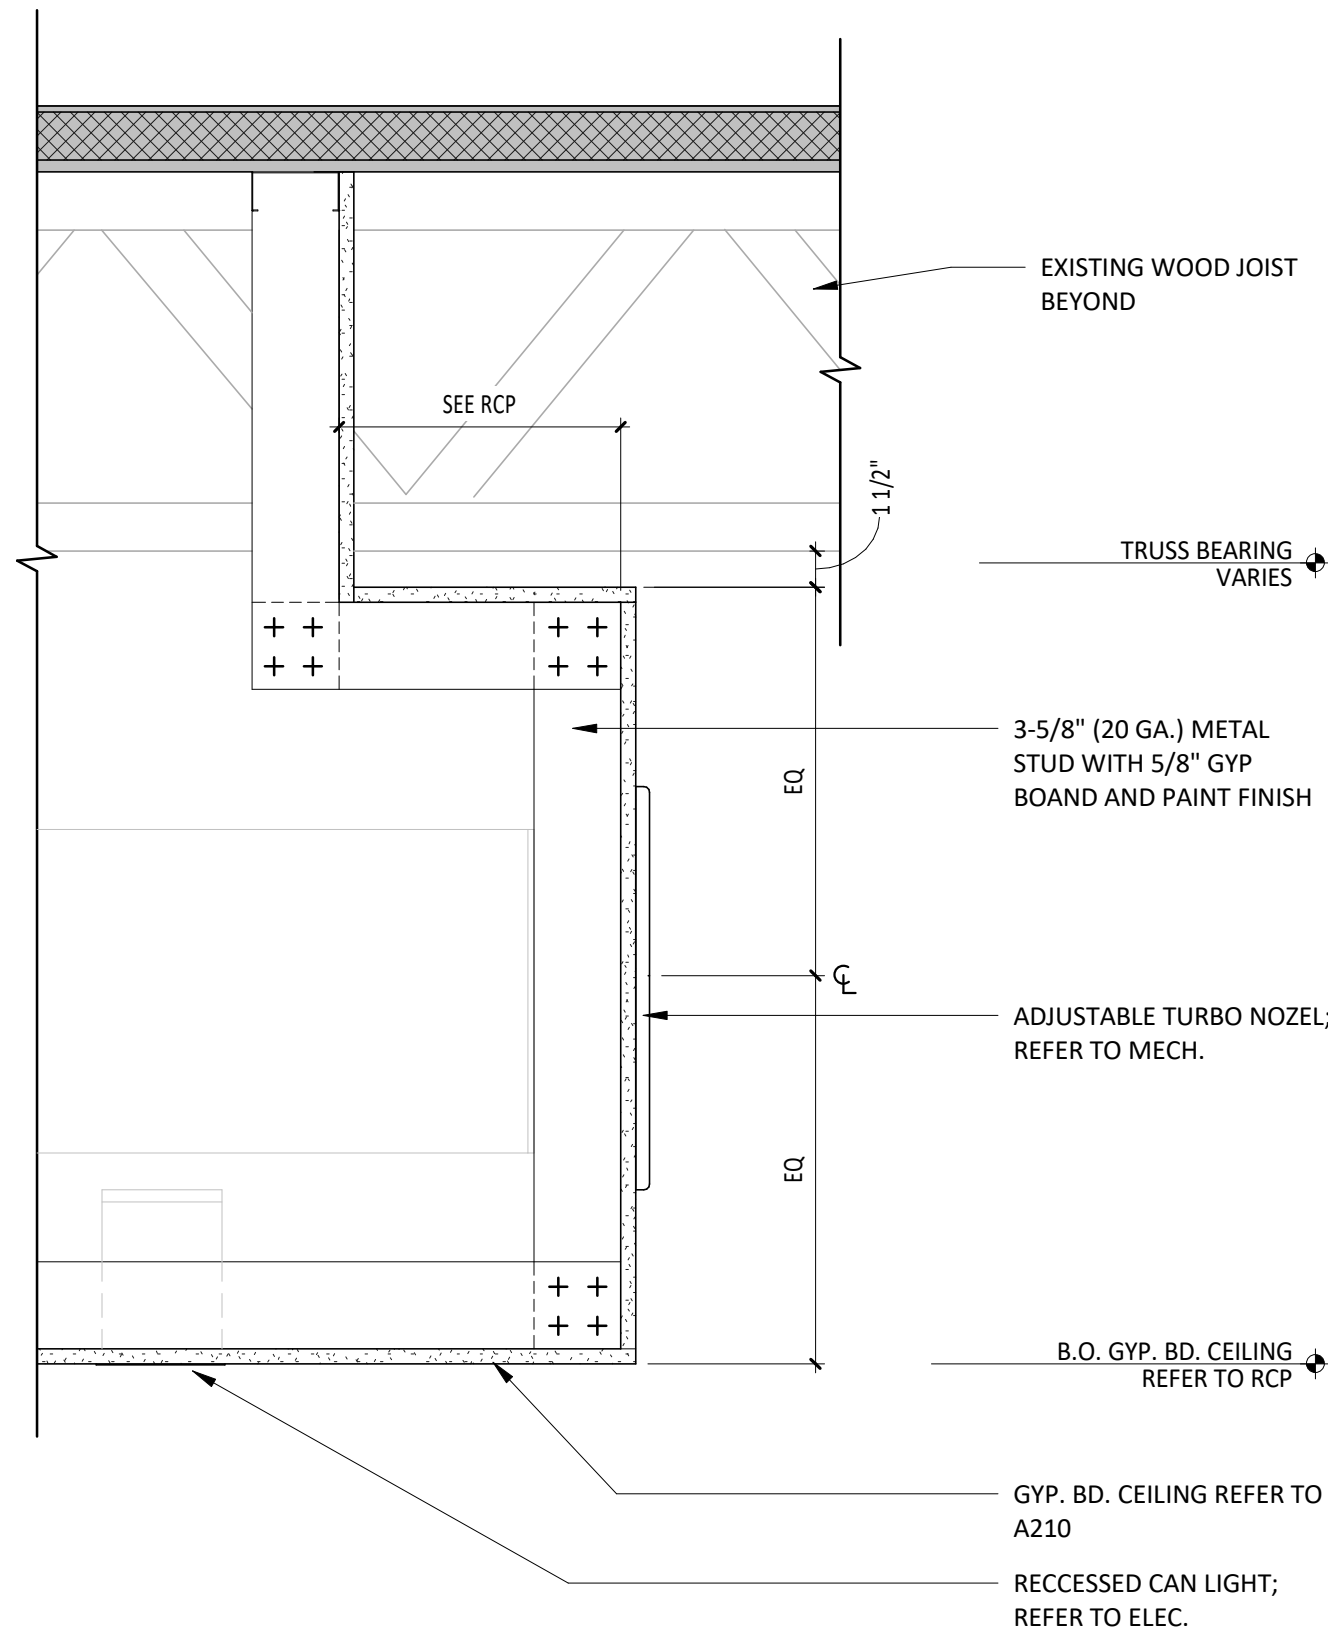


5 SECTION @ JOIST SHELF
SCALE: 1 1/2" = 1'-0"

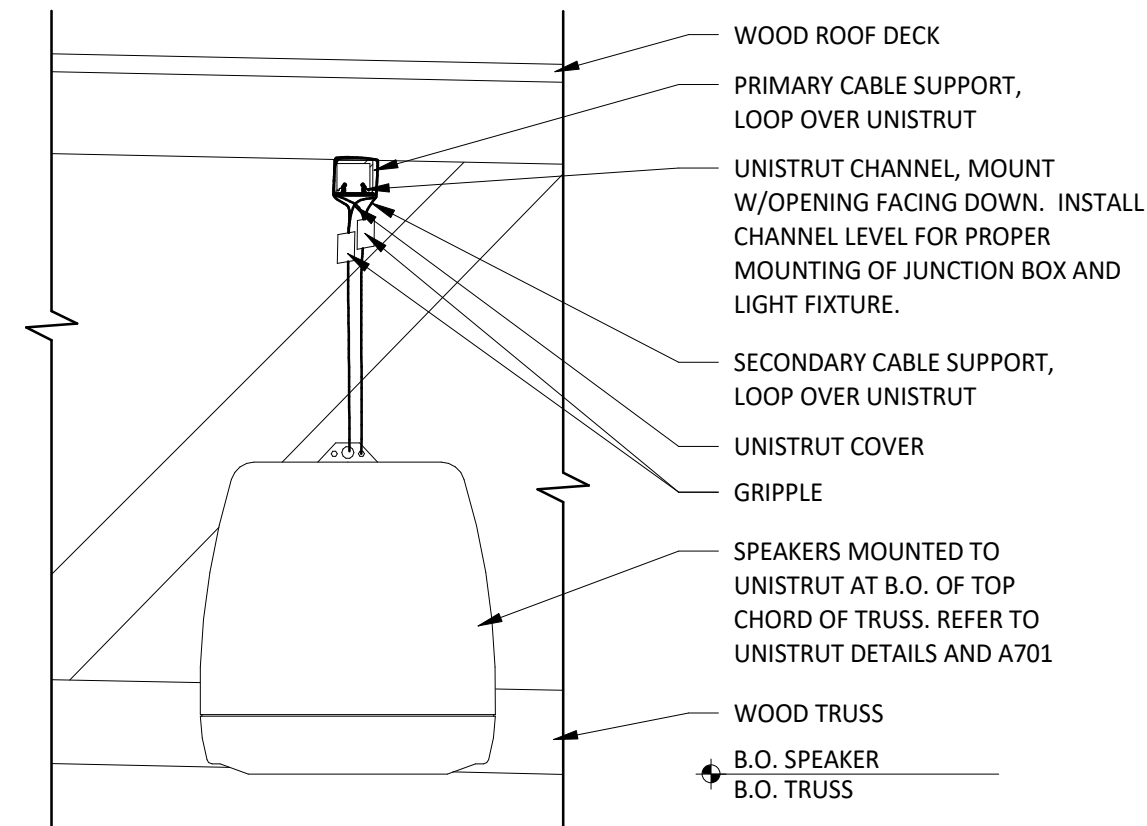


6 SUSPENDED SPEAKER INSTALLATION
SCALE: 1 1/2" = 1'-0"

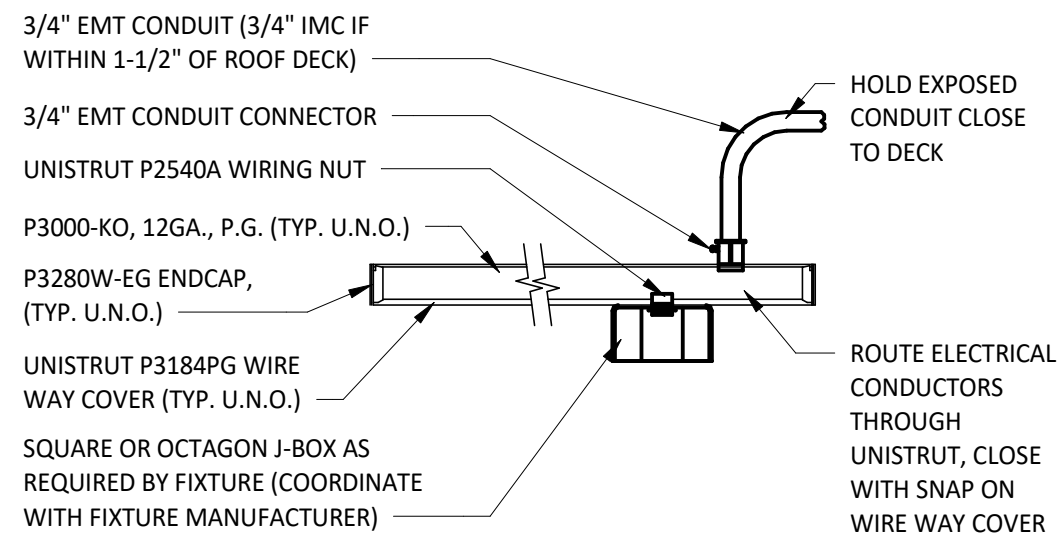


3 UNISTRUT MOUNTING DETAIL
SCALE: 1 1/2" = 1'-0"

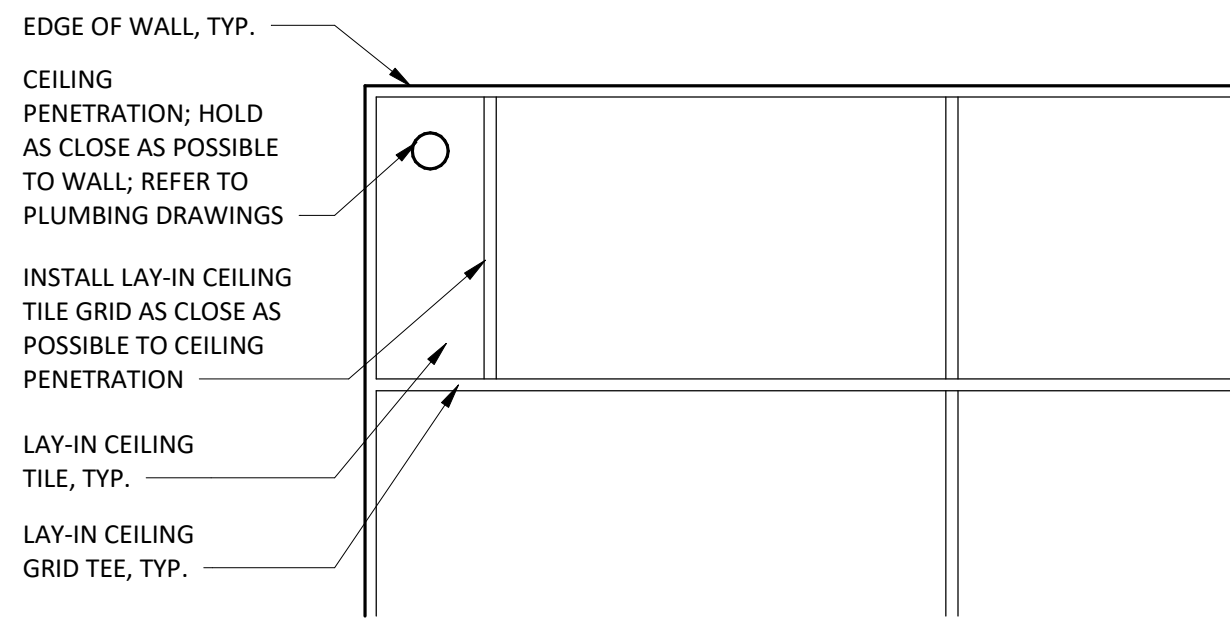


4 LAY-IN CEILING PENETRATION - PLAN DETAIL
SCALE: 3/4" = 1'-0"

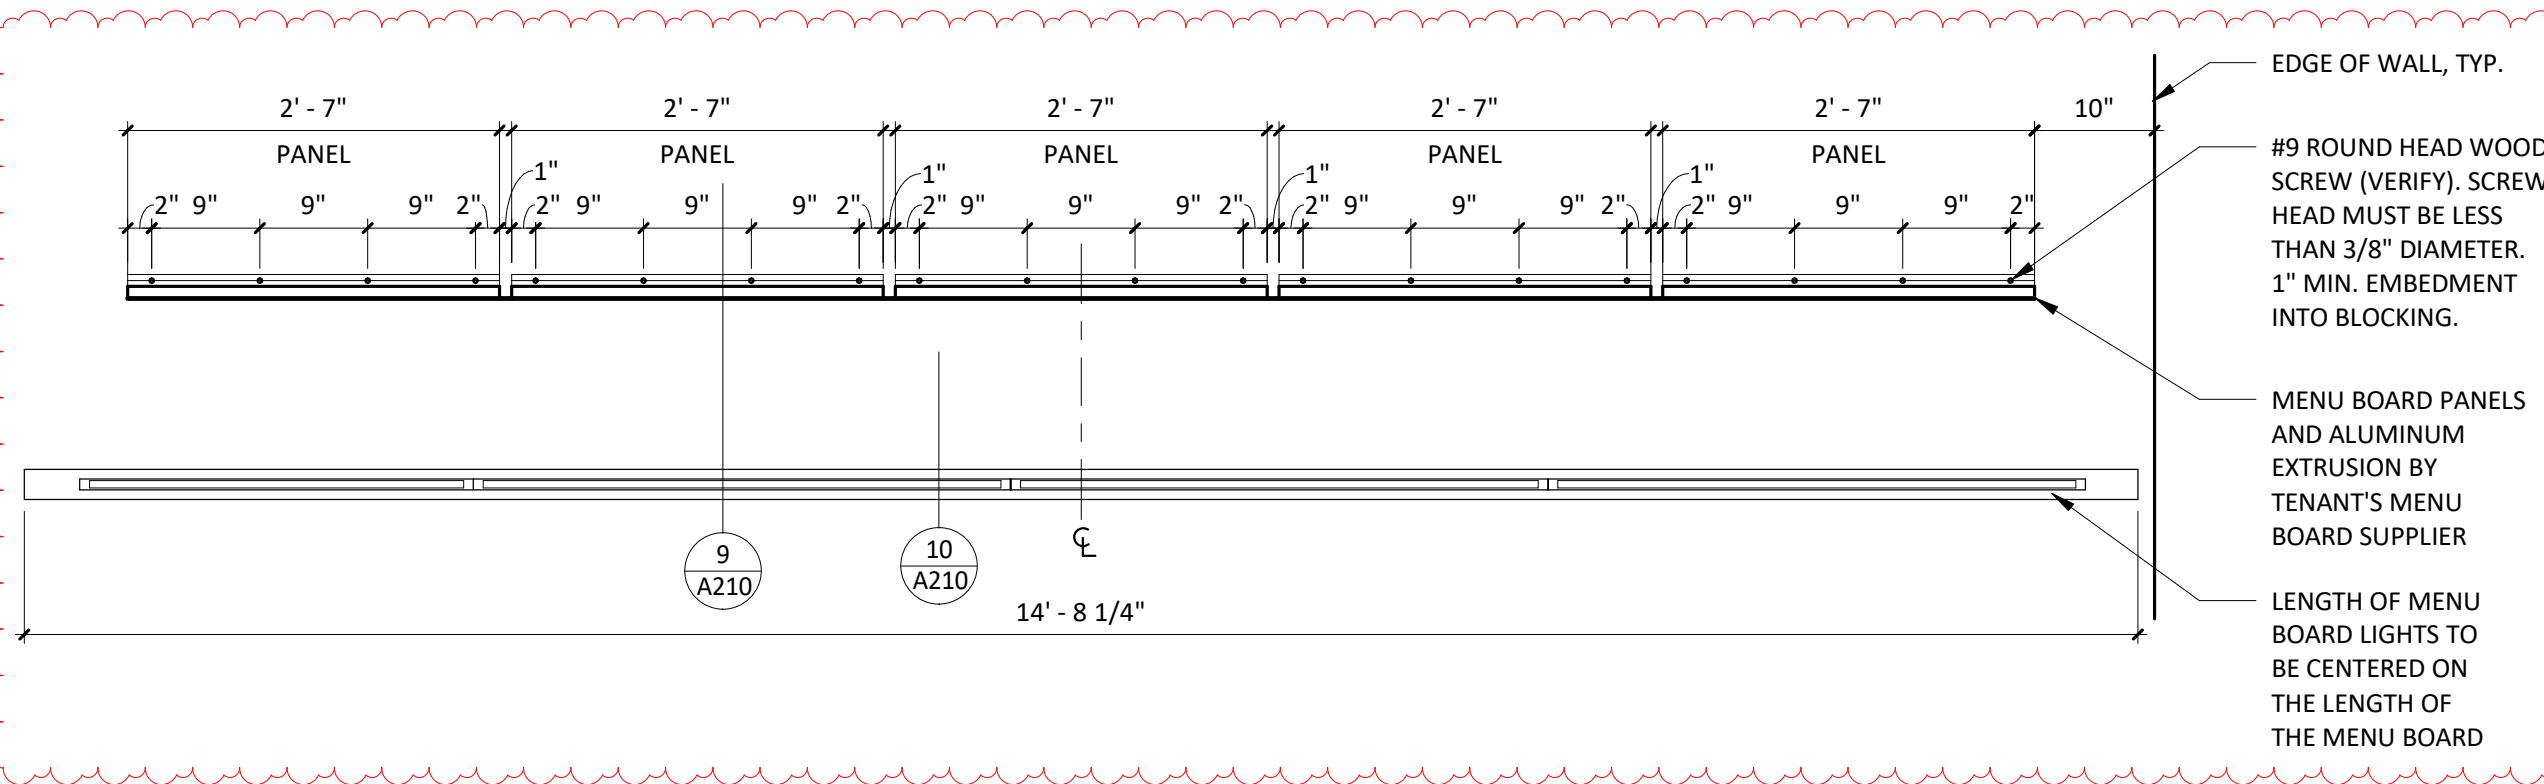


8 MENU - SCREW PATTERN PLAN
SCALE: 3/4" = 1'-0"

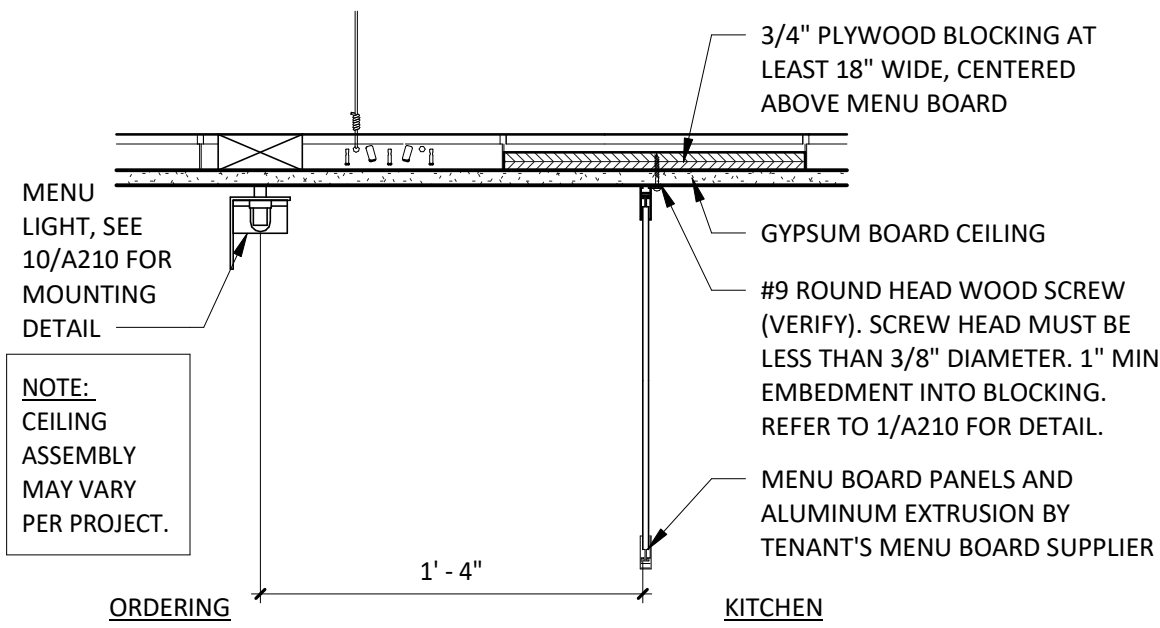


9 MENU BOARD DETAIL
SCALE: 1 1/2" = 1'-0"

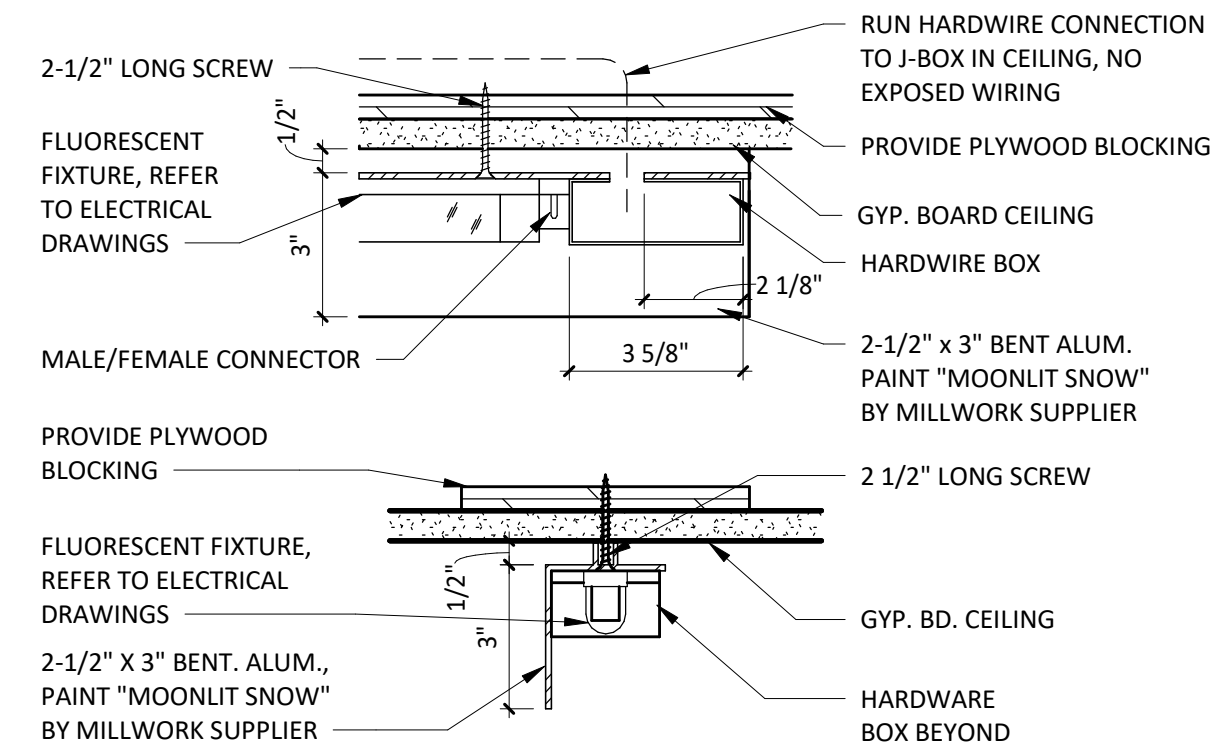


10 MENU BOARD LIGHT DETAIL
SCALE: 3" = 1'-0"

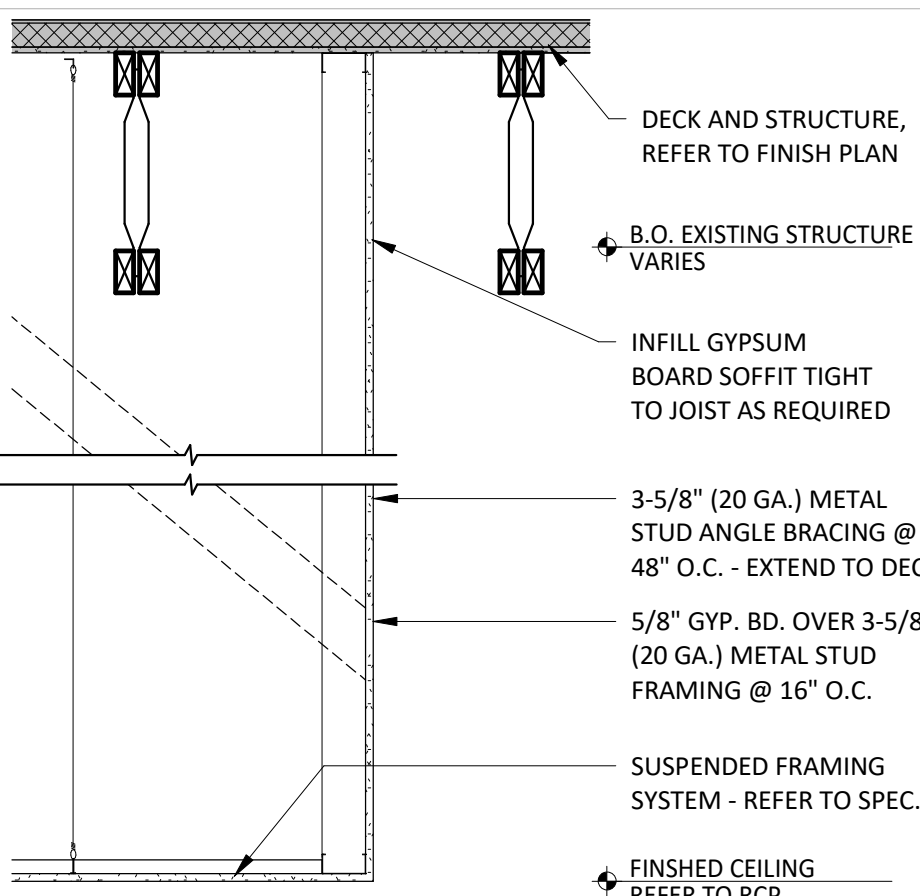

11 SECTION @ SOFFIT
SCALE: 3/4" = 1'-0"

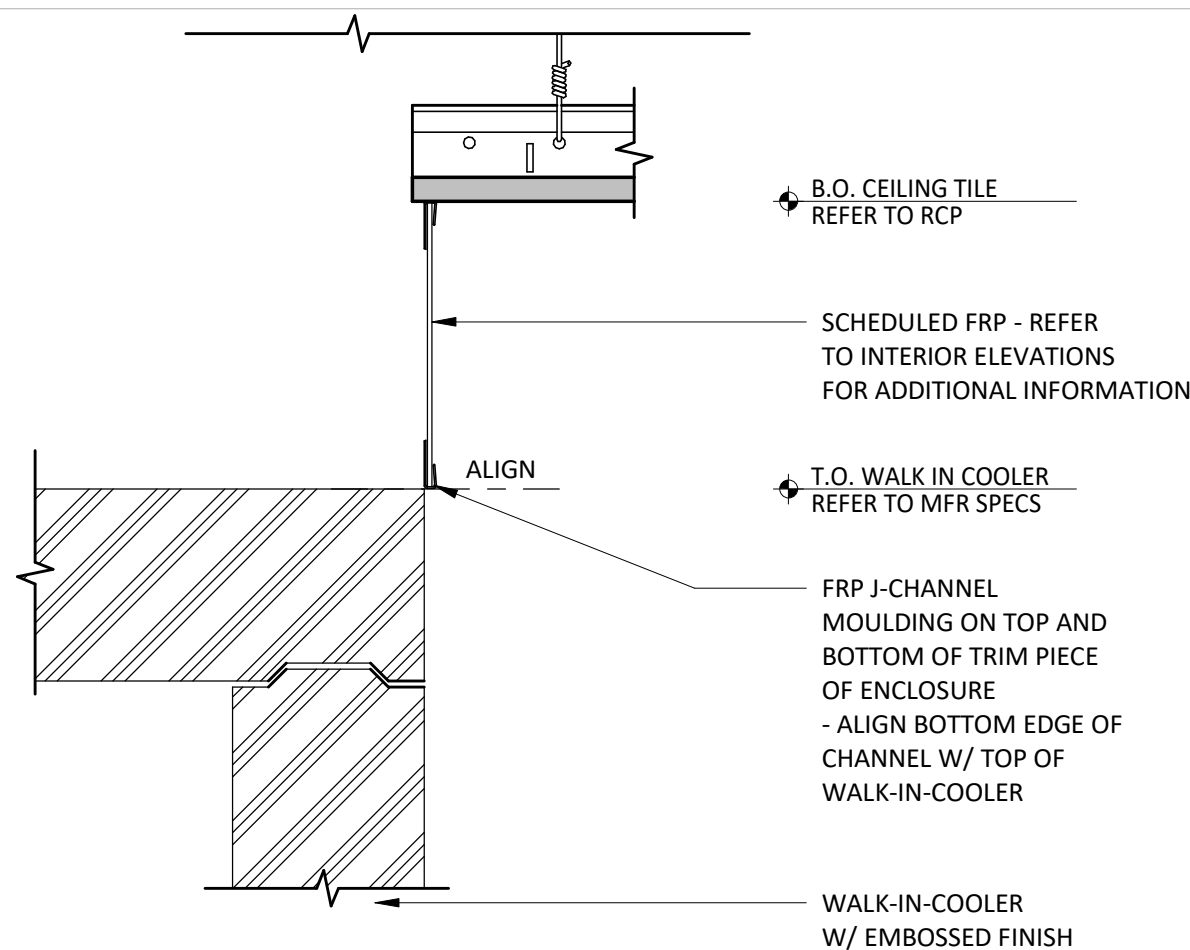

12 KITCHEN CEILING TRANSITION
SCALE: 3" = 1'-0"

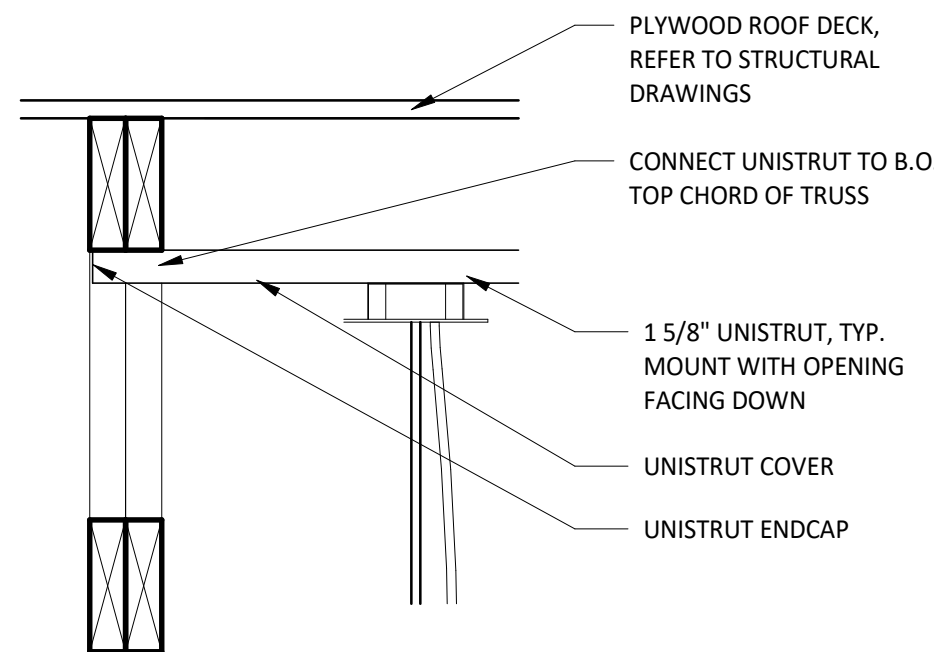

13 TYP. UNISTRUT MOUNTING DETAIL
SCALE: 1 1/2" = 1'-0"




CONSULTANT:
CLIENT:
CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2682
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

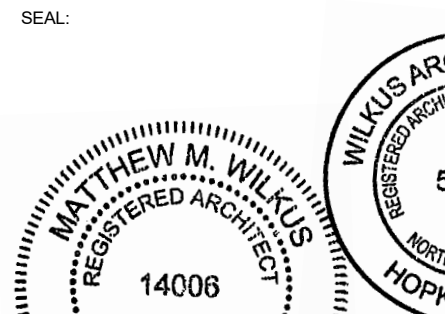

September 04, 2026
MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA


ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES


TITLE:
CEILING DETAILS

SHEET NUMBER:


A210

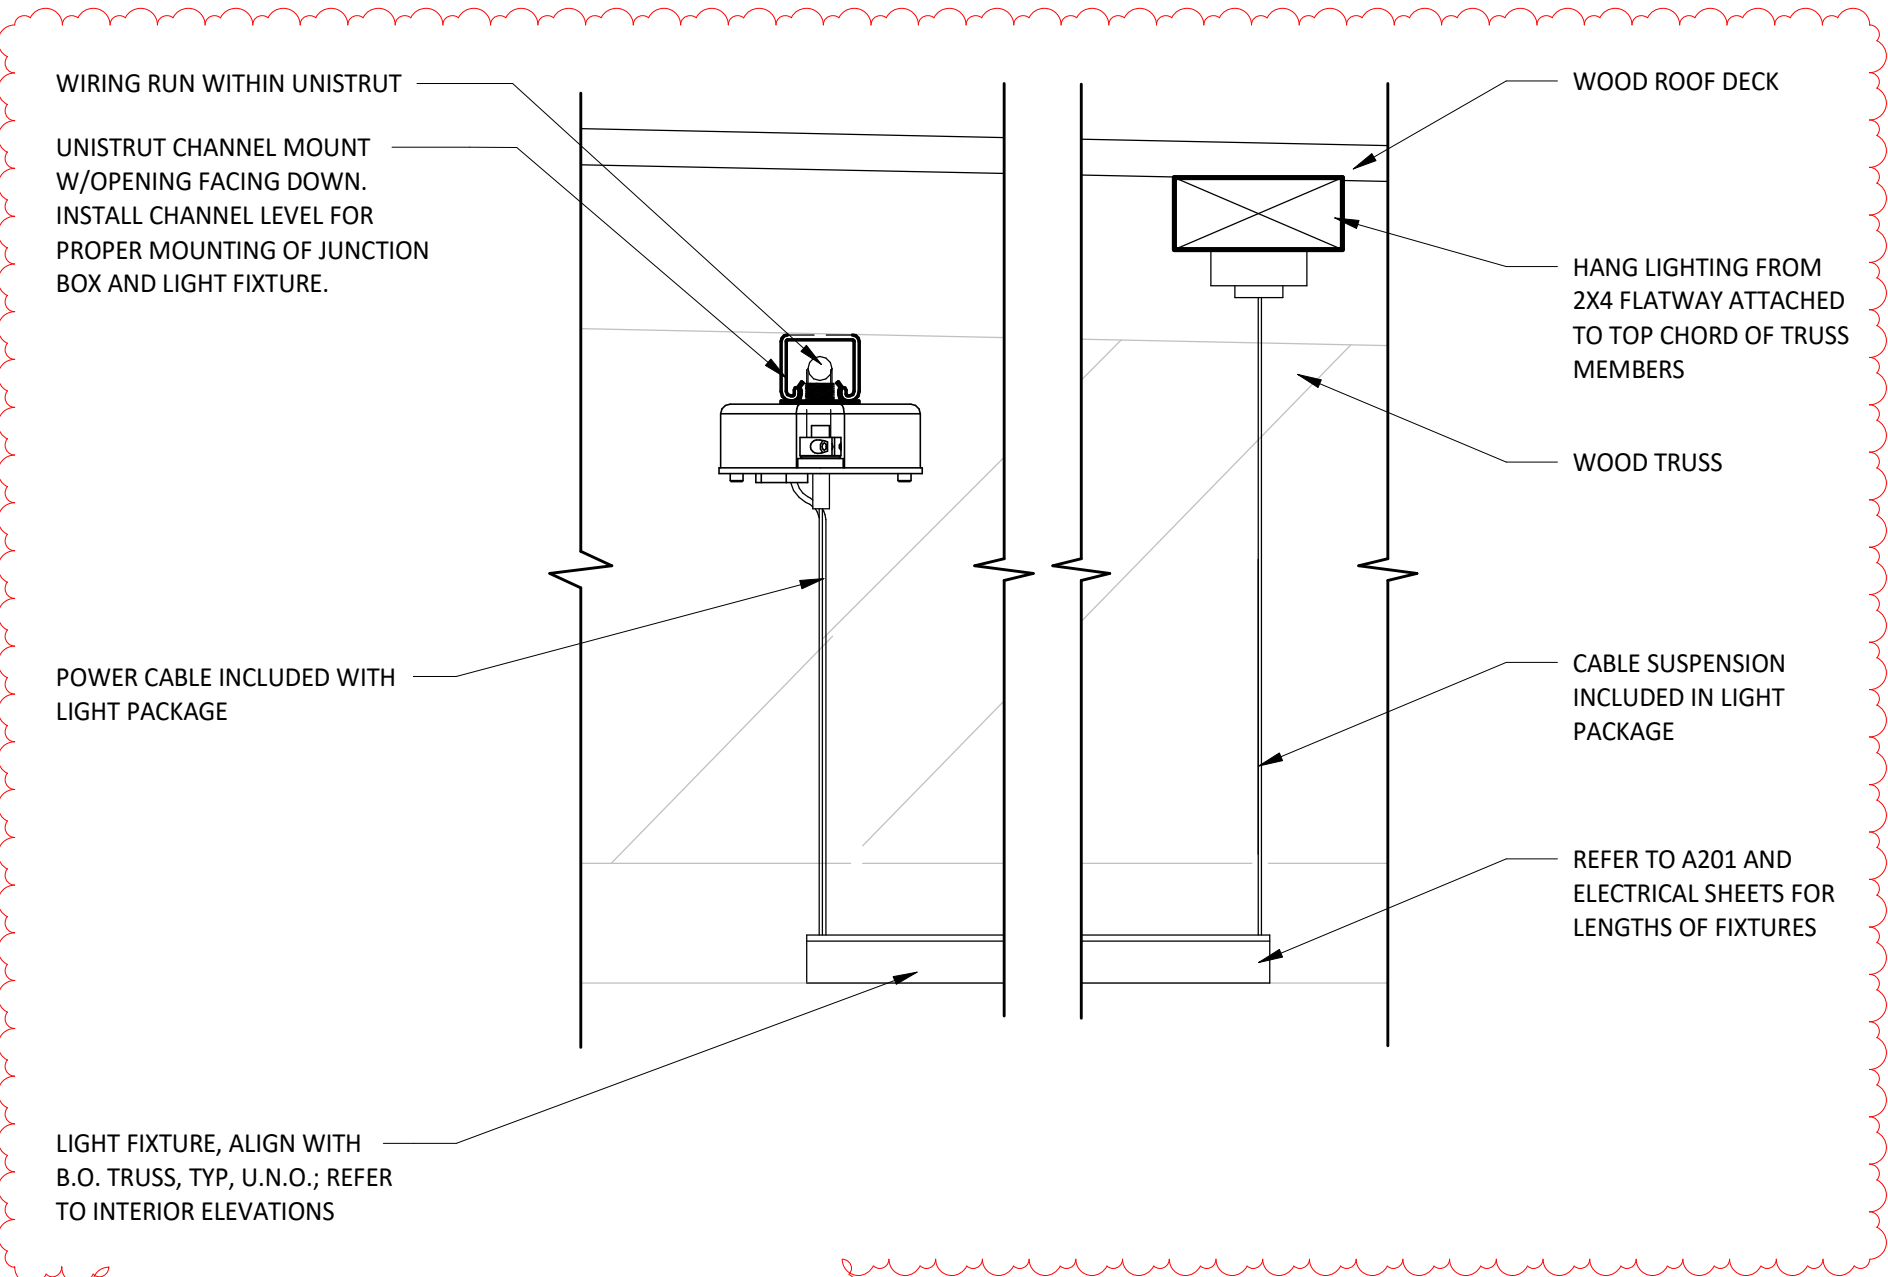


1 INDIRECT DINING LIGHT DETAIL
SCALE: 3" = 1'-0"

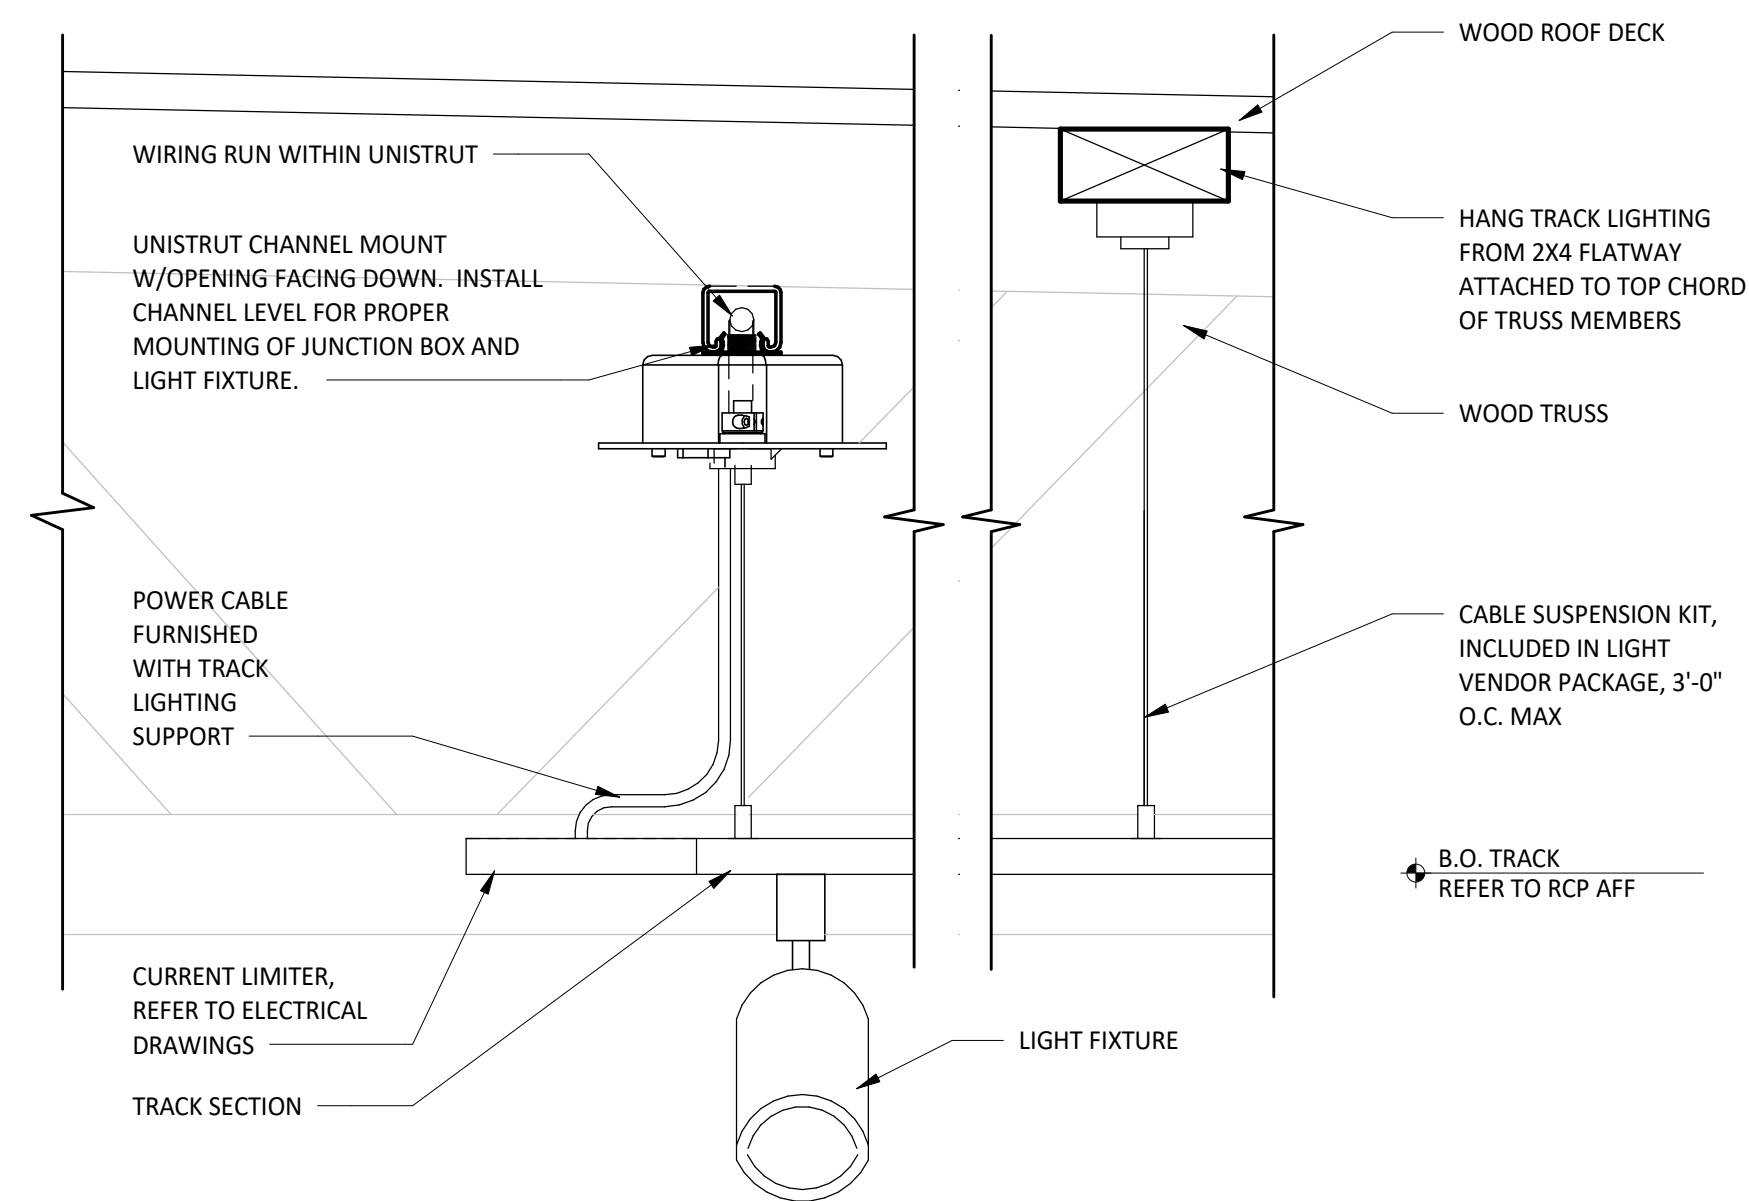

2 SUSPENDED TRACK LIGHT CONNECTION DETAIL
SCALE: 3" = 1'-0"

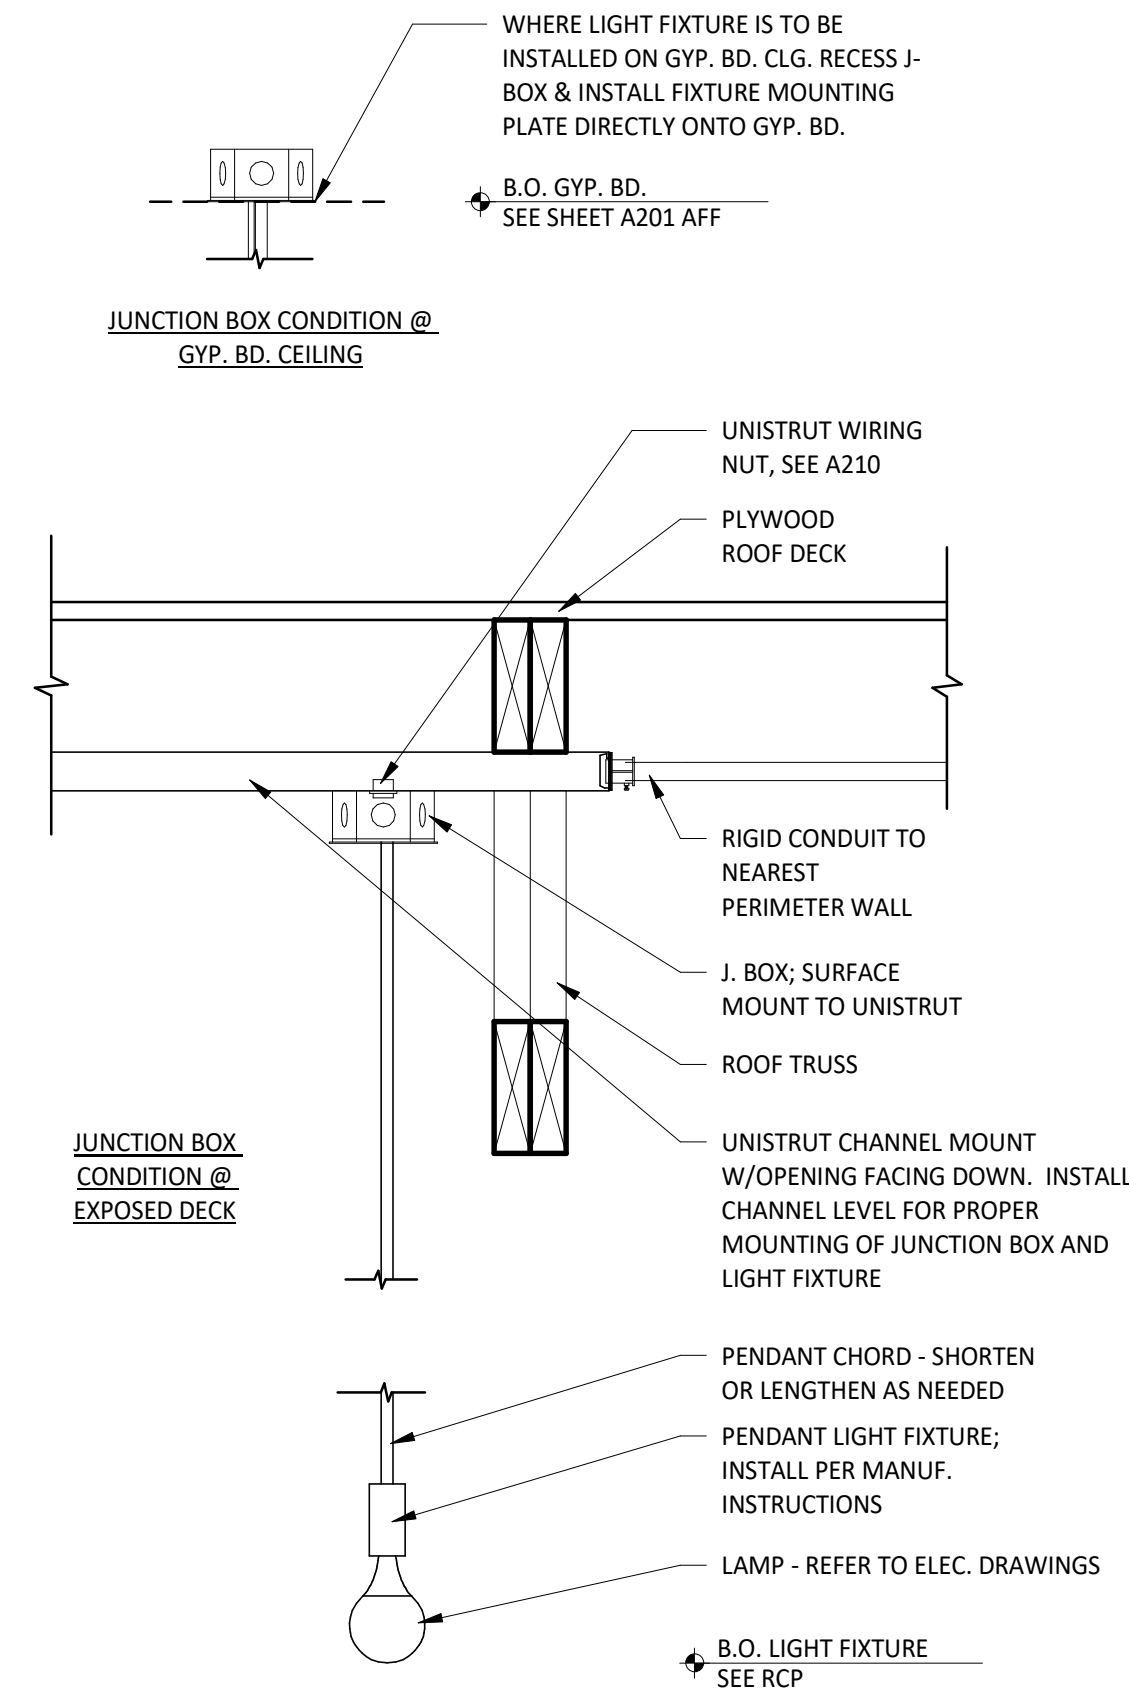

3 PENDANT LIGHT FIXTURE
SCALE: 1 1/2" = 1'-0"

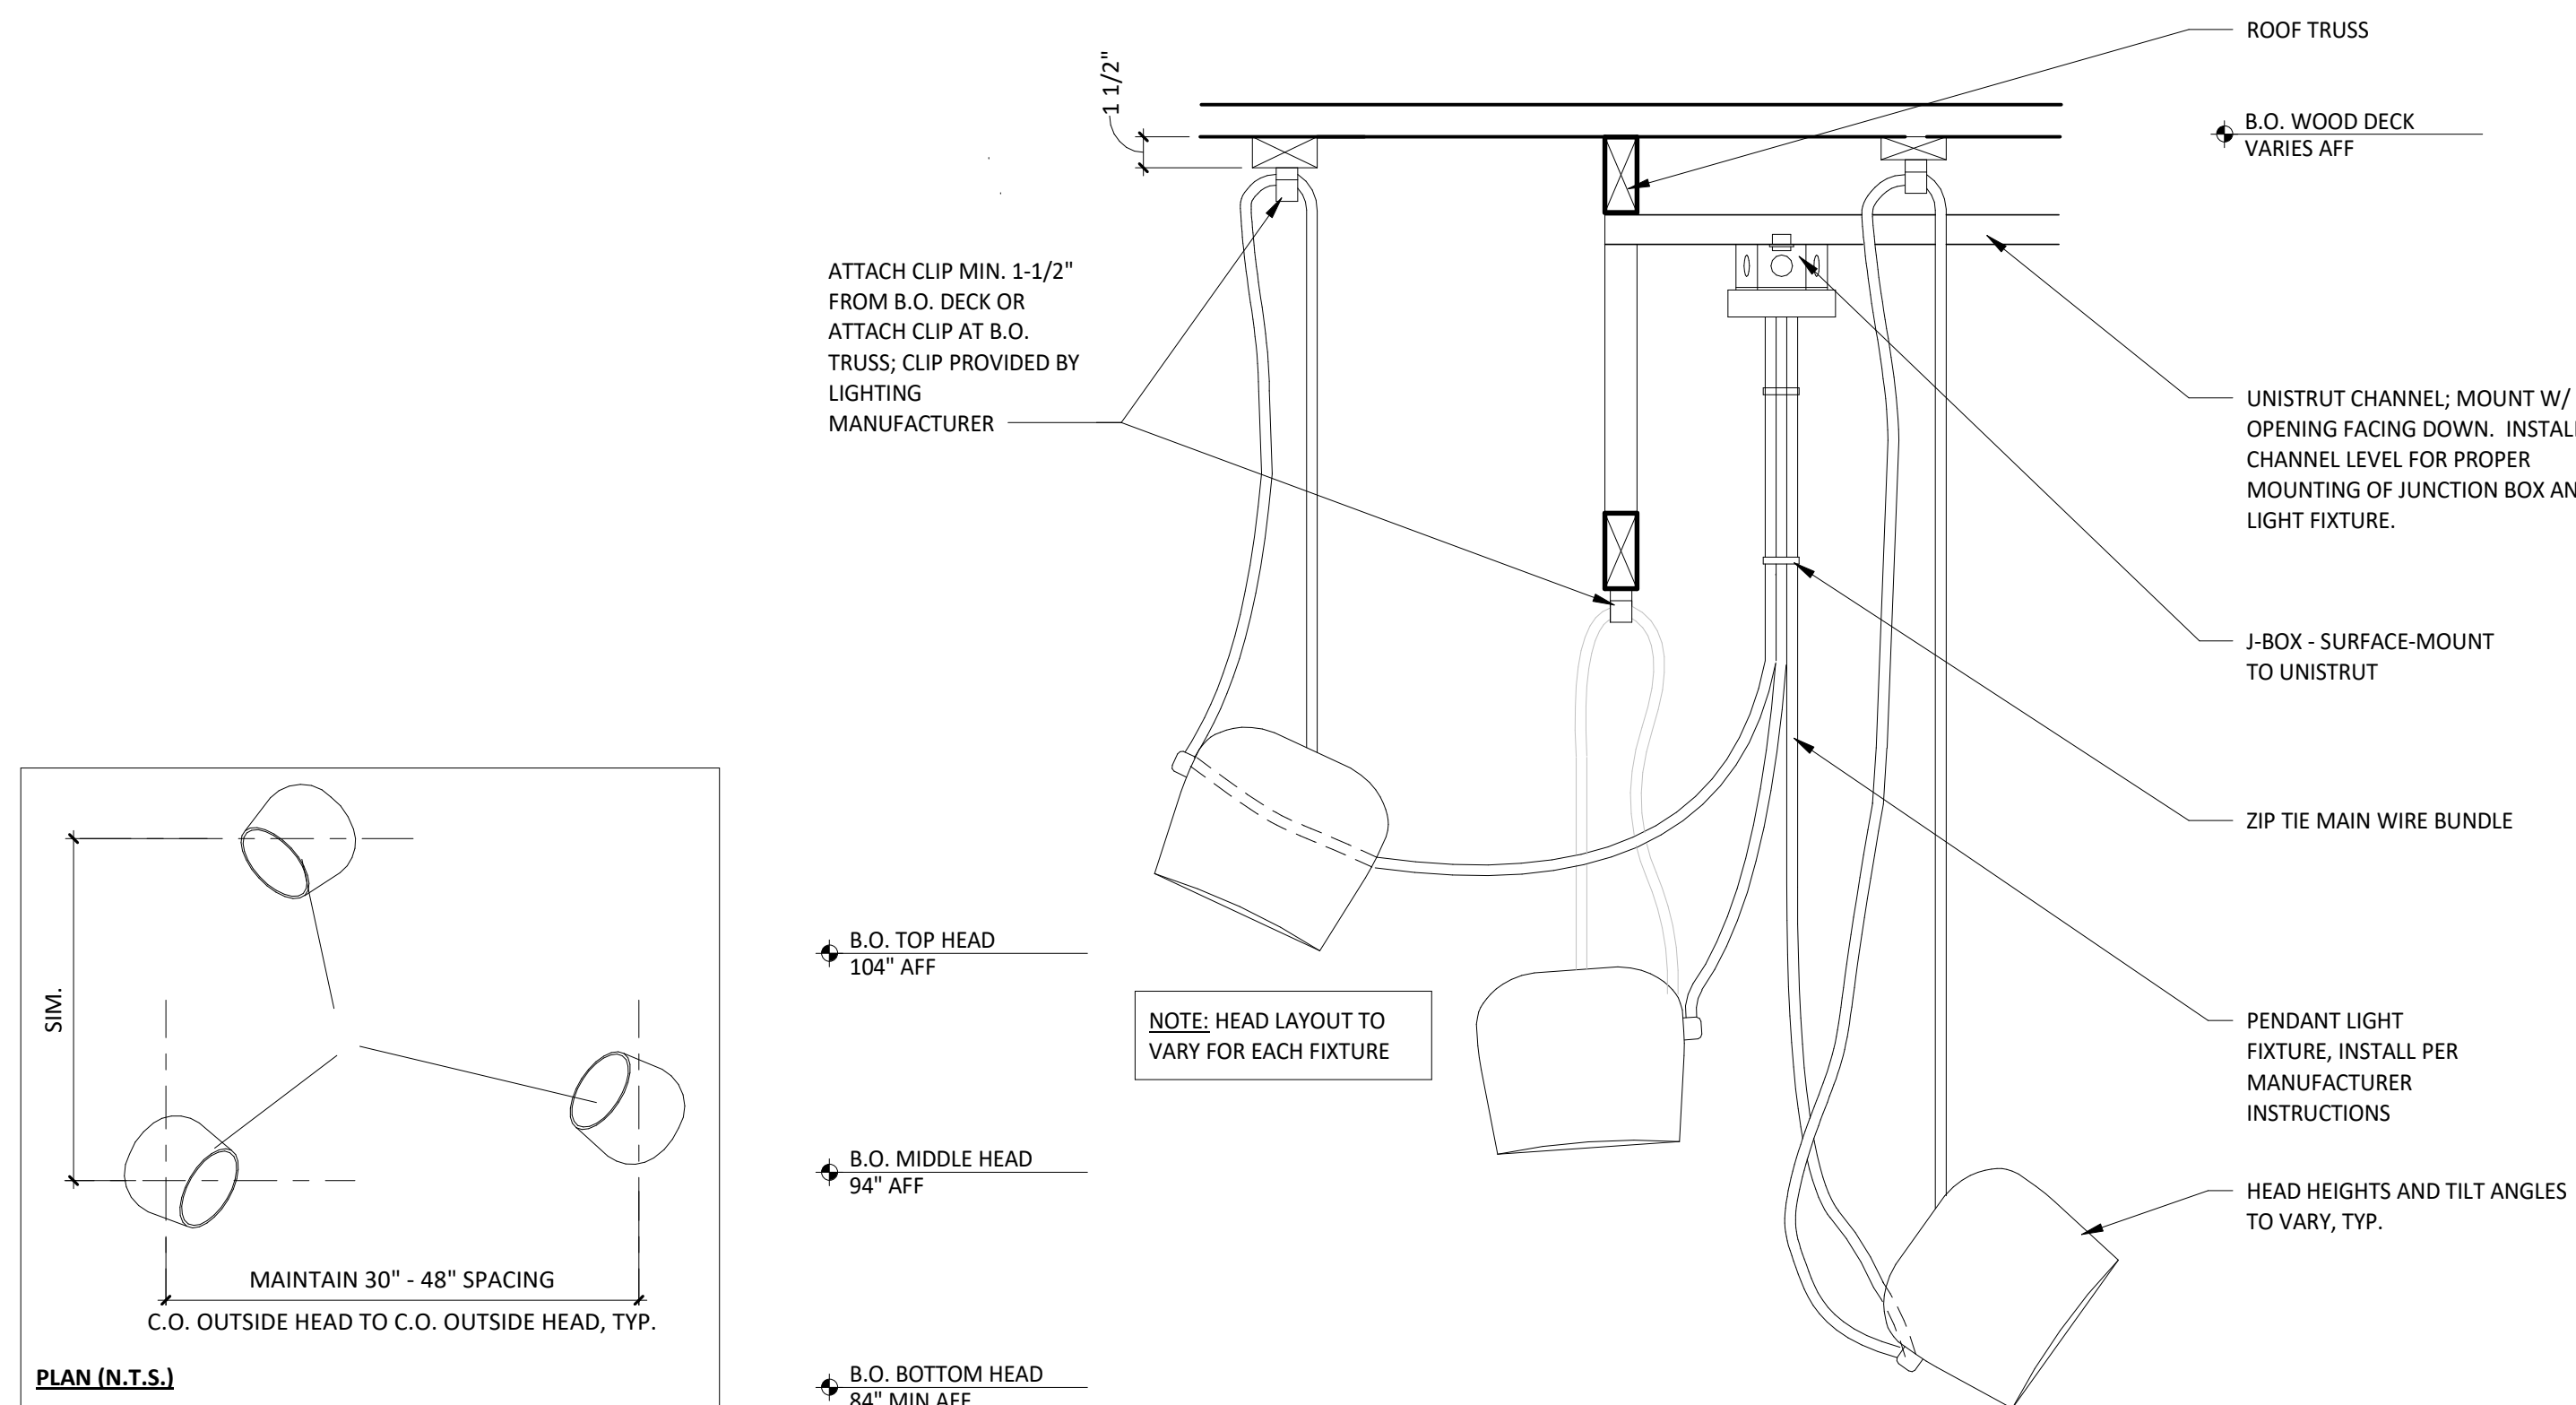

4 PENDANT LIGHT
SCALE: 1 1/2" = 1'-0"



CLIENT:

CHIPOTLE MEXICAN GRILL


CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2026
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

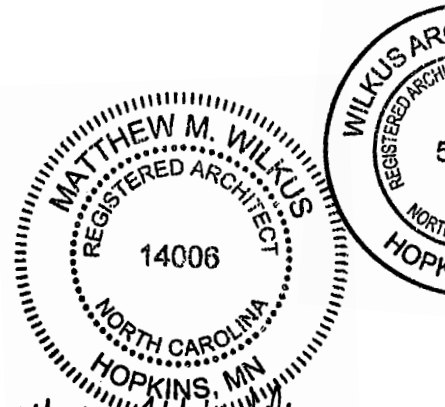

September 04, 2026
MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA


ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES


TITLE:
LIGHTING DETAILS

SHEET NUMBER:


A211

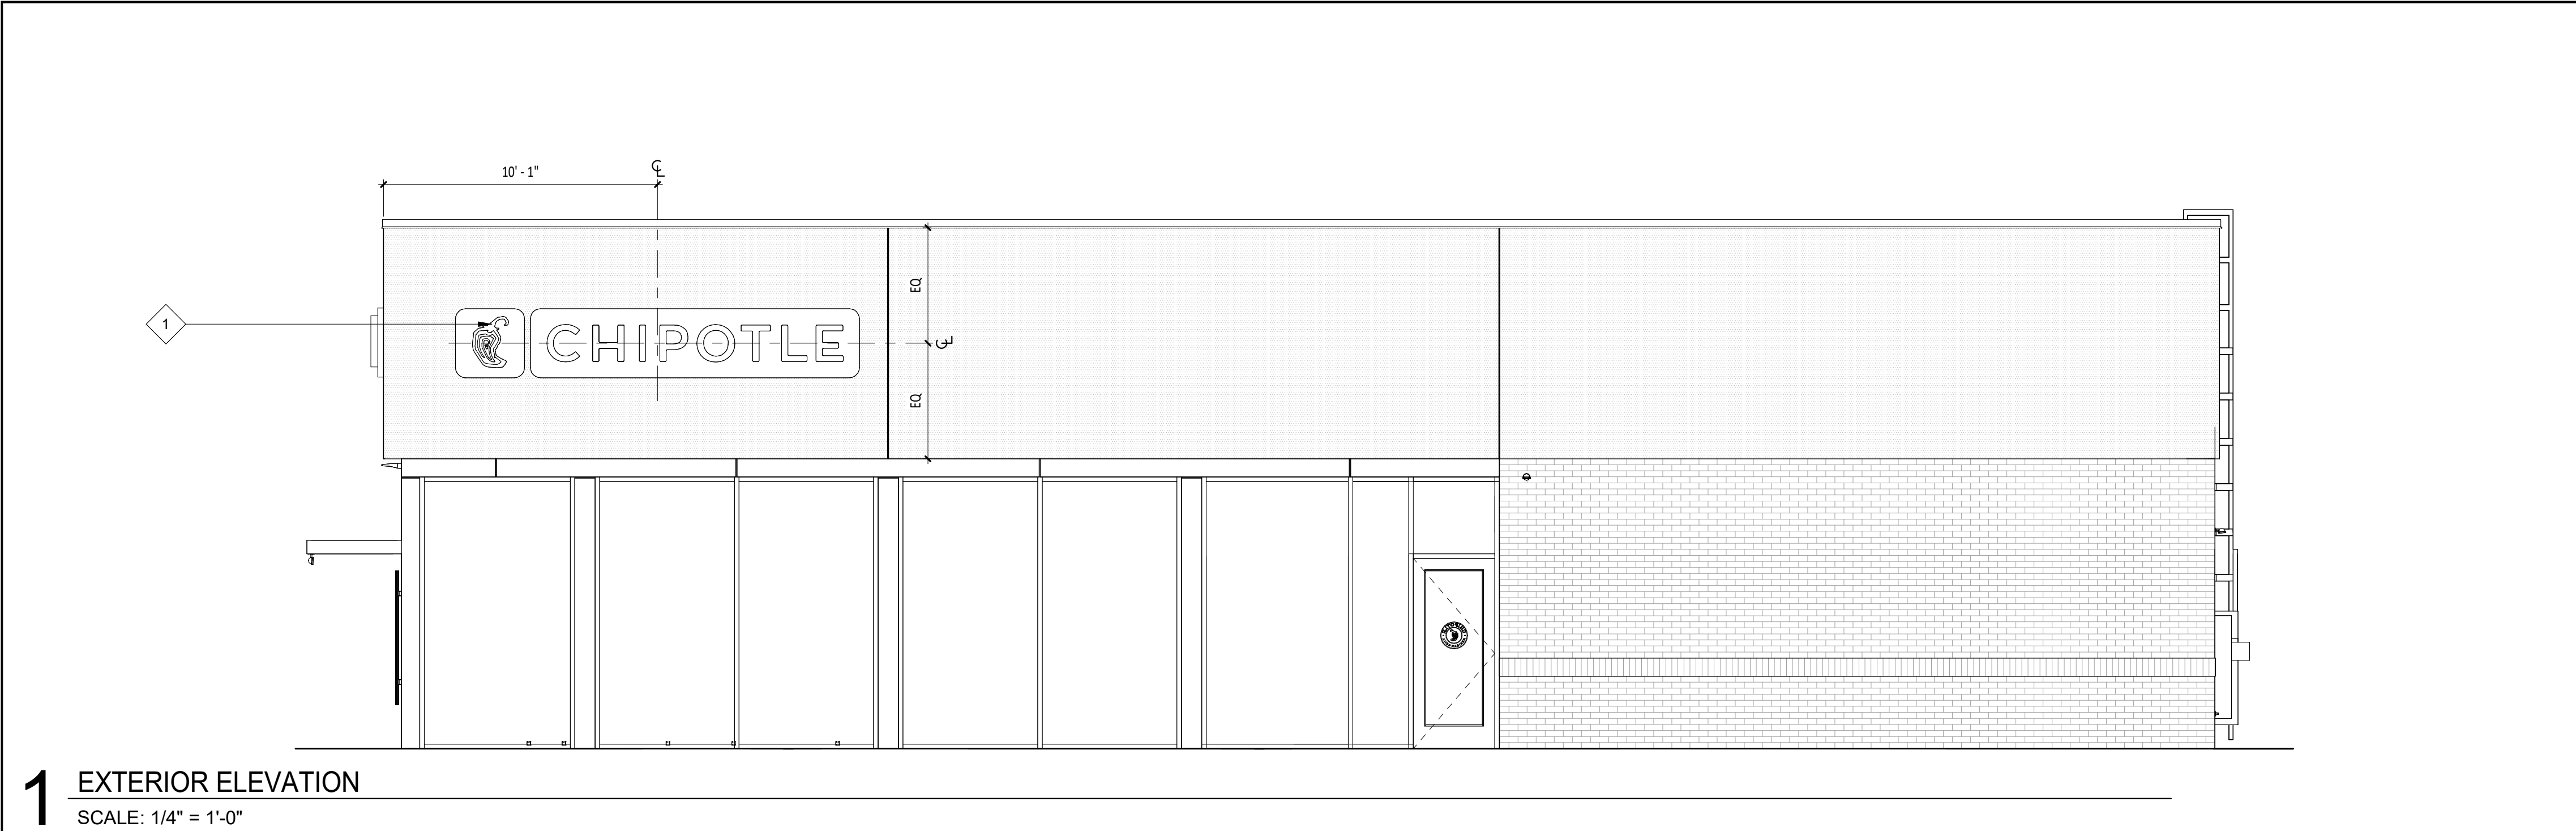


1 EXTERIOR ELEVATION
SCALE: 1/4" = 1'-0"

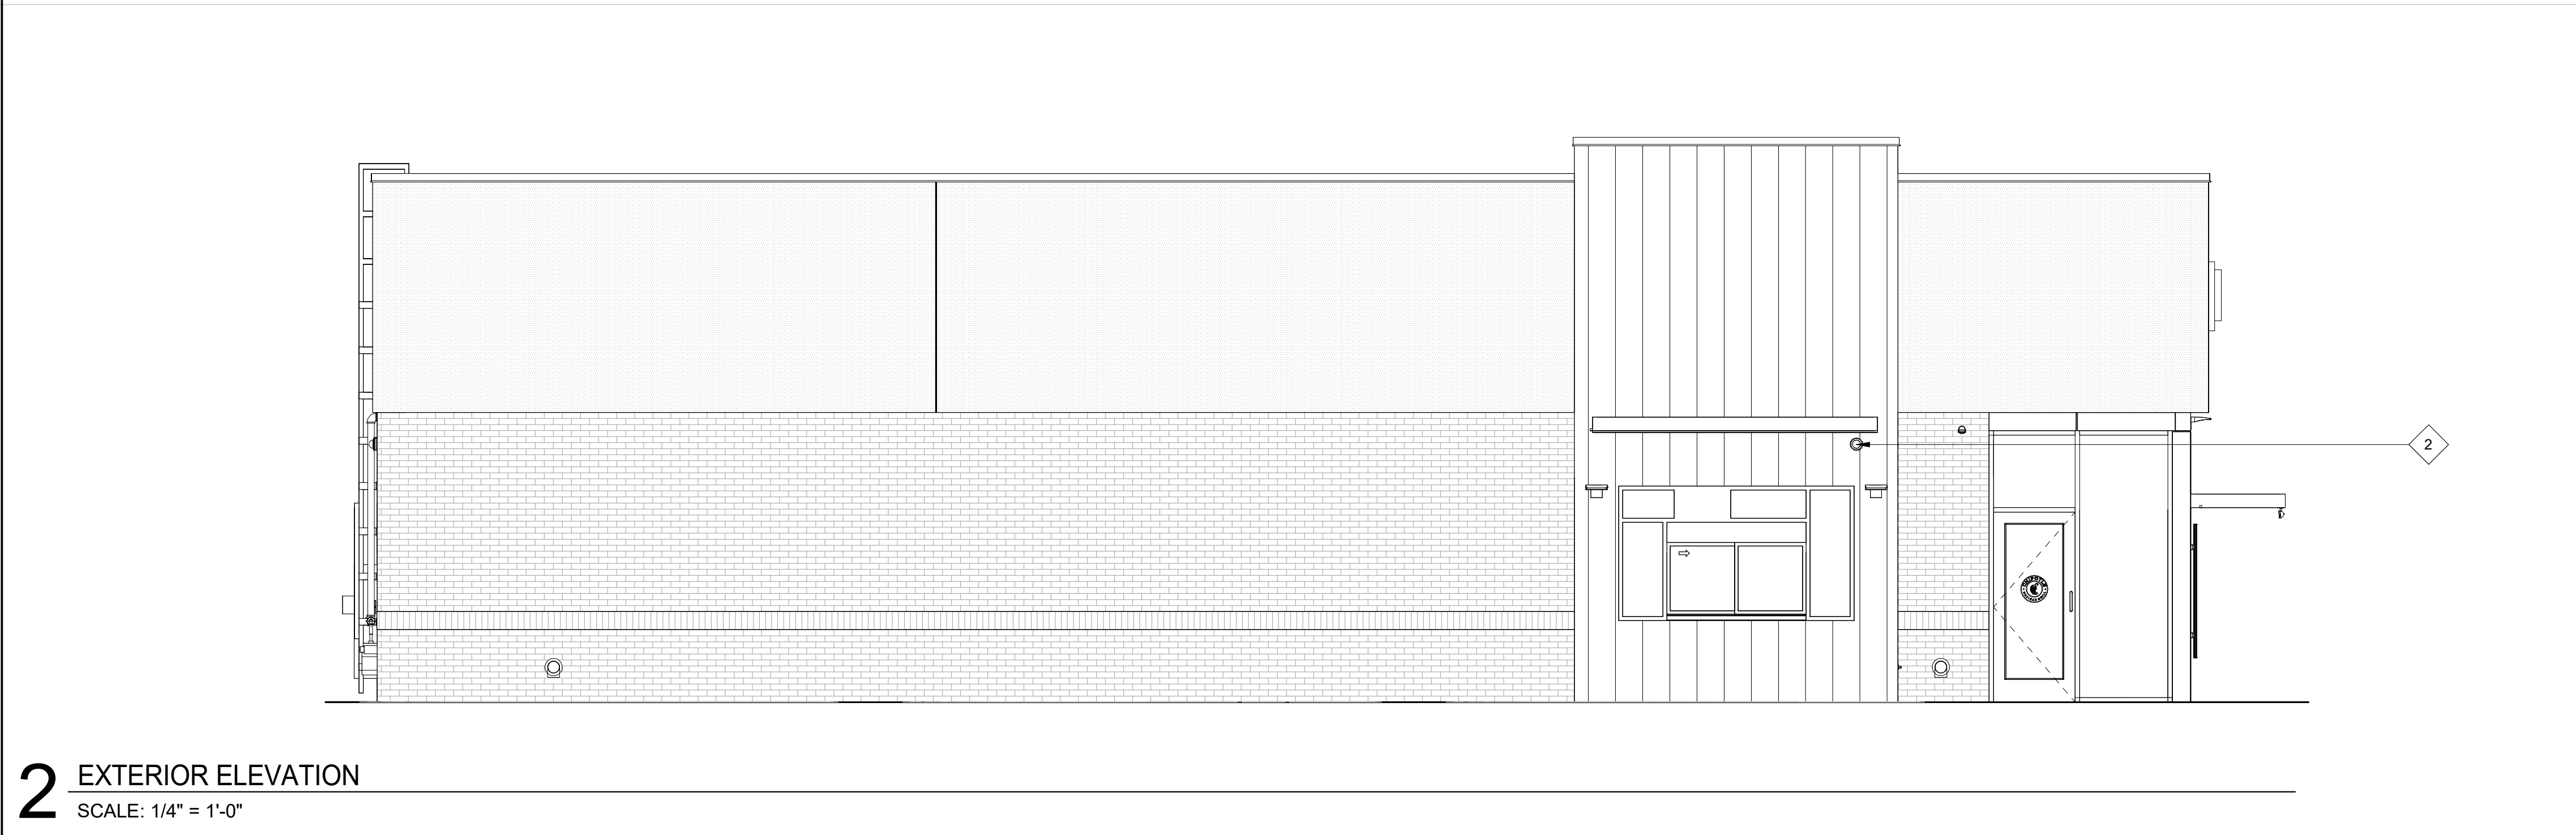

2 EXTERIOR ELEVATION
SCALE: 1/4" = 1'-0"

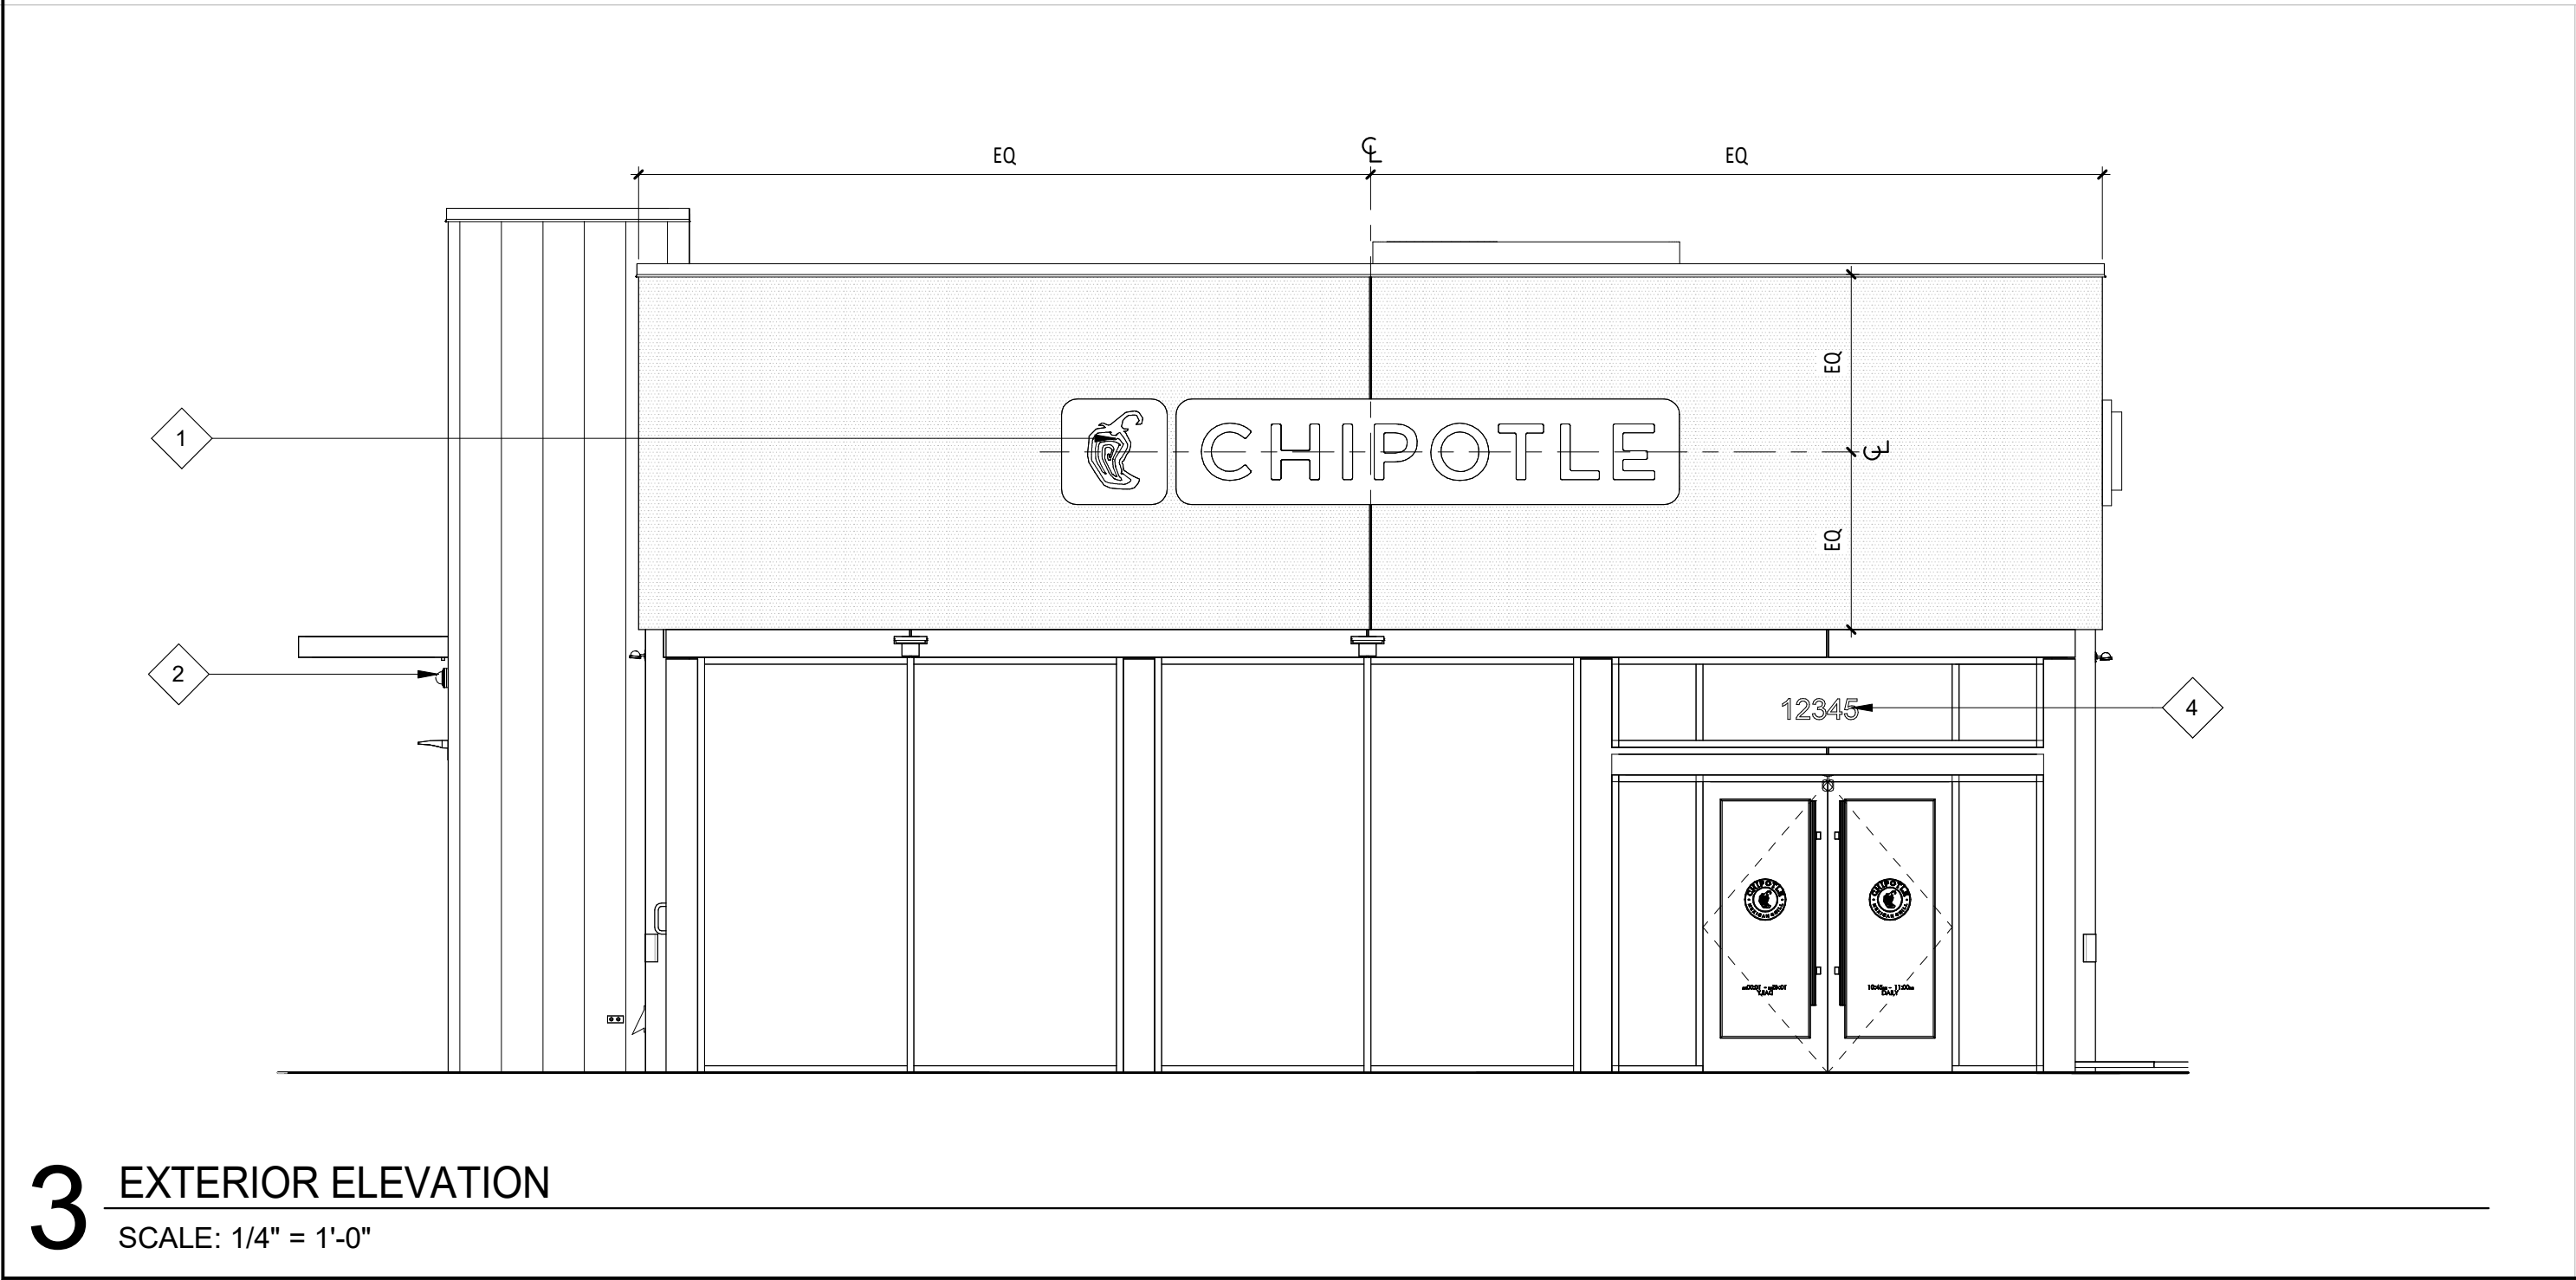

3 EXTERIOR ELEVATION
SCALE: 1/4" = 1'-0"

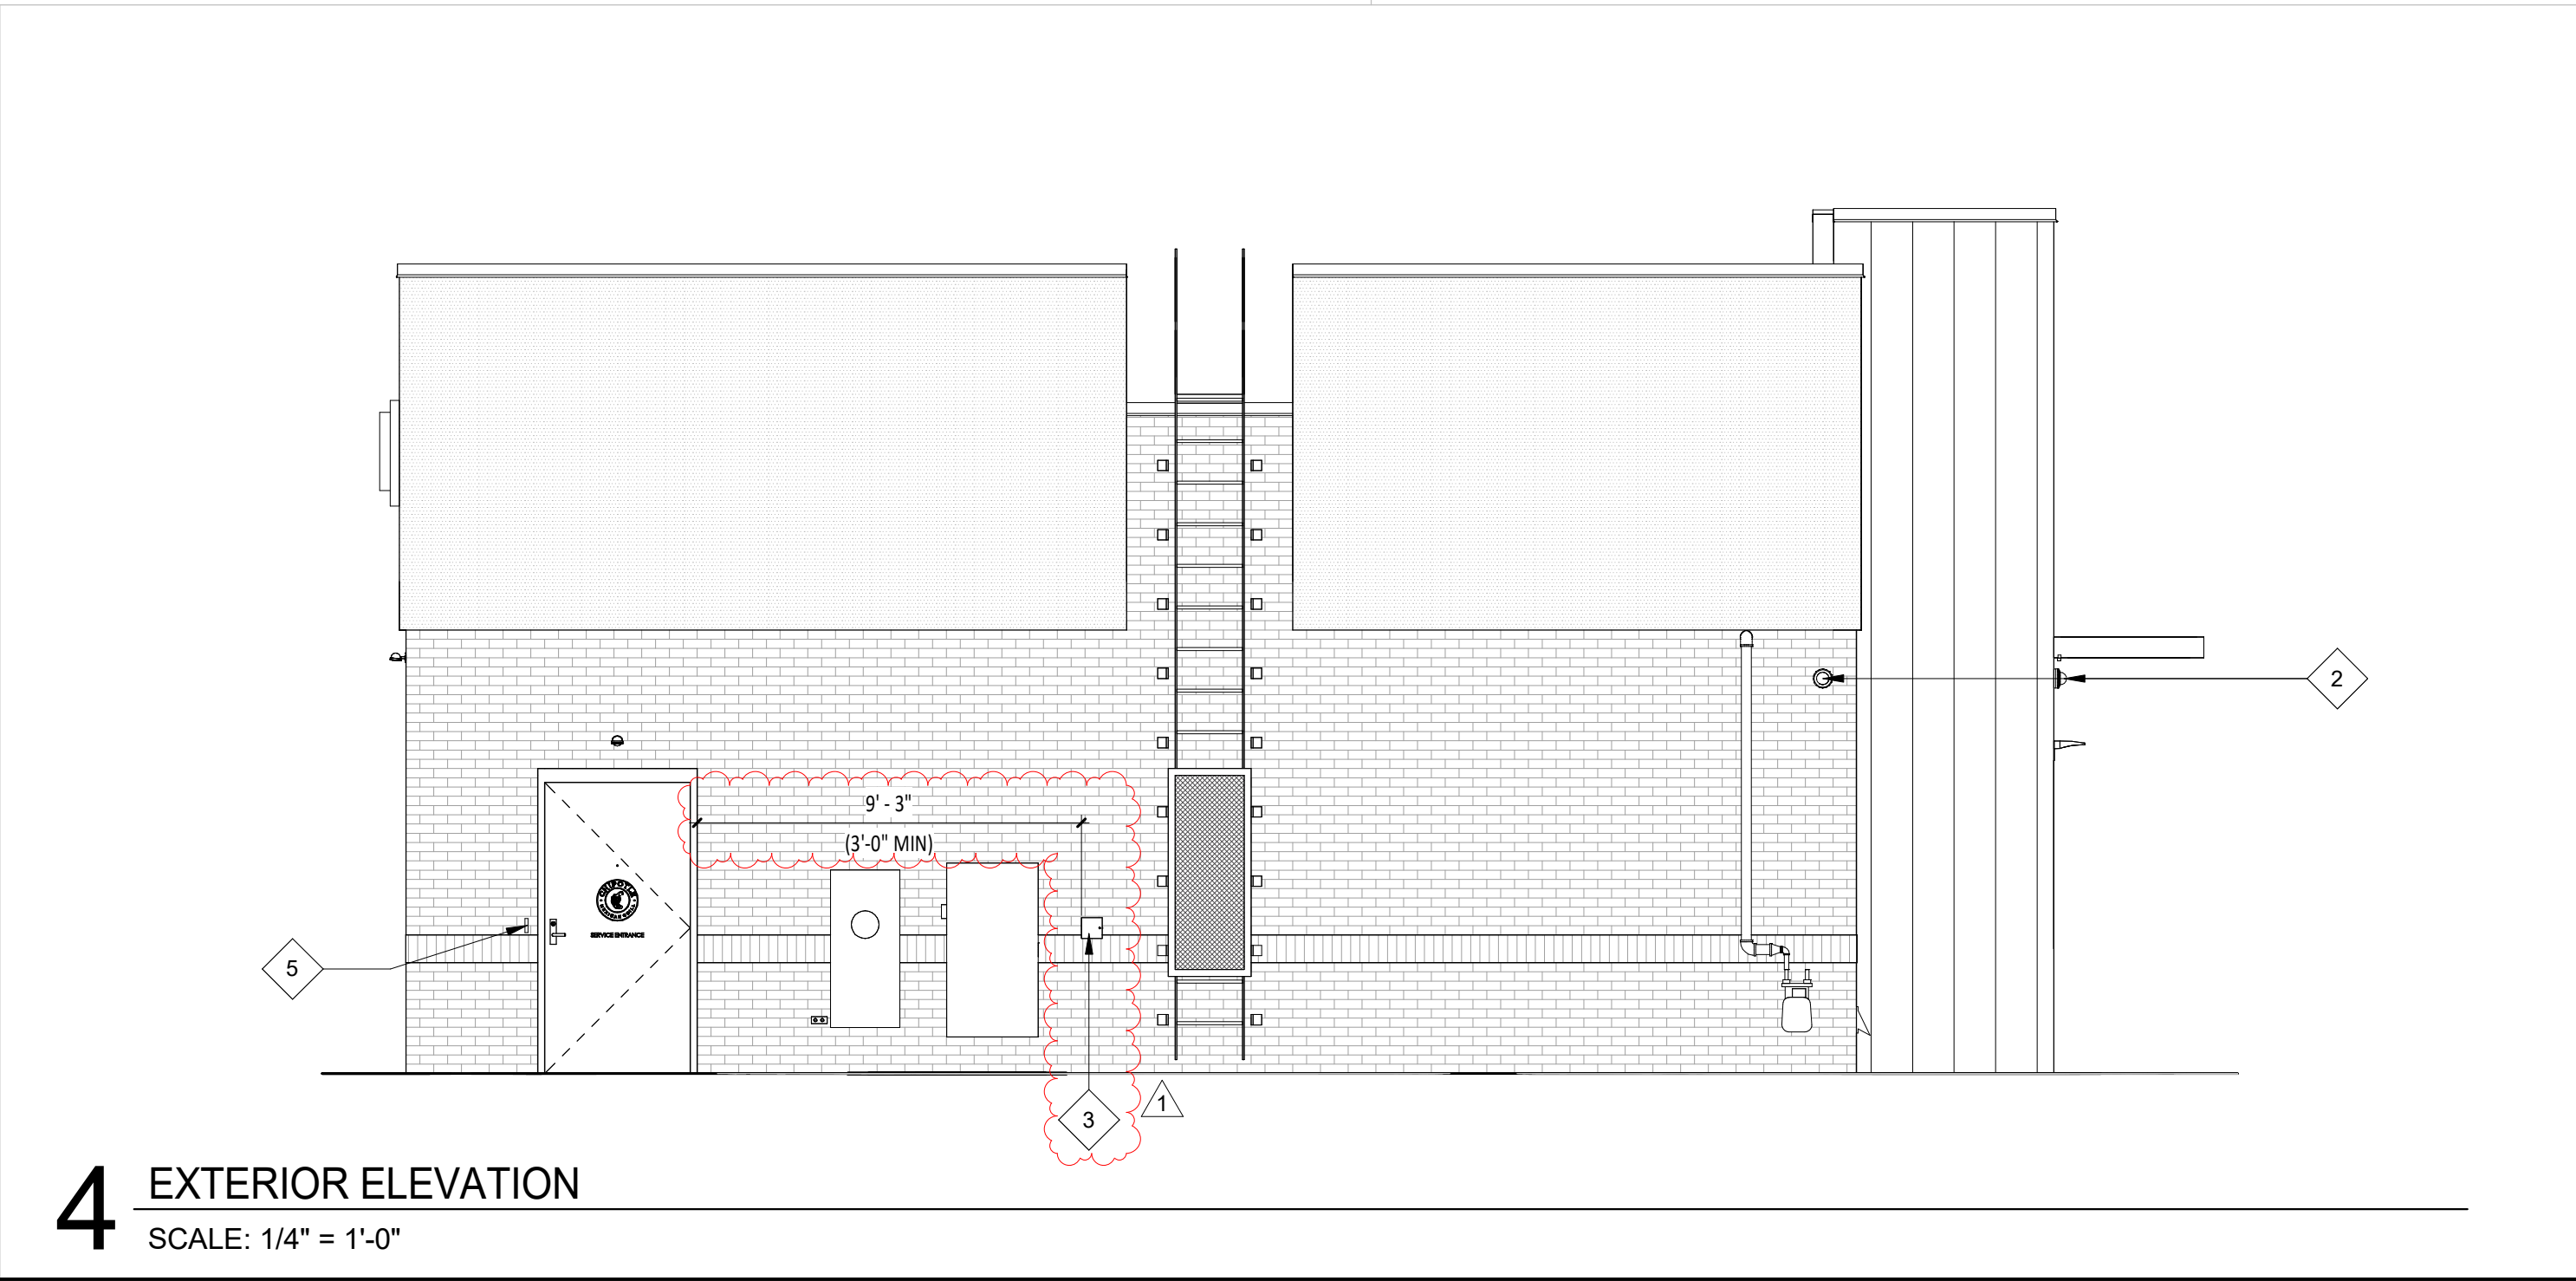

4 EXTERIOR ELEVATION
SCALE: 1/4" = 1'-0"

GENERAL NOTES - EXT. ELEV.

A. SIGNAGE IS SHOWN ONLY FOR PLACEMENT AND SCALE. ALL SIGNAGE FOR REVIEW UNDER SEPARATE PERMIT, NOT PART OF THIS PERMIT SET.

B. EXTERIOR SIGNAGE PROVIDED BY TSV AND INSTALLED BY TSV. GC TO MAKE FINAL CONNECTION.

KEYNOTE LEGEND

1	LOCATION OF TENANT'S B-3 SIGNAGE - GENERAL CONTRACTOR TO COORDINATE BLOCKING REQUIREMENTS WITH SIGNAGE VENDOR.
2	LOCATION OF SECURITY CAMERAS TO BE INSTALLED BY GENERAL CONTRACTOR.
3	LOCATION OF REMOTE CO2 FILLER - INSTALL BETWEEN 36" AND 48" ABOVE FINISHED GRADE - MINIMUM 3' - 0" FROM REAR ACCESS DOOR - VERIFY LOCATION WITH CHIPOTLE CONSTRUCTION MANAGER.
4	6" VINYL ADDRESS LETTERS - COORDINATE ADOPTED REQUIREMENTS ON SIZE AND LOCATION WITH LOCAL JURISDICTION.
5	LOCATION OF DOOR BELL - INSTALL BETWEEN 36" AND 48" ABOVE FINISHED GRADE.

CONSULTANT:

WILKUS ARCHITECTS

CLIENT:

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

MATTHEW M. WILKUS
REGISTERED ARCHITECT
14006
NORTH CAROLINA
HOPKINS, MN

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:


03/07/2025	PERMIT SET
05/29/2025	BID SET

REVISIONS:


1	08/21/2026	BA1 - FINISH UPDATES
---	------------	----------------------

TITLE:
EXTERIOR ELEVATIONS

SHEET NUMBER:
A301

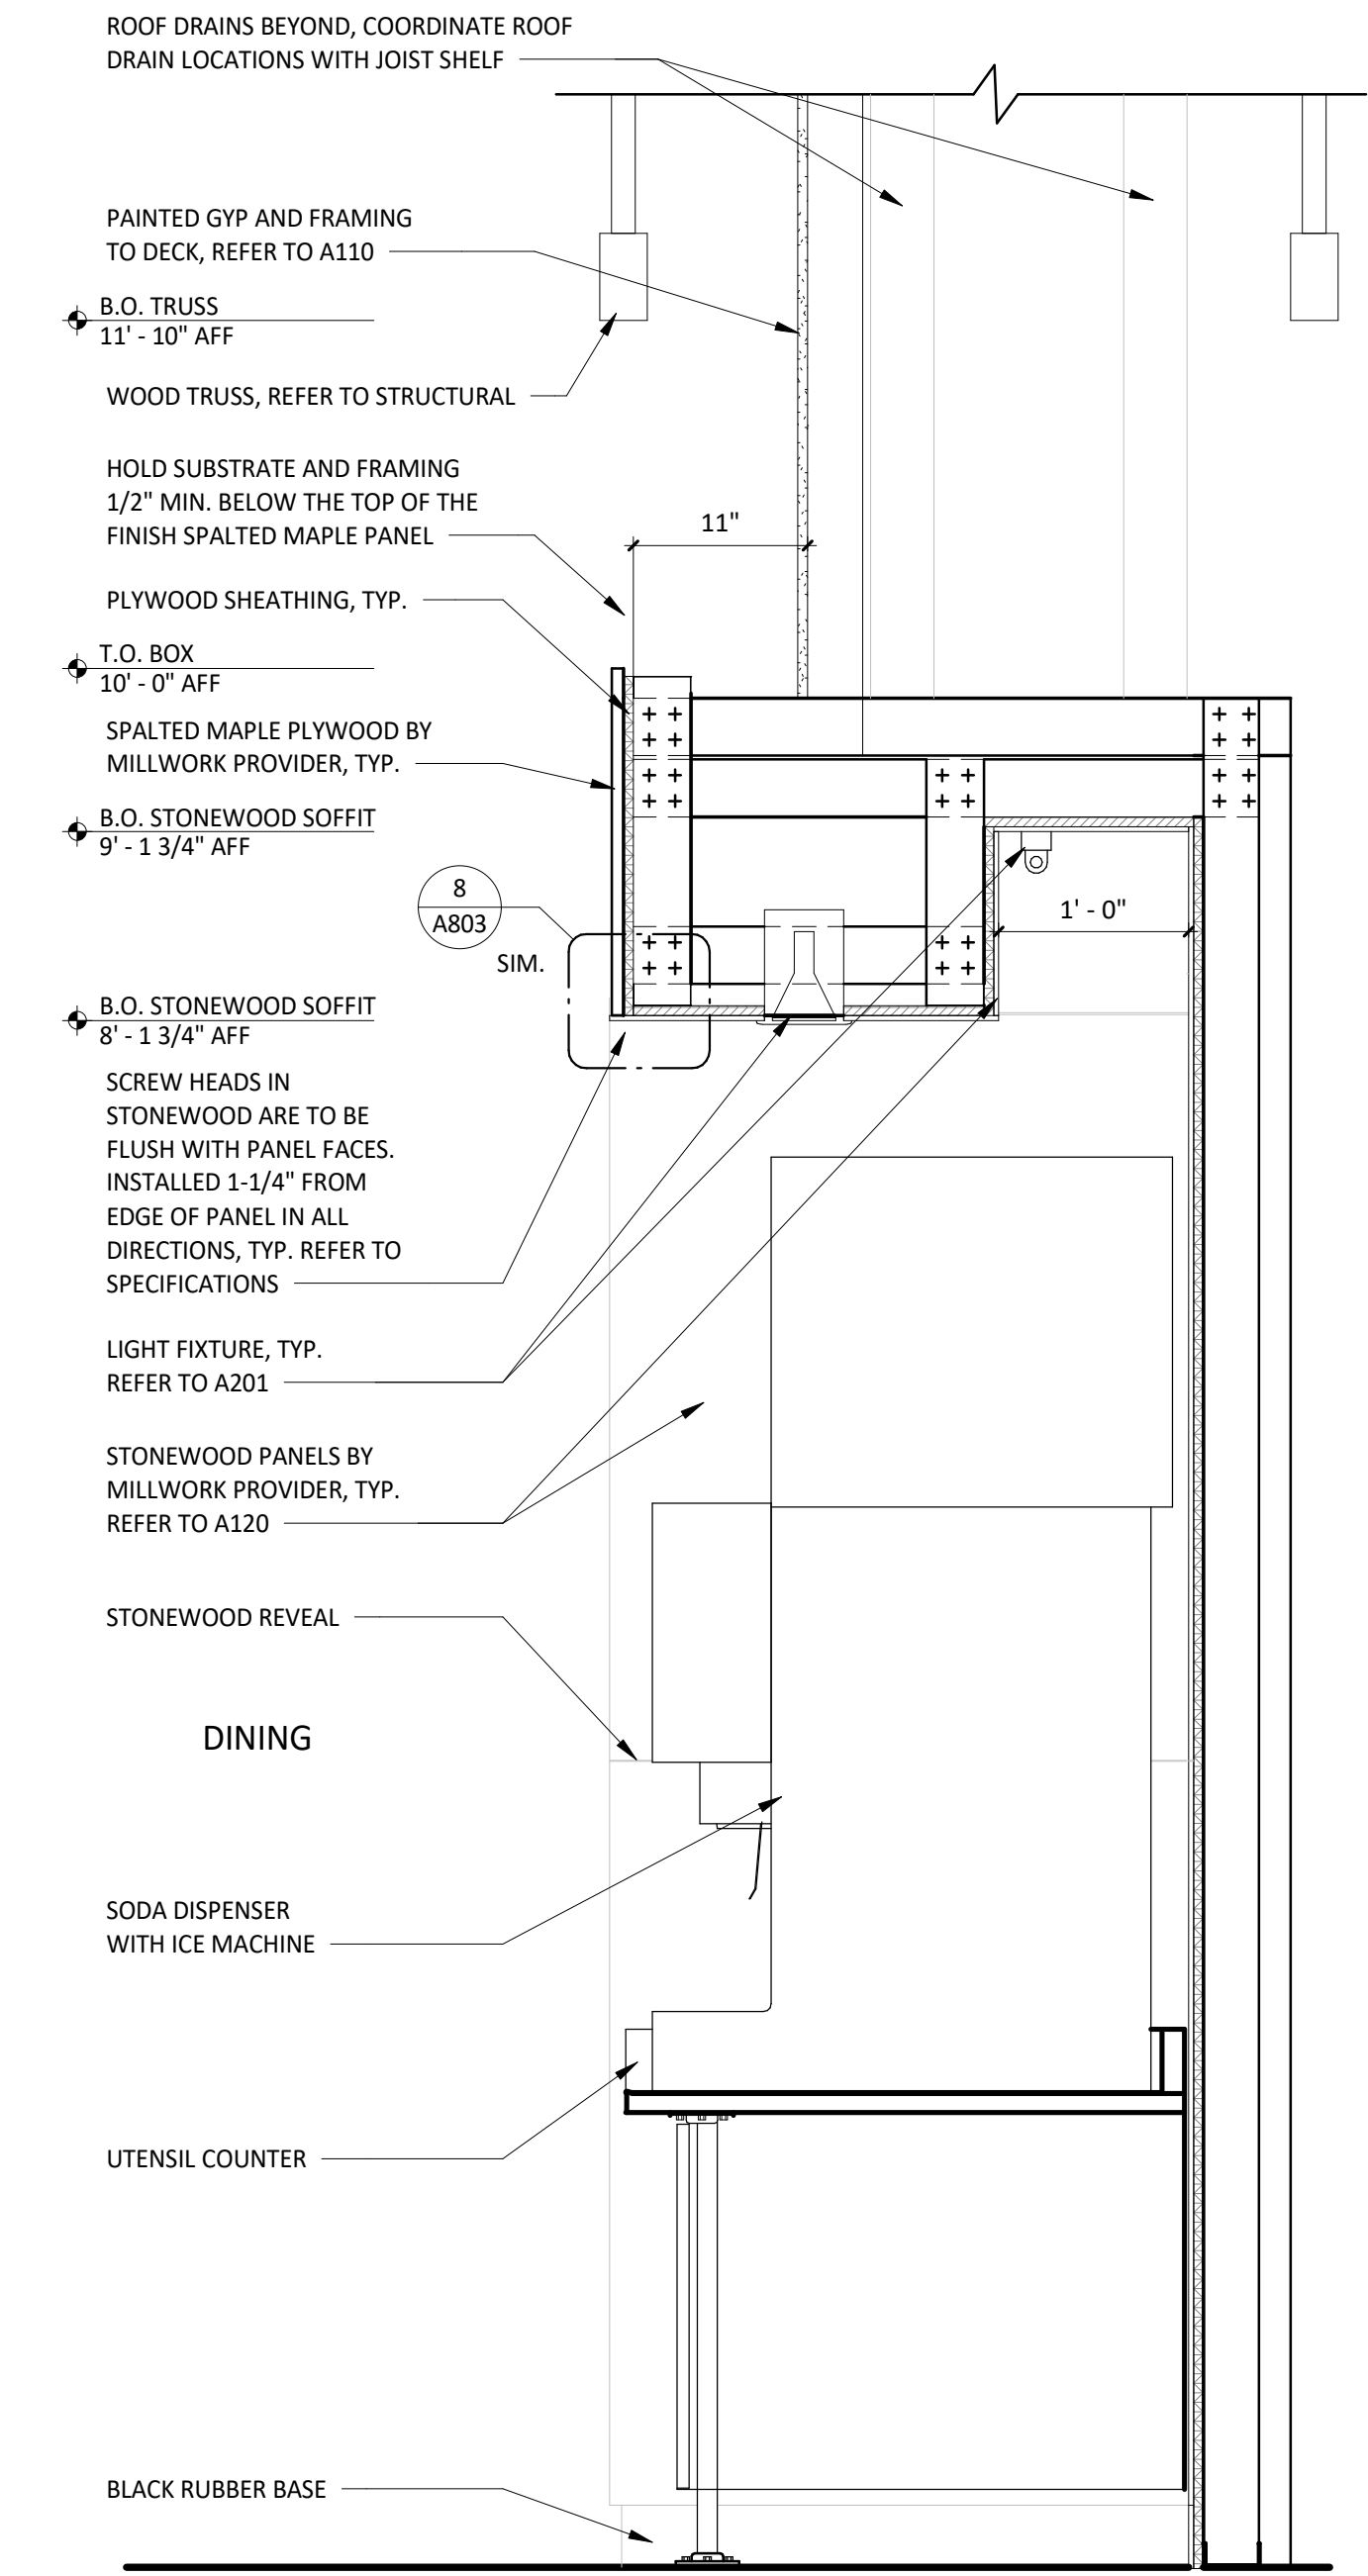

1 UTENSIL SECTION
SCALE: 1" = 1'-0"

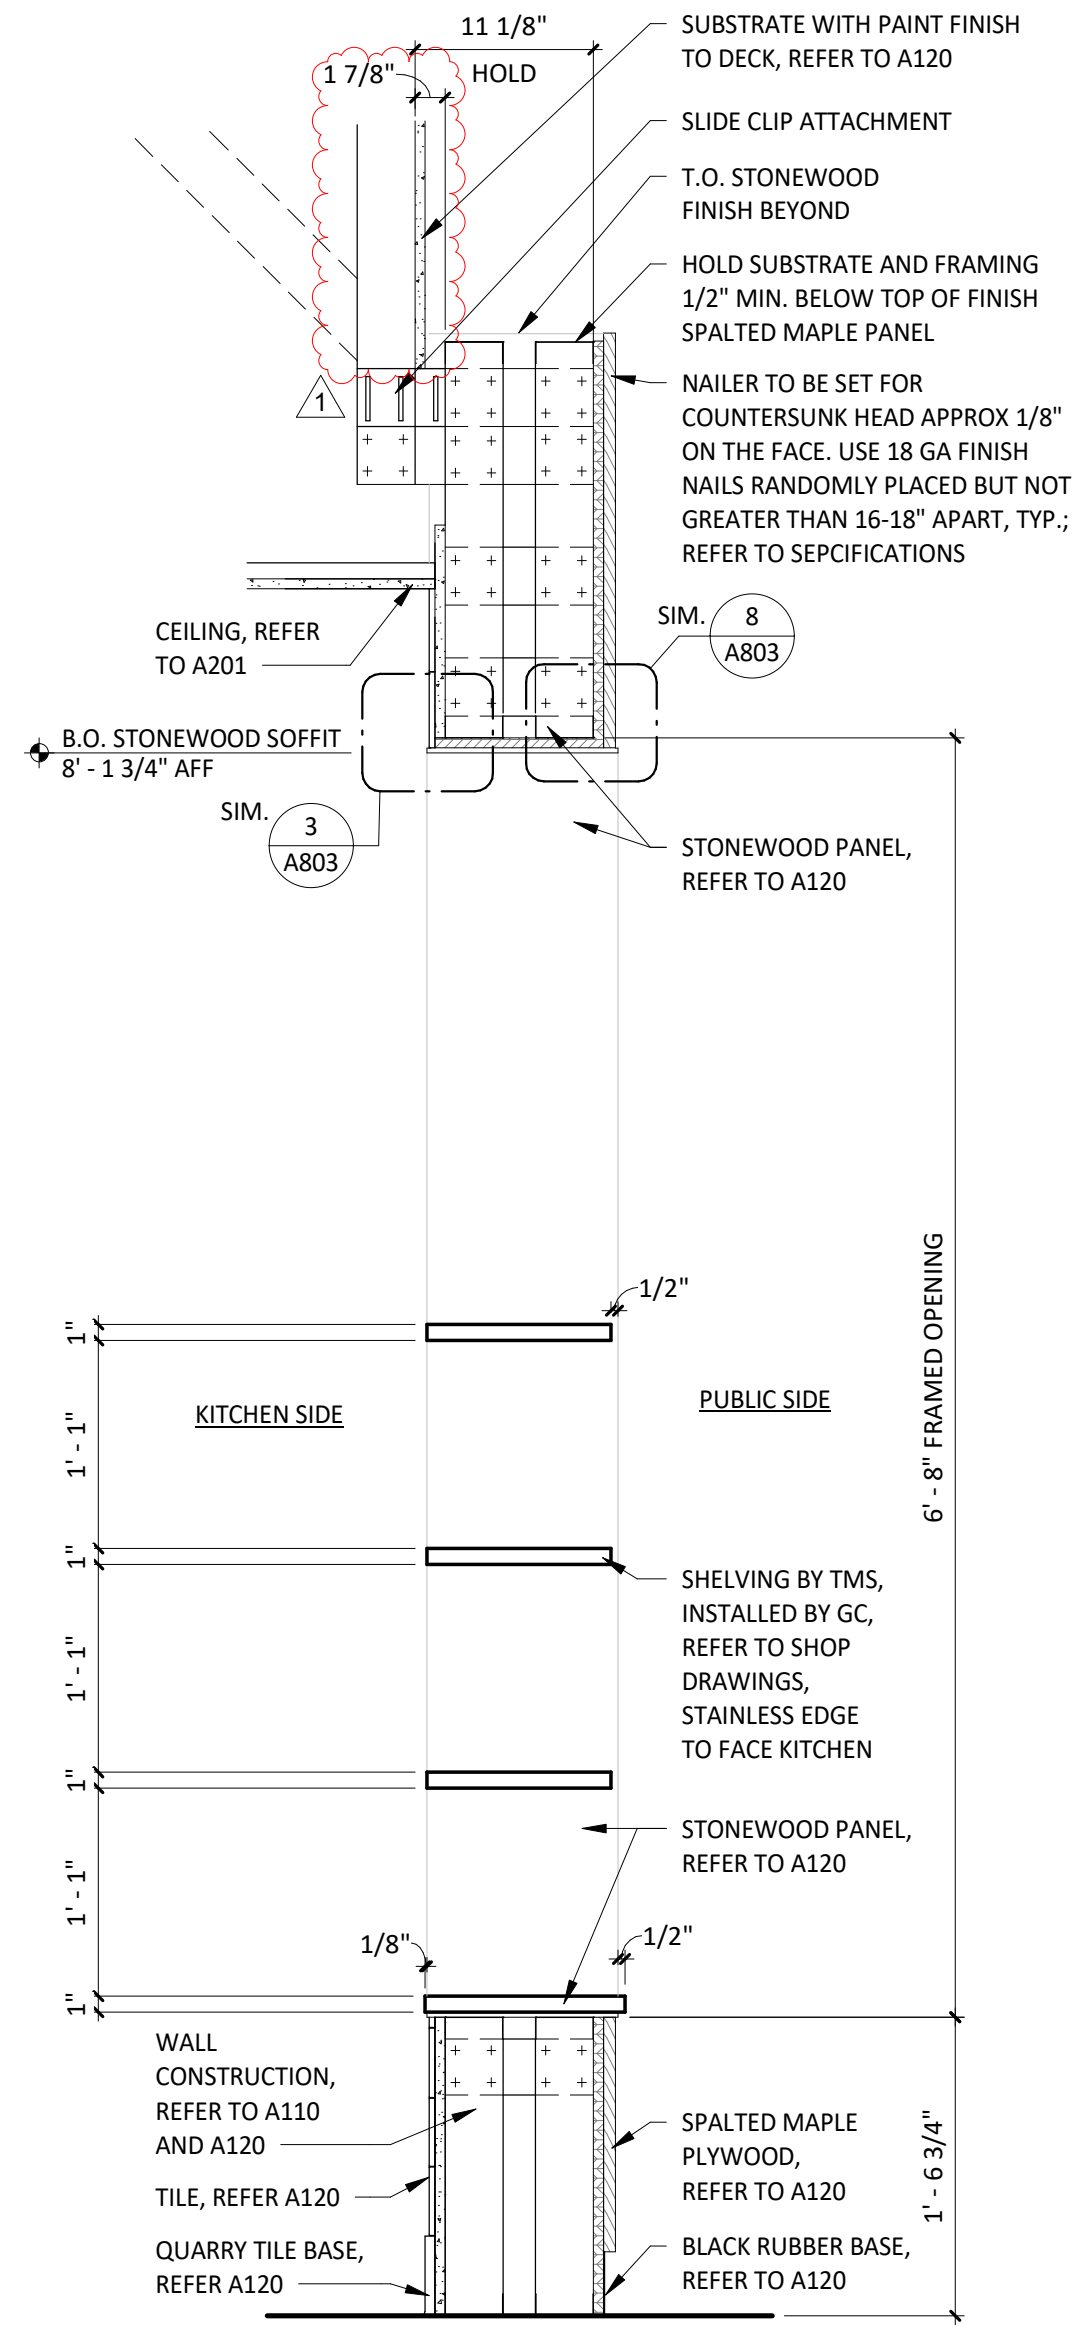

2 MOPUS SECTION - PASS THRU
SCALE: 1" = 1'-0"




COPYRIGHT 2026
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

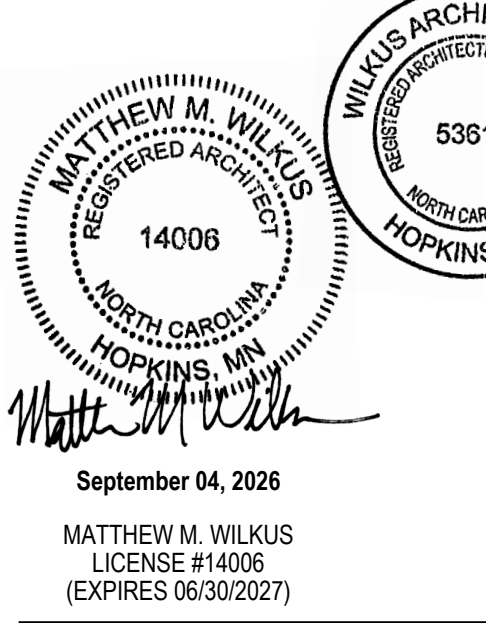

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES

TITLE:
INTERIOR
SECTIONS

SHEET NUMBER:
A502


DOOR SCHEDULE

TAG	ROOM	DOOR STATUS *	FRAME STATUS	DOOR DESCRIPTION	DOOR WIDTH	DOOR HEIGHT	DOOR THICKNESS	DOOR TYPE	DOOR FINISH	FRAME TYPE	MATERIAL	STILE	HARDWARE SET	HARDWARE STATUS*	FIRE RATING	REMARKS
1	MAIN ENTRY	EXISTING	EXISTING	DOUBLE STOREFRONT (WIDE STILE, WOOD PULL/PUSH)	6'-0"	7'-0"	0'-1 3/4"	A	SEE A301	STOREFRONT	ALUM	WIDE (5")	1	NEW/EXISTING	-	1,2,4,5
2	UTENSIL	EXISTING	EXISTING	SINGLE STOREFRONT (WIDE STILE, NON-OFFSET, PANIC)	3'-0"	7'-0"	0'-1 3/4"	A	SEE A301	STOREFRONT	ALUM	WIDE (5")	2A	EXISTING	-	1,3,4,5
3	PASSAGE	EXISTING	EXISTING	SINGLE STOREFRONT (WIDE STILE, NON-OFFSET, PANIC)	3'-0"	7'-0"	0'-1 3/4"	A	SEE A301	STOREFRONT	ALUM	WIDE (5")	2A	EXISTING	-	1,3,4,5
4	KITCHEN	EXISTING	EXISTING	HM REAR KITCHEN (STANDARD)	3'-6"	7'-0"	0'-1 3/4"	D	D1/D2 (SEE A120)		H.M.	-	3	EXISTING	-	1,4,7
5	UNISEX 1	NEW	NEW	UNISEX 1 RESTROOM (SINGLE-OCCUPANT, STANDARD)	2'-11 3/32"	7'-0"	0'-1 3/4"	B	D1 (SEE A120)	1	H.M.	-	5	NEW	-	
6	UNISEX 2	NEW	NEW	UNISEX 2 RESTROOM (SINGLE-OCCUPANT, STANDARD)	3'-0"	7'-0"	0'-1 3/4"	B	D1 (SEE A120)	1	H.M.	-	6	NEW	-	
7	OFFICE	NEW	NEW	MANAGER'S OFFICE	3'-0"	7'-0"	0'-1 3/4"	C	D1 (SEE A120)	1	H.M.	-	4	NEW	-	

DOOR REMARKS

- DOORS WITH REMARK #1 TO BE KEYED THE SAME
- EXIT INDICATOR ARRIVES WITH SIGNS STATING "THIS DOOR TO REMAIN UNLOCKED DURING BUSINESS HOURS" AND "THIS DOOR TO REMAIN UNLOCKED WHEN THE BUILDING IS OCCUPIED". VERIFY REQUIRED SIGN WORDING WITH LOCAL JURISDICTION PRIOR TO INSTALLATION. ONE SIGN IS TO BE PLACED IN A VISIBLE LOCATION ABOVE THE DOORS.
- THERE IS TO BE NO EXTERIOR HOLE OR CYLINDER
- USE NON-SHRINK STRUCTURAL GROUT BED UNDER THRESHOLD
- BLACK DOOR SWEEP TO BE USED WITH CHARCOAL STOREFRONT. LIGHT GRAY DOOR SWEEP TO BE USED WITH CLEAR ANODIZED ALUMINUM STOREFRONT
- IF STATUS IS "EXISTING" G.C TO DETERMINE CONDITION OF EXISTING HARDWARE. IF HARDWARE IS IN POOR CONDITION, PROVIDE HARDWARE IN HARDWARE SCHEDULE. CONFIRM REPLACEMENT WITH CHIPOTLE CM.
- REAR KITCHEN DOOR TO BE PAINTED 'BLACK' ON INTERIOR AND 'KNIGHTS ARMOR' ON EXTERIOR U.N.O.

TYPICAL EXTERIOR DOOR TYPES

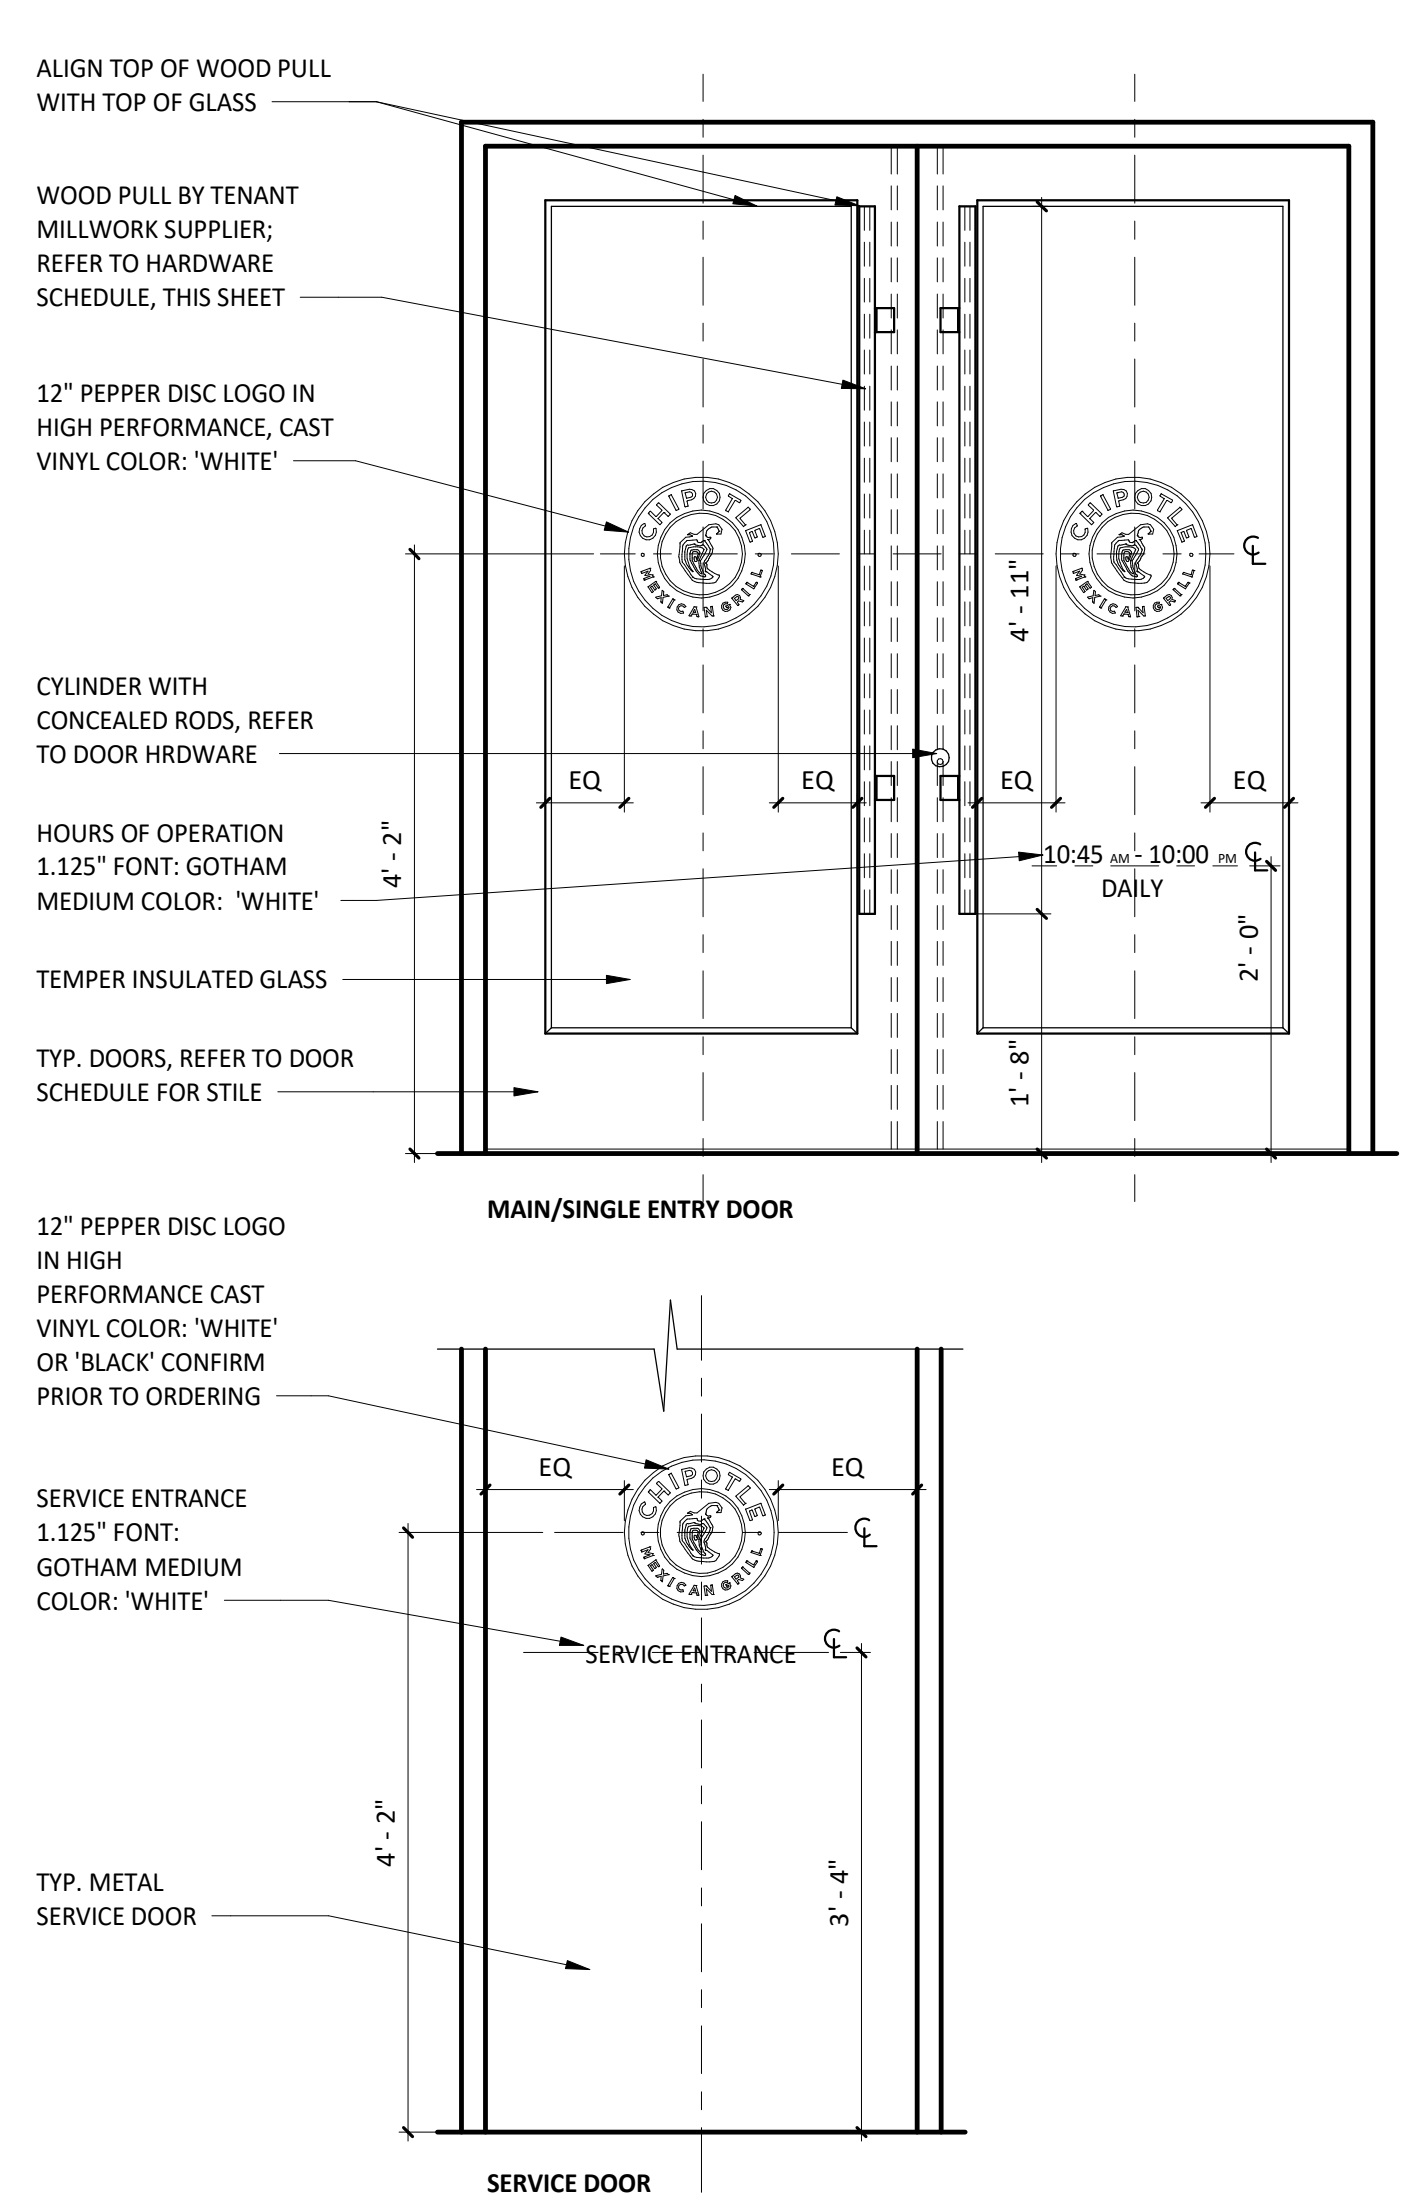

EXISTING HARDWARE SETS

G.C. TO CONFIRM ALL REQUIRED EXISTING HARDWARE IS PRESENT AND IS IN WORKING CONDITION. IF HARDWARE IS IN POOR CONDITION OR MISSING, PROVIDE HARDWARE IN HARDWARE SCHEDULE BELOW; CONFIRM REPLACEMENT WITH CHIPOTLE CM.

SET 1 - MAIN ENTRY - PAIR - WOOD PULL/PUSH

- | | | |
|-----|-------------------|--|
| (2) | HINGE | HAGER, MODEL 780-224HD-83"-CLR |
| (2) | MORTISE CYLINDER | SCHLAGE, MODEL 80-103, BRUSHED CHROME; C.O. CYLINDER AT 34" MIN. FROM BOTTOM OF DOOR |
| (2) | TEMP CORE | SCHLAGE, MODEL 80-035 INTERCHANGEABLE CORE, (BRUSHED CHROME) |
| (1) | DEADBOLT | ADAMS RITE, MODEL MS1850S-310-628 |
| (1) | EXIT INDICATOR | ADAMS RITE, MODEL 4089-00-130 |
| (1) | HEADER BOLT | ADAMS RITE, MODEL 4016-30-01 |
| (1) | THRESHOLD BOLT | ADAMS RITE, MODEL 4015-18-1B |
| (2) | CLOSER | DORMA, MODEL 8916-AF89P (TOP JAMB), (ALUMINUM) |
| (2) | DOOR STOP | IVES, MODEL FS185 (ALUMINUM) |
| (2) | OVERHEAD STOP | GLYNN-JOHNSON, MODEL 454S-SP28 (ALUMINUM) |
| (2) | CLOSER BACK PLATE | DORMA, MODEL BP89, ALUMINUM |
| (1) | THRESHOLD | PEMKO, MODEL S424A-72 (SIZE 72") |
| (2) | SMOKE SEAL | REESE, MODEL 797B-21 |
| (2) | DOOR SWEEP | PEMKO, MODEL SFSC-200-36 (36" DOOR), OWNER FURNISHED |

SET 2A - ENTRY - SINGLE - NON-OFFSET - PANIC HARDWARE

- | | | |
|-----|-------------------|--|
| (1) | HINGE | HAGER, MODEL 780-224HD-83"-CLR |
| (1) | PUSH HARDWARE | ADAMS RITE, MODEL 8801-36-628 (ALUMINUM FINISH, 36" DOOR); C.O. EXIT DEVICE AT 38" FROM BOTTOM OF DOOR |
| (1) | PULL HARDWARE | HAGER, MODEL 4G US32D (8" CTC), CENTER ON DOOR STILE |
| (1) | CLOSER | DORMA, MODEL 8916-AF89P-689 (TOP JAMB), (ALUMINUM) |
| (1) | CLOSER BACK PLATE | DORMA, MODEL BP89, ALUMINUM |
| (1) | OVERHEAD STOP | GLYNN-JOHNSON, MODEL 454S-US32D (ALUMINUM) |
| (1) | THRESHOLD | REESE, MODEL S424A-36 (SIZE 36") |
| (1) | SMOKE SEAL | REESE, MODEL 797B-21 |
| (1) | DOOR SWEEP | PEMKO, MODEL SFSC-200-36 (36" DOOR), OWNER FURNISHED |
| (1) | DOOR STOP | IVES, MODEL FS185 (ALUMINUM) |

SET 3 - REAR EXIT - SINGLE

- | | | |
|-----|-------------------|---|
| (1) | HINGE | HAGER, MODEL 780-224HD-83"-CLR |
| (1) | PUSH HARDWARE | FALCON, MODEL 25-R-EO-4"-US28 (SIZE 42") |
| (1) | PULL HARDWARE | FALCON, MODEL 510L-DANE-LHR-US26D, ALUMINUM (EXTERIOR SIDE) |
| (1) | RIM CYLINDER | GLS, MODEL RCIC-7-LZ-626 |
| (1) | TEMP CORE | SCHLAGE, MODEL 80-035 INTERCHANGEABLE CORE (FINISH: BRUSHED CHROME) |
| (1) | CLOSER | DORMA, MODEL 8916-AF89P-689 (TOP JAMB), ALUMINUM |
| (1) | CLOSER BACK PLATE | DORMA, MODEL BP89, ALUMINUM |
| (1) | THRESHOLD | REESE, MODEL S239A-42, (SIZE 42") |
| (1) | WEATHERSTRIP | REESE, MODEL DS75C-4070 |
| (1) | DOOR SWEEP | PEMKO, MODEL SFSC-200-42 (42" DOOR) (BLACK) OWNER FURNISHED |
| (1) | DOOR VIEWER | IVES, MODEL US88B26D, C.O. VIEWER AT 60" FROM BOTTOM OF DOOR |
| (1) | DOOR SILENCERS | IVES, MODEL SR64 |
| (1) | DOOR BUZZER | TRINE, MODEL 66B |
| (1) | KICKPLATE | HIAWATHA, MODEL KP834-US32D |

GENERAL DOOR HARDWARE

- ALL EGRESS DOORS SHALL BE READILY OPENABLE FROM THE EGRESS SIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT.
- LATCHES, HANDLES, PANIC BARS AND ALL DOOR HARDWARE WILL COMPLY WITH SECTION 7.2 OF NFPA 101 PER THE SPECIFICATIONS.
- THE MANAGER HAS A KEY TO UNLOCK RESTROOM DOORS, FROM THE OUTSIDE IN CASE OF AN EMERGENCY.
- ALL DOORS TO REMAIN UNLOCKED DURING BUSINESS HOURS.
- SEE THIS SHEET FOR EXTERIOR DOOR SIGNAGE INFO.
- MAXIMUM EFFORT TO OPERATE EXTERIOR OR INTERIOR DOORS WITH CLOSERS SHALL NOT EXCEED 5 POUNDS. THIS MAY BE INCREASED TO 15 POUNDS FOR FIRE-RATED DOORS.
- ALL NEW HOLLOW METAL DOORS, FRAMES AND HARDWARE TO BE FURNISHED BY TENANT HARDWARE SUPPLIER AND INSTALLED BY TENANT G.C. CALL ANDY SNYDER TWIN CITY HARDWARE AT 763-762-4860 (asnyder@tcho.com) TO ARRANGE DELIVERY. NEW VESTIBULE STOREFRONT DOORS AND DOOR HARDWARE ARE TO BE PROVIDED BY TENANT GC.
- THE BOTTOM 10 INCHES OF ALL DOORS SHALL HAVE A SMOOTH, UNINTERRUPTED SURFACE TO ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST WITHOUT CREATING A TRAP OR HAZARDOUS CONDITION.
- ALL SUPPORT SIGNAGE INSTALLED BY G.C.
- ALL SUPPORT SIGNAGE PROVIDED BY TENANT'S SUPPORT SIGNAGE SUPPLIER.
- ALL HARDWARE SHALL MATCH STOREFRONT, VERIFY WITH ARCHITECT AND/OR CHIPOTLE CONSTRUCTION MANAGER PRIOR TO ORDERING.

NEW HARDWARE SETS

SET 1 - MAIN ENTRY - PAIR - WOOD PULL/PUSH

- | | | |
|-----|---------------|--|
| (2) | PUSH HARDWARE | 1 1/2" DIAMETER WOOD PUSH, VARIES HIGH - PROVIDED BY MILLWORK SUPPLIER. MOUNT TOP OF PULLS FLUSH WITH TOP OF GLAZING STOP IN DOOR, RE: SHOP DRAWINGS |
| (2) | PULL HARDWARE | 1 1/2" DIAMETER WOOD PULL, VARIES HIGH - PROVIDED BY MILLWORK SUPPLIER. MOUNT TOP OF PULLS FLUSH WITH TOP OF GLAZING STOP IN DOOR, RE: SHOP DRAWINGS |

SET 4 - MANAGER'S OFFICE

- | | | |
|-----|-----------------|--|
| (3) | HINGE | STANLEY, MODEL FB8179-4.5-US26 (06-8438) |
| (1) | LOCKSET | SCHLAGE, MODEL L9453L-06A-626 |
| (1) | TEMP CORE | SCHLAGE, MODEL 80-035 INTERCHANGEABLE CORE (FINISH: BRUSHED CHROME) |
| (1) | KICKPLATE | HIAWATHA, MODEL KP834-32D |
| (1) | DOOR STOP | DON-JO, MODEL 1407-630, STAINLESS STEEL |
| (3) | DOOR SILENCERS | IVES, MODEL SR64 |
| (1) | SECURITY WINDOW | AIR LOUVERS, MODEL VSL1212TEMPPAK SLIMLINE 12" X 12" X 1/4" LITE KIT (10" X 10" GLASS VISIBLE) |


SET 5 - TOILET ROOM 2 RESTROOM - SINGLE OCCUPANT - STANDARD

- | | | |
|-----|----------------|--|
| (3) | HINGE | STANLEY, MODEL FB8179-4.5-US26 (06-8438) |
| (1) | CLOSER | FALCON, MODEL: SC61XRW/PAXALU |
| (1) | LOCKSET | SCHLAGE, MODEL AL40S-NEP-626 |
| (1) | DOOR STOP | DON-JO, 1407-630 |
| (3) | DOOR SILENCERS | IVES, MODEL SR64 |
| (2) | KICKPLATE | HIAWATHA, MODEL KP834-32D |
| (1) | COAT HOOK | MILLS, MODEL FT6519, SUPPLIED BY WASHROOM ACCESSORIES VENDOR, MOUNT T.O. HOOK AT 47 1/2" AFF |


SET 6 - TOILET ROOM 1 RESTROOM - SINGLE OCCUPANT - STANDARD

- | | | |
|-----|----------------|--|
| (3) | HINGE | STANLEY, MODEL FB8179-4.5-US26 (06-8438) |
| (1) | CLOSER | FALCON, MODEL: SC61XRW/PAXALU |
| (1) | LOCKSET | SCHLAGE, MODEL AL40S-NEP-626 |
| (1) | DOOR STOP | DON-JO, 1407-630 |
| (3) | DOOR SILENCERS | IVES, MODEL SR64 |
| (2) | KICKPLATE | HIAWATHA, MODEL KP834-32D |
| (1) | COAT HOOK | MILLS, MODEL FT6519, SUPPLIED BY WASHROOM ACCESSORIES VENDOR, MOUNT T.O. HOOK AT 47 1/2" AFF |


DOOR FRAME

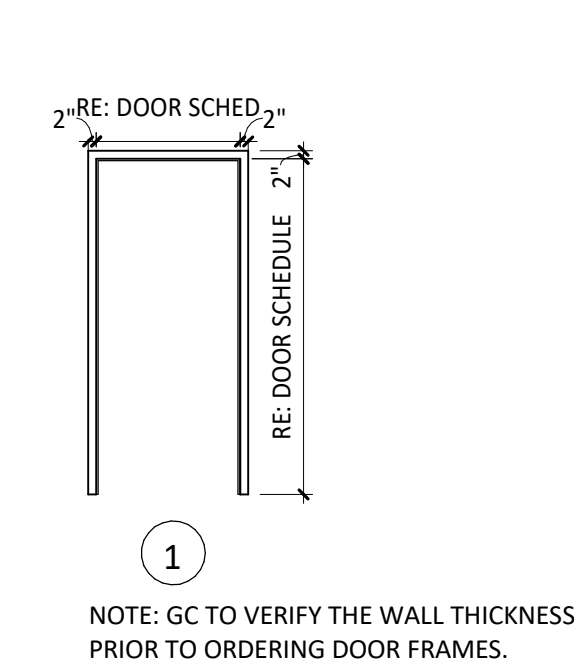


CUSTOM WOOD PULL

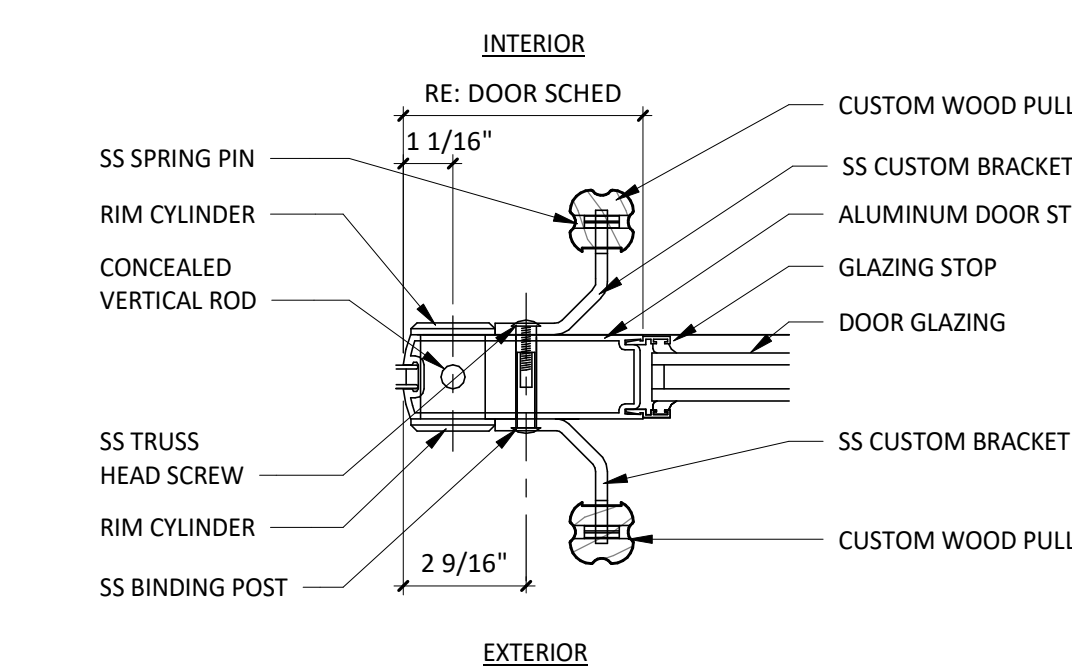


SILL FLASHING

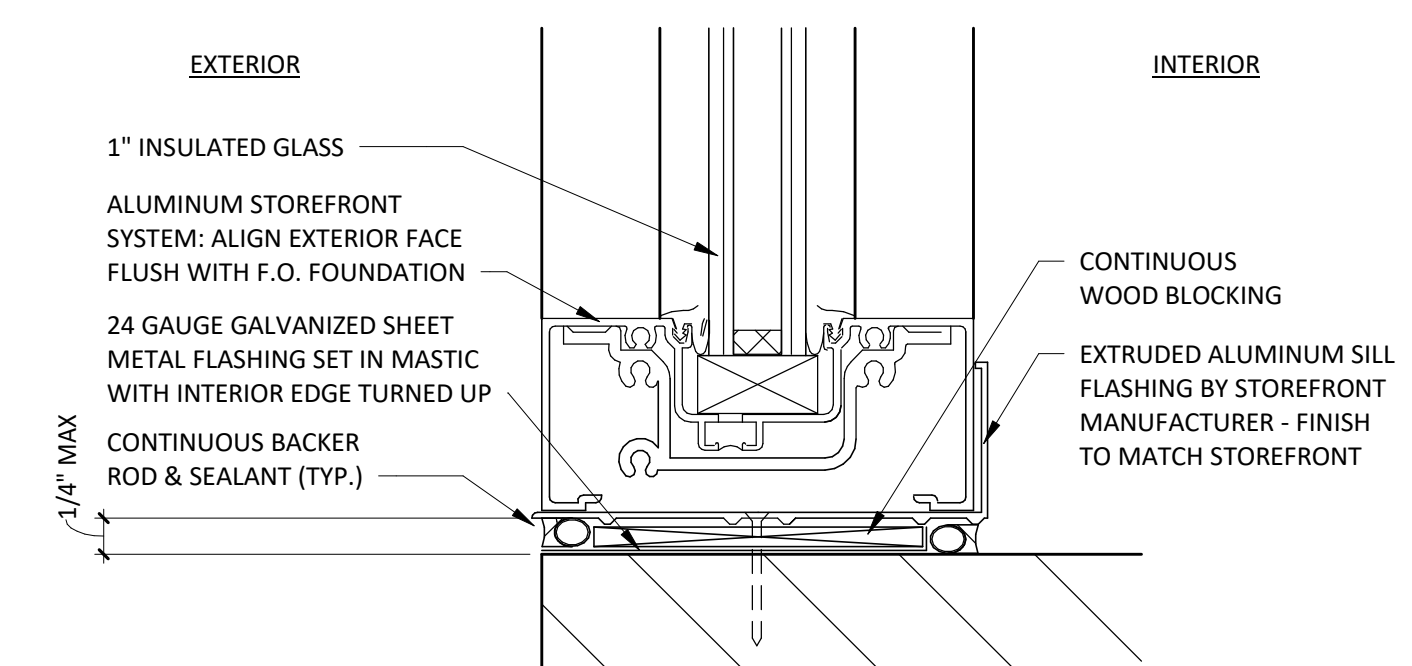

DOOR TYPES

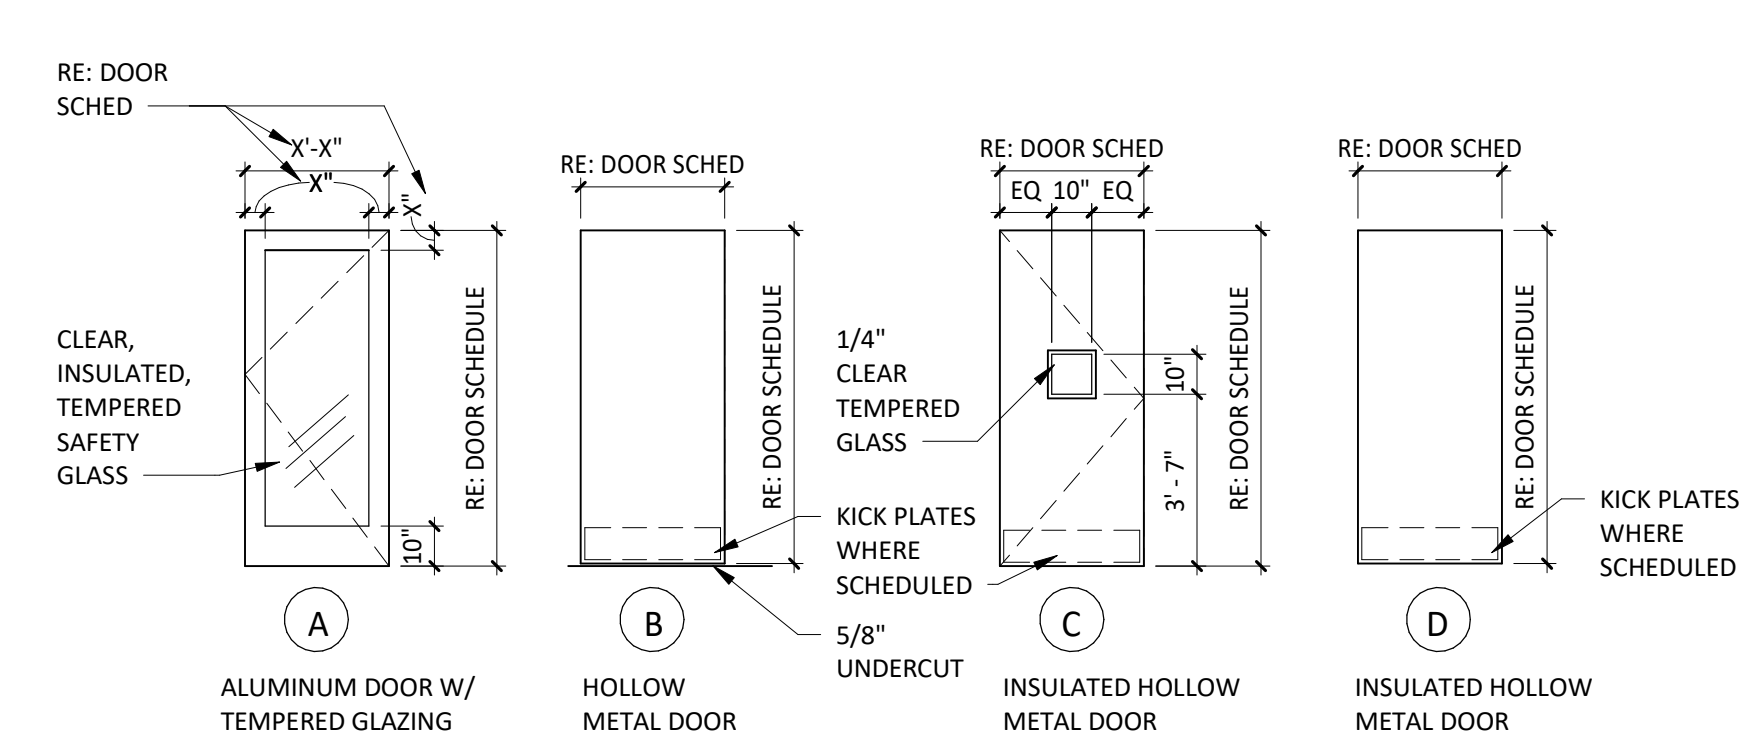

DOOR CLOSER

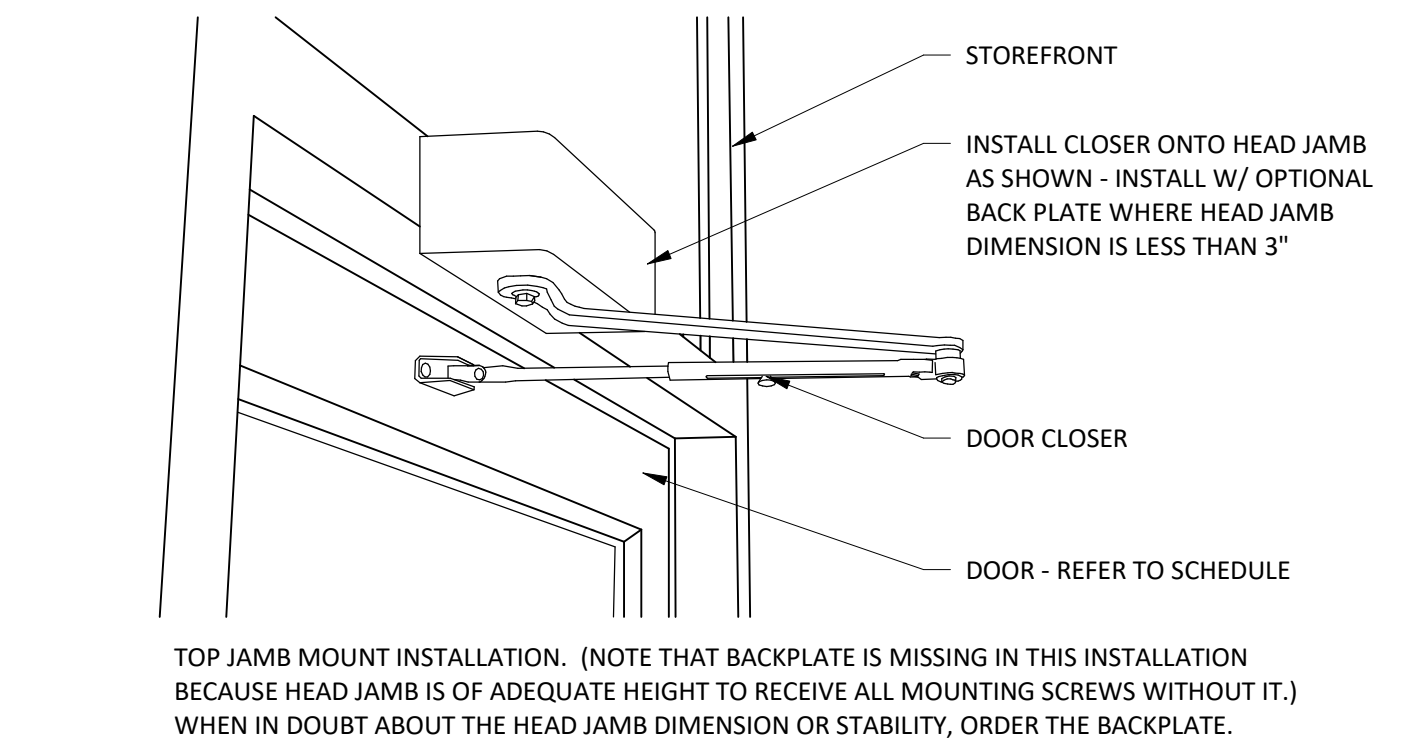

CONSULTANT:



CLIENT:




COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

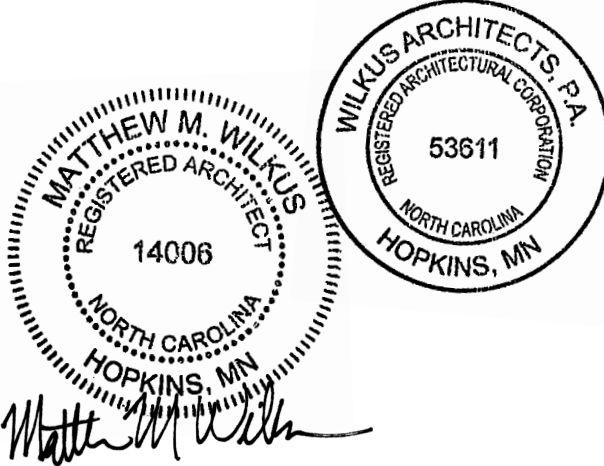

September 04, 2026

MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362

DRAWN BY JSB / KRJ

CHECKED BY DLA

ISSUE RECORD:

03/07/2025 PERMIT SET
05/29/2025 BID SET


REVISIONS:

TITLE:


DOOR &
HARDWARE
SCHEDULE

SHEET NUMBER:


A601

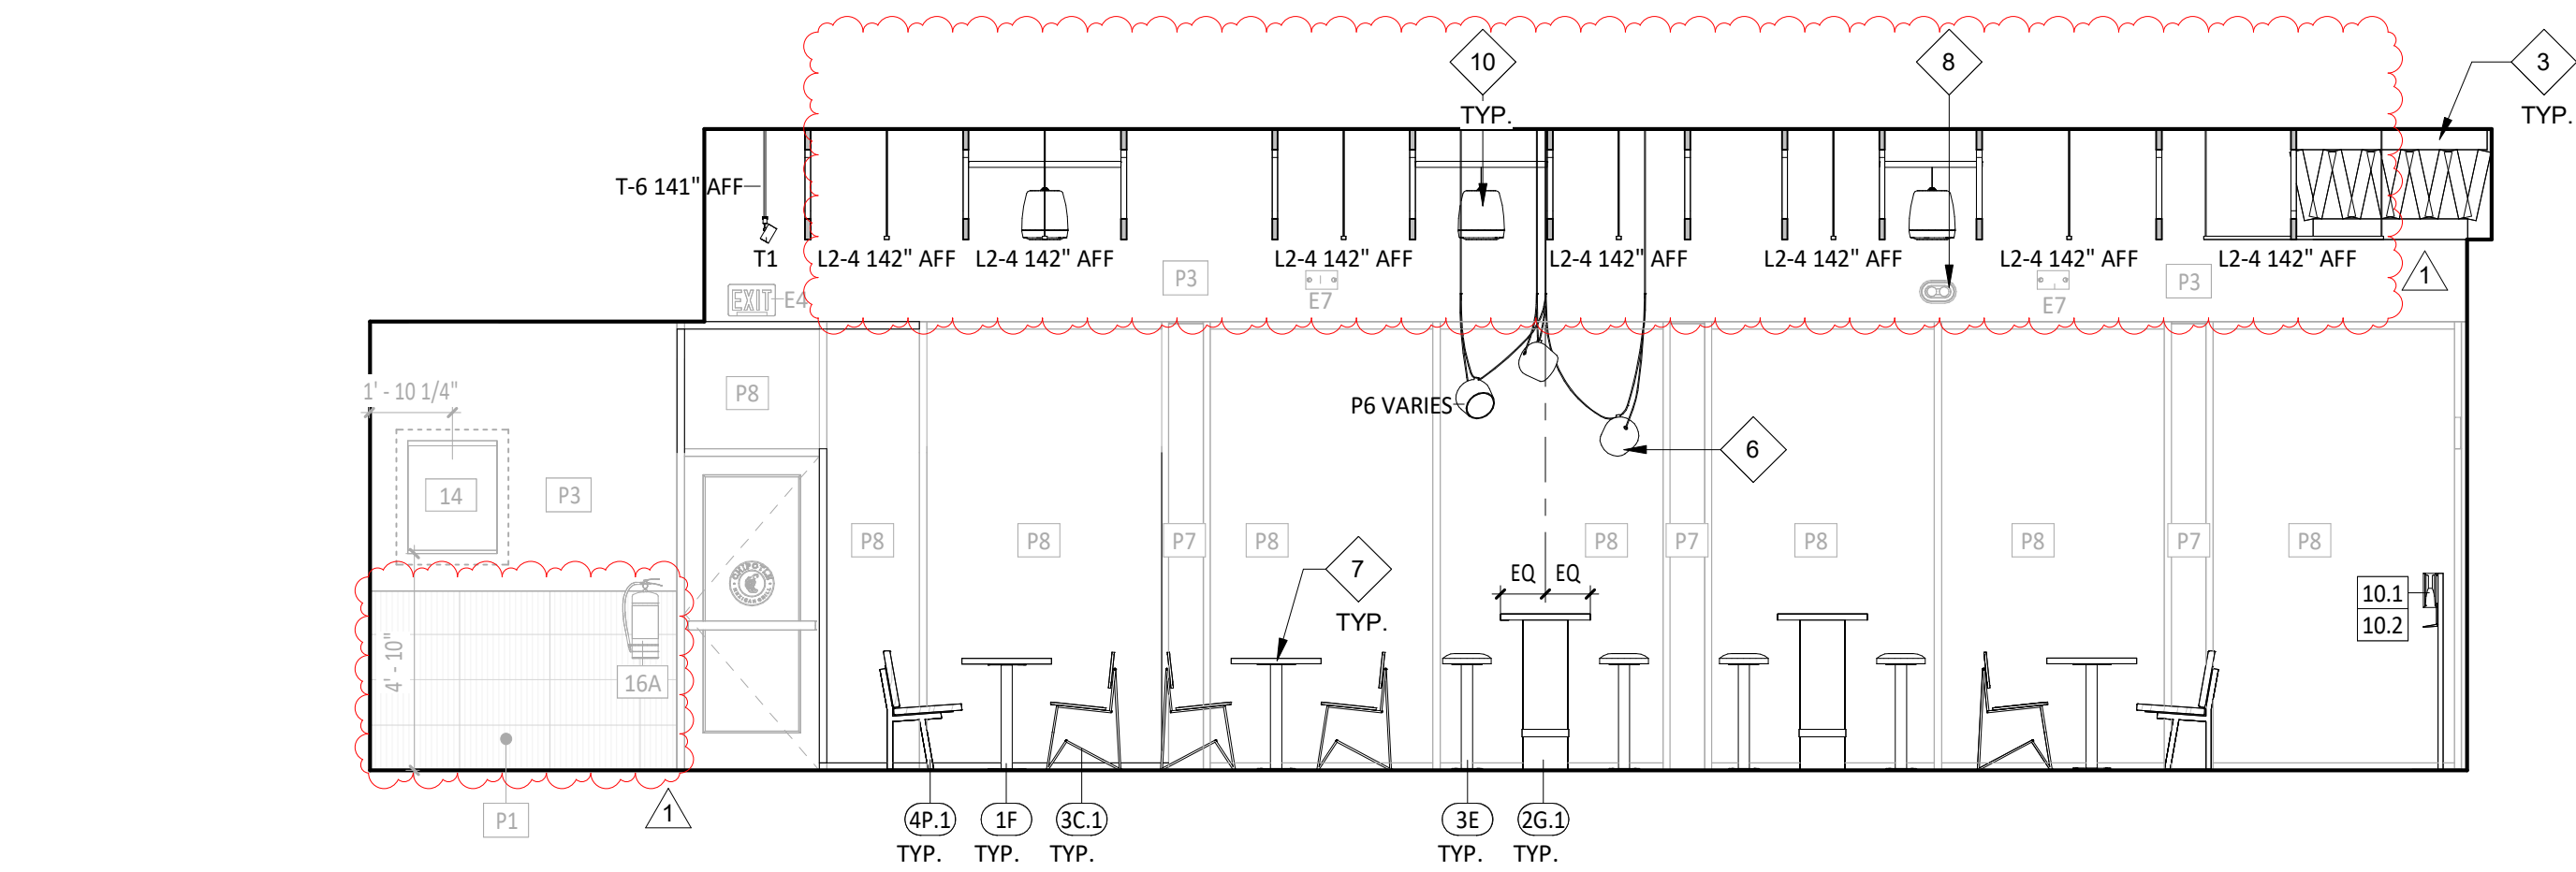


1 DINING ELEVATION
SCALE: 1/4" = 1'-0"

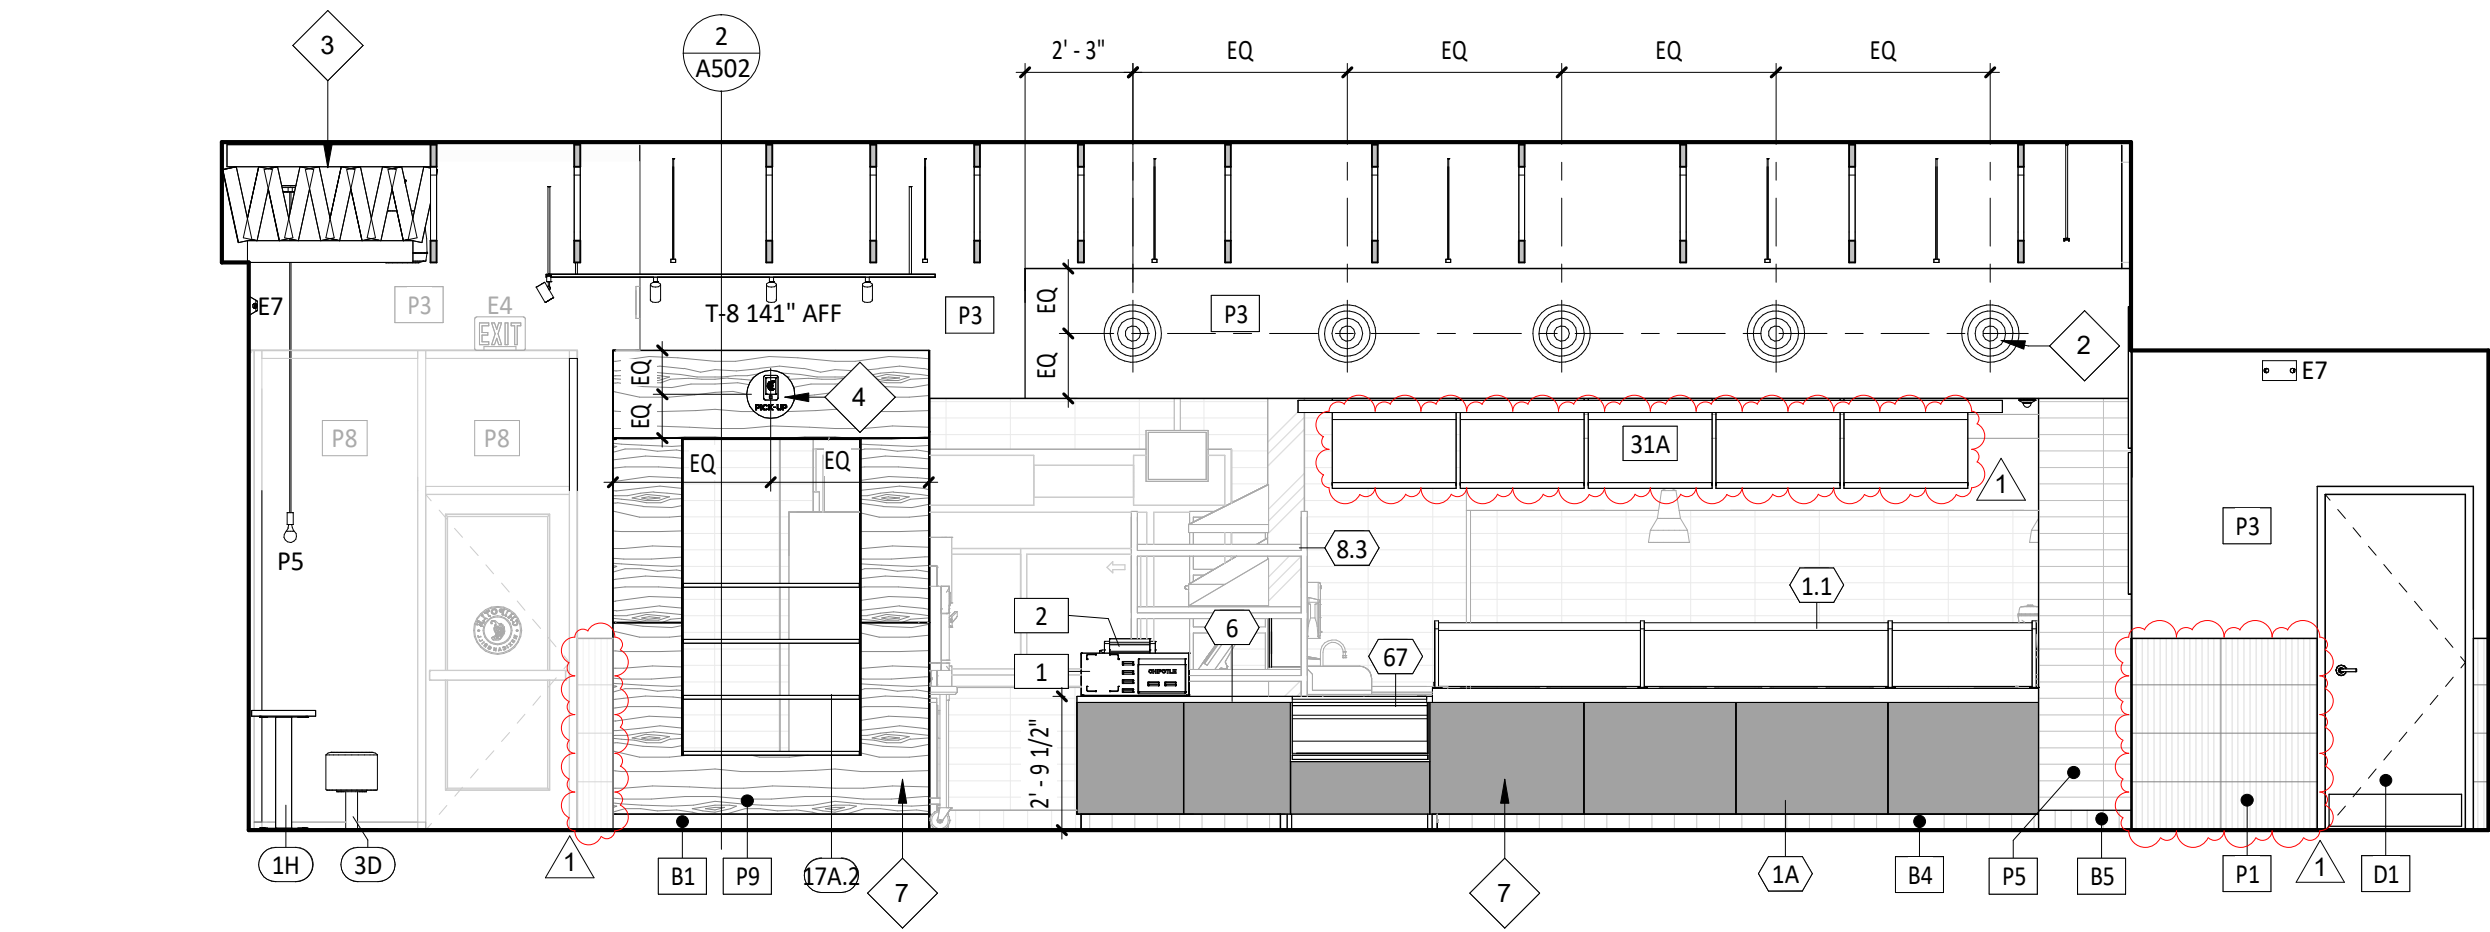


3 DINING ELEVATION
SCALE: 1/4" = 1'-0"

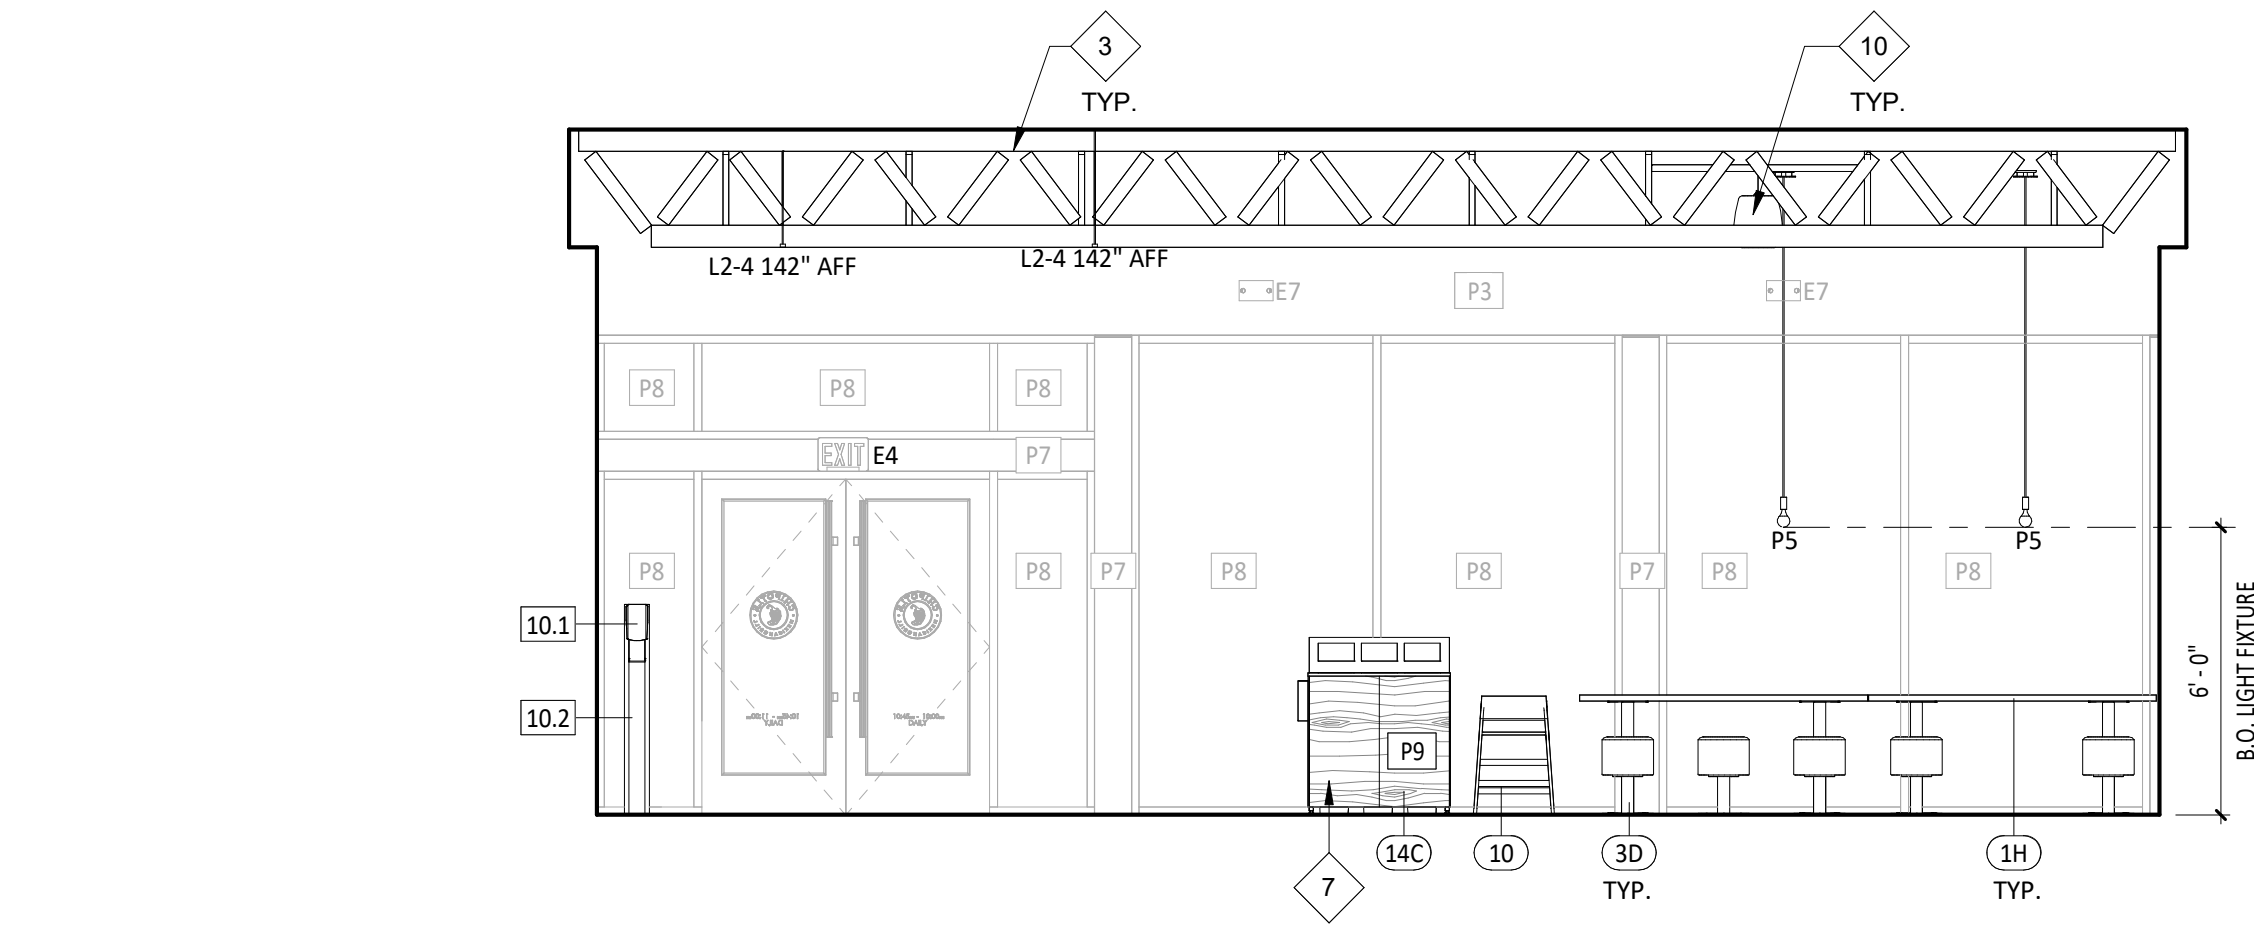

5 DINING ELEVATION
SCALE: 1/4" = 1'-0"

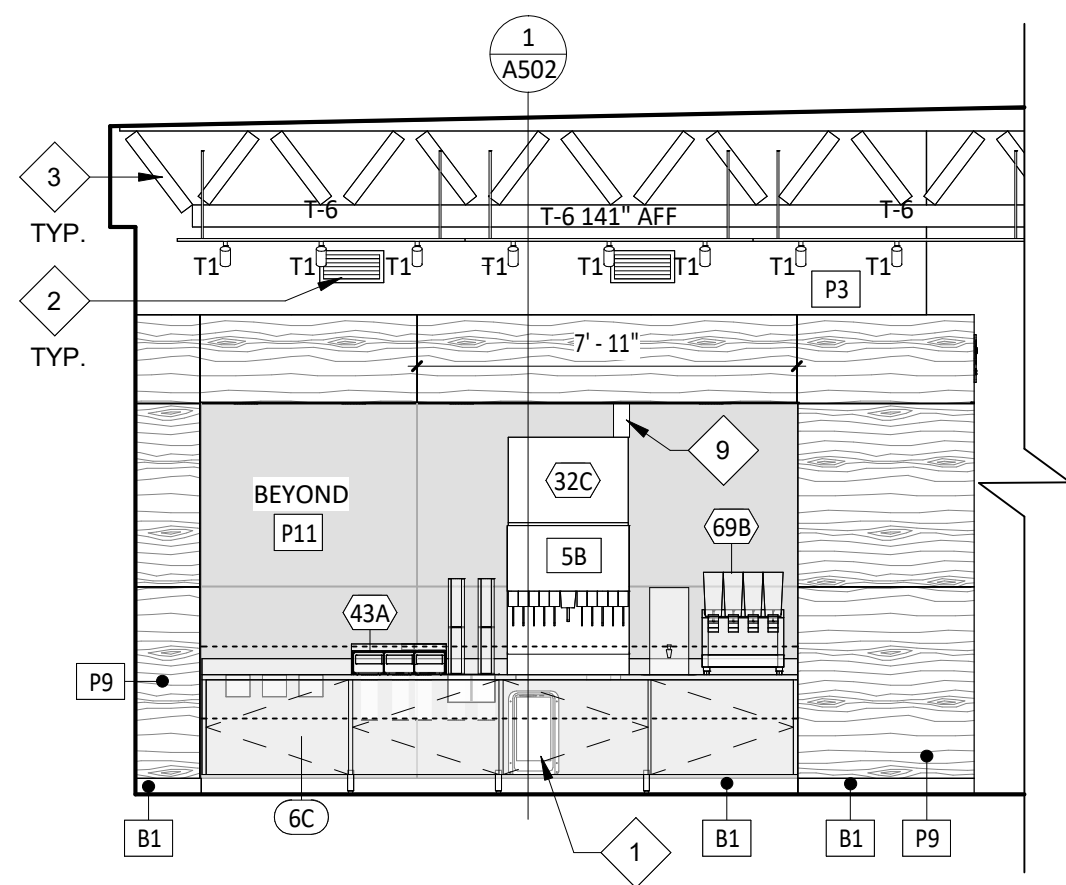

2 DINING ELEVATION
SCALE: 1/4" = 1'-0"

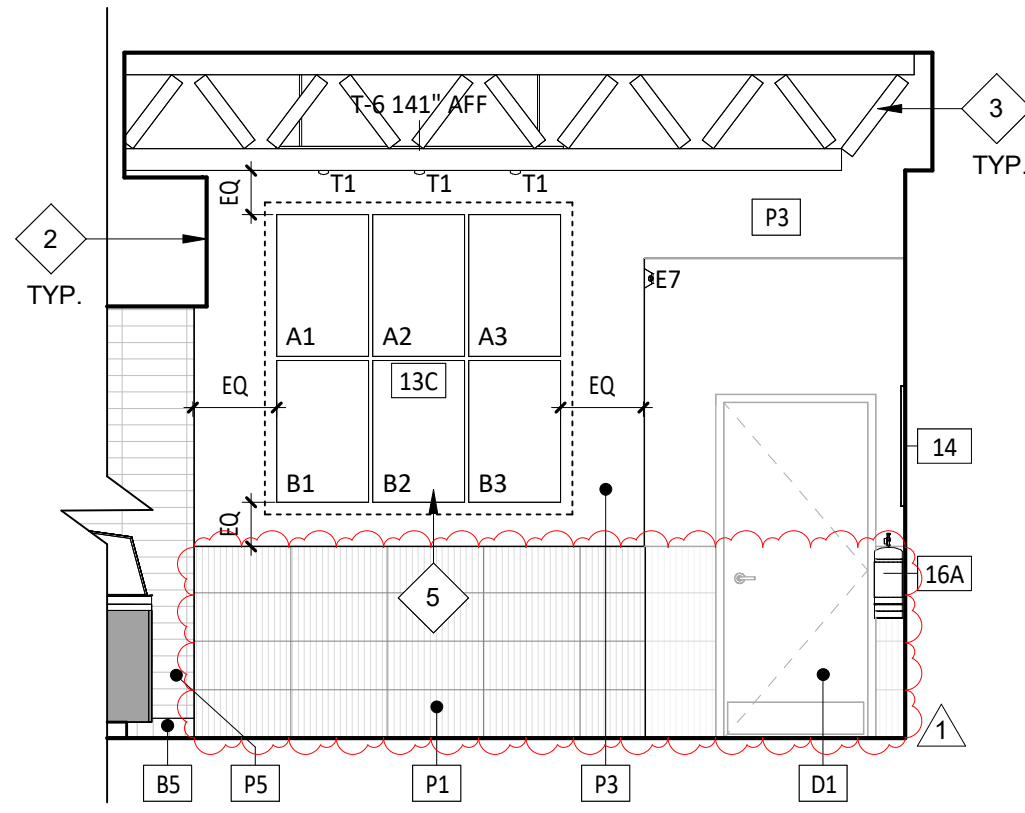

4 DINING ELEVATION
SCALE: 1/4" = 1'-0"

GENERAL NOTES - INT. ELEV.

- A. REFER TO SHEET A131 FOR EQUIPMENT LIST AND FURNITURE SCHEDULE.
B. PROVIDE FULL HEIGHT BLOCKING IN WALL FOR ALL SHELVEING, TYP.
C. REFER TO A120 FOR FINISH SCHEDULE.
D. REFER TO A201 AND ELECTRICAL DRAWINGS FOR LIGHT FIXTURE SCHEDULE.

ELEVATION LEGEND

- DENOTES WOOD BLOCKING IN WALL BEHIND WALL MOUNTED OBJECT U.N.O.

KEYNOTE LEGEND

- 1 SODA CHASE BEYOND - REFER TO PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.
2 DUCTWORK SHOWN FOR REFERENCE ONLY - REFER TO MECHANICAL DRAWINGS FOR ALL FINAL DUCTWORK LOCATIONS.
3 EXISTING STRUCTURE TO REMAIN UNPAINTED - REFER TO A140 AND A201 FOR ADDITIONAL INFORMATION.
4 PICK-UP SIGN BY TENANT SIGNAGE VENDOR - INSTALLED BY GENERAL CONTRACTOR - COORDINATE REQUIRED BLOCKING REQUIREMENTS.
5 6 - PANEL RICE BOARD ARTWORK LOCATION.
6 DECORATIVE LIGHT FIXTURE TO BE CENTERED OVER HIGH TOP TABLE BELOW - REFER TO A211 FOR ADDITIONAL INFORMATION.
7 MILLWORK BY TMS - REFER TO A130 FOR ADDITIONAL INFORMATION.
8 DUAL HEAD INTERIOR SECURITY CAMERA LOCATION.
9 GENERAL CONTRACTOR TO PROVIDE STAINLESS STEEL SHROUD AROUND EXPOSED LINES AT ICE MAKERS - REFER TO FINISH PLANS FOR DETAILS.
10 SPEAKER LOCATION - REFER TO A201 FOR ADDITIONAL INFORMATION.

CONSULTANT:



CLIENT:




CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182666
COLUMBUS, OH 43218-2666
TELEPHONE: (614) 318-2662
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

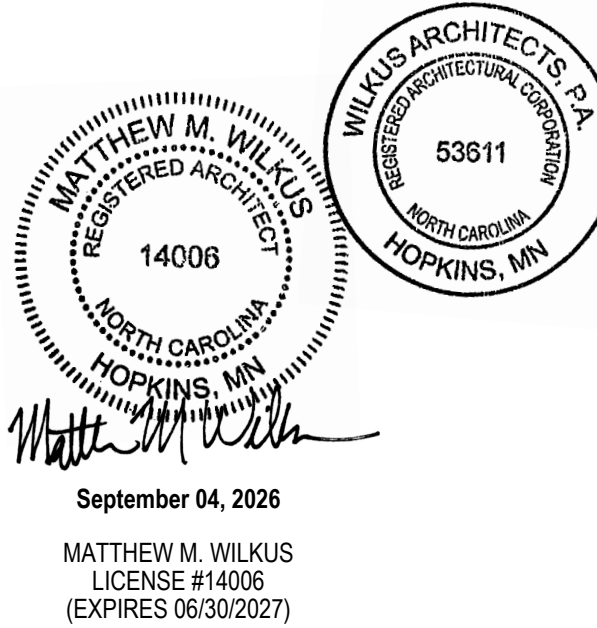

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES

TITLE:
ELEVATIONS -
INTERIOR DINING

SHEET NUMBER:

A701

*THIS DETAIL IS FOR HANDSINK ACCESSORY DIMENSIONS ONLY. FOR ACTUAL ORIENTATION OF HAND SINK AND ACCESSORIES, REFER TO KITCHEN ELEVATIONS

WALL FINISH VARIES, REFER TO A120

PAPER TOWEL DISPENSER

TANK SOAP DISPENSER

HYGIENE DISPENSER

NOTE: REFER TO SHEET G002 FOR ALL REQUIRED ACCESSIBLE MOUNTING HEIGHTS. CONTACT ARCHITECT IMMEDIATELY WITH ANY DISCREPANCIES

CLEANER SPRAY BOTTLE AND BRACKET, ALIGN OUTER EDGE OF SPRAY BOTTLE WITH OUTER EDGE OF SINK ABOVE AND BOTTOM OF BOTTLE WITH ADJ. SANITARY BUCKET

PROVIDE BLOCKING BEHIND HAND SINK AND ASSOCIATED OBJECTS WHEN REQUIRED, REFER TO ELEVATIONS ON THIS SHEET FOR EXACT LOCATIONS

HAND SINK, INSTALL TWO (2) SCREWS WITH FINISH GROMMETS INTO BACKSPLASH. SCREWS TO BE 1/4" x 3 1/2" STAINLESS STEEL LAG BOLT WITH OVAL HEAD AND STAINLESS STEEL TRIM WASHER. PROVIDE BLOCKING AS REQUIRED AT EACH SCREW LOCATION

SANITARY BUCKET, ALIGN OUTER EDGE OF BUCKET WITH OUTER EDGE OF PAPER TOWEL DISPENSER ABOVE, MOUNT B.O. BRACKET AS SHOWN.

1 TYP ELEV - HAND SINK

SCALE: 1/2" = 1'-0"

3/4" WHITE MEL. SHELVES WITH 16" STANDARDS AND 36" BRACKETS, SECURE OFFICE SHELVING THROUGH STUD WITH 2 1/2" WOOD SCREWS

PROVIDE BLOCKING BEHIND ALL SHELVING, SEE SHEET A110 GENERAL NOTES

(1) UNDERCOUNTER WIRE SHELVES FOR DSL EQUIPMENT BY TENANT

15" MONITOR AND SERVER INSTALLED BY TENANT

NOTE: REFER TO ELECTRICAL SHEETS FOR POS OUTLET LOCATIONS

WALL BASE, REFER TO A120

B.O. CEILING TILE REFER TO A201

STEREO: HI/FI RECEIVER BY TENANT

COLOR LCD SECURITY MONITOR BY TENANT W/ VMP LCD-1 MOUNTING ARM

SAFE

PRINTER/FAX/COPIER PROVIDED BY TENANT

1 1/2" PLAN COUNTERTOP WITH WHITE METAL BRACKETS

NOTE: COUNTERTOP AND SHELVING PROVIDED BY TEM, INSTALLED BY G.C.

2 DRAWER LOCKABLE FILE CABINET BY TENANT

2 TYP ELEV - OFFICE SHELVING

SCALE: 1/2" = 1'-0"

PANIC BUTTON, CONFIRM LOCATION WITH CHIPOTLE CONSTRUCTION MANAGER

CUP DISPENSER SUPPLIED AND INSTALLED BY DELFIELD, MOUNT CENTERED LEFT TO RIGHT IN THIS COMPARTMENT

PROVIDE CLEARANCE FOR CASH DRAWER

NOTE: REFER TO ELECTRICAL SHEETS FOR POS OUTLET LOCATIONS

3 TYP. ELEV - POS

SCALE: 3/4" = 1'-0"

GENERAL NOTES - INT. ELEV.

A. REFER TO SHEET A131 FOR EQUIPMENT LIST AND FURNITURE SCHEDULE.

B. PROVIDE FULL HEIGHT BLOCKING IN WALL FOR ALL SHELVING, TYP.

C. REFER TO A120 FOR FINISH SCHEDULE.

D. REFER TO A201 AND ELECTRICAL DRAWINGS FOR LIGHT FIXTURE SCHEDULE.

ELEVATION LEGEND

--- DENOTES WOOD BLOCKING IN WALL BEHIND WALL MOUNTED OBJECT U.N.O.

KEYNOTE LEGEND

1 CHIME/STROBE - REFER TO ELECTRICAL SHEETS FOR ADDITIONAL INFORMATION.

2 ANSUL PULL TO BE LOCATED 48" A.F.F. TO THE CENTER OF UNIT ABOVE THE TIMECLOCK LOCATION.

3 KRONOS TIMECLOCK WILL BE LOCATED 40" A.F.F. TO THE TOP OF UNIT - CENTER KRONOS UNIT IN WALL - REFER TO ELECTRICAL DRAWINGS.

4 ELECTRICAL PANELS (BY CHIPOTLE)

5 SODA CHASE BEYOND - REFER TO PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.

6 MONITOR BY TENANTS VENDOR.

7 WATER FILTER - REFER TO PLUMBING SHEETS FOR ADDITIONAL INFORMATION.

8 FUTURE UP-RIGHT COOLER LOCATION

9 GENERAL CONTRACTOR TO PROVIDE STAINLESS STEEL SHROUD AROUND EXPOSED LINES AT ICE MAKERS - REFER TO FINISH PLANS FOR DETAILS.

10 ALUMINUM PLATE SILL, HEAD AND JAMBS AS INDICATED - REFER TO DETAILS 12 & 13/A802.

11 MOVEABLE BACK-UP TRASH BINS FOR DINING AREA TRASH SURROUNDS - TYPICAL OF FOUR (4).

12 MOVEABLE BACK-UP TRASH BINS FOR DINING AREA TRASH SURROUNDS - TYPICAL OF TWO (2).

13 PICK UP WINDOW WITH INTEGRATED AIR CURTAIN, BY LANDLORD.

4 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"

5 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"

6 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"

7 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"

8 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"

9 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"

10 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"

11 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"

12 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"

13 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"

14 KITCHEN ELEVATION

SCALE: 1/4" = 1'-0"




CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 315-2652
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

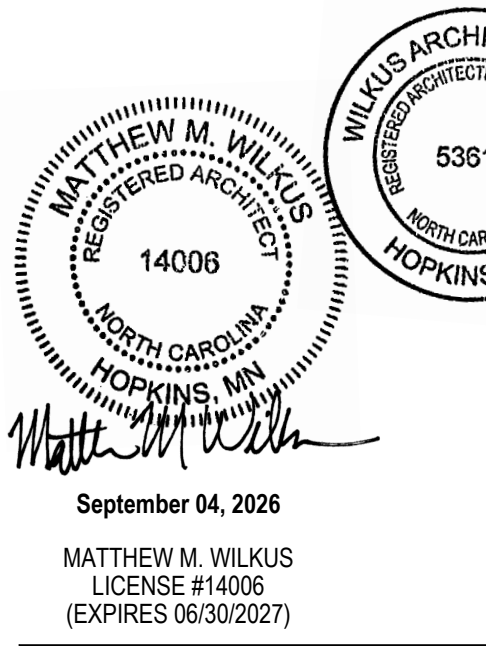

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES

TITLE:
ELEVATIONS -
INTERIOR KITCHEN

SHEET NUMBER:
A702

RESTROOM ACCESSORIES


ITEM #	DESCRIPTION	MANUF	MODEL	QTY	PROVIDED BY	INSTALLED BY	UTILITY				MOUNTING HEIGHT	REMARKS
							ELEC	GAS	WATER	SEWER		
1A	Grab Bar - 36in	ASI	3501-36	2	WA	GC					See Sheet G002	Provide Plywood Blocking to Mount to Wall
1B	Grab Bar - 42in	ASI	3501-42	2	WA	GC					See Sheet G002	Provide Plywood Blocking to Mount to Wall
3A	Vandal Proof Mirror	Varies	Vandal Proof Mirror	2	TS	GC					Bottom Edge of Reflecting Surface at 40" AFF	Provide Plywood Blocking to Mount to Wall
5	Touch-Free Soap Dispenser	Purell	CS8	2	WA	GC					47 1/2" AFF To Top Of Dispenser	
7	Recessed Toilet Paper Dispenser	ASI	0031	2	WA	GC					29" AFF to Top of Unit	Recess Mounted in Wall - Rough Opening: 6 1/4"W X 12 1/4"H X 3 3/8"D Top of Rough Opening: 29 1/4" AFF Provide Toggle Bolts to Mount to Wall
8	Utility Shelf	ASI	0692	2	WA	GC					46" AFF To Top Of Shelf	
9	Recessed Convertible Paper Towel Dispenser and Waste Receptacle, Recess Mounted in Wall	Varies	Varies	2	WA	GC					Bottom of Unit at Top of Base, Bottom of Dispenser to be at 40" AFF, Recess Mounting In Wall	Rough Opening: 16"W x 54 3/4"H x 4" D. Provide Plywood Blocking to Mount to Wall
12	Napkin Disposal - Recessed	ASI	0473	2	WA	GC					Top of Rough Opening @ 29" AFF	
14	Restroom Hand Sink	SEE MEP	SEE MEP	2	GC	GC					Mount Bottom of Front Edge Of The Sink At Exactly 29" AFF	Recess Mounted in Wall - Rough Opening: 11 1/4"W X 15 3/4"H X 4" D
14.1	Restroom Hand Sink Faucet	Chicago Faucets	3520-E2805ABCP	2	KES	GC						To Be Furnished With .5 GPM Aerator Installed. Thermostatic mixing valve is also included.
15	Hand Sanitizer Dispenser	Purell	ES8	2	WA	GC					Align T.O. Unit With T.O. Soap Dispenser	
16A	Surface Mounted Horizontal Baby Changing Station	Koala Care	KB300/05	2	WA	GC					Mount Bottom of Open Changing Bed at Exactly 27" AFF	GC to Provide adequate blocking to support the baby changing equipment. Blocking shall be installed in such a manner to not damage or compromise the rated assembly of the existing wall construction

GENERAL NOTES - RESTROOM


- A. REFER TO A801 FOR FINISH DETAIL NOTES.
- B. ALL ACCESSORIES SHALL BE AS MANUFACTURED BY AMERICAN SPECIALTIES INC OR TENANT APPROVED EQUIVALENT UNLESS DESIGNATED OTHERWISE. PROVIDE SOLID FRT WOOD BLOCKING AS NECESSARY FOR INSTALLATION PER MANUFACTURER'S RECOMMENDATIONS. SEE SHEET G002 FOR ACCESSIBILITY GUIDELINES & MOUNTING HEIGHT REQUIREMENTS.
- C. REFER TO A120 FOR FINISH SCHEDULE.
- D. REFER TO A120 AND ELECTRICAL DRAWINGS FOR LIGHT FIXTURE SCHEDULE.
- E. FOR ADDITIONAL ASSISTANCE WITH RESTROOM ACCESSORIES PLEASE REACH OUT TO CMG@HJCINC.COM.

ELEVATION LEGEND


⬡ DENOTES WOOD BLOCKING IN WALL BEHIND WALL MOUNTED OBJECT U.N.O.

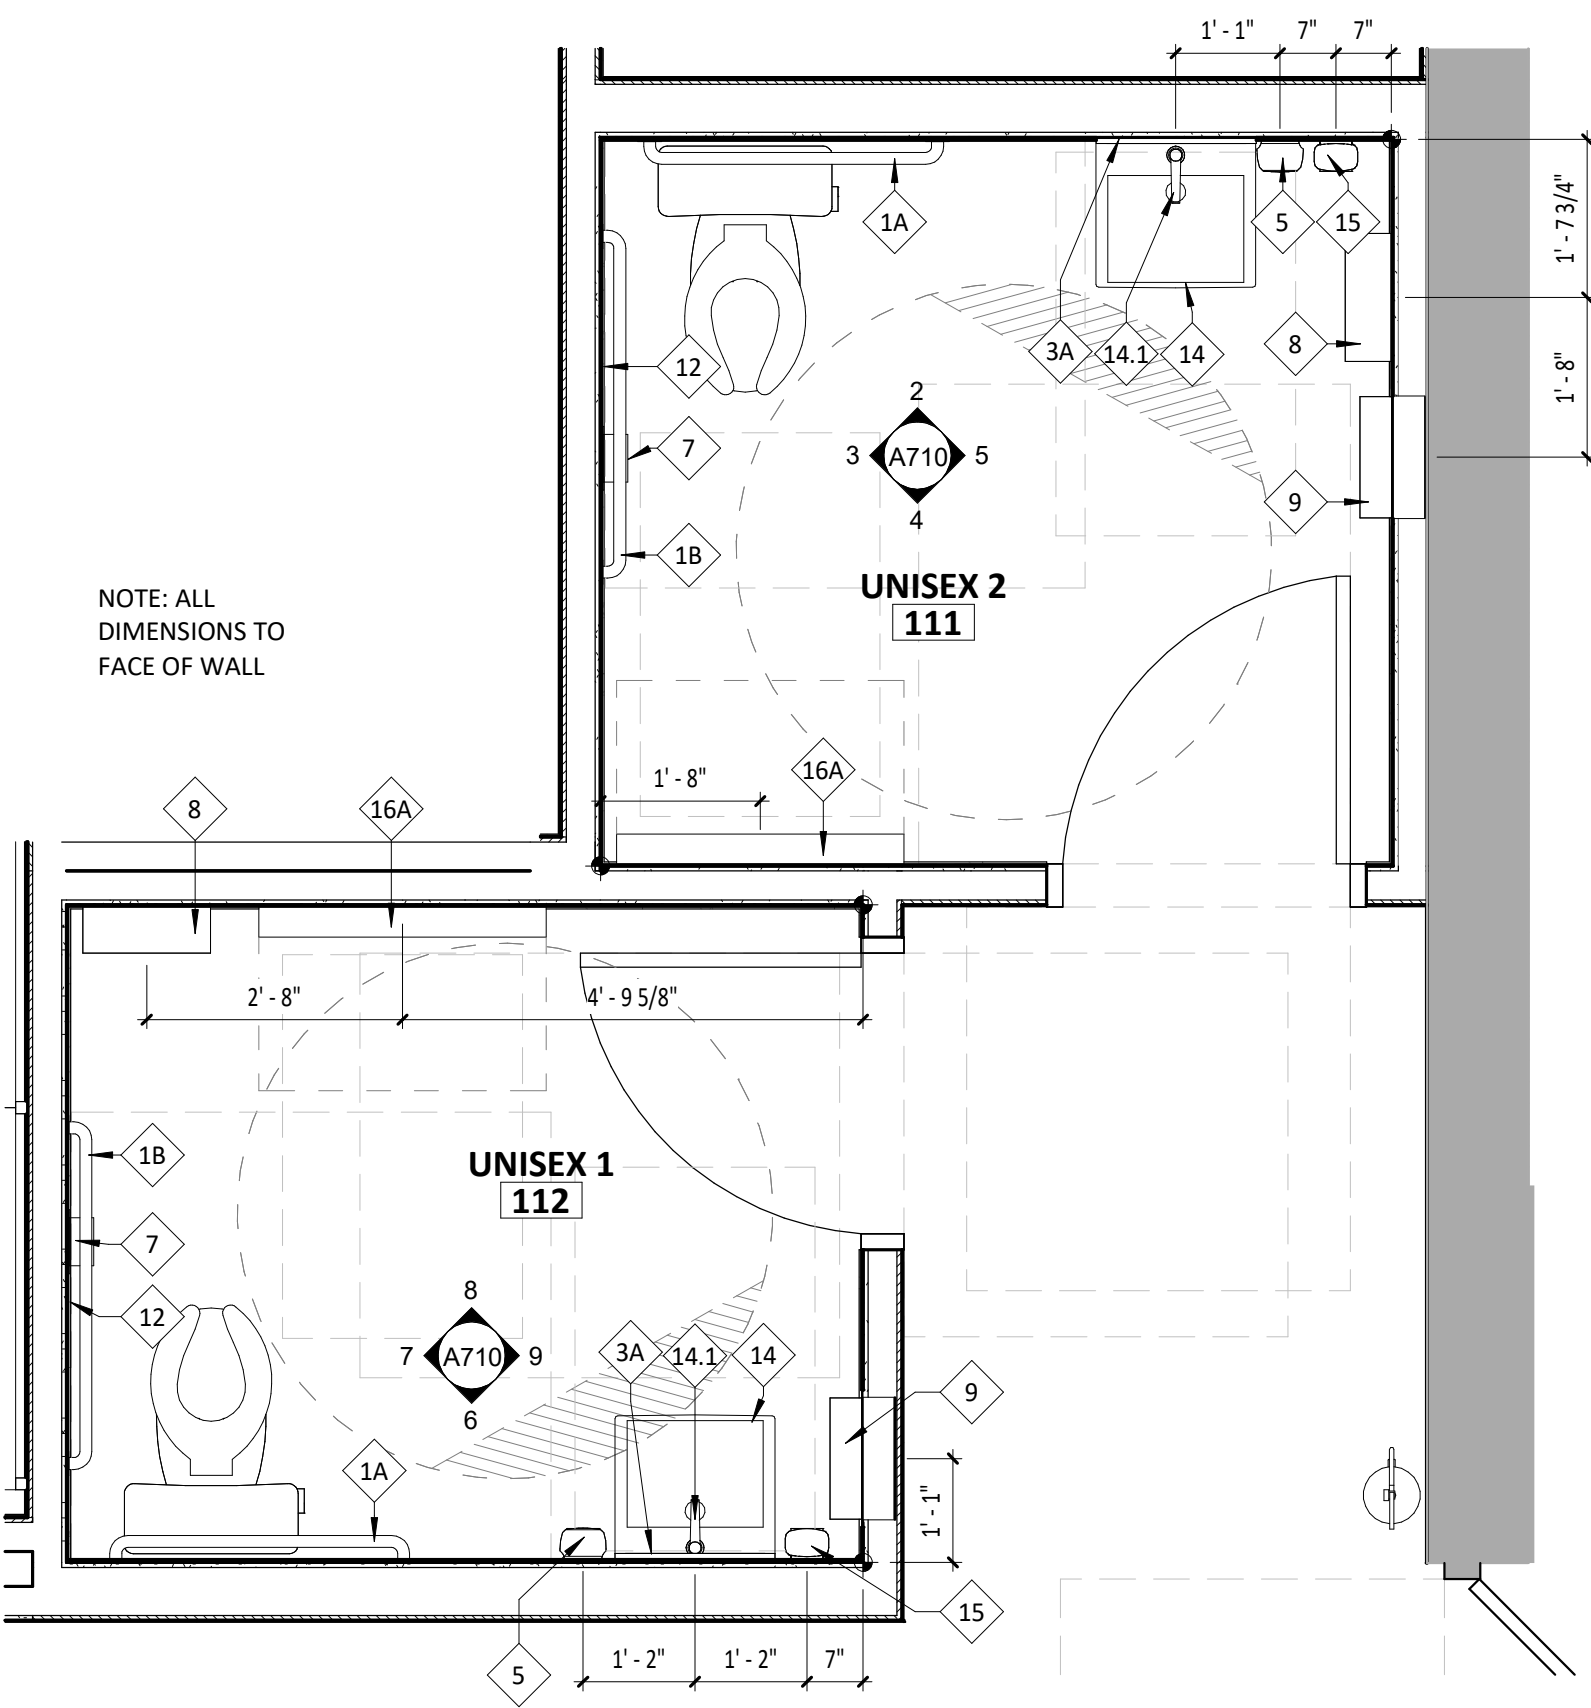


1 ENLARGED PLAN
SCALE: 1/2" = 1'-0"

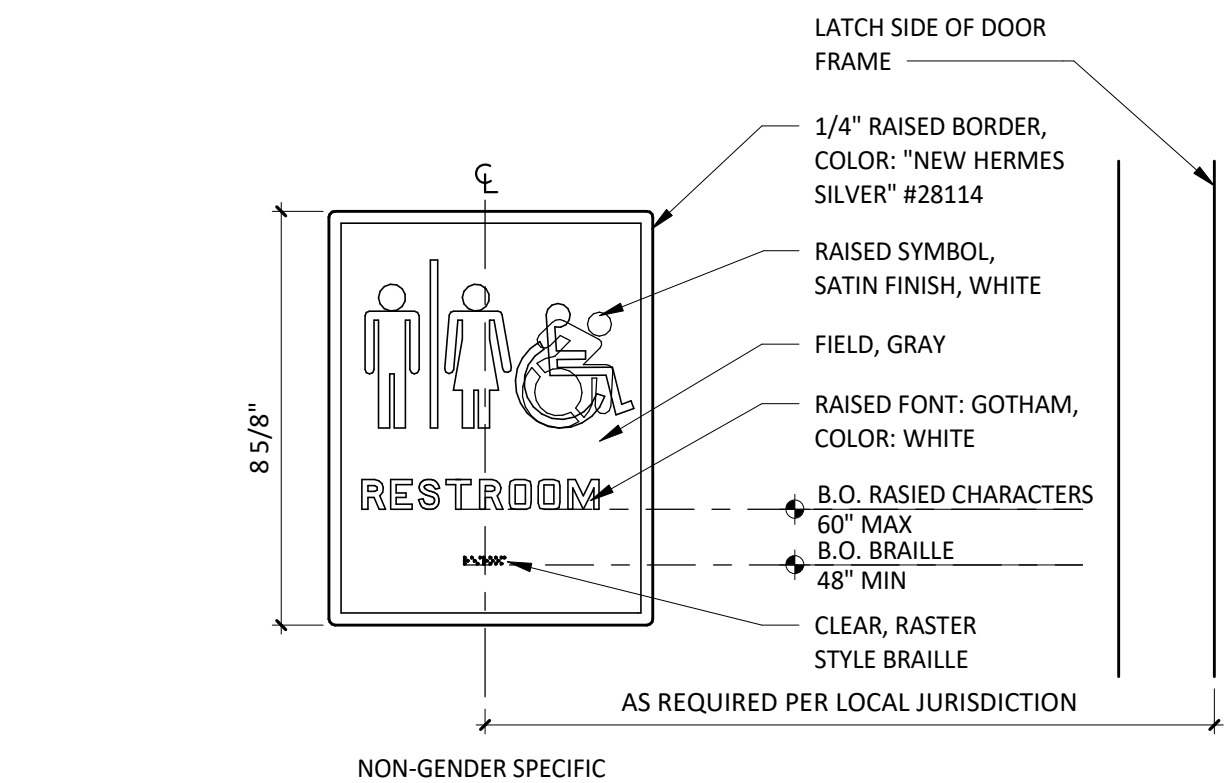


10 TYPICAL RESTROOM SIGNAGE
SCALE: 3" = 1'-0"

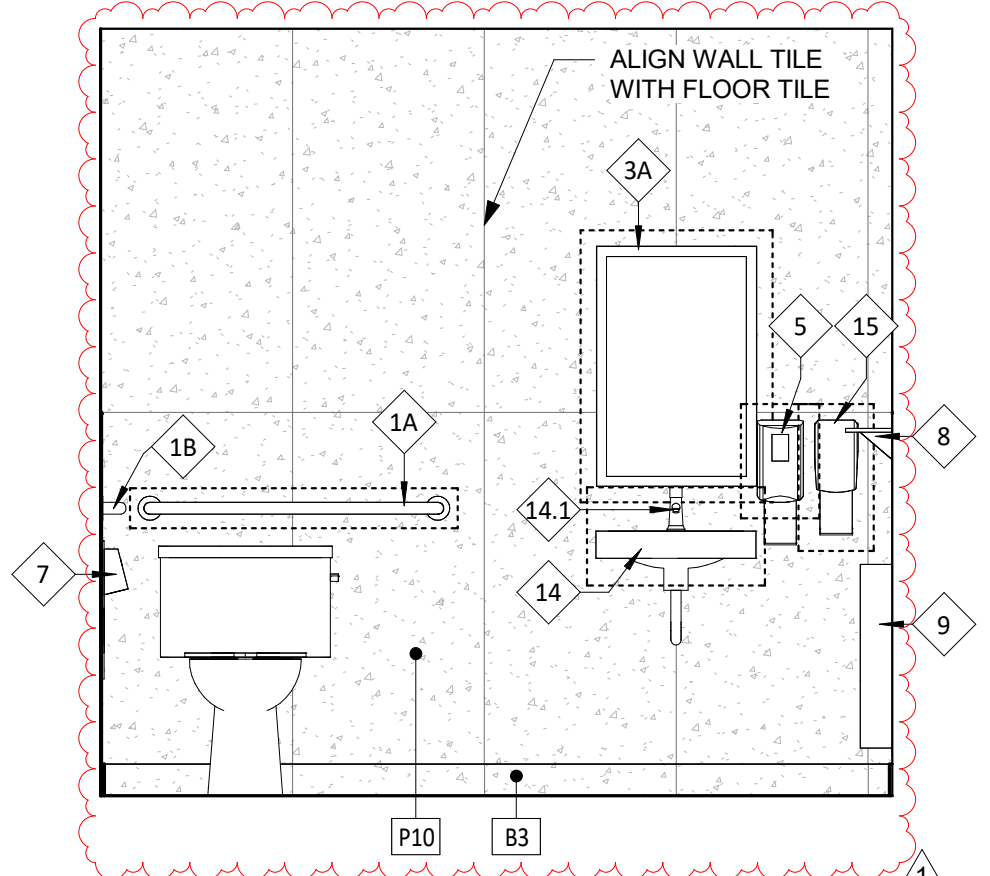


2 RESTROOM 1
SCALE: 1/2" = 1'-0"

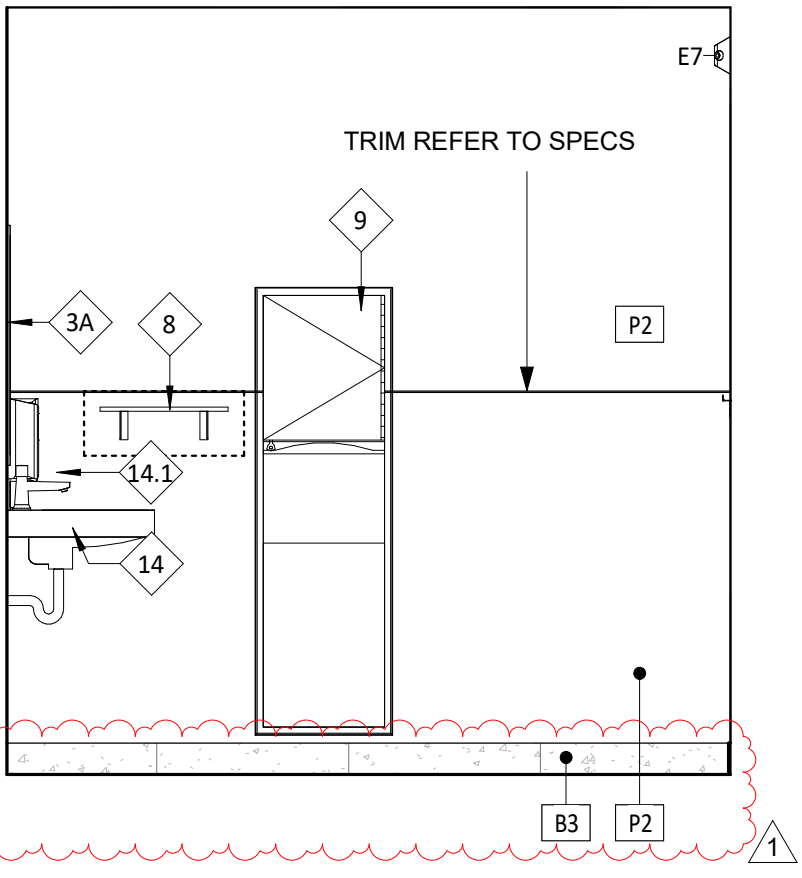


5 RESTROOM 1
SCALE: 1/2" = 1'-0"

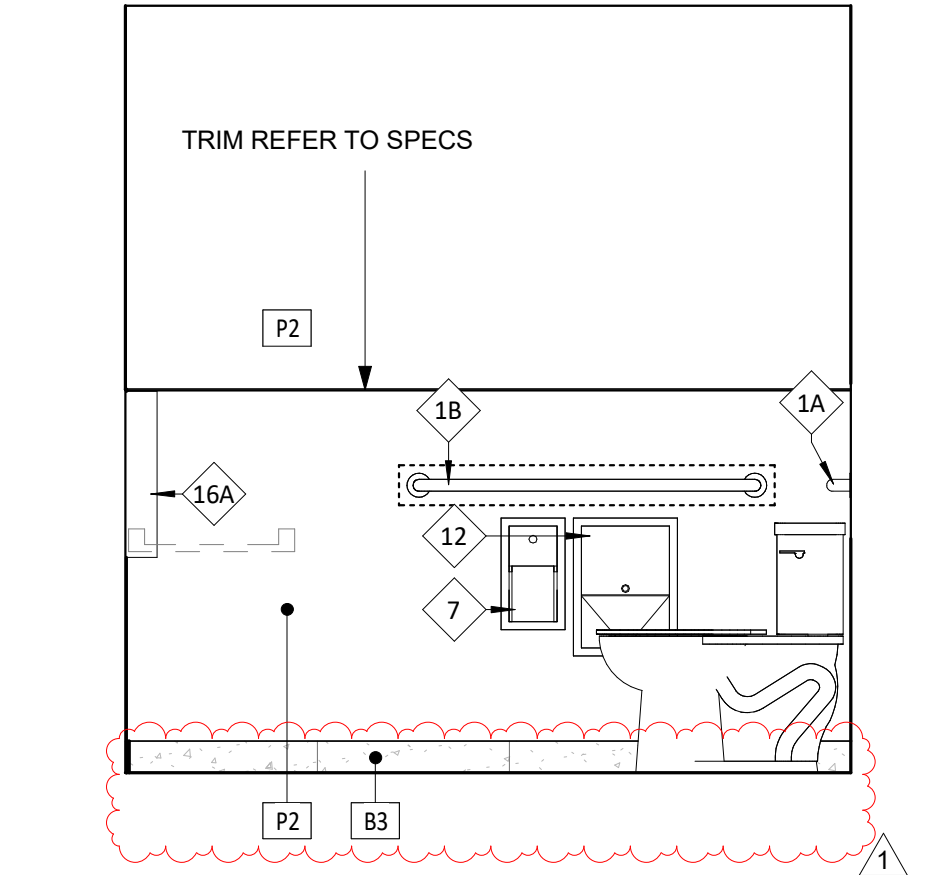


3 RESTROOM 1
SCALE: 1/2" = 1'-0"

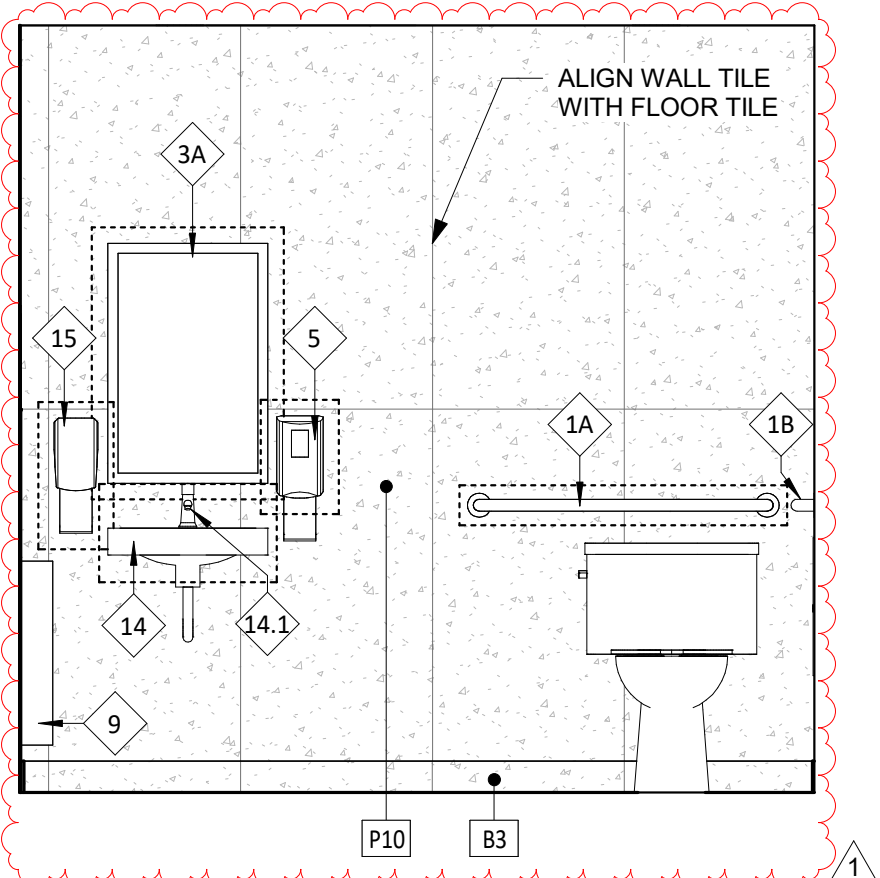


6 RESTROOM 2
SCALE: 1/2" = 1'-0"

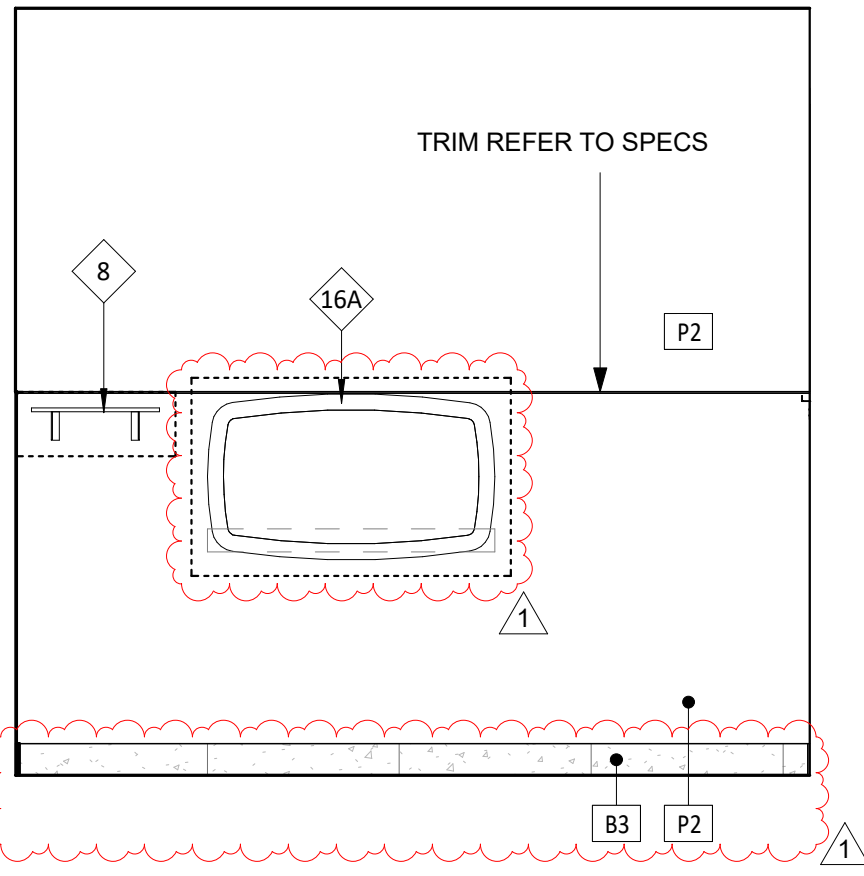


8 RESTROOM 2
SCALE: 1/2" = 1'-0"

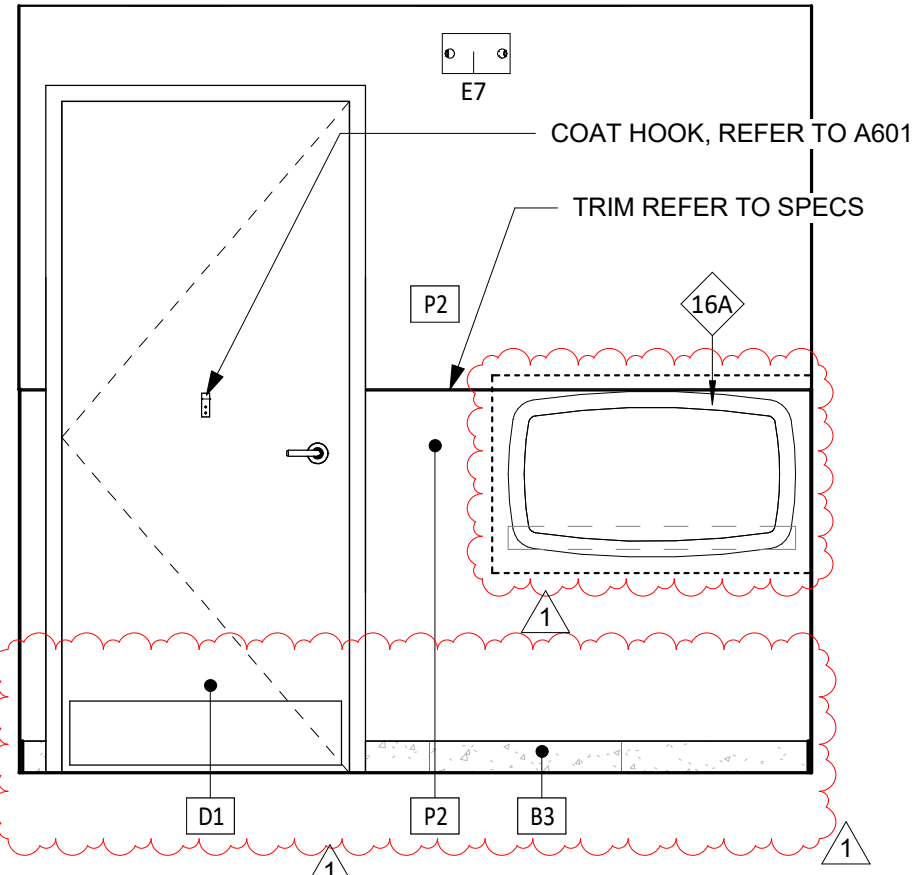

4 RESTROOM 1
SCALE: 1/2" = 1'-0"

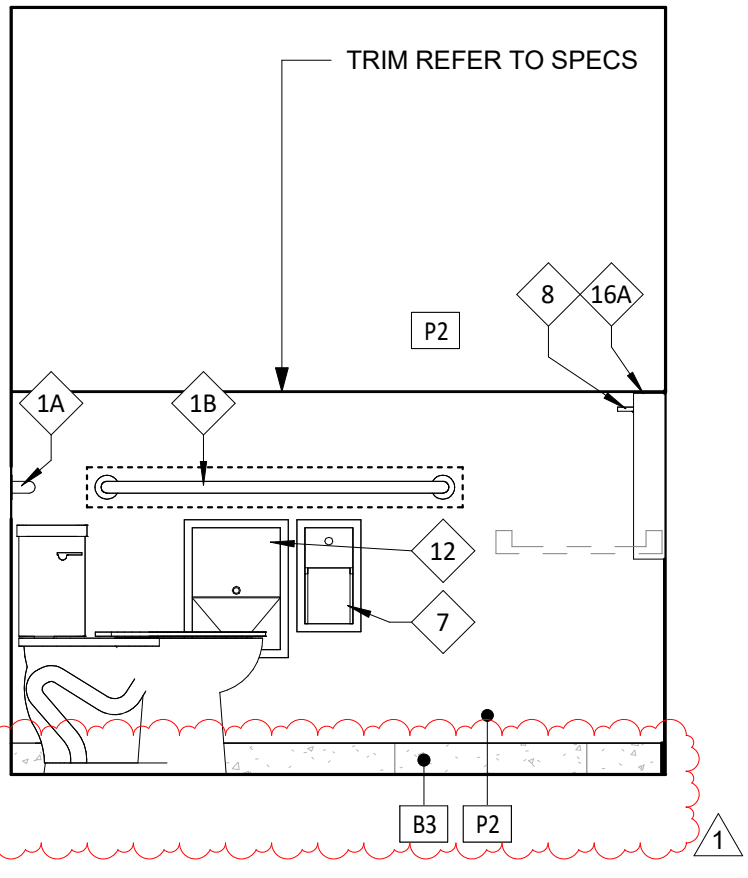

7 RESTROOM 2
SCALE: 1/2" = 1'-0"

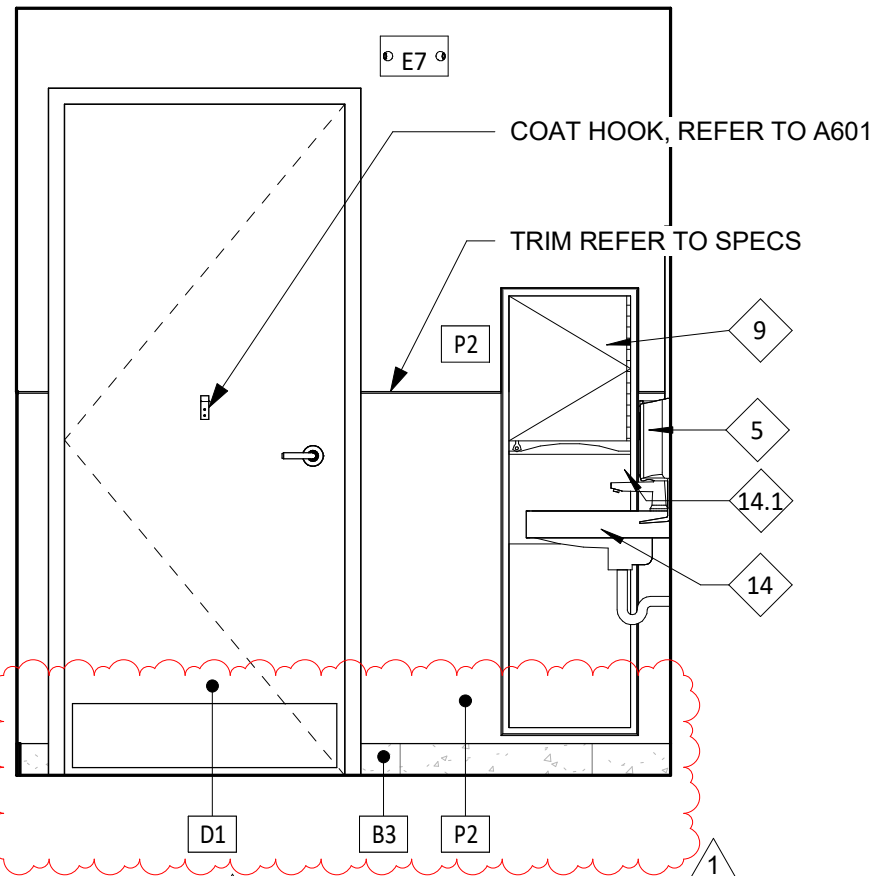

9 RESTROOM 2
SCALE: 1/2" = 1'-0"

CONSULTANT:



CLIENT:




CHIPOTLE MEXICAN GRILL, INC.
PO BOX 18296
COLUMBUS, OH 43218-2968
TELEPHONE: (614) 318-2682
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

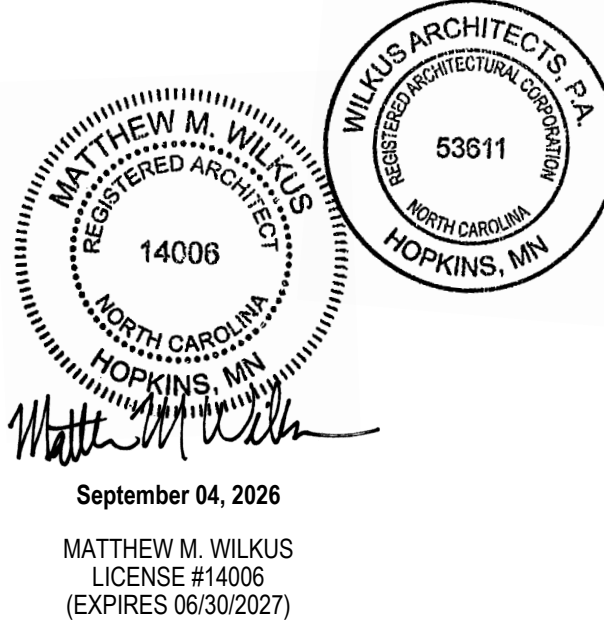

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA


ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES


TITLE:
RESTROOM INFORMATION

SHEET NUMBER:


A710

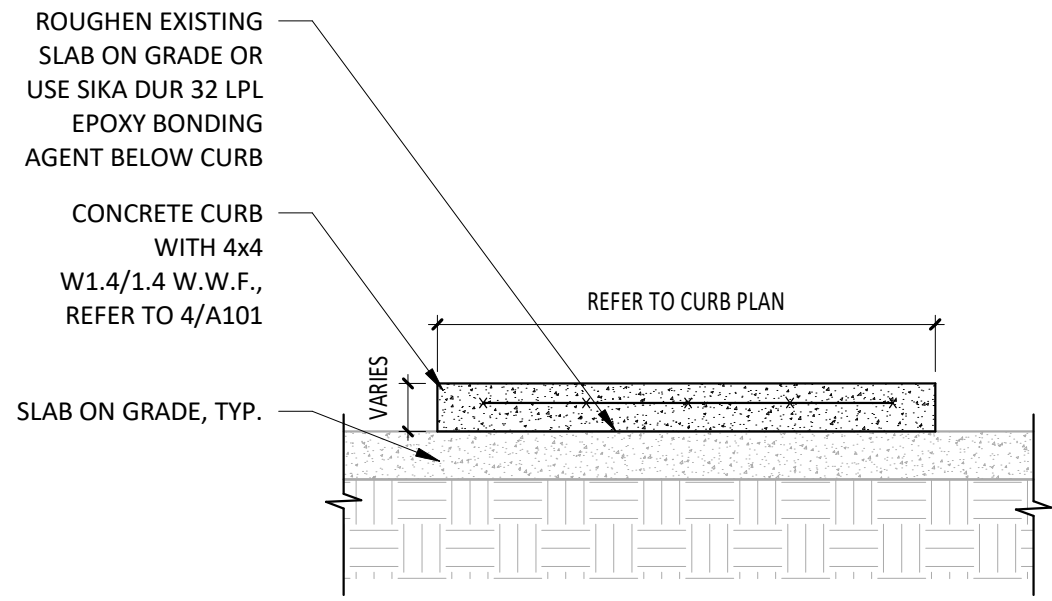


1 DETAIL @ CONCRETE CURB
SCALE: 3/4" = 1'-0"

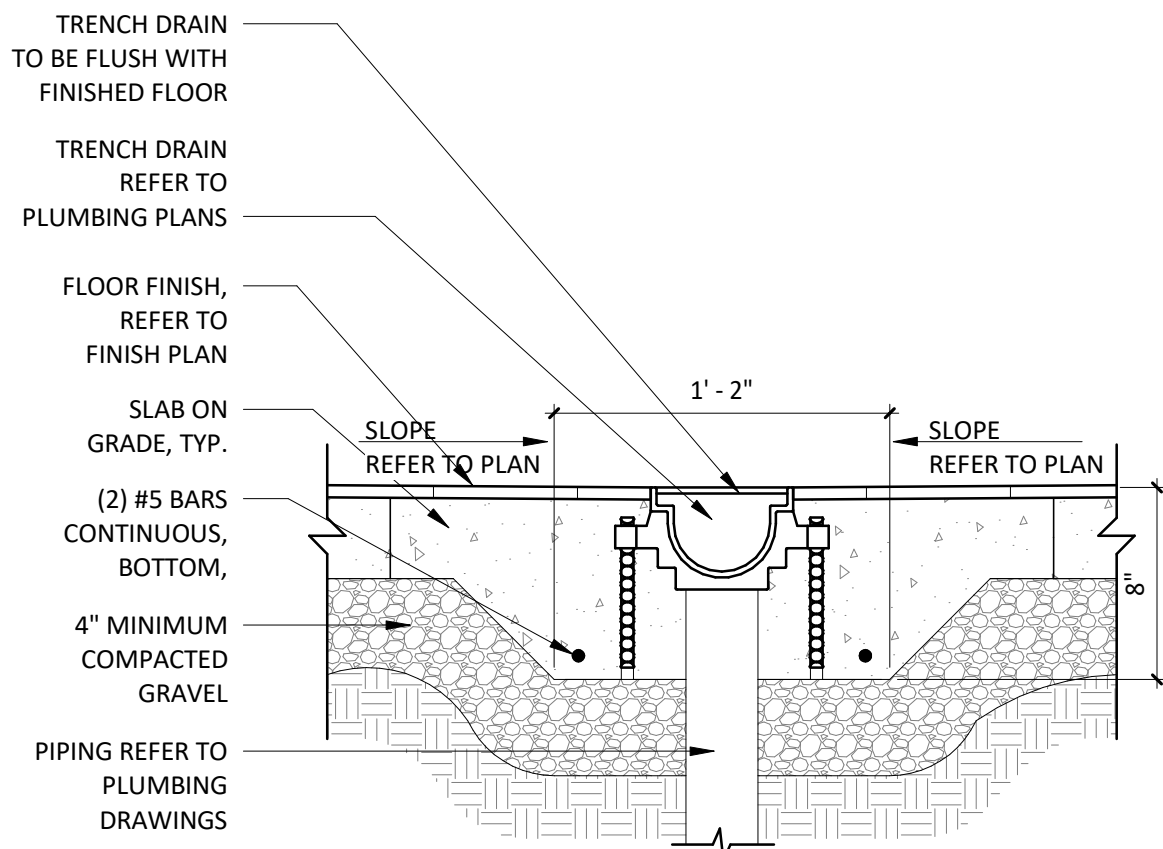


2 DETAIL @ TRENCH DRAIN
SCALE: 1 1/2" = 1'-0"

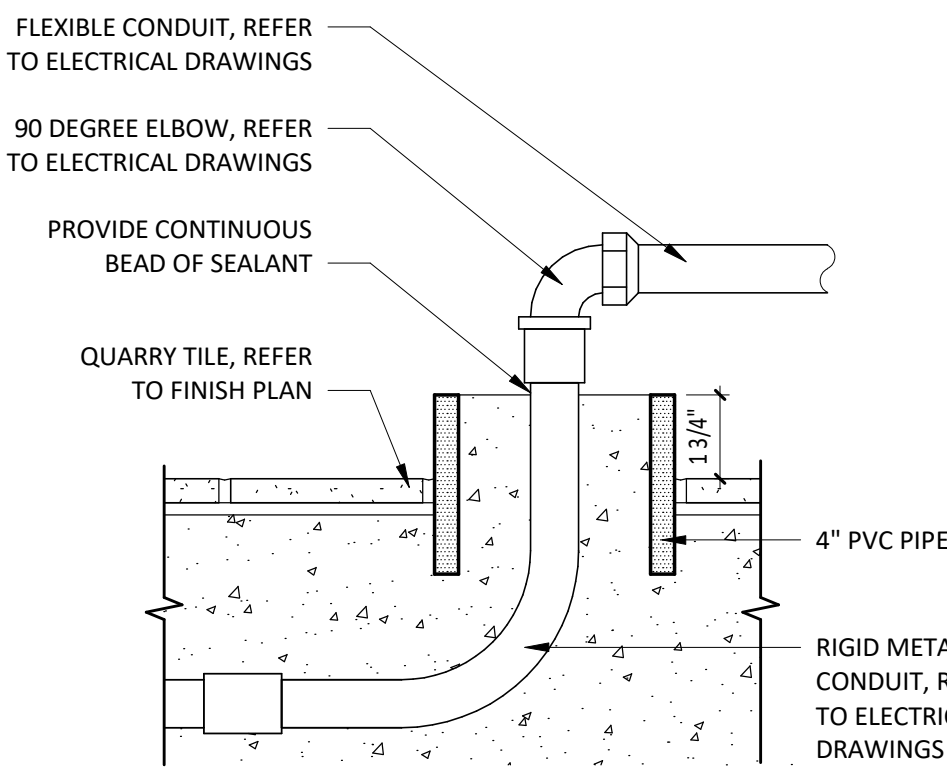


3 SECTION @ STUB LOCATION UNDER TABLES
SCALE: 3" = 1'-0"

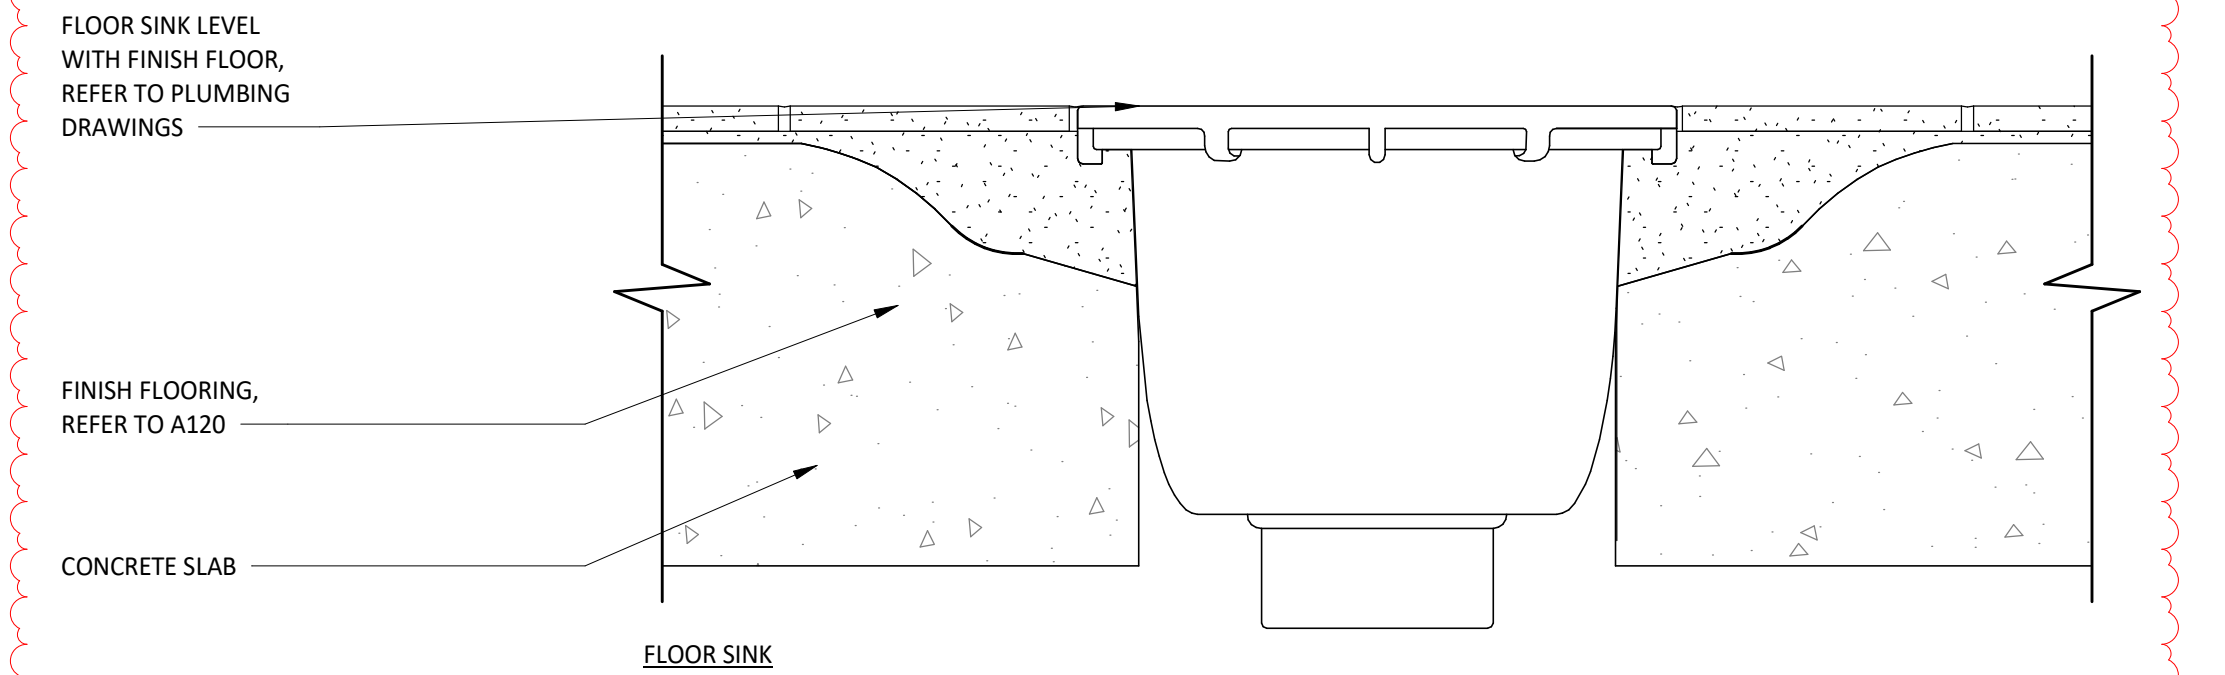


4 SECTION @ QT FLOOR DRAIN/SINK - TYP.
SCALE: 3" = 1'-0"

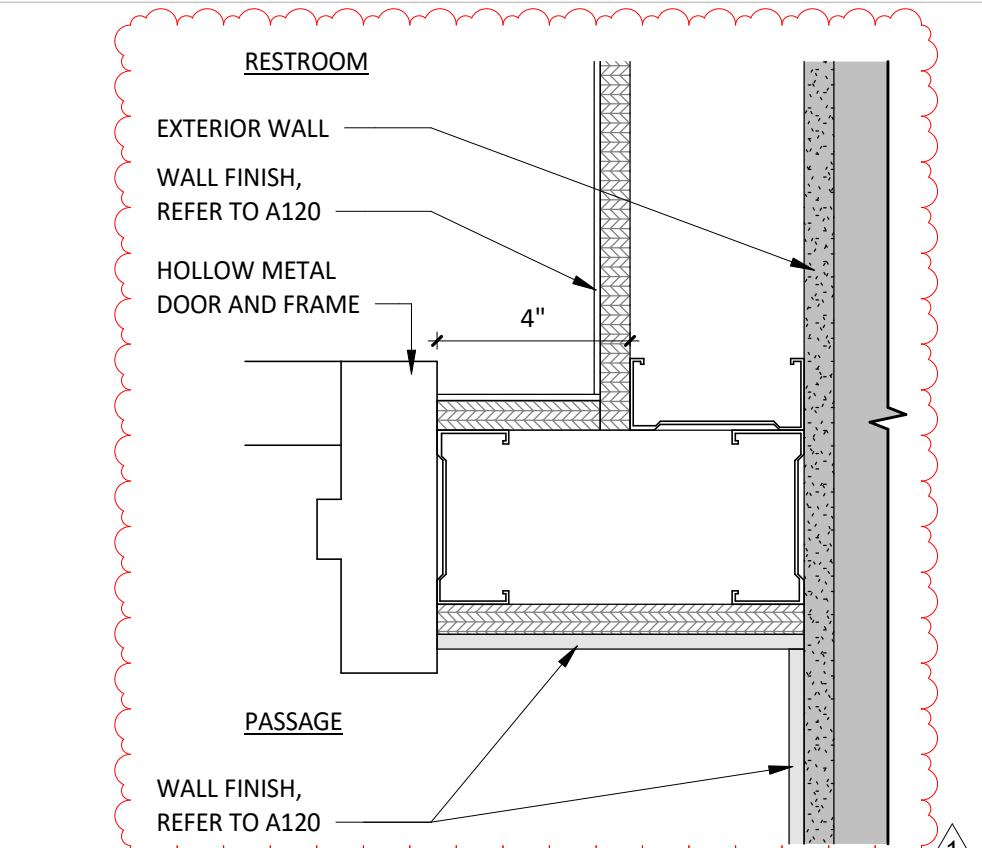


5 DETAIL @ DOOR JAMB
SCALE: 3" = 1'-0"

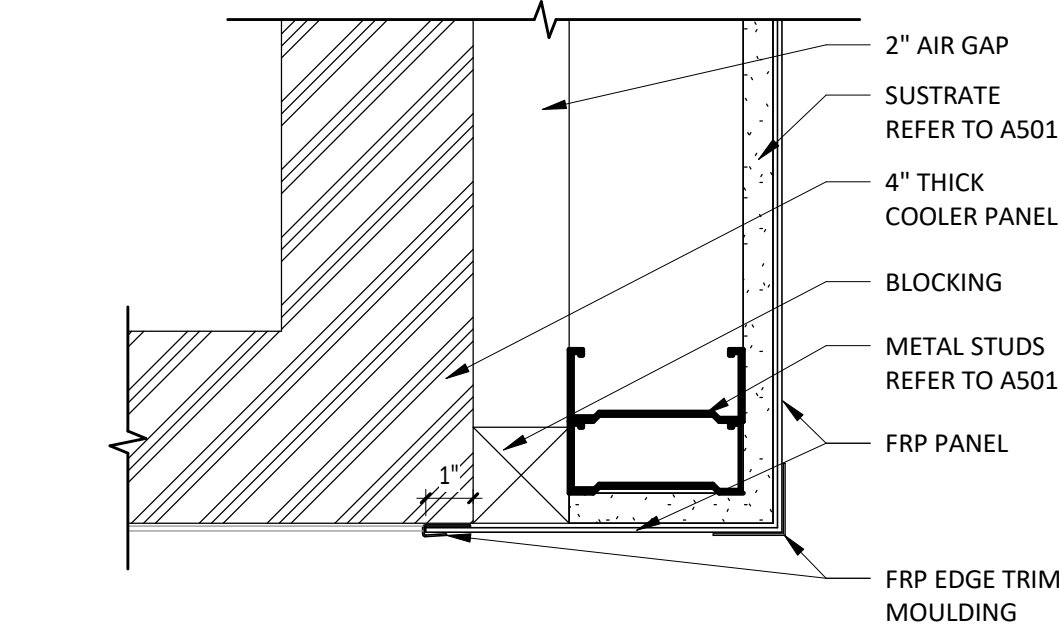


6 DETAIL @ FRP TO COOLER CLOSER STRIP
SCALE: 3" = 1'-0"

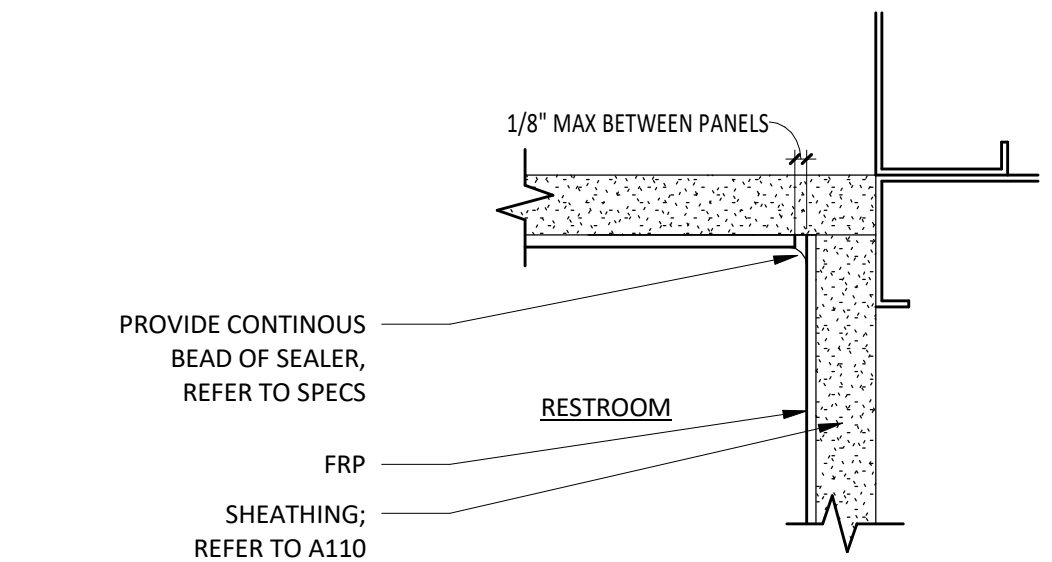



7A PLAN - RR FRP INSIDE CORNER
SCALE: 6" = 1'-0"

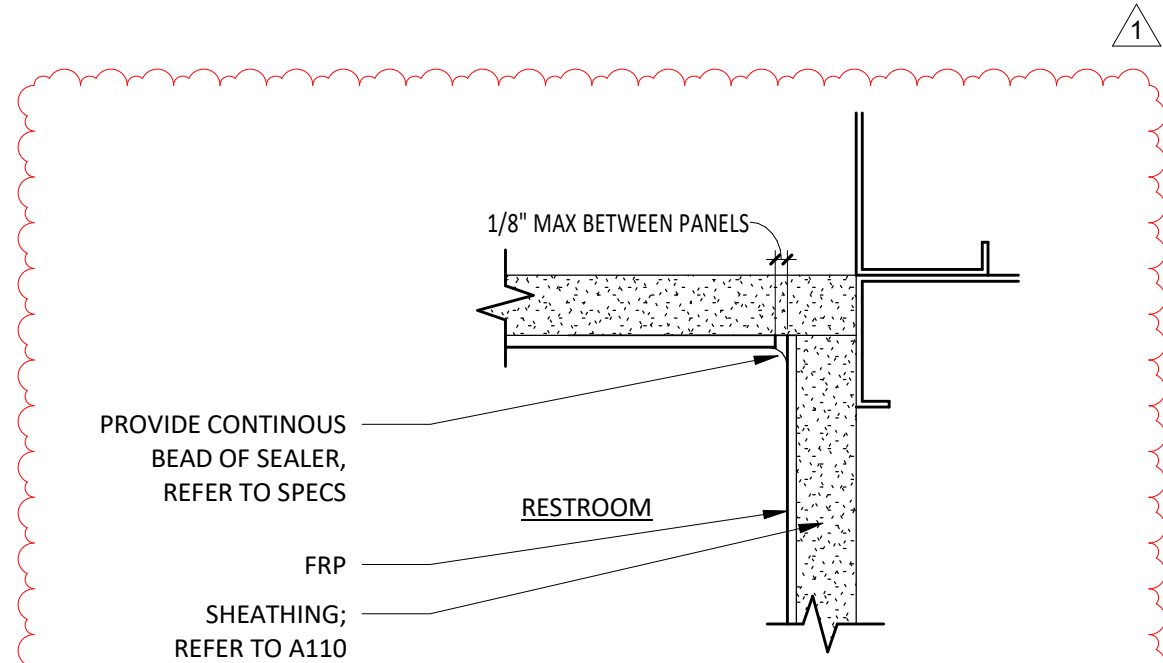


7B PLAN - RR FRP-TILE INSIDE CORNER
SCALE: 6" = 1'-0"

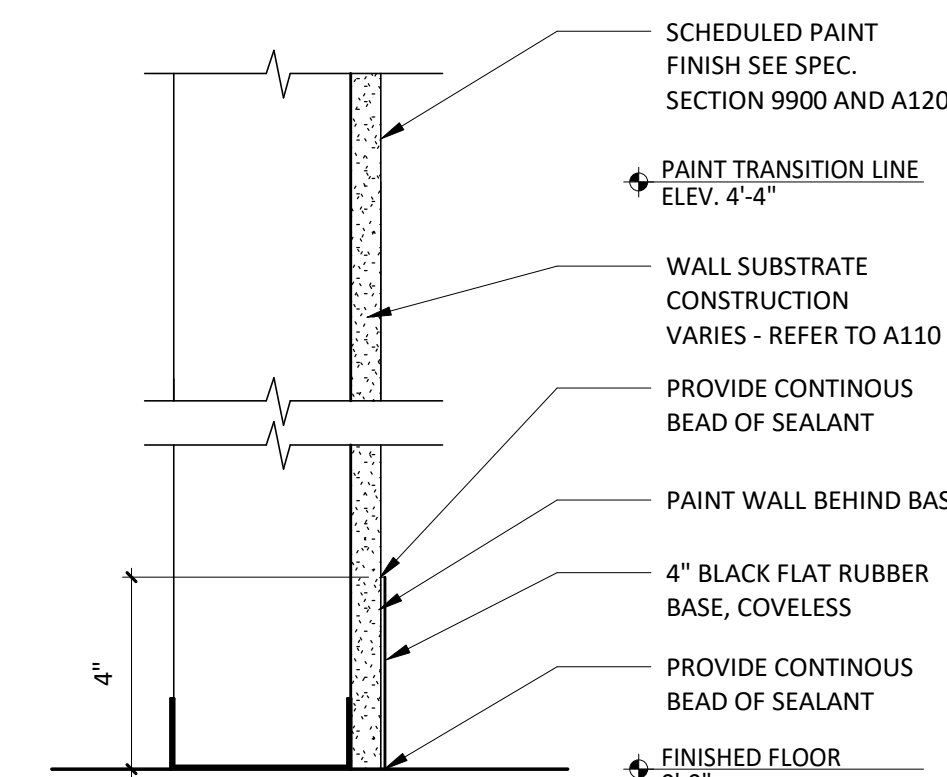


8 SECTION @ DINING ROOM WALL
SCALE: 3" = 1'-0"

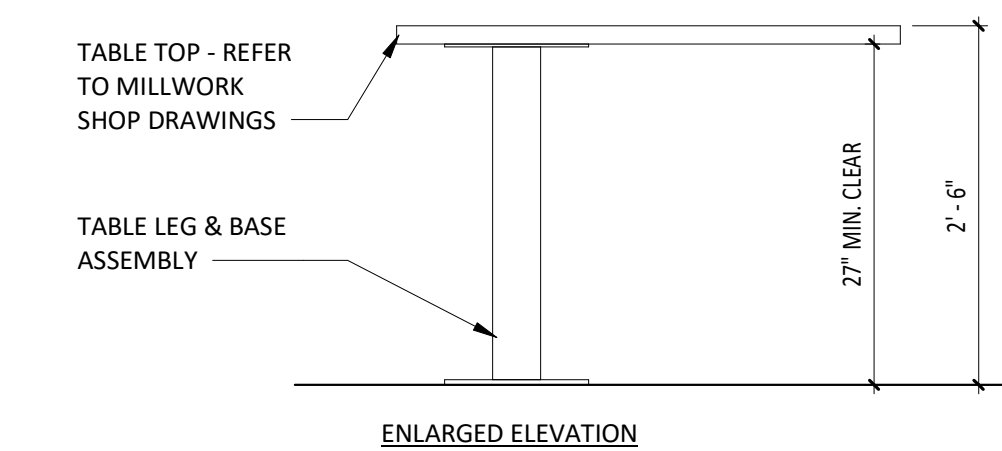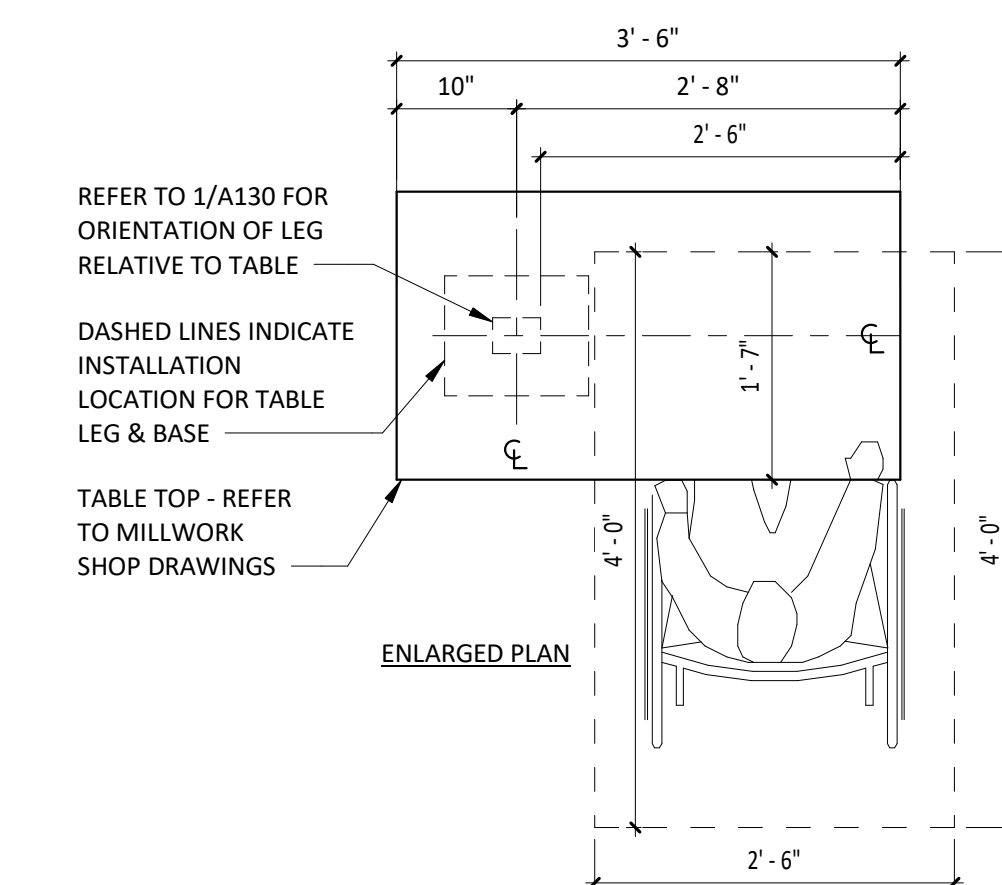


11 DETAIL @ ACCESSIBLE TABLE
SCALE: 3/4" = 1'-0"

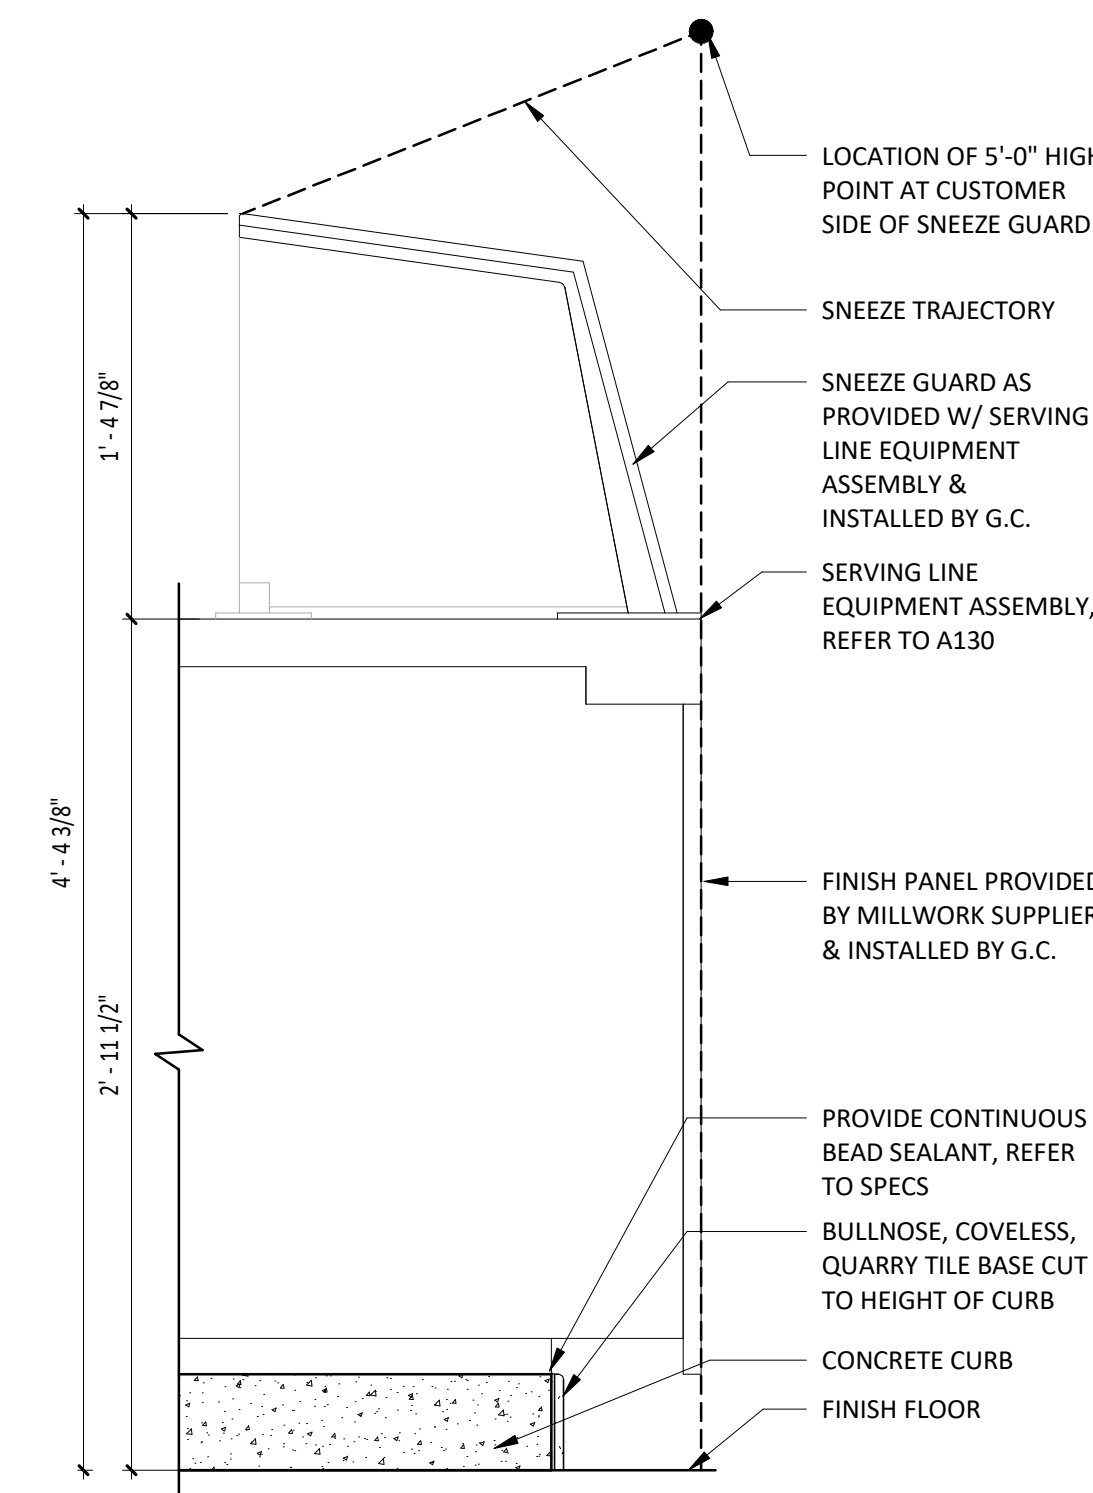

12 DETAIL @ SERVELINE SNEEZE GUARD
SCALE: 1 1/2" = 1'-0"

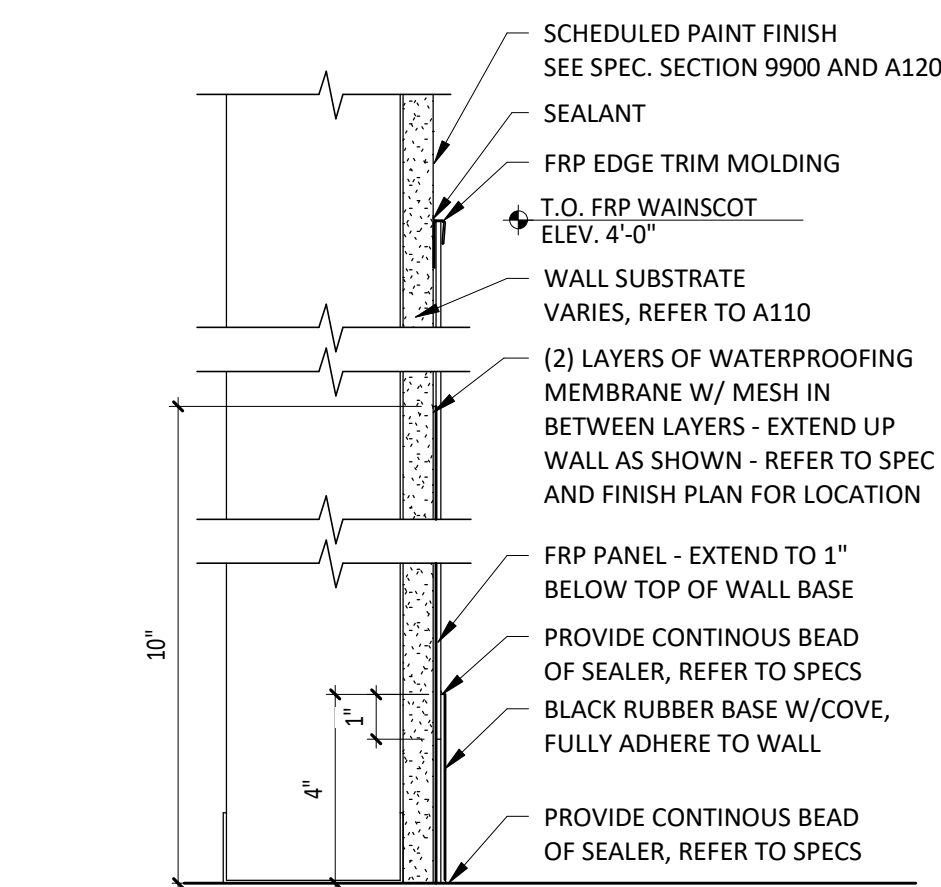

9 SECTION @ FRP WAINSCOT W/ RUBBER BASE
SCALE: 3" = 1'-0"

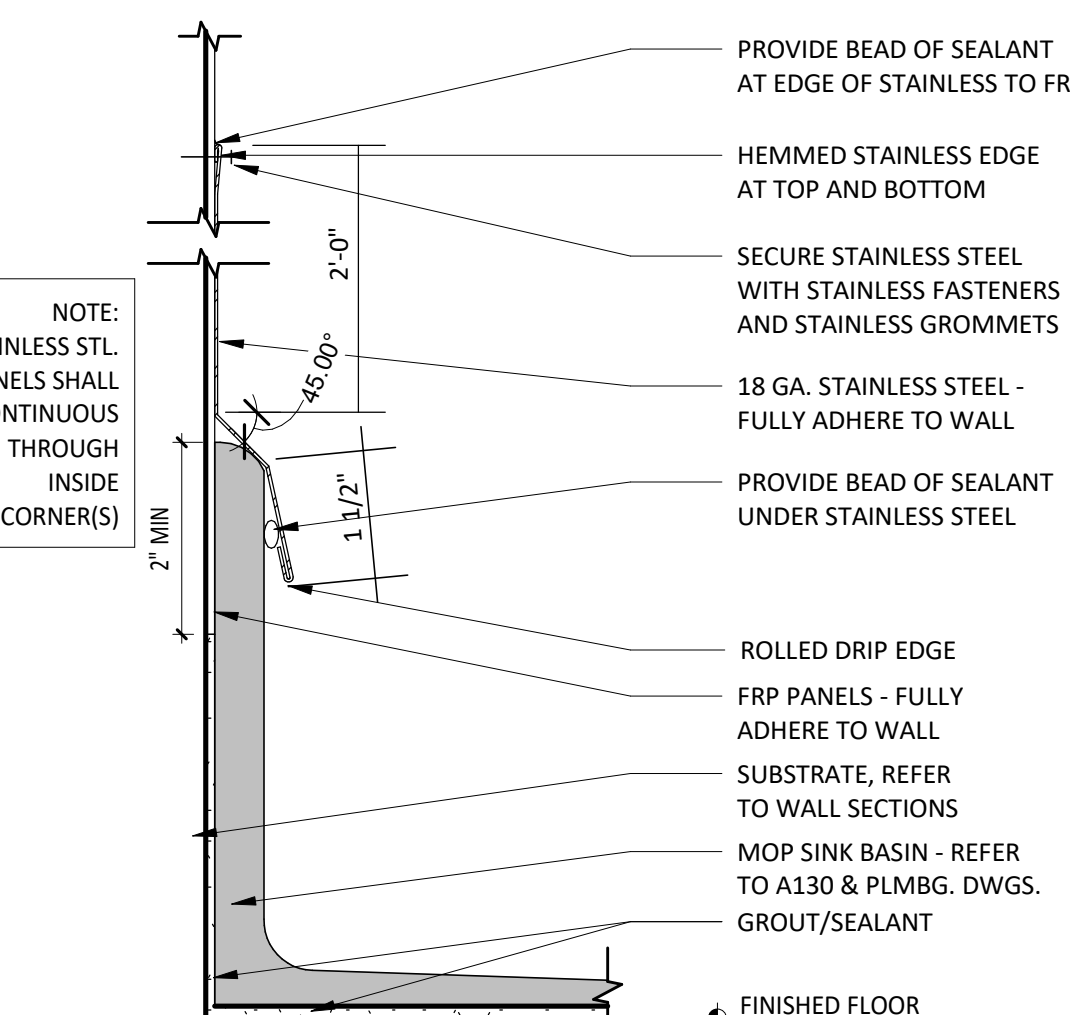

10 SECTION @ MOP SINK
SCALE: 6" = 1'-0"



CLIENT:


CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2682
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND
AS SUCH REMAINS THE PROPERTY OF CHIPOTLE
MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS
DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY
BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN
GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

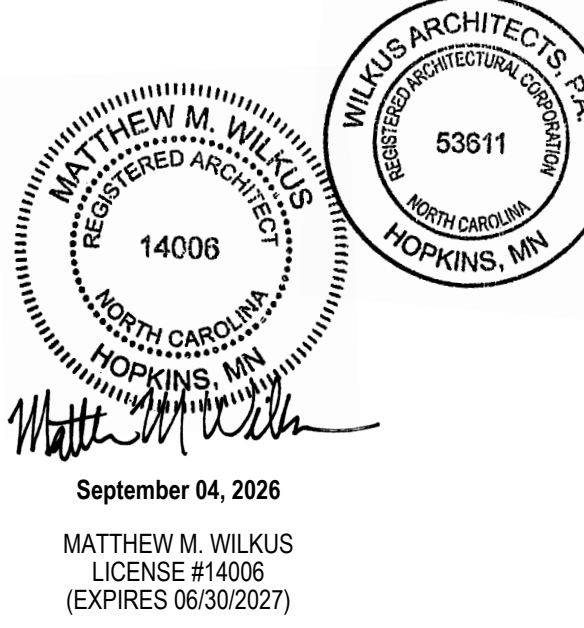

















PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA


















ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES

TITLE:
GENERAL DETAILS

SHEET NUMBER:
A801

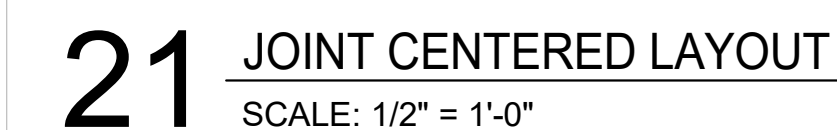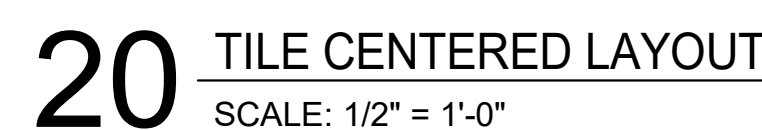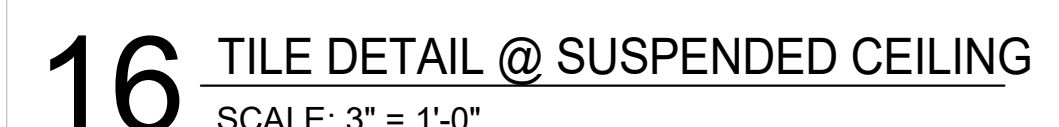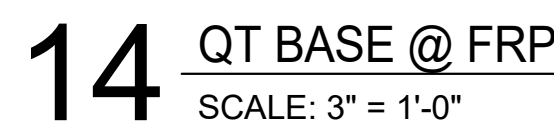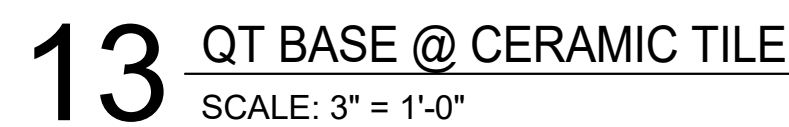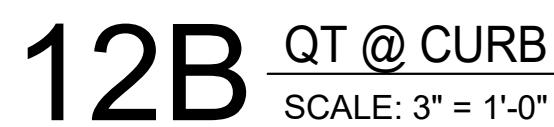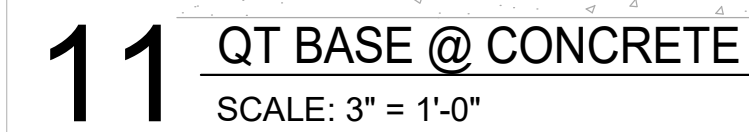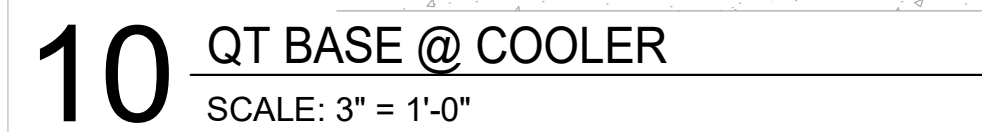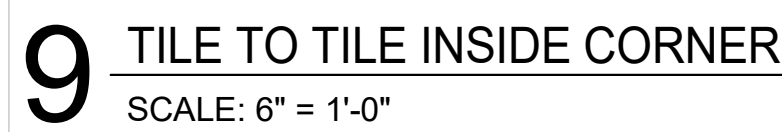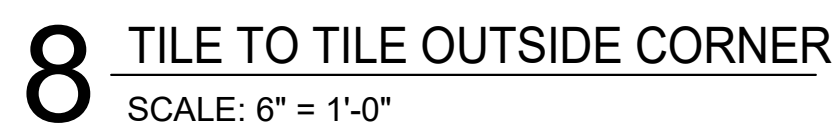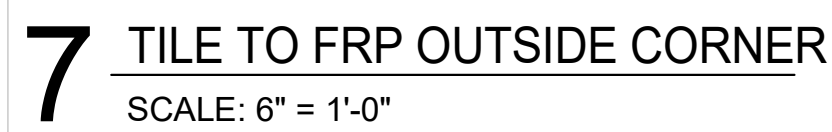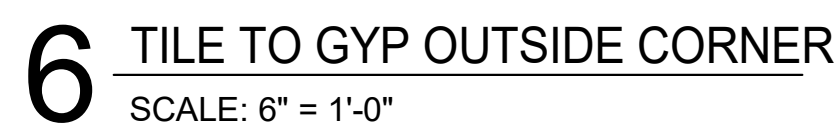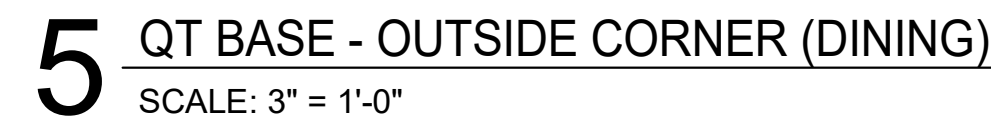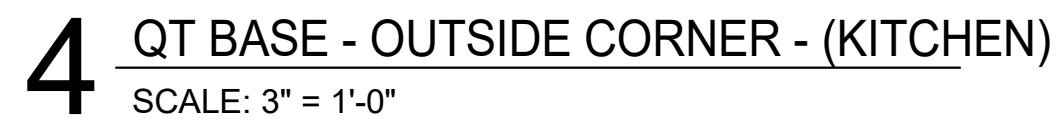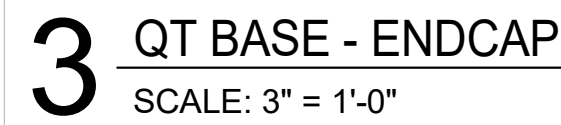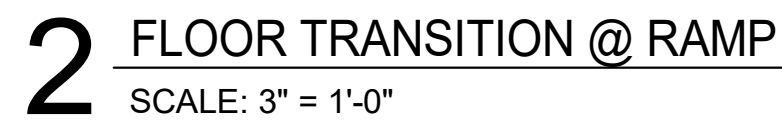

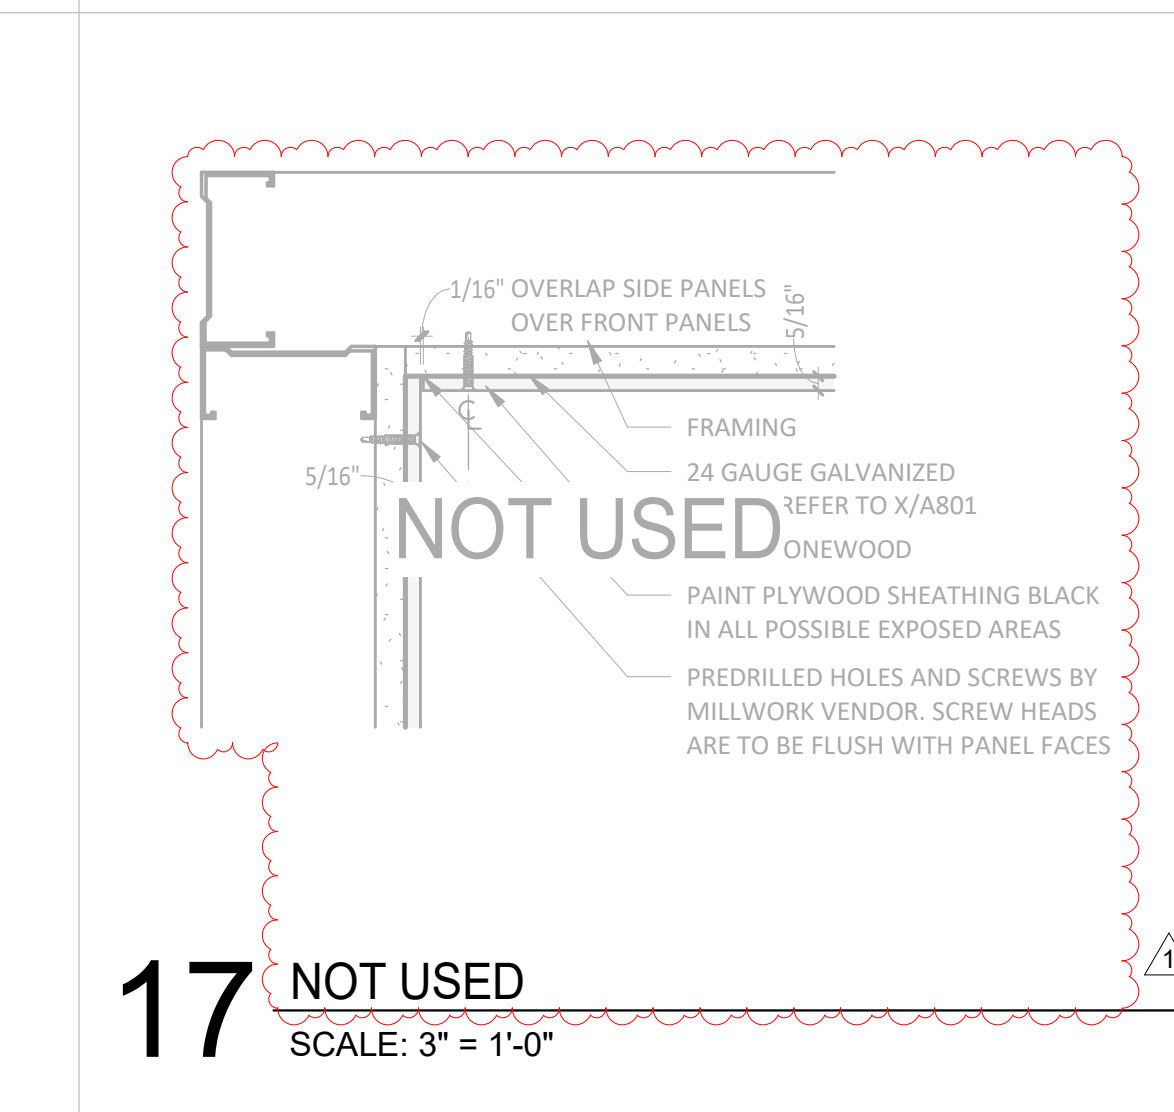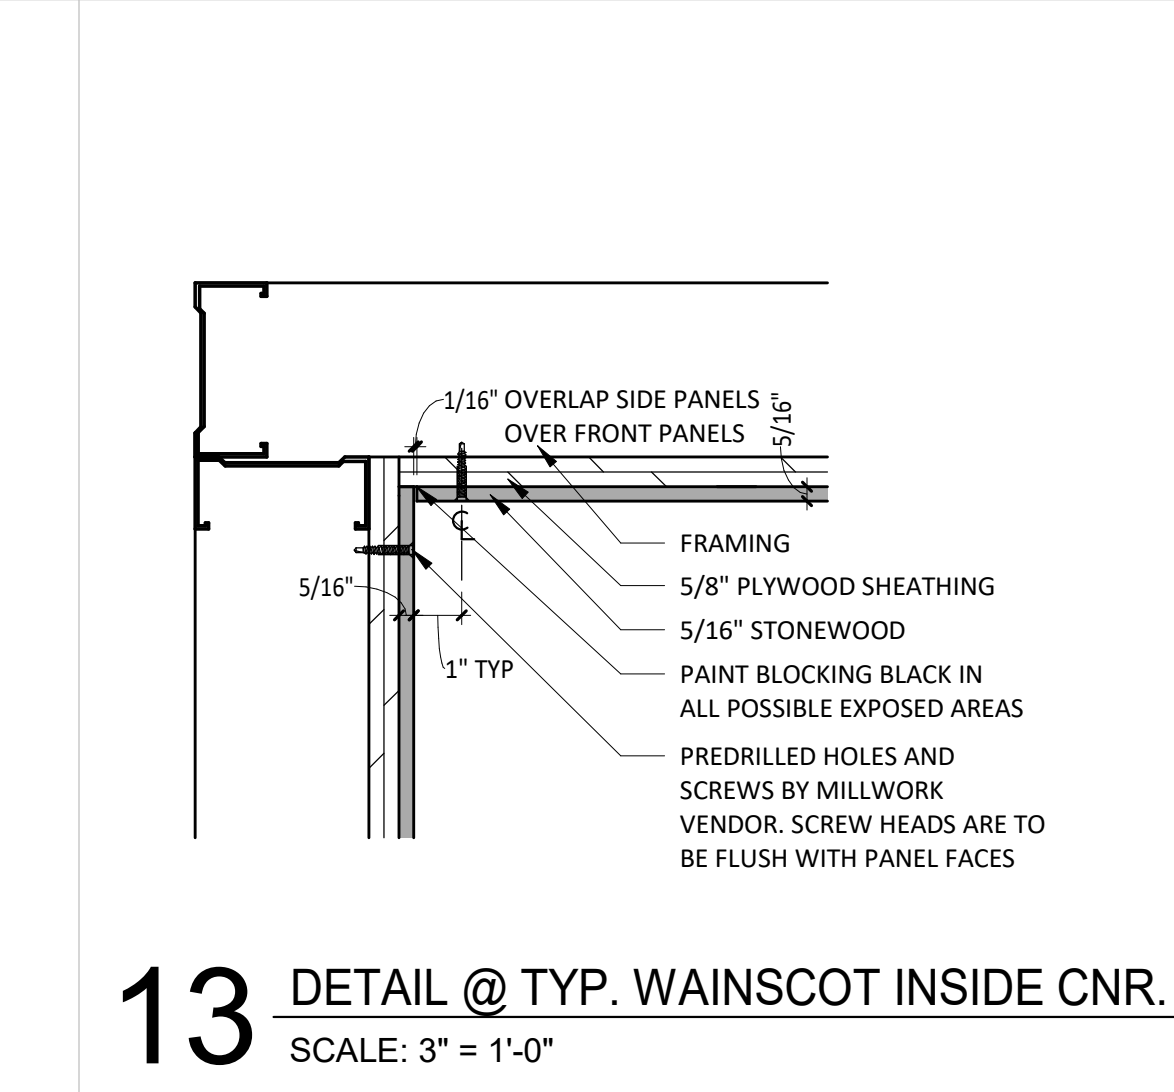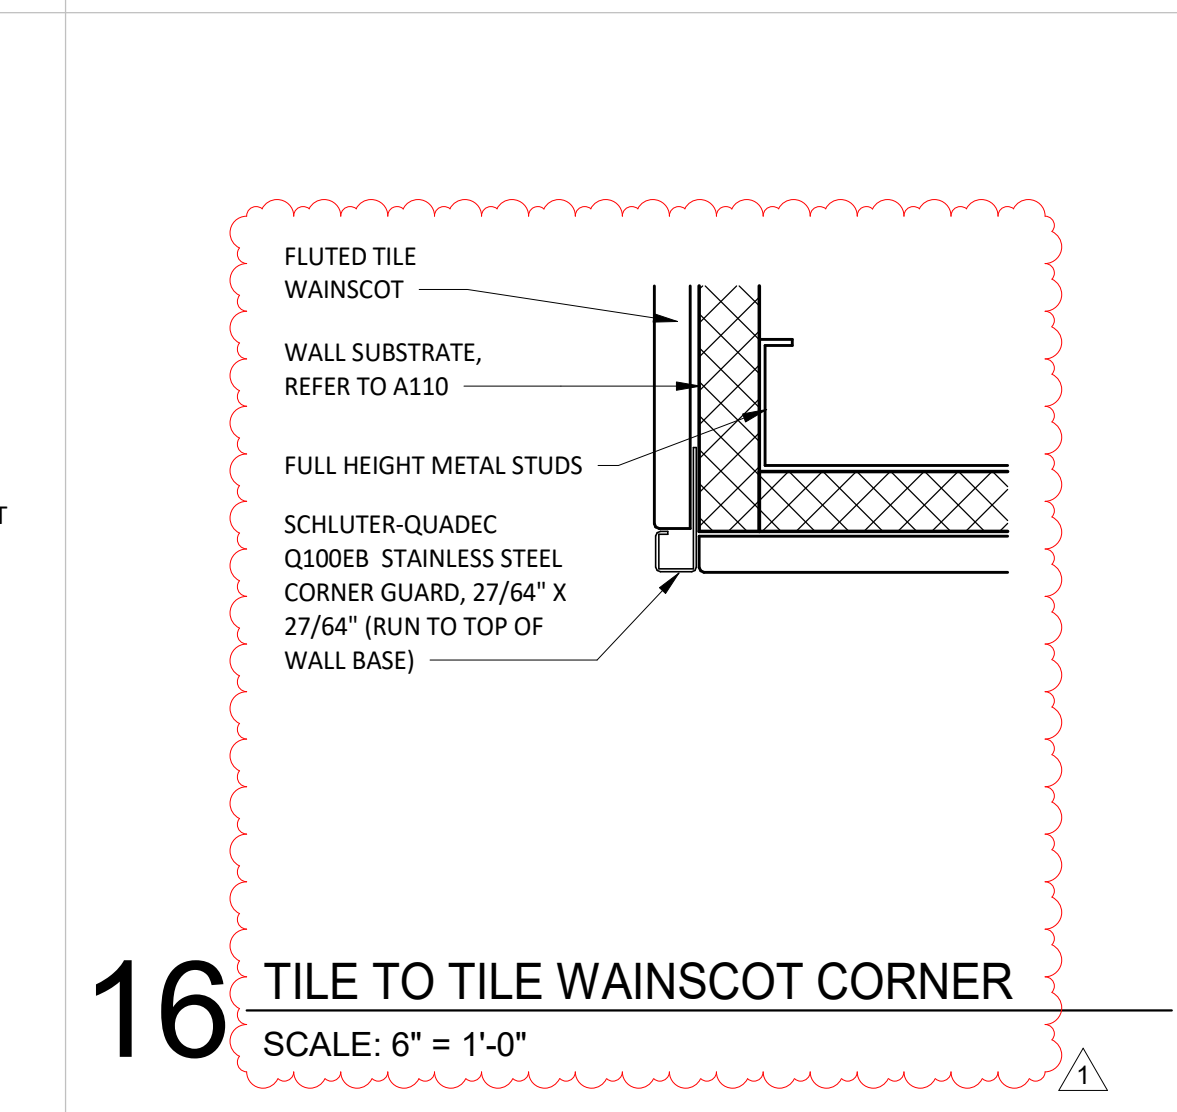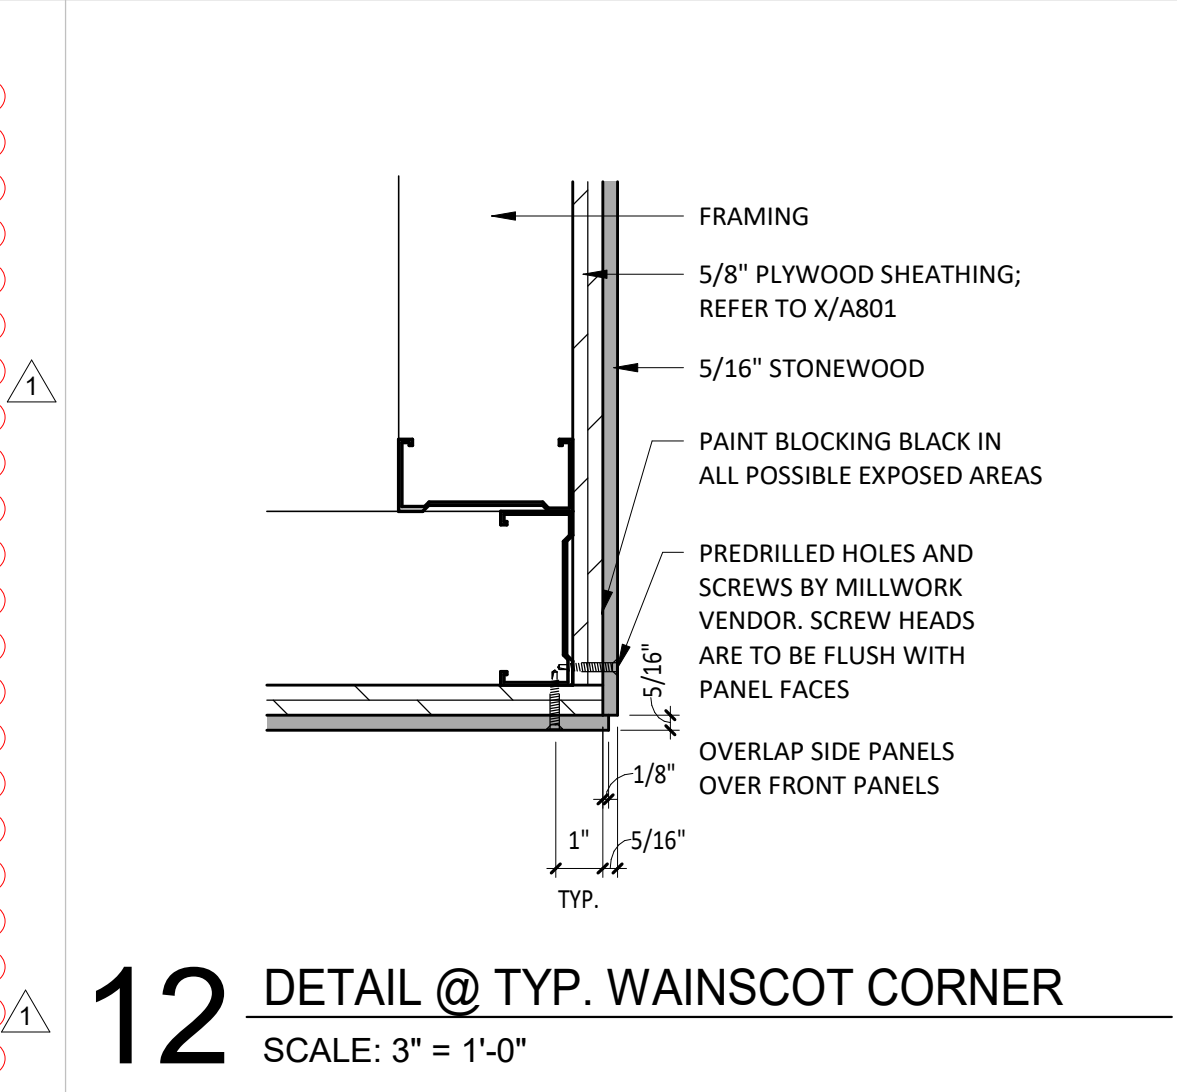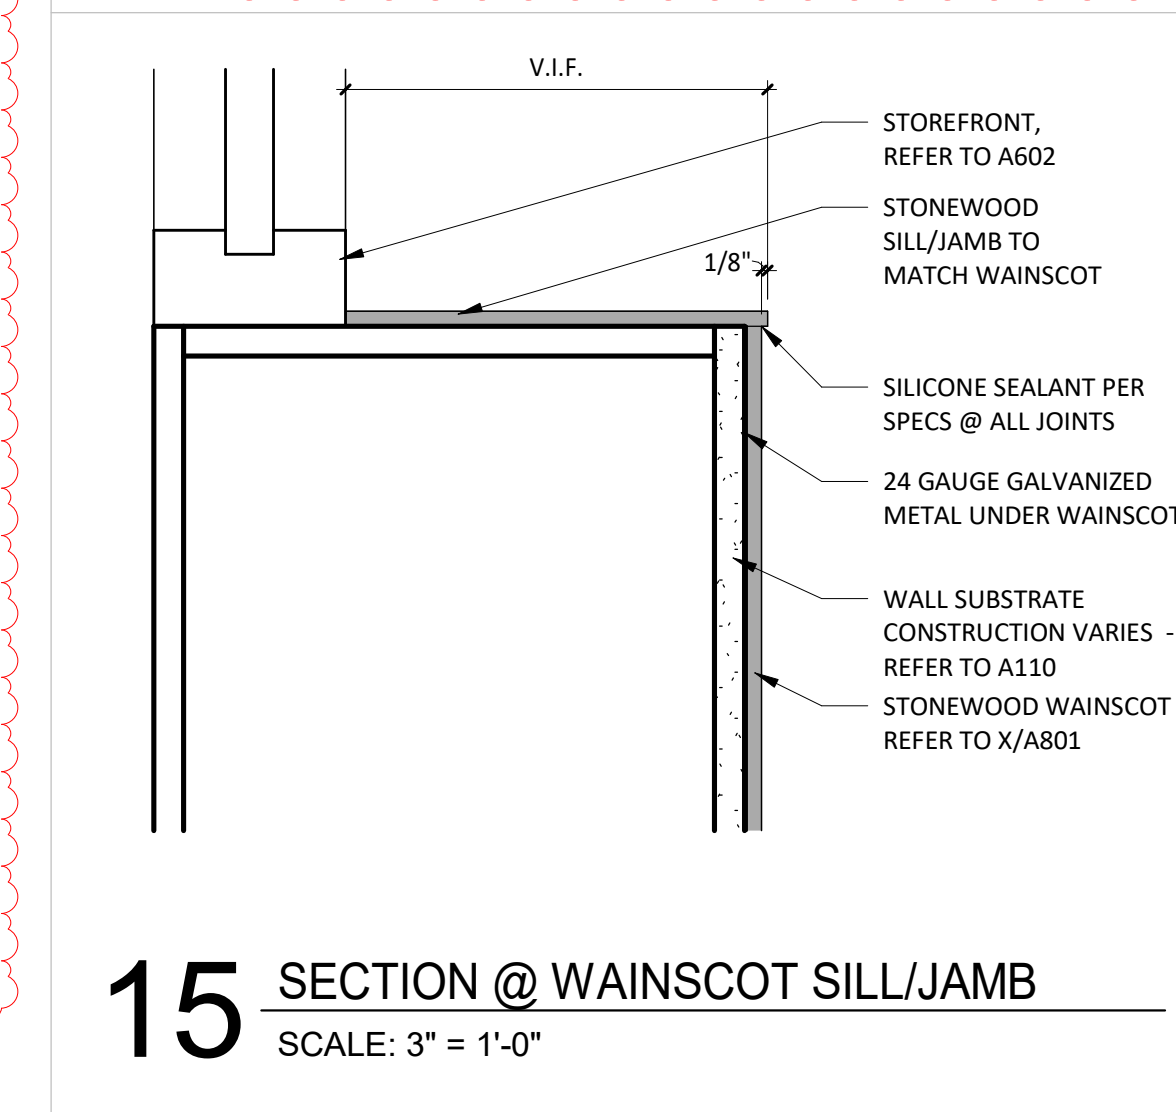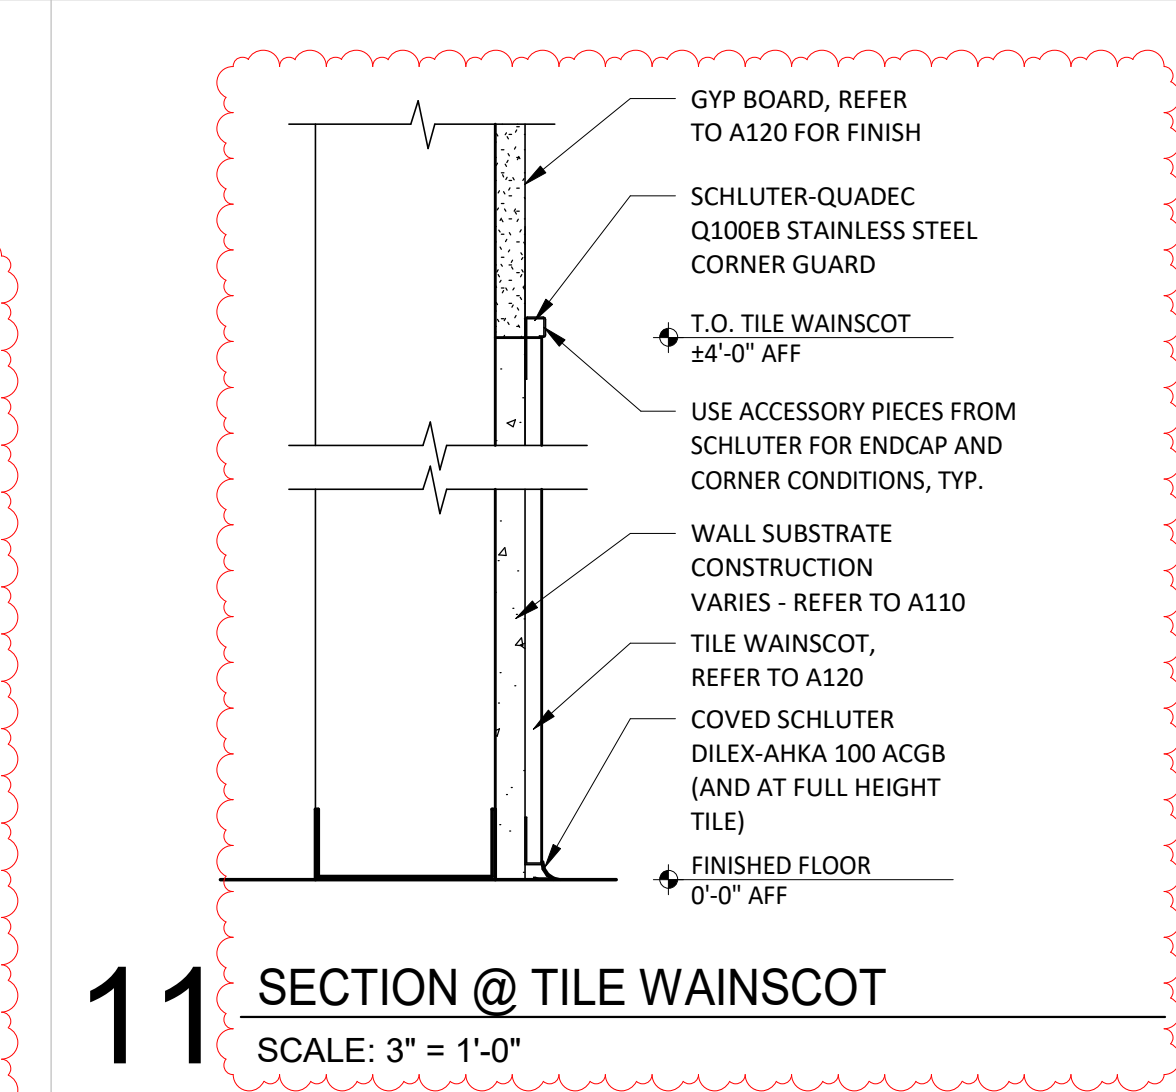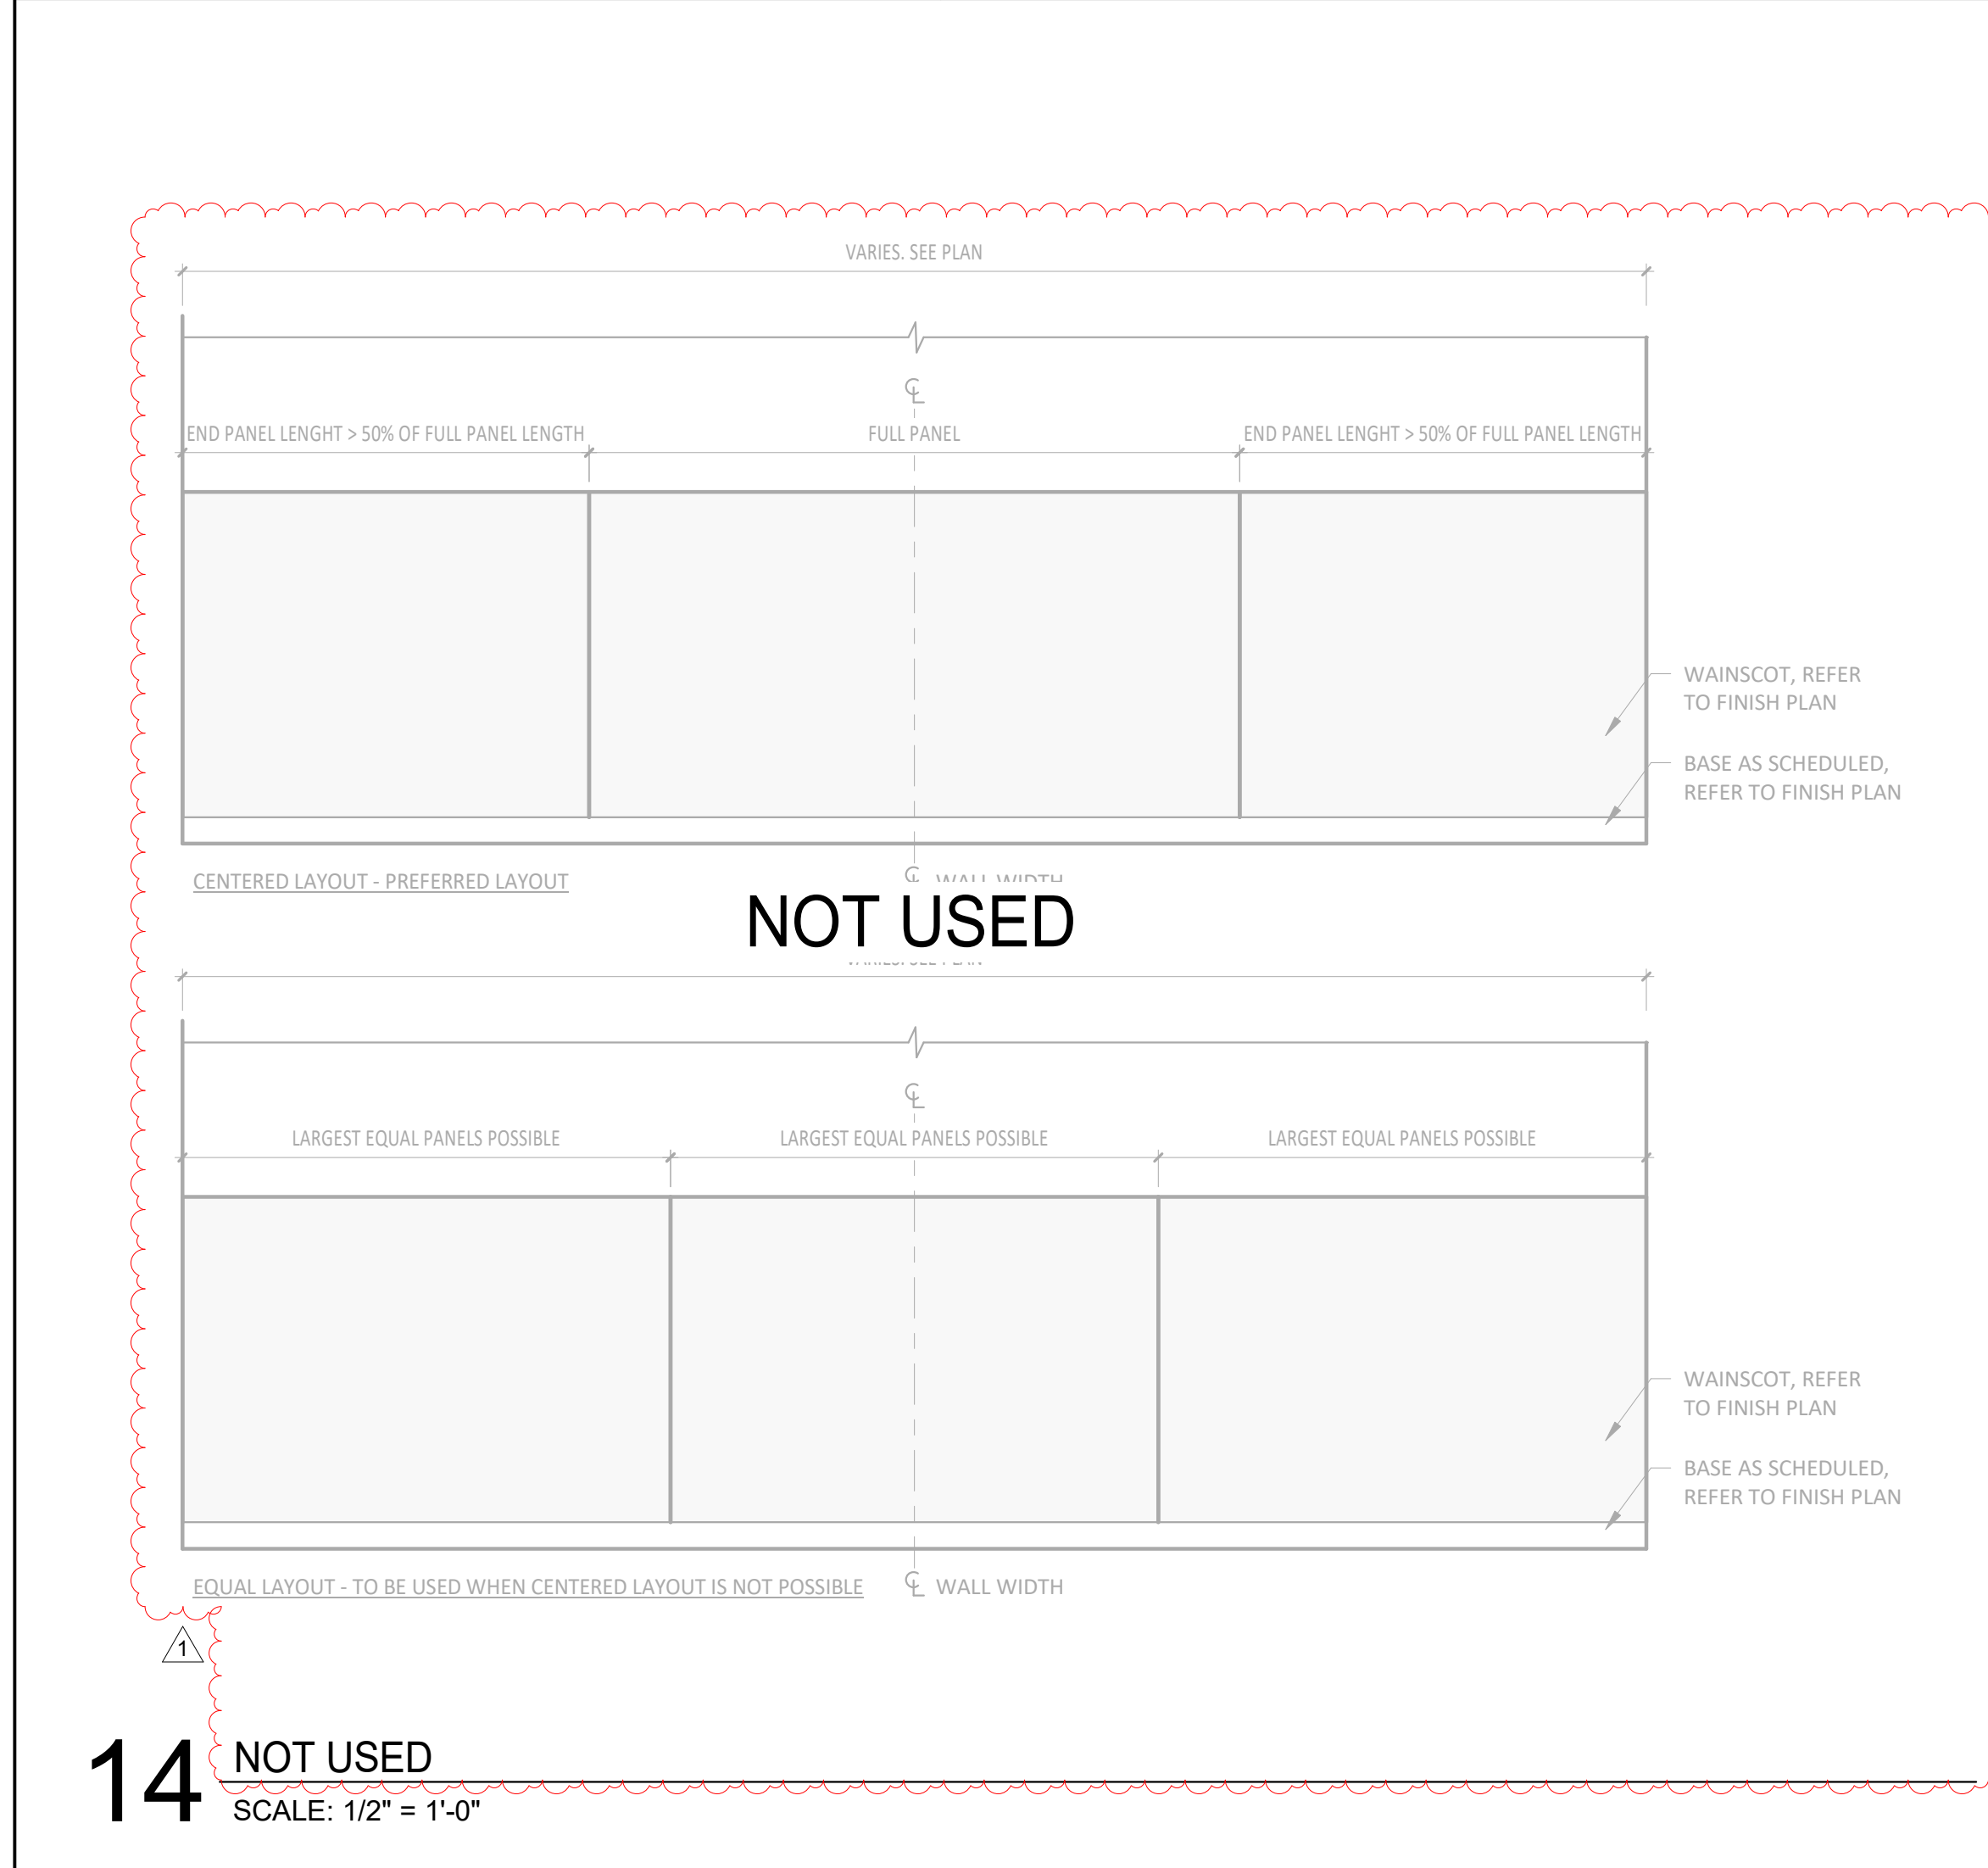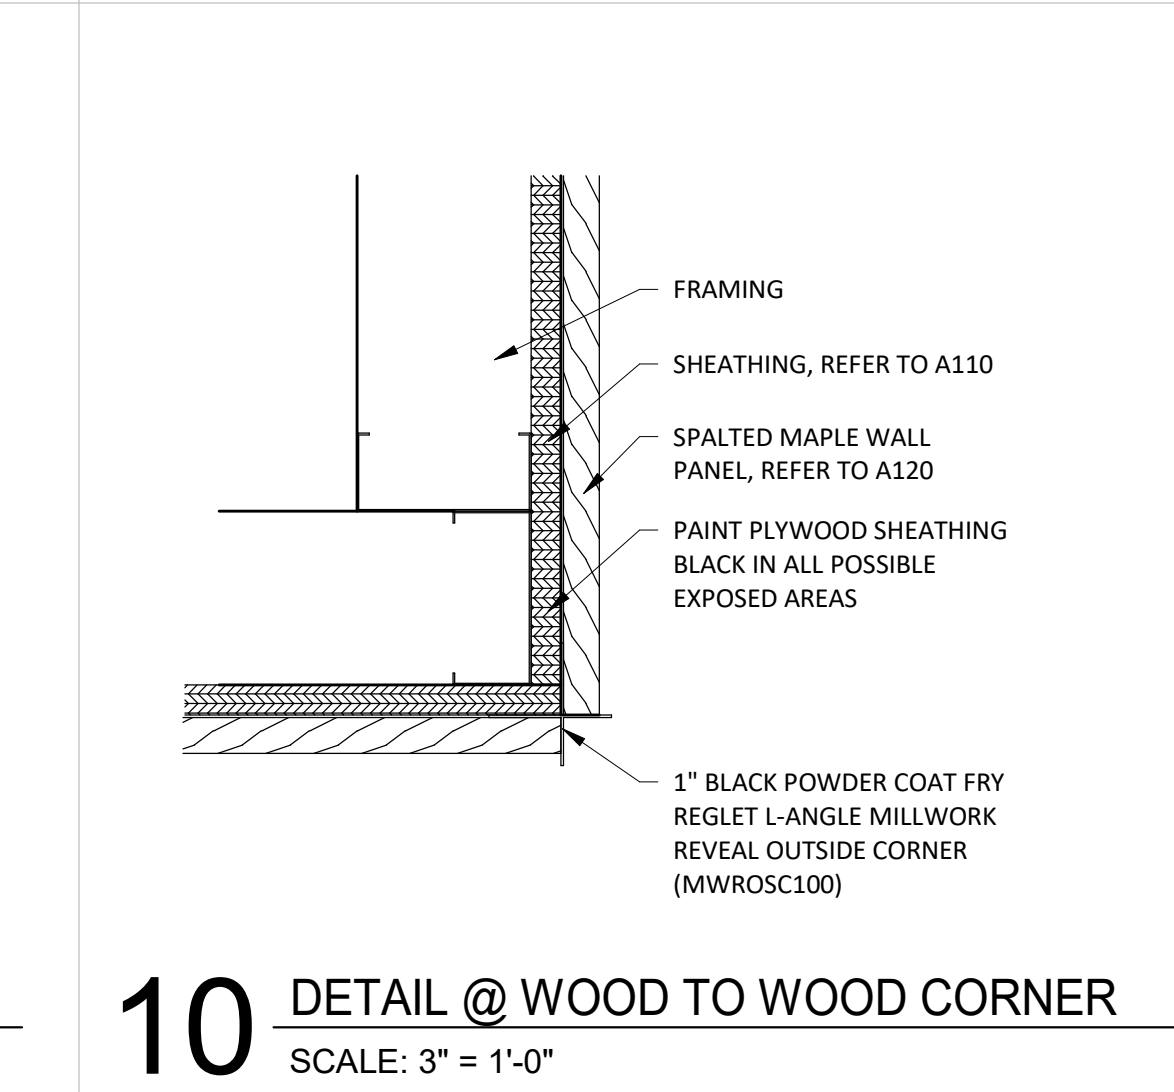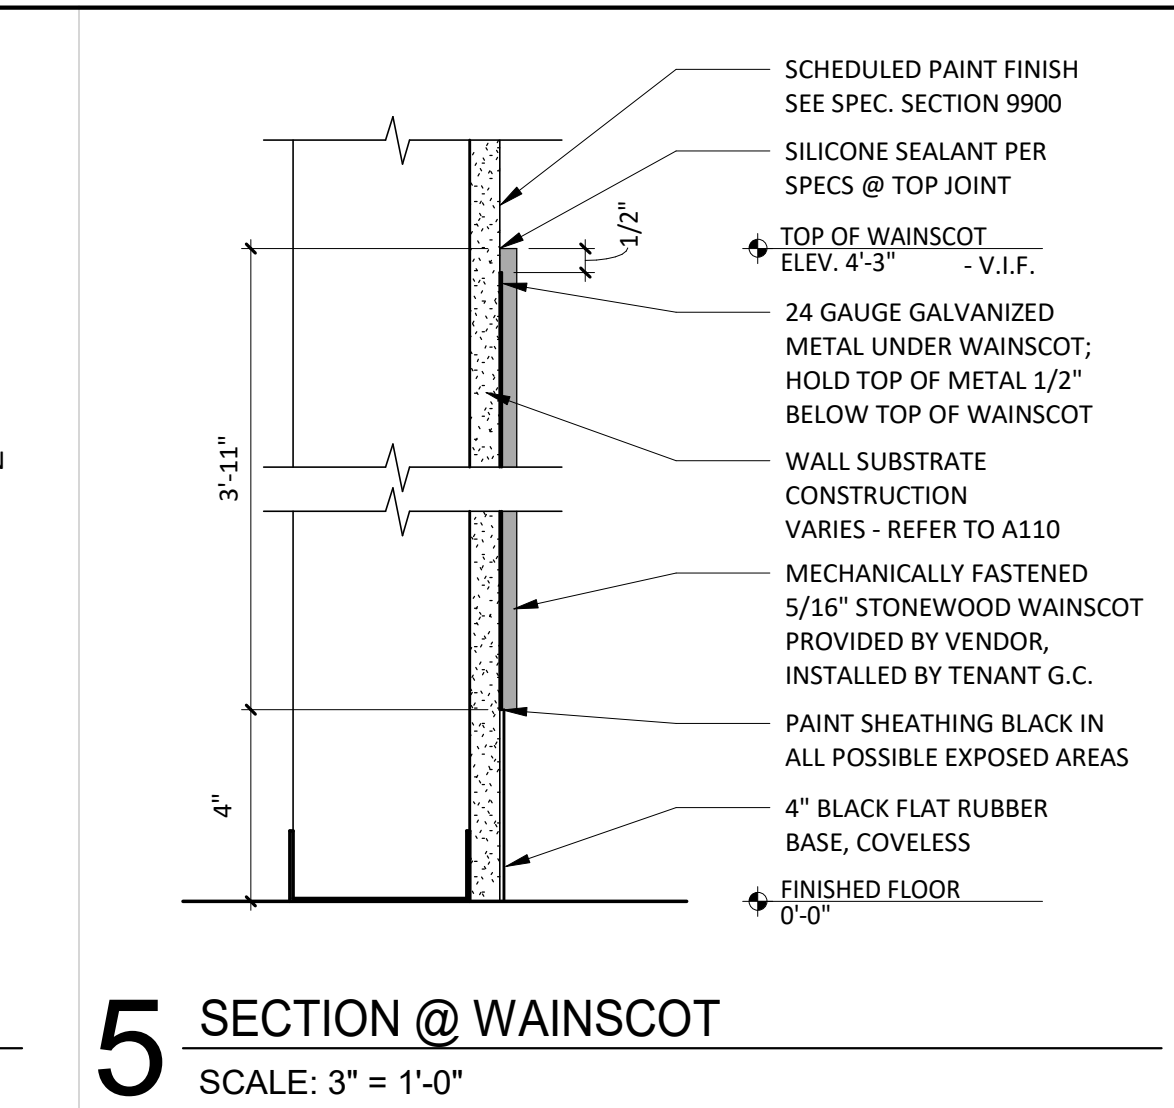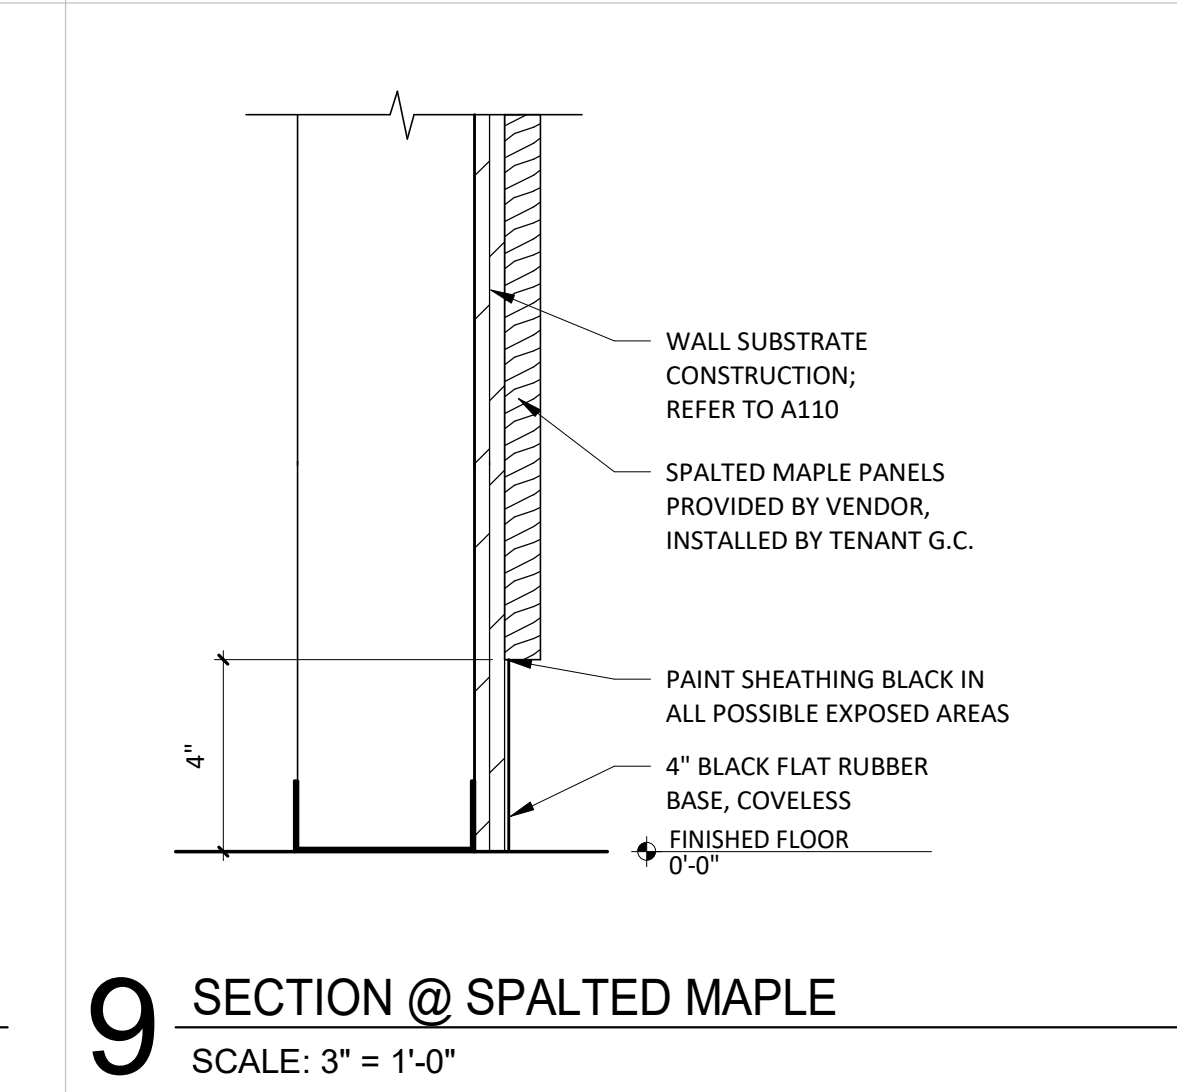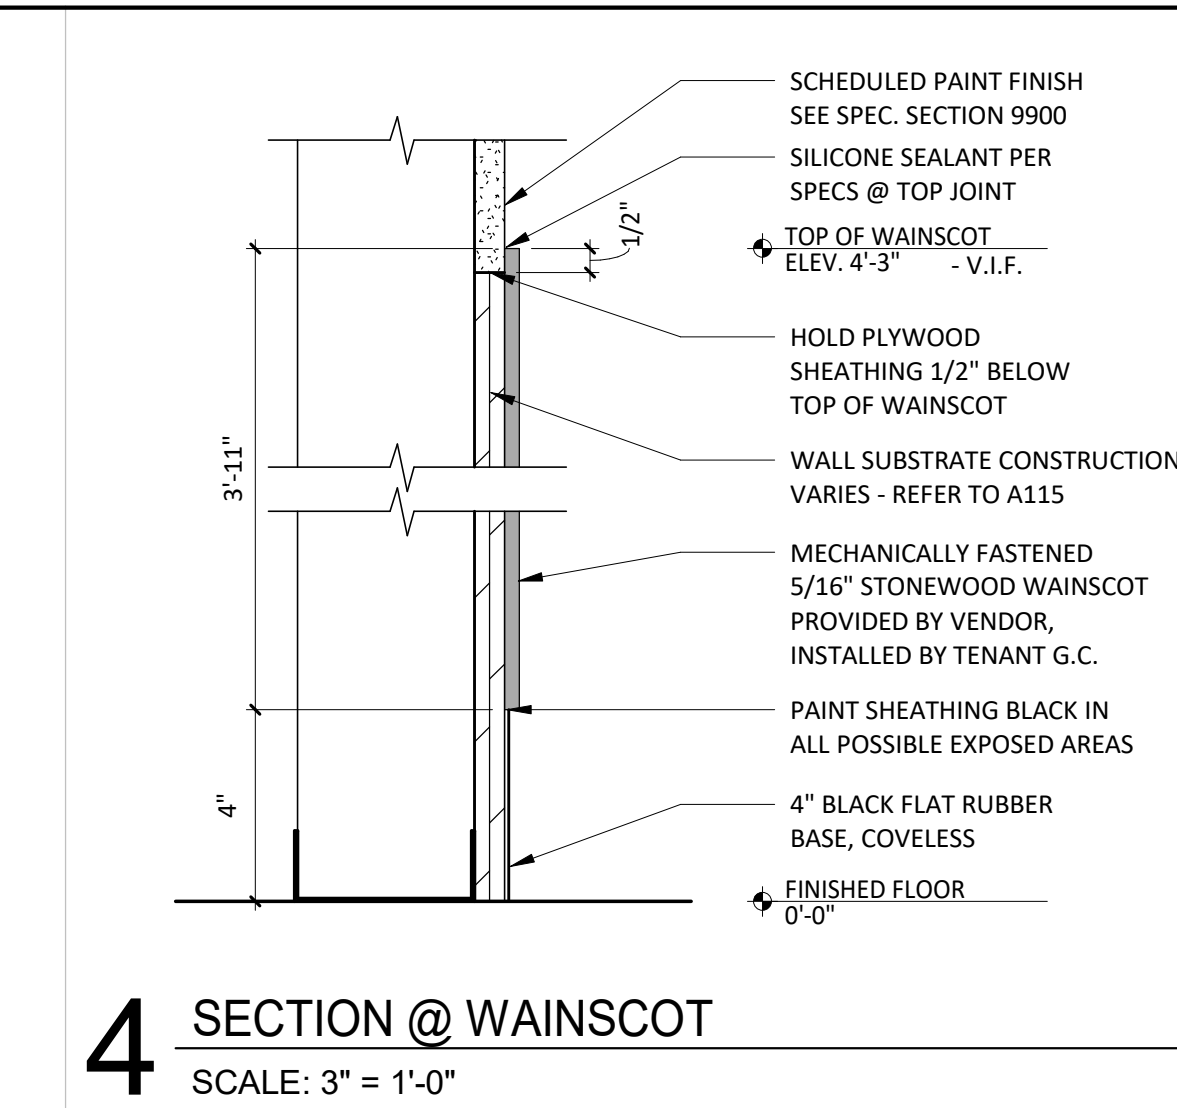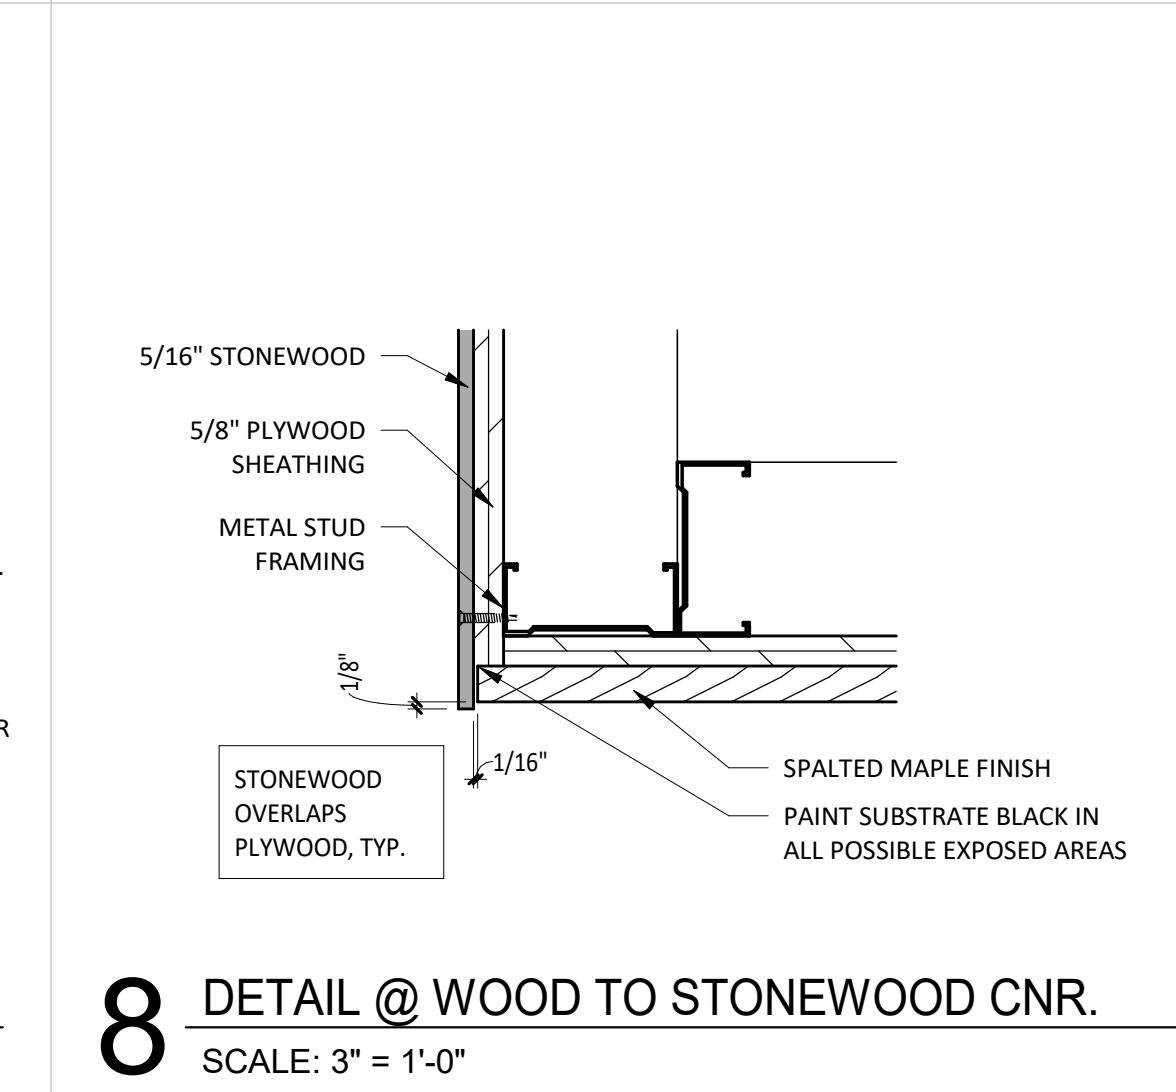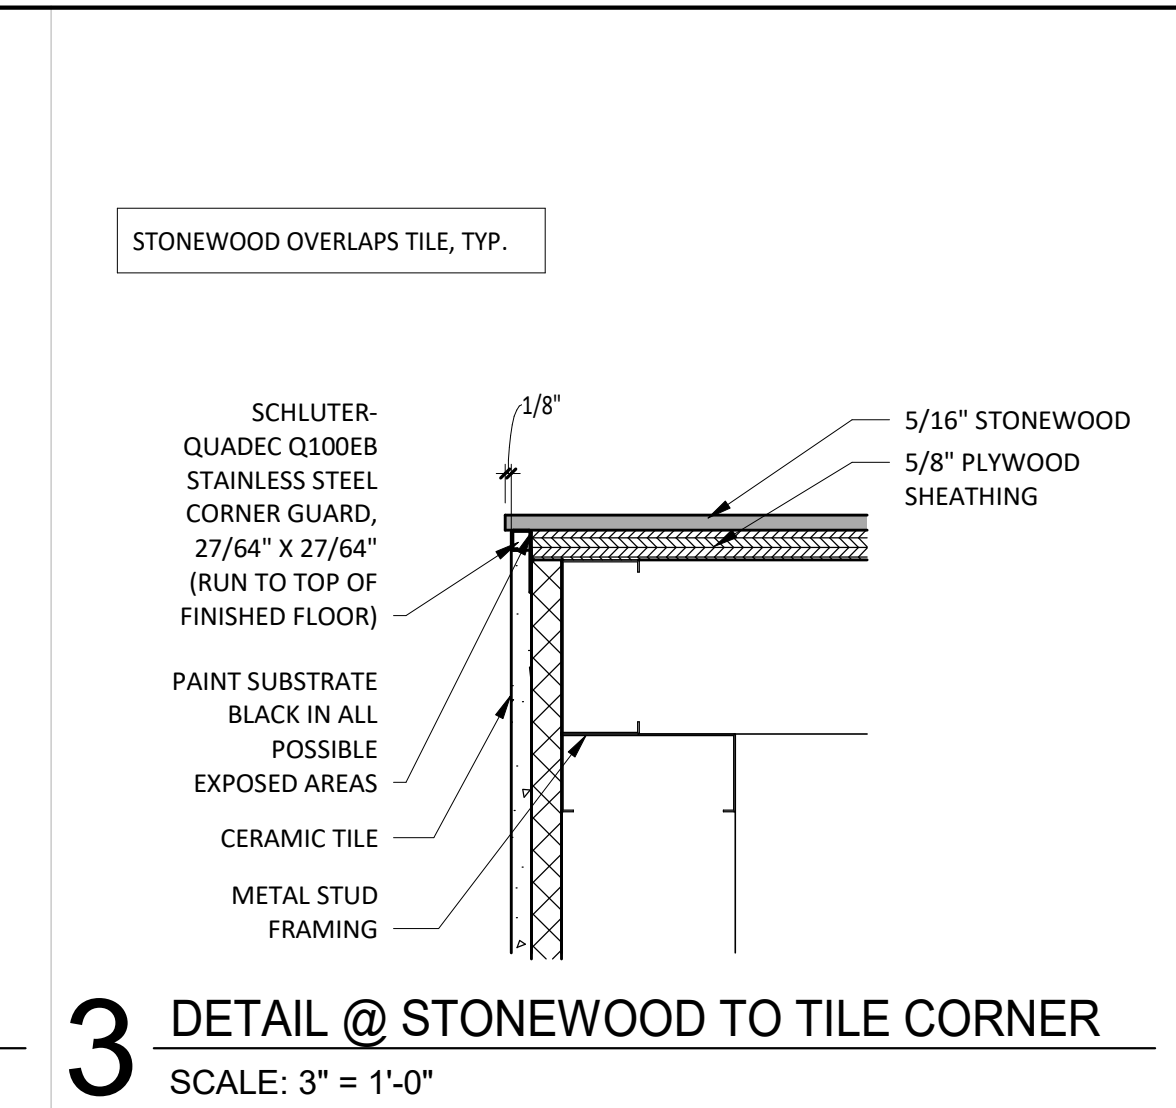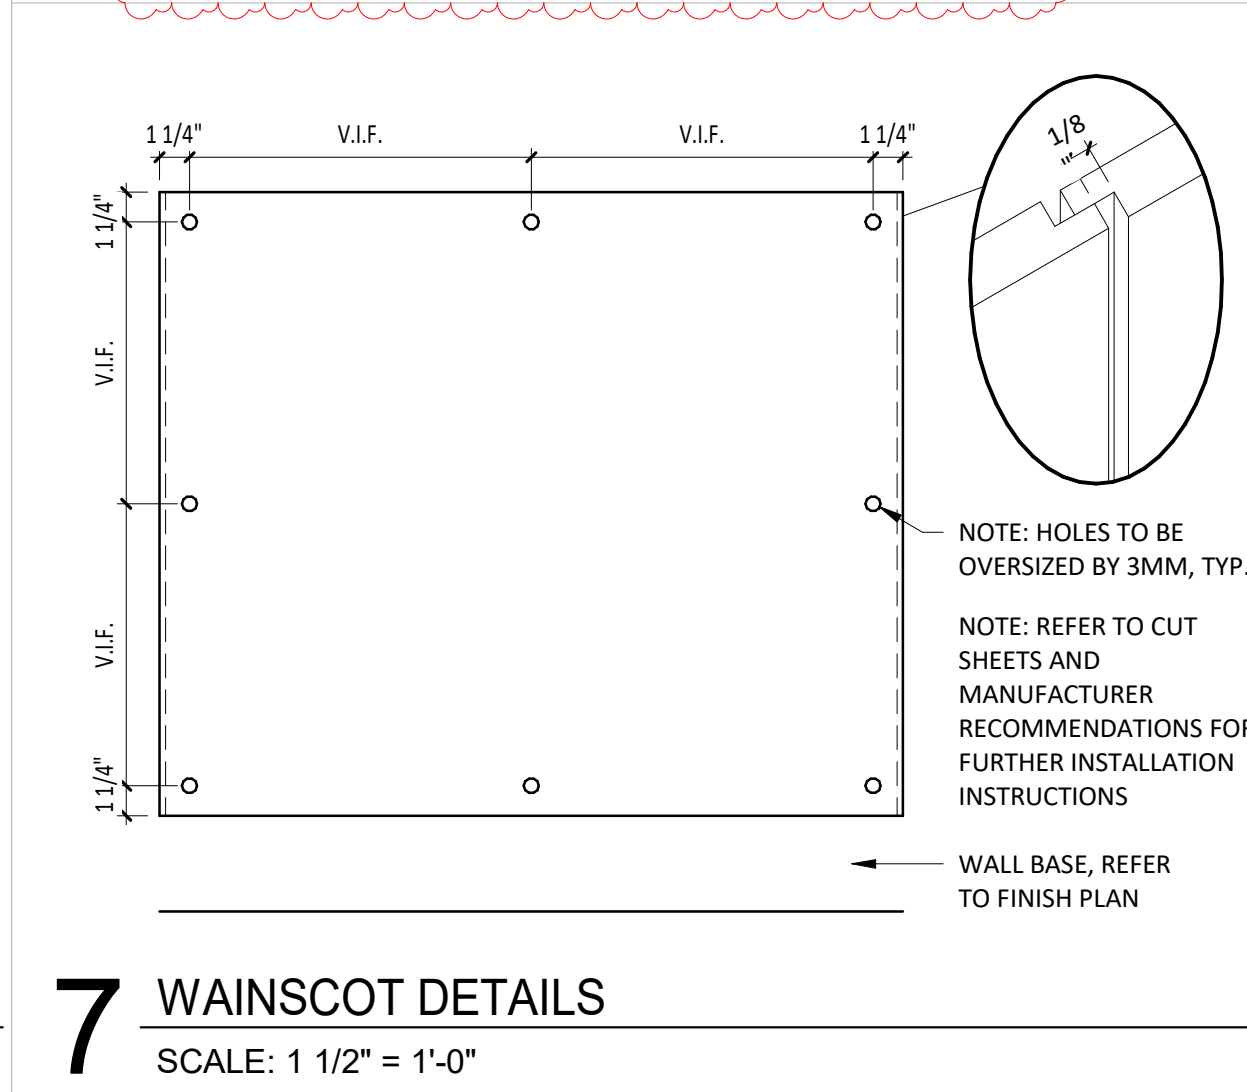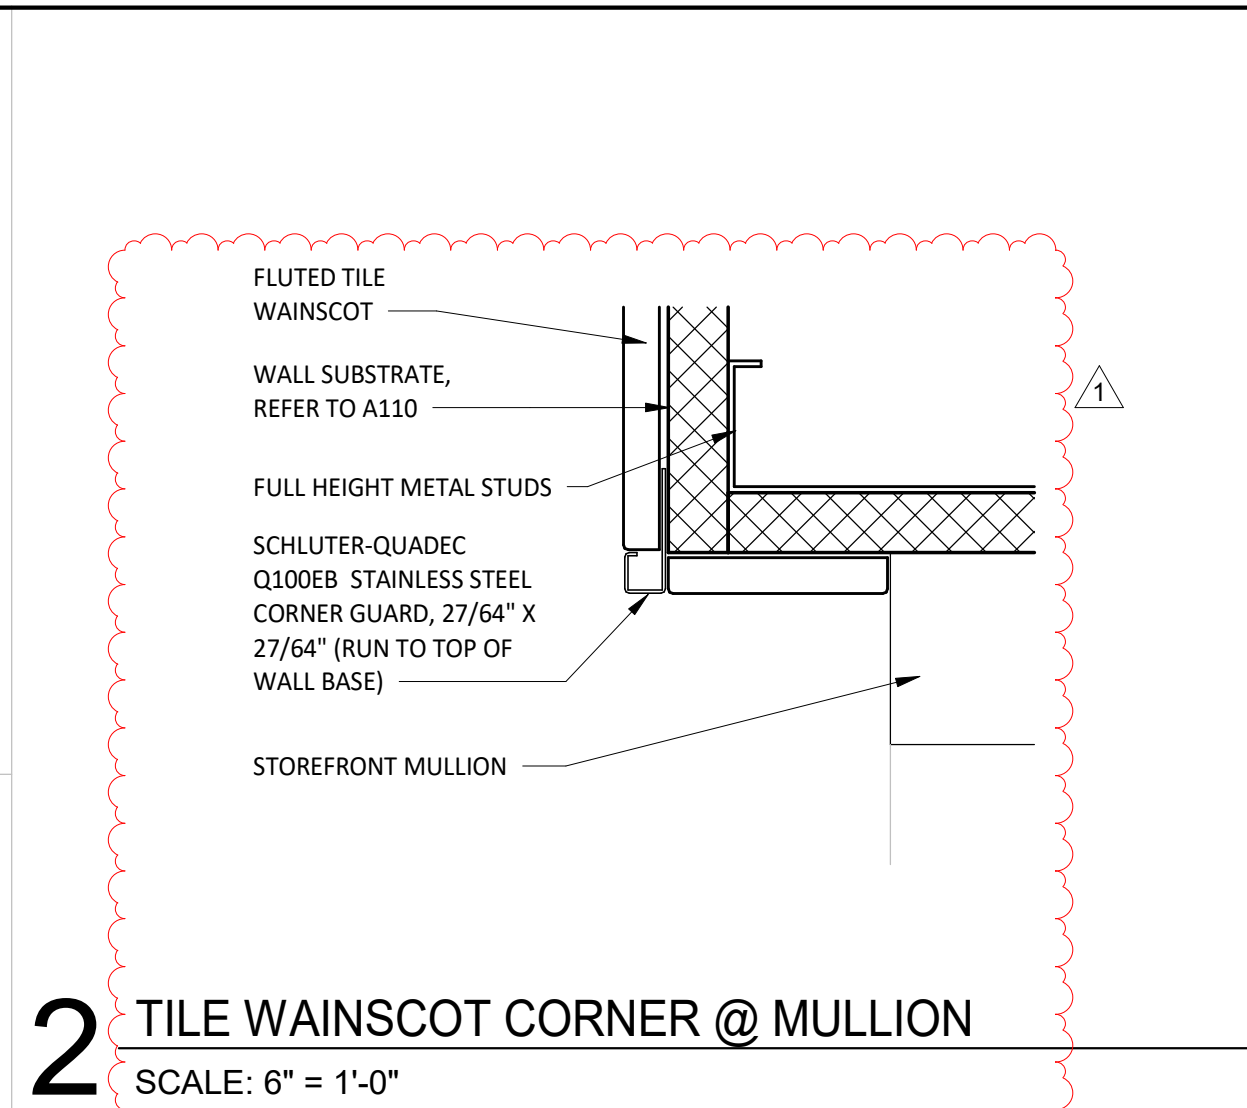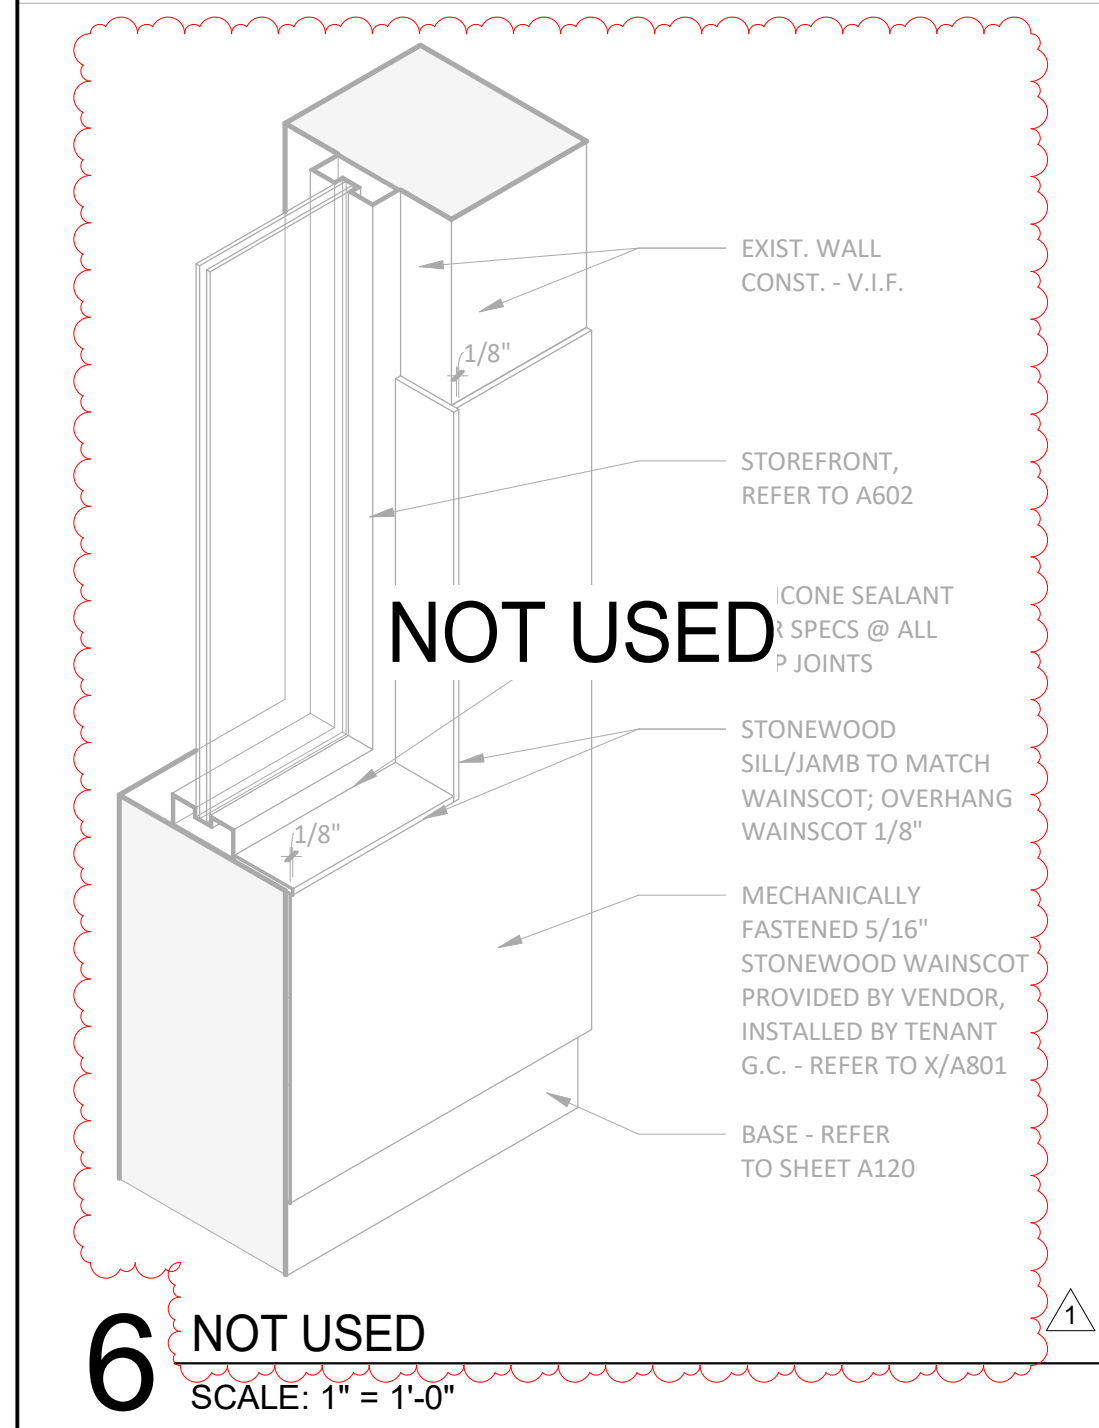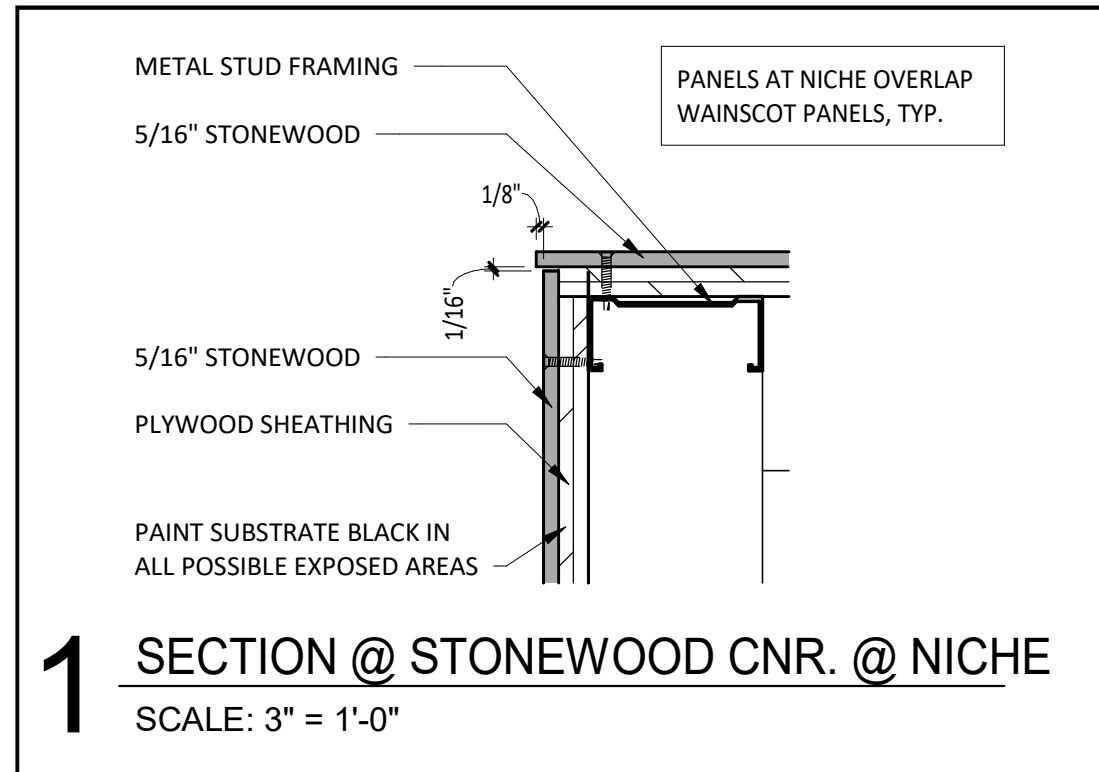

CONSULTANT:

WILKUS ARCHITECTS

CLIENT:

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 318-2682
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
TBD NC 24-87
CAMERON, NC 28326

SEAL:

MATTHEW M. WILKUS
REGISTERED ARCHITECT
14006
HOPKINS, MN
September 04, 2026
MATTHEW M. WILKUS
LICENSE #14006
(EXPIRES 06/30/2027)

PROJECT NO. 2024-0362
DRAWN BY JSB / KRJ
CHECKED BY DLA

ISSUE RECORD:
03/07/2025 PERMIT SET
05/29/2025 BID SET

REVISIONS:
1 08/21/2026 BA1 - FINISH UPDATES

TITLE:
FINISH DETAILS

SHEET NUMBER:
A803

GENERAL STRUCTURAL NOTES

1

BUILDING CODE:

1.1.1

THE 2018 NORTH CAROLINA BUILDING CODE.

2

DESIGN LOADS:

2.1

SHELL, ENGINEER TO DETERMINE BUILDING DESIGN LOADS.

2.2

EQUIPMENT: ROOFTOP UNITSSEE PLAN

3

GENERAL NOTES:

3.1

CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR THE MEANS AND METHODS OF CONSTRUCTION AND FOR THE SAFETY OF PERSONS AND PROPERTY. CONTRACTOR SHALL BE RESPONSIBLE FOR COMPLYING WITH ALL SAFETY PRECAUTIONS AND REGULATIONS DURING THE WORK. THE ENGINEER WILL NOT ADVISE ON NOR ISSUE DIRECTION AS TO SAFETY PRECAUTIONS AND PROGRAMS

3.2

THE STRUCTURAL DRAWINGS HEREIN REPRESENT THE FINISHED STRUCTURE. DURING ERECTION OF THE STRUCTURE, THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR TEMPORARY GUYING, SHORING, BRACING, FORMING, ETC. SUCH MEASURES SHALL BE LEFT IN PLACE AS LONG AS REQUIRED FOR SAFETY AND UNTIL ALL FRAMING AND CONNECTIONS ARE IN PLACE. THE INVESTIGATION, DESIGN, SAFETY, ADEQUACY AND INSPECTION OF SUCH TEMPORARY MEASURES ARE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.

3.3

DRAWINGS INDICATE GENERAL AND TYPICAL DETAILS OF CONSTRUCTION. WHERE CONDITIONS ARE NOT SPECIFICALLY SHOWN, SIMILAR DETAILS OF CONSTRUCTION SHALL BE USED, SUBJECT TO REVIEW BY THE ENGINEER.

3.4

ARCHITECTURAL DRAWINGS, MECHANICAL DRAWINGS, ELECTRICAL DRAWINGS, TELECOMMUNICATION DRAWINGS, FIRE PROTECTION DRAWINGS, EQUIPMENT DRAWINGS AND RELATED ITEMS ARE BY OTHERS.

3.5

CONTRACTOR AND SUBCONTRACTORS SHALL THOROUGHLY REVIEW ALL DRAWINGS PRIOR TO SUBMITTING BIDS. MISCELLANEOUS FASTENERS, CLIPS, ETC. THAT ARE NOT DETAILED ON THE DRAWINGS BUT ARE PART OF THE REQUIREMENTS FOR FULL INSTALLATION OF ALL STRUCTURAL SYSTEMS ARE TO BE PART OF THE BID. THE CONTRACTOR SHALL VISIT THE SITE PRIOR TO THE BID TO ASCERTAIN CONDITIONS WHICH MAY ADVERSELY AFFECT THE BID.

3.6

DURING THE BIDDING STAGE, CONTRACTOR SHALL REQUEST AN INTERPRETATION OF CONFLICTS PRIOR TO BIDDING. IF NO REQUEST IS MADE, BOTH PROVISIONS SHALL BE PRESUMED TO BE INCLUDED IN THE BID AND THE ARCHITECT/ENGINEER SHALL DETERMINE WHICH PROVISION GOVERNS, AND THE CONTRACTOR SHALL PERFORM THE WORK AT NO ADDITIONAL COST TO THE OWNER

3.7

ALL OMISSIONS AND CONFLICTS BETWEEN THE VARIOUS ELEMENTS OF THE CONSTRUCTION DRAWINGS AND/OR SPECIFICATIONS AND/OR EXISTING CONDITIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER BEFORE PROCEEDING WITH THE WORK.

3.8

THE CONTRACTOR SHALL COORDINATE ALL DEPRESSIONS, DIMENSIONS, ELEVATIONS, SLEEVES, CHASES, HANGERS, OPENINGS, BLOCK OUTS, INSERTS, ANCHORS, EQUIPMENT SUPPORTS, AND DETAILS WITH THE ENTIRE CONSTRUCTION PACKAGE INCLUDING ARCHITECTURAL DRAWINGS, MECHANICAL DRAWINGS, ELECTRICAL DRAWINGS, TELECOMMUNICATION DRAWINGS, FIRE PROTECTION DRAWINGS AND EQUIPMENT DRAWINGS.

3.9

MECHANICAL UNITS SUPPORTED BY ROOF STRUCTURE ARE SUBJECT TO THE ACCEPTANCE OF THE STRUCTURAL ENGINEER

3.10

DO NOT HANG ANYTHING FROM THE ROOF DECK.

4

EXISTING CONSTRUCTION:

4.1

WHEREVER APPLICABLE, PRIOR TO FABRICATION AND CONSTRUCTION, CONTRACTOR SHALL FIELD VERIFY ALL EXISTING ELEVATIONS, DIMENSIONS, DETAILS OF EXISTING STRUCTURAL CONNECTIONS AND OTHER CONDITIONS WHERE THEY AFFECT THIS CONSTRUCTION. NOTIFY THE ENGINEER IF THERE ARE ANY DEVIATIONS FROM THE CONTRACT DOCUMENTS. CONSULT WITH THE STRUCTURAL ENGINEER BEFORE MAKING ANY MODIFICATIONS TO THE EXISTING STRUCTURE NOT INDICATED ON THE CONTRACT DOCUMENTS.

4.2

BEFORE PROCEEDING WITH ANY WORK WITHIN THE EXISTING FACILITY, THE CONTRACTOR SHALL BECOME FAMILIAR WITH THE EXISTING STRUCTURE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE ALL NECESSARY BRACING, SHORING AND OTHER SAFEGUARDS TO MAINTAIN ALL PARTS OF THE EXISTING WORK IN A SAFE CONDITION DURING THE PROCESS OF DEMOLITION AND CONSTRUCTION AND TO PROTECT FROM DAMAGE THOSE PORTIONS OF THE EXISTING WORK WHICH ARE TO REMAIN.

4.3

THE CONTRACTOR SHALL CONSIDER ALL HAZARDS DUE TO WELDING WITHIN THE EXISTING FACILITY, INCLUDING FIRE HAZARD, TOXIC SMOKE HAZARD AND LIQUEFACTION OF MEMBERS UNDER LOAD. VERIFY THE PRESENCE OF ANY TOXIC MATERIALS PRIOR TO BIDDING THE WORK OR SUBMITTAL OF FINAL PRICE.

5

REINFORCED CONCRETE:

5.1

DESIGN CODE: BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE (ACI 318), LATEST ADOPTION.

5.2

CONCRETE MIXES SHALL BE DESIGNED PER ACI 301 USING THE FOLLOWING:
PORTLAND CEMENT CONFORMING TO ASTM C150 OR C595
FLY ASH CONFORMING TO ASTM C618
SLAG CONFORMING TO ASTM C989
SILICA FUME CONFORMING TO ASTM C1240
AGGREGATE CONFORMING TO ASTM C33
ADMIXTURES CONFORMING TO ASTM C494, C1017, AND C260. DO NOT USE CALCIUM CHLORIDE OR ADMIXTURES CONTAINING CALCIUM CHLORIDE.
CONCRETE SHALL BE READY-MIXED IN ACCORDANCE WITH ASTM C94.

5.3

MATERIAL STRENGTHS:

5.3.1

PROVIDE THE FOLLOWING CONCRETE PROPERTIES:

DESCRIPTION	COMPRESSIVE STRENGTH (f'c) AT 28 DAYS	MAX AGGREGATE SIZE	SLUMP ²	MAX WATER TO CEMENT RATIOS (W/C) ³
INTERIOR SLABS ON GRADE	4000 PSI	¾"	3" ± 1"	0.43
ANY CONCRETE SUBJECT TO FREEZE-THAW CYCLES (5% ENTRAINED AIR) ¹	4500 PSI	¾"	4" ± 1"	0.45

1

TOLERANCE ON AIR CONTENT AS DELIVERED SHALL BE ± 1.5%.

2

PRIOR TO ADDITION OF PLASTICIZER OR HIGH-RANGE WATER-REDUCER

3

THESE W/C RATIOS MAY BE LOWER THAN NECESSARY TO PROVIDE THE SPECIFIED STRENGTHS.

5.3.2

REINFORCING STEEL:
ALL OTHER BARS, STIRRUPS AND TIES,ASTM A615, GR. 60
WELDED WIRE FABRICASTM A1064

5.4

PLACEMENT OF CONCRETE AND REINFORCEMENT SHALL BE IN ACCORDANCE WITH ACI AND CRSI STANDARDS.

5.5

CLEAN REINFORCEMENT OF LOOSE RUST, MILL SCALE, EARTH, ICE, AND OTHER FOREIGN MATERIALS THAT REDUCE BOND TO CONCRETE.

5.6

FURNISH THE FOLLOWING CONCRETE COVER ON REINFORCING BARS UNLESS SHOWN OTHERWISE ON DRAWINGS:
SLABS ON GRADECENTER MESH OR BARS IN SLAB

5.7

ALL WELDED WIRE FABRIC SHALL BE TRANSPORTED AND DELIVERED IN FLAT SHEETS

5.8

MAINTAIN CONCRETE IN A CONTINUOUSLY DAMP AND WET CONDITION FOR NOT LESS THAN 7 DAYS AFTER PLACING. PROTECT FROM MOISTURE LOSS WITH SHEETING OR SPRAY-ON MEMBRANE MEETING ASTM C309 AND COMPATIBLE WITH FLOOR COVERINGS.

5.9

FINISHING REQUIREMENTS ARE AS FOLLOWS (REFER TO ACI 301):
SMOOTH RUBBED FINISH ON EXPOSED FORM SURFACES
STEEL TROWEL FINISH ON INTERIOR SLABS AND SLABS TO RECEIVE FINISH FLOORING.

5.10

DO NOT FIELD BEND BARS PARTIALLY EMBEDDED IN HARDENED CONCRETE UNLESS SPECIFICALLY INDICATED OR ACCEPTED BY THE ENGINEER.

5.11

IN SLABS PROVIDE (2) #4x4'-0" DIAGONAL BARS AT 45 DEGREES AT ALL CORNERS OF OPENINGS AND RE-ENTRANT CORNERS

5.12

COLD WEATHER CONCRETING SHALL FOLLOW PROCEDURES IN ACI 306.

5.13

HOT WEATHER CONCRETING SHALL FOLLOW PROCEDURES IN ACI 305.

5.14

FORMWORK SHALL REMAIN IN PLACE UNTIL CONCRETE HAS ATTAINED A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI, UNLESS OTHERWISE DIRECTED BY THE ENGINEER. THE CONTRACTOR SHALL PROVIDE ALL SHORING.

5.15

SPECIAL ADDITIONAL REQUIREMENTS FOR SLABS ON GRADE:

5.15.1

DESIGN STANDARD: GUIDE FOR CONCRETE FLOOR AND SLAB CONSTRUCTION (ACI 302.1)

5.15.2

REFER TO GEOTECHNICAL REPORT FOR VAPOR BARRIER, ENGINEERED FILL AND SUBGRADE COMPACTION REQUIREMENTS.

5.15.3

LAP ADJOINING WELDED WIRE FABRIC AT LEAST TWO FULL MESHES.

5.15.4

SEE DRAWINGS FOR LOCATIONS OF SLAB CONTROL JOINTS.

5.15.5

SLAB JOINTS SHALL BE FILLED WITH AN ACCEPTED MATERIAL AS LATE AS POSSIBLE, PREFERABLY AT LEAST 4 TO 6 WEEKS AFTER THE SLAB HAS BEEN CAST. PRIOR TO FILLING, REMOVE ALL DEBRIS FROM THE SLAB JOINTS. FILL IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

5.15.6

SEE THE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS OF DEPRESSED SLAB AREAS AND DRAINS. SLOPE SLAB TO DRAINS WHERE SHOWN.

5.15.7

FINISH TOLERANCE OF ALL SLABS SHALL BE IN ACCORDANCE WITH ACI 302.1 R.

6

WOOD:

6.1

DESIGN CODE: NATIONAL DESIGN SPECIFICATION (NDS) FOR WOOD CONSTRUCTION (AF&PA), LATEST ADOPTION.

6.2

MATERIALS (FOLLOWING INDICATE MINIMUM GRADES UNO ON DRAWINGS):

DESCRIPTION	SPECIES & GRADE	DESIGN VALUES (PSI)				COMMENTS		
		Fb	Fc⊥	Fcl	E (x10 ⁶)			
FRAMING LUMBER	Dimensional Lumber (2"-4")	SPRUCE-PINE-FIR	NO. 2	875	425	1150	1.4	POSTS
	Timbers (5"x5" and larger)	SPRUCE-PINE-FIR	NO. 2	500	425	500	1.0	POSTS
	Dimensional Lumber (2"-4")	SPRUCE-PINE-FIR	NO. 2	875	425	1150	1.4	JOISTS, BEAMS AND UNTELS
	Timbers (5"x5" and larger)	SPRUCE-PINE-FIR	NO. 2	600	425	425	1.0	BEAMS

6.3

ALL LUMBER CONNECTORS TO BE SUPPLIED BY USP OR SIMPSON STRONG-TIE. WHERE LUMBER CONNECTORS ARE TO BE USED BUT ARE NOT CALLED OUT IN THESE DRAWINGS THEY ARE TO BE DESIGNED AND SUPPLIED BY USP OR SIMPSON STRONG-TIE FOR THE REACTION SHOWN ON THESE DRAWINGS. WHEN USING LUMBER CONNECTORS FILL ALL NAIL HOLES TO ACHIEVE PUBLISHED VALUE. WHERE MORE STRINGENT, THESE DRAWINGS SUPERSEDE DIRECTIONS IN PRODUCT CATALOG BUT REFER TO PRODUCT CATALOG FOR TYPICAL INSTALLATION INSTRUCTIONS.

6.4

TRUSS MEMBERS AND COMPONENTS SHALL NOT BE CUT, NOTCHED, DRILLED NOR OTHERWISE ALTERED IN ANY WAY WITHOUT THE WRITTEN APPROVAL OF THE TRUSS SUPPLIER'S STRUCTURAL ENGINEER.

6.5

COORDINATE MECHANICAL EQUIPMENT LOADS AND LOCATIONS WITH MECHANICAL/ARCHITECTURAL DRAWINGS AND MECHANICAL CONTRACTOR.

ABBREVIATIONS	
ACI	AMERICAN CONCRETE INSTITUTE
AF&PA	AMERICAN FOREST & PAPER ASSOCIATION
APA	ENGINEERED WOOD ASSOCIATION
ASTM	AMERICAN SOCIETY FOR TESTING AND MATERIALS
CRSI	CONCRETE REINFORCING STEEL INSTITUTE
OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
WTCA	WOOD TRUSS COUNCIL OF AMERICA

CLIENT:

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 162966
COLUMBUS, OH 43216-2566
TELEPHONE: (614) 316-2662
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

SEAL:

PROJECT NO. 240693
DRAWN BY JWO
CHECKED BY TJM

ISSUE RECORD:
03.03.2025 PERMIT SET



REVISIONS:

TITLE:

GENERAL
STRUCTURAL
NOTES

SHEET NUMBER:

S000

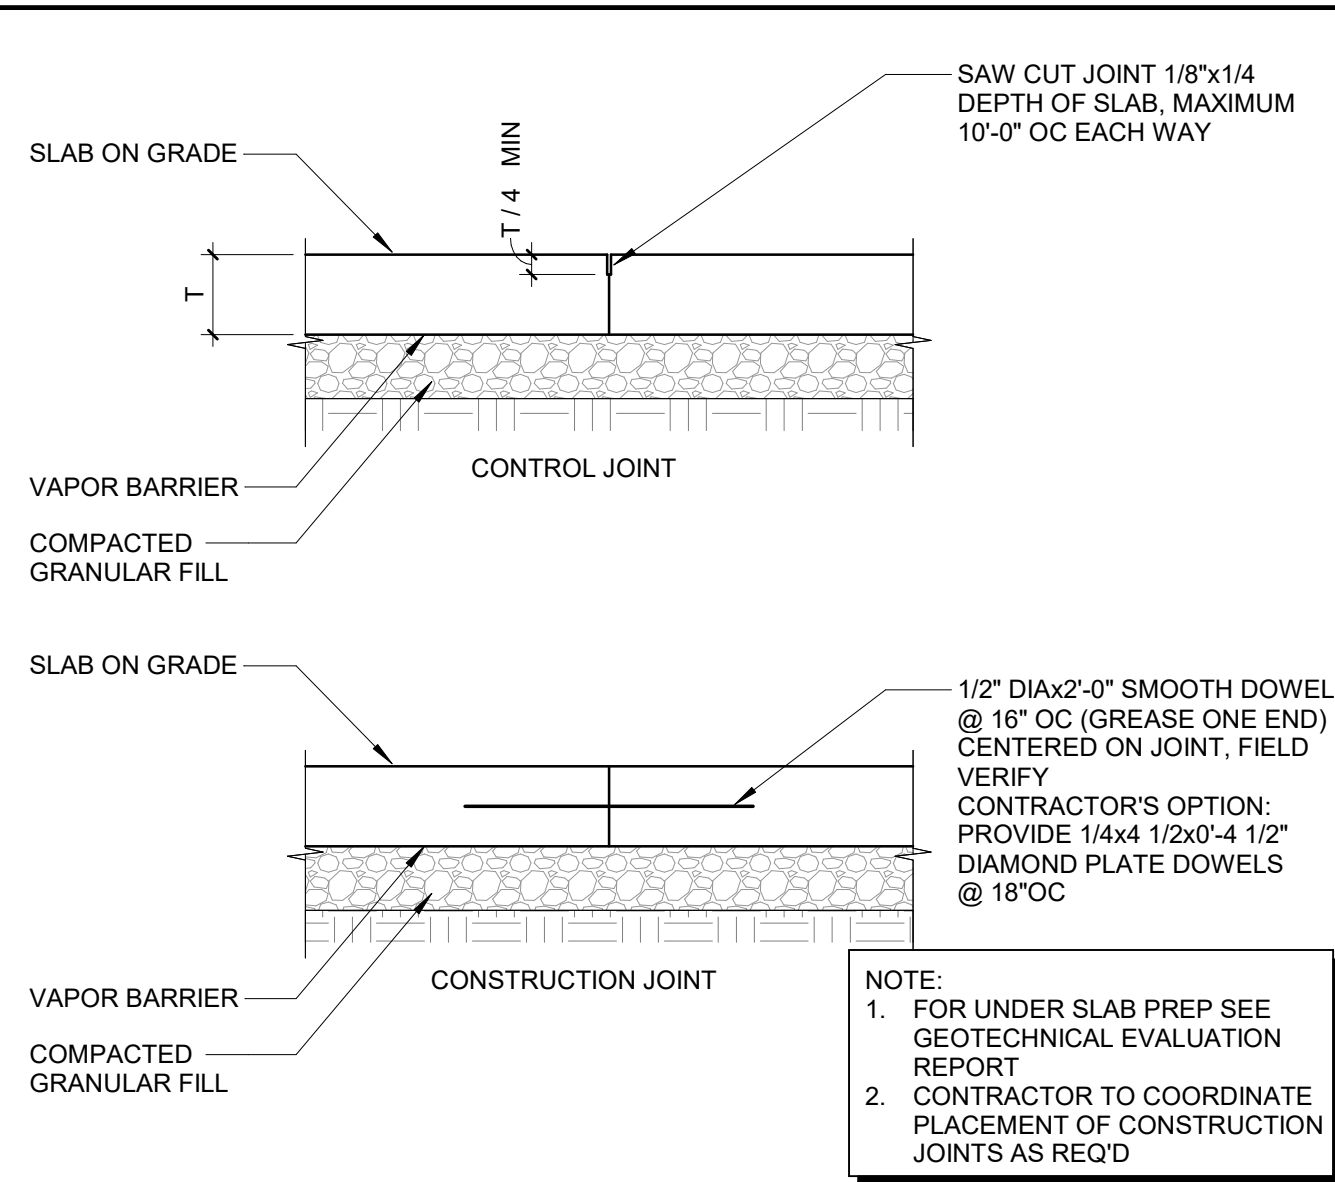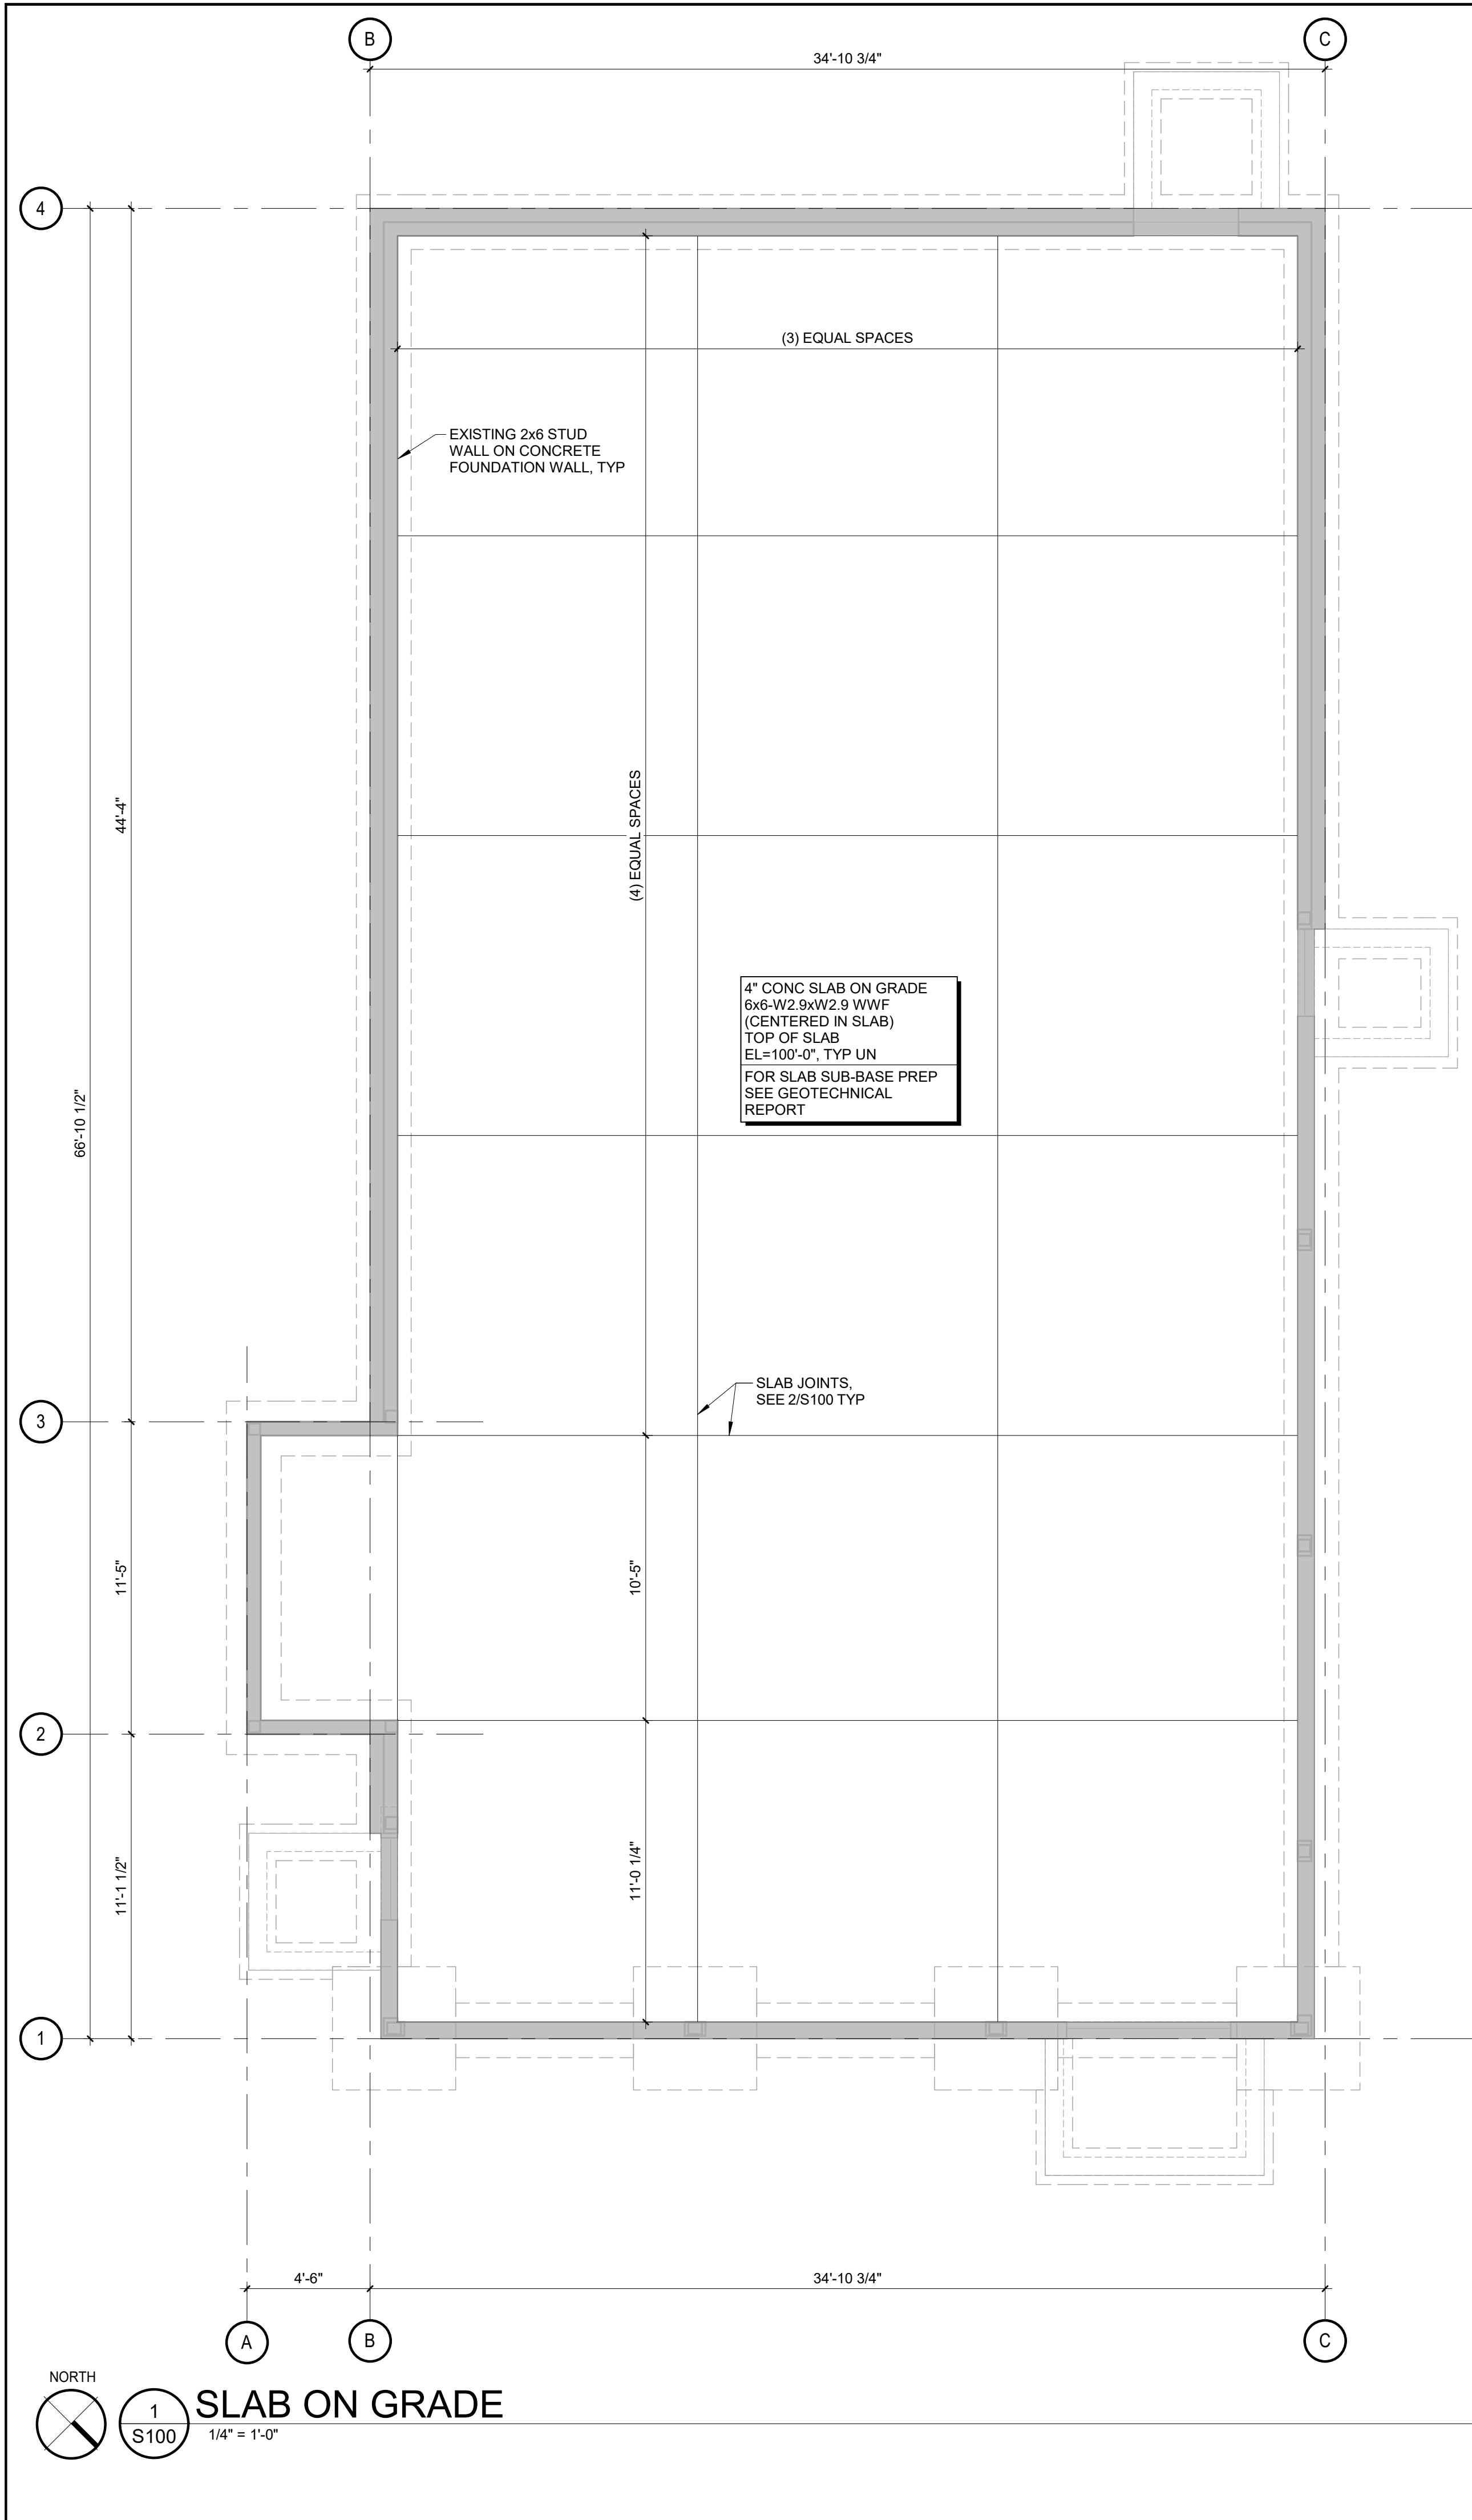

2 S100 1" = 1'-0"

INTERIOR SLAB JOINTS

SLAB PLAN NOTES:

1. FOR GENERAL STRUCTURAL NOTES SEE SHEET S000.
2. CONTRACTOR TO FIELD VERIFY ALL EXISTING DIMENSIONS, ELEVATIONS, CONDITIONS, ETC PRIOR TO DEMOLITION, FABRICATION AND CONSTRUCTION.
3. EXISTING STRUCTURAL INFORMATION IS BASED ON THE STRUCTURAL DRAWINGS PREPARED BY VAA ENG, PLLC DATED FEBRUARY 20, 2025.

CLIENT:




CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182966
COLUMBUS, OH 43218-2966
TELEPHONE: (614) 335-2652
INTERNET: WWW.CHIPOTLE.COM

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

PROJECT INFORMATION:

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

SEAL:

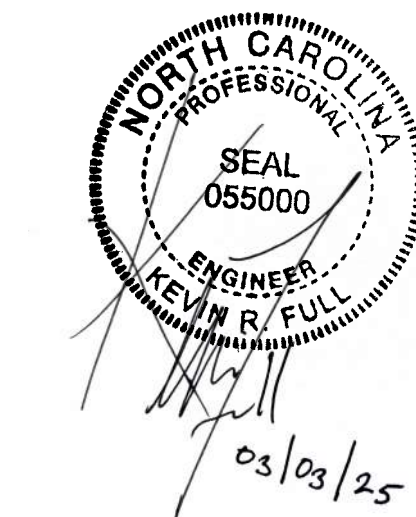

PROJECT NO. 240693
DRAWN BY JWO
CHECKED BY TJM

ISSUE RECORD:
03.03.2025 PERMIT SET


REVISIONS:

TITLE:

SLAB ON GRADE
PLAN AND DETAILS

SHEET NUMBER:

S100

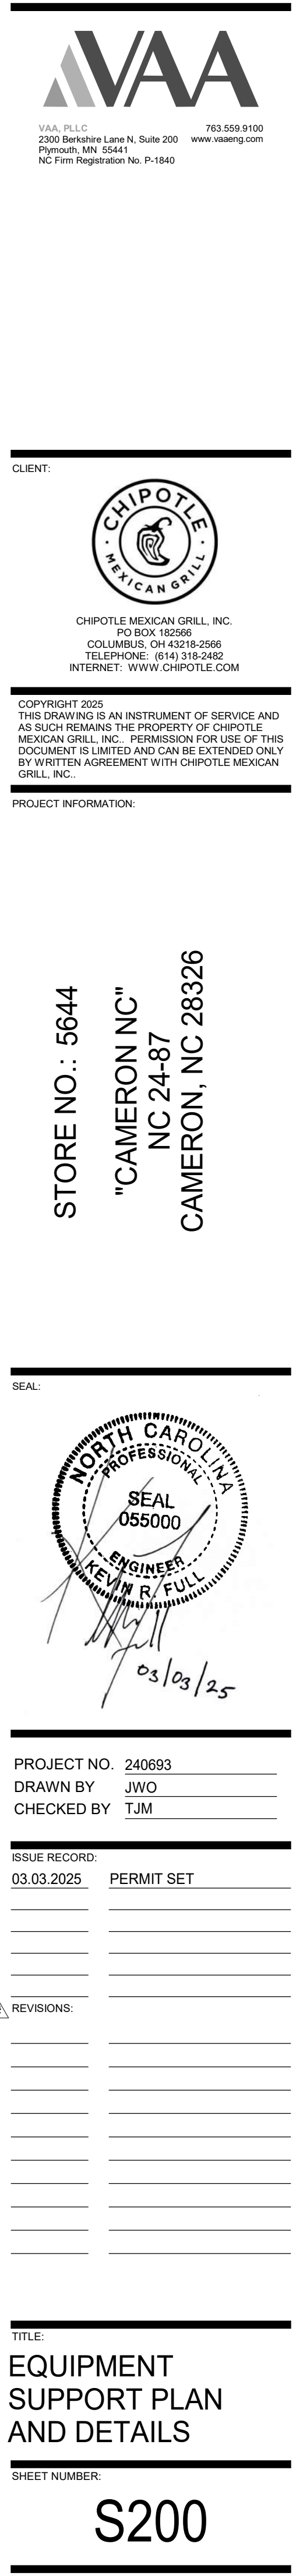

SECTION 15732 - PACKAGED ROOFTOP AIR-CONDITIONING UNITS

PART 1 - GENERAL

1.1 SECTION REQUIREMENTS

A. Submittals: Product Data and Shop Drawings.

B. Comply with ASHRAE 15.

C. EER: Equal to or greater than prescribed by the energy code adopted by the Authority Having Jurisdiction.

D. Warranties: Submit a written warranty, signed by the manufacturer, agreeing to the repair or replacement of components that fail within 5 years of Substantial Completion.

PART 2 - PRODUCTS

2.1 PACKAGED UNITS, 5 TO 20 TONS

A. Factory assembled and tested, consisting of compressors, condensers, evaporator coils, condenser and evaporator fans, refrigeration and temperature controls, filters, and dampers.

1. Refer to Rooftop Heating/Cooling Unit Schedule on drawing M600 for capacities, and manufacturers.

2. Evaporator Fans: Belt or direct driven, forward curved centrifugal.

3. Exhaust/Relief Fans: Direct drive, forward curved centrifugal or propeller.

4. Condenser Fans: Direct drive propeller.

5. Refrigerant Coils: Aluminum fins and copper coil.

6. Compressors: Serviceable hermetic or fully hermetic, with safety controls, hot gas bypass, and timed off controls.

7. Heat Exchangers: Gas fired, with gas controls, electronic ignition, high limit cutout, and forced draft proving switch.

8. Economizer controls (Comparative Enthalpy, 100% capacity).

9. Smoke Detectors: Photoelectric in supply and/or return as called for in schedule on sheet M600.

10. Operating Controls: Two stage heating and two stage cooling on units 7-1/2 tons and over.

11. Roof curb.

12. Control Wiring from T-stat to rooftop unit: Shall be 18ga / 7 conductor, rated for plenum applications.

13. Control Wiring from T-stat to remote sensor: Shall be a separate 18ga / 2 conductor shielded, rated for plenum applications.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install units level and plumb and firmly anchored.

B. Connect gas piping to burner with pipe same size as gas train inlet, and provide union with sufficient clearance for burner removal and service.

C. Install ducts to termination in roof mounting frames. Terminate ducts through roof structure.

D. Connect units to wiring systems and to ground.

END OF SECTION 15732

SECTION 15810 - DUCTS AND ACCESSORIES

PART 1 - GENERAL

1.1 SECTION REQUIREMENTS

A. Submittals: Product Data for fire and smoke dampers.

B. Comply with NFPA 90A for systems serving spaces more than 25,000 cu. ft. in volume or building Types II, IV, and V construction more than 3 stories in height.

C. Comply with NFPA 90B for systems serving spaces in 1 or 2 family dwellings or serving spaces less than 25,000 cu. ft..

D. Comply with NFPA 96, "Ventilation Control and Fire Protection of Commercial Cooking Operations," for kitchen hood ducts.

E. Comply with UL 181 and UL 181A for ducts and closures.

F. Testing, Adjusting, and Balancing Agency Qualifications: AABC certified (to be furnished by Tenant).

PART 2 - PRODUCTS

2.1 DUCTS

A. Spiral Duct: Spiral Lock Seam, without insulation, G90 galvanized finish, ASTM A-653/G24

1. Basis of Design Manufacturers: Lindab SPIROsafe, alternates to the basis of design must be submitted for review.

2. Fittings: Factory produced standing seam construction with internal sealing. Fittings with a major axis of 36" or smaller shall be 20 gauge. Fittings with a major axis of 37"-48" shall be 18 gauge.

B. Galvanized Steel Sheet: Forming steel, ASTM A 653/653M, G90 coating designation.

C. Duct Liner: ASTM C 1071, Type II, with an airstream surface coated with a temperature resistant coating. Thickness: 1-1/2 inch. R-value : 8.

1. Adhesive: ASTM C 916, Type I.

2. Mechanical Fasteners: Galvanized steel pin, length as required to penetrate liner plus a 1/8 inch projection maximum into the airstream.

D. Joint and Seam Tape: Comply with UL 181A.

E. Joint and Seam Sealant: Comply with UL 181A.

F. Rectangular Metal Duct Fabrication: Comply with SMACNA's "HVAC Duct Construction Standard" for metal thickness, reinforcing types and intervals, tie rod applications, and joint types and intervals.

2.2 ACCESSORIES

A. Volume-Control Dampers: Factory fabricated volume control dampers, complete with required hardware and accessories. Single blade and multiple opposed blade, standard leakage rating, and suitable for horizontal or vertical applications.

B. Fire Dampers: Factory-fabricated fire dampers, complete with required hardware and accessories. UL labeled according to UL 555, "Fire Dampers".

C. Flexible Connectors: Flame retardant or noncombustible fabrics, coatings, and adhesives complying with UL 181, Class 1.

D. Flexible Ducts: Factory fabricated, insulated, round duct, with an outer jacket enclosing 2 inch thick, glass fiber insulation, R-value: 6.0, around a continuous inner liner.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Duct System Pressure Class: Construct and install each duct system with 2 inch positive and negative duct pressure classifications.

B. Conceal ducts from view in finished and occupied spaces. Except where noted as exposed.

C. Avoid passing through electrical equipment spaces and enclosures.

D. Support and connect metal ducts according to SMACNA's "HVAC Duct Construction Standard".

E. Install duct accessories according to applicable portions of details of construction as shown in SMACNA standards.

F. Install liner and/or insulation on ductwork per the material schedule on sheet M010.

G. Install volume control dampers in lined duct with methods to avoid damage to liner and to avoid erosion of duct liner.

H. Install fire and smoke dampers according to manufacturer's UL approved written instructions.

I. Install fusible links in fire dampers.

J. Provide saddle taps at tees for exposed ductwork.

3.2 TESTING, ADJUSTING, AND BALANCING

A. The Tenant will supply an independent balance agent to to balance and adjust the HVAC installation. The balance agent will be responsible for any pulley or belt changes required.

B. The GC is to have trained staffed available during the balancing to correct issues noted by the balance agent.

C. The balance agent is to balance airflow within distribution systems, including submains, branches, and terminals to indicated quantities +/- 10%. The hood exhaust system shall be balanced to a tolerance of -0+10% and the make-up air system to a tolerance of -10+0%.

D. The balance agent is to supply a copy of the balance report to the Tenant, engineer and general contractor for review.

END OF SECTION 15810

SECTION 15855 - DIFFUSERS, REGISTERS, AND GRILLES

PART 1 - GENERAL

1.1 SECTION REQUIREMENTS

A. Submittals: None.

PART 2 - PRODUCTS

2.1 OUTLETS AND INLETS

A. All air terminal devices:

1. Refer to Grills, Registers, and Diffusers Schedule for equipment schedule

2. Manufacturer: As scheduled (NO SUBSTITUTIONS)

3. Material: As scheduled.

4. Finish: As scheduled.

5. Mounting: As scheduled.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Coordinate location and installation with duct installation and installation of other ceiling and wall mounted items.

B. Locate ceiling diffusers, registers, and grilles, as indicated on the architectural "reflected ceiling plans." Unless otherwise indicated, locate units in center of acoustical ceiling panels.

END OF SECTION 15855

HVAC MATERIAL SCHEDULE		
CATEGORY	APPLICATION	ALLOWABLE MATERIAL
DUCT	EXPOSED SUPPLY	RECT. LINED OR ROUND AS SHOWN, NO EXPOSED DUCT-SEALING MASTIC
	EXPOSED RETURN	RECTANGULAR, NO EXPOSED DUCT-SEALING MASTIC
	EXPOSED GEN. EXHAUST	RECTANGULAR OR ROUND AS SHOWN, NO EXPOSED DUCT-SEALING MASTIC
	CONCEALED, SUPPLY	RECT. OR ROUND AS SHOWN, LINED OR INSULATED
	CONCEALED, RETURN	RECT. OR ROUND AS SHOWN, LINED OR INSULATED
	CONCEALED, GEN. EXHAUST	RECT. OR ROUND AS SHOWN
	CONCEALED, TYPE I HOOD EXHAUST	RECTANGULAR 16 GA. BLACK IRON W/ WRAP OR UL 1978 FACTORY-MANUFACTURED DUCT W/ WRAP (SUBMIT SHOP DRAWINGS FOR FACTORY-MANUFACTURED DUCT PRIOR TO ORDERING FOR APPROVAL)

HVAC GENERAL NOTES

- A GENERAL NOTES APPLY TO HVAC SHEETS.
- B WORK SHALL COMPLY WITH STATE AND LOCAL CODE REQUIREMENTS AS APPROVED AND AMENDED BY THE AUTHORITY HAVING JURISDICTION, INCLUDING APPLICABLE SECTIONS OF NFPA, THE MECHANICAL CODE, AND ANY INTERIM AMENDMENTS AT THE TIME OF THE PROPOSAL. PURCHASE PERMITS ASSOCIATED WITH THE WORK. OBTAIN INSPECTIONS REQUIRED BY CODE. SEE ARCHITECTURAL SHEETS FOR THE PREVAILING CODES.
- C CONTRACTOR AND SUBCONTRACTORS SHALL REVIEW A COMPLETE SET OF THE CONSTRUCTION DOCUMENTS.
- D COORDINATE WORK WITH THE WORK OF OTHER TRADES, EQUIPMENT FURNISHED BY OTHERS, REQUIREMENTS OF THE OWNER, AND OF THE EXISTING CONDITIONS AT THE PROJECT SITE.
- E DRAWINGS FOR THE MECHANICAL WORK ARE DIAGRAMMATIC, SHOWING THE GENERAL LOCATION, TYPE, LAYOUT, AND EQUIPMENT REQUIRED. THE DRAWING SHALL NOT BE SCALED FOR EXACT MEASUREMENTS; REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS. REFER TO MANUFACTURER'S STANDARD INSTALLATION DRAWINGS FOR EQUIPMENT CONNECTIONS AND INSTALLATION REQUIREMENTS. PROVIDE DUCTWORK, CONNECTIONS, OFFSETS, ACCESSORIES, AND MATERIALS NECESSARY FOR A COMPLETE SYSTEM.
- F DUCT DIMENSIONS ON PLANS INDICATE DIMENSIONS OF INTERNAL FREE AREA.
- G PERFORATED CEILING DIFFUSERS SHALL BE 4-WAY UNLESS NOTED OTHERWISE.
- H COORDINATE ROOF WORK WITH THE OWNER'S CONSTRUCTION MANAGER PRIOR TO CONSTRUCTION.
- I UNLESS NOTED OTHERWISE RECTANGULAR DUCT ELBOWS GREATER THAN 45° SHALL BE MITERED ELBOWS WITH DOUBLE-THICKNESS TURNING VANES AND RECTANGULAR DUCT ELBOWS 45° OR LESS SHALL BE RADIUSSED ELBOWS WITH AN INSIDE RADIUS OF AT LEAST 1/2 THE WIDTH OF THE DUCT.
- J REPLACE AIR FILTERS WITH NEW, CLEAN MERV 8 AIR FILTERS AT TURNOVER.
- K THE TERM "FURNISH" MEANS SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS. THE TERM "INSTALL" DESCRIBES THE OPERATIONS AT THE PROJECT SITE INCLUDING THE ACTUAL UNLOADING, UNPACKING, ASSEMBLY, ERECTING, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, AND SIMILAR OPERATIONS. THE TERM "PROVIDE" MEANS TO FURNISH AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE.
- L INSTALL LABELING CALLED FOR IN THE MECHANICAL DRAWINGS USING ENGRAVED PHENOLIC PLATES (WHI TE WITH BLACK LETTERING) FURNISHED BY TSV.
- M PROVIDE P3000 12 GA. UNISTRUT WITH PG FINISH FOR DUCT SUPPORTS AND OTHER UNISTRUT IN AREAS EXPOSED TO VIEW. SLOTTED UNISTRUT AND OTHER UNISTRUT WITH HOLES IS NOT ACCEPTABLE.

HVAC ABBREVIATIONS

AFF ABOVE FINISHED FLOOR

AFG ABOVE FINISHED GRADE

CD CEILING DIFFUSER

CU CONDENSING UNIT

(E) EXISTING

EF EXHAUST FAN

ER EXHAUST REGISTER

EXT'G EXISTING

HD HOOD

MUA MAKEUP AIR UNIT

OBD BLADE DAMPER

RG RETURN GRILLE

RTU ROOFTOP UNIT

SR SUPPLY REGISTER

VSC VARIABLE SPEED CONTROL

COZAS TENANT'S CO2 ALARM SUPPLIER

GC GENERAL CONTRACTOR

HES TENANT'S HVAC EQUIPMENT SUPPLIER

HS TENANT'S HOOD SUPPLIER

KES TENANT'S KITCHEN EQUIPMENT SUPPLIER

TAB TENANT'S TEST AND BALANCE VENDOR

TCC TENANT'S CABLING CONTRACTOR

TDC TENANT'S DUCT CLEANER

TEMS TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER

TLS TENANT'S LIGHT/LAMP SUPPLIER

TMB TENANT'S MENU BOARD SUPPLIER

TMS TENANT'S MILLWORK SUPPLIER

TP TENANT'S PHONE SUPPLIER

TPS TENANT'S PANELBOARD SUPPLIER

TRS TENANT'S RAILING SUPPLIER


TSV TENANT'S SIGN VENDOR


TUV TENANT'S UV SANITIZER SUPPLIER


WCS TENANT'S WALK-IN COOLER SUPPLIER

WHS TENANT'S WATER HEATER SUPPLIER


HVAC SYMBOLS

 CEILING DIFFUSER


 CEILING-MOUNTED RETURN OR EXHAUST REGISTER

 SUPPLY REGISTER


 RETURN GRILLE


 FLEXIBLE DUCT

 MITERED CORNER WITH TURNING VANES


 DUCTWORK INTERNAL FREE DIMENSIONS (WIDTH/HEIGHT) RECTANGULAR TO ROUND DUCT TRANSITION


 DUCT-MOUNTED SMOKE DETECTOR


 MOTOR-OPERATED DAMPER


 MANUAL VOLUME DAMPER


 GREASE DUCT CLEANOUT

 MITERED CORNER WITHOUT TURNING VANES

 GRIDPOINT THERMOSTAT

 GRIDPOINT ZONE SENSOR MODULE

 GRIDPOINT SUPPLY PROBE

 PLAN NOTE: SEE PLAN NOTES LISTED ON THE SAME SHEET FOR NOTE MEANING

 CONNECT TO EXISTING

 EQUIPMENT TAG: SEE EQUIPMENT SCHEDULE ON SHEET M600 FOR EQUIPMENT INFORMATION


 AUDIO/VISUAL REMOTE SMOKE DETECTOR ANNUNCIATOR WITH REMOTE KEY OPERATED RESET

 GRILL, REGISTER, OR DIFFUSER TAG: TAG NECK SIZE AIRFLOW [CFM]

Consultant:

NATIONAL ENGINEERING

4635 Trueman Blvd, Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com

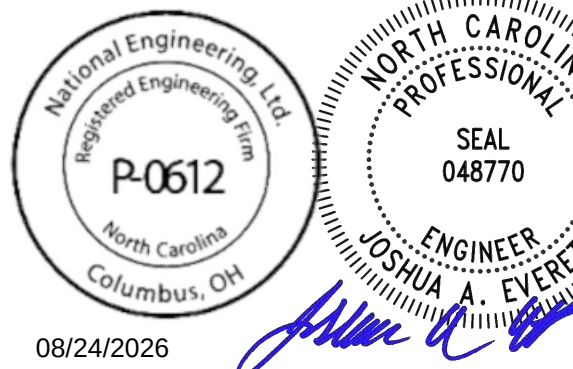

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:
03/07/2025 PERMIT SET
05/29/2025 BID SET

Revisions:

Drawn: EEP
Checked: AJJ

Project No.
2402039


Contents:

HVAC
SPECIFICATIONS

M010


HVAC PLAN NOTES

- SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR CEILING MOUNTED EQUIPMENT LOCATION. TYPICAL.
- PAINT DUCTWORK VISIBLE THROUGH DINING ROOM SUPPLY REGISTERS AND RETURN GRILL BLACK. TYPICAL.
- ADJUST SUPPLY REGISTERS SO THAT SUPPLY AIR HITS WALL ON OPPOSITE SIDE OF ROOM AT APPROXIMATELY 7' AFF WITH NO DRAFTS FELT IN THE DINING ROOM.
- 26/14 DUCT UP FOR TRANSITION TO RTU-1 RETURN CONNECTION IN ROOF CURB. RTU-1 SHALL HAVE AN INTEGRAL SMOKE DETECTOR MOUNTED IN THE RETURN AIR STREAM. INTERLOCK SMOKE DETECTOR TO RTU-1 OPERATION.
- 32/14 DUCT UP FOR TRANSITION TO RTU-2 RETURN CONNECTION IN ROOF CURB. RTU-2 SHALL HAVE AN INTEGRAL SMOKE DETECTOR MOUNTED IN THE RETURN AIR STREAM. INTERLOCK SMOKE DETECTOR TO RTU-2 OPERATION.
- 26/14 DUCT UP FROM BUILDING SUPPLY THROUGH ROOF. TRANSITION TO RTU-1 SUPPLY CONNECTION IN ROOF CURB.
- 30/16 DUCT UP FROM BUILDING SUPPLY TO RTU-2 SUPPLY CONNECTION. TRANSITION IN ROOF CURB.
- 16/12 DUCT UP THROUGH ROOF. TRANSITION TO MAU-1 SUPPLY CONNECTION IN ROOF CURB.
- 16/16 DUCT UP FROM HOOD THROUGH ROOF TO EF-1 COMPLIANT WITH NFPA 96. PROVIDE RADIUSSED ELBOWS WITH AN INSIDE RADIUS OF 0.5W AT ELBOWS IN GREASE DUCT.
- 8/6 DUCT UP THROUGH ROOF TO EF-2.
- 28/6 DUCT DOWN TO MAKEUP AIR PSP DUCT CONNECTION. TRANSITION TO SUPPLY PLENUM OPENING SIZE. TYPICAL FOR 3.
- 8" DIA. DUCT DOWN TO AC PSP DUCT CONNECTION. TRANSITION TO SUPPLY PLENUM OPENING SIZE. TYPICAL. CAP UNUSED DUCT CONNECTIONS.
- INSTALL SINGLE GANG VERTICAL J-BOX GRIDPOINT THERMOSTATS FURNISHED BY TEMS FOR RTU-1 AND RTU-2 AT THIS LOCATION AT 48" AFF. COORDINATE WITH ELECTRICAL SWITCHING IN THIS AREA. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.
- INSTALL GRIDPOINT ZONE SENSOR MODULE FURNISHED BY TEMS FOR RTU-1 AT THIS LOCATION 72" AFF DIRECTLY TO WALL (NO JUNCTION BOX). COORDINATE LOCATION WITH EQUIPMENT. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.
- INSTALL GRIDPOINT ZONE SENSOR MODULE FURNISHED BY TEMS FOR RTU-2 AT THIS LOCATION 66" AFF DIRECTLY TO WALL (NO JUNCTION BOX). COORDINATE LOCATION WITH EQUIPMENT. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.
- INSTALL GRIDPOINT SUPPLY PROBE FURNISHED BY TEMS FOR RTU-1 IN THE SUPPLY DUCTWORK UPSTREAM FROM THE FIRST BRANCH CONNECTION. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.
- INSTALL GRIDPOINT SUPPLY PROBE FURNISHED BY TEMS FOR RTU-2 IN THE SUPPLY DUCTWORK UPSTREAM FROM THE FIRST BRANCH CONNECTION. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.

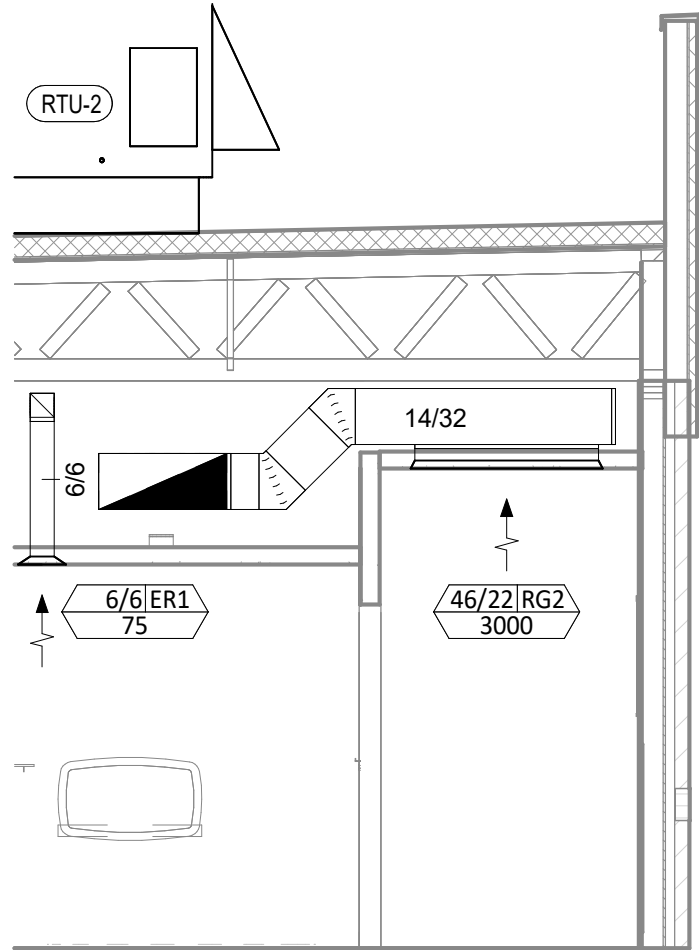


HVAC DINING ROOM SECTION

5
M100
1/4" = 1'-0"

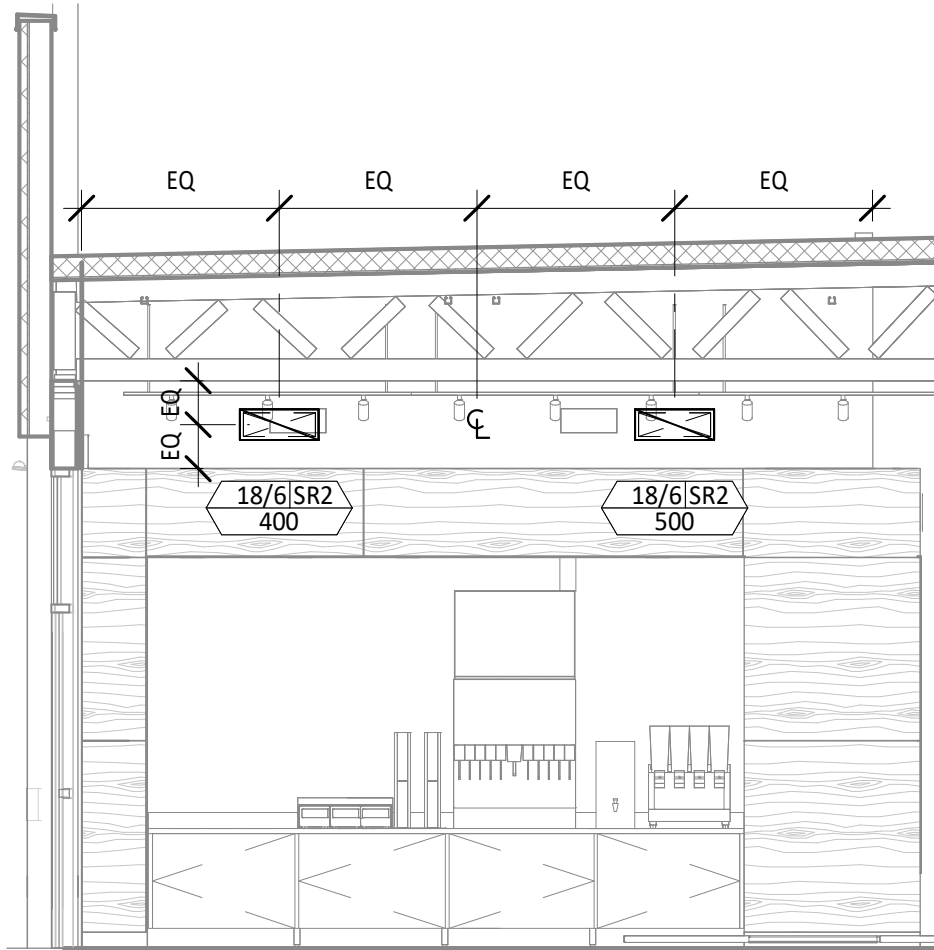

HVAC DINING ROOM SECTION

4
M100
1/4" = 1'-0"

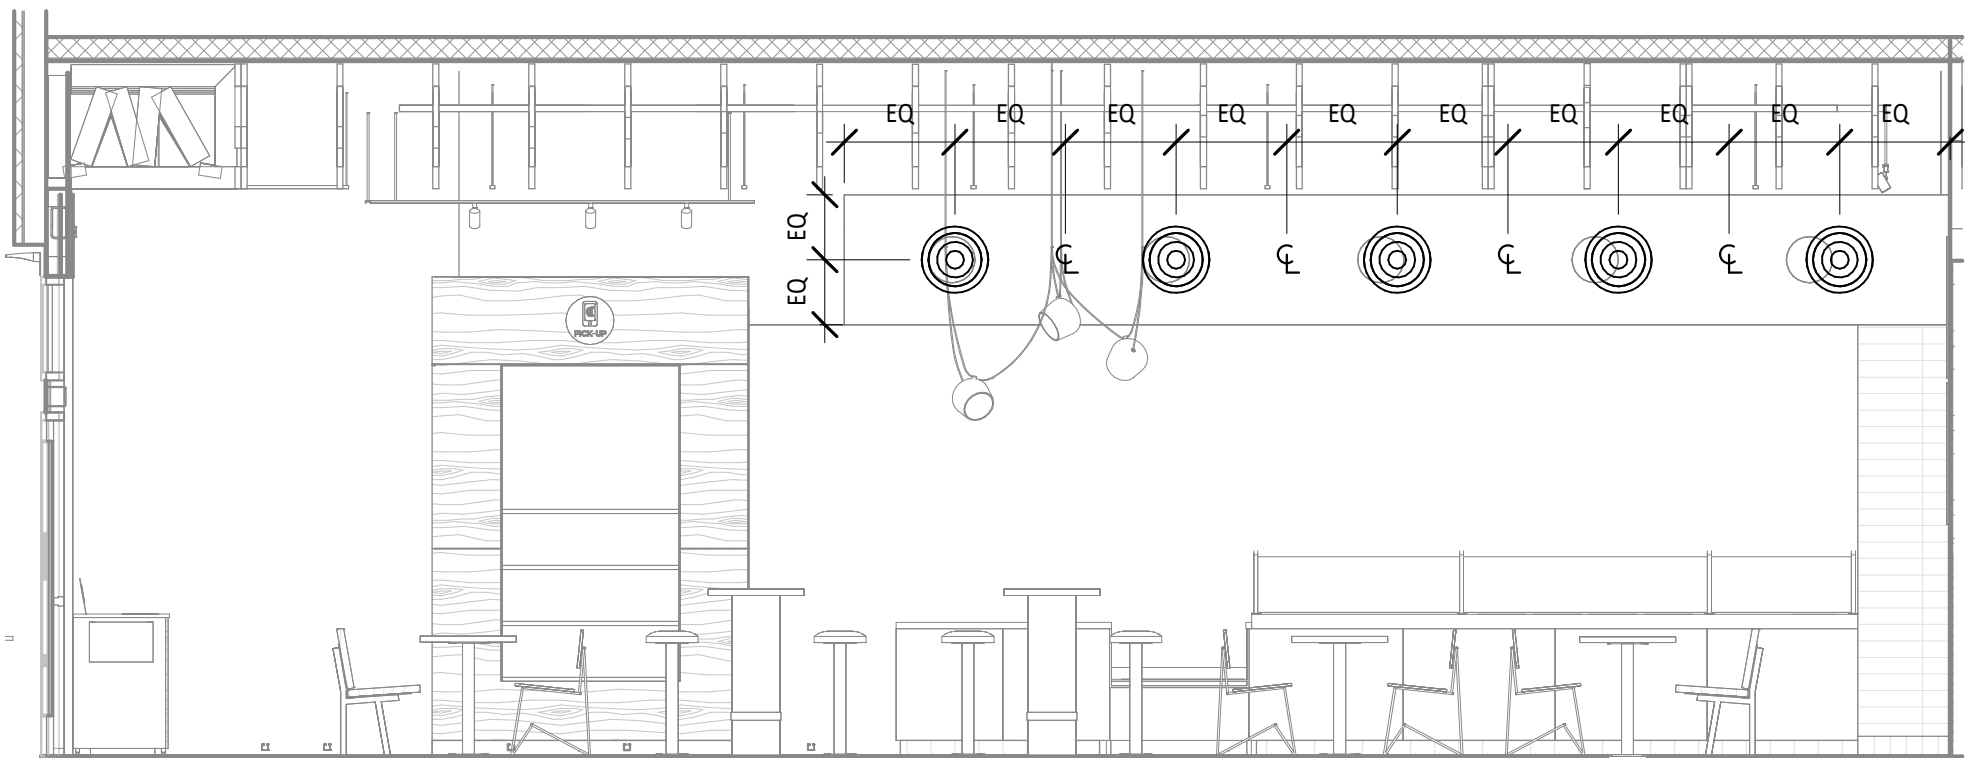


HVAC DINING ROOM SECTION

3
M100
1/4" = 1'-0"


HVAC PLAN NOTES

- INSTALL REMOTE TEMPERATURE SENSOR FOR HOOD HD-1 AT THIS LOCATION 72" AFF. COORDINATE LOCATION WITH EQUIPMENT. PROVIDE (2) #18 G. THERMISTOR CABLE FROM TEMPERATURE SENSOR TO HOOD CONTROL PANEL.
- INSTALL KITCHEN HOOD, HD-1. SUPPORT HOOD PER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL HOOD ACCORDING TO THE REQUIREMENTS OF ITS LISTING, IN COMPLIANCE WITH NFPA 96, THE BUILDING CODE, AND AUTHORITIES HAVING JURISDICTION. HOOD SHALL HAVE AN INTEGRAL DUCT COLLAR TEMPERATURE SENSOR TO AUTOMATICALLY ENERGIZE THE EXHAUST AND MAKEUP AIR FANS IF COOKING TEMPERATURES ARE DETECTED. EXHAUST DUCT SYSTEM TO BE WELDED OR FACTORY-MANUFACTURED WATER AND AIR TIGHT. INSTALL CLEANOUTS PER CODE AND AS SHOWN. INSTALL HOOD PER DETAILS 2, 4, AND 9/M700. CHIPOTLE WILL PROVIDE AN INDEPENDENT TESTING AGENCY FOR TESTING THE INTEGRITY OF THE GREASE DUCT SYSTEM.
- INSTALL REMOTE CONDENSING UNIT FOR WALK-IN COOLER ON ROOF AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL REFRIGERANT LINE SET, THERMOSTATIC EXPANSION VALVE, SOLENOID VALVE, TEMPERATURE CONTROL, SIGHT GLASS, FILTER DRIER, PRESSURE CONTROL, LOW AMBIENT CONTROLS, AND WEATHERPROOF HOUSING. TRAP AND SLOPE REFRIGERANT LINES PER MANUFACTURER'S RECOMMENDATIONS. INSTALLATION SHALL COMPLY WITH ASHRAE/ANSI STANDARD 15. INSTALL THE REFRIGERANT LINE SET UNDER THE ROOF DECK TO WITHIN 3' OF THE CONDENSING UNIT. CUT 2-1/2" HOLE IN WALK-IN COOLER ROOF FOR REFRIGERANT LINE SET AND SEAL PER THE COOLER MANUFACTURER'S INSTALLATION INSTRUCTIONS AFTER LINE SET IS INSTALLED.
- INSTALL REMOTE CONDENSER FOR ICE MACHINE ON ROOF AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL REFRIGERANT LINE SET, THERMOSTATIC EXPANSION VALVE, SOLENOID VALVE, TEMPERATURE CONTROL, SIGHT GLASS, FILTER DRIER, PRESSURE CONTROL, LOW AMBIENT CONTROLS, AND WEATHERPROOF HOUSING. TRAP AND SLOPE REFRIGERANT LINES PER MANUFACTURER'S RECOMMENDATIONS. SEAL PIPING PENETRATIONS THROUGH ROOF. INSTALLATION SHALL COMPLY WITH ASHRAE/ANSI STANDARD 15. INSTALL THE REFRIGERANT LINE SET UNDER THE ROOF DECK TO WITHIN 3' OF THE REMOTE CONDENSER. IF REFRIGERANT PIPING TO ICE MAKER IS EXPOSED TO PUBLIC VIEW CONCEAL WITHIN A STAINLESS STEEL SHROUD AS SHOWN IN THE ARCHITECTURAL DRAWINGS.
- INSTALL ROOFTOP EQUIPMENT PER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS.
- INSTALL EXHAUST FAN EF-1 PER DETAIL 5/M700 AND AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL GREASE VIROGUARD SYSTEM FURNISHED BY CHIPOTLE ON EXHAUST FAN, EF-1.
- PROVIDE SUPPLY DIFFUSER CONNECTION TO SUPPLY SYSTEM PER DETAIL 1/M700. TYPICAL.
- PROVIDE AUDIO/VISUAL REMOTE SMOKE DETECTOR ANNUNCIATOR WITH REMOTE KEY OPERATED RESET. WIRE A UNIT BACK TO EACH SMOKE DETECTOR. MOUNT UNIT 60" AFF. TYPICAL.
- INSTALL REME HALO AIR PURIFIER FURNISHED BY TUV IN RTU PER DETAIL 6/M700. SEE ELECTRICAL DRAWINGS FOR POWER CONNECTION INFORMATION. INSTALL UV WARNING STICKERS ON FACE OF ENCLOSURE PER DETAIL AND ON ANY RTU ACCESS DOOR(S) THROUGH WHICH THE REME HALO WOULD BE VISIBLE IF OPENED.
- MAINTAIN 10' CLEARANCE BETWEEN WATER HEATER FLUE TERMINATION AND OUTSIDE AIR INTAKES. MAINTAIN 10' CLEARANCE BETWEEN WATER HEATER COMBUSTION AIR INTAKE AND EXHAUST FAN EF-1 DISCHARGE. SEE PLUMBING DRAWINGS FOR MORE INFORMATION ON WATER HEATER FLUE AND COMBUSTION AIR TERMINATIONS.

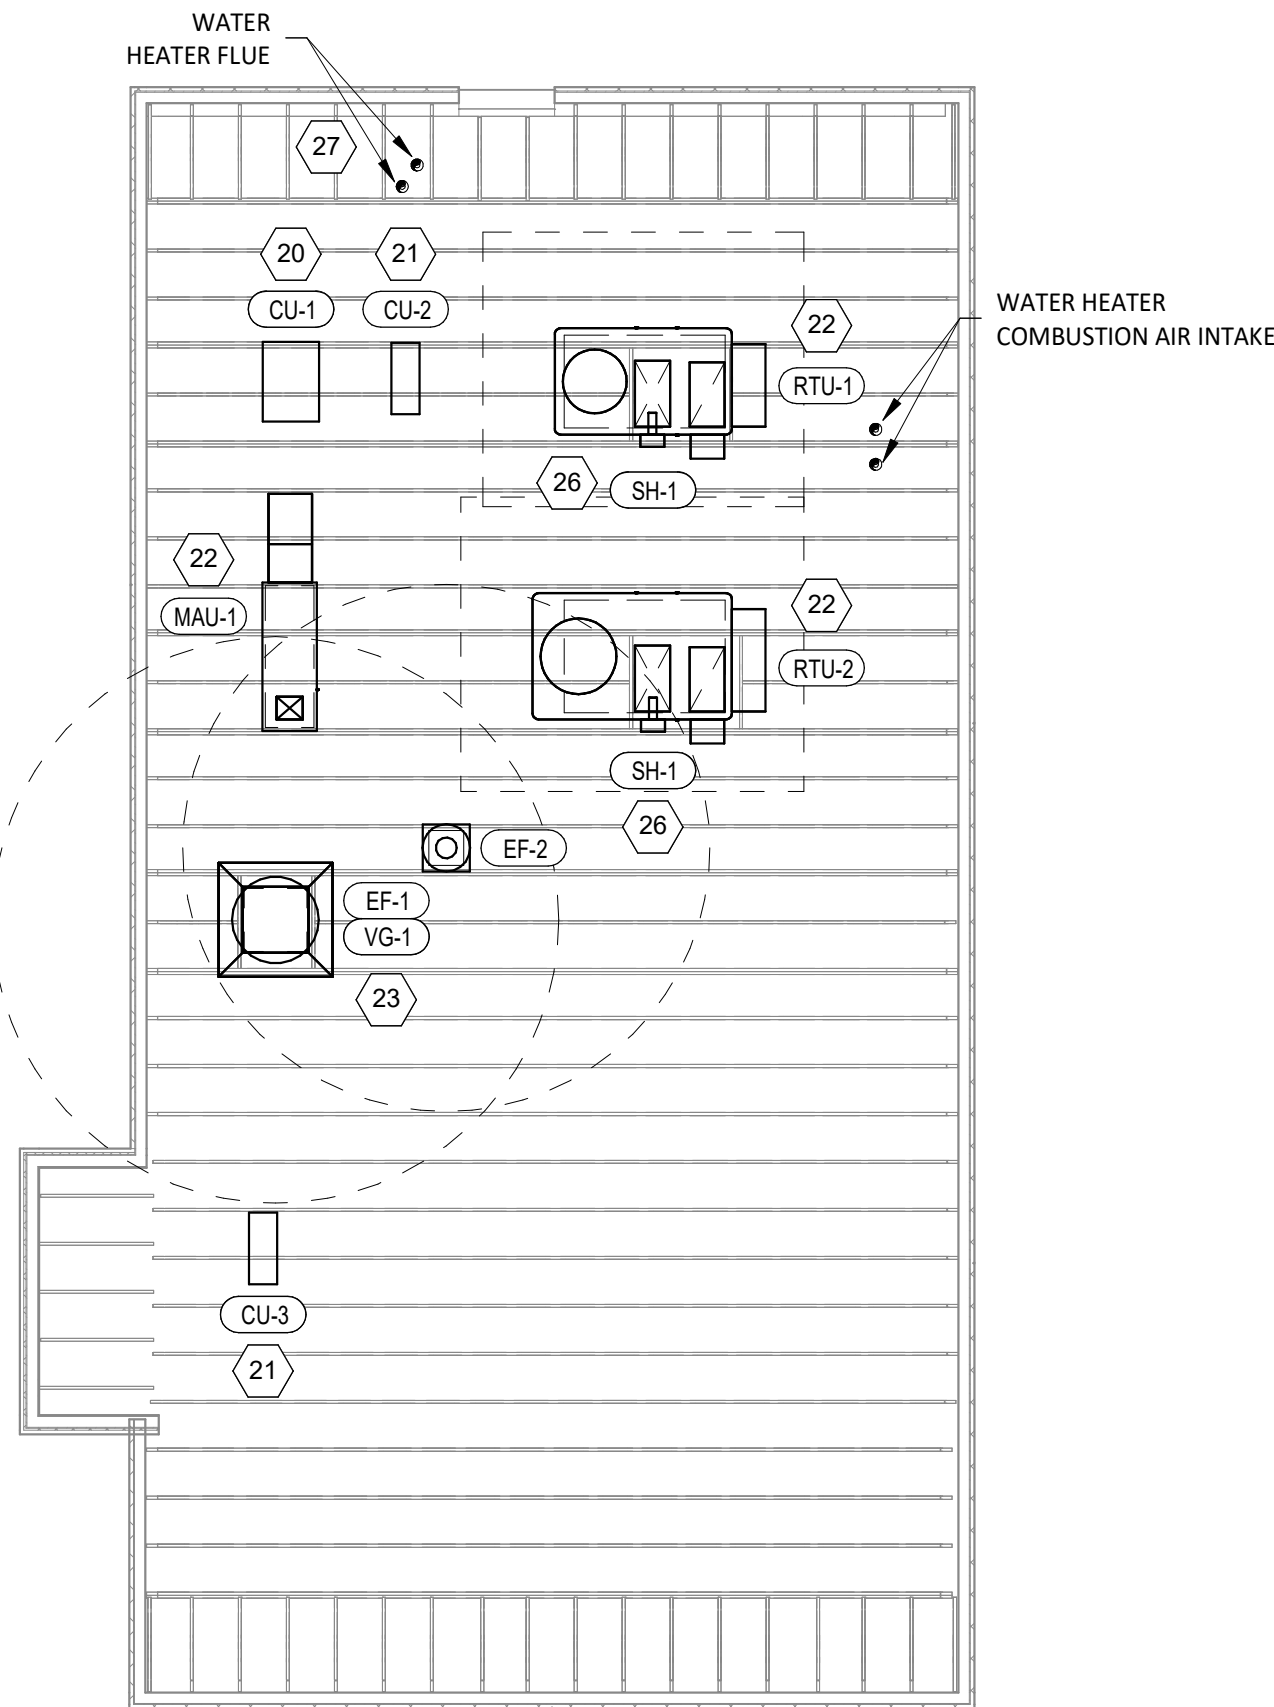

HVAC ROOF PLAN


2
M100
1/8" = 1'-0"

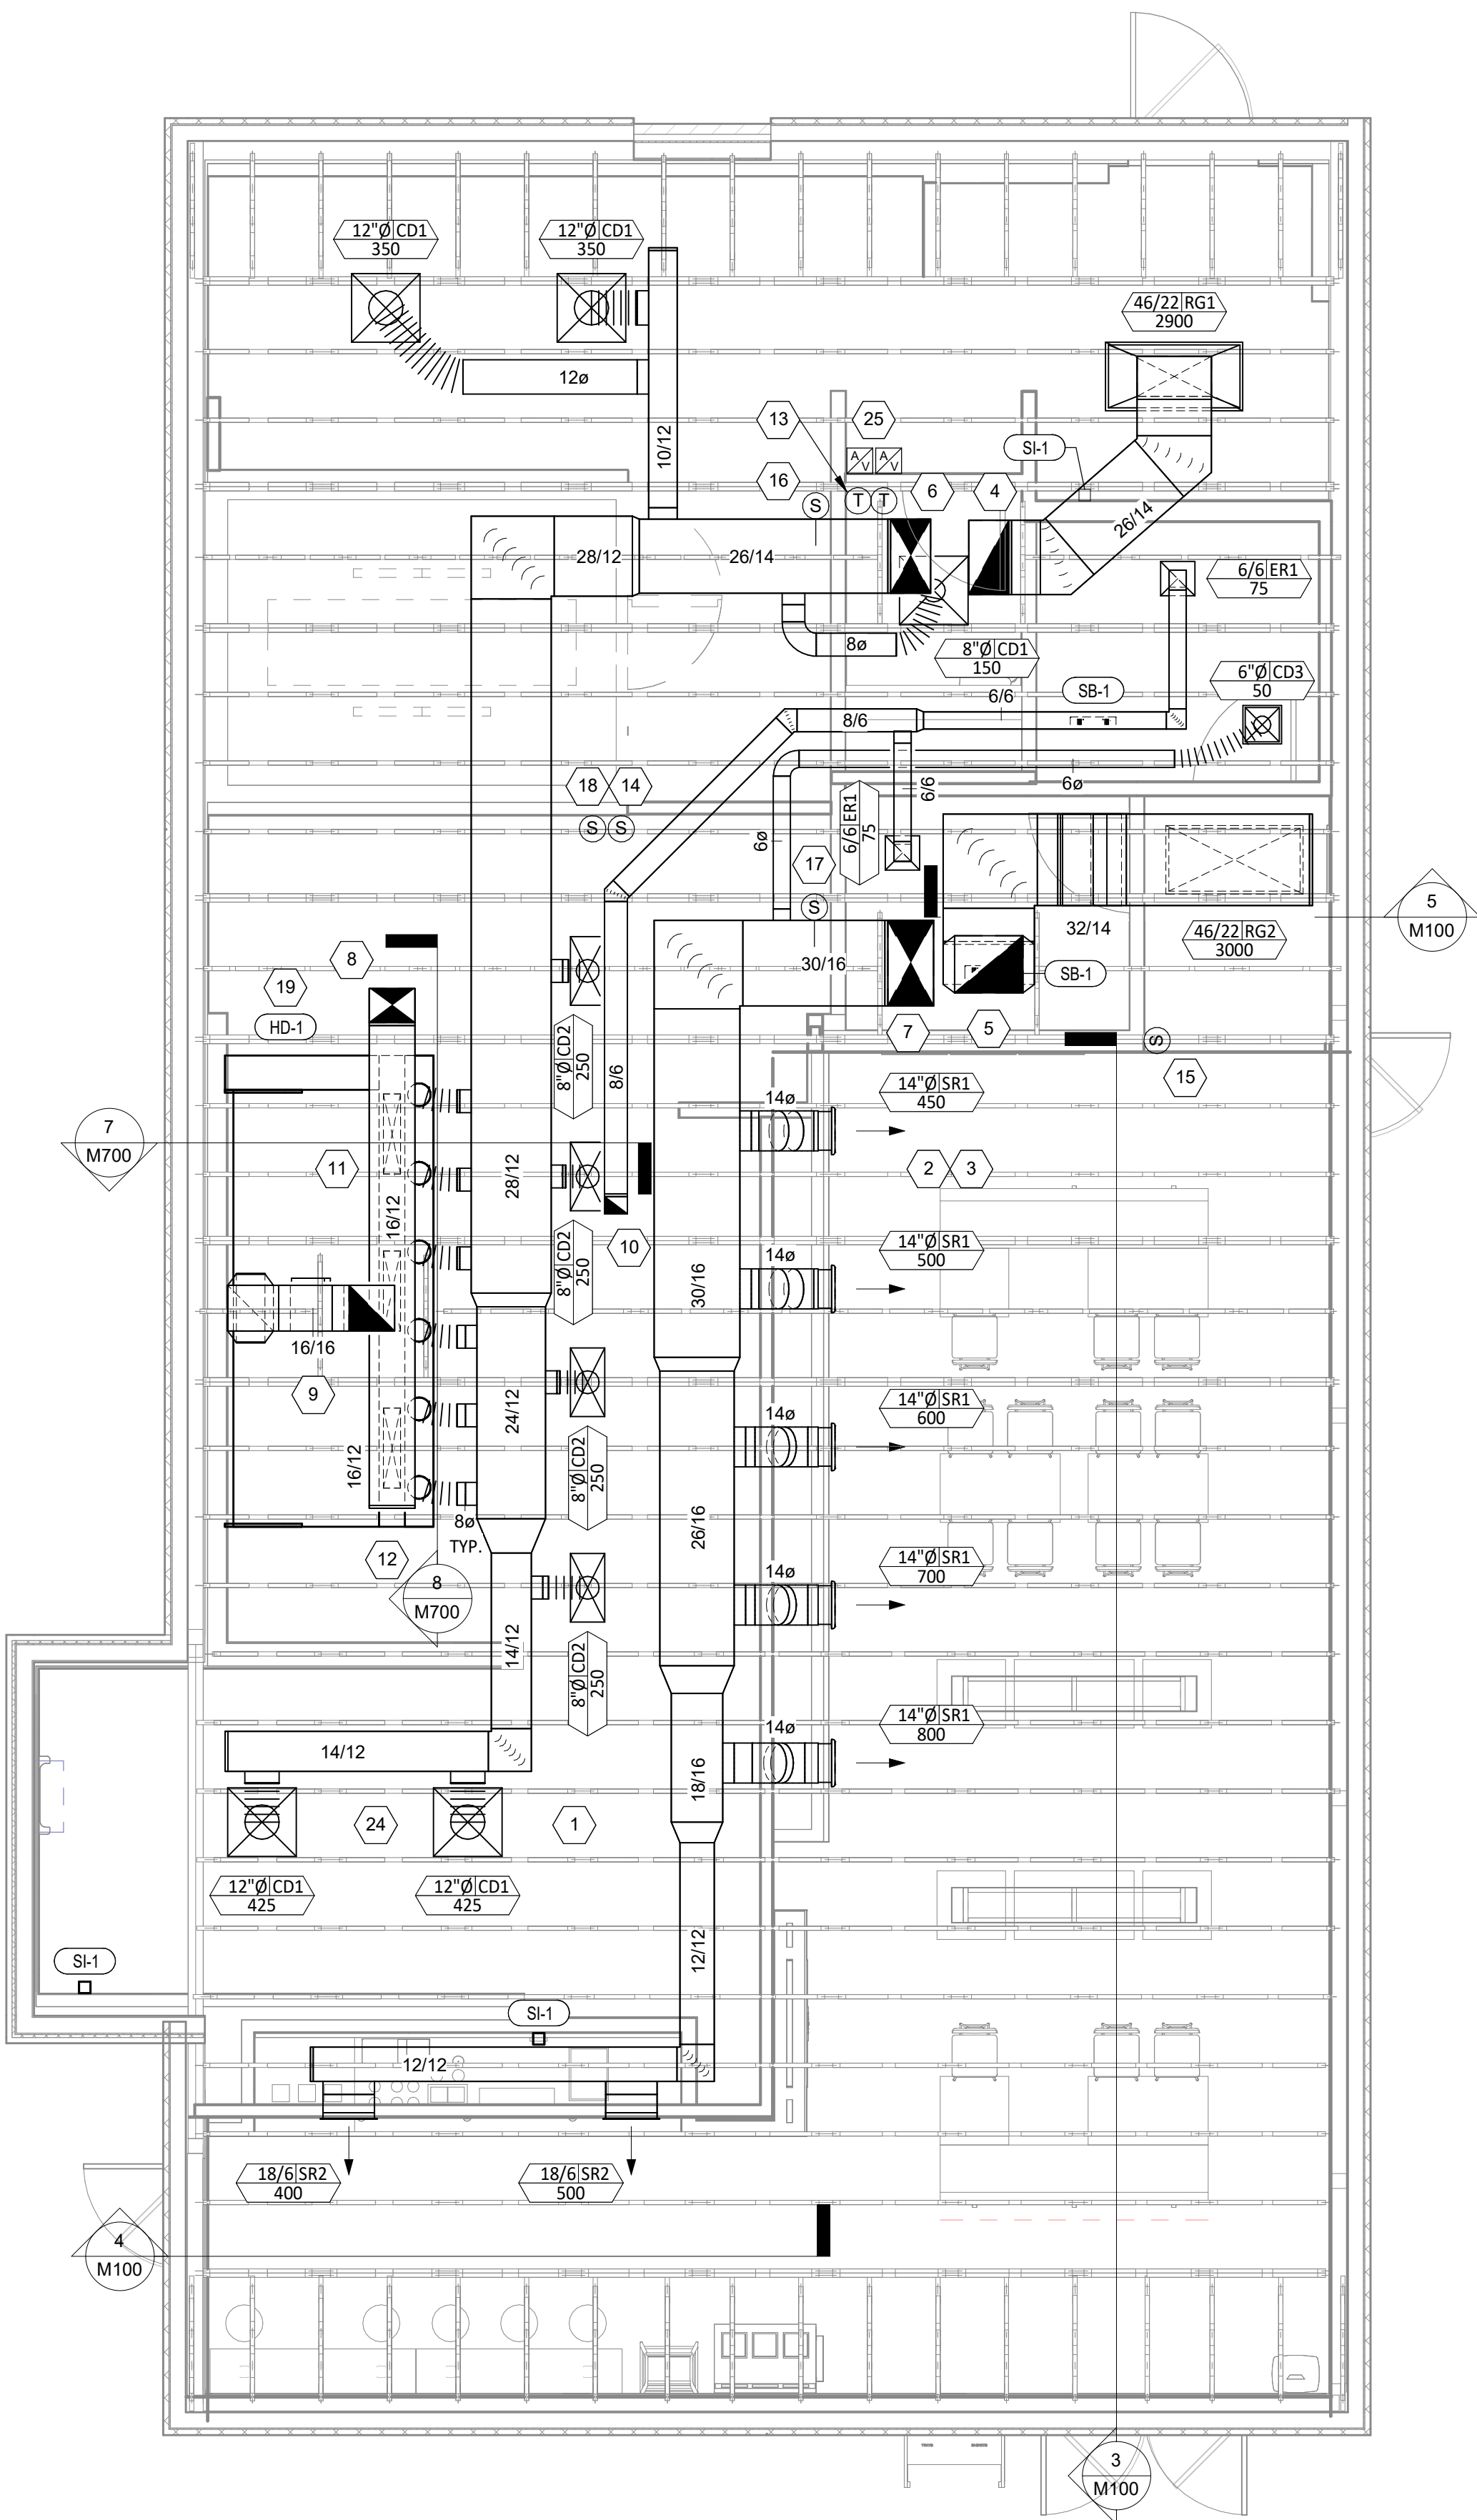

HVAC FLOOR PLAN

1
M100
1/4" = 1'-0"

Consultant:

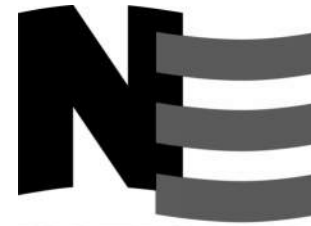

4635 Trueman Blvd. Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260

Epalma@nationalengineering.com



08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644

"CAMERON NC"

NC 24-87

CAMERON, NC 28326

Issue Record:

03/07/2025 PERMIT SET
05/29/2025 BID SET

Revisions:

Drawn: EEP
Checked: AJJ

Project No.
2402039

Contents:

HVAC PLAN

M100

SANITIZING EQUIPMENT SCHEDULE

TAG	COUNT	DESCRIPTION	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
					MANUFACTURER	MODEL	
SB-1	2	BATHROOM AIR PURIFICATION UNIT	TUV	GC	RGF ENVIRONMENTAL GROUP	BRU ASSEMBLY	SEE ELECTRICAL SHEETS FOR CONNECTION INFORMATION
SH-1	2	HVAC AIR PURIFICATION UNIT	TUV	GC	RGF ENVIRONMENTAL GROUP	REME-HALO	SEE DETAIL 6/M700 FOR INSTALLATION INFORMATION.
SI-1	3	ICE MACHINE TREATMENT SYSTEM	TUV	GC	RGF ENVIRONMENTAL GROUP	IMS-B-GA	SEE PLUMBING DRAWINGS FOR INSTALLATION INFORMATION.

VIROGUARD SCHEDULE

TAG	QUANTITY	DESCRIPTION	DUCT CONNECTION SIZE	FAN	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN MANUFACTURER
VG-1	1	HURRICANE RATED VIROGUARD HOOD EXHAUST FAN ROOFTOP CONTAINMENT SYSTEM	16" X 16"	CAPTIVE-AIRE DU180HFA	TDC	GC	ENVIROMATIC

GRILLS, REGISTERS, AND DIFFUSERS SCHEDULE

TAG	DESCRIPTION	FACE SIZE	MATERIAL	FINISH	MOUNTING	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		NOTES
								MANUFACTURER	MODEL	
CD1	PERFORATED CEILING DIFFUSER	24" X 24"	ALUMINUM	WHITE	LAY-IN CEILING	GC	GC	NAILOR	4320A TYPE L	PROVIDE INTEGRAL OBD
CD2	PERFORATED CEILING DIFFUSER	24" X 12"	ALUMINUM	WHITE	LAY-IN CEILING	GC	GC	NAILOR	4320A TYPE L	PROVIDE INTEGRAL OBD, REMOVE 4-WAY DEFLECTOR
CD3	PERFORATED CEILING DIFFUSER	12" X 12"	ALUMINUM	WHITE	GYP CEILING	GC	GC	NAILOR	4320A TYPE S	PROVIDE INTEGRAL OBD
ER1	PERFORATED CEILING EXHAUST	12" X 12"	ALUMINUM	WHITE	GYP CEILING	GC	GC	NAILOR	4330R TYPE S	PROVIDE INTEGRAL OBD
RG1	PERFORATED CEILING RETURN	48" X 24"	ALUMINUM	WHITE	LAY-IN CEILING	GC	GC	NAILOR	4330R TYPE L	
RG2	PERFORATED CEILING RETURN	48" X 24"	ALUMINUM	WHITE	GYP CEILING	GC	GC	NAILOR	4330R TYPE S	
SR1	ADJUSTABLE TURBO NOZZLE	SEE NECK SIZE	ALUMINUM	WHITE	WALL	GC	GC	AIR CONCEPTS	ANR-14	PROVIDE FACE-ACCESSIBLE OBD
SR2	DOUBLE DEFLECTION SUPPLY REGISTER	SEE NECK SIZE	ALUMINUM	WHITE	WALL	GC	GC	NAILOR	51DH	PROVIDE INTEGRAL OBD

FAN SCHEDULE

TAG	DRIVE TYPE	EXHAUST FLOW [CFM]	E.S.P. [in W.C.]	WEIGHT [lbs]	ELECTRICAL		FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
					MOTOR POWER	V/P/H			MANUFACTURER	MODEL	
EF-1	DIRECT	2550 CFM	1.20 in-wg	400	2	208/3/60	H5	GC	CAPTIVE-AIRE	DU180HFA	FURNISHED WITH DISCONNECT AND VENTED ROOF CURB
EF-2	DIRECT	150 CFM	0.60 in-wg	100	0.18 HP	120/1/60	H5	GC	CAPTIVE-AIRE	DR12HFA	FURNISHED WITH DISCONNECT, VARIABLE SPEED CONTROLLER, BACKDRAFT DAMPER AND ROOF CURB

MAKEUP AIR UNIT SCHEDULE

TAG	DESCRIPTION	AIRFLOW		E.S.P. [in. W.C.]	INPUT [MBH]	HEATING CAPACITY			APPROXIMATE WEIGHT [lbs]	ELECTRICAL		FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
		SUPPLY FLOW [CFM]				OUTPUT [MBH]	MAXIMUM TURNDOWN	EAT		MOTOR POWER	V/P/H			MANUFACTURER	MODEL	
MAU-1	MAKEUP AIR UNIT	1300		0.80	225	220	12.5:1	19 °F	650	1 HP	208/3/60	HS	GC	CAPTIVE-AIRE	A1-D.250-15D	FURNISHED WITH DISCONNECT, HURRICANE-RATED ROOF CURB, SCREEN INTAKE, AND WASHABLE ALUMINUM FILTERS GC TO FURNISH AND FIELD INSTALL PROPANE CONVERSION KIT.

CONDENSING UNIT SCHEDULE

TAG	DESCRIPTION	NOMINAL CAPACITY [TONS]	NUMBER OF COMPRESSORS	NUMBER OF CIRCUITS	REFRIGERANT TYPE	REFRIGERANT CHARGE	WEIGHT	ELECTRICAL			FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
								MOCP	FLA	V/P/H			MANUFACTURER	MODEL	
CU-1	WALK-IN COOLER REMOTE CONDENSING UNIT	--	1	1	R-448A	9.9	250	20 A	15.0 A	208/3/60	WCS	GC	EVERIDGE	RFO151E4SEANT	FURNISHED WITH WALK-IN COOLER
CU-2	ICE MAKER - REMOTE CONDENSER	--	0	1	R-404A	11 lbs 7.4 oz	100			120/1/60	KES	GC	-	-	FURNISHED WITH ICE MAKER
CU-3	ICE MAKER - REMOTE CONDENSER	--	0	1	R-404A	11 lbs 7.4 oz	100			120/1/60	KES	GC	-	-	FURNISHED WITH ICE MAKER

KITCHEN HOOD SCHEDULE

TAG	DESCRIPTION	MAX COOKING TEMP.	EXHAUST PLENUM							PERFORATED SUPPLY PLENUMS										NUMBER OF LIGHT FIXTURES	APPROXIMATE WEIGHT [lbs]	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
			AIRFLOW [CFM]	SP [in. W.C.]	DUCT COLLARS			SP [in. W.C.]	SUPPLY PLENUM LENGTH	SUPPLY PLENUM WIDTH	MAU PLENUM			AC PLENUM												
					NO.	WIDTH	LENGTH				NO.	WIDTH	LENGTH	AIRFLOW [CFM]	DUCT COLLARS	AIRFLOW [CFM]	DUCT COLLARS	NO.	DIAMETER							
																								MANUFACTURER	MODEL	
HD-1	TYPE I CANOPY HOOD WITH PERFORATED MAU AND AC SUPPLY PLENUMS	600°F	2550	0.97	1	10"	24"	12' - 9"	4' - 3"	0.1	13' - 9"	19"	1300	3	6"	28"	700	6	8"	8	1100	HS	GC	CAPTIVE-AIRE	5424 ND-2-ACPSP-F	MAT'L: 18 GA. TYPE 430 SS. FURNISHED WITH VERTICAL END PANELS, 24V GAS VALVE, VAPORPROOF INCANDESCENT LIGHT FIXTURES, 16" TALL HE SS FILTERS, INTEGRAL UTILITY CABINET, KITCHEN EXHAUST SUPPRESSION SYSTEM, DUCT COLLAR TEMPERATURE SENSOR, PREWIRE PACKAGE, SPARE FIRE SYSTEM DRY CONTACT, AND 4-POLE 20A CONTACTOR

ROOFTOP UNIT SCHEDULE

TAG	DESCRIPTION	NOMINAL CAPACITY [TONS]	EER	AIRFLOW			NET COOLING CAPACITY				HEATING CAPACITY			# OF COMPRESSORS	# OF CIRCUITS	REFRIG. TYPE	REFRIG. CHARGE	APPROX. WEIGHT [lbs]	ELECTRICAL			FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS	
				TOTAL [CFM]	OA [CFM]	ESP [IN. W.C.]	TOTAL [MBH]	SENSIBLE [MBH]	EAT [DEG. F]	COND. EAT [DEG. F]	INPUT [MBH]	OUTPUT [MBH]	EAT [DEG. F]						MOCP	FLA	V/P/H			MANUFACTURER	MODEL		
RTU-1	KITCHEN ROOFTOP UNIT	8.5	12.1	3400	500	0.8	104	69	76	66	100	150	120	61	2	2	R-454B	8.3 lb	1300	70 A	53.0 A	208/3/60	HES	GC	TRANE	YHK102	FURNISHED WITH COMP. ENTHALPY ECON., BAROMETRIC RELIEF, RET. SMOKE DETECTOR W/ REMOTE KEYED ANNUNCIATOR/RESET, M.O.D., MERV-8 FILTERS, HURRICANE-RATED CURB, HAIL GUARD, TOOLLESS HINGED ACCESS PANELS, DISCONNECT, & UNIT-MOUNTED CONVENIENCE RECEPTACLE
RTU-2	DINING ROOM ROOFTOP UNIT	10	11.6	4000	1000	0.8	121	79	79	69	102	200	160	57	2	2	R-454B	8.4 lb	1500	80 A	60.0 A	208/3/60	HES	GC	TRANE	YHK120	GC TO FURNISH AND FIELD INSTALL PROPANE CONVERSION KIT. FURNISHED WITH COMP. ENTHALPY ECON., BAROMETRIC RELIEF, RET. SMOKE DETECTOR W/ REMOTE KEYED ANNUNCIATOR/RESET, M.O.D., MERV-8 FILTERS, HURRICANE-RATED CURB, HAIL GUARD, TOOLLESS HINGED ACCESS PANELS, DISCONNECT, & UNIT-MOUNTED CONVENIENCE RECEPTACLE GC TO FURNISH AND FIELD INSTALL PROPANE CONVERSION KIT.

AIR BALANCE SCHEDULE

Tag	Supply Flow [CFM]	Return Flow [CFM]	Exhaust Flow [CFM]	Subtotal [CFM]
EF-1	0	0	2550	-2550
EF-2	0	0	150	-150
MAU-1	1300	0	0	1300
RTU-1	3400	2900	0	500
RTU-2	4000	3000	0	1000
Net Pressurization [CFM]				100


CONTROL FUNCTIONS

- A. THE MAIN COOKING EXHAUST FAN AND MAKE-UP AIR UNIT SHALL BE INTERLOCKED TO OPERATE TOGETHER. THIS CONTROL CIRCUIT IS ACTIVATED BY A SWITCH AND INCLUDES A FIRE PROTECTION OVERRIDE.
- B. THE TEMPERATURE IN EACH ZONE IS CONTROLLED BY SPACE TEMPERATURE SENSORS CONNECTED TO THE THERMOSTATS LOCATED IN THE OFFICE. ALL ZONES SHALL OPERATE WITH CONTINUOUS FAN OPERATION DURING OCCUPIED TIMES AND INTERMITTENTLY AS NEEDED TO MAINTAIN SET POINTS DURING UNOCCUPIED TIMES. OUTSIDE AIR DAMPERS SHALL BE OPEN CONTINUOUSLY WHEN EITHER IN OCCUPIED MODE OR WHEN THE HOOD SYSTEM IS ON AND SHALL BE CLOSED DURING UNOCCUPIED PERIODS.
- C. THE THERMOSTATS SHALL DETERMINE OCCUPIED/UNOCCUPIED STATUS BASED ON THE SCHEDULE IN THE ENERGY MANAGEMENT SYSTEM.

Consultant:



4635 Trueman Blvd. Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com

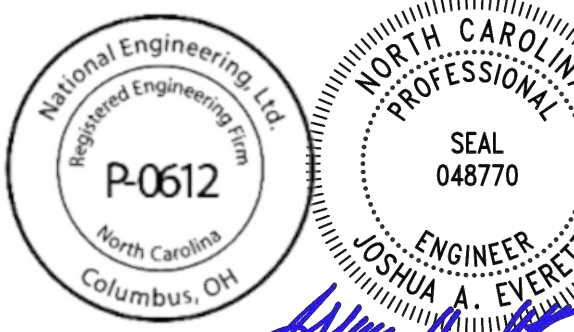

08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:

03/07/2025 PERMIT SET
05/29/2025 BID SET

Revisions:

Drawn: EEP
Checked: AJJ









Project No.

2402039

Contents:

HVAC SCHEDULES

M600

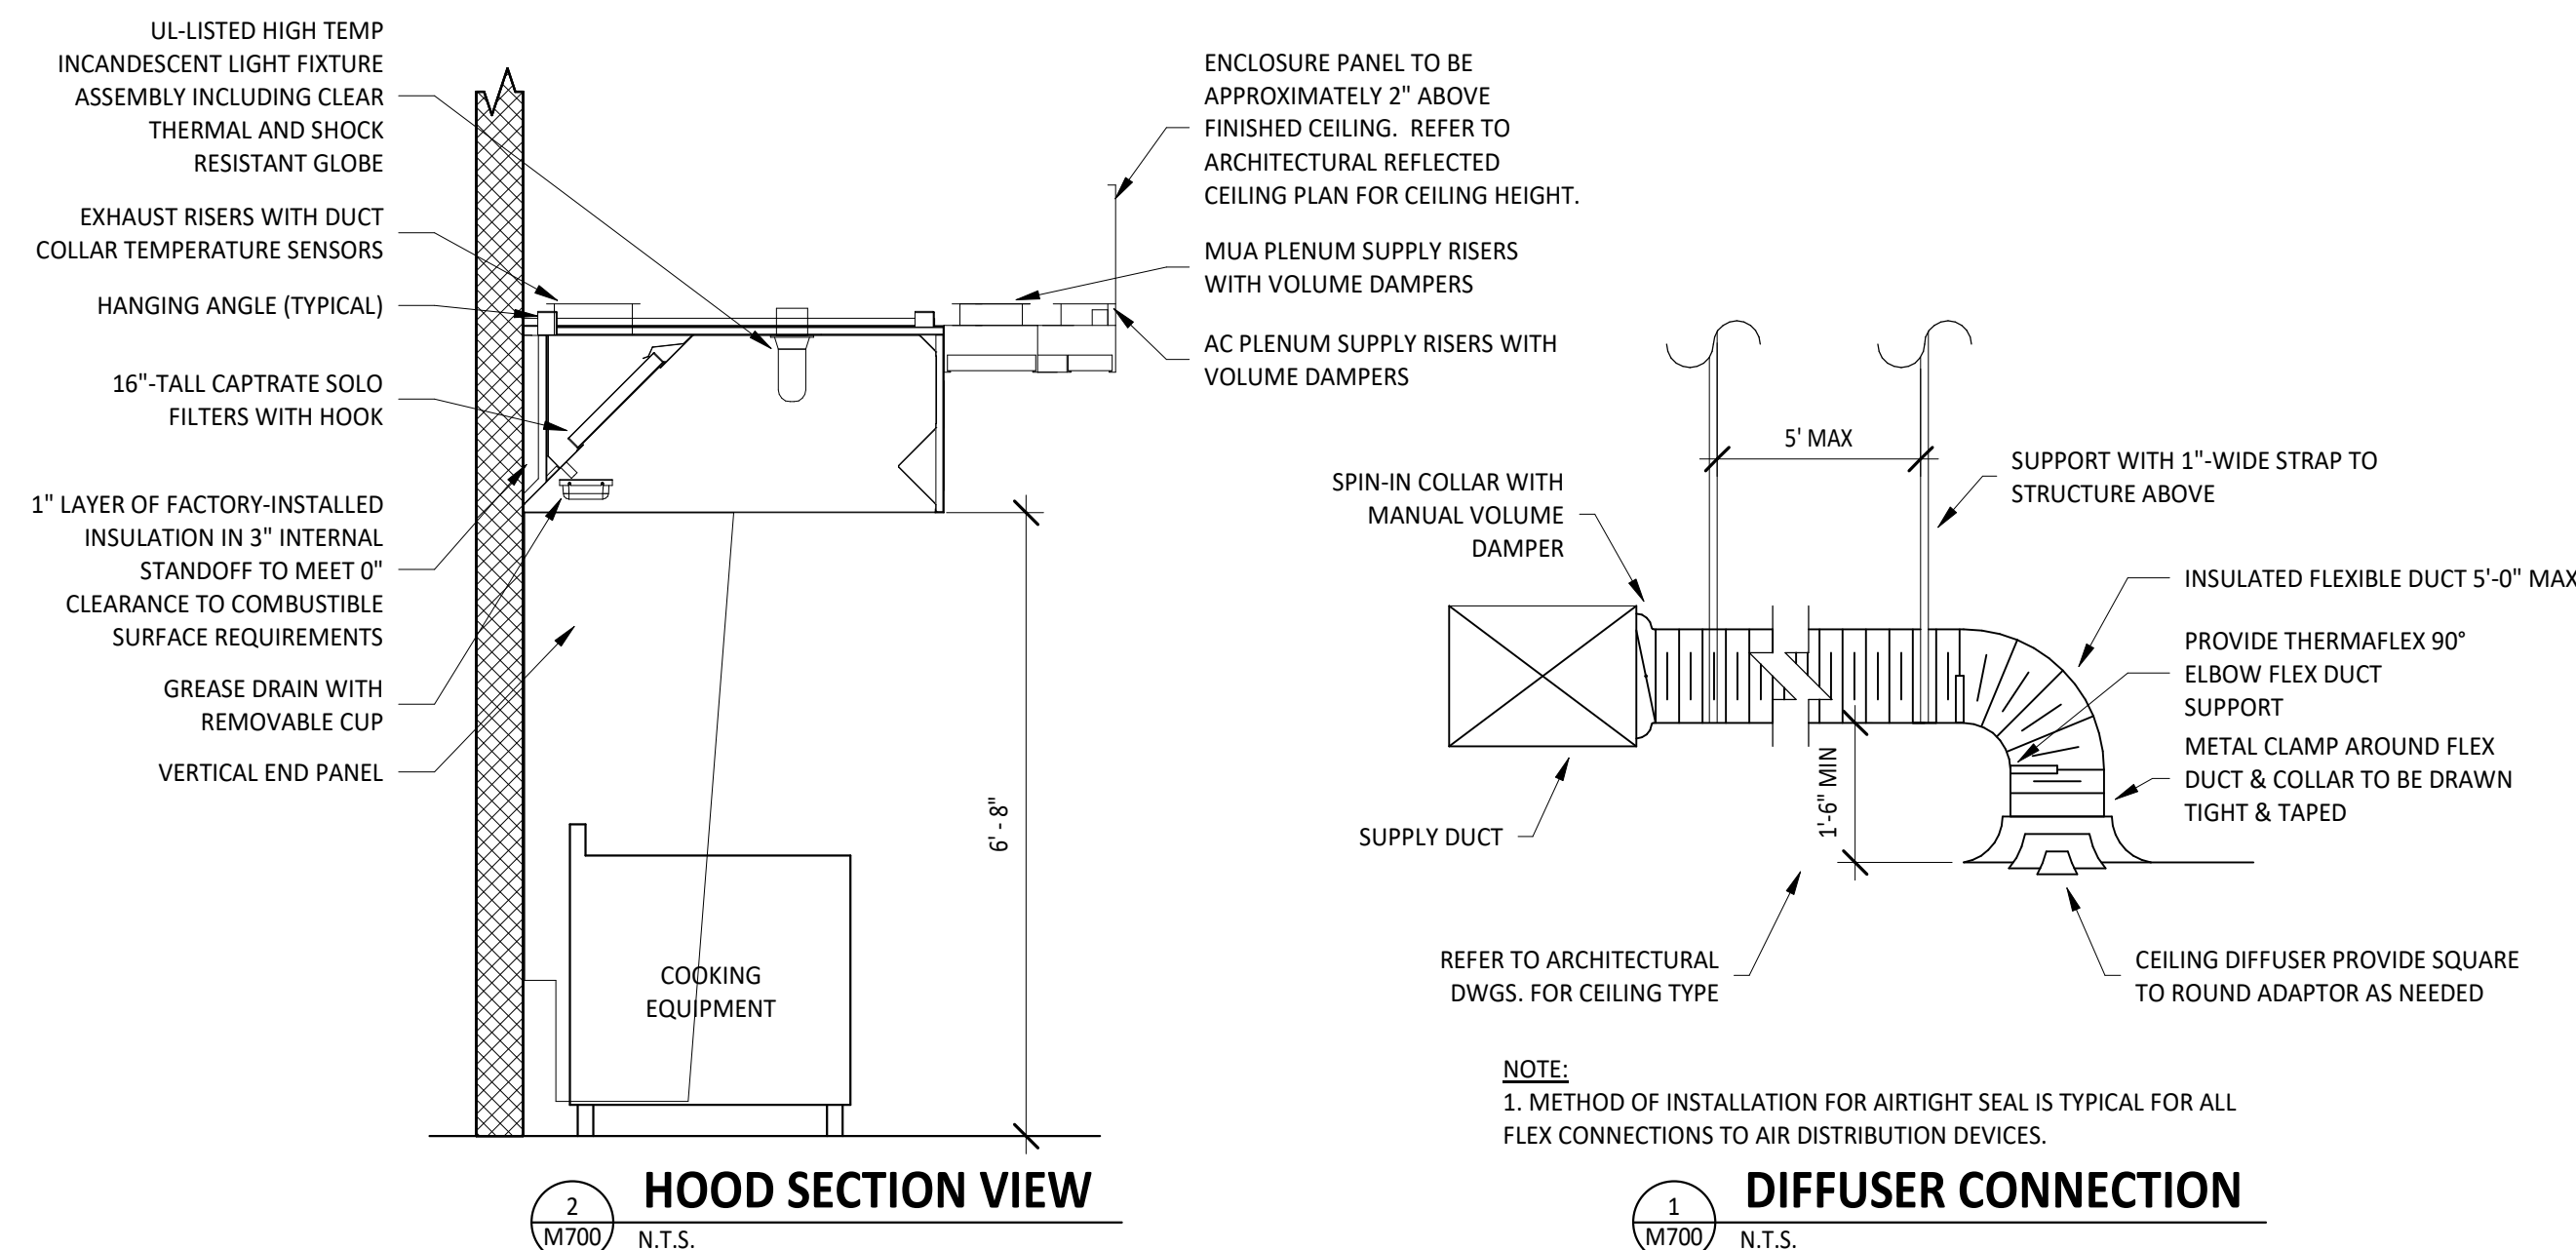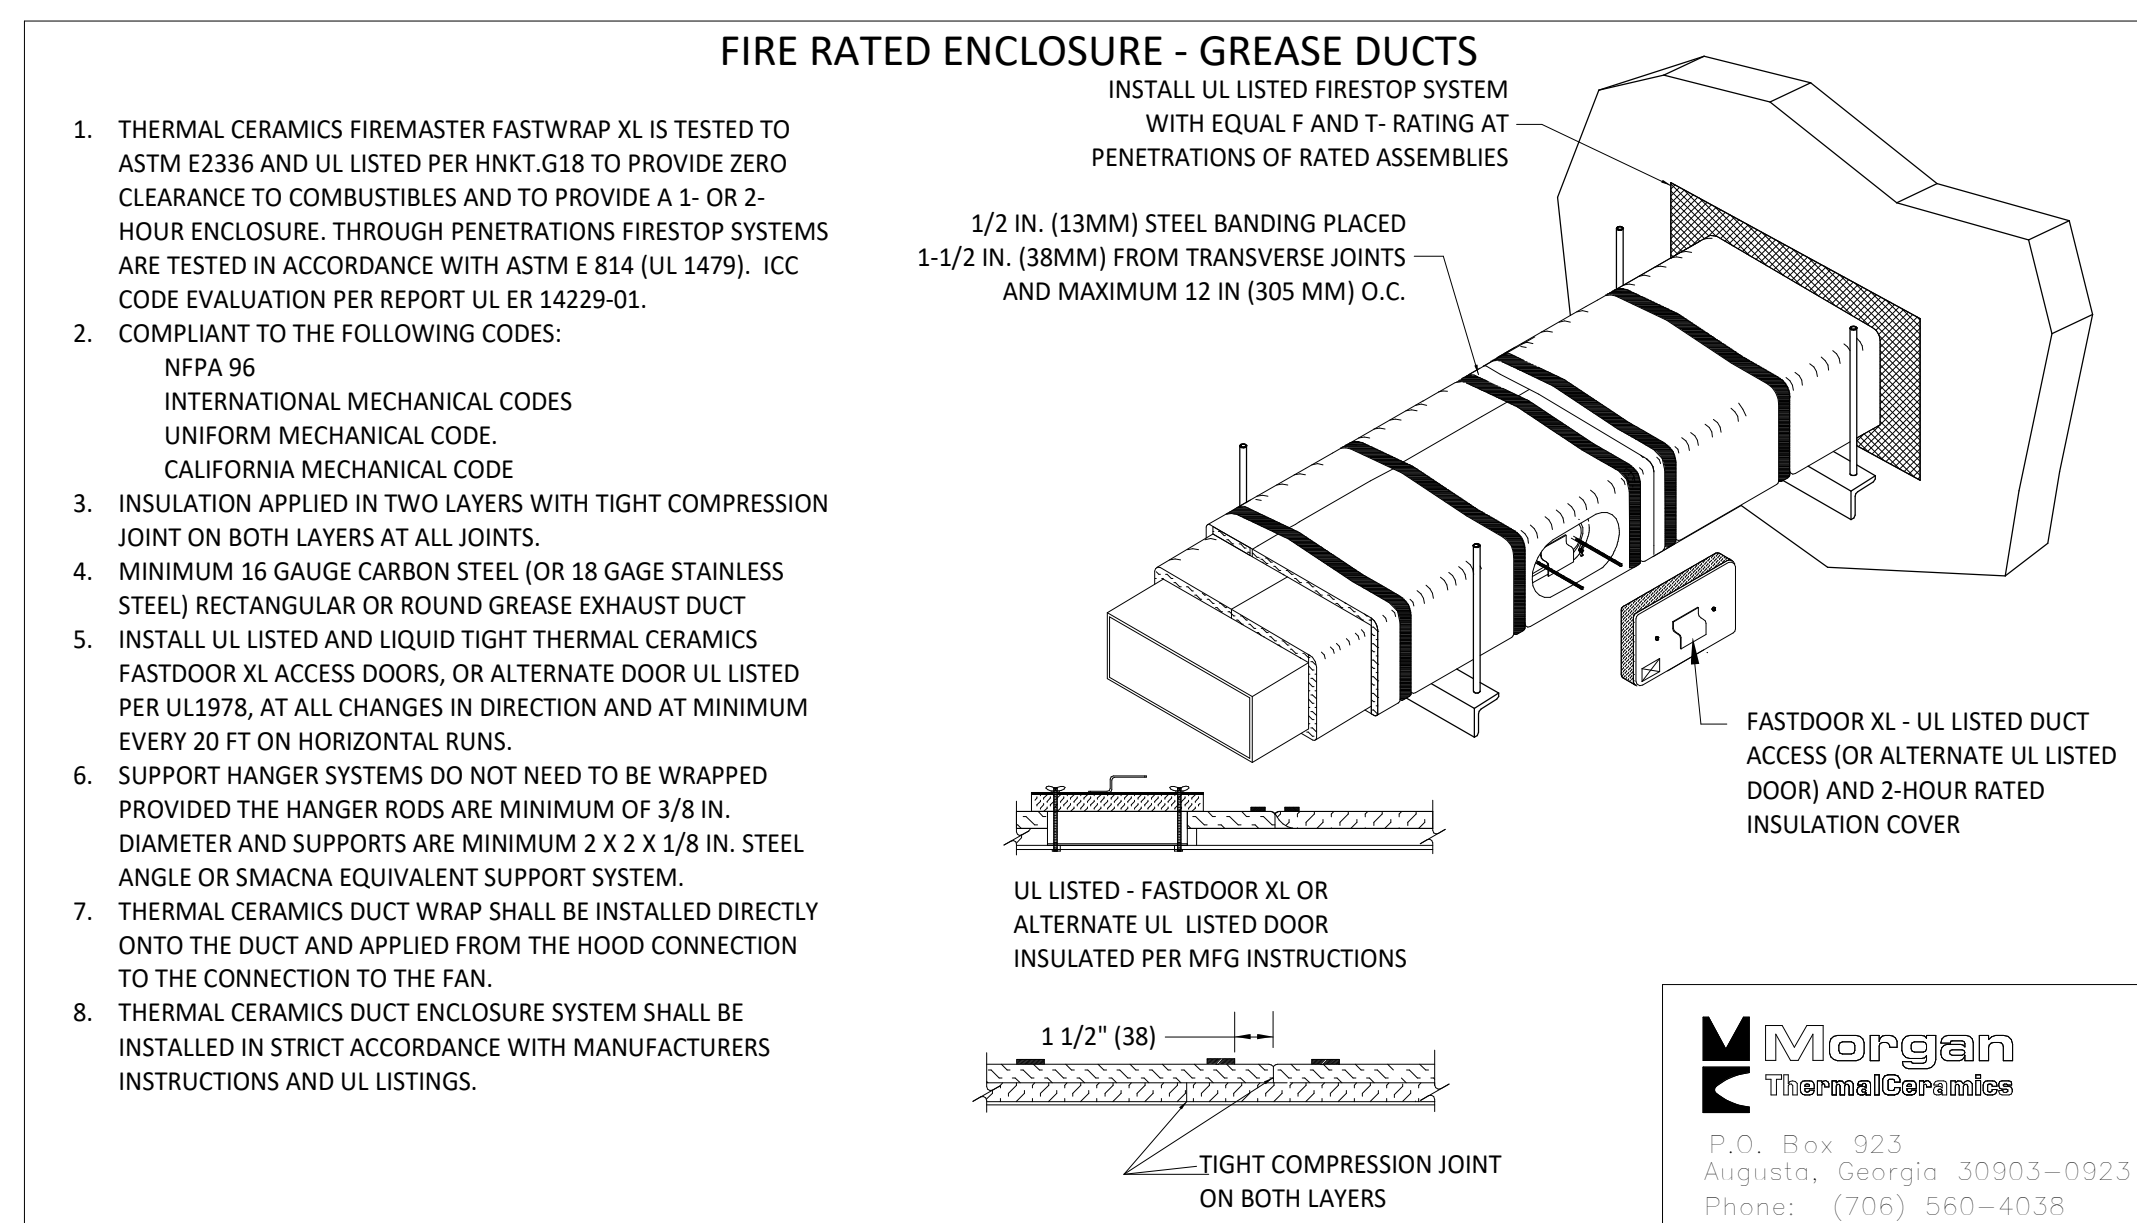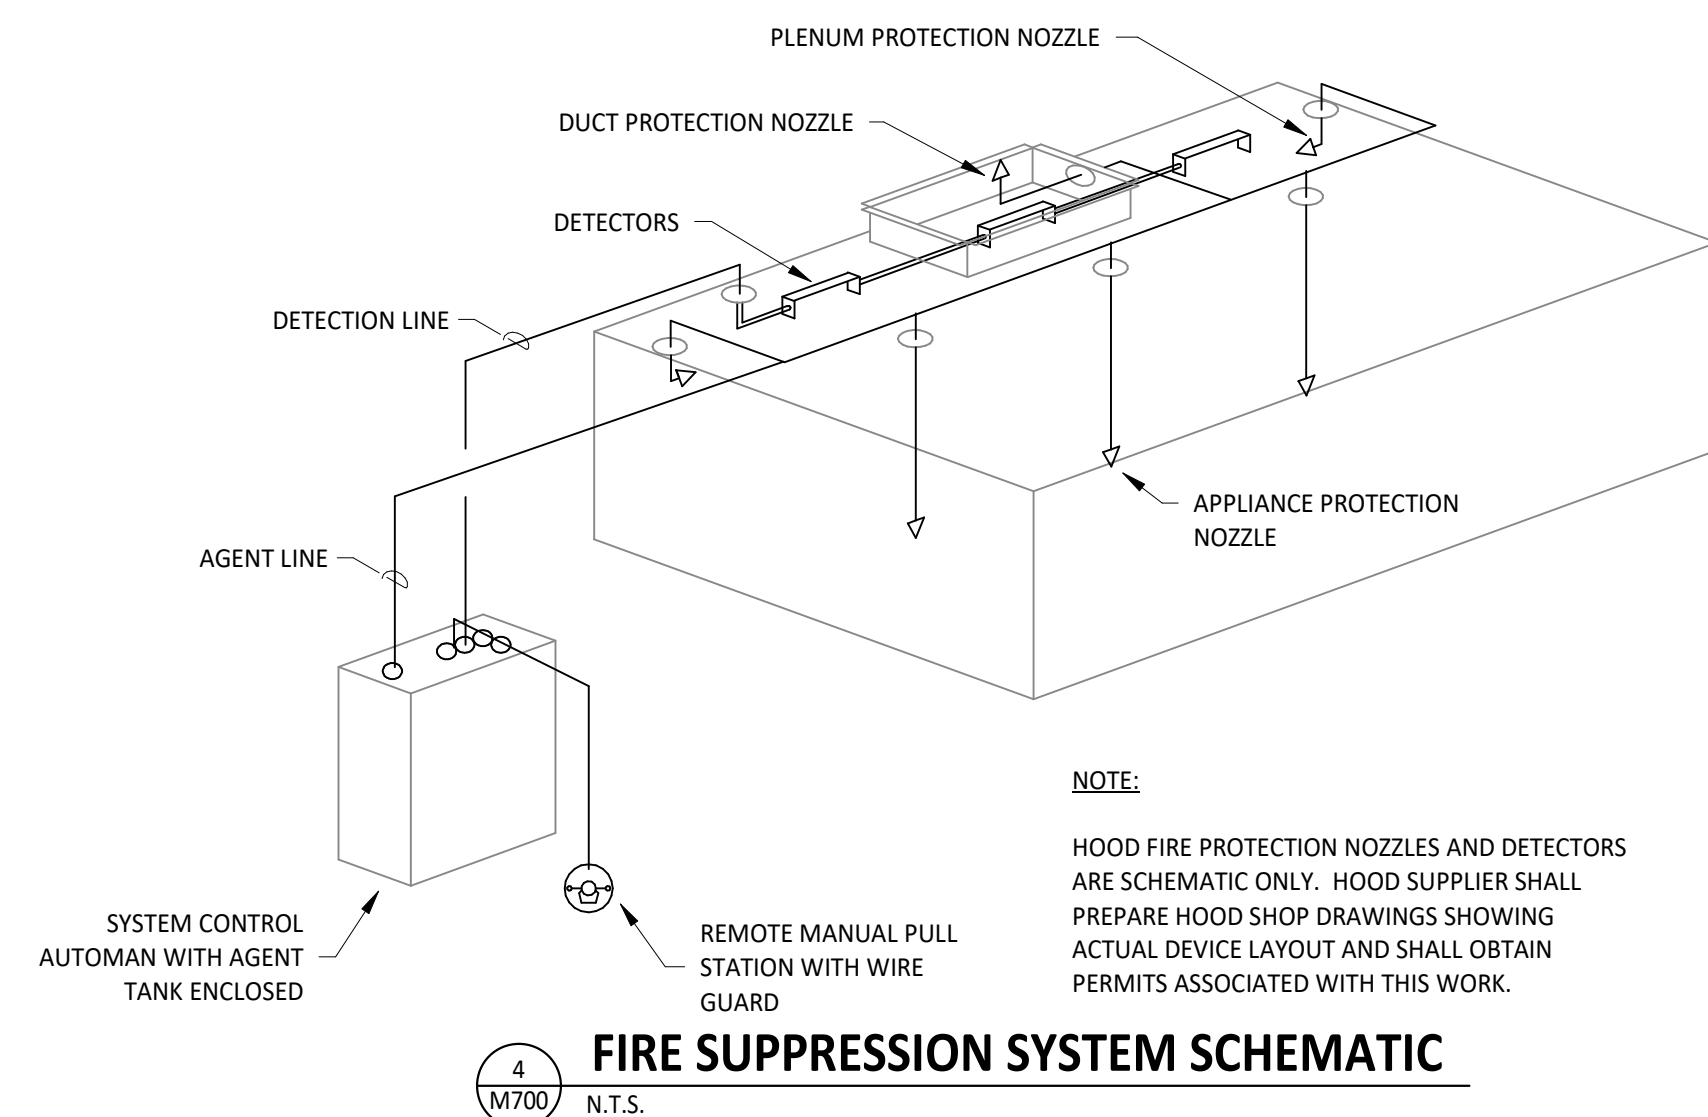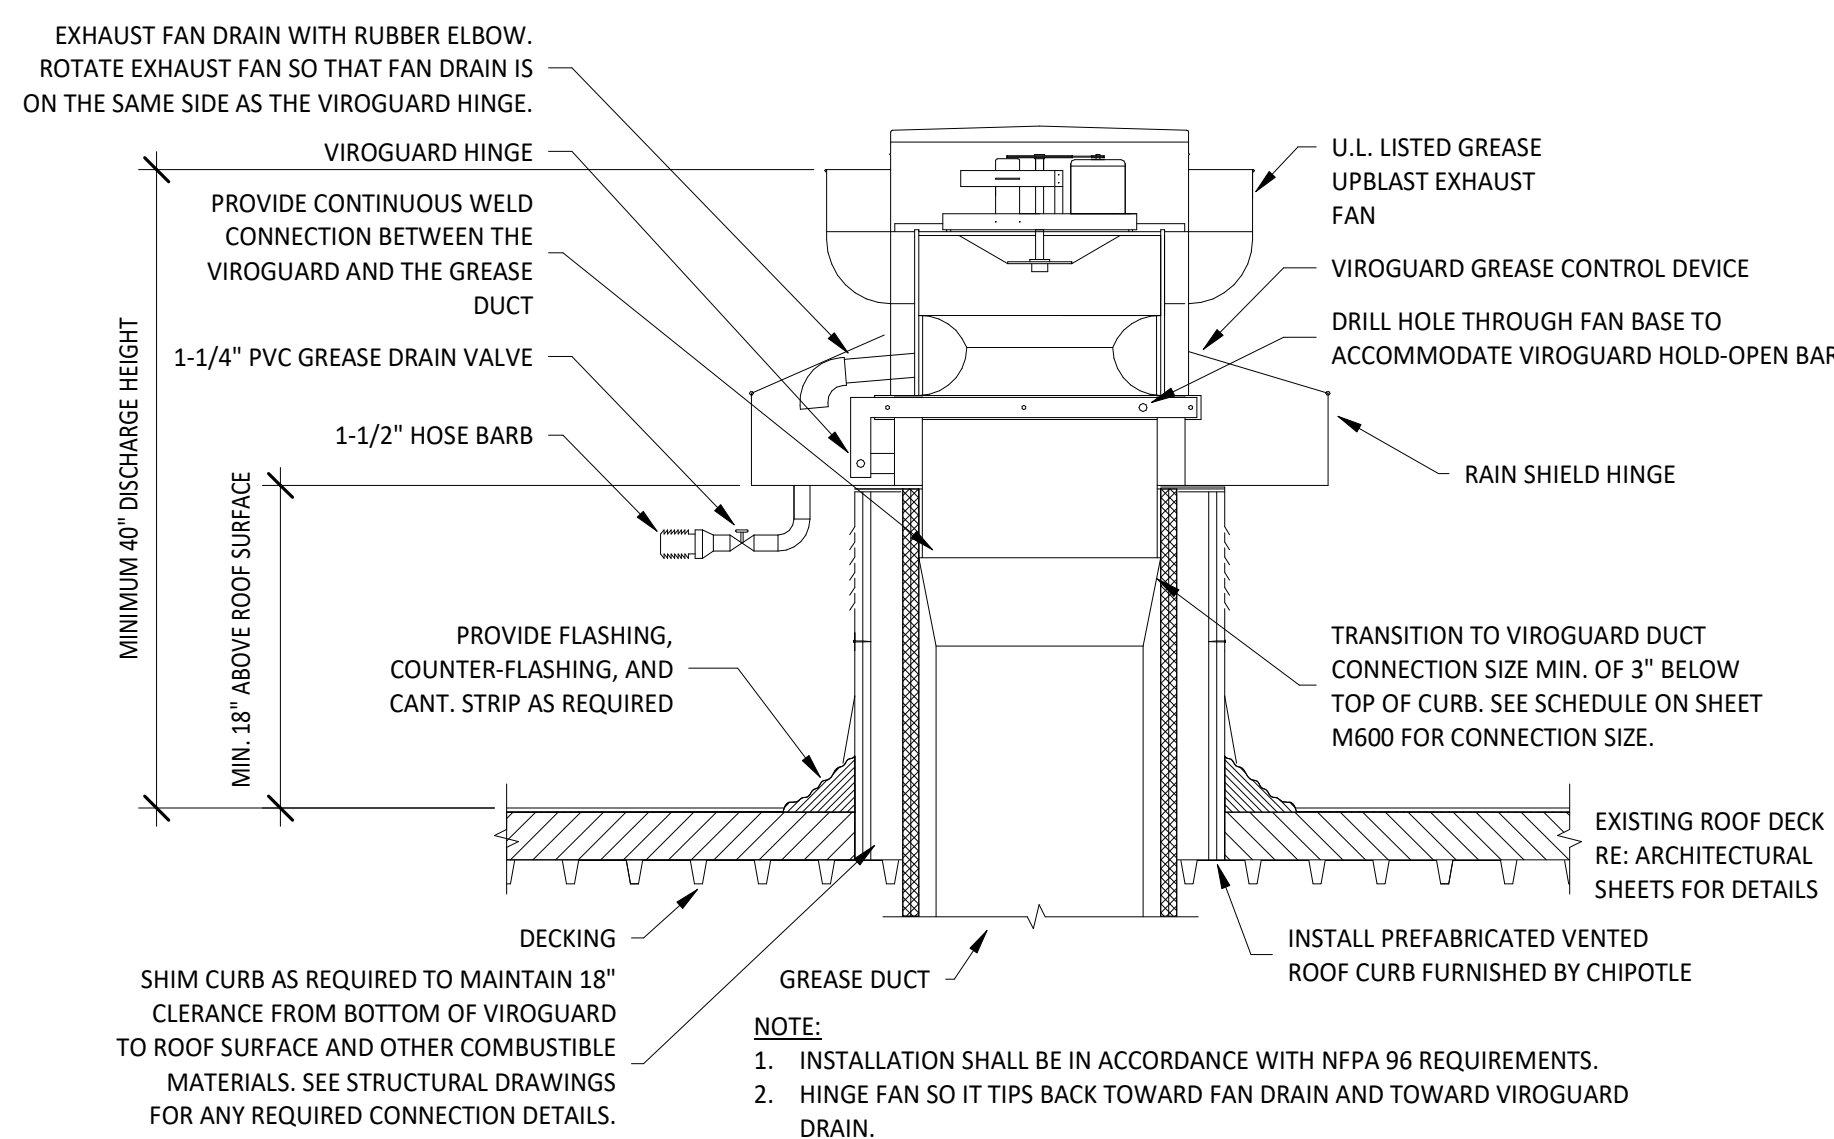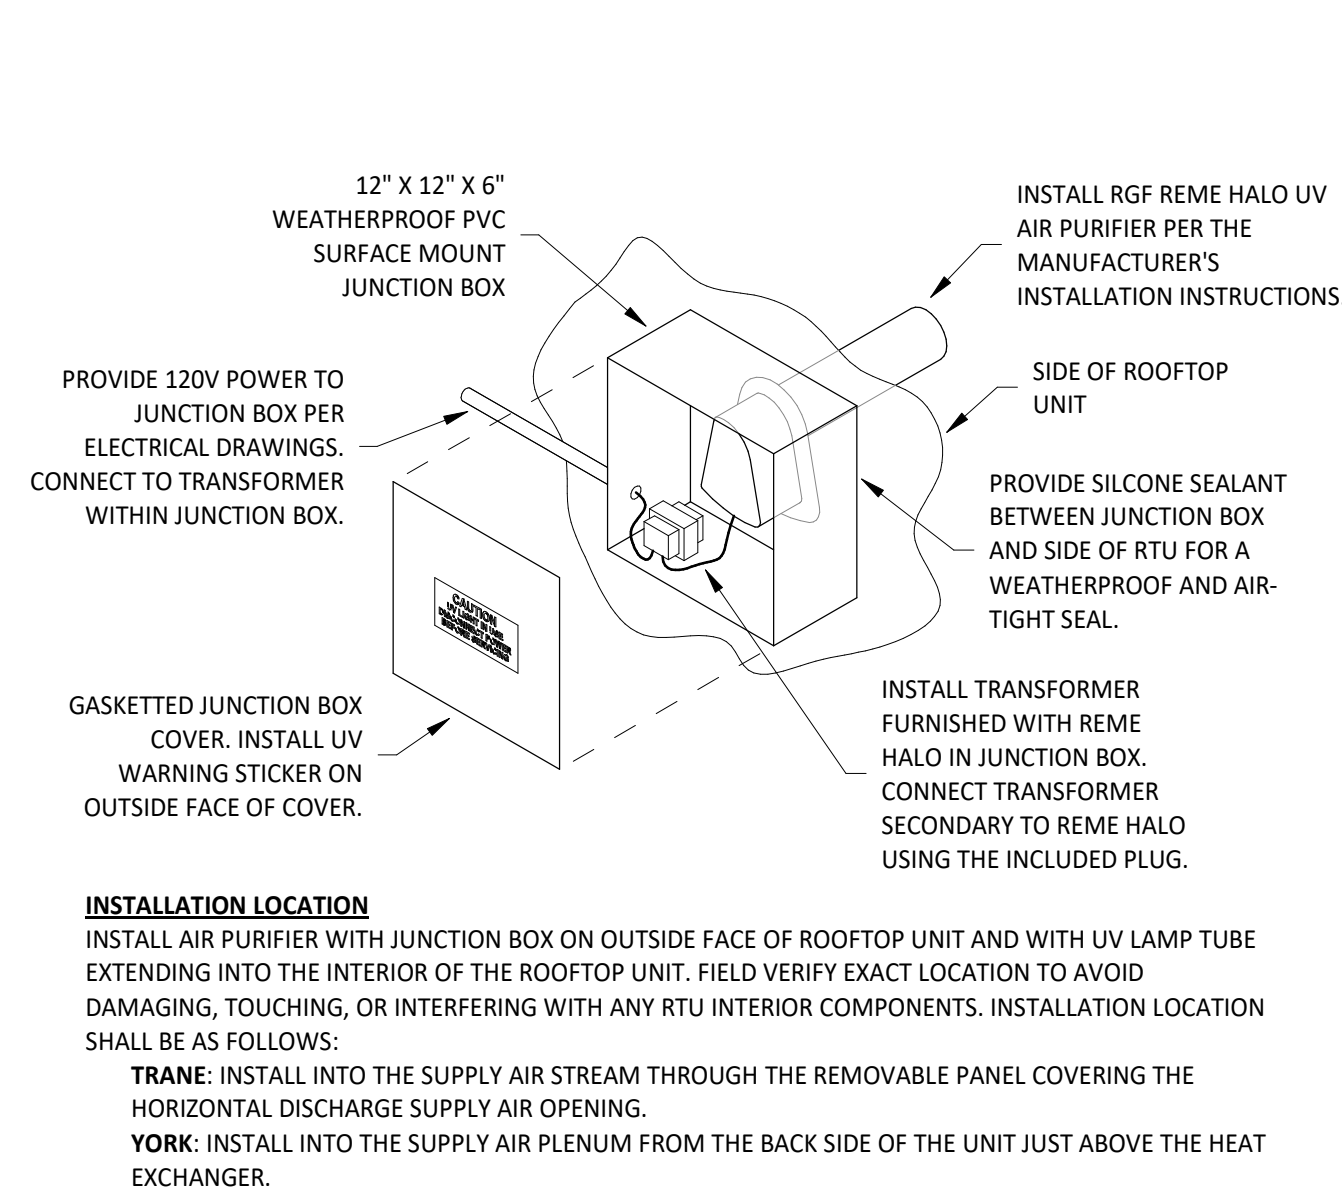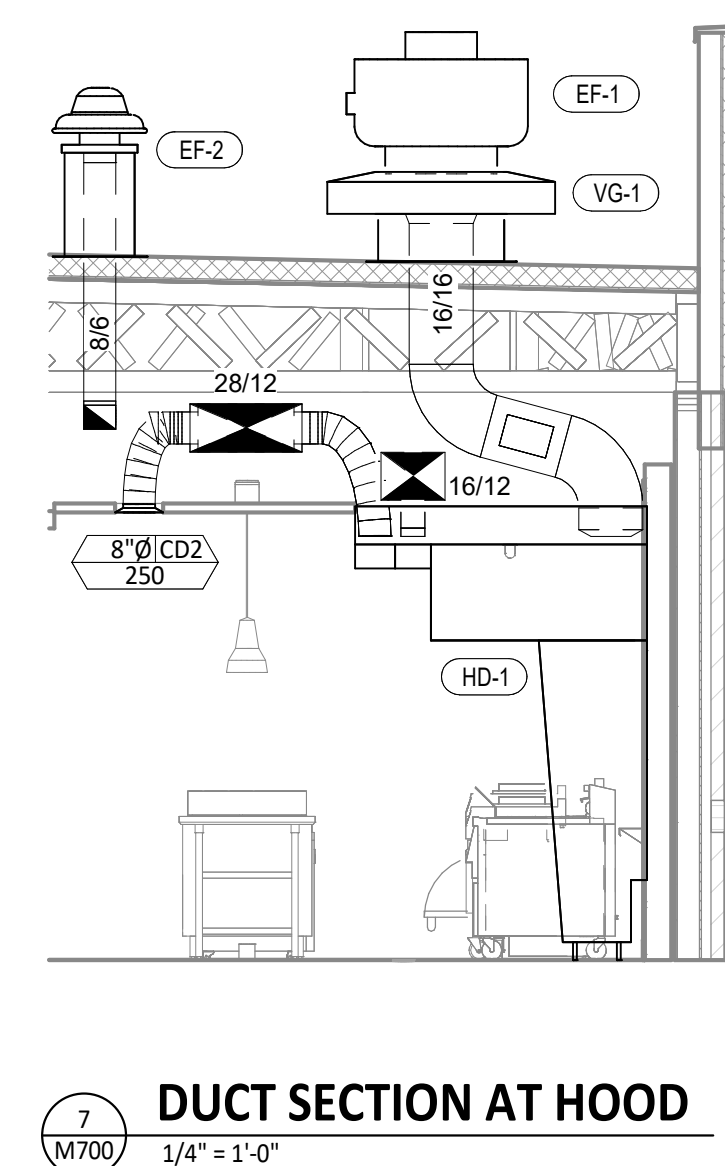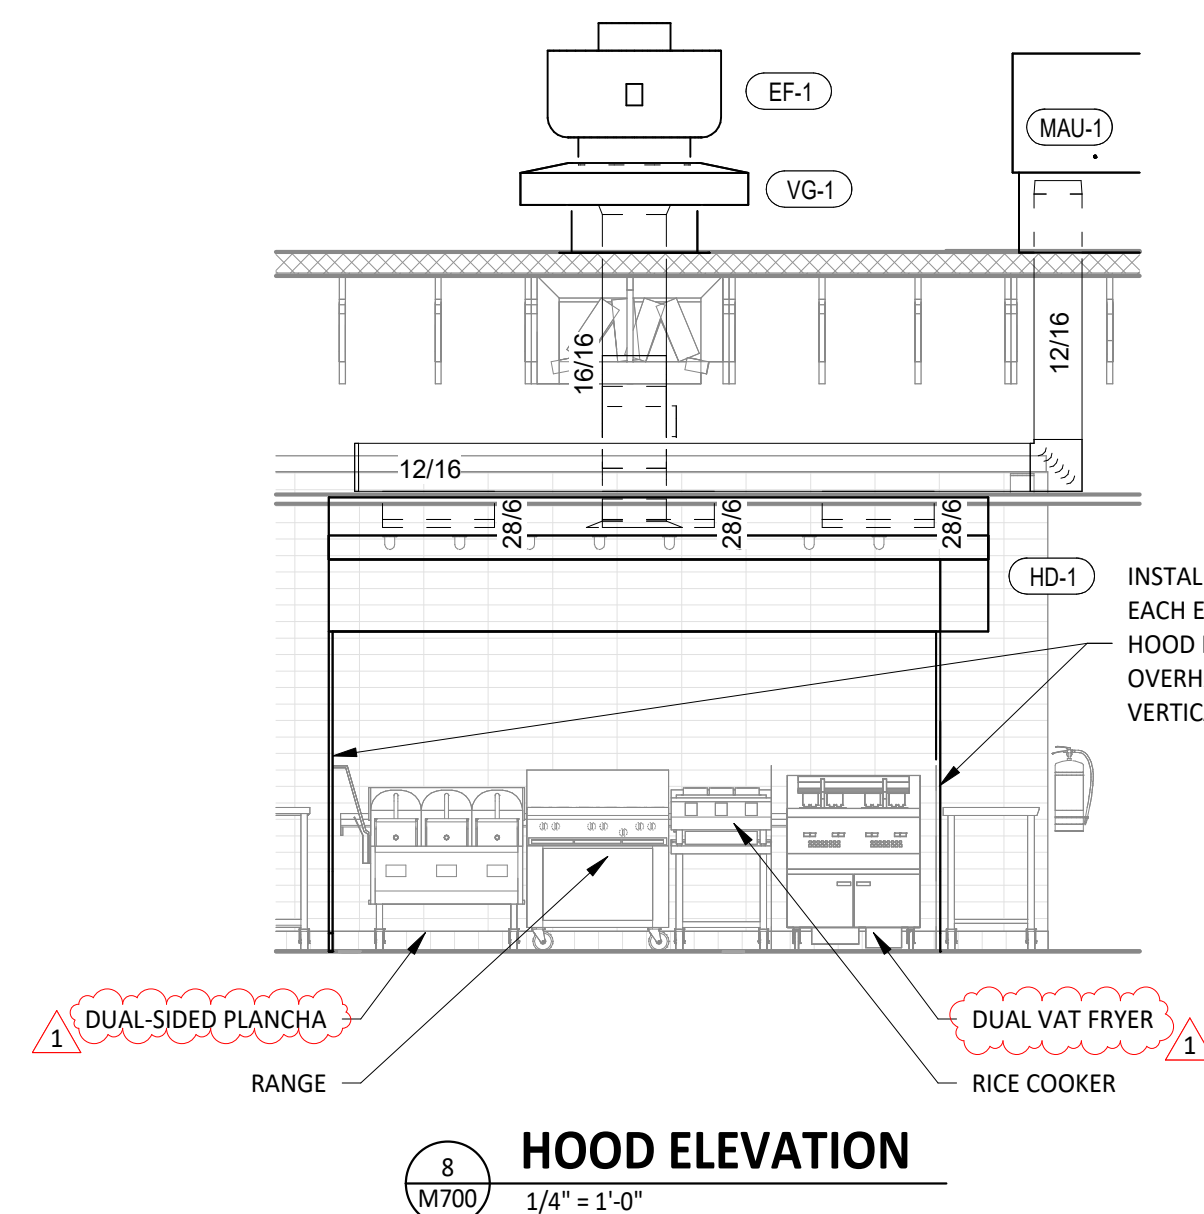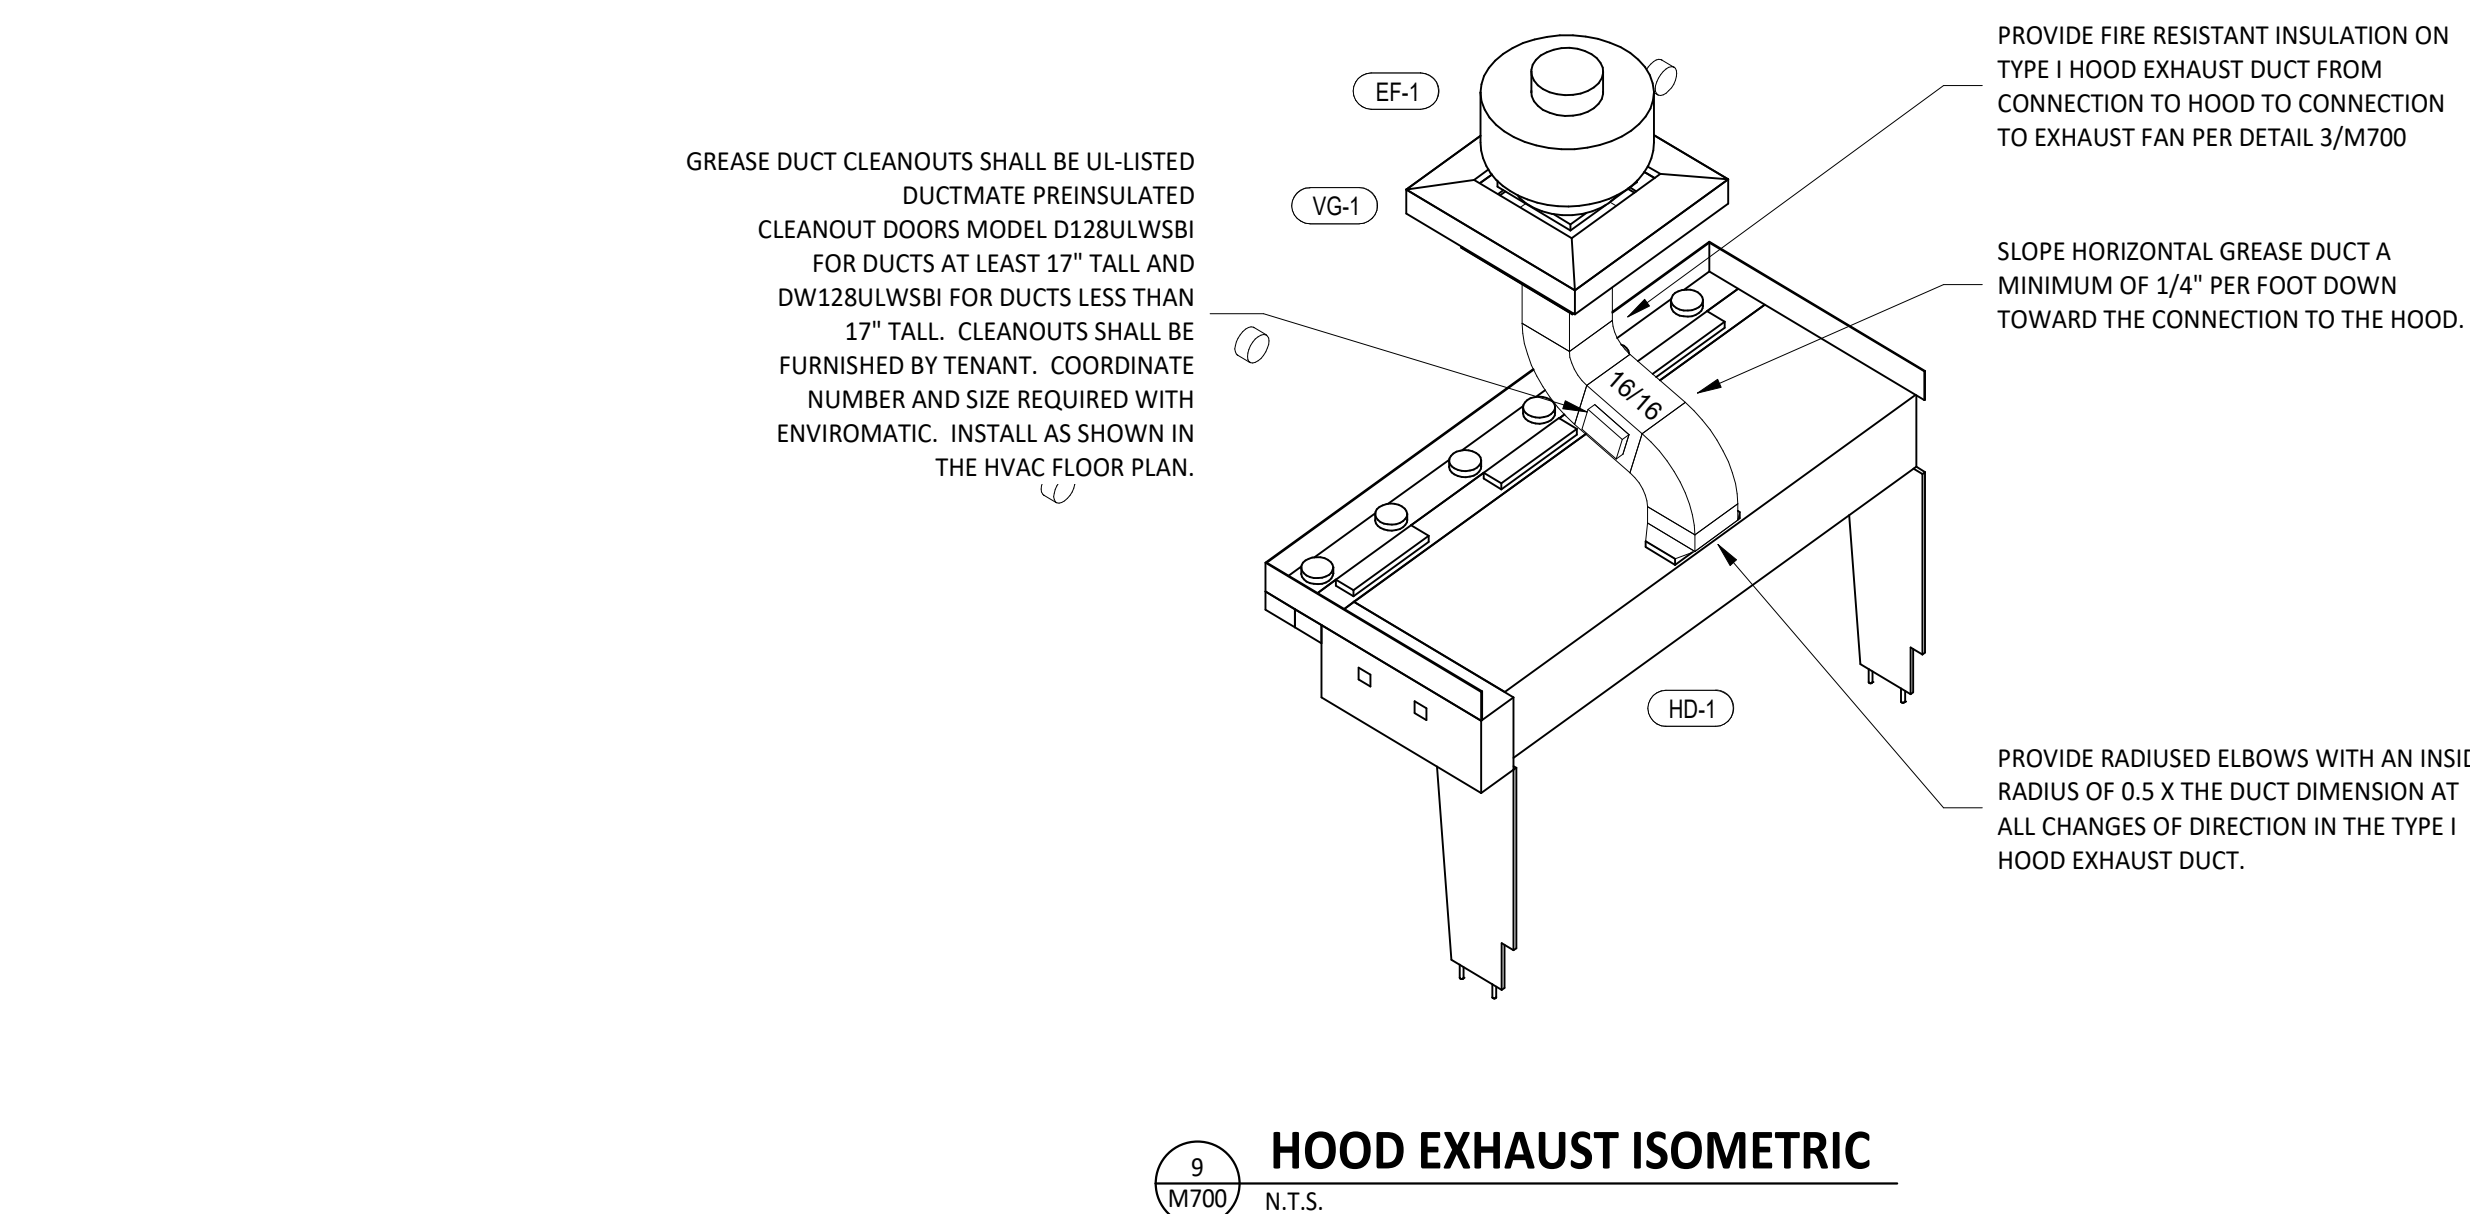

4635 Trueman Blvd. Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com



08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:	
03/07/2025	PERMIT SET
05/29/2025	BID SET

Revisions:
1 08/21/2026 FINISH & DB UPDATES

Drawn:	Checked:
EEP	ALL


Project No.
2402039

Contents:

HVAC DETAILS

M700

[illegible]

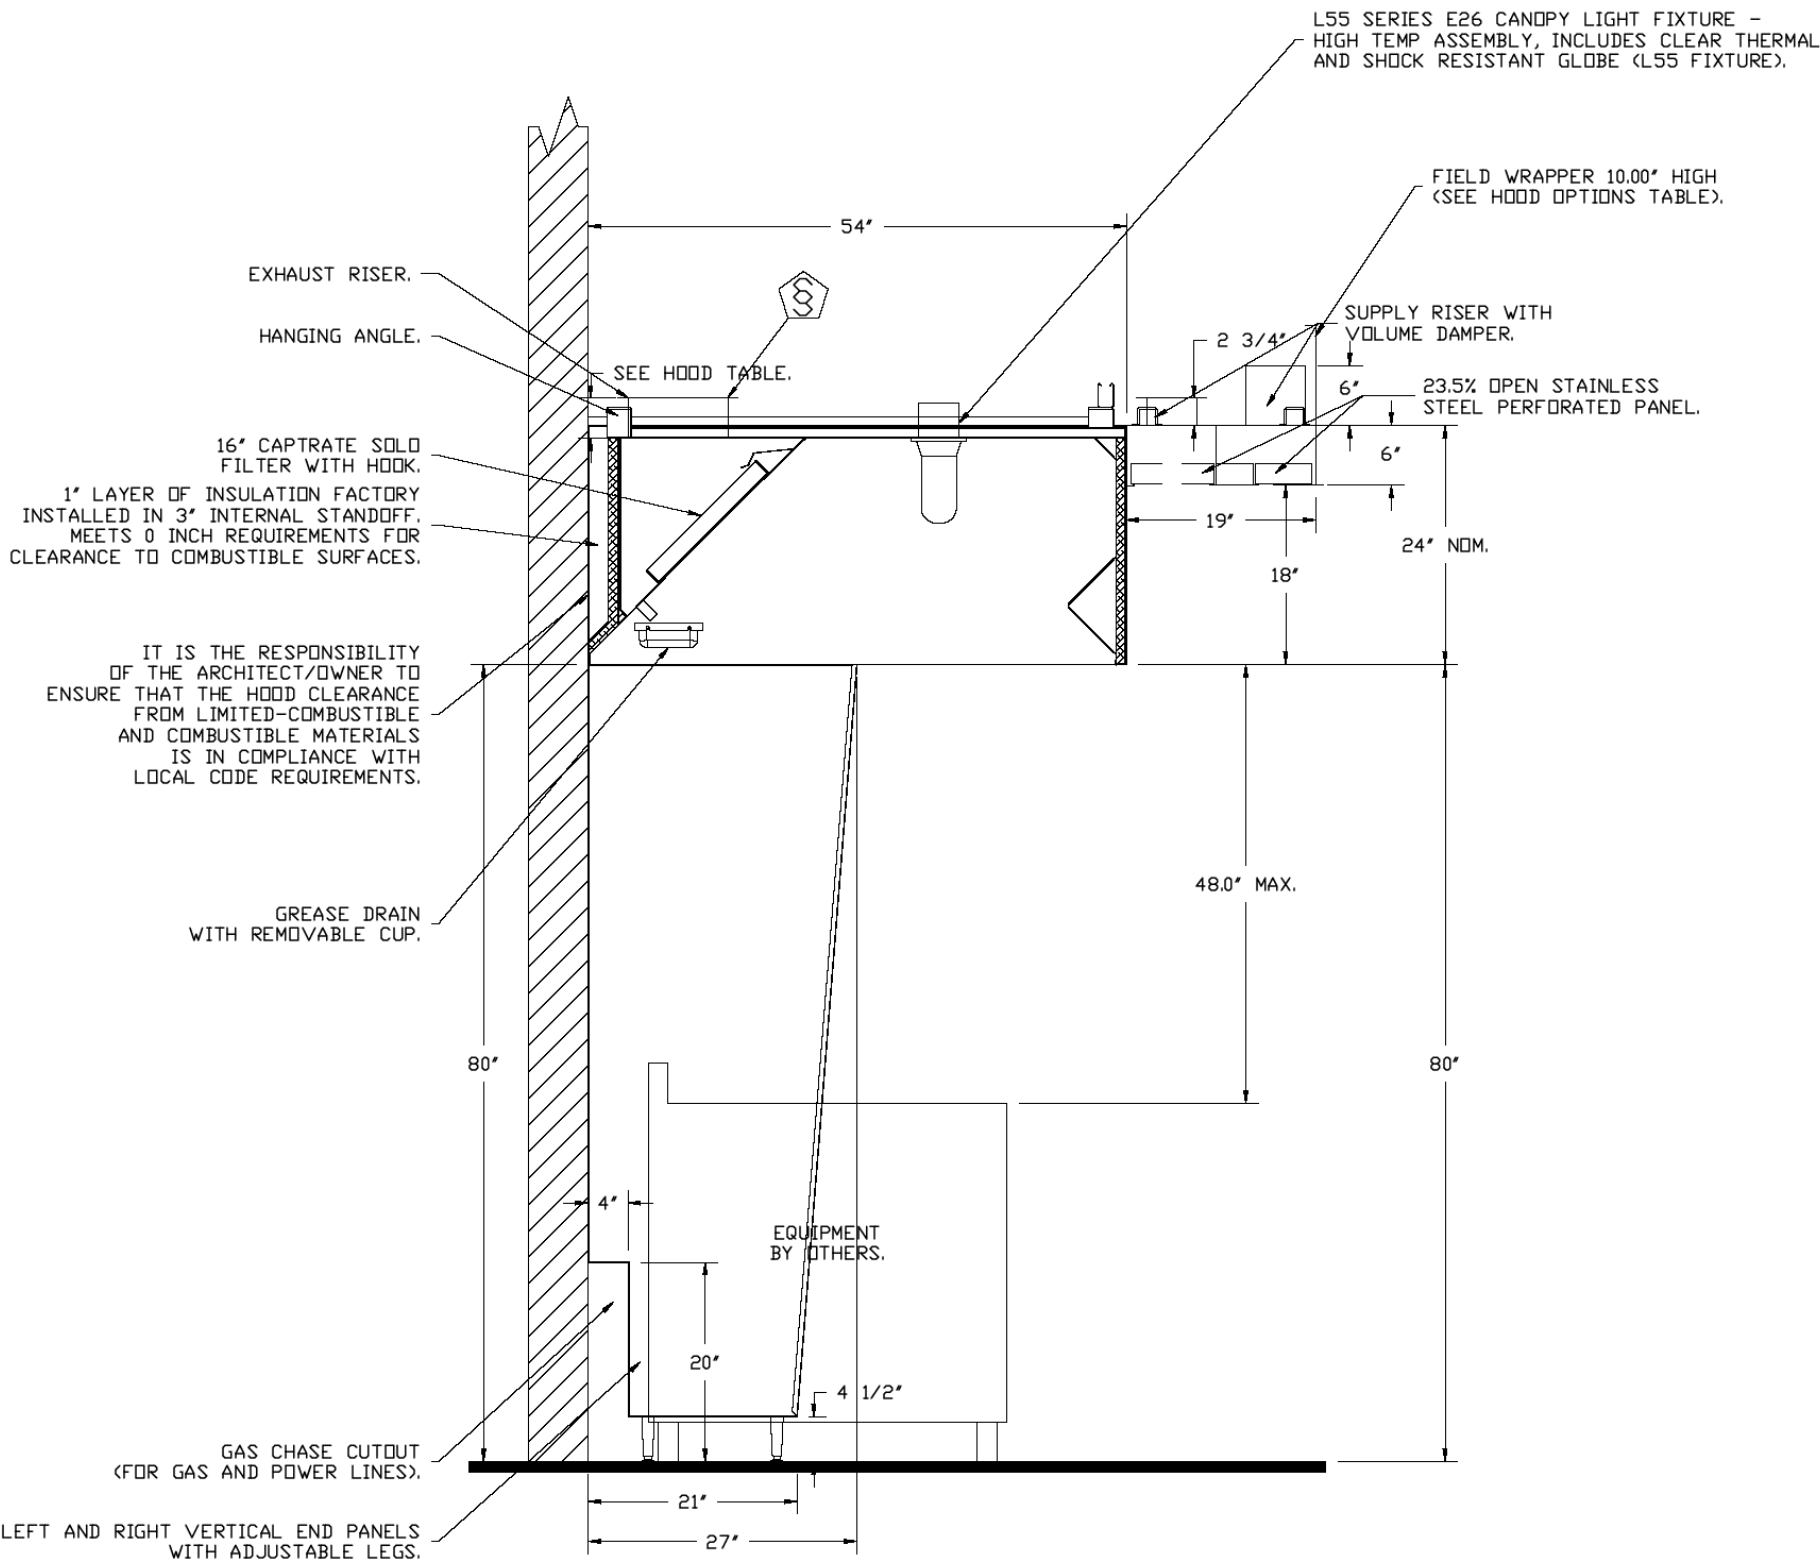

SECTION VIEW - MODEL 5424ND-2-ACPSP-F
HOOD - #1

REVISIONS	
DESCRIPTION	DATE

CHIPOTLE CAMERON #5644

Cameron, NC, 28326

Highwoods Group

4641 Paragon Park Rd., Raleigh, NC. 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: reg40@captivate.com

www.captivate.com

DATE: 3/3/2025

DWG.#:
73777730

DRAWN BY: JMB-40

SCALE:
3/4" = 1'-0"

MASTER DRAWING

SHEET NO.

2

4641 Paragon Park Rd., Raleigh, NC, 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: reg40@captiveaire.com

Highwoods Group

CAPTIVE MARK

CHIPOTLE CAMERON #5644
Cameron, NC. 28326

DATE: 3/3/2025

DWG.#
737773

DRAWN BY: JMB-4

SCALE:
3/4" = 1'—

MASTER DRAWING

SHEET NO
2


HOOD SHOP DRAWINGS HAVE BEEN
DESIGNED/PREPARED BY OTHERS.
SHOWN FOR REFERENCE ONLY

Consultant:



4635 Trueman Blvd. Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260

Epalma@nationalengineering.com

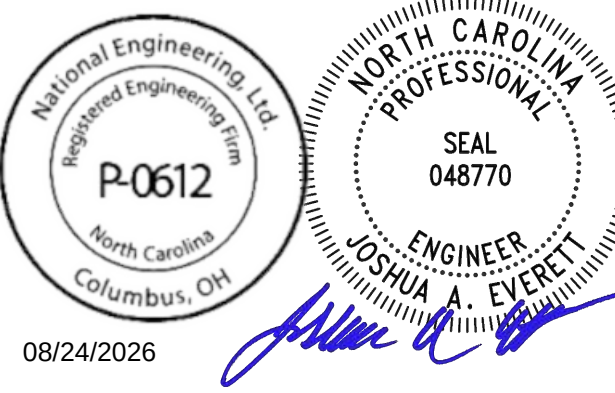

08/24/2020

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28520

Issue Record:	
03/07/2025	PERMIT SET
05/29/2025	BID SET

Revisions:

Drawn: _____ Check: _____

EEP AJ


Project No.

2402039

Contents:

CAPTIVEAIRE SHOP DRAWINGS


M71:

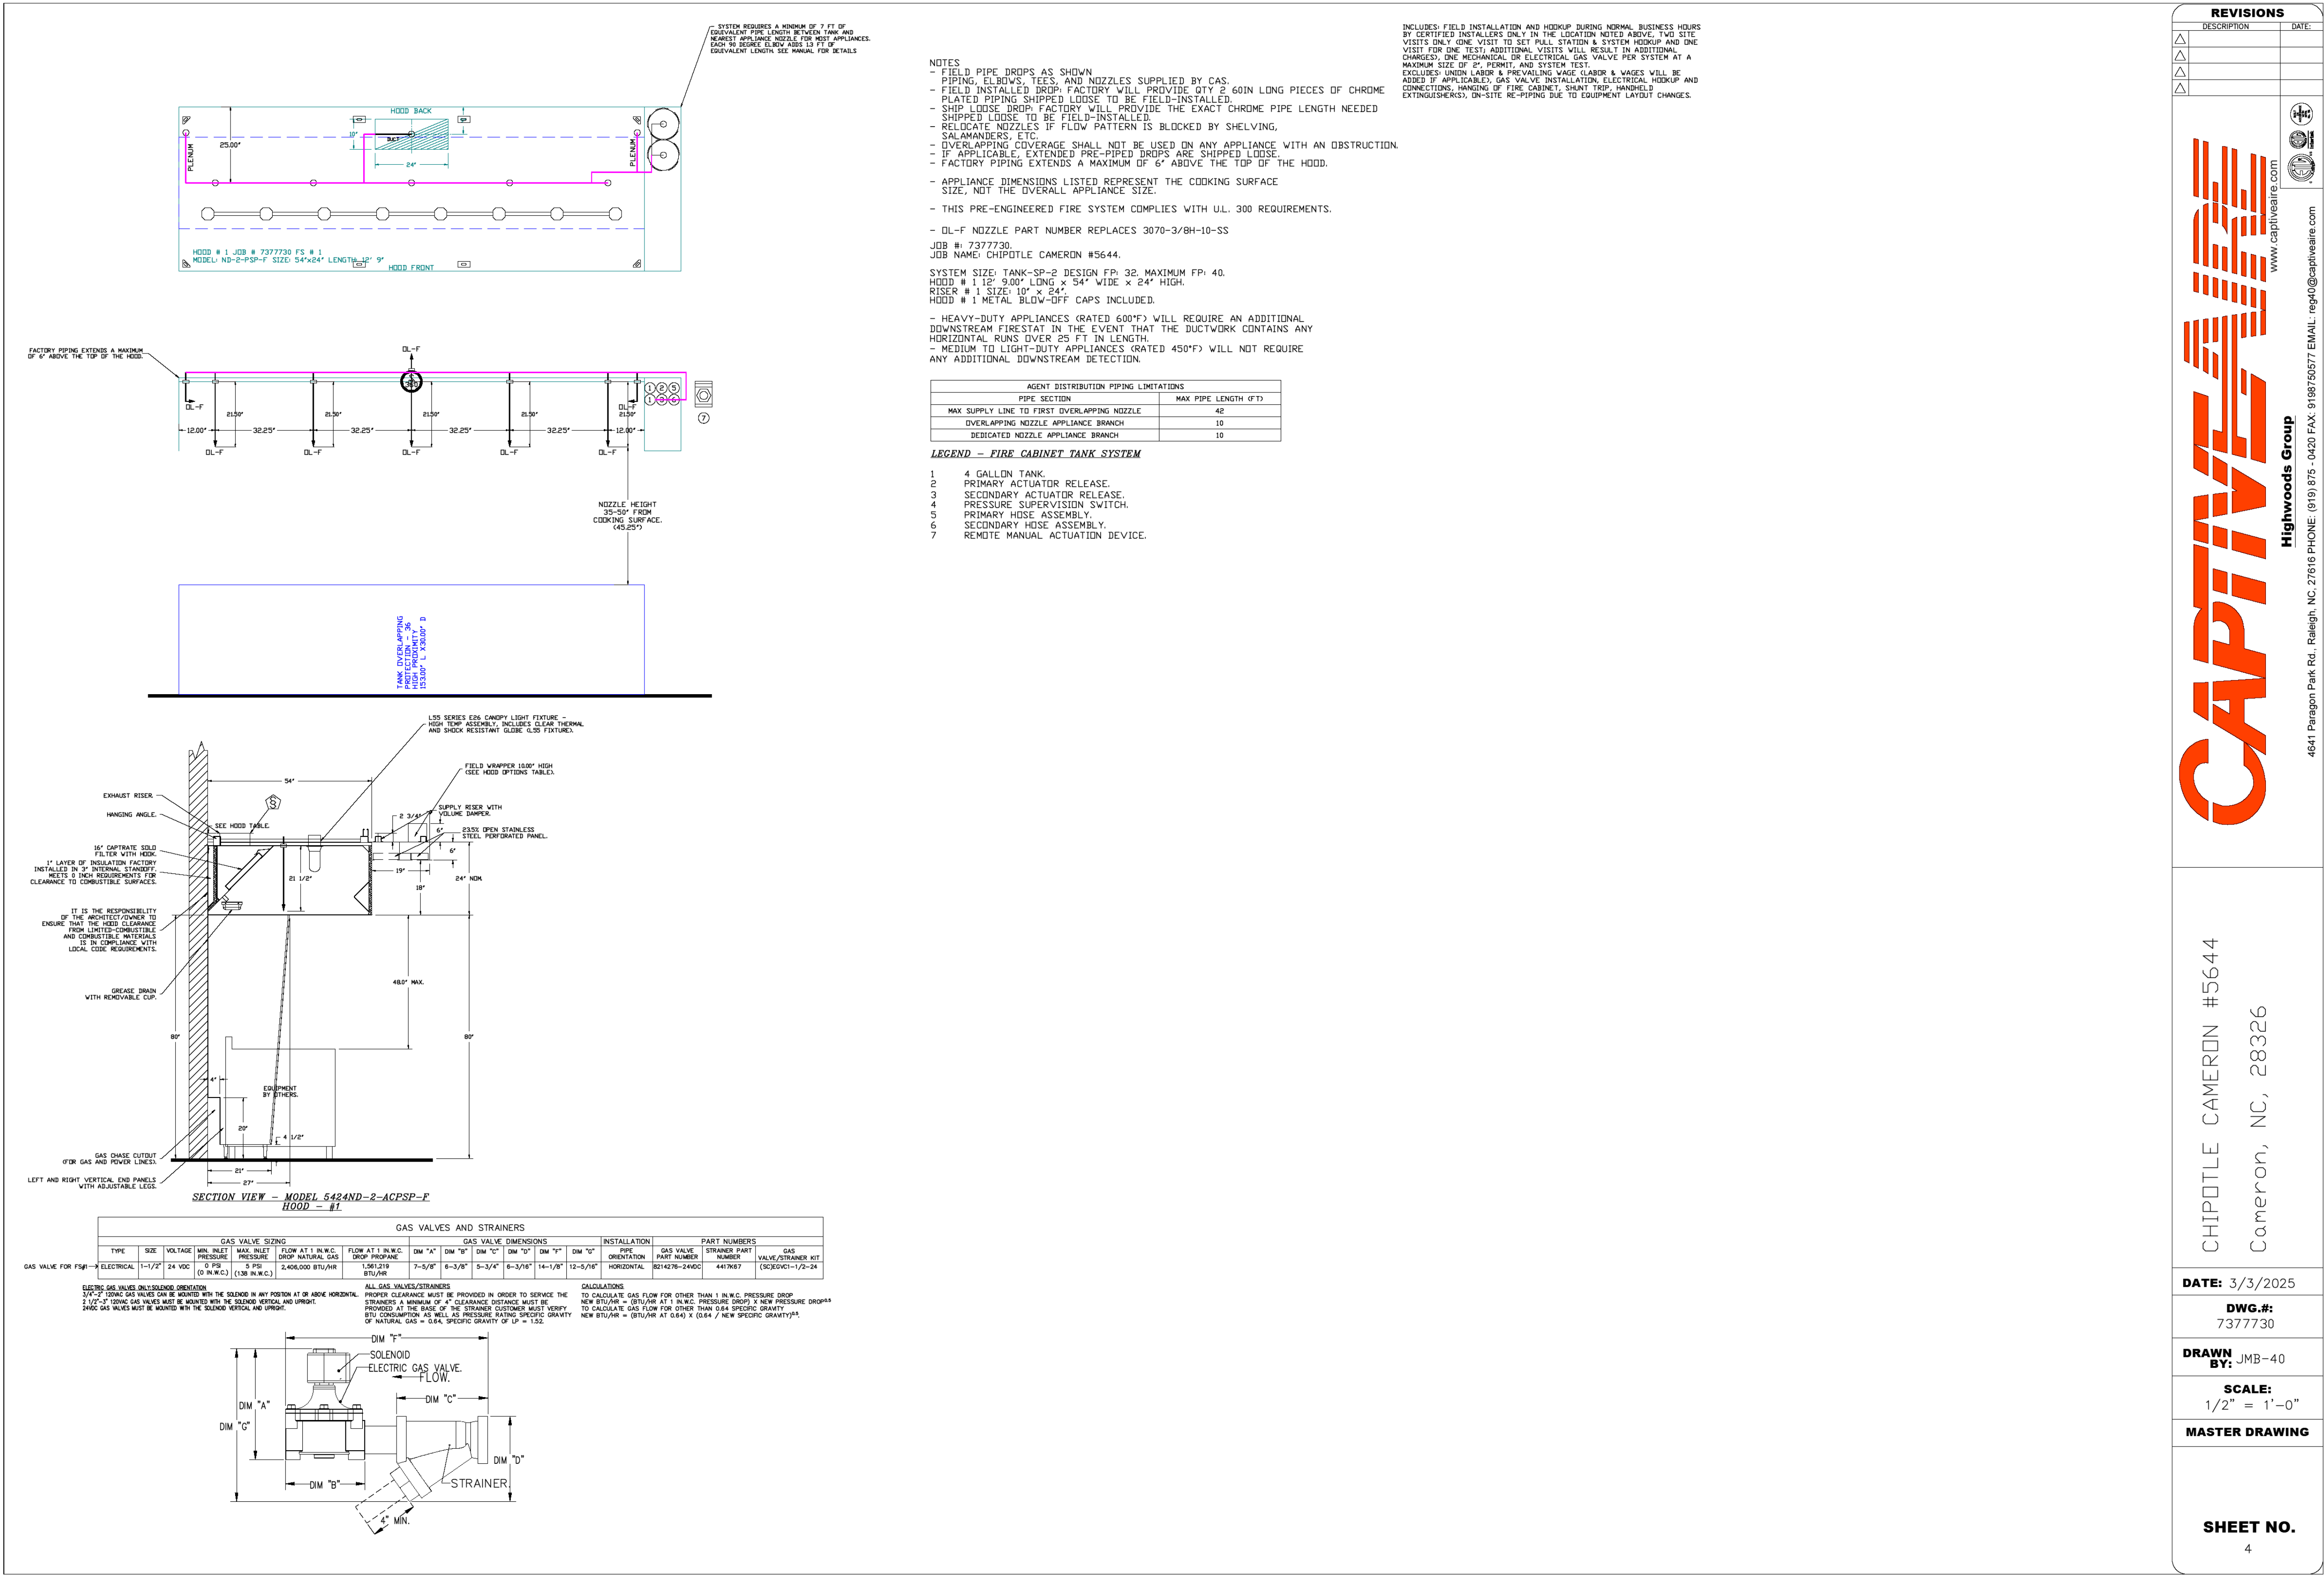

Consultant:

NATIONAL ENGINEERING

4635 Trueman Blvd, Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com

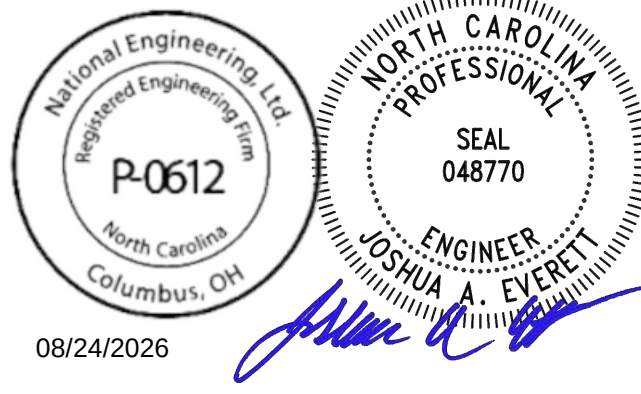

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:	
03/07/2025	PERMIT SET
05/29/2025	BID SET

Revisions:	

Drawn:	Checked:
EEP	AJJ

Project No.
2402039

Contents:
CAPTIVEAIRE SHOP DRAWINGS

M713

HOOD SHOP DRAWINGS HAVE BEEN DESIGNED/PREPARED BY OTHERS. SHOWN FOR REFERENCE ONLY

EXHAUST FAN INFORMATION – JOB#7377730

FAN UNIT NO	TAG	QTY	FAN UNIT MODEL #	MANUFACTURER	CFM	ESP	RPM	MOTOR ENCL	HP	BHP	PHASE	VOLT	FLA	DISCHARGE VELOCITY	WEIGHT (LBS)	SDNES
1	EF-1	1	DUI180HFA	CAPTIVEAIRE	2550	1.450	1224	TEFC,PREMIUM	2.000	1.2780	3	208	7.3	589 FPM	199	16.8
2	EF-2	1	DR12HFA	CAPTIVEAIRE	150	0.600	1293	TEAD-ECM	0.250	0.0950	1	115	2.9		50	6.2

MUA FAN INFORMATION – JOB#7377730

FAN UNIT NO	TAG	QTY	FAN UNIT MODEL #	BLDWER	HOUSING	MIN CFM	DESIGN CFM	ESP	RPM	MOTOR ENCL	HP	BHP	PHASE	VOLT	FLA	MCA	MDCP	WEIGHT (LBS)	SDNES
3	MAU-1	1	A1-D.250-1SD	15MF-1-MDD	A1-D.250	1000	1300	0.500	1549	ODP,PREMIUM	1.000	0.5660	3	208	3.1	3.9A	15A	507	12.2

GAS FIRED MAKE-UP AIR UNIT(S)

FAN UNIT NO	TAG	INPUT BTUs	OUTPUT BTUs	TEMP RISE	REQUIRED INPUT GAS PRESSURE	GAS TYPE	BURNER EFFICIENCY(%)
3	MAU-1	74592	68625	50°F	7 IN. W.C. – 14 IN. W.C.	LP	92

FAN #1 DUI180HFA – EXHAUST FAN (EF-1)

FAN OPTIONS

FAN UNIT NO	TAG	QTY	DESCRIPTION
1	EF-1	1	GREASE BOX
		1	REMOVE HINGE KIT LABEL FROM THE FAN BASE
		1	2 YEAR PARTS WARRANTY
2	EF-2	1	I 12-BDD DAMPER
		1	ECM WIRING PACKAGE – MANUAL OR 0-10VDC REFERENCE SPEED CONTROL –RTC- (TELCD MOTOR), CCW ROTATION
		1	2 YEAR PARTS WARRANTY
3	MAU-1	1	SIZE 1 TEMPERED COMMERCIAL DOWN DISCHARGE FOR DIRECT DRIVE AHUS
		1	INLET PRESSURE GAUGE, 0-35"
		1	MANIFOLD PRESSURE GAUGE, -5 TO 15" WC
		1	SHIP LOOSE GAS STRAINER 3/4"
		1	MOTORIZED BACKDRAFT DAMPER FOR A1-D HOUSING – MEETS AMCA CLASS 1A RATING
		1	SEPARATE 120V WIRING PACKAGE (REQUIRED AND USED ONLY FOR DCV OR PREWIRE WITH VFD) – THREE PHASE ONLY
		1	2 YEAR PARTS WARRANTY
		1	EXTERIOR GAS CONNECTION PROVIDED BY FACTORY WITH QUICK SEAL AND ANTI-ROTATION BRACKET
		1	



FAN ACCESSORIES

FAN UNIT NO	TAG	EXHAUST				SUPPLY			
		GREASE CUP	GRAVITY DAMPER	WALL MOUNT	SIDE DISCHARGE	GRAVITY DAMPER	MOTORIZED DAMPER	WALL MOUNT	
1	EF-1	YES							
2	EF-2		YES						
3	MAU-1						YES		

CURB ASSEMBLIES

NO	DN FAN	TAG	WEIGHT	ITEM	SIZE
1	# 1	EF-1	39 LBS	CURB	26.500"W X 26.500"L X 20.000"H VENTED.
2	# 2	EF-2	31 LBS	CURB	17.500"W X 17.500"L X 26.000"H.
3	# 3	MAU-1	65 LBS	CURB	21.000"W X 71.000"L X 20.000"H INSULATED.

HMI SCHEDULE				
UNIT NUMBER	HMI #	HMI LOCATION	TEMP AVERAGING	MODBUS ADDRESS
FAN #3	HMI #1 – UNIT	IN UNIT	NOT AVERAGED	55

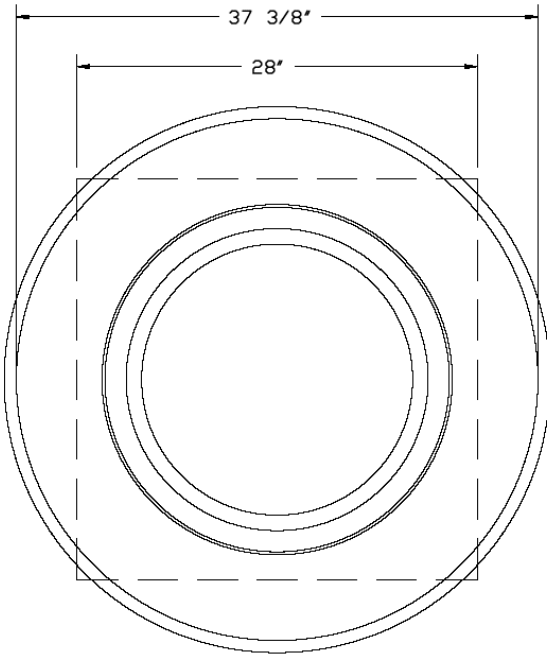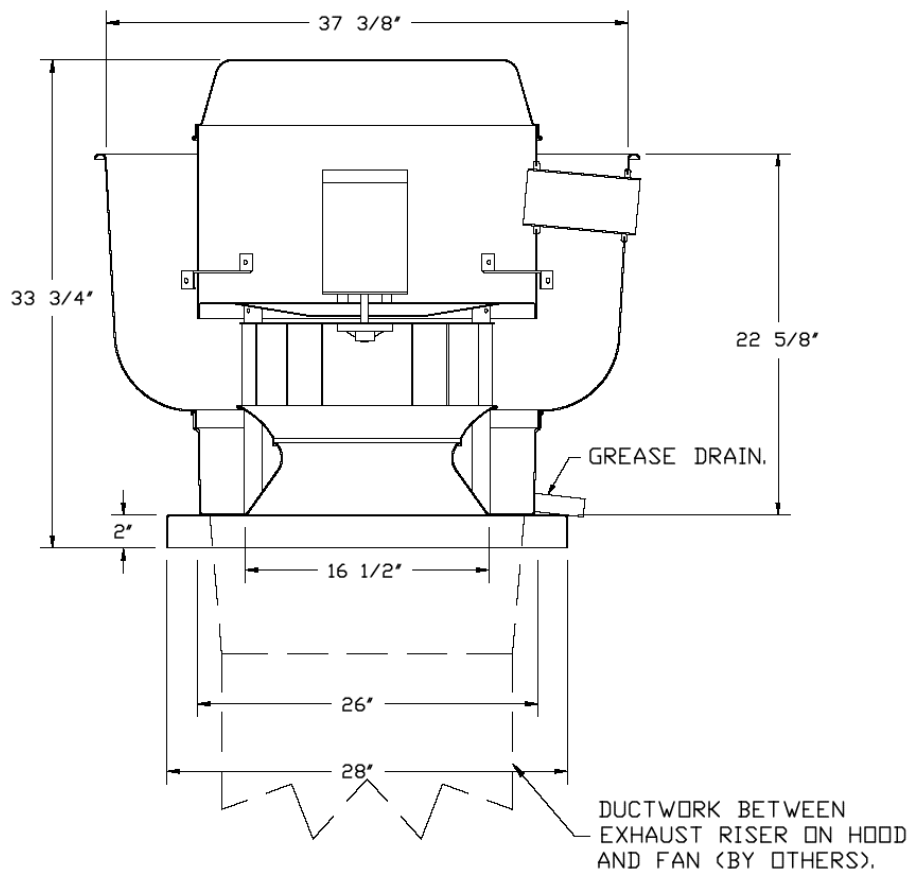

TOP VIEW

FEATURES:


- DIRECT DRIVE CONSTRUCTION (NO BELTS/PULLEYS).
- ROOF MOUNTED FANS.
- RESTAURANT MODEL.
- UL705 AND UL762 AND UL-C-5645
- VARIABLE SPEED CONTROL.
- INTERNAL WIRING.
- THERMAL OVERLOAD PROTECTION (SINGLE PHASE).
- HIGH HEAT OPERATION 300°F (149°C).
- GREASE CLASSIFICATION TESTING.
- NEMA 3R SAFETY DISCONNECT SWITCH.

NORMAL TEMPERATURE TEST
EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING AIR AT 300°F (149°C) UNTIL ALL FAN PARTS HAVE REACHED THERMAL EQUILIBRIUM, AND WITHOUT ANY DETERIORATING EFFECTS TO THE FAN WHICH WOULD CAUSE UNSAFE OPERATION.

ABNORMAL FLARE-UP TEST
EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING BURNING GREASE VAPORS AT 600°F (316°C) FOR A PERIOD OF 15 MINUTES WITHOUT THE FAN BECOMING DAMAGED TO ANY EXTENT THAT COULD CAUSE AN UNSAFE CONDITION.

OPTIONS:

- GREASE BOX.
- REMOVE HINGE KIT LABEL FROM THE FAN BASE.
- 2 YEAR PARTS WARRANTY.

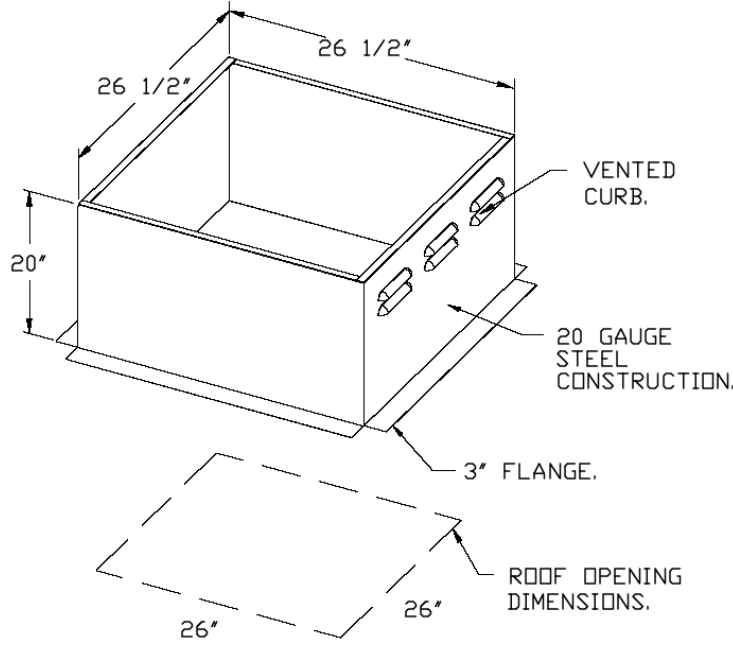

REVISIONS

DESCRIPTION	DATE

Highwoods Group

CHIPOTLE CAMERON #5644
Cameron, NC, 28326

DATE: 3/3/2025

DWG.#:
7377730

DRAWN BY: JMB-40

SCALE:
3/4" = 1'-0"


MASTER DRAWING

SHEET NO.
5

Consultant:



4635 Trueman Blvd, Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com

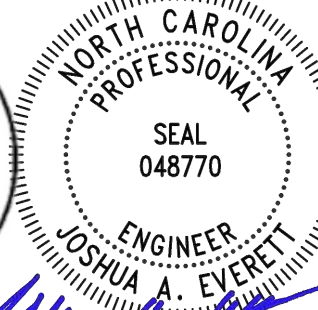

08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644

"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:
03/07/2025 PERMIT SET
05/29/2025 BID SET

Revisions:

Drawn: EEP
Checked: AJJ

Project No:
2402039


Contents:

CAPTIVEAIRE SHOP
DRAWINGS


M714

HOOD SHOP DRAWINGS HAVE BEEN
DESIGNED/PREPARED BY OTHERS.
SHOWN FOR REFERENCE ONLY

FAN #2_DRI2HFA - EXHAUST FAN (CF-2)

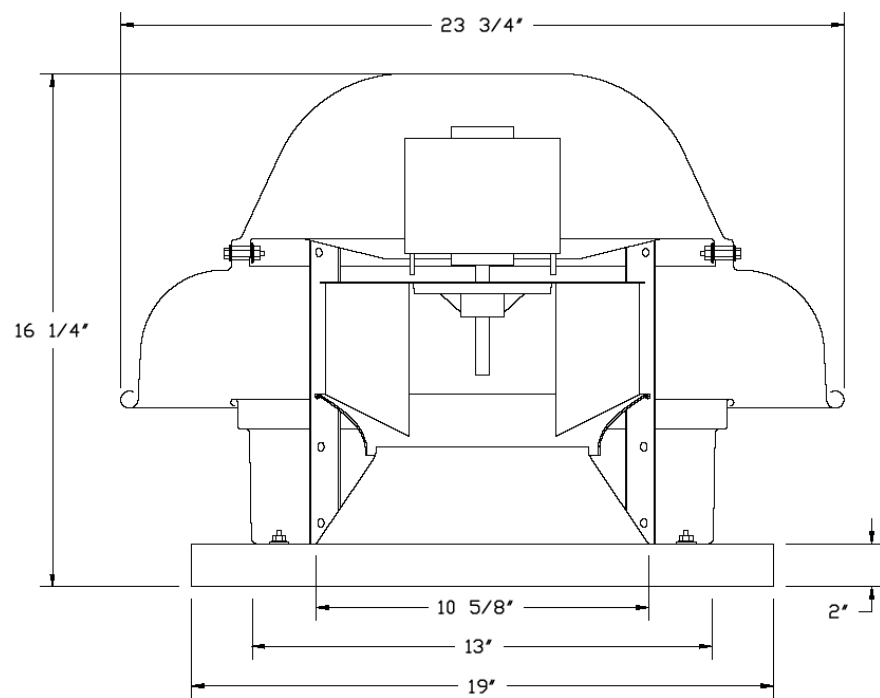

TOP VIEW

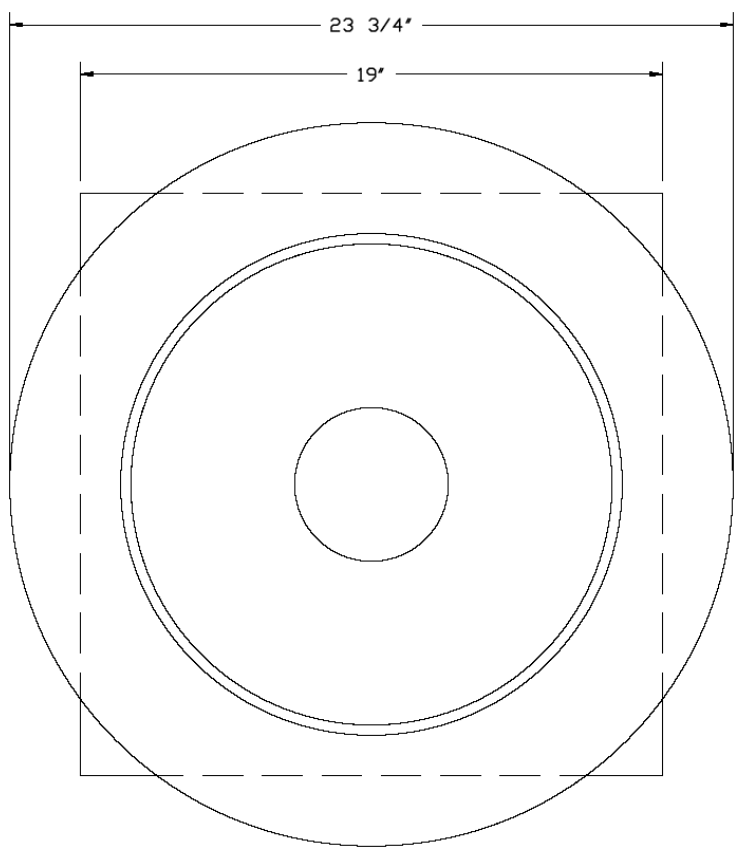


FEATURES:


- DIRECT DRIVE CONSTRUCTION (NO BELTS/PULLEYS).
- ROOF MOUNTED FANS.
- UL705.
- SAFETY DISCONNECT.
- STANDARD BIRD SCREEN.
- SPEED CONTROL.
- THERMAL OVERLOAD PROTECTION (SINGLE PHASE).

OPTIONS:


- 1 12-BDD DAMPER.
- ECM WIRING PACKAGE - MANUAL OR 0-10VDC REFERENCE SPEED CONTROL.
- RTC- (TELCD MOTOR), CCW ROTATION.
- 2 YEAR PARTS WARRANTY.

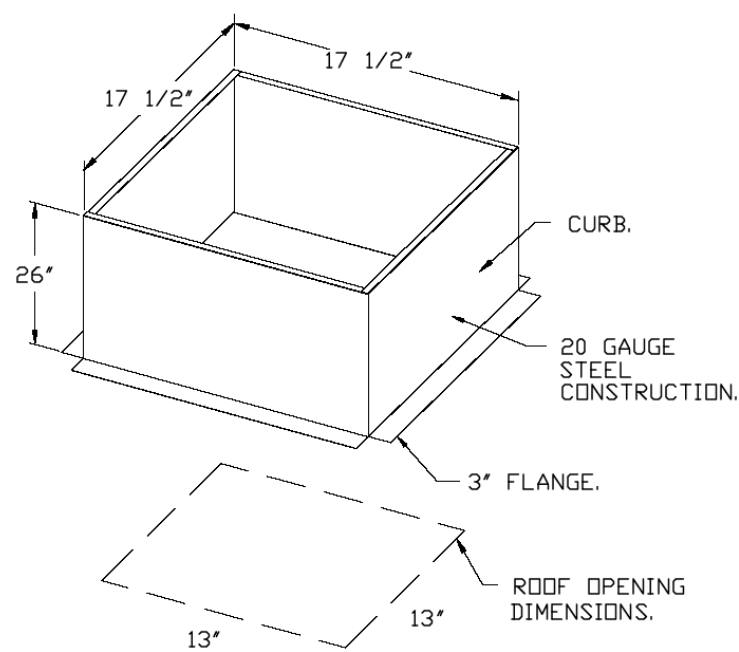

BACKDRAFT DAMPER INSTALLATION

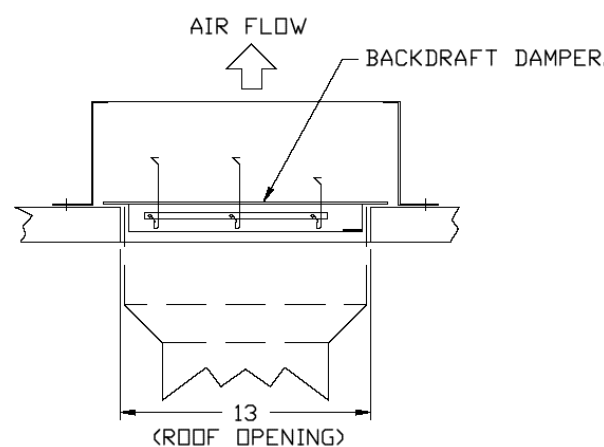

REVISIONS	
DESCRIPTION	DATE

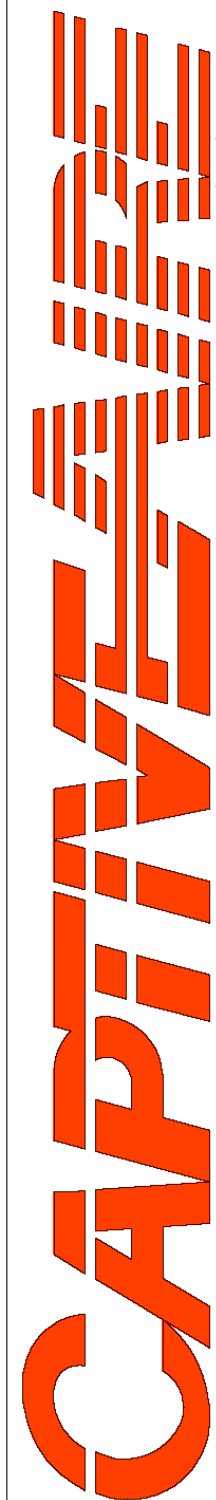

CHIPOTLE CAMERON #5644
Cameron, NC, 28326

DATE: 3/3/2025
DWG.#: 7377730
DRAWN BY: JMB-40
SCALE: 3/4" = 1'-0"
MASTER DRAWING


SHEET NO.
6

HOOD SHOP DRAWINGS HAVE BEEN
DESIGNED/PREPARED BY OTHERS.
SHOWN FOR REFERENCE ONLY

Consultant:



4635 Trueman Blvd, Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com

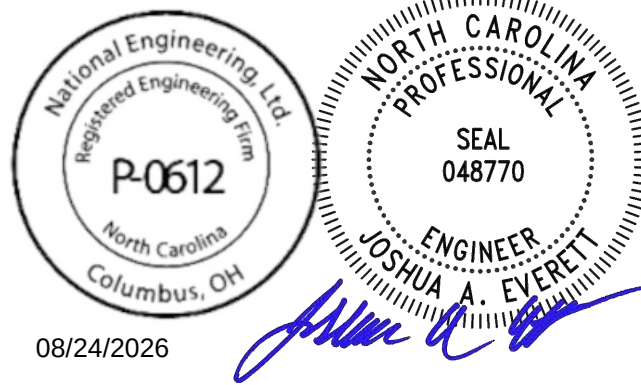

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:	PERMIT SET
03/07/2025	BID SET
05/29/2025	

Revisions:	

Drawn: EEP
Checked: AJJ

Project No.
2402039

Contents:
CAPTIVEAIRE SHOP
DRAWINGS

M715

INNOTE: SUPPLY DUCT MUST BE INSTALLED TO MEET SMACNA STANDARDS. A MINIMUM STRAIGHT DUCT LENGTH MUST BE MAINTAINED DOWNSTREAM OF UNIT DISCHARGE AS OUTLINED IN AMCA PUBLICATION 201. WHEN USING RECTANGULAR DUCTWORK, ELBOWS MUST BE RADIUS THROAT, RADIUS BACK WITH TURNING VANES. FLEXIBLE DUCTWORK AND SQUARE THROAT/SQUARE BACK ELBOWS SHOULD NOT BE USED. ANY TRANSITION AND/OR TURNS IN THE DUCTWORK WILL CAUSE SYSTEM EFFECT. SYSTEM EFFECT WILL DRASTICALLY INCREASE STATIC PRESSURE AND REDUCE AIRFLOW. DO NOT RELY ON UNIT TO SUPPORT DUCT IN ANY WAY. FAILURE TO FOLLOW THESE DUCTWORK MAY CAUSE SYSTEM EFFECTS AND REDUCE PERFORMANCE OF THE EQUIPMENT.

SUGGESTED STRAIGHT DUCT SIZE IS 14" x 14".

```

WINTER TEMPERATURE = 25°F.  TEMP. RISE = 50°F
BTUs CALCULATED OFF ACTUAL AIR DENSITY.
OUTPUT BTUs AT ALTITUDE OF 0.0 FT. = 69442.
INPUT BTUs AT ALTITUDE OF 0.0 FT. = 75491.
OUTPUT BTUs AT ALTITUDE OF 327 FT. = 68625.
INPUT BTUs AT ALTITUDE OF 327 FT. = 74593.

```



DIRECT FIRED PROFILE PLATE SPECIFICATIONS:

DESCRIPTION: DIRECT FIRED BURNERS SHALL HAVE PATENTED (US PATENT NO. US6629523B2), SELF-ADJUSTING PROFILE PLATES DESIGNED TO ENSURE PROPER AIR VELOCITY AND PRESSURE DROP ACROSS THE BURNER. PROFILE PLATES SHALL BE DESIGNED TO ACHIEVE CLEAN COMBUSTION OF THE FUEL PRODUCT AT LEVELS TO A MAXIMUM OF 50PPM OF CARBON MONOXIDE (CO), AND 0.5PPM OF NITROGEN DIOXIDE (NO2) DIRECT FIRED. UNITS SHALL BE CONFIGURED WITH THE BLOWER MOUNTED DOWNSTREAM OF THE BURNER. THIS ARRANGEMENT WILL ENSURE A CONSISTENT AIRFLOW, REGARDLESS OF INLET AIR TEMPERATURE.

APPLICATION

SPRING-LOADED BURNER PROFILE PLATES ARE ENGINEERED TO AUTOMATICALLY REACT TO THE MOMENTUM OF A FRESH AIR STREAM, WITHOUT THE NEED FOR ANY MOTORS OR ACTUATORS TO MECHANICALLY ADJUST THEM. WITH THIS FEATURE, ALL DF UNITS ARE DESIGNED FOR DEMAND CONTROL VENTILATION (DCV) REQUIREMENTS.


ALL PROFILE PLATE ASSEMBLIES SHALL BE INCLUDED IN THE DF UNIT'S ETL LISTING AND COMPLY WITH COMBINED SAFETY STANDARDS ANSI Z83.4 AND CSA 3.7 (NON-RECIRCULATING DF HEATERS) AND ANSI Z83.18 (RECIRCULATING DF HEATERS)

GENERAL CONSTRUCTION:

- PROFILE PLATES SHALL BE FORMED FROM G90 GALVANIZED STEEL.
- PROFILE PLATES SHALL VARY IN SIZE PER UNIT.
- PROFILE PLATES SHALL BE MOUNTED ALONG THE SAME PLANE AS THE DISCHARGE OF THE BURNER
- DESIGN SHALL INCORPORATE PROPERLY TORQUED, PERMANENTLY MOUNTED SPRING HINGES.
- SPRING HINGES SHALL BE MADE FROM PLATED STEEL.



OPTIONS:
- FULL BOTTOM CORNERS.

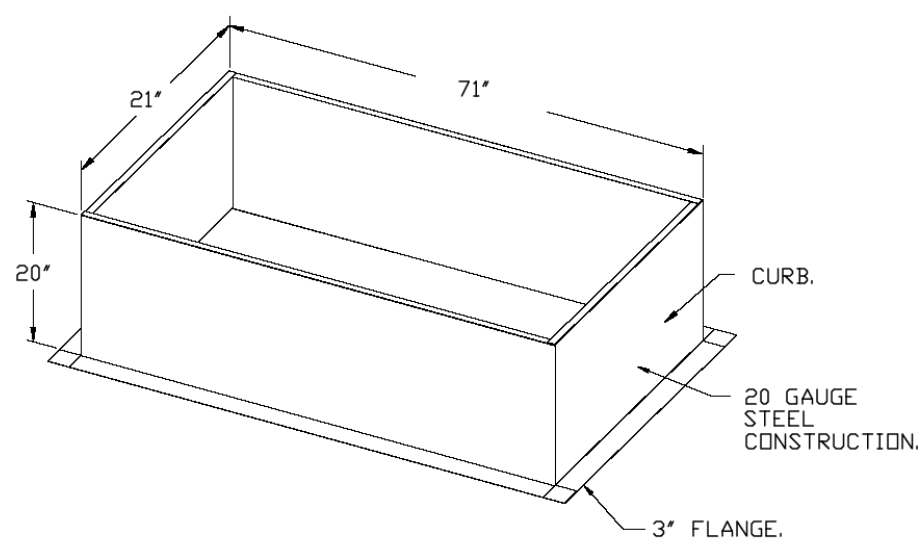

www.captiveaire.com

Highwoods Group

CAPTIVE

CHIPOTLE CAMERON #5644
Cameron, NC, 28326

DATE: 3/3/2025

DWG.#:
7377730


DRAWN BY: JMB-40

SCALE:
3/4" = 1'-0"


MASTER DRAWING

SHEET NO.
7

Consultant:

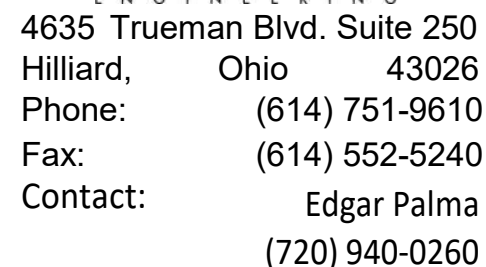


Epalma@nationalengineering.com

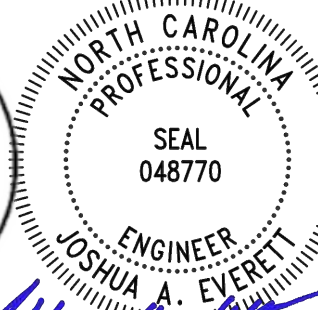

08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:	
03/07/2025	PERMIT SET
05/29/2025	BID SET

Revisions:

Drawn:	Checked:
EEP	AJJ





Project No.
2402039

Contents:

CAPTIVEAIRE SHOP DRAWINGS

M716

HOOD SHOP DRAWINGS HAVE BEEN
DESIGNED/PREPARED BY OTHERS.
SHOWN FOR REFERENCE ONLY

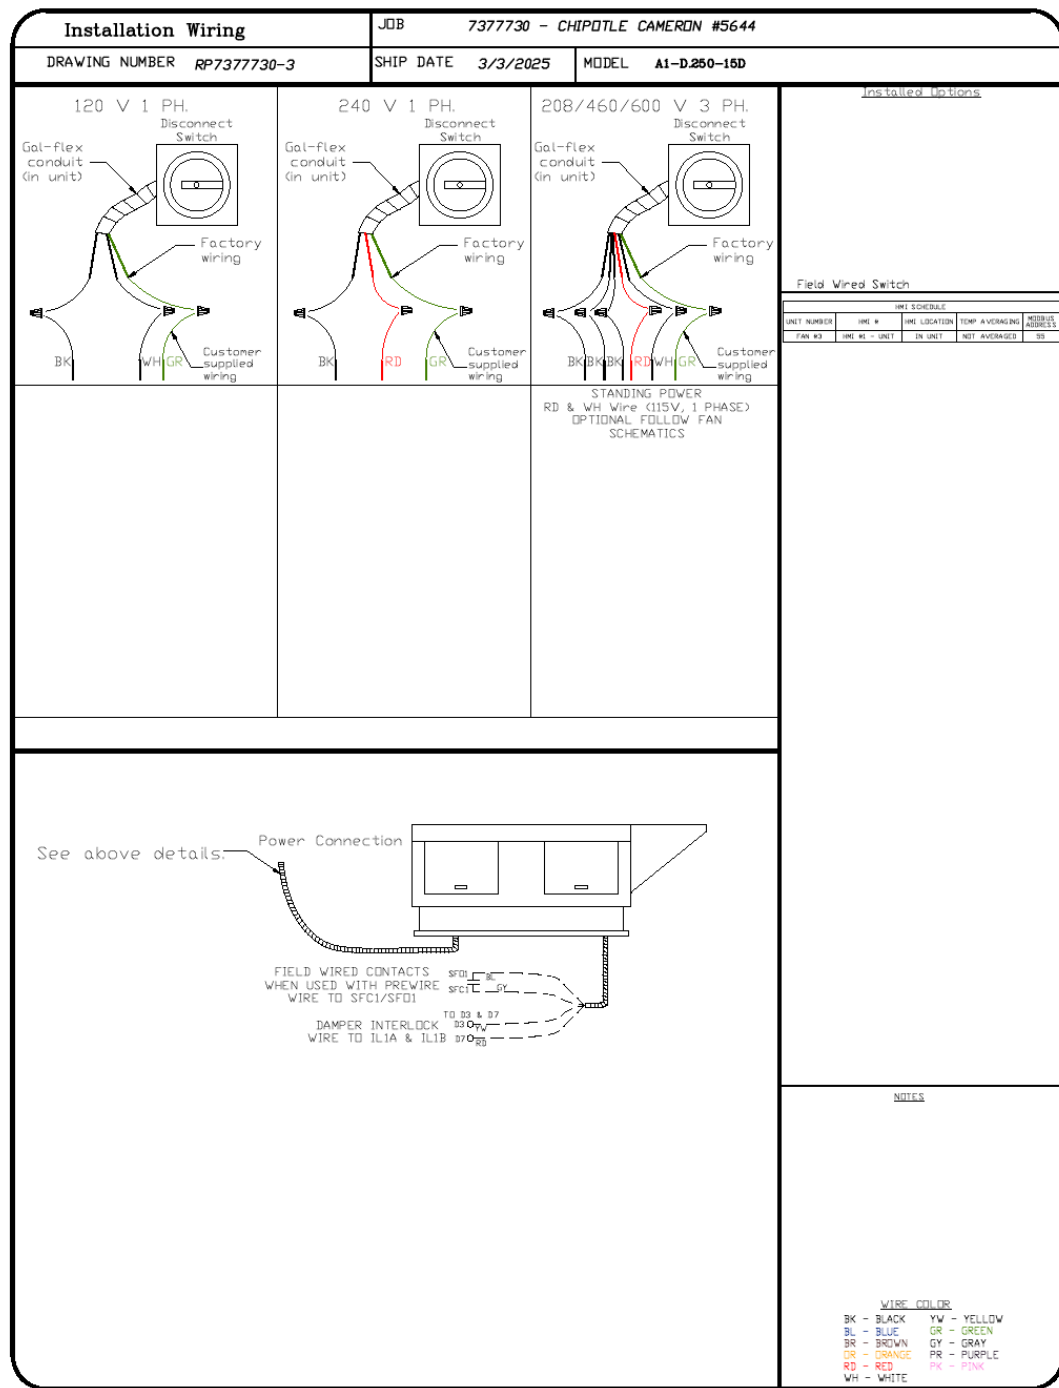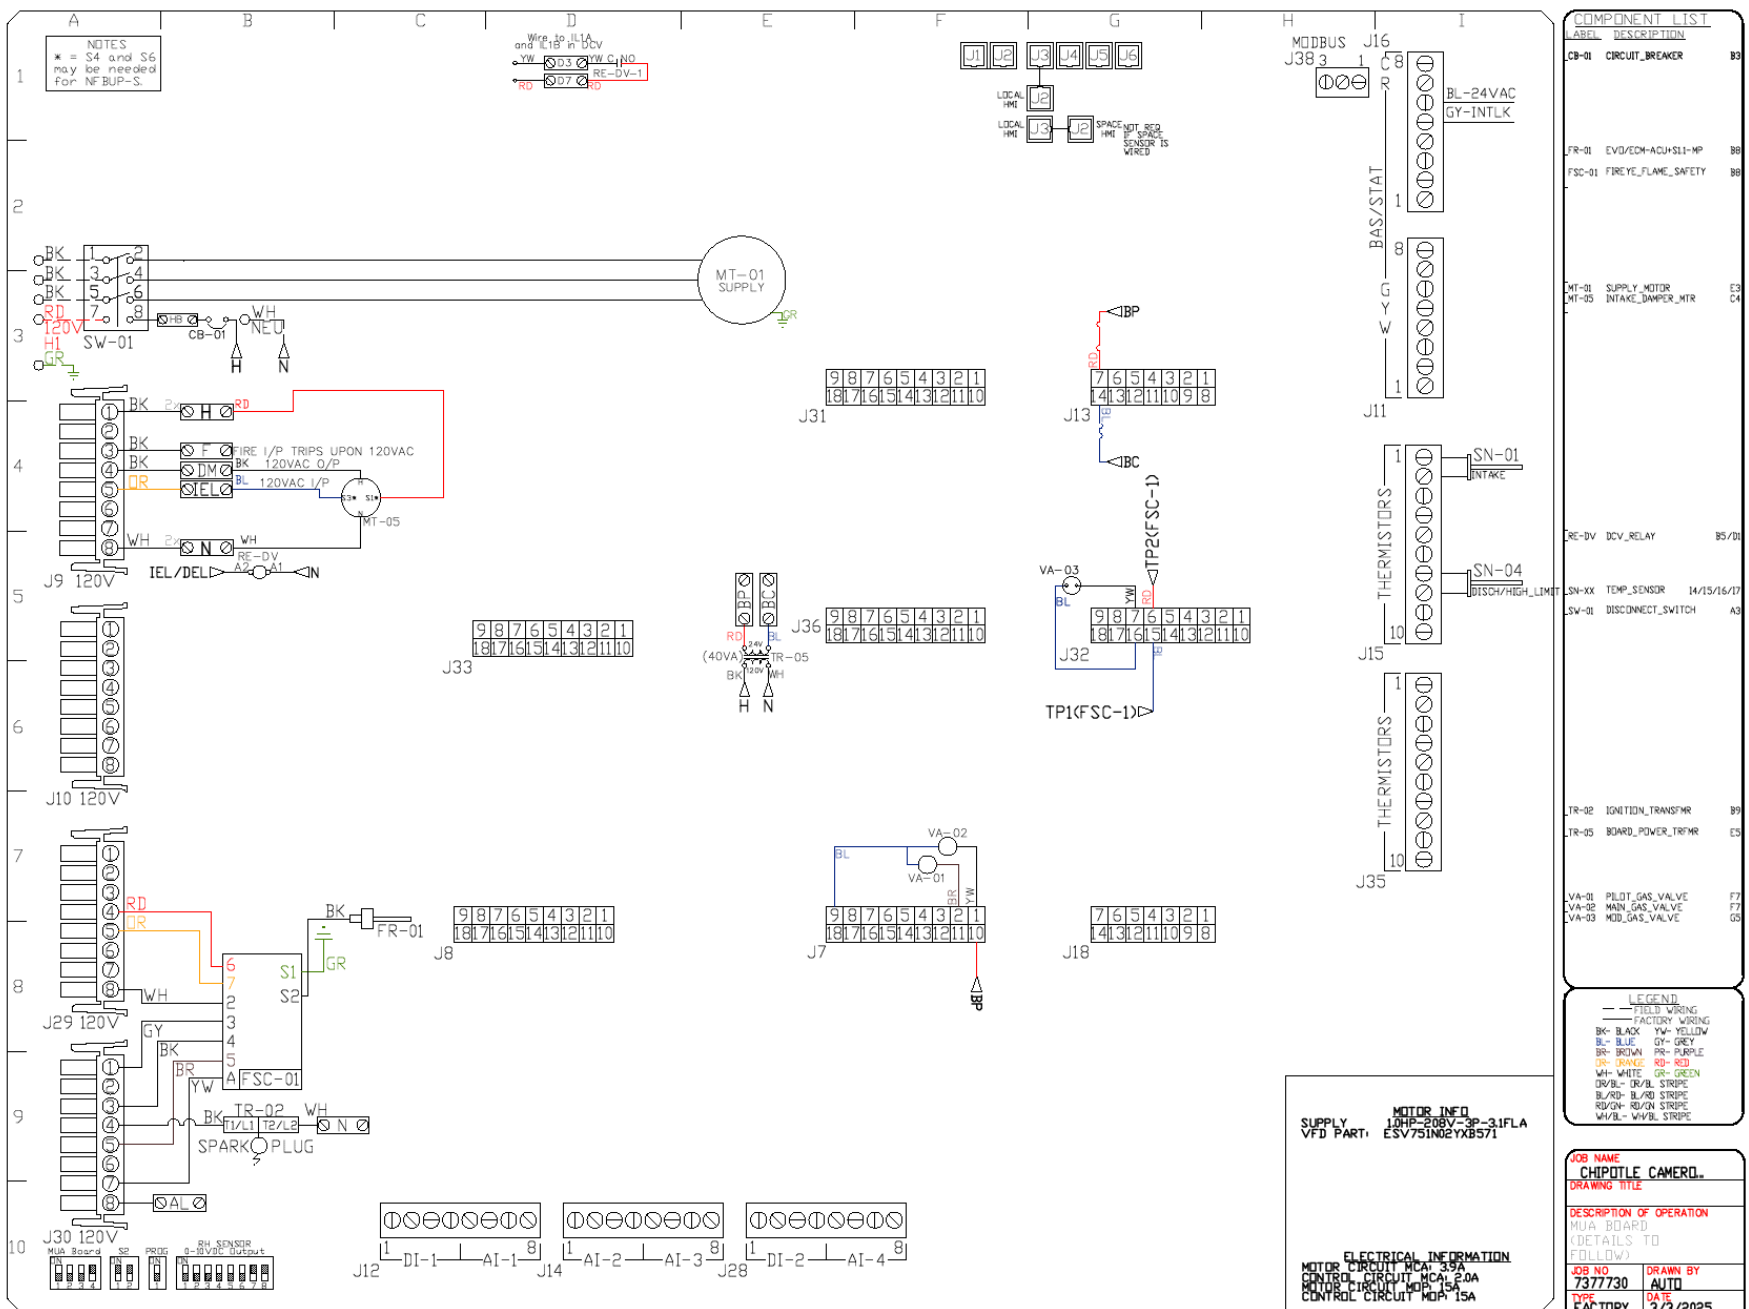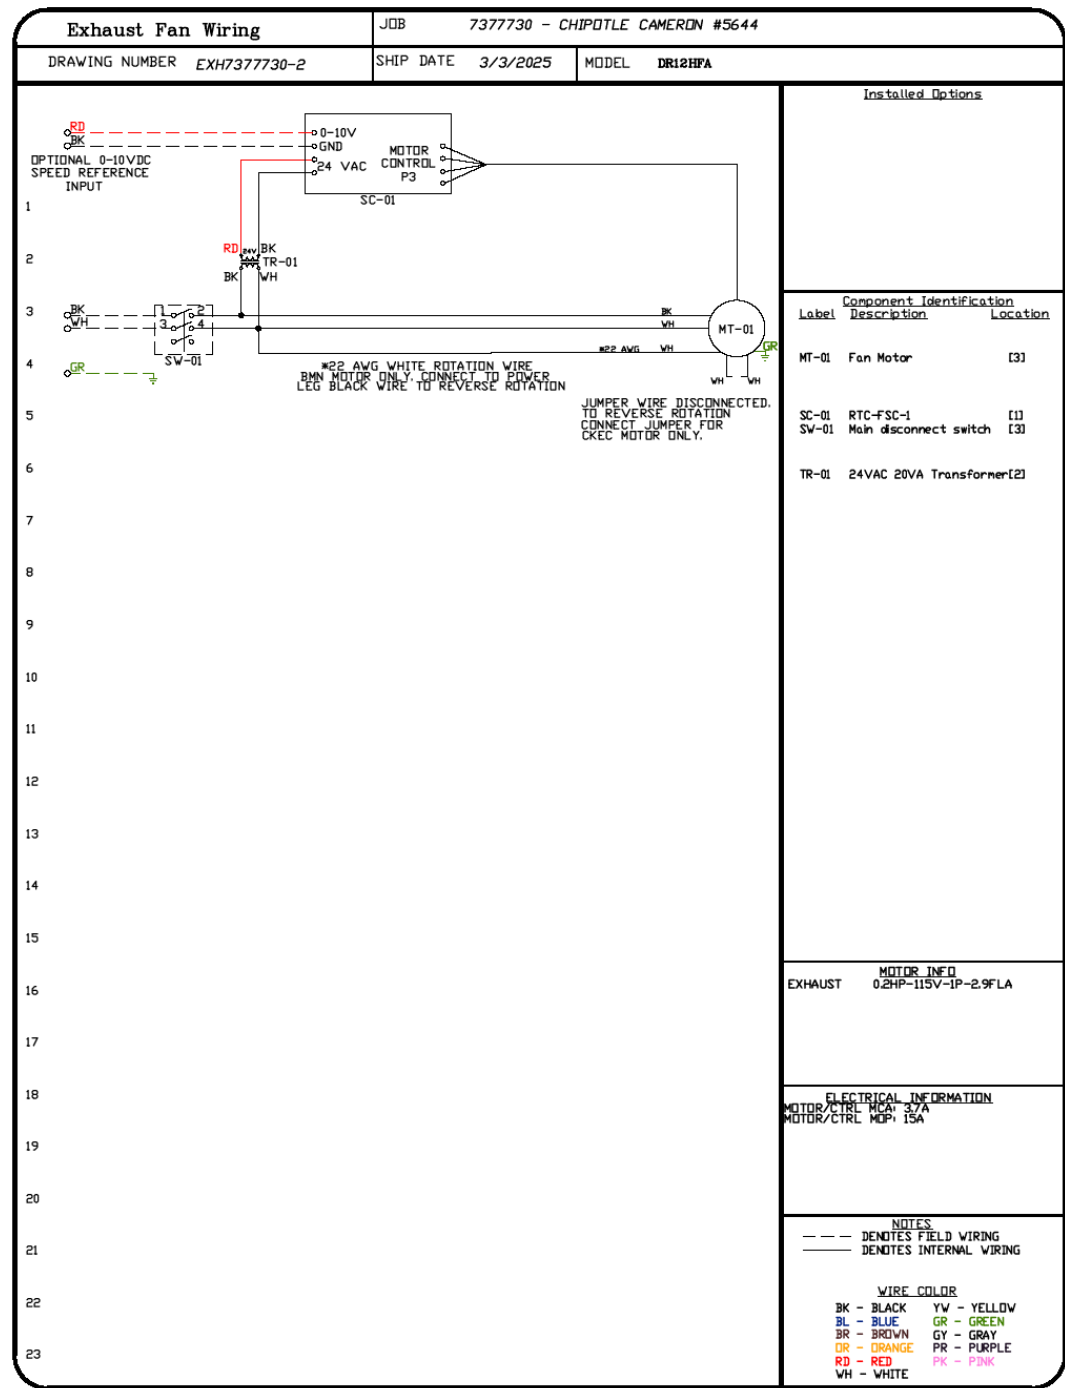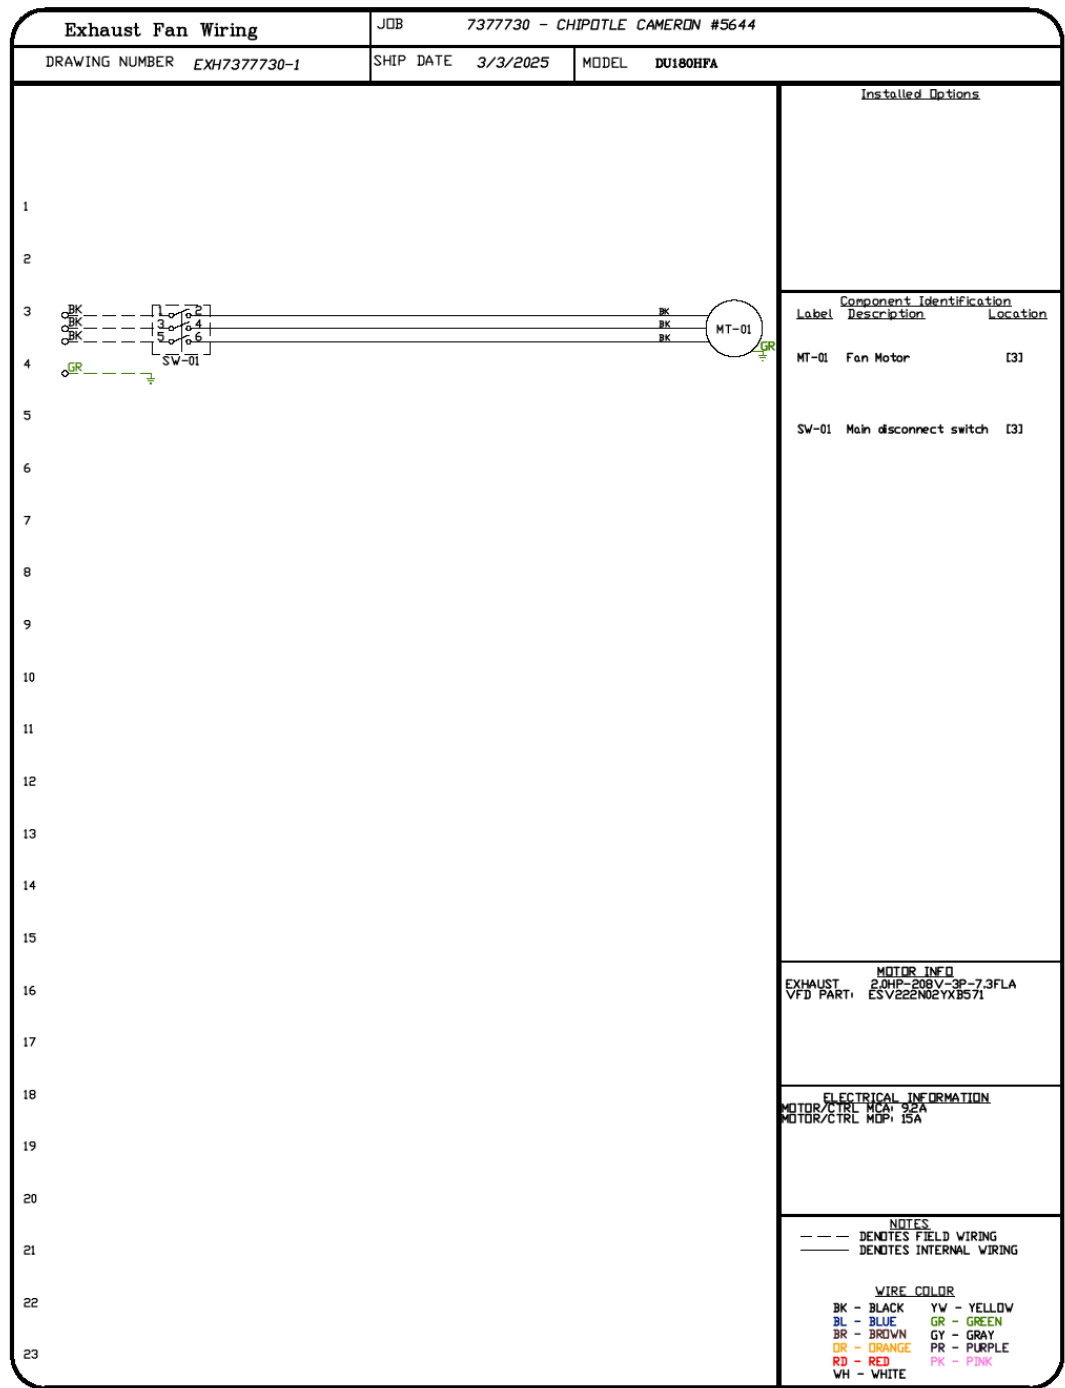

REVISIONS

DESCRIPTION DATE

DATE: 3/3/2025

DWG.#: 7377730

DRAWN BY: JMB-40

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 8

Consultant:

NATIONAL

ENGINEERING

4635 Trueman Blvd. Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com



COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:	
03/07/2025	PERMIT SET
05/29/2025	BID SET

Revisions:	

Drawn: EEP Checked: AJJ

Project No. 2402039

Contents:

CAPTIVEAIRE SHOP
DRAWINGS

M717

HOOD SHOP DRAWINGS HAVE BEEN
DESIGNED/PREPARED BY OTHERS.
SHOWN FOR REFERENCE ONLY

SECTION 15055 - COMMON PIPING REQUIREMENTS

- PART 1 - GENERAL
- A. SECTION REQUIREMENTS
1. Comply with the requirements of the Building Code and the local authority having jurisdiction.
- PART 2 - PRODUCTS
- 2.1 SUPPORTING DEVICES
- A. Hanger and Pipe Attachments: Factory fabricated with galvanized coatings; nonmetallic coated for hangers in direct contact with copper tubing.
- B. Building Attachments: Powder actuated type, drive pin attachments with pullout and shear capacities appropriate for supported loads and building materials; UL listing and FM approval for fire protection systems.
- C. Mechanical Anchor Fasteners: Insert-type attachments with pullout and shear capacities appropriate for supported loads and building materials; UL listing and FM approval for fire protection systems.
- PART 3 - EXECUTION
- 3.1 INSTALLATION
- A. Install piping free of sags and bends.
- B. Install fittings for changes in direction and branch connections.
- C. Install sleeves for pipes passing through concrete and masonry walls, gypsum board partitions, and concrete floor and roof slabs.
- D. Exterior Wall, Pipe Penetrations: Mechanical sleeve seals installed in steel or cast iron pipes for wall sleeves.
- E. Fire Barrier Penetrations: Seal pipe penetrations with through-penetration firestop systems.
- F. Install unions adjacent to each valve and at final connection to each piece of equipment.
- G. Install dielectric unions and flanges to connect piping materials of dissimilar metals in gas piping.
- H. Install dielectric coupling and nipple fittings to connect piping materials of dissimilar metals in water piping.
- I. Provide full ring escutcheons at plumbing penetrations through walls or ceilings. Tightly seal escutcheons to the adjacent surface.
- 3.2 HANGERS AND SUPPORTS
- A. Install building attachments within concrete or to structural steel. Install additional attachments at concentrated loads, including valves, flanges, guides, strainers, expansion joints, and at changes in direction of piping.
- B. Install powder actuated drive pin fasteners in concrete after concrete is cured. Do not use in lightweight concrete or in slabs less than 4 inches thick.
- C. Install mechanical anchor fasteners in concrete after concrete is cured. Do not use in lightweight concrete or in slabs less than 4 inches thick.
- D. Support fire protection system piping independent of other piping.
- E. Load Distribution: Install hangers and supports so piping live and dead loading and stresses from movement will not be transmitted to connected equipment.
- END OF SECTION 15055

SECTION 15080 - MECHANICAL INSULATION

- PART 1 - GENERAL
- 1.1 SECTION REQUIREMENTS
- A. Submittals: None.
- B. Quality Assurance: Label with maximum flame-spread rating of 25 and maximum smoke developed rating of 50 according to ASTM E 84.
- PART 2 - PRODUCTS
- 2.1 PIPE INSULATION
- A. Preformed Glass Fiber Pipe Insulation: ASTM C 547, Class 1, with factory applied, all purpose, vapor retarder jacket.
- B. Polyolefin Pipe Insulation: Unicellular polyethylene, preformed pipe insulation. Comply with ASTM C 534, Type I, except for density.
- PART 3 - EXECUTION
- 3.1 INSTALLATION
- A. Install vapor barriers on insulated pipes with surface operating temperatures below 60 deg F.
- B. Insulate fittings, valves, and specialties.
- C. Seal vapor barrier penetrations for hangers, supports, anchors, and other projections.
- D. Coat glass fiber pipe insulation ends with vapor barrier coating.
- E. Roof Penetrations: Apply insulation for interior applications to a point even with the top of the roof flashing.
- F. Exterior Wall Penetrations: For penetrations of below grade exterior walls, terminate insulation flush with mechanical sleeve seal.
- G. Interior Walls and Partitions Penetrations: Apply insulation continuously through walls and partitions, except fire rated walls and partitions.
- H. Fire Rated Walls and Partitions Penetrations: Terminate insulation at penetrations through fire rated walls and partitions. Seal around penetration with through penetration firestop systems.
- I. Floor Penetrations: Terminate insulation at the underside of the floor assembly and at the floor support at top of floor. Seal around penetration with through penetration firestop systems.
- J. Glass Fiber Insulation Installation: Bond insulation to pipe with adhesive. Seal seams and joints with vapor barrier compound.
- K. Interior Piping System Applications: Insulate the following piping systems:
1. Domestic cold, hot, and recirculation water pipes.
 2. Exposed sanitary drains and water supply pipes for public hand sinks.
 3. Refrigerant piping.
- L. Do not apply insulation to the following systems, materials, and equipment:
1. Flexible connectors.
 2. Fire protection piping systems.
 3. Sanitary drainage and vent piping.
 4. Chrome plated pipes and fittings, except for plumbing fixtures for the disabled.
 5. Piping specialties, including air chambers, unions, strainers, check valves, plug valves, and flow regulators.
- M. Pipe Insulation Thickness Application Schedule: Insulate piping with the following materials and thicknesses:
1. Domestic Hot and Recirculation water pipes: 1-inch preformed glass fiber pipe insulation.
 2. Domestic Cold Water: 1/2-inch preformed glass fiber pipe insulation.
 3. P-Trap and Fixture Supplies for public hand sinks: ADA-compliant pre-formed insulation.
- END OF SECTION 15080

SECTION 15110 - VALVES

- PART 1 - GENERAL (Not Applicable)
- PART 2 - PRODUCTS
- 2.1 GENERAL DUTY VALVES
- A. End Connections: Threads shall comply with ANSI B1.20.1. Flanges shall comply with ANSI B16.1 for cast iron valves and ANSI B16.24 for bronze valves. Solder-joint connections shall comply with ANSI B16.18.
- B. Ball Valves: Rated for 150 psig saturated steam pressure, 400 psig WOG pressure; 2 piece construction; with bronze body, standard (or regular) port, chrome plated brass ball, replaceable "Teflon" or "TFE" seats and seals, blowout proof stem, and vinyl covered steel handle.
- C. Plug Valves: Rated at 150 psig WOG; bronze body, with straightaway pattern, square head, and threaded ends.
- D. Swing Check Valves: Class 125, cast bronze body and cap; with horizontal swing, Y-pattern, and bronze disc.
- E. Valves for Copper Tube: Solder ends, except provide threaded ends for heating hot water and low pressure steam service.
- F. Valves for Steel Pipe: Threaded ends.
- PART 3 - EXECUTION
- 3.1 INSTALLATION
- A. Use gate and ball valves for shutoff duty and ball for throttling duty.
- B. Locate valves for easy access and provide separate support where necessary.
- C. Install accessible valves for each fixture and item of equipment.
- D. Install valves in horizontal piping with stem at or above center of pipe.
- E. Install valves in a position to allow full stem movement.
- F. Install check valves for proper direction of flow in horizontal position with hinge pin level.
- END OF SECTION 15110

SECTION 15140 - DOMESTIC WATER PIPING

- PART 1 - GENERAL
- 1.1 SECTION REQUIREMENTS
- A. Performance Requirements: Unless otherwise indicated minimum pressure requirements for water piping are as follows:
1. Service Entrance Piping: 100 psig.
 2. Domestic Water Piping: 80 psig.
- B. Comply with NSF 14 "Plastic Piping Components and Materials."
- C. Comply with NSF 61 "Drinking Water System Components -- Health Effects."
- PART 2 - PRODUCTS
- 2.1 PIPES AND TUBES (See Material Schedule on sheet P010 for where these materials are to be used)
- A. Hard Copper Tube: ASTM B 88, Types L and M, water tube, drawn temper.
- 2.2 FITTINGS
- A. Wrought Copper, Solder Joint Pressure Fittings: ASME B 16.22.
- B. Cast Copper Alloy, Solder Joint Pressure Fittings: ASME B 16.18.
- C. Bronze Flanges: ASME B 16.24, Classes 150 and 300.
- D. Copper Unions: ASME B 16.18, cast copper alloy body, hexagonal stock, with ball and socket joint, metal to metal seating surfaces, and solder joint, threaded, or solder joint and threaded ends. Threads complying with ASME B 1.20.1.
- E. Copper and Copper Alloy Press-Connect Pressure Fittings: Copper Press Fittings: ASME B16.51
- 2.3 JOINING MATERIALS
- A. Solder Filler Metal: ASTM B 32, lead free.
- B. Brazing Filler Metals: AWS AS.8, alloys to suit system requirements.
- C. Solvent Cements: As recommended by manufacturer.
- D. Plastic Pipe Seals: ASTM F 477, elastomeric gasket.
- PART 3 - EXECUTION
- 3.1 VALVE APPLICATIONS
- A. Install gate valves close to main on each branch and riser serving two or more plumbing fixtures or equipment connections and where indicated.
- B. Install gate or ball valves on inlet to each plumbing equipment item, on each supply to each plumbing fixture not having stops on supplies, and elsewhere as indicated.
- C. Install drain valve at base of each riser, at low points of horizontal runs, and where required to drain water distribution piping system.
- D. Install swing check valve on discharge side of each pump and elsewhere as indicated.
- E. Install ball valves in each hot water circulating loop and discharge side of each pump.
- 3.2 PIPING INSTALLATIONS
- A. Install hangers and supports at intervals indicated in the applicable plumbing code and as recommended by pipe manufacturer.
- B. Support vertical piping at each floor.
- 3.3 INSPECTING AND CLEANING
- A. Inspect and test piping systems following procedures of authorities having jurisdiction.
- B. Clean and disinfect water distribution piping following procedures of authorities having jurisdiction.
- END OF SECTION 15140

SECTION 15150 - SANITARY WASTE AND VENT PIPING

- PART 1 - GENERAL
- 1.1 SECTION REQUIREMENTS
- A. Minimum Pressure Requirement for Soil, Waste and Vent: 10 feet head.
- B. Comply with NSF 14 "Plastic Piping Components and Related Materials".
- PART 2 - PRODUCTS
- 2.1 PIPES AND TUBES
- A. PVC Plastic, DWV Pipe: ASTM D 2665, Schedule 40, plain ends.
- 2.2 FITTINGS
- A. PVC Plastic, DWV Pipe Fittings: ASTM D 2665, made to ASTM D 3311; socket type; drain, waste, and vent pipe patterns.
- PART 3 - EXECUTION
- 3.1 PIPING INSTALLATION
- A. Install cleanout and extension to grade at connection of building sanitary drain and building sanitary sewer.
- B. Locate drainage piping runouts as close as possible to bottom of floor slab supporting fixtures or drains.
- 3.2 INSPECTION
- A. Inspect and test piping systems following procedures of authorities having jurisdiction.
- END OF SECTION 15150

SECTION 15198 - NATURAL GAS PIPING

- PART 1 - GENERAL
- 1.1 SECTION REQUIREMENTS
- A. Quality Assurance: Comply with NFPA 54 and the Plumbing Code.
- PART 2 - PRODUCTS
- 2.1 PIPE, TUBE, AND SPECIALTIES
- A. Steel Pipe: ASTM A 53, Type S (Seamless), Grade B, Schedule 40, plain ends.
- B. Fittings:
- a. Malleable Iron Threaded Fittings: ASME B16.3, Class 150.
 - b. Cold Press Mechanical Joint Fitting System: Viega MegaPress
- C. Manual Valves: Comply with standards listed or, if appropriate, to ANSI Z21.15.
- D. Gas Stops: AGA certified, bronze-body, plug type with bronze plug, for 2-psig or less natural gas. Include AGA stamp, flat or square head or lever handle, and threaded ends complying with ASME B1.20.1.
- E. Gas Valves: 150-psig WOG, cast-iron or bronze body, bronze plug, straightaway pattern, square head, tapered-plug type.
- F. Gas Pressure Regulators: ANSI Z21.18, single stage, steel jacketed, corrosion resistant pressure regulators. Include atmospheric vent, elevation compensator. Regulator pressure ratings, inlet and outlet pressures, and flow volume in cubic feet per hour of natural gas at specific gravity are as indicated.
- G. Line Gas Pressure Regulators: Inlet pressure rating not less than system pressure.
- H. Flexible Connectors: ANSI Z21.24, copper alloy.
- I. Strainers: Bronze body, Y-pattern, full size of connecting piping. Include stainless-steel screens with 3/64 inch perforations and a pressure rating of 125-psig- minimum, WOG working pressure.
- PART 3 - EXECUTION
- 3.1 INSTALLATION
- A. Close equipment shutoff valves before turning off gas to premises or section of piping. Perform leakage test as specified to determine that all equipment is turned off in affected piping section.
- B. Install shutoff valve, downstream from gas meter, outside building at gas service entrance.
- C. Install gas stops for shutoff to appliances with NPS 2" or smaller low pressure gas supply.
- D. Drips and Sediment Traps: Install drips at points where condensate may collect. Include outlets of gas meters. Locate where readily accessible to permit cleaning and emptying. Do not install where condensate would be subject to freezing.
- E. Install gas piping at uniform slope of 0.1 percent upward toward risers.
- F. Connect branch piping from top or side of horizontal piping.
- G. Install strainers on supply side of each control valve, gas pressure regulator, solenoid valve, and elsewhere as indicated.
- H. Install valves in accessible locations, protected from damage.
- I. Install gas valve upstream from each gas pressure regulator. Where two gas-pressure regulators are installed in series, valve is not required at second regulator.
- J. Connect gas piping to equipment and appliances with shutoff valves and unions. Install gas valve upstream from and within 36 inches of each appliance using gas. Install union or flanged connection downstream from valve.
- K. Inspect, test, and purge piping according to NFPA 54, Part 4, "Gas Piping Inspection, Testing, and Purging", and requirements of authorities having jurisdiction.
- END OF SECTION 15198

SECTION 15410 - PLUMBING FIXTURES

- PART 1 - GENERAL
- 1.1 SECTION REQUIREMENTS
- Submittals: None.
- A. Comply with requirements of Public Law 102-486, "Energy Policy Act", regarding water flow rate and water consumption of plumbing fixtures.
- B. Comply with applicable standards below:
1. Enameled, Cast Iron Fixtures: ASME A112.19.1M.
 2. National Sanitation Foundation Construction: NFS2.
 3. Porcelain Enameled Fixtures: ASME A112.19.4M.
 4. Slip Resistant Bathing Surfaces: ASTM F 462.
 5. Stainless Steel Fixtures: ASME A112.19.3M.
 6. Vitreous China Fixtures: ASME A112.19.2M.
- PART 2 - PRODUCTS
- 2.1 Refer to the fixture schedule on drawing P600
- PART 3 - EXECUTION
- 3.1 INSTALLATION
- A. Install fixtures with flanges and gasket seals.
- B. Install flushometer valves for accessible water closets and urinals with handle mounted on wide side of compartment. Install other actuators in locations that are easy for the disabled to reach.
- C. Fasten wall hanging plumbing fixtures securely to supports attached to building substrate when supports are specified, and to building wall construction where no support is indicated.
- D. Fasten floor mounted fixtures to substrate. With fixtures having holes for securing fixture to wall construction, fasten to reinforcement built into walls.
- E. Fasten wall mounted fittings to reinforcement built into walls.
- F. Fasten counter mounted plumbing fixtures to casework.
- G. Secure supplies to supports or substrate within pipe space behind fixture.
- H. Set mop basins in leveling bed of cement gROUT.
- I. Install individual supply inlets, supply stops, supply risers, and tubular brass traps with cleanouts at fixture.
- J. Install water supply stop valves in accessible locations.
- K. Install traps on fixture outlets. Omit traps on fixtures having integral traps. Omit traps on indirect wastes, unless otherwise indicated or required by the Authority Having Jurisdiction.
- L. Install full-ring escutcheons at wall, floor, and ceiling penetrations in exposed, finished locations and within cabinets and millwork. Use deep pattern escutcheons where required to conceal protruding pipe fittings.
- M. Install piping connections between plumbing fixtures and piping systems and plumbing equipment. Install insulation on supplies and drains of fixtures for the disabled.
- N. Ground equipment. Tighten electrical connectors and terminals according to UL 486A and UL 486B.
- END OF SECTION 15410

SECTION 15554 - FLUES AND VENTS

- PART 1 - GENERAL
- 1.1 SECTION REQUIREMENTS
- A. Submittals: None.
- PART 2 - PRODUCTS
- 2.1 GAS VENTS
- A. Vent/air intake for high efficiency domestic water heater. Follow manufacturer's recommendations for sizing and material.
- B. Accessories: Tees, elbows, increasers, draft hood connectors, metal cap with bird barrier, adjustable roof flashing, storm collar, support assembly, thimbles, firestopping spacers, and fasteners; fabricated of similar materials and designs as vent-pipe straight sections.
- PART 3 - EXECUTION
- 3.1 INSTALLATION
- A. Install vents according to stipulated minimum clearances from combustibles.
- B. Seal between sections of positive pressure vents using only sealants recommended by manufacturer.
- C. Support vents at intervals to support the weight of the vent and all accessories, without exceeding loading of appliances.
- END OF SECTION 15554

PLUMBING GENERAL NOTES

- A. GENERAL NOTES APPLY TO PLUMBING SHEETS.
- B. PLUMBING WORK SHALL BE DONE IN ACCORDANCE WITH THE PLUMBING CODE, LOCAL HEALTH DEPARTMENT STANDARDS, AND THE AUTHORITY HAVING JURISDICTION. SEE ARCHITECTURAL SHEETS FOR THE PREVAILING CODES.
- C. PIPING LAYOUTS ON DRAWINGS ARE SCHEMATIC. EXACT LOCATIONS ARE TO BE COORDINATED WITH THE EXISTING CONDITIONS AND THE WORK OF OTHER TRADES.
- D. CONCEAL PIPING UNLESS NOTED OTHERWISE. WATER SUPPLY PIPES SHALL BE INSTALLED LEVEL.
- E. PROVIDE SHUT-OFF VALVES FOR ISOLATION OF FIXTURE GROUPS AS SHOWN ON DRAWINGS IN ADDITION TO STOP VALVES AT EACH FIXTURE.
- F. PROVIDE STOP VALVES AT FIXTURES.
- G. PROVIDE TRAP PRIMERS FOR FLOOR DRAINS.
- H. WHERE THE WATER OR GAS SUPPLY LINE SIZE SHOWN IN THE PLUMBING DIAGRAMS DIFFERS FROM THE FIXTURE OR EQUIPMENT CONNECTION SIZE, PROVIDE LINE SIZE PIPE TO WITHIN 6" OF THE FIXTURE OR EQUIPMENT BEFORE TRANSITIONING TO THE CONNECTION SIZE.
- I. PIPING IN EXTERIOR WALLS SHALL BE INSTALLED BETWEEN THE INSULATION AND THE INTERIOR WALL FINISHING MATERIAL.
- J. INSULATE THE HOT AND COLD WATER, CONDENSATE DRAINAGE, AND STORM PIPING PER THE SPECIFICATIONS AND DETAIL 8/P700.
- K. PROVIDE GAS SHUT-OFF VALVES AT EACH PIECE OF EQUIPMENT. PROVIDE ACCESSIBLE DIRT LEG AT THE BOTTOM OF VERTICAL SECTIONS OF GAS PIPE AND AT THE CONNECTION TO EACH PIECE OF EQUIPMENT.
- L. PLUMBING FIXTURES, ACCESSORIES, AND MATERIALS PROVIDED FOR DOMESTIC WATER SHALL BE LEAD FREE.
- M. PRIOR TO TURNOVER PERFORM A VIDEO INSPECTION OF THE SANITARY AND GREASE LINES FROM THE MAIN LINES WITHIN THE TENANT SPACE TO THE MAIN SEWER TO VERIFY THAT THE SANITARY WASTE SYSTEM IS CONNECTED, CLEAN, AND FREE OF SAGS, BELLIES, BREAKS, AND DEBRIS. DELIVER A REPORT AND COPY OF THE VIDEO TO THE TENANT'S CONSTRUCTION MANAGER PRIOR TO TURNOVER.
- N. THE TERM "FURNISH" MEANS SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS. THE TERM "INSTALL" DESCRIBES THE OPERATIONS AT THE PROJECT SITE INCLUDING THE ACTUAL UNLOADING, UNPACKING, ASSEMBLY, ERECTING, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, AND SIMILAR OPERATIONS. THE TERM "PROVIDE" MEANS TO FURNISH AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE.
- O. PRIOR TO CONNECTION TO ANY EXISTING SEWER SYSTEM PERFORM A DIE TEST TO VERIFY THE TYPE OF SYSTEM AND THE DIRECTION OF FLOW. REPORT ANY DEVIATION FROM THE CONSTRUCTION DOCUMENTS TO THE TENANT'S CONSTRUCTION MANAGER.
- P. PROVIDE SANITARY AND GREASE WASTE PIPES AT A MINIMUM SLOPE OF 1/4" PER FOOT UNLESS NOTED OTHERWISE.
- Q. INSTALL SHUTOFF AND ISOLATION VALVES SHOWN TO BE ABOVE CEILINGS IN ACCESSIBLE LOCATIONS WITHIN 12" OF LAY-IN CEILINGS.
- R. PERFORM A FLOW TEST ON THE DOMESTIC WATER SERVICE AT POSSESSION. IF THE STATIC WATER PRESSURE IS OVER 80 PSI THEN COORDINATE WITH CHIPOTLE CONSTRUCTION MANAGER TO PROVIDE A PRESSURE REGULATOR (WATTS LFU5B-Z3 OR EQUAL). PROVIDE RESULTS OF THE FLOW TEST TO THE ENGINEER FOR CONFIRMATION OF ADEQUATE CAPACITY.
- S. AIR GAPS SHALL NOT BE LESS THAN TWICE THE PIPE DIAMETER BETWEEN THE WASTE PIPE AND FLOOD LEVEL RIM OF THE RECEPTOR.
- T. MEASURE THE GAS PRESSURE AT BOTH NO FLOW AND FULL FLOW CONDITIONS IMMEDIATELY DOWNSTREAM OF THE METER AND PRESSURE REGULATOR, OR THE PRESSURE REGULATOR SERVING THE COOKLINE FOR 2 PSI DISTRIBUTION SYSTEMS, AND AT THE RICE COOKER GAS CONNECTIONS PER CMG'S DOCUMENTATION AND REPORT THESE FOUR PRESSURE READINGS TO CM USING CMG'S FORM.

PLUMBING SYMBOLS

- ELBOW UP
- ELBOW DOWN
- DOMESTIC COLD WATER
- DOMESTIC FILTERED COLD WATER
- DOMESTIC SOFTENED COLD WATER
- DOMESTIC HOT WATER (110 DEGREES)
- DOMESTIC HOT WATER RECIRC.
- GAS
- GAS (ON ROOF)
- SANITARY WASTE
- GREASE WASTE
- SANITARY VENT
- CONDENSATE DRAIN
- PLAN NOTE: SEE PLAN NOTES LISTED ON THE SAME SHEET FOR NOTE MEANING
- CONNECT TO EXISTING
- REDUCED PRESSURE ZONE BACKFLOW PREVENTER
- WATER METER
- GAS METER
- EQUIPMENT TAG: SEE EQUIPMENT SCHEDULE ON SHEET P600 FOR EQUIPMENT INFORMATION
- VALVE
- SOLENOID-OPERATED VALVE
- WALL HYDRANT/ROOF HYDRANT
- CHECK VALVE
- CIRCUIT-SETTER BALANCE VALVE RATED FOR POTABLE WATER
- FLOOR DRAIN
- FLOOR SINK
- CLEANOUT


PLUMBING ABBREVIATIONS

- AFF ABOVE FINISHED FLOOR
- AFG ABOVE FINISHED GRADE
- (E) EXISTING
- EXT'G EXISTING
- FCO FLOOR CLEANOUT
- FD FLOOR DRAIN
- FS FLOOR SINK
- GCO GRADE CLEANOUT

- CO2AS TENANT'S CO2 ALARM SUPPLIER
- GC GENERAL CONTRACTOR
- HES TENANT'S HVAC EQUIPMENT SUPPLIER
- HS TENANT'S HOOD SUPPLIER
- KES TENANT'S KITCHEN EQUIPMENT SUPPLIER
- TAB TENANT'S TEST AND BALANCE VENDOR
- TCC TENANT'S CABLING CONTRACTOR
- TDC TENANT'S DUCT CLEANER
- TEMS TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER
- TLS TENANT'S LIGHT/LAMP SUPPLIER
- TMB TENANT'S MENU BOARD SUPPLIER
- TMS TENANT'S MILLWORK SUPPLIER
- TP TENANT'S PHONE SUPPLIER
- TPS TENANT'S PANELBOARD SUPPLIER
- TRS TENANT'S RAILING SUPPLIER
- TSV TENANT'S SIGN VENDOR
- TUV TENANT'S UV SANITIZER SUPPLIER
- WCS TENANT'S WALK-IN COOLER SUPPLIER
- WHS TENANT'S WATER HEATER SUPPLIER

PLUMBING MATERIAL SCHEDULE		
CATEGORY	APPLICATION	ALLOWABLE MATERIAL
WATER SUPPLY PIPE	ABOVE GRADE	TYPE L COPPER TUBE
	CONCEALED	SCH. 40 STEEL PIPE, MALLEABLE IRON THREADED FITTINGS
PROPANE GAS PIPE	EXPOSED	SCH. 40 STEEL PIPE, MALLEABLE IRON THREADED FITTINGS, PAINTED
	ABOVE GROUND, CONCEALED	PVC PLASTIC DWV PIPE AND FITTINGS
SANITARY WASTE & VENT PIPE	ABOVE GROUND PREP SINK AND WARE WASHING SINK DRAINS	PVC PLASTIC DWV PIPE AND FITTINGS
	ABOVE GROUND HAND SINK DRAINS	BRASS WITH CHROME FINISH
	BELOW GROUND	PVC PLASTIC DWV PIPE AND FITTINGS

Consultant:

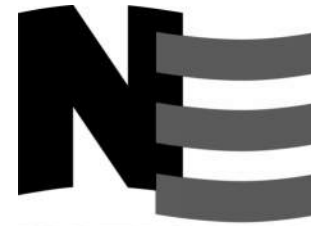

4635 Trueman Blvd. Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260

Epalma@nationalengineering.com



08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644

"CAMERON NC"

NC 24-87

CAMERON, NC 28326

Issue Record:	PERMIT SET
03/07/2025	
05/29/2025	BID SET

Revisions:	
1	08/21/2026 FINISH & DB UPDATES

Drawn:	Checked:
ECP	AJJ

Project No.
2402039

Contents:

PLUMBING SPECIFICATIONS

P010

PLUMBING FIXTURE SUPPLY CONNECTIONS


ROUGH-IN TYPE KEY											
ANGLE 3/8"		BRASS CRAFT KTR19 OR EQUAL (BRASS/CHROME 1/4 TURN ANGLED BALL STOP WITH 3/8" COMPRESSION CONNECTION)									
ANGLE 1/2"		BRASS CRAFT R39X C OR EQUAL (BRASS/CHROME MULTI-TURN ANGLED STOP WITH 1/2" COMPRESSION CONNECTION)									
ANGLE 3/4"		EVERFLOW 74342-NL W/ 3/4" SWEAT X MIP ADAPTER OR EQUAL (BRASS ANGLE STOP W/ 3/4" FIP INLET AND OUTLET)									
DIRECT		PROVIDE COPPER PIPE IN CONNECTION SIZE SHOWN TO FIXTURE									
HOSE 1/2"		ARROWHEAD BRASS WM50F OR EQUAL (BRASS/CHROME WASHING MACHINE VALVE W/ 3/4" MHT OUTLET)									
MIP		PROVIDE PIPE WITH MIP THREAD STUBBED OUT OF WALL IN CONNECTION SIZE SHOWN AND LENGTH COMPATIBLE WITH FIXTURE AND WALL MATERIAL/FINISHES.									
TAG	FIXTURE	CONNECTION SIZES		ROUGH-IN TYPE	FIXTURE UNITS (EACH)			COUNT	FIXTURE UNITS (TOTAL)		
		CW	HW		CW	HW	TOTAL		CW	HW	TOTAL
BFP-1	RPZ BACKFLOW PREVENTER	1/2"		DIRECT	1		1	1	1		1
DM-1	DISH SANITIZING MACHINE (PUMPED OUTLET)		1/2"	HOSE 1/2"	0	1	1	1	0	1	1
ET-1	EXPANSION TANK	3/4"		DIRECT	0	0	0	1	0	0	0
HB-1	HOSE BIBB	1/2"	1/2"	MIP	1.5	1.5	2	1	1.5	1.5	4
HB-2	HOSE BIBB	1/2"		MIP	1.5	0	1.5	1	1.5	0	1.5
HS-1B	RESTROOM HAND SINK FAUCET	1/2"	1/2"	ANGLE 3/8"	1.5	1.5	2	1	1.5	1.5	4
HS-2	KITCHEN HAND SINK	1/2"	1/2"	ANGLE 3/8"	1.5	1.5	2	1	1.5	1.5	8
IM-1	ICE MAKER - BOH	1/2"		HOSE 1/2"	1	0	1	1	1	0	1
IM-2	ICE MAKER - SODA	1/2"		HOSE 1/2"	1		1	1	1		1
IM-3	ICE MAKER - SODA	1/2"		HOSE 1/2"	1		1	1	1		1
MB-1B	MOP BASIN FAUCET	1/2"	1/2"	MIP	2.25	2.25	3	1	2.25	2.25	3
PF-1	POT FILLER	1/2"		MIP	1.5	0	1.5	1	1.5	0	1.5
RH-1	FREEZE PROOF ROOF HYDRANT	3/4"		DIRECT	1	0	1	1	1	0	1
SK-1	THREE COMPARTMENT SINK	1/2"	1/2"	ANGLE 1/2"	4	4	4	1	4	4	4
SK-2	PREP SINK	3/4"	3/4"	ANGLE 3/4"	3	3	4	1	3	3	4
WC-1	WATER CLOSET	1/2"		ANGLE 3/8"	5	0	5	1	5	0	10
										46	

CONNECTED GAS LOAD

FIXTURE	TAG	MBH	EQUIVALENT LENGTH FROM METER [FT]
WATER HEATER	DWH-1	199	65
WATER HEATER	DWH-2	199	65
DUAL VAT GAS FRYER	FB-1	170	90
MAKEUP AIR UNIT	MAU-1	225	70
RICE COOKER	RC-1	33	90
RANGE	RN-1	192	95
KITCHEN ROOFTOP UNIT	RTU-1	150	90
DINING ROOM ROOFTOP UNIT	RTU-2	200	65
Grand total		1368	


MAX: 95

- NOTES:
- PRESSURE REQUIRED AFTER METER: 11" W.C.
 - DISTANCES ARE APPROXIMATE
 - GC TO VERIFY NECESSARY REGULATORS AND CONVERSIONS REQUIRED TO USE PROPANE FOR ALL GAS EQUIPMENT PRIOR TO INSTALLATION

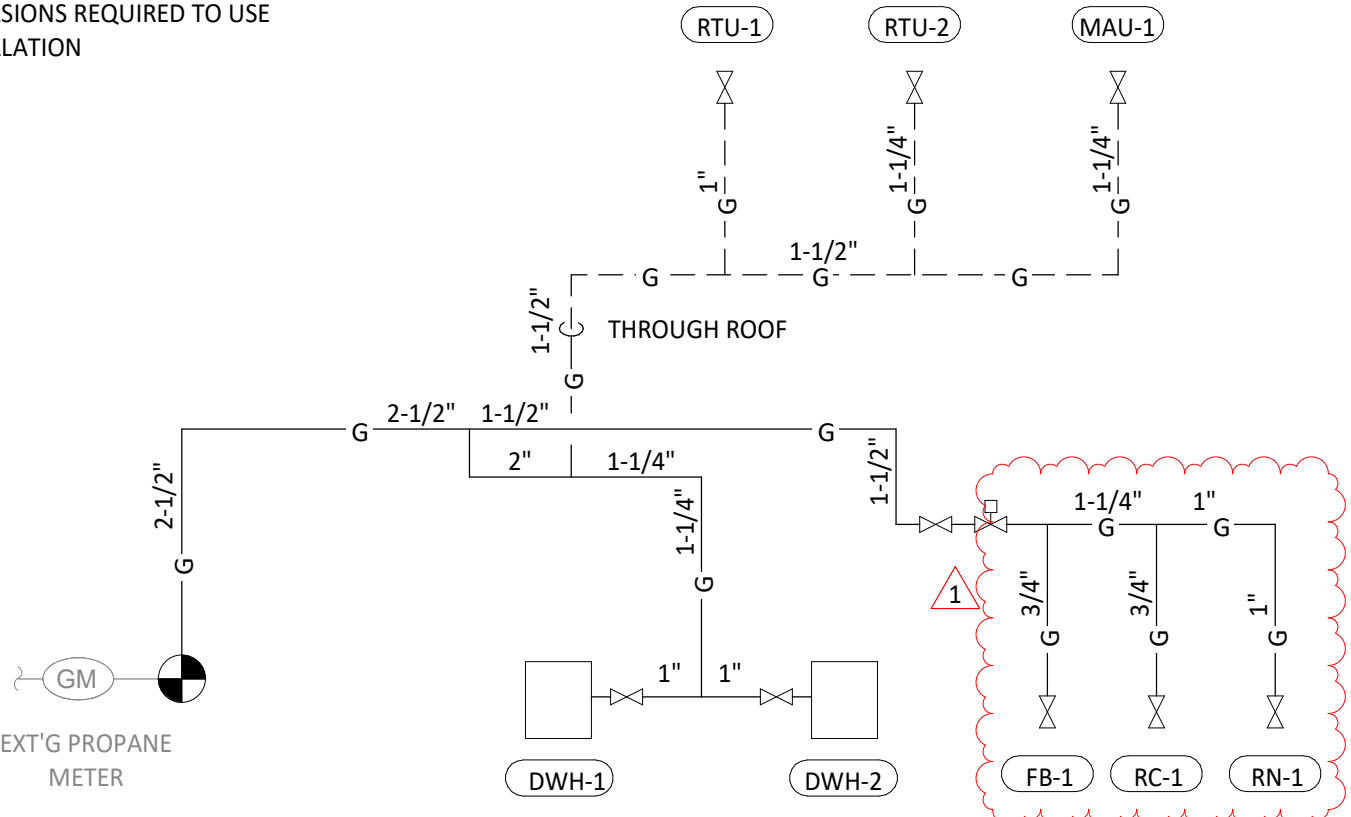

GAS DISTRIBUTION DIAGRAM

3 P100 N.T.S.

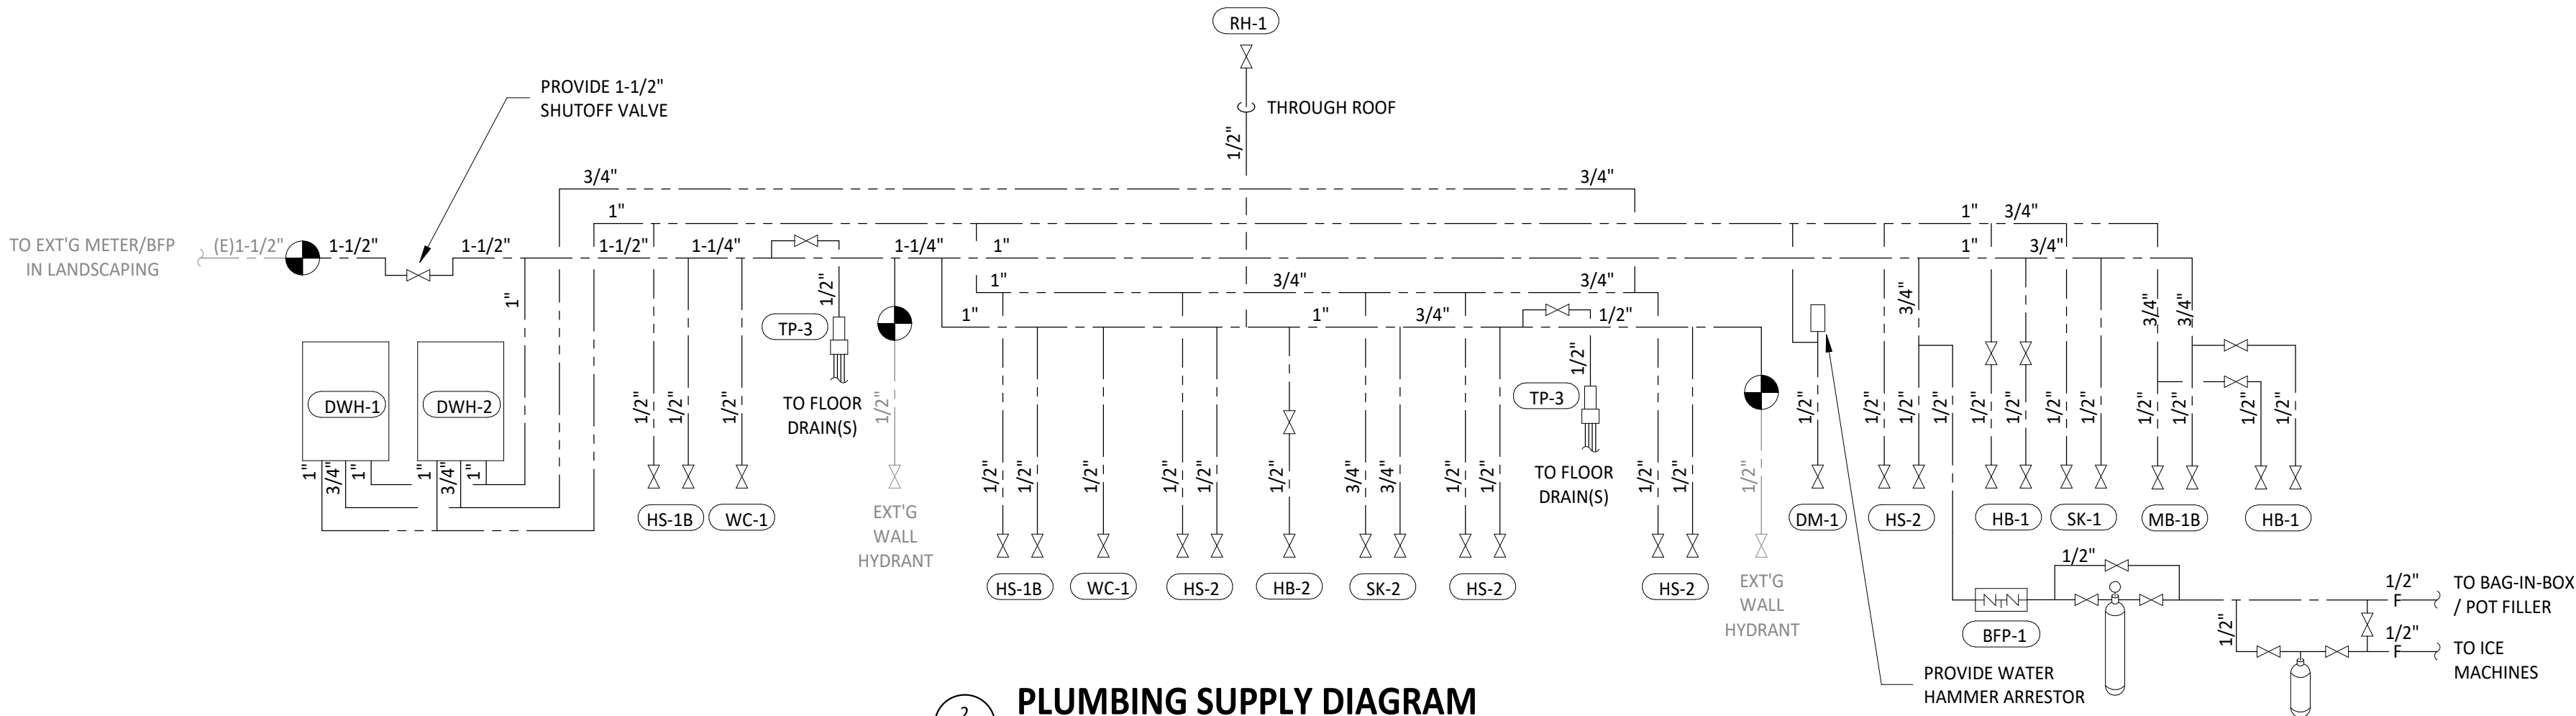


PLUMBING SUPPLY DIAGRAM

2 P100 N.T.S.

PLUMBING SUPPLY PLAN NOTES

- CONNECT TO THE EXISTING 1-1/2" DOMESTIC WATER SERVICE LEADING TO EXISTING WATER METER AND BACKFLOW PREVENTER. REFER TO CIVIL PLANS FOR THE EXACT LOCATION FOR THE WATER METER AND BACKFLOW PREVENTER.
- PROVIDE 1/2" FILTERED WATER TO THE BAG-IN-BOX SODA CARBONATOR AT 102" AFF. SODA CARBONATOR SHALL HAVE AN INTEGRAL ASSE 1022-RATED CARBONATED BEVERAGE BACKFLOW PREVENTION DEVICE.
- PROVIDE WATER HEATERS DWH-1 AND DWH-2 PER DETAIL 1/P700.
- PROVIDE WATER FILTERS MOUNTED TO WALL PER DETAIL 11/P700. PROVIDE 1/2" SUPPLY PIPES FROM FILTERS TO ICE MAKER AND SODA CARBONATOR AS SHOWN.
- PROVIDE 1/2" FILTERED WATER ROUGH-IN TO THE ICE MAKER AT 56" AFF. PROVIDE 6' LONG STAINLESS STEEL FLEXIBLE BRAIDED WASHING MACHINE WATER CONNECTOR WITH MINIMUM 0.43" ID (BRASSCRAFT SL12-72WA F OR EQUAL) FOR FINAL CONNECTION TO ICE MAKER.
- PROVIDE DOMESTIC WATER ROUGH-INS FOR THE MOP BASIN FAUCET AT 36" AFF. PROVIDE DOMESTIC WATER ROUGH-INS FOR THE CHEMICAL DISPENSER FAUCET (HB-1) AT 64" AFF DIRECTLY ABOVE THE MOP BASIN FAUCET. SEE ARCHITECTURAL ELEVATION FOR ADDITIONAL INFORMATION.
- CONNECT TO THE EXISTING PROPANE METER.
- PROVIDE GAS CONNECTIONS TO THE RICE COOKER AND RANGE PER DETAIL 7/P700.
- SUPPORT THE GAS PIPE ON THE ROOF PER DETAIL 5/P700. WOOD BLOCKING IS NOT AN ACCEPTABLE METHOD OF SUPPORTING THE GAS PIPE.
- PROVIDE ACCESSIBLE LINE-SIZED GAS VALVE, DIRT LEG, AND UNION AT GAS CONNECTION TO THE EQUIPMENT.
- REFER TO ARCHITECTURAL DRAWINGS FOR PAINTING OF INTERIOR AND EXTERIOR EXPOSED GAS PIPE.
- PROVIDE DOMESTIC WATER ROUGH-INS FOR THE CHEMICAL DISPENSER FAUCET (HB-1) AT 52" AFF. SEE ARCHITECTURAL ELEVATION FOR ADDITIONAL INFORMATION.
- PROVIDE DOMESTIC WATER ROUGH-INS FOR THE VICTORY WASH DISPENSER FAUCET (HB-2) AT 52" AFF. SEE ARCHITECTURAL ELEVATION FOR ADDITIONAL INFORMATION.
- PROVIDE RESTROOM HAND SINK WALL CARRIER IN WALL PER PLUMBING SCHEDULE. INSTALL THERMOSTATIC MIXING VALVE FURNISHED WITH HAND SINK FAUCET SECURED TO WALL BELOW HAND SINK. ALL HAND SINK PIPING AND ACCESSORIES SHALL BE FULLY CONTAINED DIRECTLY BELOW HAND SINK.
- PROVIDE KITCHEN EQUIPMENT GAS SHUTOFF 6" BELOW THE CEILING PER DETAIL 4/P700.
- CONNECT CHEMICAL DISPENSER TO HB-1. CHEMICAL DISPENSER HAS AN INTEGRAL AIR GAS AS IS SHOWN IN DETAIL 10/P700.
- PROVIDE ASSE 1016/1070 POINT-OF-USE THERMOSTATIC MIXING VALVE, WATTS LFUSG-B, ON WATER SUPPLY TO KITCHEN HAND SINKS. PROVIDE ANGLE STOP BELOW SINK, FASTEN MIXING VALVE TO WALL, AND MAKE FINAL CONNECTION FROM ANGLE STOPS TO MIXING VALVE AND FROM MIXING VALVE TO FAUCET USING BRAIDED STAINLESS STEEL HOSE. ADJUST MIXING VALVE FOR A DISCHARGE TEMPERATURE OF APPROXIMATELY 110° F.
- PROVIDE ACCESSIBLE VALVE IN WATER SUPPLY TO FIXTURE AS SHOWN.
- PROVIDE GAS CONNECTION TO THE DUAL-VAT FRYER PER DETAIL 6/P700.
- NOT USED.
- PROVIDE AN ACCESSIBLE MAIN DOMESTIC WATER SHUTOFF VALVE ABOVE LAY-IN CEILING AS SHOWN. VALVE SHALL BE 12" ABOVE THE TOP OF THE LAY-IN CEILING. PERMANENTLY INSTALL THE "WATER SHUTOFF" SIGN TO THE CEILING GRID BELOW THE VALVE.
- INSTALL RGF IMSB ICE MAKER SANITIZER FURNISHED BY TUV PER CHIPOTLE'S INSTALLATION INSTRUCTIONS.
- PROVIDE 3/4" DOMESTIC HOT AND COLD WATER ROUGH-INS FOR THE PREP SINK (SK-2) FAUCET AT 24" AFF TO ALLOW FOR THE VICTORY WASH CHEMICAL DOCK TO BE INSTALLED DIRECTLY BELOW THE PREP SINK BASIN. MAKE FINAL CONNECTION TO PREP SINK FAUCET USING 3/4" BRAIDED STAINLESS STEEL WATER HEATER CONNECTOR HOSE.
- PROVIDE 1/2" HOT WATER TO THE DISH MACHINE AT 66" AFF ABOVE LEFT SIDE OF DISH MACHINE, MAKING FINAL CONNECTION USING HOSE FURNISHED WITH DISH MACHINE. PROVIDE WATER HAMMER ARRESTOR ON HOT WATER LINE.
- PROVIDE ROOF HYDRANT RH-1 WITH BOTTOM OF NOZZLE INSTALLED 24" ABOVE THE BOTTOM OF ROOF DECK. PROVIDE ACCESSIBLE ISOLATION VALVE IN WATER SUPPLY TO ROOF HYDRANT. SUPPORT ROOF HYDRANT PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- PROVIDE FILTERED DOMESTIC WATER ROUGH-IN FOR THE SPEED FILL POT FILLER FAUCET (PF-1) AT 42" AFF. SEE ARCHITECTURAL ELEVATION FOR DETAIL.
- PROVIDE 1/2" FILTERED WATER ROUGH-IN TO THE ICE MAKER AT 24" AFF. PROVIDE 6' LONG STAINLESS STEEL FLEXIBLE BRAIDED WASHING MACHINE WATER CONNECTOR WITH MINIMUM 0.43" ID (BRASSCRAFT SL12-72WA F OR EQUAL) FOR FINAL CONNECTION TO ICE MAKER.
- INSTALL RGF IMSB ICE MAKER SANITIZER FURNISHED BY TUV PER CHIPOTLE'S INSTALLATION INSTRUCTIONS. LOCATE IMSB BELOW UTENSIL COUNTER IN A LOCATION THAT DOES NOT INTERFERE WITH THE ROLLING RACK BELOW THE UTENSIL COUNTER.
- PROVIDE ACCESSIBLE TRAP PRIMER ABOVE LAY-IN CEILING AS SHOWN. INSTALL PER MANUFACTURER'S INSTALLATION INSTRUCTIONS WITH A SERVICE VALVE AT THE TRAP PRIMER INLET. PROVIDE 1/2" DISTRIBUTION PIPE(S) TO FLOOR DRAIN TRAP PRIMER CONNECTION(S) AS SHOWN. HORIZONTAL DISTRIBUTION PIPING SHALL HAVE CONTINUOUS SLOPE TO THE FLOOR DRAIN(S).
- REPLACE STOCK WATER CLOSET HANDLE WITH UNIVERSAL CABLE-OPERATED HANDLE (FLUSHMATE AP300503 OR AP300504 - FIELD VERIFY COMPATIBILITY WITH FLUSHMATE SYSTEM IN WATER CLOSET).
- CONNECT TO EXISTING WALL HYDRANT AS SHOWN.

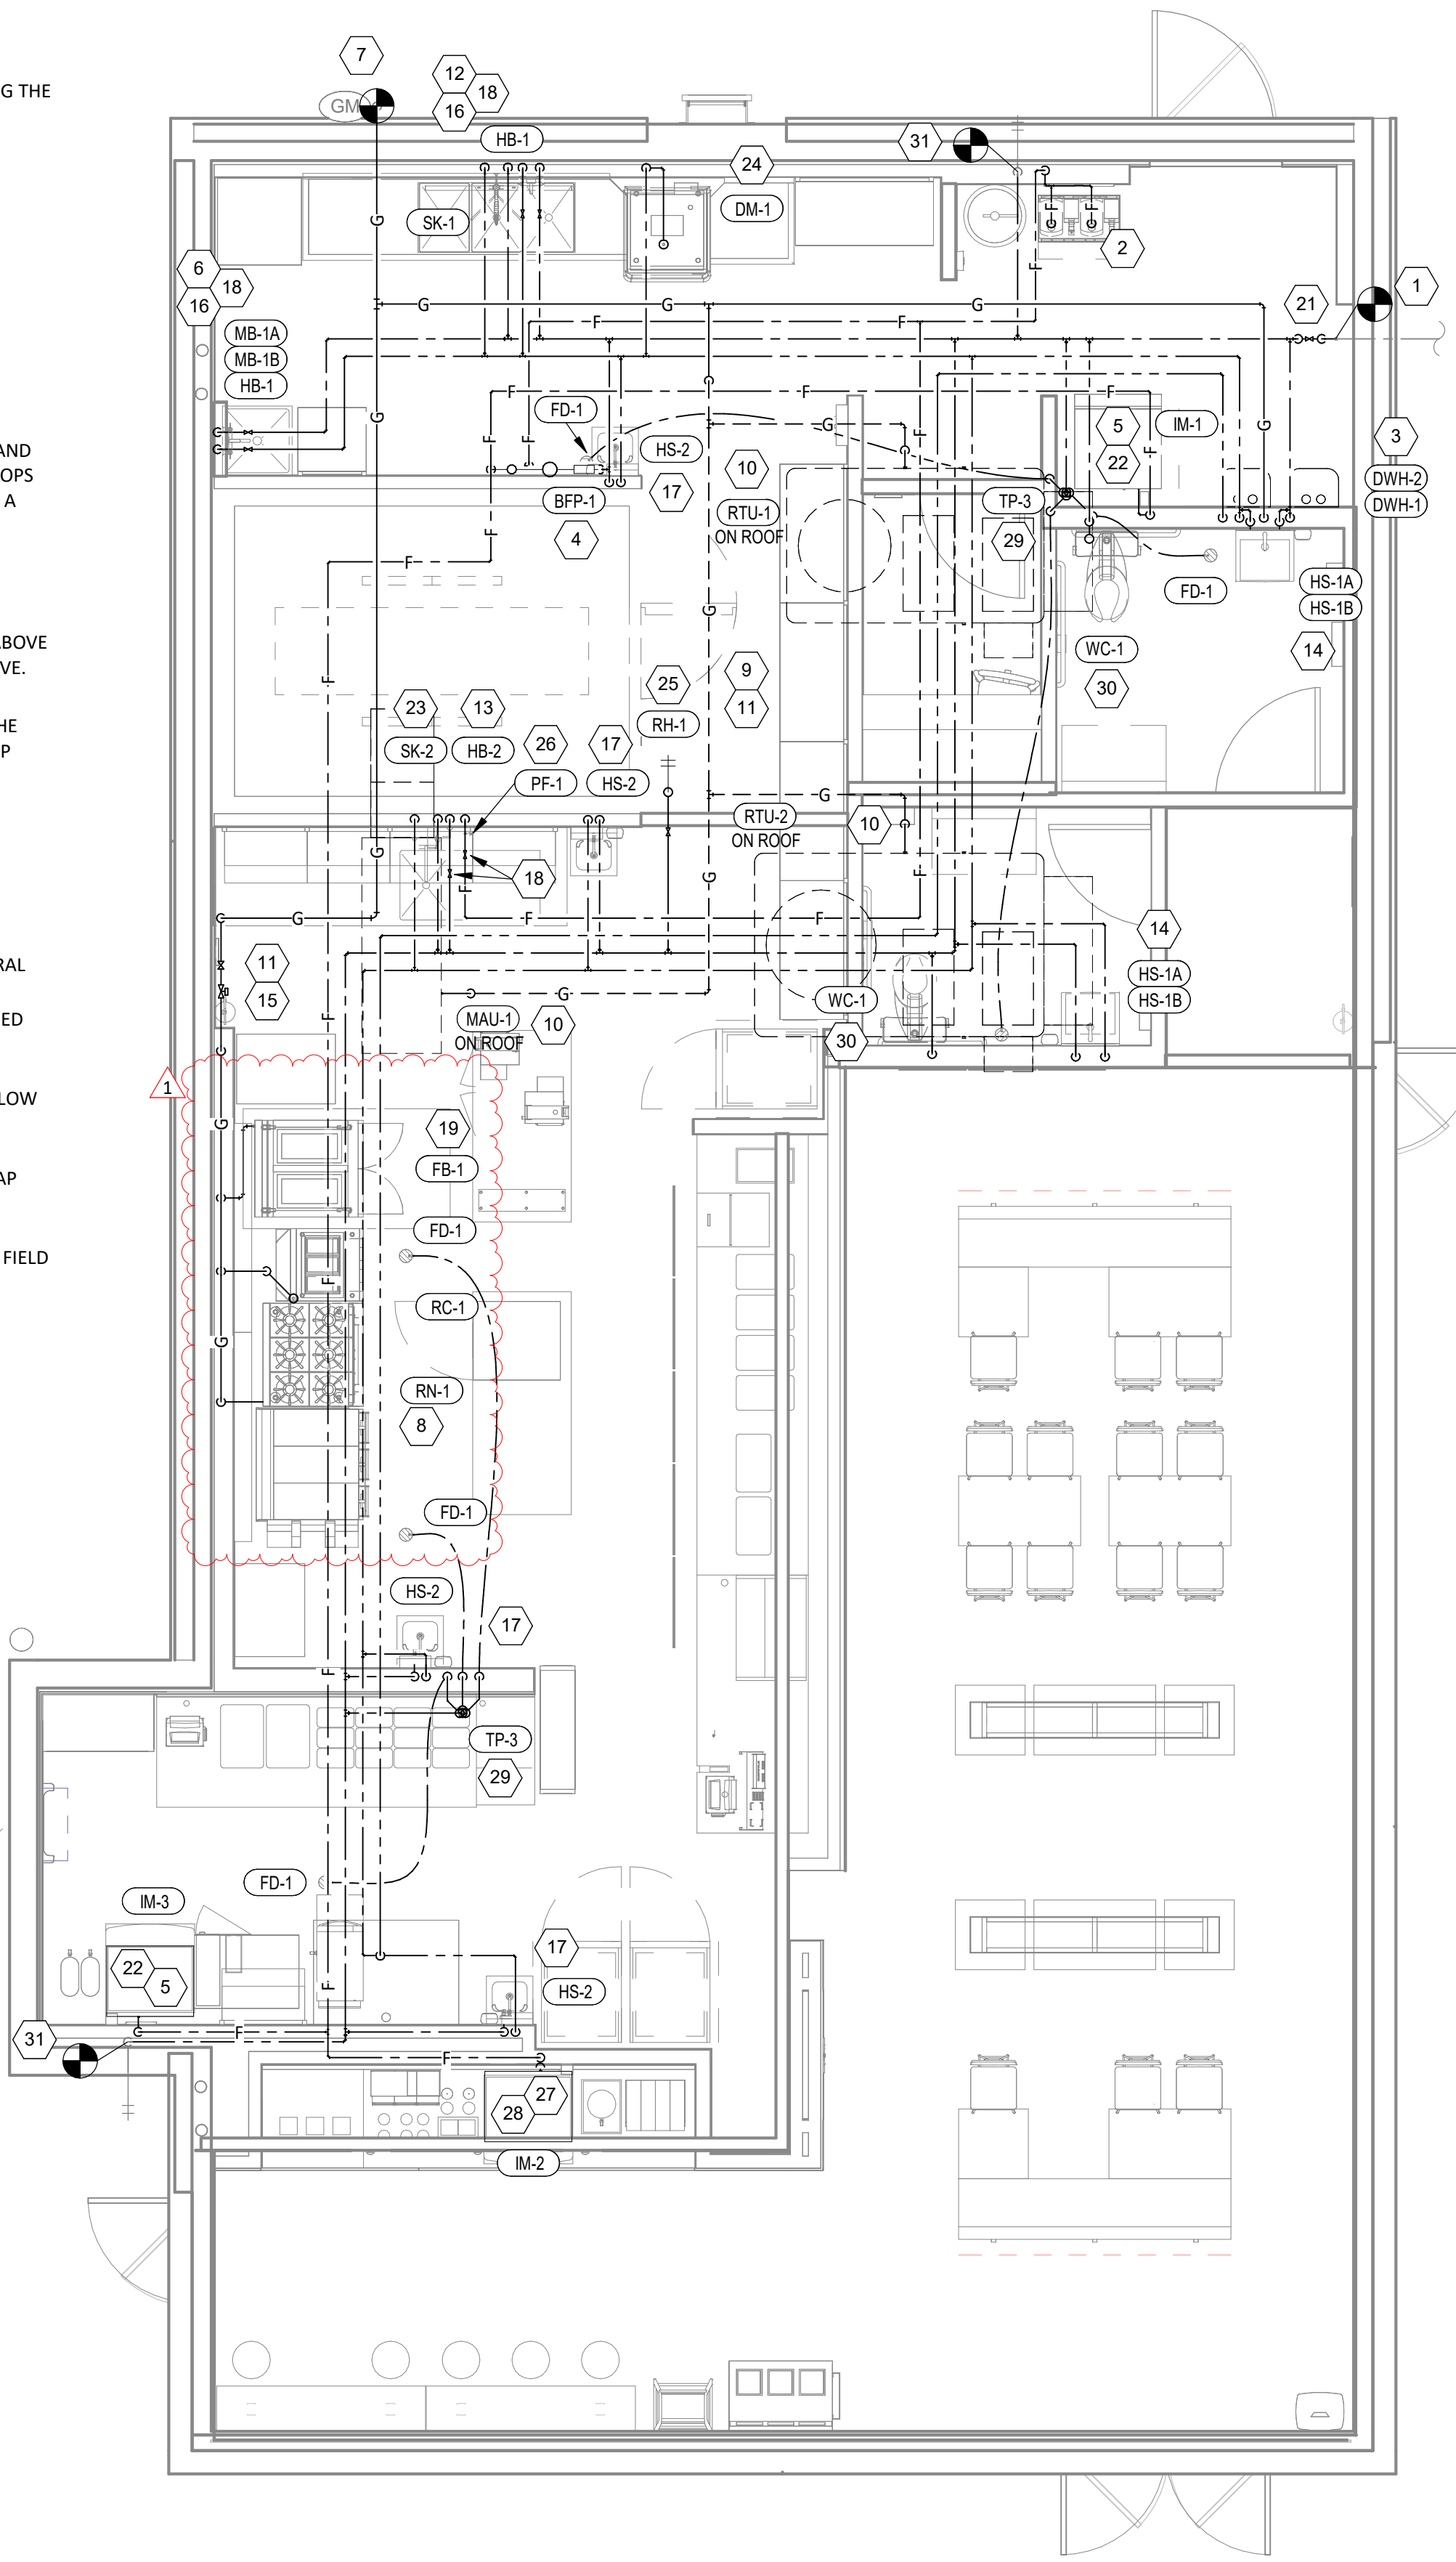


PLUMBING SUPPLY PLAN

1 P100 1/4" = 1'-0"

Consultant:



4635 Trueman Blvd, Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma (720) 940-0260
Epalma@nationalengineering.com

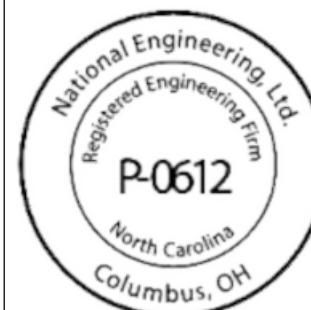

08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644

"CAMERON NC"

NC 24-87

CAMERON, NC 28326

Issue Record:

03/07/2025 PERMIT SET
05/29/2025 BID SET

Revisions:

1 08/21/2026 FINISH & DB UPDATES

Drawn:

EEP

Checked:

AJJ

Project No.

2402039

Contents:

PLUMBING PLAN
WATER & GAS

P100

- 1 PROVIDE 3/4" CONDENSATE DRAIN FROM THE WALK-IN COOLER EVAPORATOR TO THE MOP SINK AS SHOWN. SLOPE CONDENSATE DRAIN A MINIMUM OF 1" PER FOOT. HOLD EXPOSED CONDENSATE DRAIN IN WALK-IN COOLER AS HIGH AS POSSIBLE. CONCEAL DRAIN PIPING WITHIN FRAMED WALLS AS SHOWN. DISCHARGE THROUGH AN AIR GAP. MAKE FINAL CONNECTION TO EVAPORATOR INSIDE WALK-IN COOLER USING A UNION. CONDENSATE DRAIN SHOULD PENETRATE WALL AT 8" AFF AND BE SECURED TO FLOOR.
- 2 PROVIDE DRAIN CONNECTIONS TO THE THREE COMPARTMENT SINK PER DETAIL 2/P700.
- 3 COORDINATE ROUTING OF SODA BUNDLES WITH COCA-COLA TECHNICIAN FROM BAG-IN-BOX AREA TO EACH SODA FOUNTAIN. OTHER THAN WITHIN THE WALLS DOWN TO THE DRYER BOX THE SODA BUNDLE SHALL BE ROUTED OVERHEAD WITHOUT CONDUIT. COORDINATE SUPPORT AND ROUTING OF THE SODA LINE BUNDLES WITH COCA-COLA TECHNICIAN DURING ROUGH IN AND PROVIDE NECESSARY SUPPORTS. SEE ARCHITECTURAL DRAWINGS FOR SODA BUNDLE TERMINATION LOCATION AND PROVIDE TERMINATION PER DETAIL 12/P700.
- 4 PROVIDE PVC DRAIN PIPES FROM THE ICE MACHINE TO THE FLOOR SINK PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. PROVIDE A CODE-APPROVED AIR GAP AT THE DISCHARGE TO THE FLOOR SINK. SECURE ICE MAKER DRAIN PIPES TO THE BOTTOM OF THE ICE MAKER.
- 5 PROVIDE DRAIN LINES FROM THE FOOD PREP SINK TO THE FLOOR SINK. PROVIDE AN AIR GAP AT THE DISCHARGE TO THE FLOOR SINK.
- 6 PROVIDE A 3" VENT THROUGH THE ROOF PER DETAIL 3/P700.
- 7 CONNECT TO THE EXISTING 4" GREASE WASTE LINE LEADING TO EXISTING DEDICATED 1,500 GALLON GREASE INTERCEPTOR.
- 8 CONNECT TO THE EXISTING 4" SANITARY SEWER LINE.
- 9 PROVIDE 3/4" VALVED DRAIN FROM HOT FOOD TABLE TO THE FLOOR SINK. DRAIN THROUGH AN AIR GAP.
- 10 PROVIDE INSULATED COPPER DRAIN LINES FROM THE TEA TRAY DRAIN AND THE ICE MAKER DRAIN TO THE FLOOR SINK. DRAIN THROUGH AN AIR GAP. HOLD DRAIN AS HIGH AS POSSIBLE AND SECURE TO STRUCTURE BELOW THE UTENSIL COUNTER.
- 11 TRIM TRENCH DRAIN ENDS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS PRIOR TO INSTALLATION SO THAT GRATE FITS WITHOUT GAPS. INSTALL TRENCH DRAIN WITH SLIGHT POSITIVE SLOPE TOWARD THE DRAIN CONNECTION TO AVOID STANDING WATER IN TRENCH DRAIN.
- 12 DO NOT PROVIDE WALL CLEANOUTS ON TILE OR PUBLICLY-VISIBLE WALLS. IF A WALL CLEANOUT IS REQUIRED ON THESE SURFACE COORDINATE THE EXACT LOCATION WITH CHIPLET'S CONSTRUCTION MANAGER.
- 13 PROVIDE INDIRECT WASTE AND CONDENSATE DRAINS FROM FIXTURES OTHER THAN KITCHEN SINKS CONCEALED IN THE WALL AS SHOWN IN DETAIL 9/P700.
- 14 PROVIDE DRAIN FROM WATER FILTER BFP TO FLOOR DRAIN CONCEALED IN THE WALL AS SHOWN IN DETAIL 9/P700.
- 15 PROVIDE TRENCH DRAIN AS SHOWN IN DETAIL 15/P700.
- 16 INSTALL DRAIN HOSE FURNISHED WITH DISH MACHINE FROM DISH MACHINE OUTLET TO FLOOR SINK. HOLD DRAIN HOSE TIGHT TO WALL AND SECURE TO 3-COMP SINK DRAIN TO MAINTAIN AN AIR GAP AT THE FLOOR SINK.
- 17 PROVIDE CONDENSATE TRAP ON RTU PER DETAIL 13/P700.
- 18 PROVIDE 3/4" PVC DRAIN PIPE FROM THE ICE MACHINE TO THE FLOOR SINK PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. PROVIDE A CODE-APPROVED AIR GAP AT THE DISCHARGE TO THE FLOOR SINK.
- 19 PROVIDE PVC DRAIN LINES FROM TEA TRAY AND ICE MAKER TO FLOOR SINK. DRAIN THROUGH AN AIR GAP. COORDINATE PIPE ROUTING WITH EQUIPMENT BEFORE COLD-SIDE TABLE.




P110

PLUMBING FIXTURE SCHEDULE																		
TAG	FIXTURE	FURNISHED BY	INSTALLED BY	MANUFACTURER	MODEL	DESCRIPTION	QUANTITY	CONNECTION SIZES			FIXTURE UNITS (EACH)				FIXTURE UNITS (TOTAL)			
								CW	HW	WASTE	CW	HW	TOTAL	SAN	CW	HW	TOTAL	SAN
BFP-1	RPZ BACKFLOW PREVENTER	GC	GC	CONBRACO	4ALF-203-T2F	LEAD FREE REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTER WITH AUTOMATIC DIFFERENTIAL RELIEF VALVE	1	1/2"			1		1		1	0	1	0
DM-1	DISH SANITIZING MACHINE (PUMPED OUTLET)	KES	GC	FURNISHED BY KES	--	CHEMICAL SANITIZING DISH MACHINE WITH INTEGRAL ELECTRIC BOOSTER HEATER AND PUMPED OUTLET	1		1/2"	3/4"	0	1	1	0	0	1	1	0
ET-1	EXPANSION TANK	GC	GC	AMTROL	ST-5	2 GALLON CAPACITY	1	3/4"			0	0	0	0	0	0	0	0
FCO-1	FLOOR CLEANOUT (4")	GC	GC	SIoux CHIEF	852-4PNR	ON-GRADE ADJUSTABLE CLEANOUT WITH INTERNAL THREADED CLEANOUT PLUG AND ROUND NICKEL-BRONZE RING AND COVER (OR APPROVED EQUAL WITH INTERNAL THREADED CLEANOUT PLUG)	6			4"				0	0	0	0	0
FD-1	FLOOR DRAIN	GC	GC	SIoux CHIEF	842-2-PNR	ADJUSTABLE FLOOR DRAIN, ROUND POLISHED METAL RING AND STRAINER	6			2"			0	2	0	0	0	12
FS-1	FLOOR SINK	GC	GC	SIoux CHIEF	861-3PU2	HEAVY DUTY PVC FLOOR SINK WITH ALUMINUM DOME BOTTOM STRAINER AND OPEN HALF PVC GRATE	8			3"			0	5	0	0	0	40
HB-1	HOSE BIBB	KES	GC	T&S	B-2345-01-XX	COMMERCIAL QUALITY HOT & COLD MIXING WALL HYDRANT. SUPPLY ARMS SHALL HAVE INTEGRAL SHUT-OFF STOP AND CHECK VALVE.	2	1/2"	1/2"		1.5	1.5	2	0	3	3	4	0
HB-2	HOSE BIBB	KES	GC	T&S	B-0730	SILL FAUCET WITH 1/2" NPT FEMALE INLET AND 3/4" GARDEN HOSE THREADED OUTLET.	1	1/2"			1.5	0	1.5	0	1.5	0	1.5	0
HS-1A	RESTROOM HAND SINK	GC	GC	AMERICAN STANDARD	9024.001EC	ADA-ACCESSIBLE, WALL-MOUNTED, PORCELAIN LAVATORY. PROVIDE ZURN Z1231 (Z1231-D FOR BACK-TO-BACK APPLICATIONS) CONCEALED ARM CARRIER IN WALL. APPROVED ALTERNATE: KOHLER K-2084	2	0"	0"	2"	0	0	0	1	0	0	0	2
HS-1B	RESTROOM HAND SINK FAUCET	KES	GC	FURNISHED BY KES	--	METERED FAUCET WITH 0.5 GPM AERATOR AND FURNISHED WITH THERMOSTATIC MIXING VALVE. ADJUST FAUCET FOR 30 SECOND RUN TIME.	2	1/2"	1/2"	0"	1.5	1.5	2	0	3	3	4	0
HS-2	KITCHEN HAND SINK	KES	GC	FURNISHED BY KES	--	STAINLESS STEEL SINK WITH WALL MOUNTING BRACKET AND BACKSPASH MOUNTED FAUCET WITH SWIVEL GOOSENECK	4	1/2"	1/2"	2"	1.5	1.5	2	1	6	6	8	4
IM-1	ICE MAKER - BOH	KES	GC	SEE ARCH	--	BACK OF HOUSE ICE MAKER WITH BIN (STANDARD CAPACITY REMOTE AIR COOLED)	1	1/2"			1	0	1	0	1	0	1	0
IM-2	ICE MAKER - SODA	KES	KES	SEE ARCH	--	SODA MACHINE-MOUNTED ICE MAKER (INTEGRAL AIR COOLED)	1	1/2"			1		1		1	0	1	0
IM-3	ICE MAKER - SODA	KES	KES	SEE ARCH	--	SODA MACHINE-MOUNTED ICE MAKER (REMOTE AIR COOLED)	1	1/2"			1		1		1	0	1	0
MB-1A	MOP BASIN	GC	GC	FIAT	MSB2424	PROVIDE 24"x24"x10" MOLDED-STONE MOP BASIN. INSTALL MOP BASIN IN A BED OF GROUT SO THERE ARE NO VOIDS BETWEEN THE MOP BASIN AND THE SLAB.	1	0"	0"	3"	0	0	0	3	0	0	0	3
MB-1B	MOP BASIN FAUCET	KES	GC	FURNISHED BY KES	--	SERVICE SINK FAUCET WITH BUILT IN STOPS, LEVER HANDLES, AND WALL BRACE.	1	1/2"	1/2"	0"	2.25	2.25	3	0	2.25	2.25	3	0
PF-1	POT FILLER	KES	GC	FURNISHED BY KES	--	WALL-MOUNTED POT FILLER W/ SELF-CLOSING FILLER VALVE AND 3/8" NPT FEMALE INLET	1	1/2"			1.5	0	1.5		1.5	0	1.5	0
RH-1	FREEZE PROOF ROOF HYDRANT	GC	GC	HOEPTNER	2131R	AUTOMATIC DRAINING, FREEZELESS ROOF HYDRANT WITH ANTI-SIPHON VACUUM BREAKER HOEPTNER PRODUCTS (408) 847-7615	1	3/4"			1	0	1		1	0	1	0
SK-1	THREE COMPARTMENT SINK	KES	GC	FURNISHED BY KES	--	THREE-COMPARTMENT WARE-WASHING SINK FURNISHED WITH (1) PRE-RINSE UNIT WITH ADD-ON FAUCET	1	1/2"	1/2"	2"	4	4	4	5	4	4	4	5
SK-2	PREP SINK	KES	GC	FURNISHED BY KES	--	STAINLESS STEEL PREP TABLE WITH INTEGRAL PREP SINK. FURNISHED WITH "BIG FLO" FAUCET	1	3/4"	3/4"	2"	3	3	4	0	3	3	4	0
TD-1	TRENCH DRAIN	GC	GC	ZURN	Z886 8601 8602	6" X 160" HDPE TRENCH DRAIN (SLOPED FROM 3.50" TO 4.70") WITH (2) CLOSED END CAPS, (1) 4" NO-HUB BOTTOM OUTLET, AND CLASS-A HEEL-PROOF POLYETHYLENE GRATES. SEE DETAIL 12/P700 FOR REDUCTION TO 2" DRAIN CONNECTION.	1			2"	0	0	0	2	0	0	0	2
TP-3	TRAP PRIMER (THREE-FOUR FLOOR DRAINS)	GC	GC	PRECISION PLUMBING PRODUCTS	P1-500 W/ DU-U	TRAP PRIMER WITH INTEGRAL VACUUM BREAKER AND DISTRIBUTION UNIT. CAP UNUSED DISTRIBUTION UNIT OUTLETS.	2	1/2"			0		0		0	0	0	0
WC-1	WATER CLOSET	GC	GC	KOHLER	K-3519 W/ SEAT K-4666-C	WHITE HIGHLINE 1.0 GPF, 17-1/8"-HIGH, ADA ACCESSIBLE, PRESSURE ASSIST WATER CLOSET WITH OPEN-FRONT SEAT. INSTALL TRIP LEVER ON THE TANK TO THE OPEN SIDE OF THE STALL (ADD -RA TO THE MODEL # FOR RIGHT HAND TRIP LEVER).	2	1/2"		3"	5	0	5	4	10	0	10	8
							48								39.25	22.25	46	76

WATER HEATER SCHEDULE - INSTANTANEOUS								
TAG	DESCRIPTION	FURNISHED BY	INSTALLED BY	MANUFACTURER	MODEL	INPUT MBH	DELIVERY	NOTES
DWH-1	DIRECT VENT GAS-FIRED INSTANTANEOUS WATER HEATER	GC	GC	NAVIENT	NPE-240A2	199	354 GPH @ 65" RISE	RATED FLOW RATE: 5.6 GPM @ 67°F RISE THERMAL EFFICIENCY: 96% PROVIDE WITH LEAD FREE "PLUMB EASY VALVE SET". GC SHALL PURCHASE WATER HEATER DIRECTLY THROUGH A NAVIENT AUTHORIZED DISTRIBUTOR (1-800-519-8794 OR WWW.NAVIENT.COM TO LOCATE AUTHORIZED DISTRIBUTOR). GC TO FURNISH AND FIELD INSTALL PROPANE CONVERSION KIT.
DWH-2	DIRECT VENT GAS-FIRED INSTANTANEOUS WATER HEATER	GC	GC	NAVIENT	NPE-240A2	199	354 GPH @ 65" RISE	RATED FLOW RATE: 5.6 GPM @ 67°F RISE THERMAL EFFICIENCY: 96% PROVIDE WITH LEAD FREE "PLUMB EASY VALVE SET". GC SHALL PURCHASE WATER HEATER DIRECTLY THROUGH A NAVIENT AUTHORIZED DISTRIBUTOR (1-800-519-8794 OR WWW.NAVIENT.COM TO LOCATE AUTHORIZED DISTRIBUTOR). GC TO FURNISH AND FIELD INSTALL PROPANE CONVERSION KIT.

Consultant:

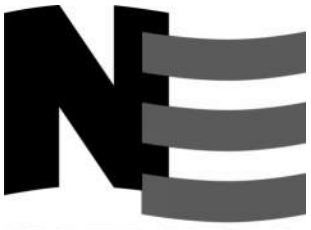

4635 Trueman Blvd. Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com



08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644

"CAMERON NC"
NC 24-87
CAMERON, NC 28326





Issue Record:		PERMIT SET	
03/07/2025	05/29/2025	BID SET	

Drawn: EEP Checked: AJJ

Project No.
2402039

Contents:
PLUMBING
SCHEDULES

P600

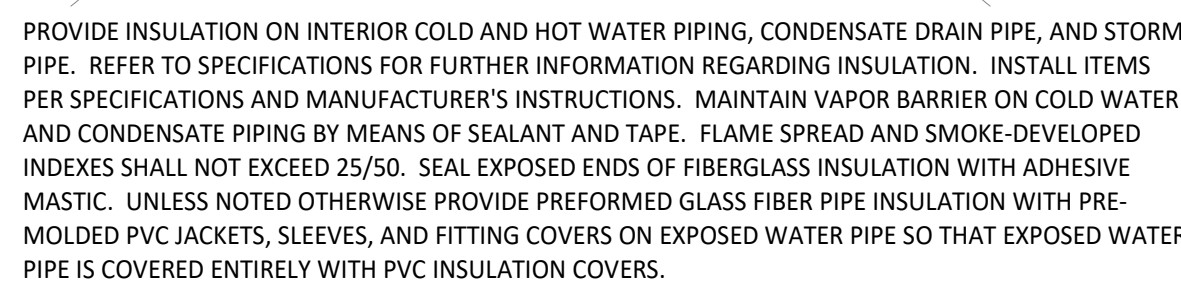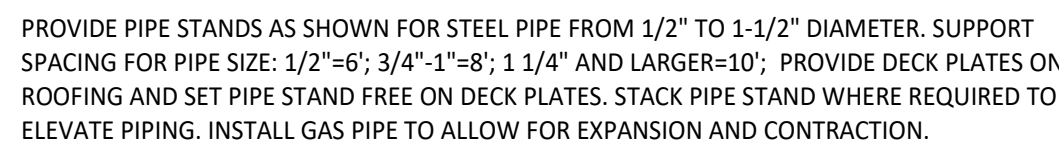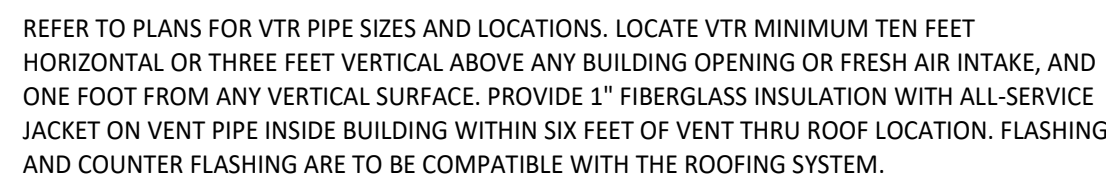
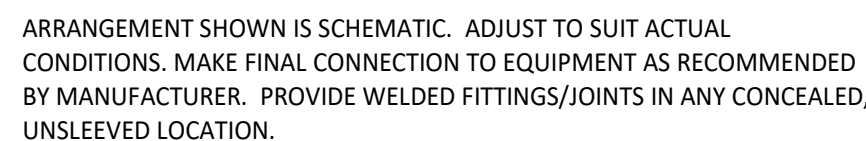


WATER HEATER DETAIL NOTES

1. PROVIDE TWO 90° ELBOWS AND A SCREEN FOR THE FLUE TERMINATION THROUGH THE ROOF PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
2. ROUGH-IN COLD, HOT, AND RECIPE PIPES AT 64" AND GAS PIPE AT 61" BELOW THE FINISHED CEILING.
3. PROVIDE EXPANSION TANK ET-1 AS SHOWN. SUPPORT TANK FROM WALL OR STRUCTURE ABOVE.
4. PROVIDE WATER HEATER RECEPTACLE WITHIN 12" OF THE FINISHED CEILING. FASTEN CORD TIGHT TO THE WALL.
5. PROVIDE PRESSURE RELIEF VALVE. PIPE PRESSURE RELIEF VALVE TO POINT OF DISCHARGE.
6. CONCEAL WATER PIPING WITHIN THE WALL AS SHOWN. INSULATE CONCEALED WATER PIPING. DO NOT PROVIDE INSULATION ON EXPOSED WATER PIPING AT WATER HEATER.
7. INSTALL "PLUMB EASY VALVE SET" EXPOSED AT THE COLD AND HOT WATER CONNECTIONS TO THE WATER HEATER AS SHOWN.
8. IF THE PIPE SIZES AS SHOWN ON THE PLUMBING PLANS IS LARGER THAN THE WATER HEATER CONNECTIONS SIZES, PROVIDE REDUCERS WITHIN 6" OF THE WATER HEATER.
9. PIPE PRESSURE RELIEF VALVE DISCHARGE AND FLUE CONDENSATE DRAIN TO THE POINT OF DISCHARGE. DRAIN THROUGH AN AIR GAP.
10. PROVIDE AN EXPOSED DRIP LEG AND LINE-SIZE GAS VALVE ON THE GAS SERVICE TO THE WATER HEATER.
11. CONCEAL GAS PIPING IN THE WALL AS SHOWN.
12. PROVIDE 1/2" PVC PIPE FROM THE FLUE CONDENSATE CONNECTION TO THE FLOOR DRAIN OR MOP BASIN. DRAIN THROUGH AN AIR GAP.
13. INSTALL THE TANKLESS WATER HEATER WITH THE TOP OF THE WATER HEATER BETWEEN 9" & 12" OF THE FINISHED CEILING.
14. PROVIDE A 2"Ø PVC PIPE FROM THE TANKLESS WATER HEATER TO THE POINT OF DISCHARGE. SLOPE HORIZONTAL SECTION OF THE FLUE 1/4" PER FOOT TOWARDS THE WATER HEATER.
15. PROVIDE A SCREENED AIR INTAKE WITH TWO 90° ELBOWS ABOVE THE ROOF PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
16. CONCEAL DRAIN LINES IN WALL PER DETAIL 9/THIS SHEET.
17. PROVIDE COMMUNICATION CABLE CONCEALED IN WALL BETWEEN WATER HEATERS.
18. IF WATER HEATERS ARE INSTALLED WITH A COMMON VENT SYSTEM THEN PROVIDE THE NAVEN COMMON VENT COLLAR KIT WITH BACK-DRAFT DAMPER PER THE MANUFACTURER'S INSTALLATION MANUAL.

WATER HEATER GENERAL NOTES

- A. CLEAN INLET STRAINERS AFTER CONSTRUCTION HAS COMPLETED AND PRIOR TO TURNOVER OF THE BUILDING TO THE TENANT.
- B. INSTALL PIPING WITH AS FEW ELBOWS AS POSSIBLE.
- C. MAINTAIN REQUIRED CLEARANCE TO COMBUSTIBLE MATERIALS.
- D. ADJUST WATER HEATER TO A SETPOINT OF 120° F.

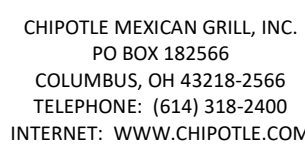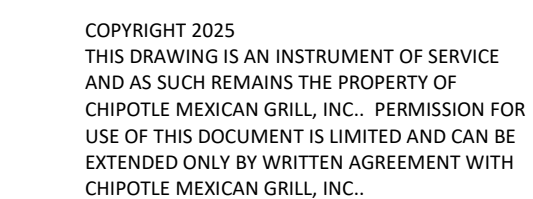

STORE NO.: 5644

"CAMERON NC"

NC 24-87
CAMERON, NC 28326

[illegible]

PLUMBING DETAILS

P700

LIGHTING FIXTURE SCHEDULE

TAG	QUANTITY	TYPE	MOUNT	FURNISHED BY	INSTALLED BY	MANUFACTURER	MODEL	LAMP(S)	VOLTS	WATTS	SPECIAL REQUIREMENTS
A1	9	2x2 LED LENSED TROFFER	LAY-IN	TLS	GC	NORA LIGHTING	NPDBL-E22/334 W	(1) 3000K LED	120	30	COMPATIBLE WITH 0-10V DIMMING, FACTORY LOCKED TO 3000K
B1	7	RECESSED 6IN CAN LIGHT	CEILING	TLS	GC	NORA LIGHTING	NHIC-6G24ATFL with NTM-57W/M1 Trim	(1) 17W ECOSTORY ECO-PAR38C-17-GU24-27K-250 LED (25"-2700K) W/ GU 24 BASE	120	17	
B2	34	RECESSED 6IN CAN LIGHT W/ LED TRIM	CEILING	TLS	GC	NORA LIGHTING	NHIC-6G24ATFL WITH NLCBC-65130WW LED TRIM	INTEGRAL 3000K LED	120	17	LED TRIM FURNISHED WITH GU24 SOCKET ADAPTER
B3	4	RECESSED 6IN CAN LIGHT W/ BLACK LED TRIM	CEILING	TLS	GC	NORA LIGHTING	NHIC-6G24ATFL WITH NLCBC2-651278B LED TRIM	INTEGRAL 3000K LED	120	12	BLACK LED TRIM FURNISHED WITH GU24 SOCKET ADAPTER
C0	2	LOW PROFILE LED - 1 FT	SURFACE	TLS	GC	HERA LIGHTING	EL/LED/12/WW	INTEGRAL 3000K LED	120	5	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
C2	3	LOW PROFILE LED - 3 FT	SURFACE	TLS	GC	HERA LIGHTING	EL/LED/34/WW	INTEGRAL 3000K LED	120	12	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
C3	6	LOW PROFILE LED - 4 FT	SURFACE	TLS	GC	HERA LIGHTING	EL/LED/46/WW	INTEGRAL 3000K LED	120	15	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
E1	3	EMERGENCY LIGHT - DUAL HEAD	VARIOUS	TLS	GC	EXITRONIX	LED-90	(2) SPECIAL LED	120	2	90 MINUTE BATTERY BACKUP
E2	4	EXTERIOR REMOTE EMERGENCY LIGHT	VARIOUS	EXT'G	EXT'G	EXITRONIX	MLED1-B-WP	(1) SPECIAL LED	4	1	LOW VOLTAGE REMOTE EMERGENCY LIGHT POWERED BY REMOTE-CAPABLE EXIT SIGN WITH MOUNTING PLATE
E4	4	WHITE EXIT SIGN WITH EMERGENCY LIGHT - STANDARD RED LETTERS	VARIOUS	EXT'G	EXT'G	EXITRONIX	CLED-U-WH	(1) SPECIAL LED	120	2	90 MINUTE BATTERY BACKUP WITH INTEGRAL EMERGENCY LIGHT, REMOTE HEAD CAPABLE
E7	10	EMERGENCY LIGHT	VARIOUS	TLS	GC	DUAL-LITE	EV2	(2) 1W INTEGRAL LED	120	1	90 MINUTE BATTERY BACKUP
H1	8	HOOD LIGHT	SURFACE	THS/TLS	THS	VAPOR PROOF LIGHT FIXTURE FURNISHED WITH HOOD	FURNISHED WITH HOOD	(1) TCP L16A19N1527K	120	23	INSTALL LAMP FURNISHED SEPARATELY BY LIGHTING SUPPLIER
J4	2	DECORATIVE PENDANT	SURFACE	TLS	GC	BARNLIGHT	BLE-C-BRN-100-ASH-SB-K-1-00-NA-GU24	GREEN CREATIVE 9A19DIM/927/GU24/R	120	9	WITH BLACK LAMP SHADE, BLACK CORD, AND OAK LAMP HOLDER
L2-4	14	LINEAR INDIRECT	SUSPENDED	TLS	GC	FINELITE	E1-L-4'-S-830-TG-120V-SC-FA-FE-C4	INTEGRAL LED	120	8	WITH STANDARD OUTPUT, 80 CRI 3000K LED, SINGLE CIRCUIT, AND HARD CEILING MOUNTING
P5	2	PENDANT	SURFACE	TLS	GC	HI-LITE MFG	H-LC-91/CB12-91/20W LBL	TCP FG25D4027CCQ	120	5	ADJUST CORD LENGTH FOR MOUNTING HEIGHT CALLED FOR IN ARCHITECTURAL DRAWINGS
P6	1	DECORATIVE DINING ROOM PENDANT	SURFACE	TLS	GC	BARN LIGHT	BLE-C-JGT-133-35630-3	INTEGRAL LED	120	30	HARDWIRED SET OF (3) HEADS WITH UNIVERSAL CANOPY AND STANDARD BLACK CABLES
S1	1	DRIVE-UP PICK-UP WINDOW CHIME/STROBE	WALL	TLS	GC	FEDERAL SIGNAL	SLM500B W/ SLMBW-012-024	INTEGRAL	16	0	SET SWITCH A TO "CHIME 1 SINGLE" (11011) AND SWITCH B TO "CHIME 2 SINGLE" (00111)
T1	14	TRACK HEAD	TRACK	TLS	GC	JUNO	R605L 30K 90CRI PDIM WFL BL	INTEGRAL LED	120	10	BLACK CYLINDER TRACK HEAD W/ UNIVERSAL 120V TRAC ADAPTER AND WIDE FLOOD BEAM
T-6	4	TRACK (6 FEET)	SURFACE	TLS	GC	JUNO	T 6FT BK	N/A	120	0	SINGLE CIRCUIT, BLACK FINISH
T-8	1	TRACK (8 FEET)	SURFACE	TLS	GC	JUNO	T 8FT BK	N/A	120	0	SINGLE CIRCUIT, BLACK FINISH
TCL-0.5	1	CURRENT LIMITER (60W)	SURFACE	TLS	GC	JUNO	TCLFM11 BL W/ TCLCB 0.5A BLCK	N/A	120	0	BLACK CURRENT LIMITING END FEED
TCL-2	1	CURRENT LIMITER (240W)	SURFACE	TLS	GC	JUNO	TCLFM11 BL W/ TCLCB 2A BLCK	N/A	120	0	BLACK CURRENT LIMITING END FEED
W1	4	WIC LED FIXTURE	SURFACE	WCS	GC	FURNISHED WITH WIC	FURNISHED WITH WIC	INTEGRAL LED	120	29	WET-RATED COOLER FIXTURE
X6	4	EXTERIOR FLOOD LIGHT	SURFACE	EXT'G	EXT'G	RAB LIGHTING	WPLED10Y	INTEGRAL LED	120	10	PROVIDE WITH WALL-MOUNT KIT.
X9	2	LED CHANNEL LIGHT	SURFACE	EXT'G	EXT'G	PARADIGM LED	AMC-2410-S W/ OPAL LENS AND END CAPS	FLEXSR-45-30-67-24	120	45	FURNISHED W/ REMOTE-MOUNTED NEMA 3R LED DRIVER. SEE PLAN FOR LENGTHS.

LIGHTING FIXTURE SCHEDULE NOTES

- A. SEE THE ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LIGHT LOCATIONS.
B. SEE THE ARCHITECTURAL LIGHTING DETAILS FOR FIXTURE CONSTRUCTION DETAILS.

LIGHTING CONTROL COMPONENTS SCHEDULE

	DESCRIPTION	QUANTITY	FURNISHED BY	INSTALLED BY	MANUFACTURER	MODEL	REMARKS
LCP	LIGHT LIGHTING CONTROL PANEL	1	TLS	GC	ACUITY	ARP INTENC08 NLT 8FCR MVOLT HLK FM DTC CPTLE1	8 RELAY PANEL FOR DIMMING CONTROL WITH FLUSH MOUNT ENCLOSURE, AND DIGITAL TIME CLOCK
SC	WALL-MOUNTED OVERRIDE SWITCH (4 CHANNEL)	1	TLS	GC	ACUITY	nPODMA 4P WH	SEE LIGHTING CONTROL DIAGRAM FOR SWITCH CONFIGURATION
OC	WALL-MOUNTED LINE VOLTAGE OCCUPANCY SENSOR	3	TLS	GC	HUBBELL	LHMTS 1-N-WH	WHITE DUAL TECHNOLOGY SINGLE RELAY WITH 1 BUTTON AND NEUTRAL WIRING

LIGHTING CONTROL PANEL SCHEDULE: LCP


RELAY	PANEL	CIRCUIT	AREA SERVED	CONTROL	TIME ON	TIME OFF	NOTES
R1	A	32	KITCHEN A	TIMECLOCK	7:00:00 AM	12:00:00 AM	SINGLE POLE (NC)
R2	A	32	KITCHEN B	TIMECLOCK	7:00:00 AM	12:00:00 AM	SINGLE POLE (NC)
R3			SPARE				SINGLE POLE (NC)
R4	A	30	DINING ROOM A	TIMECLOCK	10:00:00 AM	12:00:00 AM	SINGLE POLE (NC)
R5	A	30	DINING ROOM B	TIMECLOCK	10:00:00 AM	12:00:00 AM	SINGLE POLE (NC)
R6			SPARE				SINGLE POLE (NC)
R7	A	28	RESTROOM EXHAUST FAN	TIMECLOCK	7:00:00 AM	12:00:00 AM	SINGLE POLE (NC)
R8	A	46	EXT. LIGHTING/SIGNAGE	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	SINGLE POLE (NC)

LIGHTING CONTROL PANEL SCHEDULE NOTES

- A. DUPLICATE PANEL SCHEDULE AND PERMANENTLY INSTALL WITHIN THE LIGHTING CONTROL PANEL.

ELECTRICAL LIGHTING PLAN NOTES

- INSTALL WALL-MOUNTED LIGHTING OVERRIDE SWITCH AND CONNECT TO LCP AS SHOWN IN DETAIL 6/E710
- FOR UNCIRCUITED LIGHT FIXTURES, CONNECT TO RELAY CIRCUIT INDICATED NEXT TO THE FIXTURE TAG THROUGH THE LIGHTING CONTROL PANEL (LCP) UNLESS NOTED OTHERWISE.
- WALL MOUNT THE EMERGENCY LIGHT FIXTURE AT 6" BELOW THE CEILING UNLESS NOTED OTHERWISE
- VERIFY MOUNTING HEIGHT OF EXIT SIGN PRIOR TO ROUGH IN. EXIT SIGN MUST BE VISIBLE FROM AREA SERVED AFTER BUILDING SYSTEMS HAVE BEEN INSTALLED. SEE ARCHITECTURAL ELEVATIONS FOR FURTHER INFORMATION.
- INSTALL LIGHT FIXTURES FURNISHED WITH THE WALK-IN COOLER. PROVIDE UNSWITCHED CONDUCTOR FROM LIGHTING CIRCUIT TO WALK-IN COOLER LIGHTING J-BOX AND FROM J-BOX TO LIGHT FIXTURES AS SHOWN. CONDUIT BETWEEN LIGHT FIXTURES SHALL BE ROUTED ON THE INTERIOR OF THE WALK-IN COOLER. SEAL INTERIOR AND EXTERIOR OF CONDUITS WHERE THEY PASS THROUGH THE WALK-IN COOLER ENVELOPE PER THE NEC.
- PROVIDE UNISTRUT AS SHOWN ON THE ARCHITECTURAL RCP PER THE ARCHITECTURAL UNISTRUT DETAIL. TYPICAL.
- CONNECT EXTERIOR LIGHTING CIRCUIT TO CIRCUIT SHOWN THROUGH THE EXTERIOR LIGHTING CONTACTOR PANEL PER DETAIL 6/E710.
- INSTALL WALL-MOUNTED OCCUPANCY SENSOR FURNISHED BY LIGHTING SUPPLIER AT 42" AFF. ADJUST OCCUPANCY SENSOR TO PROVIDE AUTOMATIC ON/AUTOMATIC OFF OPERATION WITH A FIXED TIMER OF 30 MINUTES AND WITH BOTH THE PASSIVE INFRARED AND ULTRASONIC SENSORS ENABLED.
- INSTALL CHIME/STROBE FURNISHED WITH VEHICLE DETECTION SYSTEM ON WALL 12" BELOW CEILING AND CONNECT TO VEHICLE DETECTOR SYSTEM PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- NOT USED.
- NOT USED.
- INSTALL LIGHTING CONTROL SYSTEM PER DETAIL 6/E710.
- RELOCATE EXISTING LED DRIVER FOR EXISTING X9 LIGHT FIXTURE TO ACCESSIBLE LOCATION ABOVE LAY-IN CEILING AS SHOWN. PROVIDE LOW VOLTAGE WIRING FROM DRIVER TO LIGHT FIXTURE CONCEALED FROM VIEW

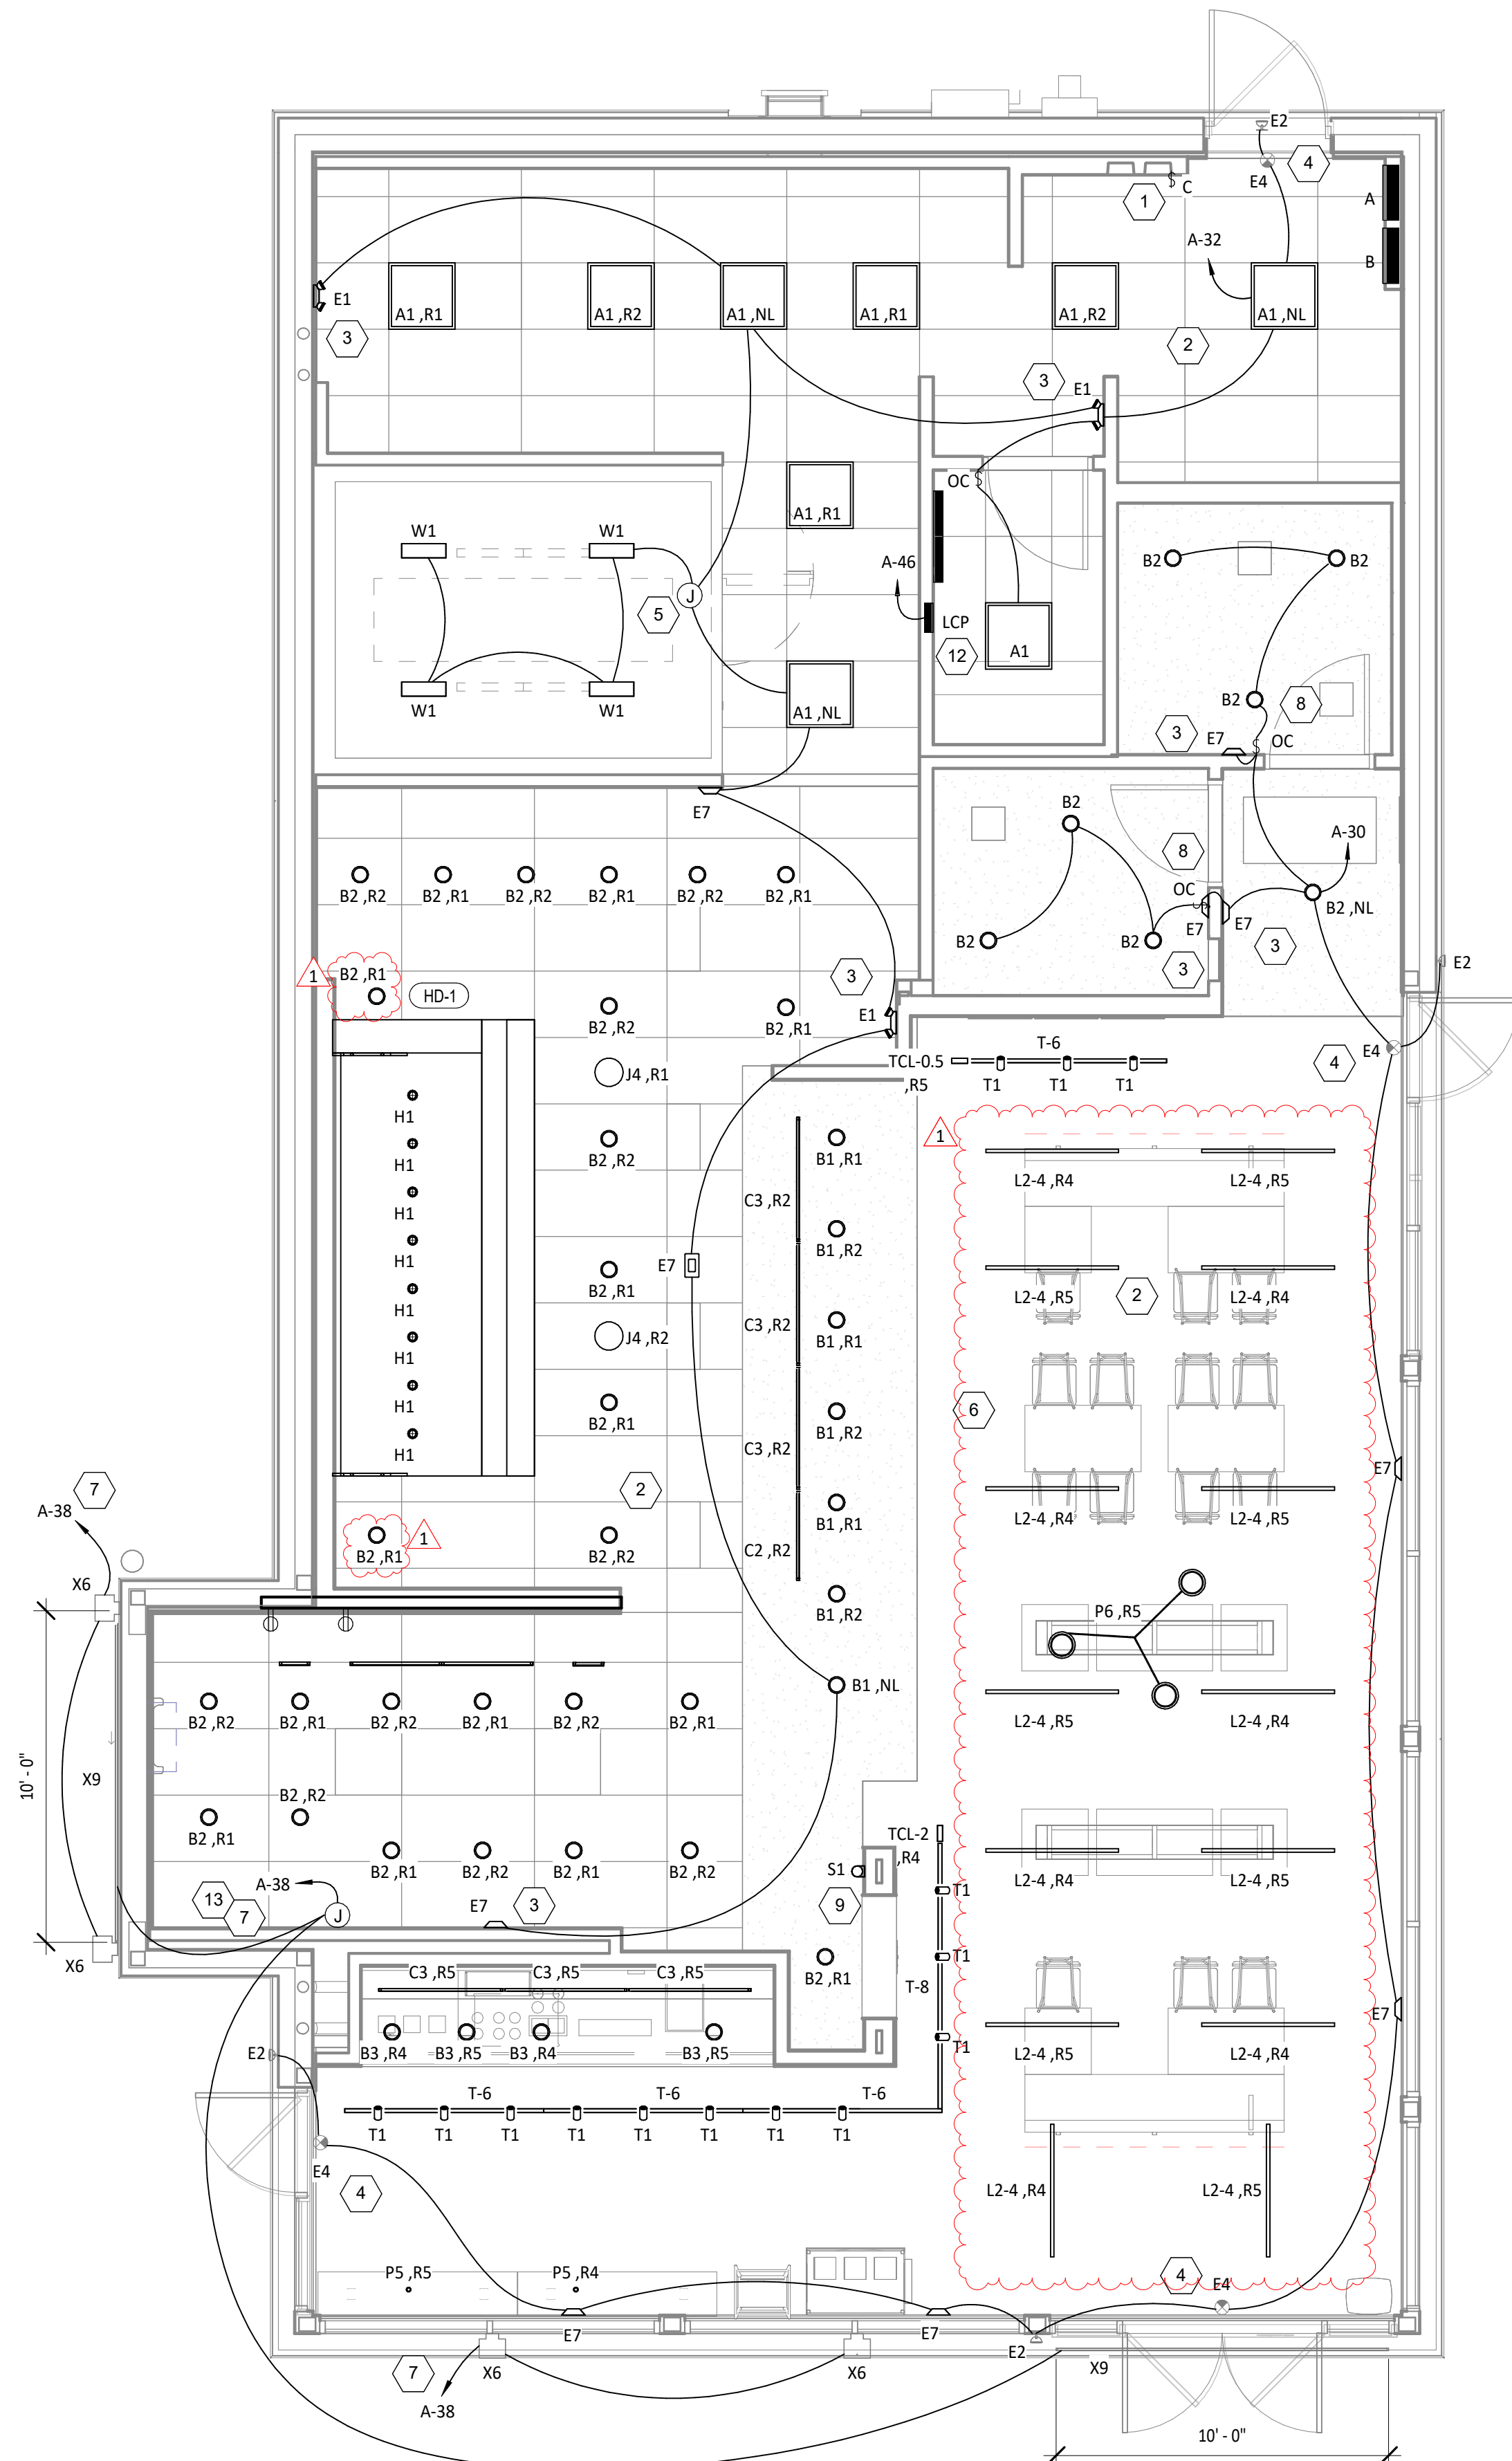

LIGHTING FLOOR PLAN
1/4" = 1'-0"

Consultant:



4635 Trueman Blvd, Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com



08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644

"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:

03/07/2025 PERMIT SET
05/29/2025 BID SET

Revisions:

1 08/21/2026 FINISH & DB UPDATES

Drawn: Checked:

EJP AJJ

Project No.

2402039

Contents:

**ELECTRICAL
LIGHTING PLAN**


E100


ELECTRICAL POWER PLAN NOTES

- 1 SHOW ROOM WINDOW RECEPTACLE. COORDINATE EXACT RECEPTACLE MOUNTING HEIGHT IN THE FIELD. LOCATION SHALL BE IN THE DRYWALL IMMEDIATELY ABOVE THE MAIN STORE-FRONT WINDOW AND AS SHOWN IN THE DINING ROOM ELECTRICAL ELEVATIONS ON SHEET E700.
- 2 ICE MACHINE ELECTRICAL TIE-IN. COORDINATE EXACT LOCATION WITH EQUIPMENT INSTALLER PRIOR TO ROUGH-IN. PROVIDE 15-20P FLANGED INLET WIRED TO THE REMOTE CONDENSER. PROVIDE 48" CORDS, ONE WITH 5-20P END AND ONE WITH 15-20R END, FROM ICE MAKER TO RECEPTACLE AND FLANGED INLET.
- 3 CONNECT FRYER AND RICE COOKER RECEPTACLES TO THE CIRCUITS SHOWN THROUGH THE CONTACTOR INTEGRAL TO THE HOOD CONTROL PANEL. INTEGRAL CONTACTOR SHALL BE INTERLOCKED TO HOOD FIRE PROTECTION SYSTEM SO THAT RECEPTACLES ARE DE-ENERGIZED UPON ACTIVATION OF HOOD FIRE PROTECTION SYSTEM. PROVIDE VERTICAL METAL DIE CAST WEATHERPROOF WHILE IN USE OUTLET COVER ON RECEPTACLES. COVER SHALL BE INTERMATIC WP1010MXD FOR SINGLE GANG BOXES AND WP1030MXD FOR DOUBLE GANG BOXES. NO SUBSTITUTIONS SHALL BE ACCEPTED.
- 4 JUNCTION BOX FOR EXTERIOR SIGN LIGHTING. COORDINATE EXACT LOCATION WITH CHIPOTLE'S CONSTRUCTION MANAGER AND THE SIGN INSTALLER PRIOR TO ROUGH-IN. CONNECT TO CIRCUIT SHOWN THROUGH THE EXTERIOR LIGHTING CONTACTOR PANEL AS SHOWN IN DETAIL 6/E710.
- 5 PROVIDE A SINGLE GANG VERTICAL JUNCTION BOX FOR THE KITCHEN EXHAUST SUPPRESSION SYSTEM PULL STATION. PROVIDE A 1/2" CONDUIT FROM THE J-BOX TO 6" ABOVE THE CEILING AND TERMINATE WITH A CONDUIT BUSHING. COORDINATE EXACT LOCATION WITH THE KITCHEN EXHAUST SUPPRESSION SYSTEM INSTALLER AND THE FIRE MARSHALL PRIOR TO ROUGH-IN.
- 6 HOOD CONTROL PANEL AND KITCHEN EXHAUST SUPPRESSION SYSTEM CABINET SHALL BE LOCATED WITHIN THE INTEGRAL HOOD UTILITY CABINET. PROVIDE FINAL ELECTRICAL CONNECTIONS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS NECESSARY FOR A COMPLETE AND OPERATIONAL SYSTEM.
- 7 INSTALL WIRING HARNESS FURNISHED WITH WALK-IN COOLER FROM CONDENSING UNIT ON ROOF TO THE CAPSULE-PAK REFRIGERATION MODULE ON THE WALK-IN COOLER.
- 8 PROVIDE AN EMPTY SINGLE GANG J-BOX FOR VOLUME CONTROLS. INSTALL 16/2 SPEAKER WIRE FURNISHED BY MSS FROM THE J-BOX TO THE AMPLIFIER IN THE OFFICE WITH 3 FEET OF SLACK AT EACH END.
- 9 COORDINATE DATA/POWER RECEPTACLE MOUNTING REQUIREMENTS WITH THE CASE WORK INSTALLER PRIOR TO ROUGH-IN.
- 10 PROVIDE ROUGH-IN FOR LAUNCHPORT AS NOTED. LAUNCHPORT WILL BE FURNISHED AND INSTALLED BY CHIPOTLE WITH THE WALLSTATION AT 62" AFF. PROVIDE A 4" X 2-1/8" DEEP OCTAGON J-BOX WITH 1-1/2" EXTENSION RING AT 62" AFF FOR THE WALLSTATION INSTALLATION WITH A 1" CONDUIT WITH PULL STRING FROM THE J-BOX TO ABOVE THE OFFICE CEILING.
- 11 PROVIDE (2) EMPTY 2" CONDUITS WITH PULL STRINGS FROM THE BASE BUILDING'S TELEPHONE AND DATA SERVICE ENTRANCE LOCATIONS TO THE SPACE ABOVE THE OFFICE CEILING. TERMINATE WITH CONDUIT BUSHING.
- 12 PROVIDE A SUITABLE LENGTH OF LIQUID-TIGHT CONDUIT TO THE EXHAUST FAN EF-1 TO ALLOW THE EXHAUST FAN TO HINGE COMPLETELY OPEN WHEN THE VIROGUARD SYSTEM IS INSTALLED.
- 13 AFTER THE FAX LINE, POS, AND OFFICE EQUIPMENT IS INSTALLED PROVIDE CHILDPROOF RECEPTACLE COVERS ON UNUSED IG RECEPTACLES AT THE FAX LINE, POS, AND OFFICE.
- 14 PROVIDE ONE PHASE, ONE NEUTRAL, AND ONE GROUND CONDUCTOR FROM THE ICE MAKER TO THE REMOTE CONDENSING UNIT.
- 15 UNIT SHALL HAVE AN INTEGRAL NON-FUSED DISCONNECT SWITCH.
- 16 PROVIDE 3" CONDUIT (EMT, IMC, OR RMC) THROUGH ROOF. TERMINATE WITH WEATHERHEAD EVEN WITH TOP OF PARAPET FOR FUTURE CELL BOOSTER. SECURE CONDUIT TO STRUCTURE TO SUPPORT FUTURE ANTENNA INSTALLATION. PROVIDE 1/4" X 2" X 10" 16-HOLE GROUNDING BUSBAR (BURNDY BBB14210A OR EQUAL) MOUNTED TO CONDUIT ABOVE ROOF FOR FUTURE CONNECTION OF LIGHTNING ARRESTORS. PROVIDE #2 CU GROUND FROM BUSBAR TO MAIN ELECTRODE GROUNDING CONDUCTOR.
- 17 PROVIDE HORIZONTAL SINGLE-GANG J-BOX AS SHOWN FOR MOUNTING OF DINING ROOM DUAL-HEAD CAMERA. SEE ELECTRICAL ELEVATION FOR EXACT HEIGHT AND LOCATION. PROVIDE 3/4" CONDUIT WITH PULLSTRING FROM J-BOX TO ABOVE LAY-IN CEILING AREA IN OFFICE.
- 18 ROUGH-INS TO SERVE LINE AND POS EQUIPMENT ARE UNDERGROUND. COORDINATE ROUGH-IN REQUIREMENTS AND LOCATIONS WITH EQUIPMENT MANUFACTURER PRIOR TO ROUGH-IN.
- 19 ROOFTOP UNIT SHALL HAVE AN INTEGRAL UNIT-MOUNTED GFCI RECEPTACLE. PROVIDE CONNECTION TO CIRCUIT SHOWN.
- 20 ICE MAKER RECEPTACLES SHALL BE CONCEALED BEHIND THE ICE MAKER. COORDINATE LOCATION WITH ACTUAL WIDTH OF ICE MAKER.
- 21 CONNECT DUAL-SIDED PLANCHA RECEPTACLES TO THE CIRCUITS SHOWN THROUGH THE 60A/6-POLE CONTACTOR ABOVE THE PANELBOARD AND THE SHOCK-BLOCK GFCI DEVICES ADJACENT TO THE PANELBOARD. CONTACTOR SHALL BE INTERLOCKED TO HOOD FIRE PROTECTION SYSTEM SO THAT RECEPTACLES ARE DE-ENERGIZED UPON ACTIVATION OF HOOD FIRE PROTECTION SYSTEM. PROVIDE Hubbell Taymac MX2150S WEATHERPROOF OUTLET COVER ON RECEPTACLES. NO SUBSTITUTIONS SHALL BE ACCEPTED. LABEL BATTERY-PROTECTED RECEPTACLES "BATTERY-PROTECTED: DISCONNECT AT PANEL BDP".
- 22 LABEL MAIN DISCONNECT SWITCH AND PANEL A "WARNING: BATTERY-PROTECTED RECEPTACLES IN USE. DISCONNECT AT PANEL BDP."
- 23 NOT USED.
- 24 NOT USED.
- 25 CONNECT RESTROOM EXHAUST FAN TO CIRCUIT SHOWN THROUGH THE LIGHTING CONTROL PANEL (LCP).
- 26 INSTALL 16/2 SPEAKER WIRE FURNISHED BY MSS. INSTALL SPEAKER WIRE BETWEEN SPEAKERS IN THE DINING ROOM AS SHOWN TO THE VOLUME CONTROL IN THE KITCHEN WITH 3 FEET OF SLACK AT EACH END. SEE ARCHITECTURAL PLANS FOR SPEAKER LOCATIONS. ADJUST EACH SPEAKER 70V TAP SETTING TO BE 15 WATTS.
- 27 PROVIDE POWER CONNECTIONS TO ISLAND PREP TABLE PER DETAIL 2/E710. PROVIDE GFCI DUPLEX RECEPTACLES IN THREE J-BOXES INTEGRAL TO PREP TABLES (FOR UNDERCOUNTER REFRIGERATOR, HOT HOLDING CABINET, AND GENERAL RECEPTACLE).


ELECTRICAL POWER PLAN NOTES

- 28 PROVIDE GFCI RECEPTACLE AND J-BOX AND INSTALL CO2 ALARM FURNISHED BY CO2AS AS SHOWN IN DETAIL 4/E710.
- 29 PROVIDE J-BOX AND INSTALL CO2 ALARM REMOTE DISPLAY UNIT FURNISHED BY CO2AS AS SHOWN IN DETAIL 4/E710.
- 30 INSTALL WALK-IN-COOLER EXTERNAL READOUT THERMOMETER REMOTE PROBE ON WALL OPPOSITE FROM DOOR AS SHOWN. ROUTE TEMPERATURE PROBE WIRE ABOVE WALK-IN COOLER CEILING PANELS, SEAL PENETRATIONS THROUGH THE CEILING PANELS, AND SECURE VERTICAL PROBE WIRE TIGHT TO WALLS. NO EXCESS PROBE WIRE SHALL BE WITHIN THE WALK-IN COOLER.
- 31 PROVIDE A J-BOX 6" BELOW THE LAY-IN CEILING WITH A 1/2" CONDUIT ROUTED TO THE HCP. PROVIDE 16 GA 3 CONDUCTOR LOW VOLTAGE WIRE FROM THE HOOD SUPPRESSION SYSTEM GAS VALVE BACK TO THE HCP WITH FINAL CONNECTION IN THE HCP BY THE FS INSTALLER. LOW VOLTAGE WIRING FROM THE J-BOX TO THE GAS VALVE SHALL BE CONCEALED WITHIN FLEXIBLE METAL CONDUIT OR LIQUIDTIGHT FLEXIBLE METAL CONDUIT. COORDINATE J-BOX LOCATION WITH GAS VALVE SO THAT CONDUIT IS 12" OR LESS.
- 32 PROVIDE 4" SQUARE J-BOX ON EXTERIOR WALL FOR MOUNTING OF EXTERIOR CAMERA. SEE ARCHITECTURAL ELEVATION FOR EXACT HEIGHT AND LOCATION. PROVIDE 3/4" CONDUIT WITH PULLSTRING FROM J-BOX TO ABOVE LAY-IN CEILING AREA IN KITCHEN. J-BOX SHALL NOT BE SURFACE MOUNTED. BASE OF CAMERA SHALL BE MOUNTED FLUSH TO EXTERIOR WALL FINISH.
- 33 PROVIDE 1" CONDUITS FROM LOW-VOLTAGE J-BOXES AT POS COUNTER CONCEALED WITHIN THE SERVE LINE WIRING CHASE TO THE WALL, THEN CONCEALED WITHIN THE WALL AND ABOVE THE CEILING TO ABOVE THE OFFICE CEILING.
- 34 INSTALL VEHICLE DETECTOR SYSTEM FURNISHED BY TLS SURFACE-MOUNTED ON WALL IN ACCESSIBLE LOCATION ABOVE CEILING AND CONNECT TO STROBE/CHIME AND DETECTOR LOOP PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. MAKE FINAL ADJUSTMENTS TO LOOP SENSITIVITY PER THE MANUFACTURER'S INSTRUCTIONS. ONCE ALL COMPONENTS ARE INSTALLED AND OPERATIONAL THE CHIME/STROBE LIGHT SHOULD STAY ILLUMINATED AND THERE SHOULD BE A SINGLE CHIME WHEN A VEHICLE DRIVES OVER OR STOPS ON LOOP.
- 35 SEAL INTERIOR AND EXTERIOR OF CONDUITS THAT PASS THROUGH THE WALK-IN COOLER ENVELOPE PER THE NEC.
- 36 PROVIDE ISLAND PREP TABLE FOOD WARMER RECEPTACLE WITH GROUND PIN TOWARDS THE BOTTOM OF THE RECEPTACLE.
- 37 INSTALL TRANSFORMER FURNISHED BY TUV WITH THE REME HALO AIR PURIFIER IN THE JUNCTION BOX ON THE EXTERIOR OF THE RTU PER DETAIL 6/M700. CONNECT LINE SIDE OF THE TRANSFORMER TO THE RTU SERVICE RECEPTACLE CIRCUIT SO THAT REME HALO RUNS CONTINUOUSLY. CONNECT THE LOW VOLTAGE SIDE OF THE TRANSFORMER TO THE REME HALO USING THE INCLUDED BARREL PLUG.
- 38 PROVIDE (2) 10"x10"x4" JUNCTION BOXES (J-BOX #1/J-BOX #2) ON THE WALL ABOVE PANELBOARDS 6" BELOW THE LAY-IN CEILING AND MOUNTED ADJACENT TO EACH. PROVIDE CONDUITS AND WIRING SHOWN IN DETAIL 8/E710. TEMS SHALL PROVIDE GRIDPOINT 3 PHASE METER AND TRANSFORMER WITHIN J-BOX #1 AND GRIDPOINT IOM/HUB WITHIN J-BOX #2. SEE GRIDPOINT INSTALLATION SHEET FOR DETAILS.
- 39 PROVIDE HORIZONTAL SINGLE-GANG J-BOX BELOW FUTURE GRIDPOINT CONTROLLER LOCATION. PROVIDE CONDUITS AND WIRING AS SHOWN IN DETAIL 8/E710.
- 40 INSTALL WIRED DOOR BUZZER AT 96" AFF. SEE ARCHITECTURAL DOOR EQUIPMENT FOR EQUIPMENT INFORMATION. CONNECT TO CIRCUIT SHOWN THROUGH THE TRANSFORMER FURNISHED WITH THE DOOR BUZZER. PROVIDE WIRING TO A BUTTON ADJACENT TO THE SERVICE DOOR AND CONNECT PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- 41 CONNECT BATHROOM SANITIZER TO CIRCUIT SHOWN SO THAT IT IS ENERGIZED AT ALL TIMES.
- 42 PROVIDE POWER AND LOW VOLTAGE CONNECTIONS TO DISH SANITIZING MACHINE PER DETAIL 7/E710. CONNECT THE DETERGENT DISPENSER TO THE DISH MACHINE USING THE INCLUDED WIRING HARNESS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- 43 PROVIDE RECEPTACLE FOR 2-DOOR AND/OR 1-DOOR REFRIGERATOR WITH GROUND PINS TOWARDS THE BOTTOM OF THE RECEPTACLE.
- 44 PROVIDE CORD AND NEMA 5-20P PLUG FROM UTENSIL COUNTER ICE MAKER, THROUGH UTENSIL COUNTER, TO ICE MAKER RECEPTACLE.
- 45 LABEL UTENSIL COUNTER RECEPTACLES "TRACTOR BEVERAGE", "ICE MAKER/IMSB", AND "SODA FOUNTAIN".
- 46 LABEL RECEPTACLE "UV INSECT TRAP".
- 47 PROVIDE POWER CONNECTION TO ISLAND PREP TABLE PER DETAIL 2/E710. PROVIDE GFCI DUPLEX RECEPTACLE IN THE J-BOX INTEGRAL TO PREP TABLE FOR UNDERCOUNTER REFRIGERATOR. PROVIDE FINAL CONNECTION TO CARVING STATION HEATER.
- 48 IF NEUTRAL CONDUCTOR IS NOT NEEDED FOR SERVE LINE HOT FOOD SERVER TERMINATE NEUTRAL IN JUNCTION BOX.
- 49 PROVIDE A TWO-CONDUCTOR LOW VOLTAGE WIRE IN 3/4" C. AND (4) #12, #12 N., #12 G. IN 1" C. FROM MAU-1 TO THE HOOD CONTROL PANEL PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- 50 PROVIDE A HORIZONTAL SINGLE-GANG J-BOX FOR DATA JACK AS SHOWN FOR KRONOS TIME CLOCK.
- 51 PROVIDE A RECESSED J-BOX AT 56" AFF FOR THE INSTALLATION OF THE SECURITY SYSTEM KEYPAD WITH A 1/2" CONDUIT TO ABOVE THE LAY-IN CEILING. TERMINATE CONDUIT WITH A CONDUIT BUSHING.
- 52 PROVIDE A RECESSED SINGLE-GANG J-BOX ABOVE DOOR AND 3" IN FROM LATCH SIDE OF DOOR FOR THE INSTALLATION OF THE SECURITY SYSTEM DOOR CONTACT WITH A 1/2" CONDUIT TO ABOVE THE LAY-IN CEILING. TERMINATE CONDUIT WITH A CONDUIT BUSHING.
- 53 PROVIDE POWER TO EXISTING DUPLEX GFCI RECEPTACLE FOR IRRIGATION CONTROLLER.
- 54 PROVIDE 60A/6-POLE CONTACTOR FOR CONTROL OF DUAL-SIDED PLANCHA IN AN ACCESSIBLE LOCATION ABOVE THE LAY-IN CEILING IN THE PANELBOARD AREA. CONNECT CONTACTOR TO HOOD CONTROL PANEL SO THAT THE CONTACTOR DE-ENERGIZES UPON ACTIVATION OF THE HOOD FIRE SUPPRESSION SYSTEM.
- 55 INSTALL LITTLEFUSE SHOCK-BLOCK GFCI DEVICES FURNISHED BY TPS IN AN ACCESSIBLE LOCATION ON WALL ADJACENT TO PANEL FOR PROTECTION OF THE CIRCUITS FEEDING THE DUAL-SIDED PLANCHA RECEPTACLES.

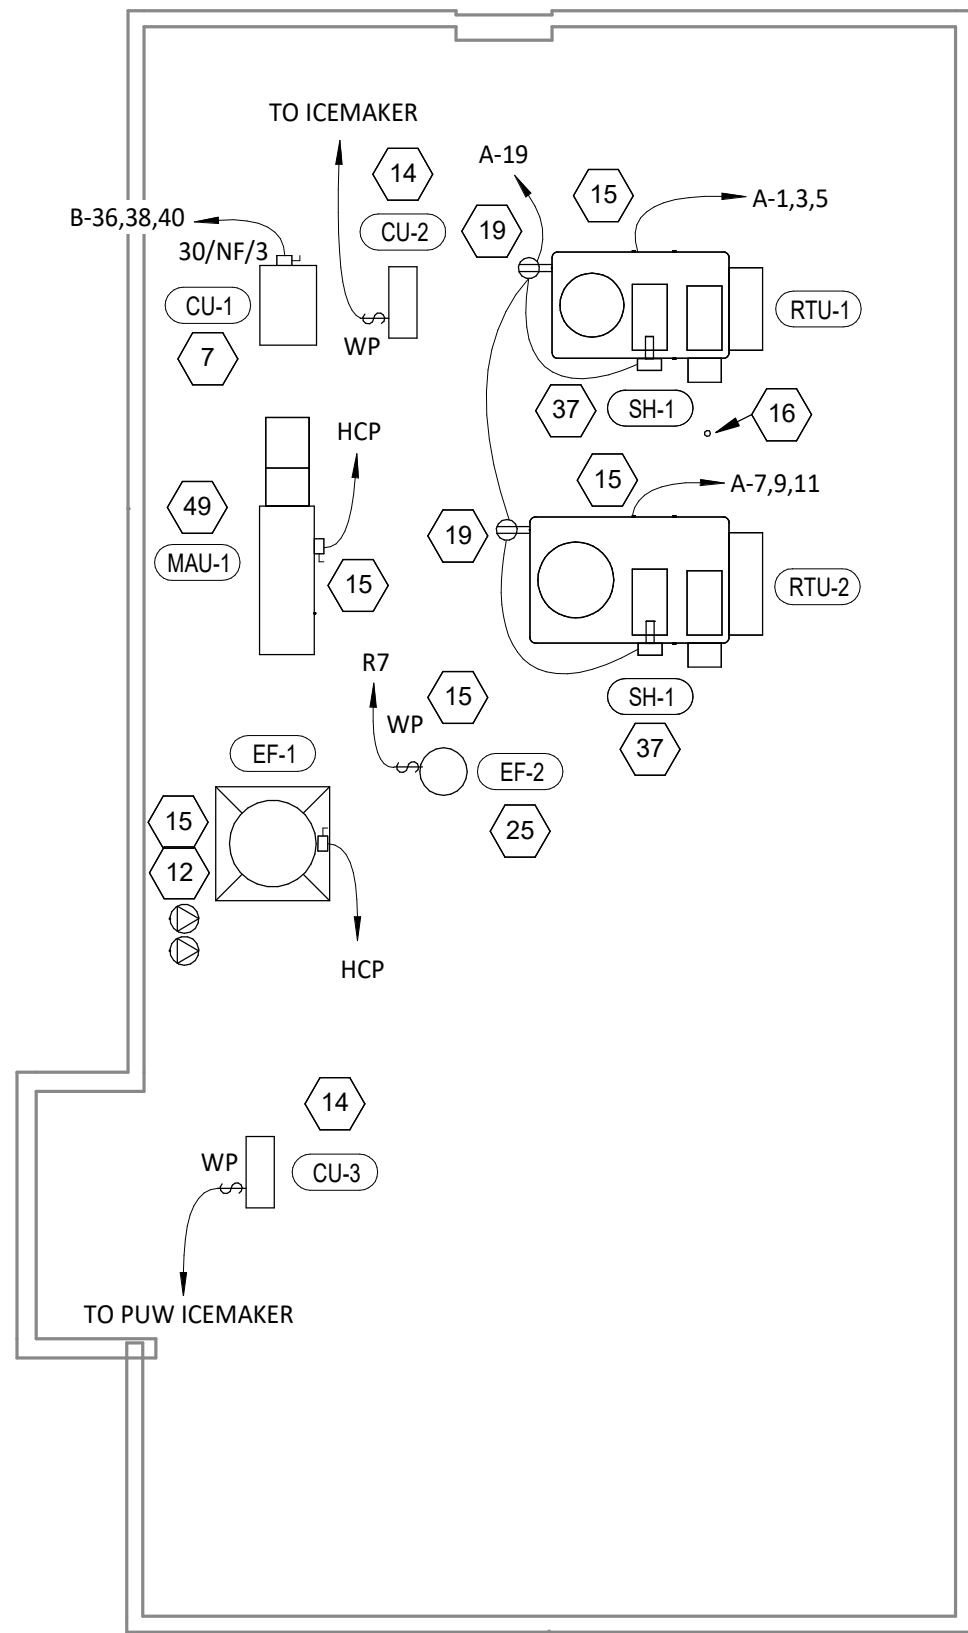

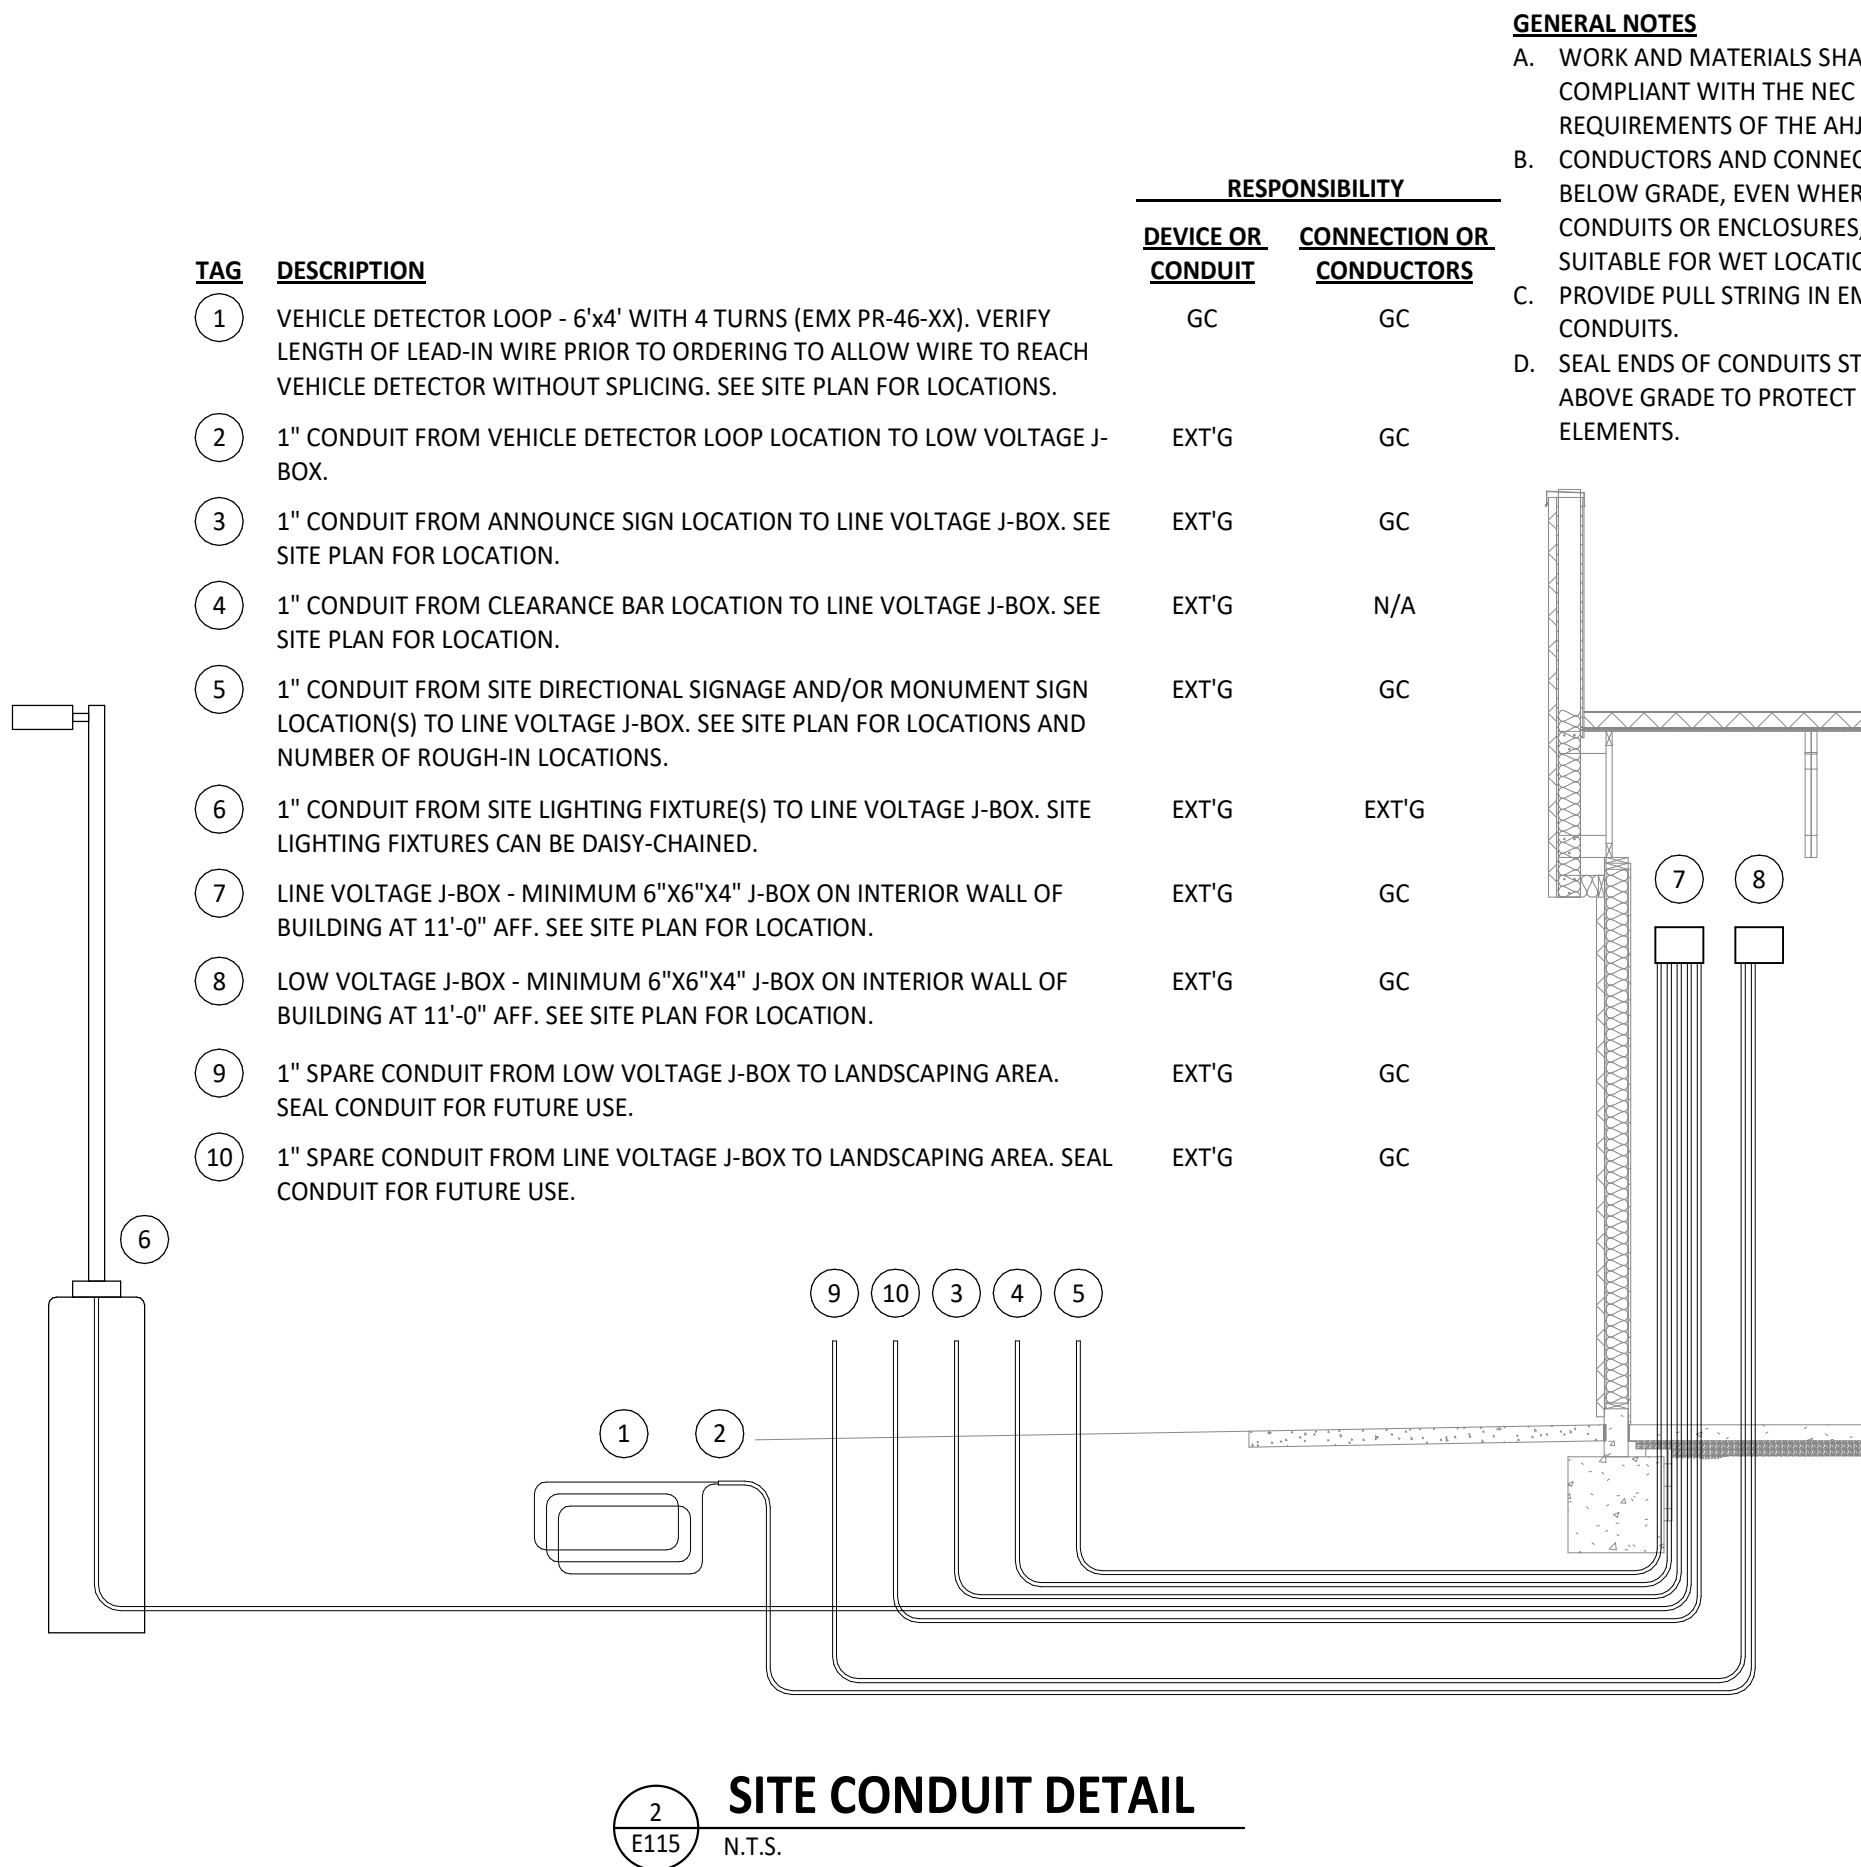

2
E115
SITE CONDUIT DETAIL
N.T.S.

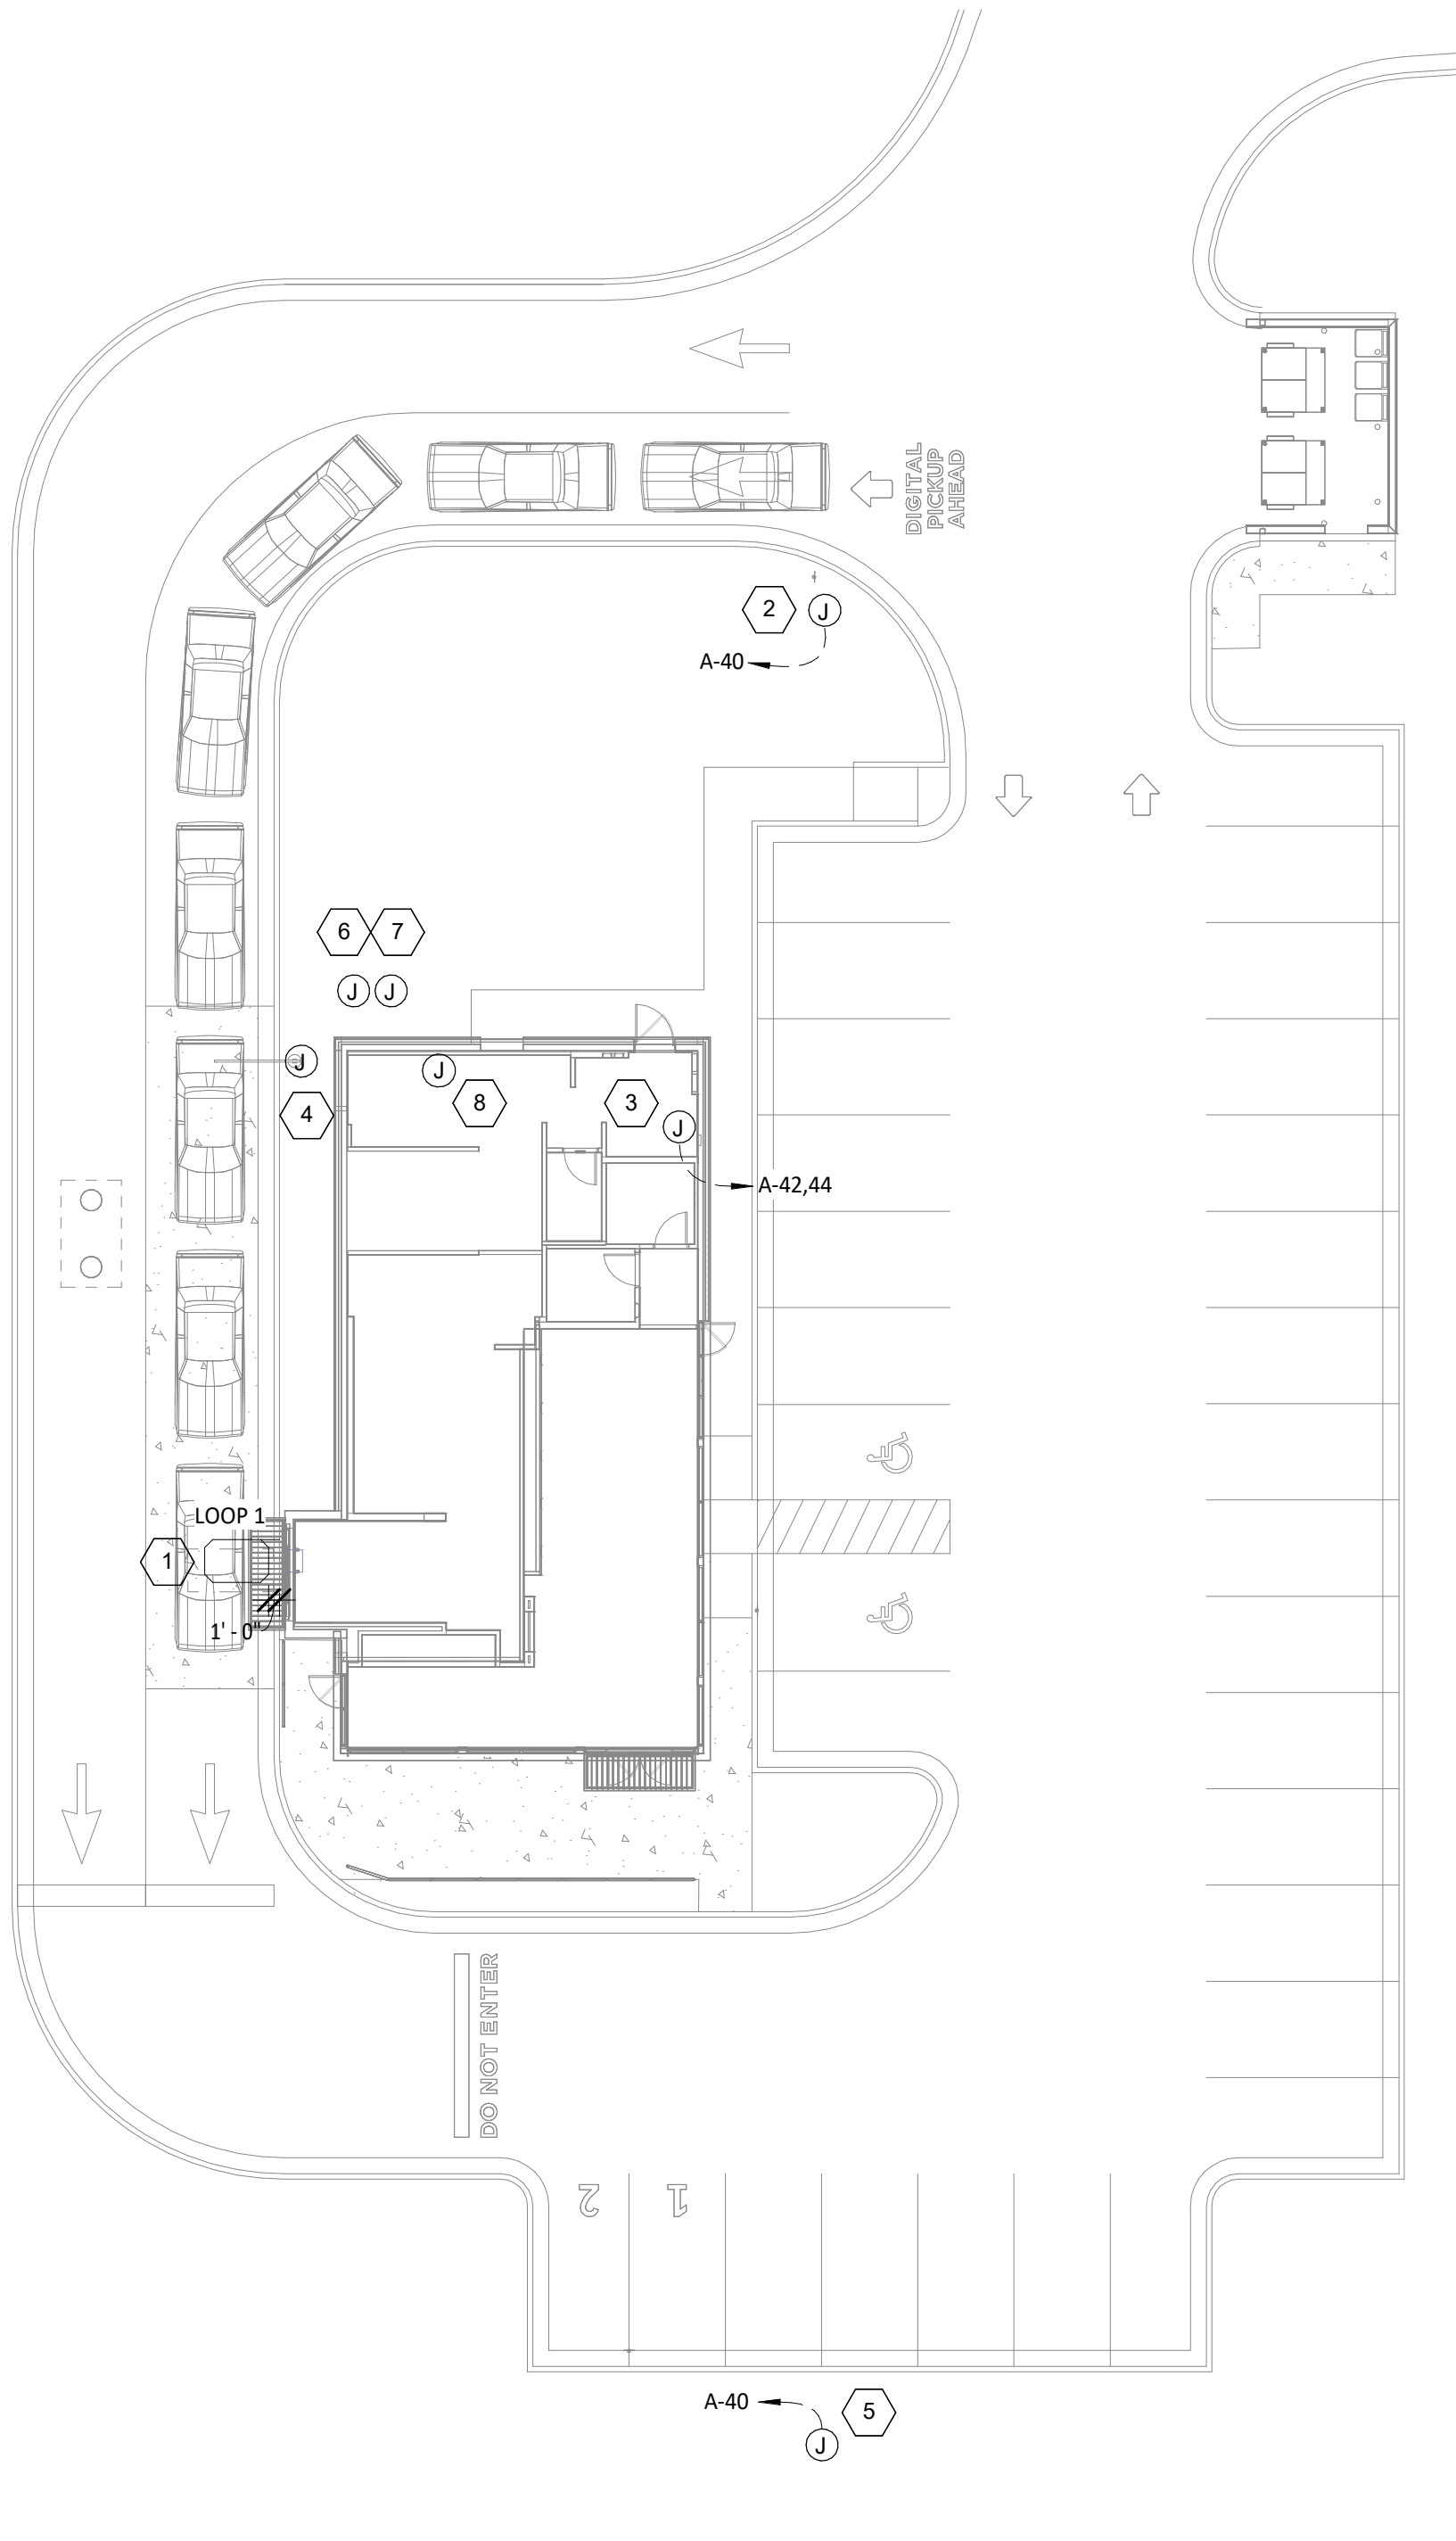

1
E115
POWER SITE PLAN
1/16" = 1'-0"



ELECTRICAL POWER PLAN NOTES

1. INSTALL VEHICLE DETECTION LOOP FURNISHED BY TLS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. ALIGN DETECTOR LOOP TO BE CENTERED ON THE PICK-UP WINDOW.
2. CONNECT ANNOUNCE SIGN TO CIRCUIT SHOWN THROUGH THE EXTERIOR LIGHTING CONTACTOR PANEL AS SHOWN IN DETAIL 6/E710. SEE DETAIL 2/THIS SHEET FOR SITE CONDUITS.
3. CONNECT SITE LIGHTING TO CIRCUIT SHOWN THROUGH THE EXTERIOR LIGHTING CONTACTOR PANEL AS SHOWN IN DETAIL 6/E710. FIELD VERIFY SITE LIGHTING VOLTAGE AND CIRCUITING REQUIREMENTS PRIOR TO FINAL CONNECTION.
4. PROVIDE EMPTY CONDUIT WITH PULL STRING TO CLEARANCE BAR. SEE DETAIL 2/THIS SHEET FOR SITE CONDUITS.
5. CONNECT MONUMENT SIGN TO CIRCUIT SHOWN THROUGH THE EXTERIOR LIGHTING CONTACTOR PANEL AS SHOWN IN DETAIL 6/E710. SEE DETAIL 2/THIS SHEET FOR SITE CONDUITS.
6. EXISTING 1" SPARE LOW VOLTAGE CONDUIT. SEE DETAIL 2/THIS SHEET FOR MORE INFORMATION.
7. EXISTING 1" SPARE LINE VOLTAGE CONDUIT. SEE DETAIL 2/THIS SHEET FOR MORE INFORMATION.
8. EXISTING INTERIOR J-BOXES AT 11'-0" AFF FOR LINE VOLTAGE AND LOW VOLTAGE SITE WIRING. SEE DETAIL 2/THIS SHEET FOR MORE INFORMATION.

Consultant:



4635 Trueman Blvd, Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com

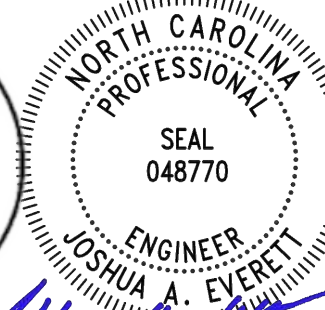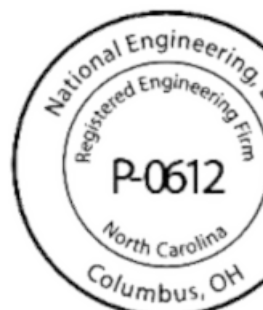

08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:

03/07/2025 PERMIT SET
05/29/2025 BID SET

Revisions:

Drawn: EEP
Checked: AJJ

Project No.
2402039

Contents:

ELECTRICAL SITE
POWER PLAN

E115

VOLTS: 208/120V Wye PHASES: 3 WIRES: 4 MOUNTING: Recessed ENCLOSURE: Type 1																PANEL: A MAINS: MCB AMPERAGE: 400 A MCB RATING: 400 A		
CKT #	DESCRIPTION	C/B [A]	# PLS	NOTES	LOAD [A]	LOAD TYPE	LOAD [kVA] A	LOAD [kVA] B	LOAD [kVA] C	LOAD TYPE	LOAD [A]	NOTES	# PLS	C/B [A]	DESCRIPTION	CKT #		
1							6.4	0.0								2		
3	AIR CONDITIONER - KITCHEN (RTU-1) (3-#4, #8 G. in 1-1/4" C.)	70	3	HACR	53.0	C		6.4	0.0	-	0.0		3	20	TVSS (4-#12, #12 G. IN 3/4" C.)	4		
5									6.4	0.0						6		
7							7.2	0.0								8		
9	AIR CONDITIONER - DINING ROOM (RTU-2) (3-#4, #8 G. in 1-1/4" C.)	80	3	HACR	60.0	C		7.2	0.0	-	0.0		3	20	GRIDPOINT 3 PHASE METER (4-#12, #12 G. IN 3/4" C.)	10		
11									7.2	0.0						12		
13	RECEPTACLES - DINING Receptáculos - Comedor	20	1		1.5	G	0.2	0.2		G	1.5		1	20	GRIDPOINT TRANSFORMER	14		
15	BOP/UPS	15	1		0.0	G		0.0	1.2							16		
17	RECEPTACLES - STOREFRONT Receptáculos - Frente del restaurante	20	1		9.0	G			1.1	1.2	E	10.4	3	20	HOOD EXHAUST FAN (EF-1) (3-#12, #12 G. IN 3/4" C.)	18		
19	RECEPTACLES - ROOFTOP Receptáculos - Techo	20	1		3.3	G, E	0.4	1.2								20		
21	RECEPTACLES - POS GENERAL Receptáculos - Cajero general	20	1		6.0	G		0.7	0.5							22		
23	SECURITY/AUDIO Seguridad y audio	20	1		3.0	G			0.4	0.5	E	3.9	3	15	HOOD MAKEUP AIR FAN (MAU-1) (3-#12, #12 G. IN 3/4" C.)	24		
25	RECEPTACLES - DMIL Receptáculos - Fax	20	1	GFCI	6.9	G	0.8	0.5								26		
27	IRRIGATION CONTROLLER	20	1		0.5	F		0.1	0.5	A, E	4.4		1	15	RESTROOM FAN (EF-2)	28		
29	RECEPTACLES - OFFICE Receptáculos - Oficina	20	1	GFCI	9.0	G			1.1	0.4	A	3.4	1	20	LIGHTING - DINING ROOM Iluminación - Comedor	30		
31	BATHROOM SANITIZER Sanitizante de baño	20	1		0.2	E	0.0	1.6		A	13.7		1	20	LIGHTING - KITCHEN Iluminación - Cocina	32		
33	HD-1 (CONTROL AND LIGHTS) (control y luces)	15	1		1.5	E		0.2	0.0	--	--		1	20	SPARE	34		
35	PICK UP WINDOW NOTIFICATION	20	1		0.3	G			0.0	0.3	B	2.7	1	20	SIGN LIGHTING Iluminación para letreros	36		
37	SPARE	20	1	--	--		0.0	0.1		A, B	1.1		1	20	LIGHTING - EXTERIOR Iluminación - Exterior	38		
39	PICK-UP WINDOW	20	1		1.5	G		0.2	0.7	B	5.8		1	20	SITE SIGNAGE	40		
41	DUAL-SIDED PLANCHA (1 OF 2) (3-#8, #10 G. in 3/4" C.)	50	3	GFCI (SHOCK BLOCK)	37.0	F			4.4	1.3	B	12.5	2	20	SITE LIGHTING (2-#10, #10 G. IN 3/4" C.)	42		
43																44		
45									4.4	0.0	A	0.0	1	20	LIGHTING CONTROL PANEL	46		
47										4.4	0.0	--	--	1	20	SPARE	48	
49	DUAL-SIDED PLANCHA (2 OF 2) (3-#8, #10 G. in 3/4" C.)	50	3	GFCI (SHOCK BLOCK)	37.0	F	4.4	0.0		--	--		1	20	SPARE	50		
51									4.4	0.0	--	--	1	20	SPARE	52		
53	SPARE	20	1	--	--				0.0	0.0	--	--	1	20	SPARE	54		
							19.5	--		--	--		1	--				
	FEED THRU (PANEL B) (4-500 KCMIL, #1/8 G. IN 4" C.)	0	3	LUGS	167.3	SPARE; F		21.2	--	--	--		1	--				
									19.6	--	--	--	1	--				
PHASE TOTAL [kVA]:							48.3 kVA	47.8 kVA	48.3 kVA									
PHASE TOTAL [AMPS]:							403 A	398 A	403 A									
TYPE	DESCRIPTION	CONNECTED LOAD		DEMAND FACTOR		ESTIMATED DEMAND		PANEL TOTALS										
A	INTERIOR LIGHTING	2 kVA		125.00%		3 kVA		TOTAL CONNECTED kVA: 144 kVA										
B	EXTERIOR LIGHTING	4 kVA		125.00%		5 kVA		TOTAL CONNECTED AMPS: 401 A										
C	COMFORT COOLING	41 kVA		100.00% + 25% LARGEST MOTOR		41 kVA		TOTAL ESTIMATED kVA: 115.4 kVA										
D	COMFORT HEATING	0 kVA		0.00%		0 kVA		TOTAL ESTIMATED AMPS: 320 A										
E	MISC. MOTOR	6 kVA		100.00%		6 kVA												
F	KITCHEN EQUIPMENT	87 kVA		65.00%		57 kVA												
G	RECEPTACLES	5 kVA		100.00%		5 kVA												

VOLTS: 208/120V Wye PHASES: 3 WIRES: 4 MOUNTING: Recessed ENCLOSURE: Type 1																PANEL: B MAINS: LUGS AMPERAGE: 400 A MCB RATING: 0 A			
CKT #	DESCRIPTION	C/B [A]	# PLS	NOTES	LOAD [A]	LOAD TYPE	LOAD [kVA] A	LOAD [kVA] B	LOAD [kVA] C	LOAD TYPE	LOAD [A]	NOTES	# PLS	C/B [A]	DESCRIPTION	CKT #			
1	CARBONATOR/CO2 ALARM Sistema de carbonatación y alarma de CO2	20	1	GFCI	10.9	F	1.3	1.4		F	11.3		1	20	FOOD PREP TABLE (ISLAND) Mesa para la preparación de alimentos (isla)	2			
3	FOOD PREP TABLE Mesa para la preparación de alimentos	20	1		11.3	F		1.4	1.1	F	9.4	GFCI	1	20	SODA SYSTEM DISPENSER Dispensador para el sistema de refrescos	4			
5	FOOD PREP TABLE AFVT	20	1	GFCI	1.5	F			0.2	1.4	F	12.0	GFCI	1	20	ICE MAKER - UTENSIL COUNTER Máquina para hacer hielo	6		
7	UPRIGHT REFRIGERATOR - 1 DOOR Refrigerador vertical	20	1	GFCI	10.0	F	1.2	1.0		F	8.5	GFCI	1	20	BUBBLER	8			
9	READY-TO-DRINK REFRIGERATOR	20	1	GFCI	8.8	F		1.1	0.2	F	1.5	GFCI	1	20	UV INSECT LIGHT TRAP	10			
11	COLD TOP (SERVE LINE) Tabla fría (línea de servicio)	20	1		12.0	F			1.4	1.0	F	10.0				12			
13	ICE MAKER SANITIZER Desinfectante de la máquina para hacer hielo	20	1	GFCI	1.5	F	0.2	1.0					2	20	CARVING STATION Estación para cortar carnes	14			
15	ICE MAKER Máquina para hacer hielo	20	1	GFCI	16.0	F		1.9	2.1	F	20.0		2	30	HOT FOOD SERVER (SERVE) (2-#10, #10 N., #10 G. in 3/4" C.) Servidor de alimentos	16			
17	GAS WATER HEATER Calentador de agua a gas	20	1	GFCI	5.0	F			0.6	2.1						18			
19	GAS RICE COOKER Olla arrocera	20	1	GFCI	0.5	F	0.1	0.0			--	--	1	20	SPARE	20			
21	GAS FRYER Freidora de gas	20	1	GFCI	12.0	F		1.4	1.4							22			
23	FOOD WARMER (RICE TABLE) Calentador de alimentos (mesa para el arroz)	15	1		1.5	F			0.2	1.4	F	13.0	GFCI	2	20	TORTILLA PRESS (SERVE LINE) (2-#10, #10 G. in 3/4" C.) Calentador de tortillas	24		
25	TORTILLA PRESS (SML) (2-#10, #10 G. in 3/4" C.)	20	2	GFCI	13.0	F	1.4	0.3		F	2.6		1	20	REFRIGERATOR (COOK LINE) Refrigerador (línea para cocina)	26			
27	Calentador de tortillas (línea del fax)							1.4	2.1	F	20.0	GFCI	2	30	HOT FOOD SERVER (SML) (2-#10, #10 N., #10 G. in 3/4" C.) Servidor de alimentos calientes (línea de fax)	28			
29	UPRIGHT REFRIGERATOR - 1 DOOR Refrigerador vertical	20	1	GFCI	10.0	F			1.2	2.1	F					30			
31	DISH MACHINE (2-#10, #10 G. IN 3/4" C.)	30	2		25.0	F	2.6	1.4		F	11.7	GFCI	1	20	FOOD WARMER (SML) Calentador de alimentos (línea de fax)	32			
33	Lavavajillas							2.6	1.2	F	10.0	GFCI	1	20	COLD TOP (SML) Tabla fría (línea de fax)	34			
35	QUESADILLA MAKER - PUW (2-#10, #10 G. IN 3/4" C.)	30	2	GFCI	28.0	F			2.9	1.8	F					36			
37							2.9	1.8			F	15.0	3	20	CU-1 (3-#10, #10 G. IN 3/4" C.)	38			
39	UNDERCOUNTER COOLER (PUW)	20	1	GFCI	1.5	F		0.2	1.8							40			
41	QUESADILLA MAKER - PUW (2-#10, #10 G. IN 3/4" C.)	30	2	GFCI	28.0	F			2.9	0.2	F	1.6	1	20	WIC - EVAPORATOR	42			
43							2.9	0.0			F	0.2	1	20	WIC - DOOR	44			
45	SPARE	20	1	--	--			0.0	1.5	F	12.5	GFCI	1	20	ICE MAKER (PUW) Máquina para hace hielo	46			
47	SPARE	20	1	--	--				0.0	0.2	F	1.5	GFCI	1	20	SODA SYSTEM DISPENSER (PUW)	48		
49	SPARE	20	1	--	--		0.0	0.0			--	--	1	20	SPARE	50			
51	SPARE	20	1	--	--			0.0	0.0		--	--	1	20	SPARE	52			
53	SPARE	20	1	--	--				0.0	0.0	--	--	1	20	SPARE	54			
PHASE TOTAL [kVA]:							19.5 kVA	21.2 kVA	19.6 kVA										
PHASE TOTAL [AMPS]:							162 A	177 A	163 A										

Consultant:



4635 Trueman Blvd. Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260

Epalma@nationalengineering.com



08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:
03/07/2025 PERMIT SET
05/29/2025 BID SET

Revisions:
1 08/21/2026 FINISH & DB UPDATES







Drawn: EEP
Checked: AJJ

Project No.
2402039



Contents:

ELECTRICAL
SCHEDULES

E600

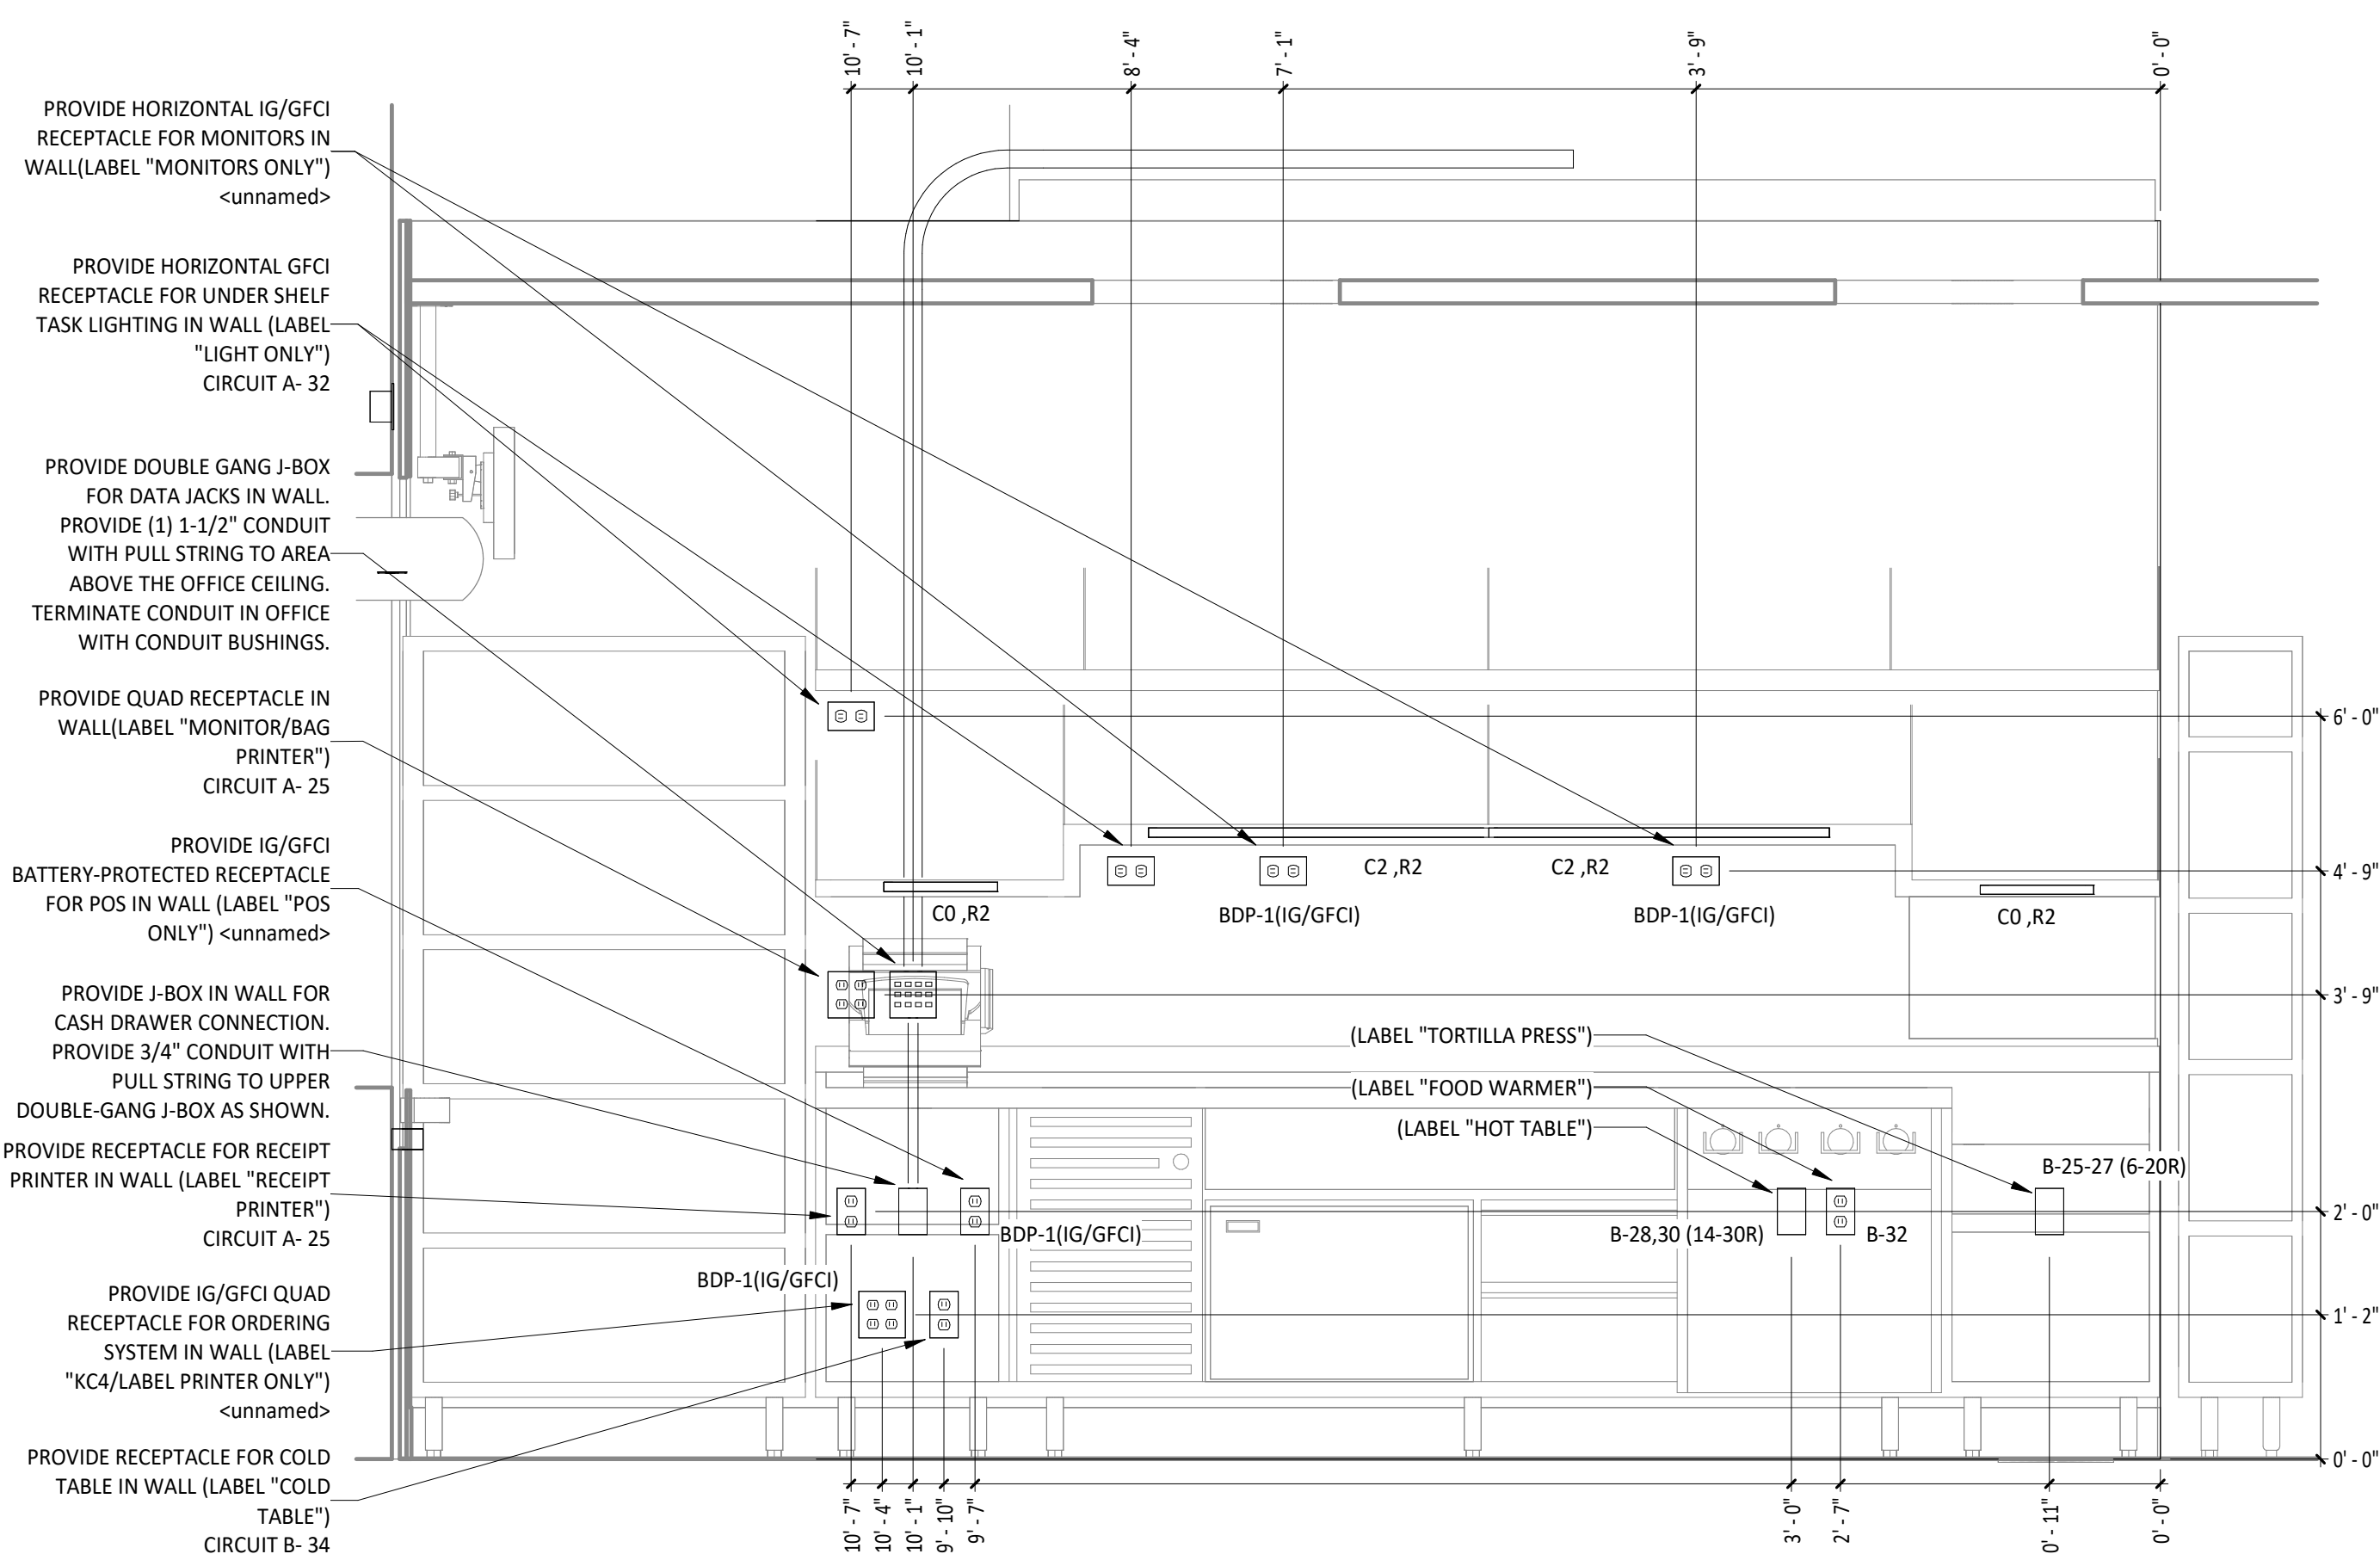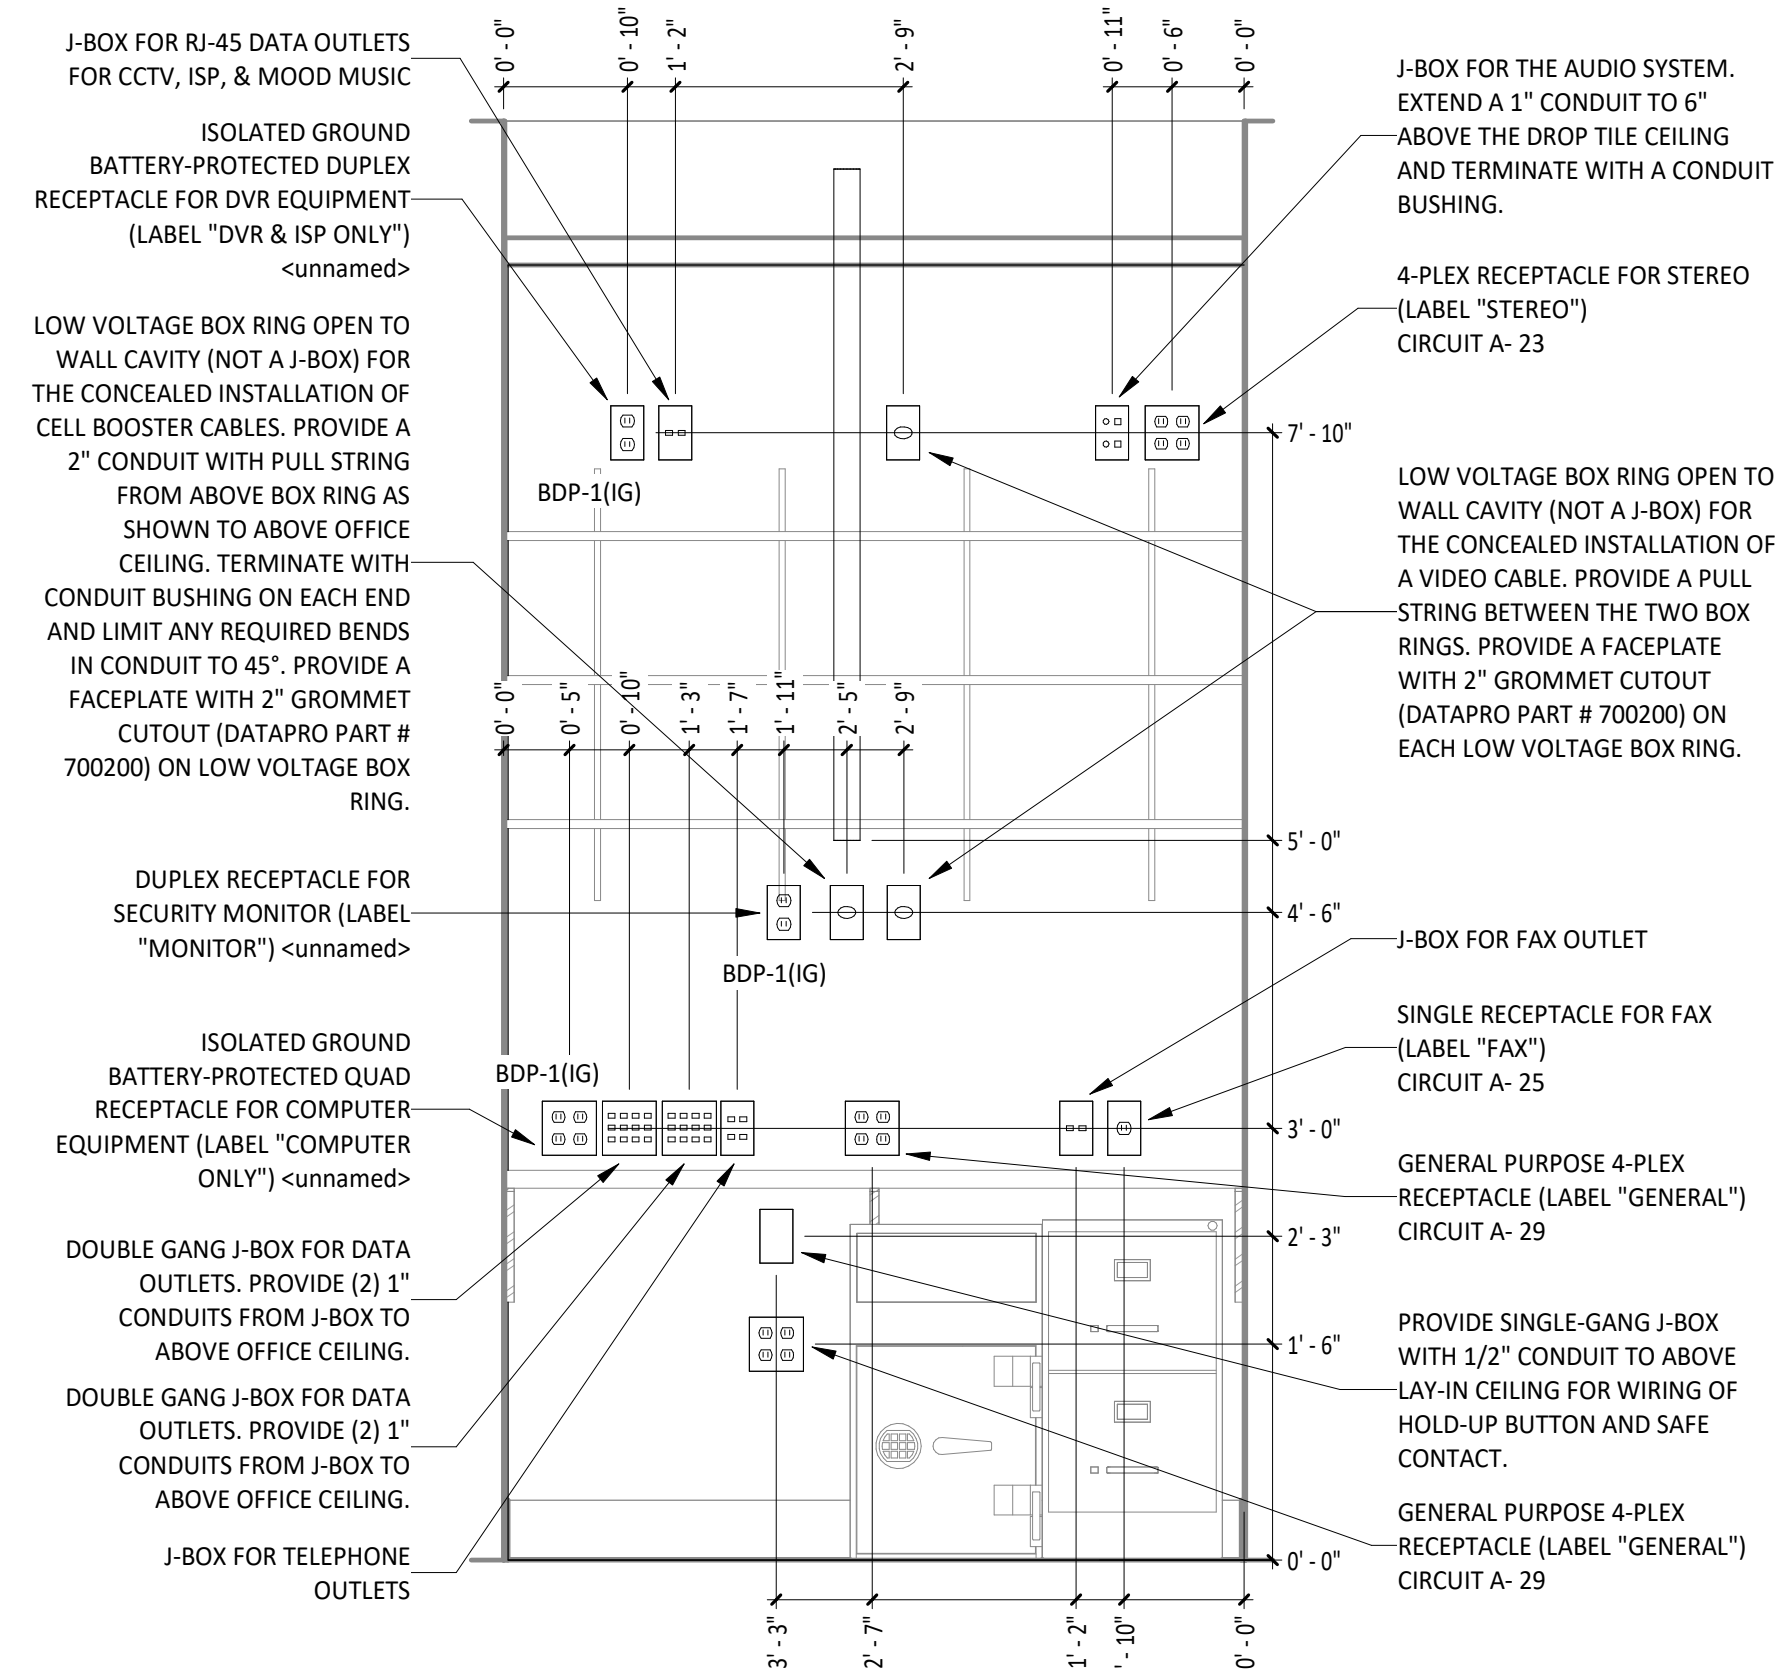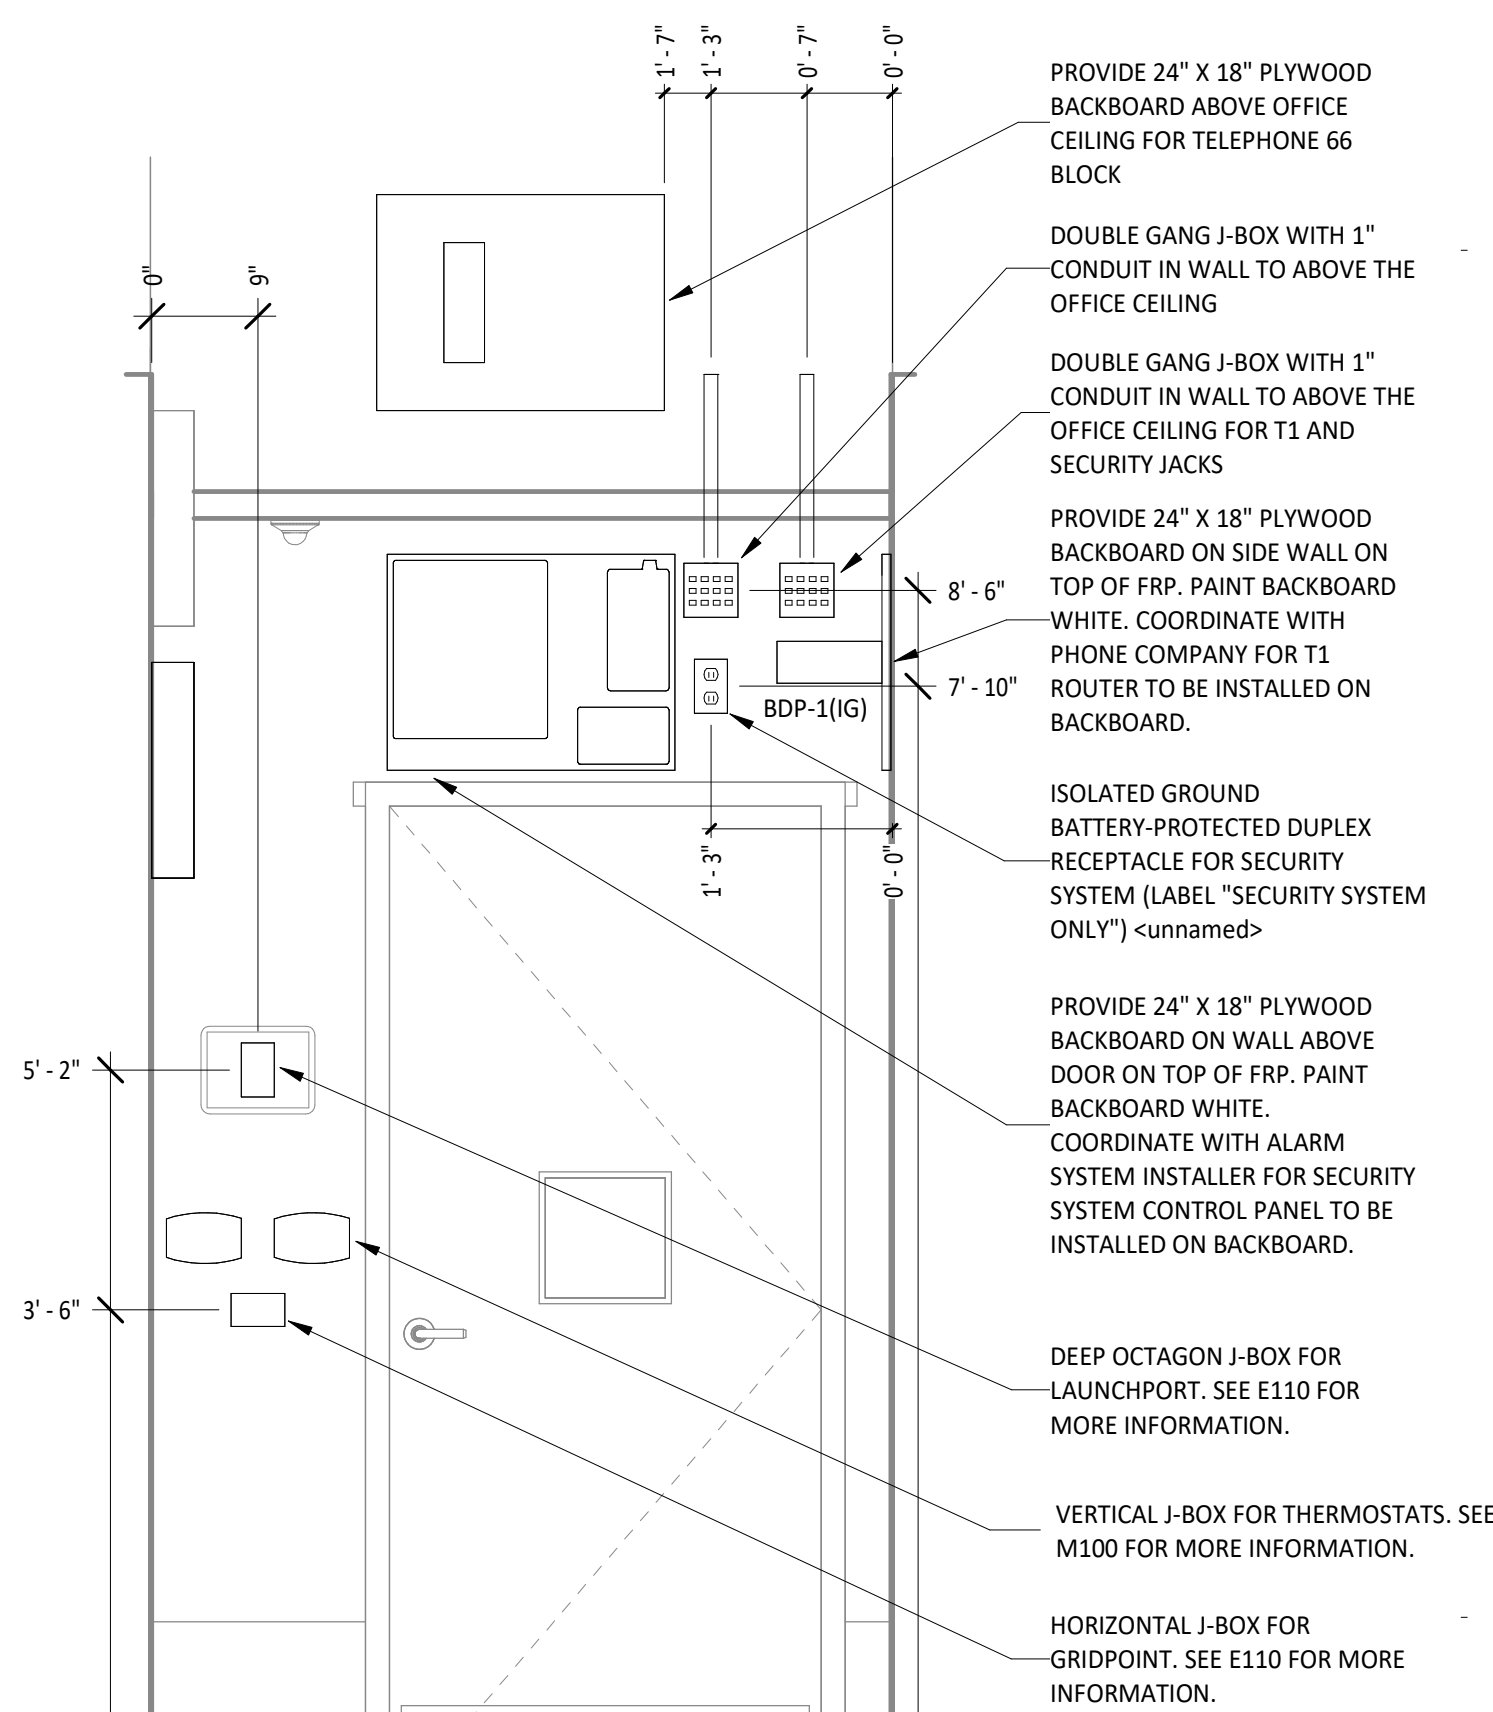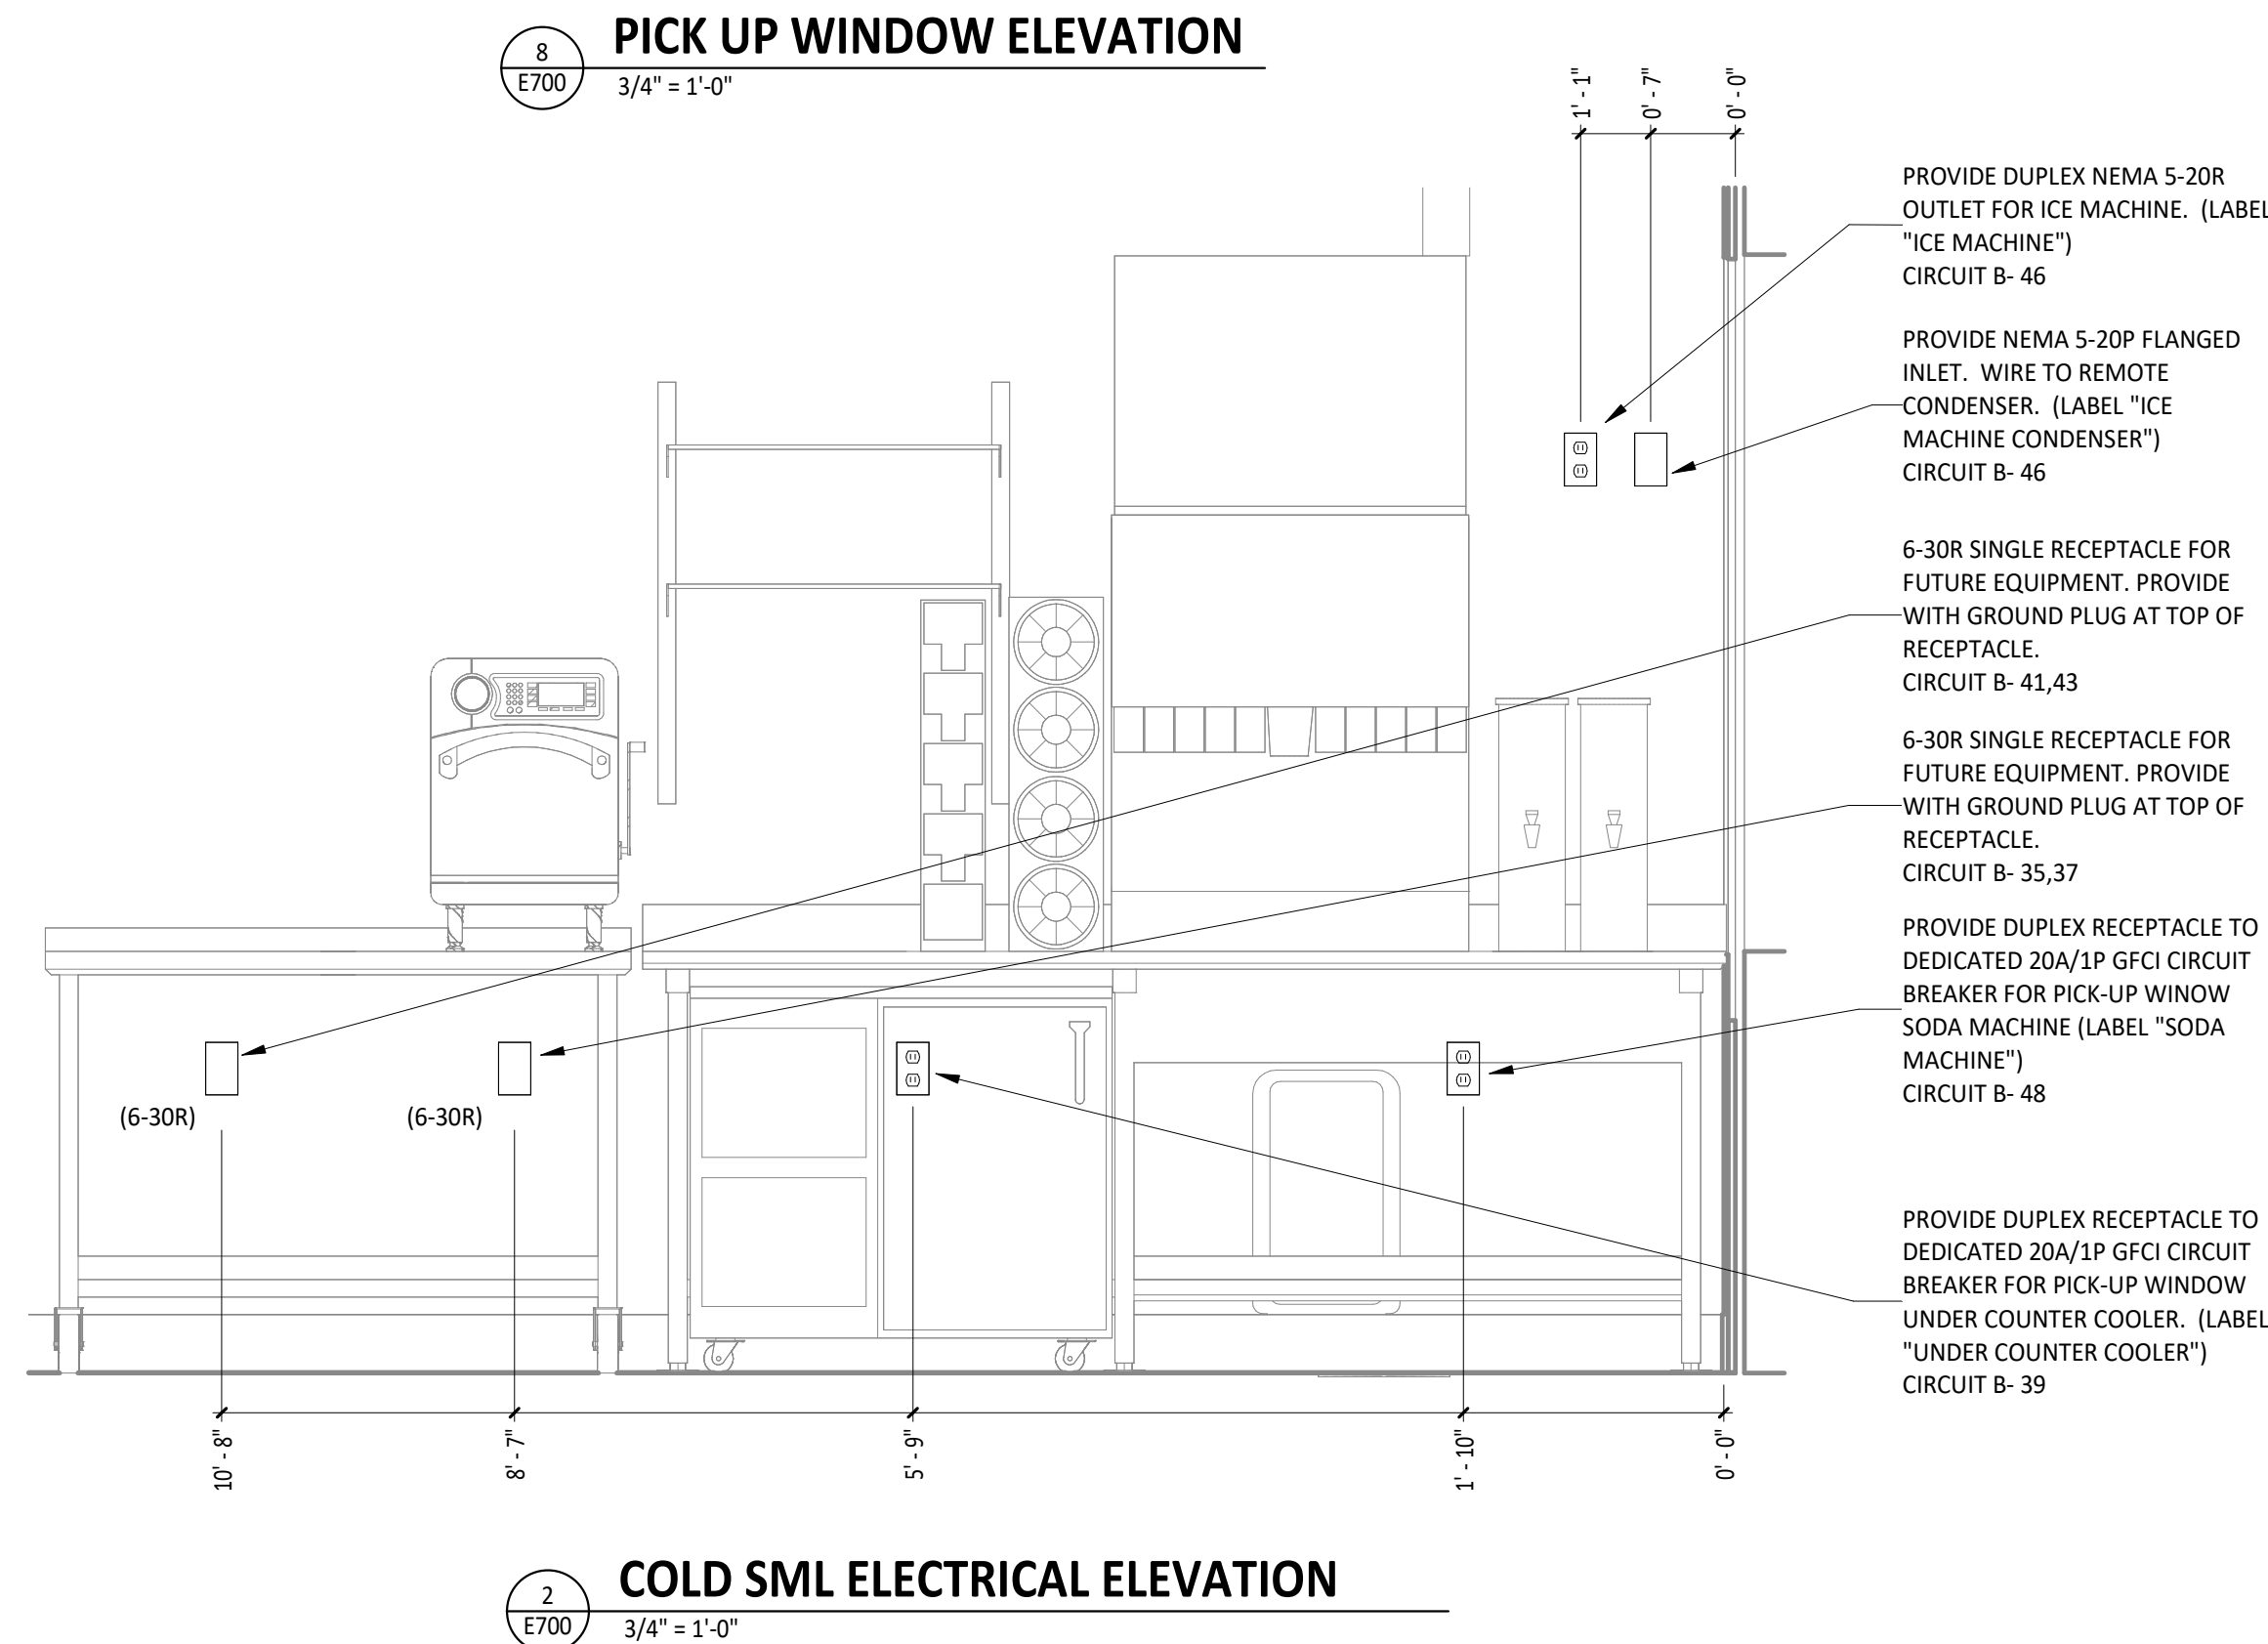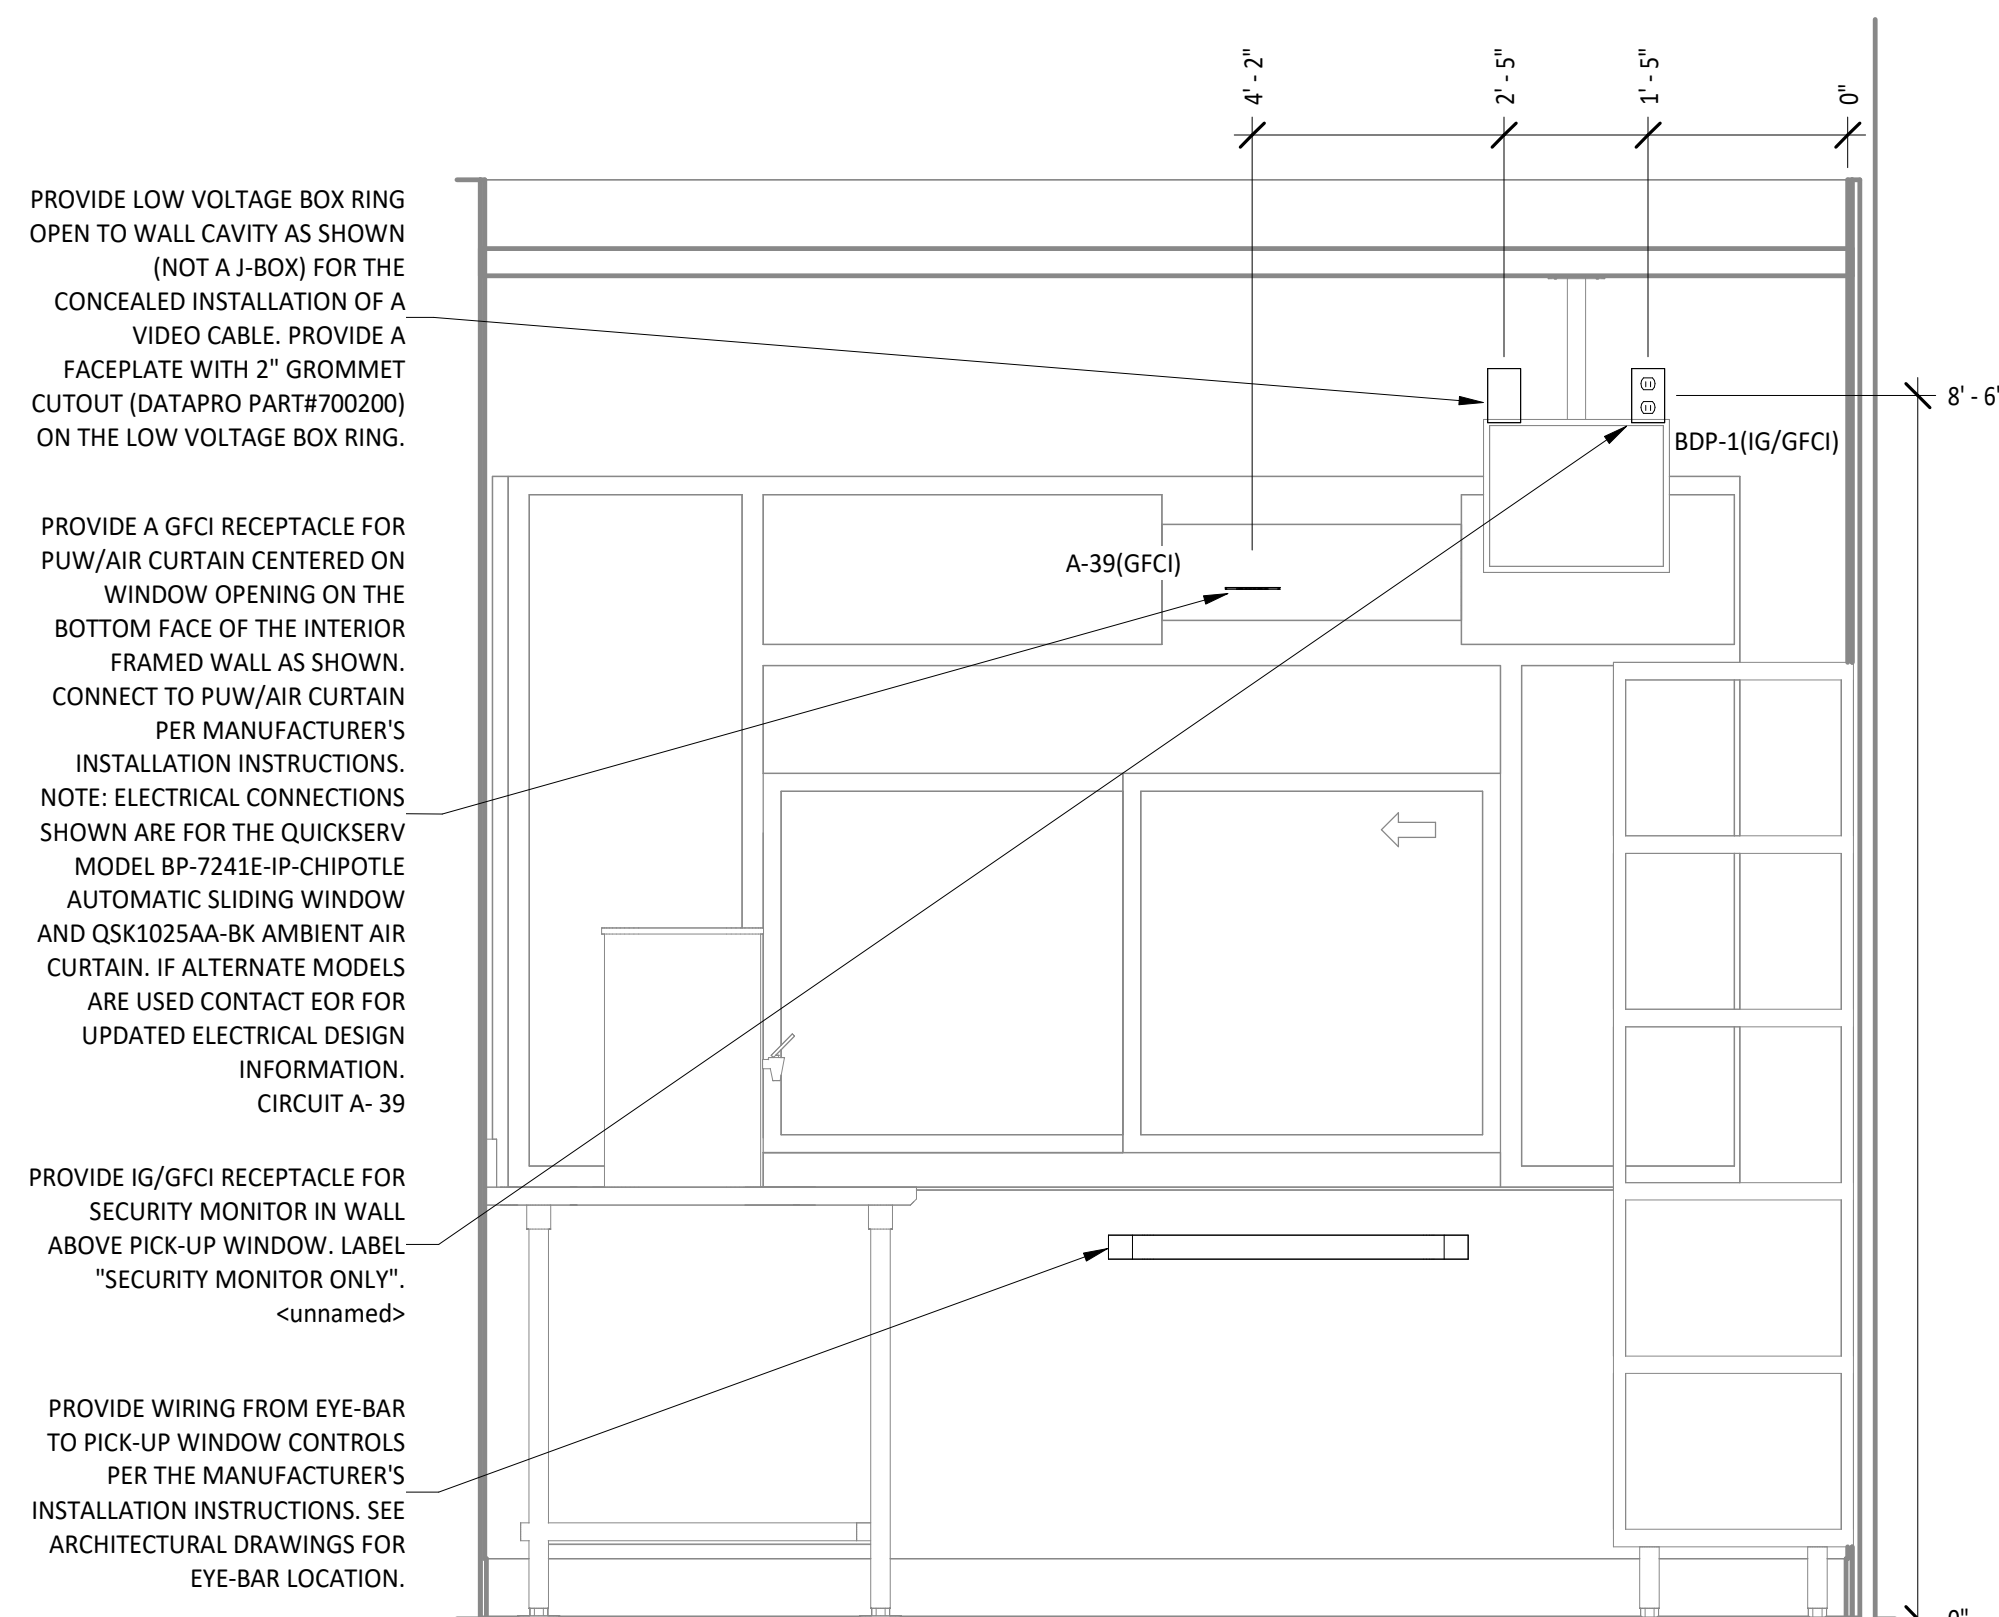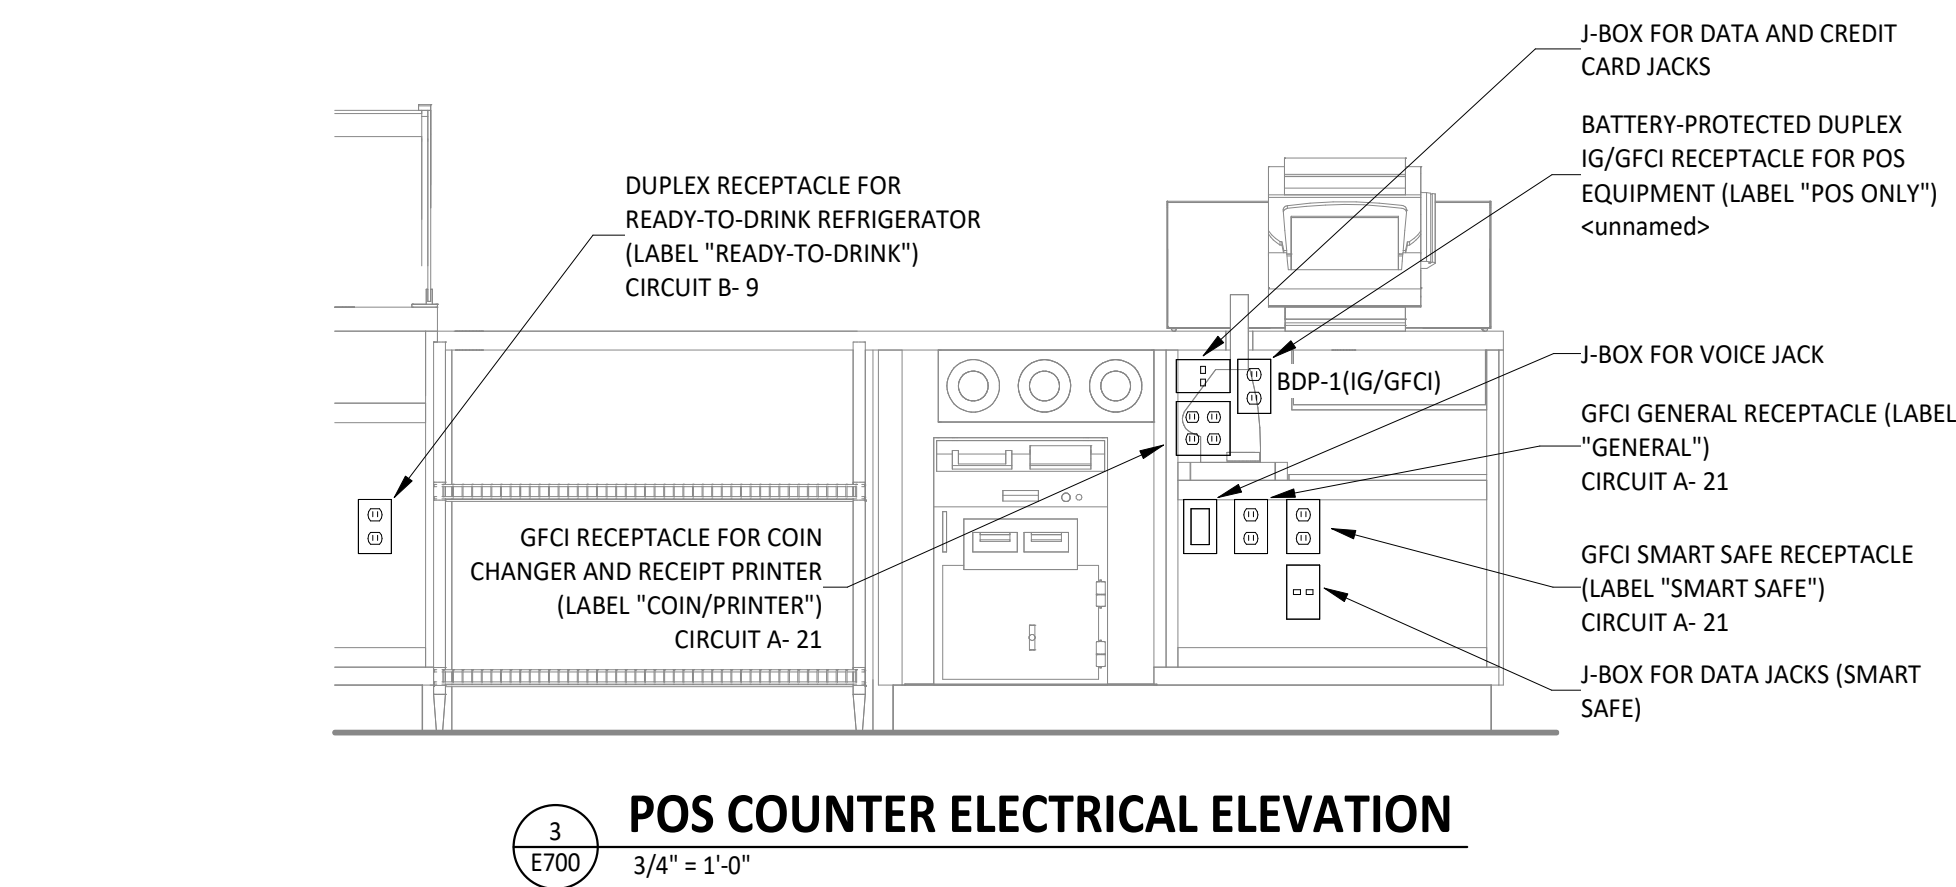

4635 Trueman Blvd. Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma
(720) 940-0260
Epalma@nationalengineering.com

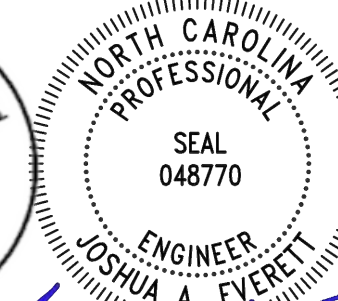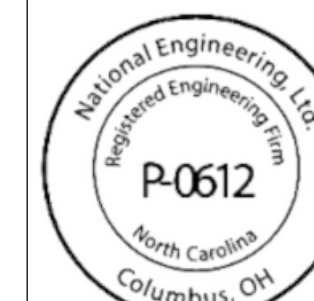

08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.CO

STORE NO.: 5644

"CAMERON NC"

NC 24-87

CAMERON, NC 28326

Issue Record:

03/07/2025	PERMIT SET
05/29/2025	BID SET

05/29/2025 BID SET

Revisions:


Drawn:	Checked:
EEP	Ali

Project No.
2402039


Contents:

ELECTRICAL INTERIOR ELEVATIONS


E700

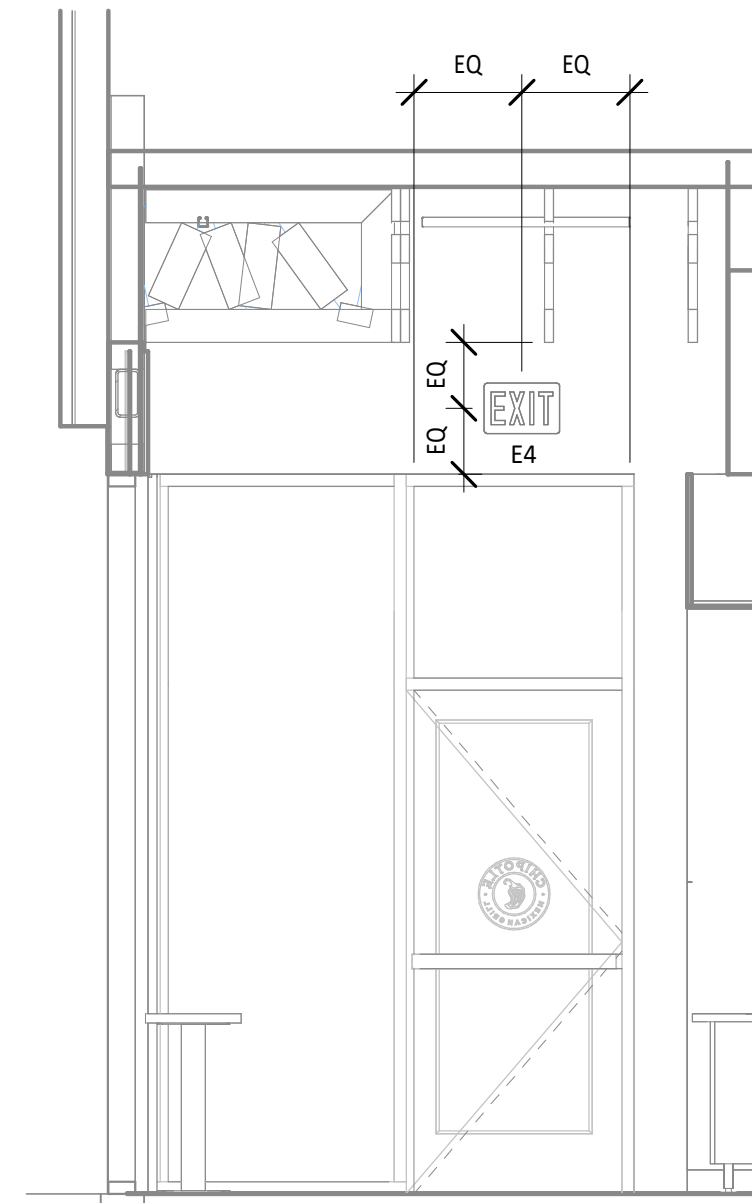

3 E705 DINING ROOM ELECTRICAL ELEVATION

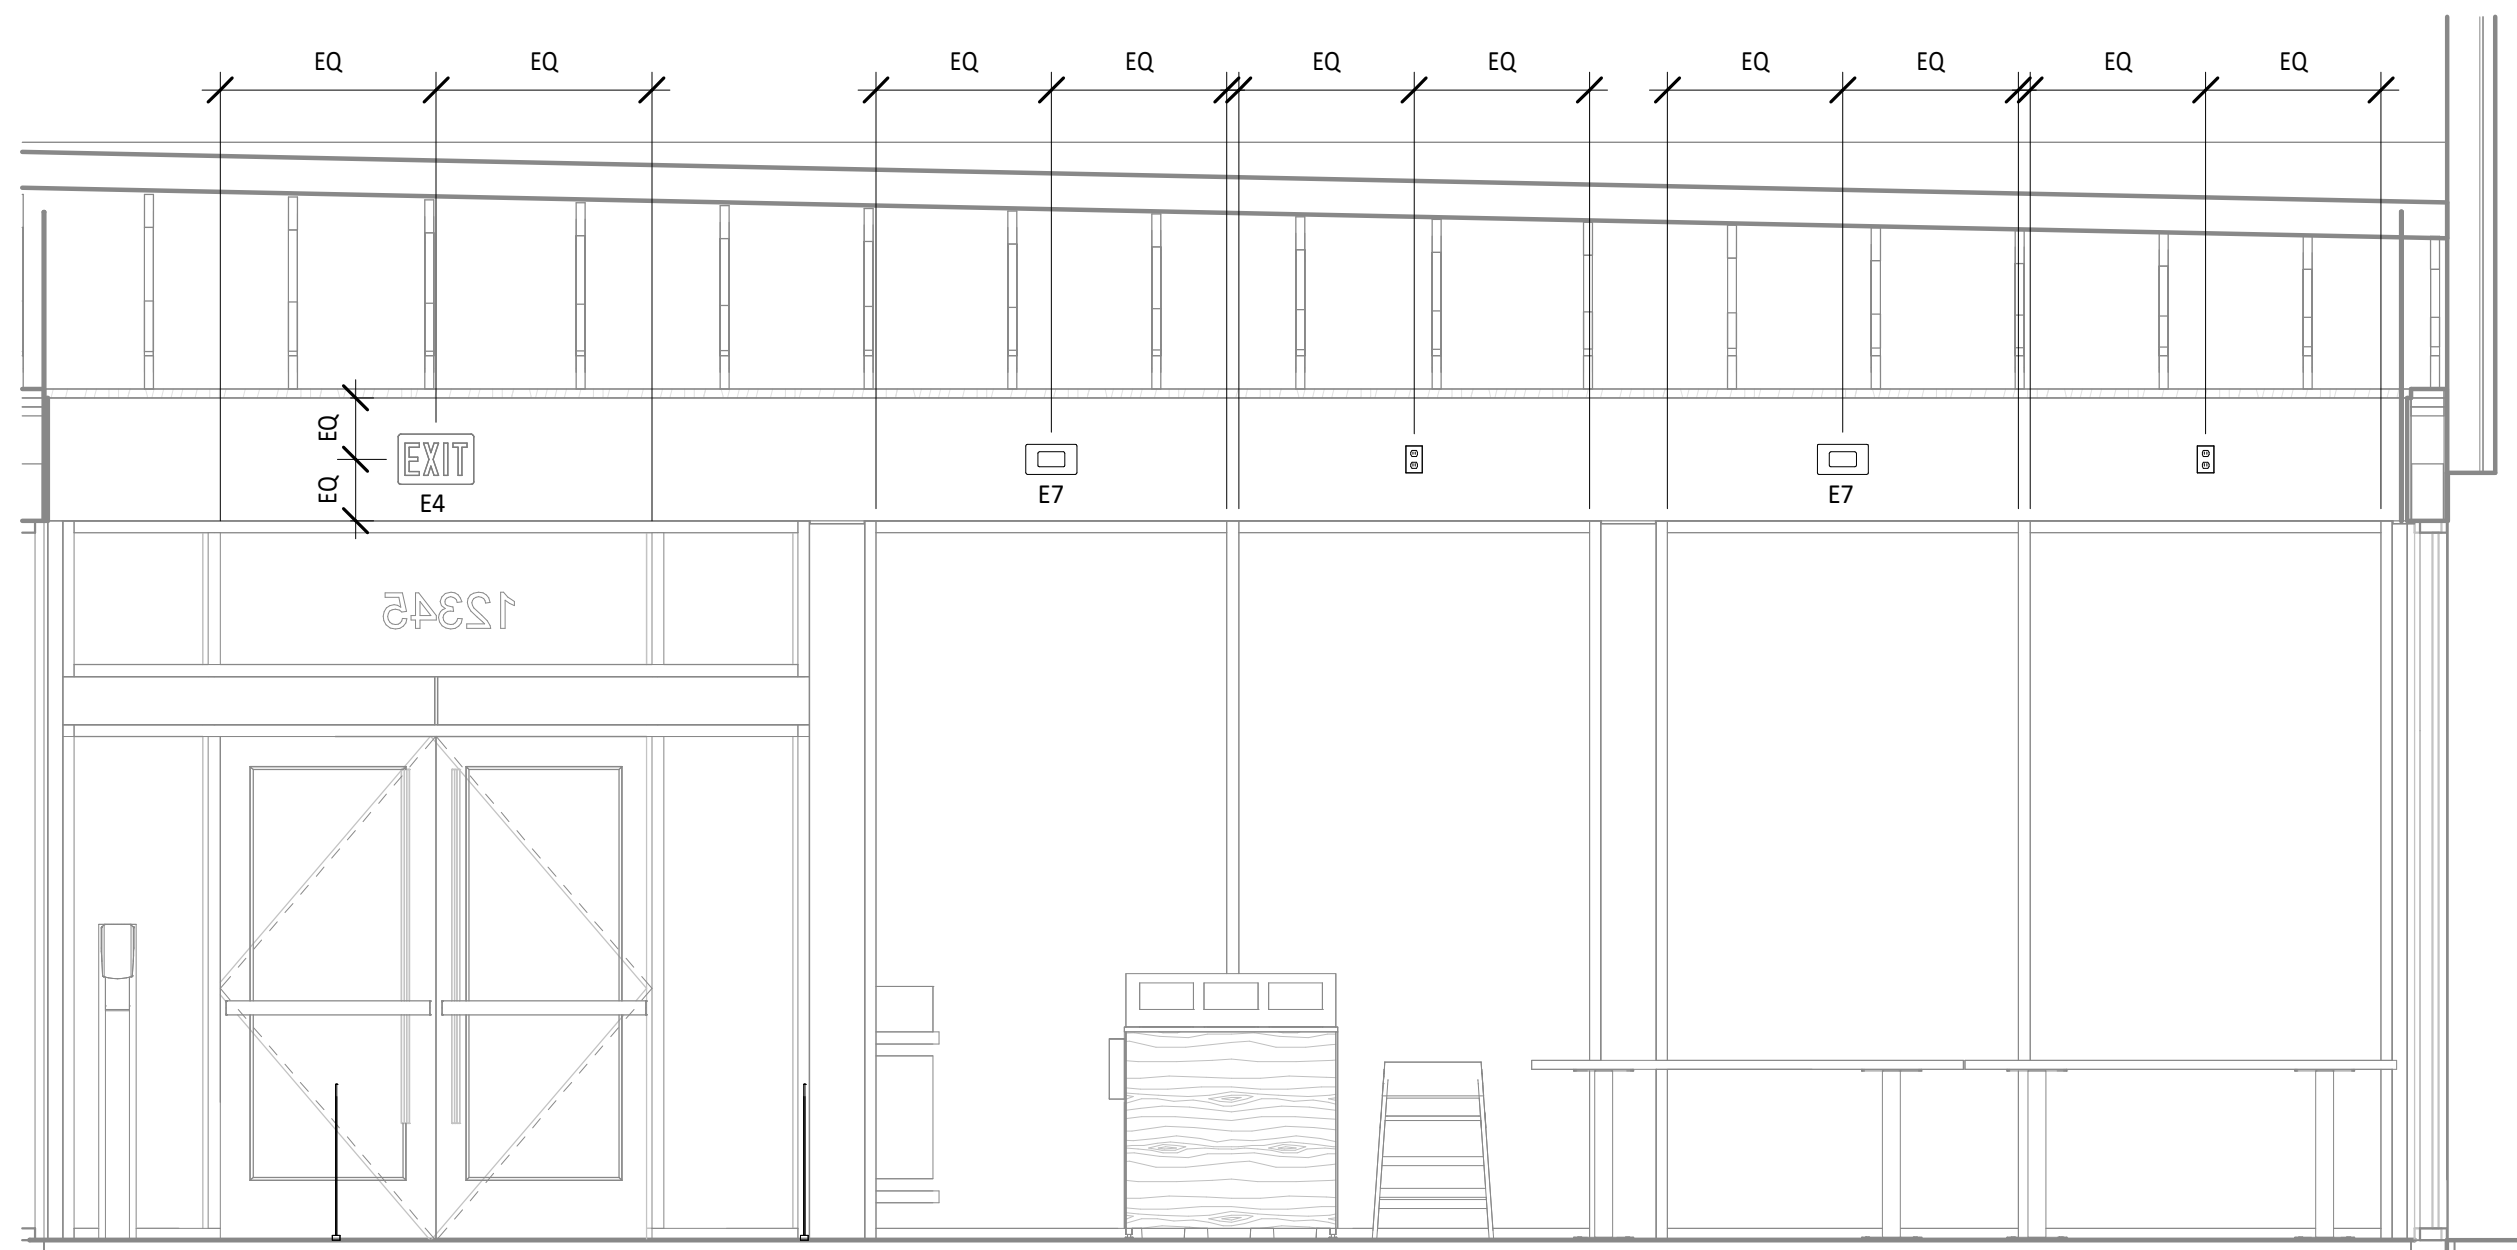

DINING ROOM ELECTRICAL ELEVATION

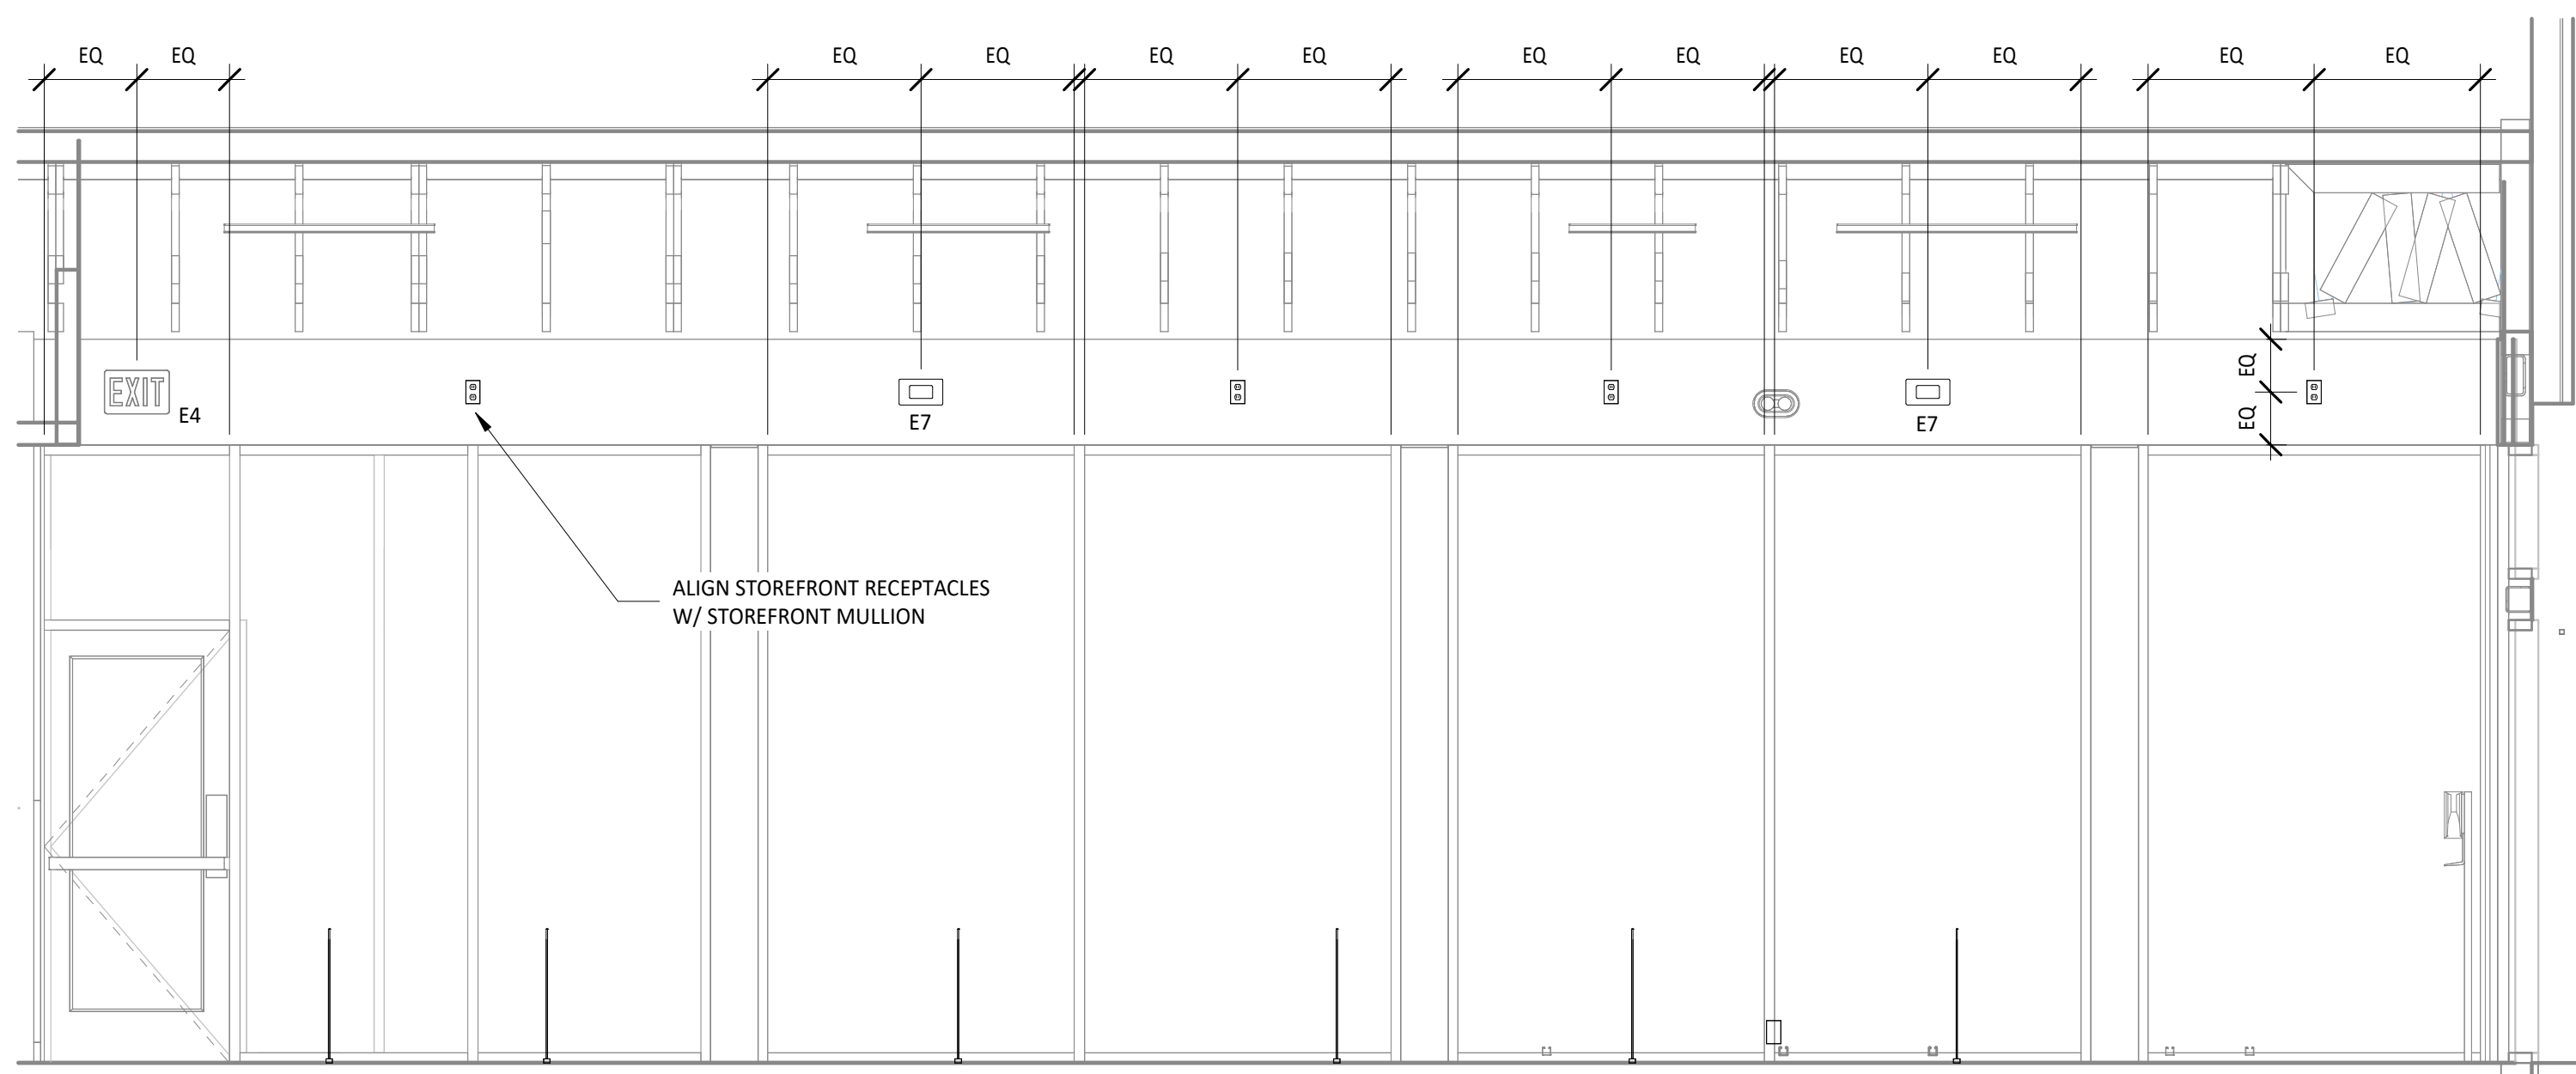

1 DINING ROOM ELECTRICAL ELEVATION

nsultant:



NATIONAL
ENGINEERING

635 Trueman Blvd. Suite 250

Hilliard, Ohio 43026

Phone: (614) 751-9610


Phone: (614) 751-9010
Fax: (614) 552-5240

Fax: (614) 552-5240

Contact: Edgar Palma

(720) 940-0260

alma@nationalengineering.com

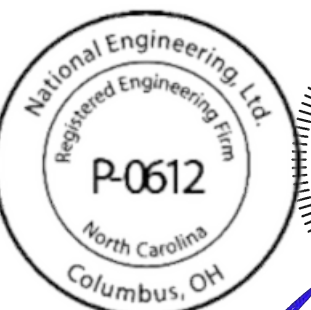

08/24/2026

THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
HIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
HIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644

NC 34 87

CAMERON, NC 28326

Due Record:	
03/07/2025	PERMIT SET
05/29/2025	BID SET

[illegible]

Drawn: _____ Checked: _____
 P. _____ AJJ

Project No.
402039

Contents:

ELECTRICAL INTERIOR ELEVATIONS

E705

GRIDPOINT DIAGRAM NOTES

1. INSTALL GRIDPOINT THERMOSTATS FURNISHED BY TEMS FOR RTU-1 AND RTU-2. PROVIDE THERMOSTAT WIRING FROM EACH THERMOSTAT TO THE CORRESPONDING ROOFTOP UNIT.
2. PROVIDE CAT5E CABLE FROM RTU-1 THERMOSTAT TO J-BOX #2 ABOVE ELECTRICAL PANELS (LEAVE 16" OF CABLE COILED UP INSIDE OF J-BOX #2 AND 16" BEHIND WALL OF THERMOSTAT FOR FINAL CONNECTION TO THE EMS SYSTEM BY THE TEMS) AND LABEL BOTH ENDS OF CABLE "TSTATS".
3. PROVIDE CAT5E CABLE(S) BETWEEN THERMOSTATS (LEAVE 16" OF CABLE BEHIND WALL OF EACH THERMOSTAT FOR FINAL CONNECTION BY THE TEMS) AND LABEL BOTH ENDS OF CABLE "TSTAT JUMPER". SEE GRIDPOINT INSTALLATION INSTRUCTIONS FOR TERMINATION INSTRUCTIONS.
4. INSTALL GRIDPOINT ZONE SENSOR MODULES FURNISHED BY TEMS AS SHOWN ON HVAC FLOOR PLAN. PROVIDE 18G-24G SHIELDED TWISTED PAIR FROM ZSM TO CORRESPONDING THERMOSTAT T1 TERMINALS. SEE GRIDPOINT INSTALLATION INSTRUCTIONS FOR TERMINATION INSTRUCTIONS.
5. INSTALL GRIDPOINT SUPPLY PROBE FURNISHED BY TEMS AS SHOWN ON HVAC FLOOR PLAN. PROVIDE 18G-24G SHIELDED TWISTED PAIR FROM SUPPLY PROBE TO CORRESPONDING THERMOSTAT T2 TERMINALS. SEE GRIDPOINT INSTALLATION INSTRUCTIONS FOR TERMINATION INSTRUCTIONS.
6. PROVIDE 3/4" LIQUIDTIGHT CONDUIT FROM DISH SANITIZING MACHINE TO LOW-VOLTAGE JUNCTION BOX OR TRIM RING FLUSH MOUNTED TO WALL. PROVIDE CONTINUOUS (NOT SPLICED) CAT5E CABLE FROM DISH SANITIZING MACHINE TO OFFICE (ABOVE LAY-IN CEILING) WITH 54" SLACK WITHIN THE DISH MACHINE AND 10' SLACK ABOVE THE LAY-IN CEILING. PROVIDE RJ-12 PLUG ON CABLE AT DISH MACHINE END WITH BLUE WIRE CONNECTED TO PIN 3 AND BLUE/WHITE WIRE CONNECTED TO PIN 4. LABEL CABLE ON BOTH ENDS WITH "DISHWASHER".
7. PROVIDE CAT5 CABLE FROM J-BOX #2 TO OFFICE ABOVE LAY-IN CEILING AND LABEL "RS-485 COMMS" ON BOTH ENDS OF THE CABLE. LEAVE 10' OF SLACK CABLE ABOVE OFFICE CEILING AND 16" OF SLACK CABLE INSIDE OF J-BOX #2.
8. PROVIDE CABLE (18-24AWG SHIELDED TWISTED PAIR) FROM J-BOX #2 TO OFFICE ABOVE LAY-IN CEILING AND LABEL "EMS POWER" ON BOTH ENDS OF THE CABLE. LEAVE 10' OF SLACK CABLE ABOVE OFFICE CEILING AND 16" OF SLACK CABLE INSIDE OF J-BOX #2.
9. PROVIDE SURFACE MOUNT 10" X 10" X 4" NEMA 1 ENCLOSURES ABOVE PANELBOARDS AND 6" BELOW CEILING.
10. PROVIDE 3/4" CONDUIT WITH INSULATING BUSHING ON END CONCEALED IN WALL FROM J-BOX #2 TO 6" ABOVE LAY-IN CEILING.
11. PROVIDE 3/4" CONDUIT(S) FROM J-BOX #1 TO J-BOX #2.
12. PROVIDE EMPTY 1" CONDUIT(S) FROM PANELBOARD(S) TO J-BOX #1 FOR FUTURE CT WIRING BY TEMS.
13. FIRST PANELBOARD FED FROM ELECTRICAL SERVICE. PROVIDE WITH (1) 20A/3-POLE CIRCUIT BREAKER (FOR GRIDPOINT'S 3-PHASE METER). IF PANELBOARD HAS 120V CIRCUITS AVAILABLE THEN ALSO PROVIDE (1) 20/1-POLE CIRCUIT BREAKER (FOR GRIDPOINT TRANSFORMER).
14. IF SPACE HAS MULTIPLE ELECTRICAL SERVICES THEN PROVIDE A "J-BOX #1" AND ASSOCIATED BREAKERS, CONDUITS, AND CONDUCTORS ON THE FIRST PANELBOARD FED FROM EACH ELECTRICAL SERVICE.
15. FOR EACH ELECTRICAL SERVICE PROVIDE (1) SET OF [(4) #12, #12 G.] FROM 3-POLE GRIDPOINT CIRCUIT BREAKER AND, IF THE PANELBOARD HAS 120V CIRCUITS AVAILABLE, (1) SET OF [(2) #12, #12 G.] FROM 1-POLE GRIDPOINT CIRCUIT BREAKER IN 3/4" CONDUIT CONCEALED IN WALL TO J-BOX #1. TERMINATE IN J-BOX #1 WITH 16" SLACK FOR FINAL CONNECTION BY TEMS.
16. IF THE PANELBOARD DOES NOT HAVE 120V CIRCUITS AVAILABLE PROVIDE A 1-POLE 120V 20A CIRCUIT BREAKER IN A PANEL WITH A 120V CIRCUIT AVAILABLE. PROVIDE (1) SET OF [(2) #12, #12 G.] FROM THE GRIDPOINT CIRCUIT BREAKER IN 3/4" CONDUIT CONCEALED IN WALL TO J-BOX #1. TERMINATE IN J-BOX #1 WITH 16" SLACK FOR FINAL CONNECTION BY TEMS.
17. GRIDPOINT CONTROLLER PROVIDED BY TEMS
18. PROVIDE HORIZONTAL SINGLE-GANG J-BOX BELOW FUTURE GRIDPOINT CONTROLLER LOCATION AS SHOWN. PROVIDE 3/4" CONDUIT WITH PULL STRING AND INSULATING BUSHING FROM J-BOX TO 6" ABOVE OFFICE LAY-IN CEILING.

NOTE:
ARRANGEMENT SHOWN IS
DIAGRAMMATIC - SEE PLANS FOR ACTUAL
DEVICE LOCATIONS.

WARE WASHING

PANELBOARD AREA


GRIDPOINT WIRING DIAGRAM

8
E710

N.T.S.

SEQUENCE OF OPERATIONS


- A. EMERGENCY LIGHT FIXTURES, EXIT SIGNS, LOCALLY-SWITCHED FIXTURES, AND FIXTURES DESIGNATED AS NIGHT LIGHTS ARE NOT CONTROLLED THROUGH THE RELAY PANEL.
- B. ALL TIMES NOTED SHALL BE LOCAL TIME AND SHALL AUTOMATICALLY ADJUST FOR DAYLIGHT SAVINGS TIME, IF APPLICABLE.
- C. ALL KITCHEN LIGHTING CIRCUITS AND RESTROOM EXHAUST FAN CIRCUIT (R1, R2, R7) SHALL BE ENERGIZED AT FULL POWER FROM 7:00AM UNTIL MIDNIGHT AND SHALL BE DE-ENERGIZED AT OTHER TIMES.
- D. ALL DINING ROOM LIGHTING CIRCUITS (R4, R5, R6) SHALL BE ENERGIZED FROM 10:00AM UNTIL MIDNIGHT AND SHALL BE DE-ENERGIZED AT OTHER TIMES.
- E. EXTERIOR LIGHTING/SIGNAGE RELAY (R8) SHALL BE ENERGIZED FROM ONE HOUR BEFORE SUNSET UNTIL ONE HOUR AFTER CLOSING AND SHALL BE DE-ENERGIZED AT OTHER TIMES.
- F. OVERRIDES: WHEN ONE OF THE OVERRIDE BUTTONS IS PRESSED THE SYSTEM WILL GO INTO OVERRIDE MODE FOR THE DURATION NOTED BELOW OR UNTIL THE NEXT SCHEDULED EVENT. FOLLOWING THIS PERIOD THE RELAYS WILL RETURN TO THE CURRENT SCHEDULED CONDITION. DURING THIS OVERRIDE TIME THE CORRESPONDING LAMP WILL ILLUMINATE ON THE OVERRIDE BUTTON.
- G. INTERIOR (CHANNEL 1): WHEN THE INTERIOR OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 1) RELAYS R1, R2, R4, R5, R6, AND R7 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
- H. KITCHEN DIMMING (CHANNEL 2): WHEN THE KITCHEN NORMAL/DIM OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 2) RELAY R2 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
- I. DINING DIMMING (CHANNEL 3): WHEN THE DINING NORMAL/DIM OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 3) RELAYS R5 AND R6 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
- J. EXTERIOR (CHANNEL 4): WHEN THE EXTERIOR OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 4) RELAY R8 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
- K. VERIFY THAT TIME, TIME ZONE, AND LONGITUDE/LATITUDE ARE SET CORRECTLY ON LCP. VERIFY WITH STORE OPERATIONS THAT THE ON/OFF TIMES ARE COMPATIBLE WITH THE STORE OPERATING HOURS PRIOR TO TURNOVER.

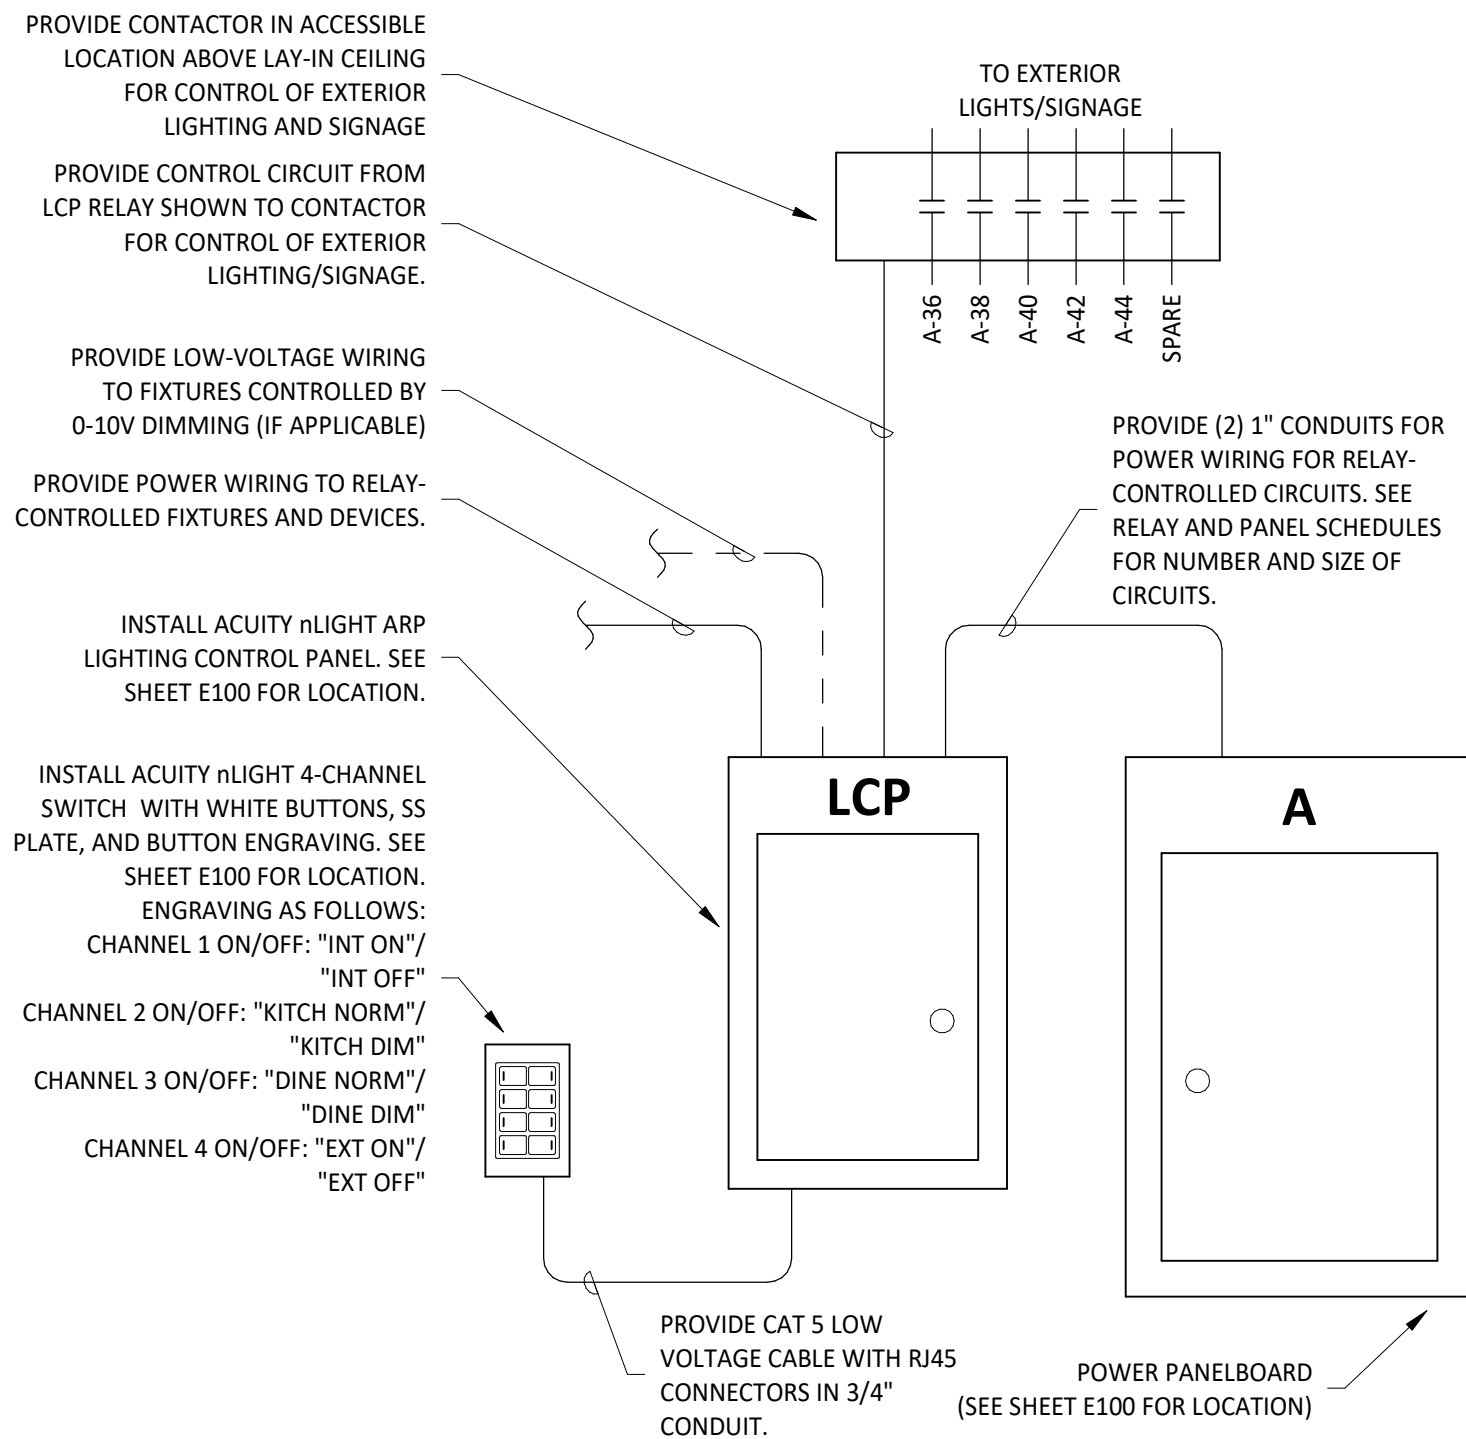

INTERIOR LIGHTING CONTROL DIAGRAM

6
E710


N.T.S.

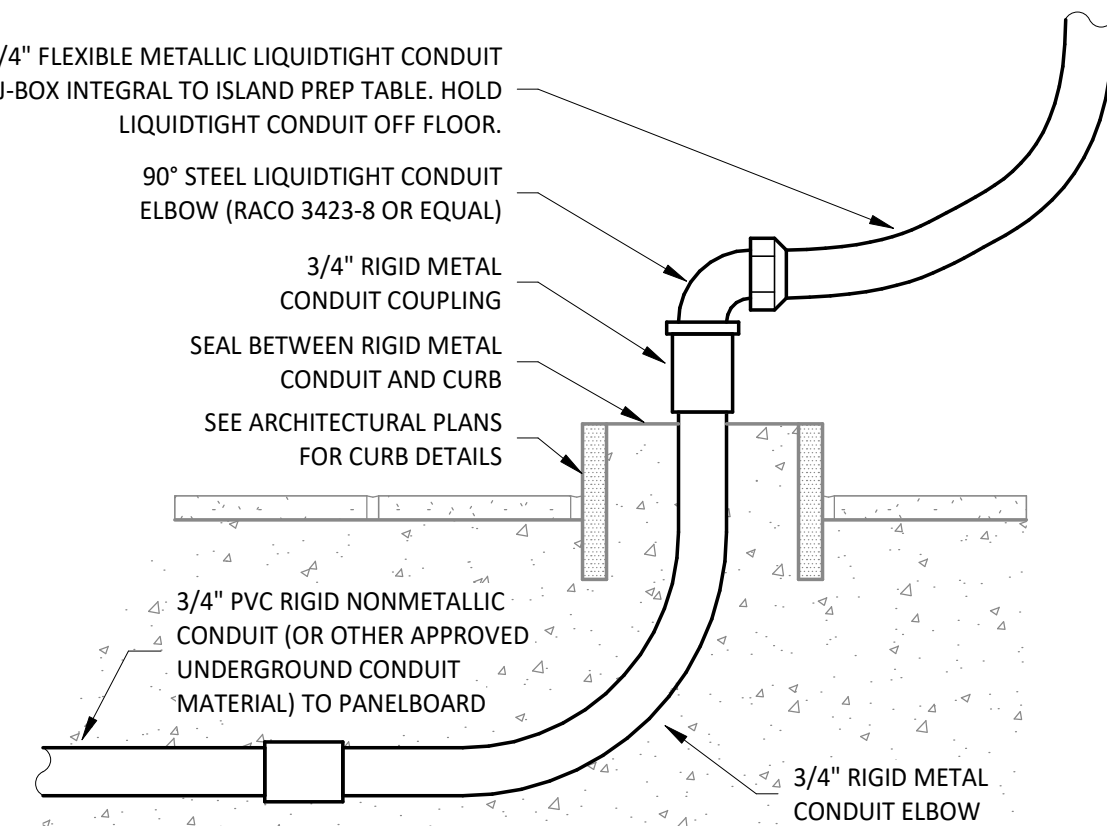

PEDESTAL OUTLET DETAIL

2
E710

N.T.S.

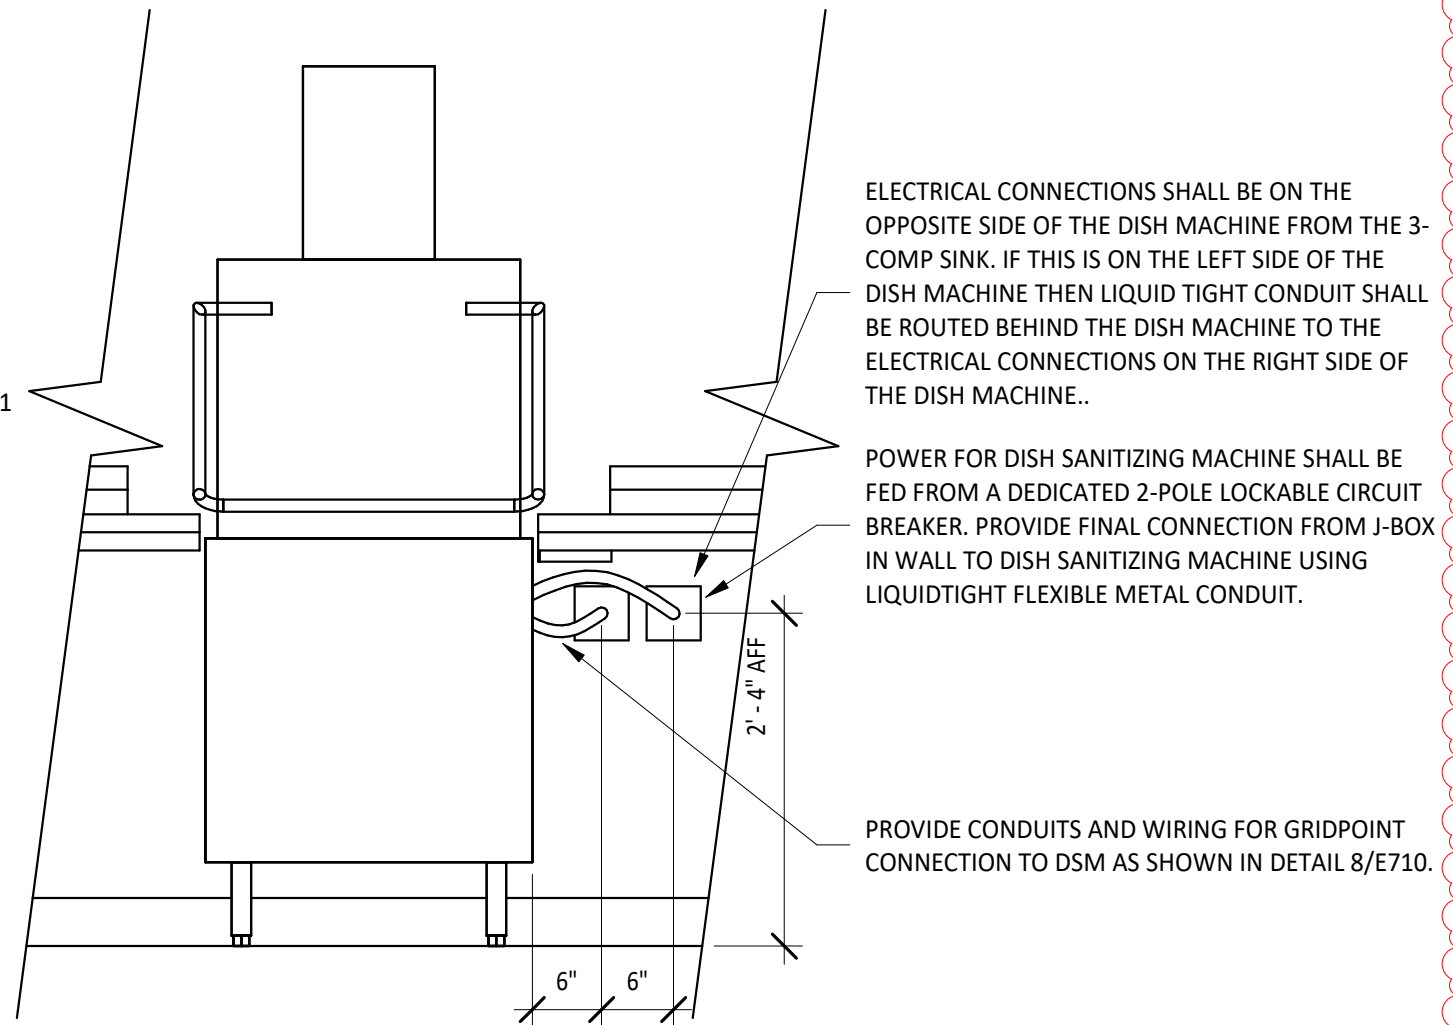


DISH SANITIZING MACHINE ELECTRICAL DETAIL

7
E710

N.T.S.


CO2 ALARM OPTIONS	
CO2 DETECTOR	X
CO2 REMOTE DISPLAY UNIT	X
REMOTE STROBE	
RELAY	

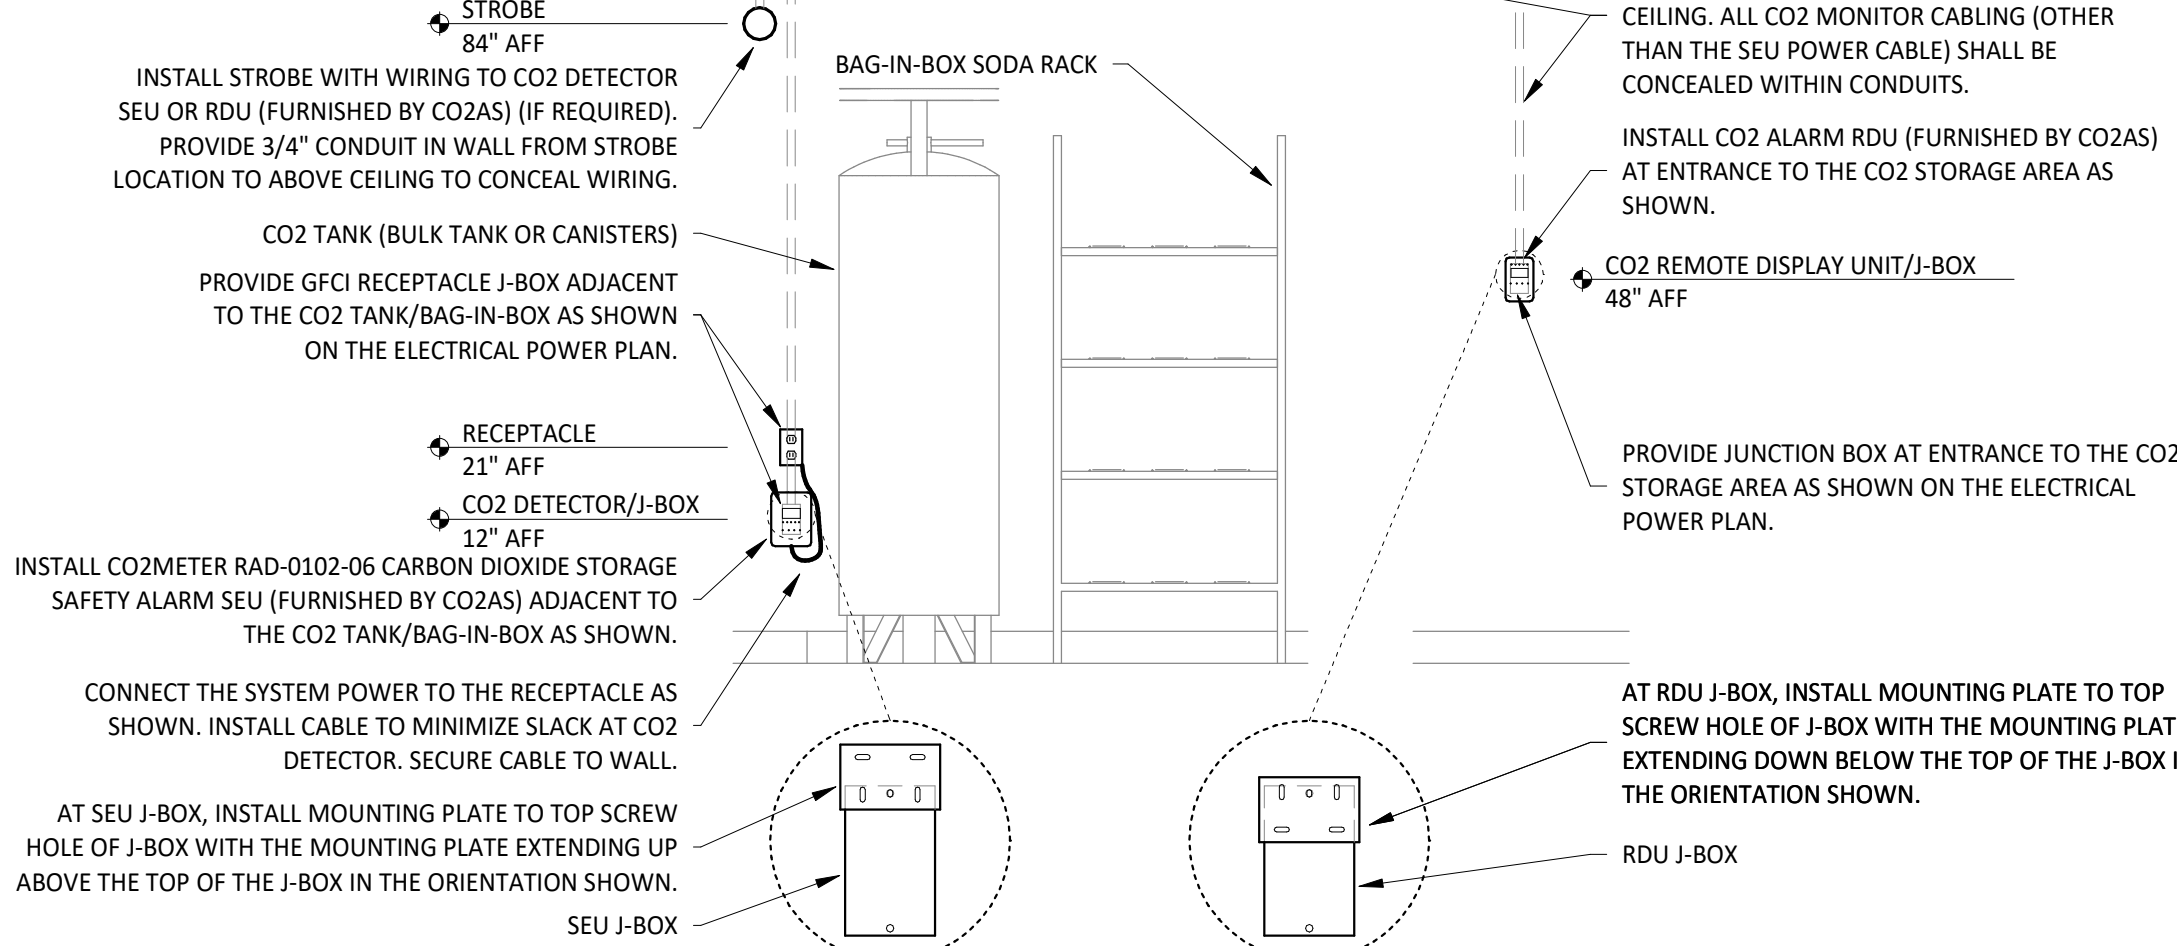

CO2 ALARM DETAIL

4
E710


N.T.S.

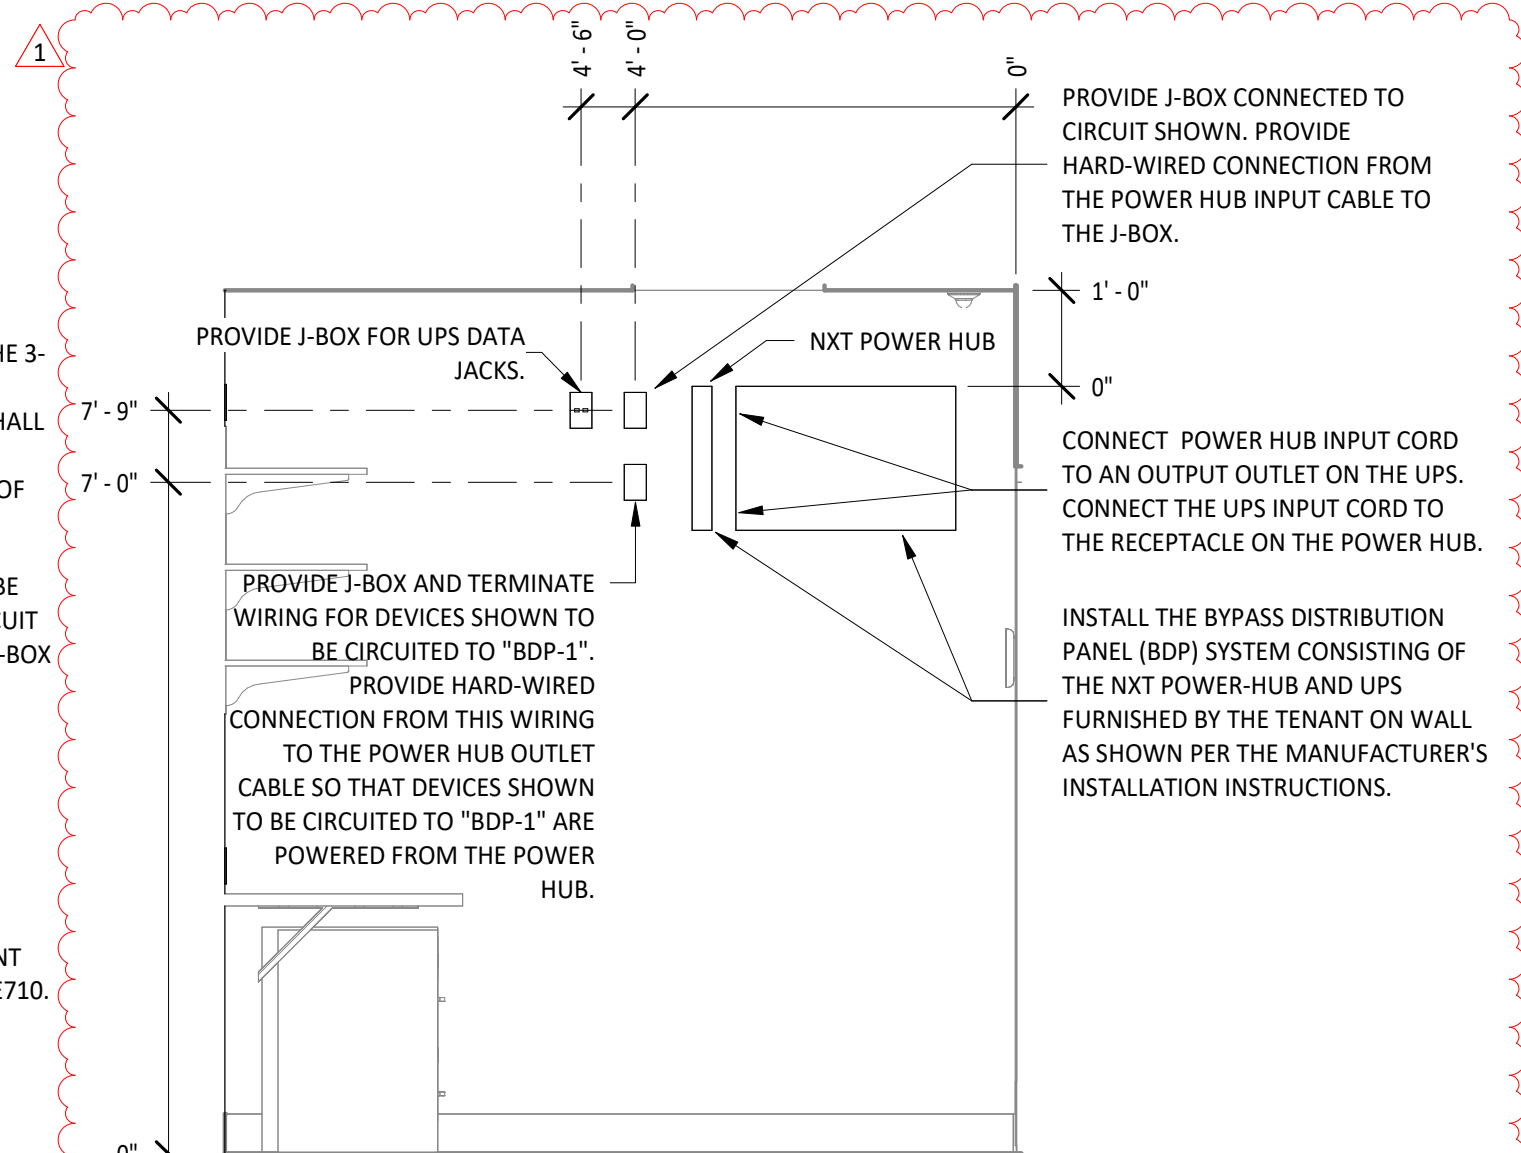

BDP/UPS ELEVATION

3
E710

1/2" = 1'-0"

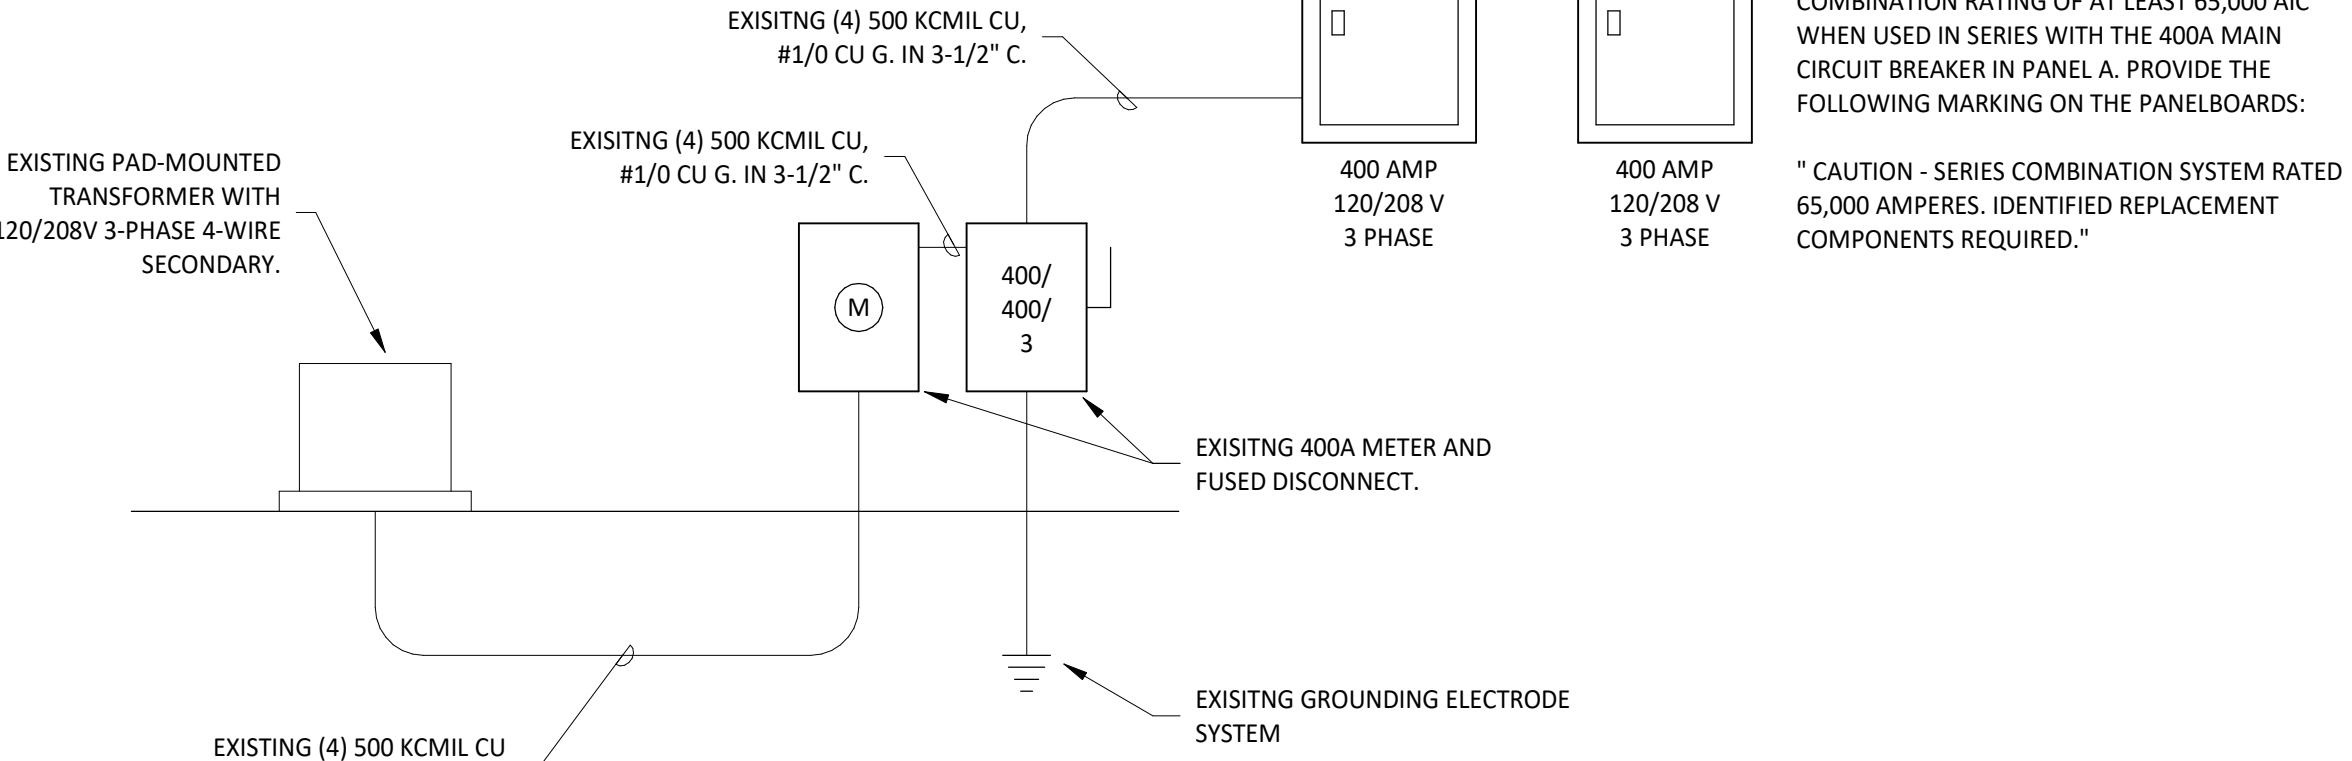

MAIN DISTRIBUTION DIAGRAM

1
E710

N.T.S.

Consultant:



4635 Trueman Blvd, Suite 250
Hilliard, Ohio 43026
Phone: (614) 751-9610
Fax: (614) 552-5240
Contact: Edgar Palma (720) 940-0260
Epalma@nationalengineering.com



08/24/2026

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE
AND AS SUCH REMAINS THE PROPERTY OF
CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR
USE OF THIS DOCUMENT IS LIMITED AND CAN BE
EXTENDED ONLY BY WRITTEN AGREEMENT WITH
CHIPOTLE MEXICAN GRILL, INC..



CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 5644
"CAMERON NC"
NC 24-87
CAMERON, NC 28326

Issue Record:
03/07/2025 PERMIT SET
05/29/2025 BID SET

Revisions:
1 08/21/2026 FINISH & DB UPDATES

Drawn: EEP
Checked: AJJ

Project No:
2402039

Contents:

ELECTRICAL DETAILS

E710