



**FIELD REPORT**

Project: Serenity Amenity Client: TriPointe Date: 01/22/26  
 City: Fuquay Forman: Austin Contractor: Inland  
 Temperature: 57 Weather Conditions: Overcast Number of Trips: 1  
 Personnel: Austin G Notified Austin of Inland of results  
 1<sup>st</sup> Trip Arrived: 1:00 pm Left: 4:30 pm 2<sup>nd</sup> Trip Arrived: \_\_\_\_\_ Left: \_\_\_\_\_

**REMARKS**

TME personnel arrived on site as requested by the contractor. Austin from Inland Construction was on site. Tech evaluated Cantilevered Retaining Wall footers subgrade via half inch probe rod. Tech observed subgrade to be firm bearing. Tech evaluated mail kiosk subgrade for mud mat and observed subgrade to be firm bearing. Tech sampled concrete, testing for approximate air %, slump, and sample cylinders. Tech created 5 cylinders and stored them in cure box. Tech will return following day to take cylinder samples to lab once they have cured.

**CMU Wall footers**




Signature: *Austin G. Roth*

TME's presence on site is to perform specific services limited to that scheduled by others based on the understanding of our agreement with our client. This report is not an acceptance or approval of site activities. Test results and inspections are representative of our observations only while onsite at that specific time and location and may vary at other locations. The frequency of testing is based on timely scheduling of work by others and properly conveying progress of work in progress. At no time will TME be responsible for Safety considerations for other parties on the site.



FIELD REPORT ATTACHMENTS

Project: Serenity Amenity Client: TriPointe Date: 01/22/26

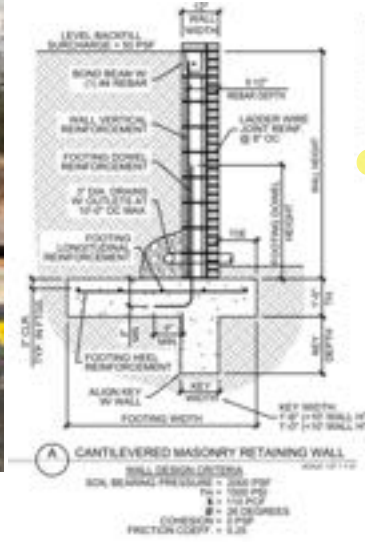


**RETAINING WALL DESIGN TABLE**

WALL HEIGHT	FOOTING WIDTH	KEY WIDTH	KEY DEPTH	FOOTING REINFORCEMENT	WALL VERTICAL REINFORCEMENT	FOOTING VERTICAL REINFORCEMENT	FOOTING HORIZONTAL REINFORCEMENT
10'-0" TO 12'-0"	1'-0"	1'-0"	1'-0"	4#4	#4 @ 12" OC	#4 @ 12" OC	#4 @ 12" OC
8'-0" TO 10'-0"	1'-0"	1'-0"	1'-0"	4#4	#4 @ 12" OC	#4 @ 12" OC	#4 @ 12" OC
6'-0" TO 8'-0"	1'-0"	1'-0"	1'-0"	4#4	#4 @ 12" OC	#4 @ 12" OC	#4 @ 12" OC
4'-0" TO 6'-0"	1'-0"	1'-0"	1'-0"	4#4	#4 @ 12" OC	#4 @ 12" OC	#4 @ 12" OC
2'-0" TO 4'-0"	1'-0"	1'-0"	1'-0"	4#4	#4 @ 12" OC	#4 @ 12" OC	#4 @ 12" OC



Truck ticket

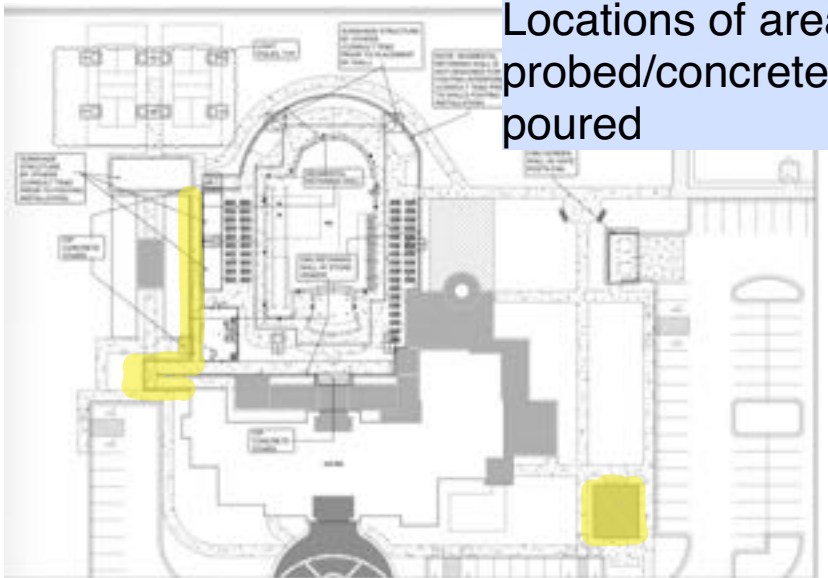

Locations of areas probed/concrete poured

All locations should be considered approximate and were not surveyed.



**CONCRETE FIELD REPORT**

Project: Serenity Amenity Client: TriPointe Date: 01/22/26  
 City: Fuquay Arrived On-Site: 1:00 pm Left Site: 4:30 pm  
 Temperature: 57 Weather Conditions: Overcast Number of Trips: \_\_\_\_\_  
 Material(s) Tested:  Slab  Foundation  Wall  Masonry  Other: Wall Footer  
 Personnel: Austin G Notified Austin of Inland Construction of results  
 Concrete Supplier: Concrete Supply Co. Specified Strength: 3,000 psi Specified Slump: 5.0 inches  
 Concrete Strength on ticket: 3,000 psi

**TEST DATA**

Truck No.	Batch Time	Plant No.	Ticket No.	Size of Load	Sample	Slump (in)	Air %	Unit Wt. (pcf)	H2O Added (gallons)	Concrete Temp.	No. of Test Samples	Daily Set No.
3,806	14:03	1	237004594	10.00	15:15	3.9	3.00	144.91	0.00	61	5	1

Daily Set No.	Sample Type	Specified Strength	Detailed Location
1	Concrete	3,000 psi	Cantilevered Retaining Wall Footers
		psi	
		psi	
		psi	
		psi	
		psi	

The above report is the field rendition of the author only and subject to review