




FIELD REPORT

Project: Serenity Amenity Client: TriPointe Date: 01/23/26
City: Fuquay Forman: Austin Contractor: Inland
Temperature: 47 Weather Conditions: Cloudy Number of Trips: 1
Personnel: Austin G Notified Austin of Inland of results
1st Trip Arrived: 12:30 pm Left: 5:30 pm 2nd Trip Arrived: Left:

REMARKS

TME personnel arrived on site as requested by the contractor. Austin from Inland Construction was on site. Tech evaluated Cantilevered Retaining Wall footing subgrade via half inch probe rod. Tech observed subgrade to be firm bearing. Tech evaluated rebar and observed rebar to be correct in length and orientation. Tech sampled concrete, testing for approximate air %, slump, and made sample cylinders. Tech created 5 cylinders and stored them in cure box. Tech will return the following day to transport cylinder samples to lab. Tech was notified that after tech had sampled concrete, contractor added 10 gallons of water to concrete truck. Slump was 8.5" but the specified slump was 5". Tech also retrieved cylinders from previous days sampling, transported to the lab.

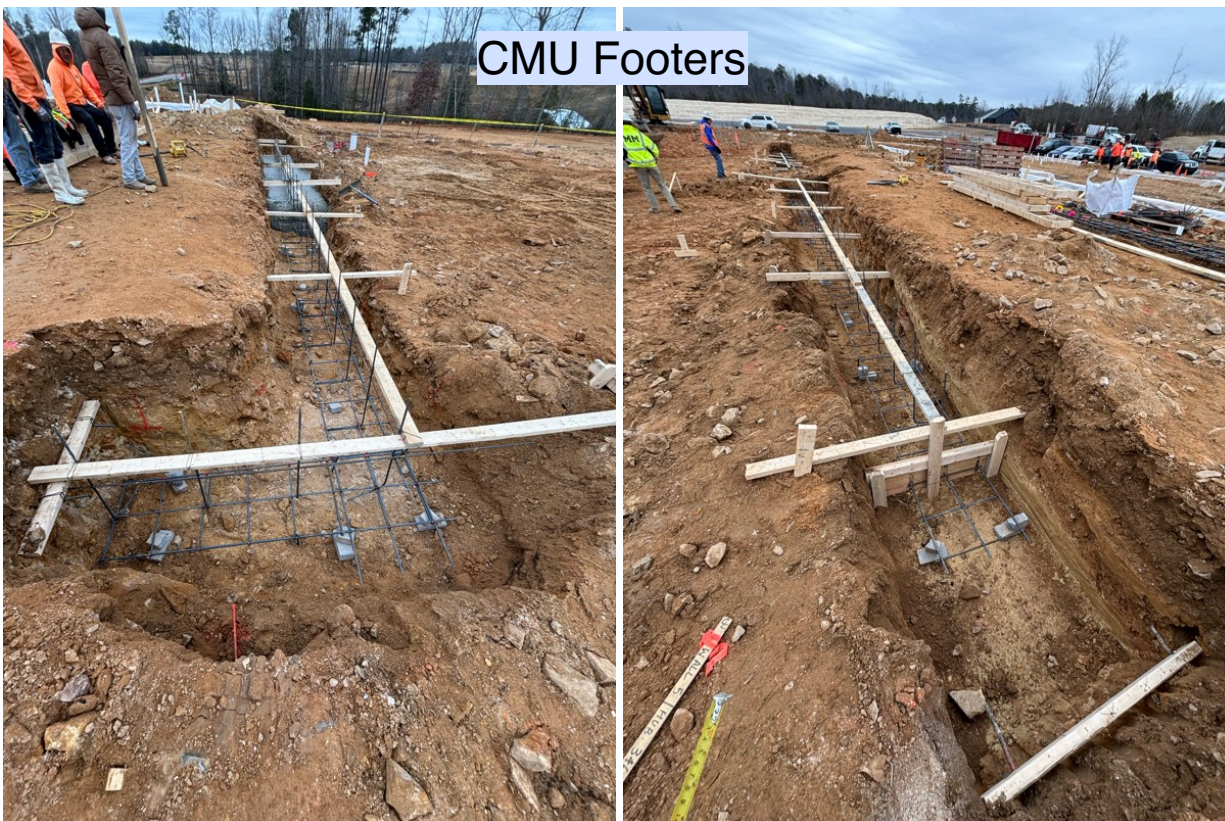

Signature: Austin G. Roth

TME's presence on site is to perform specific services limited to that scheduled by others based on the understanding of our agreement with our client. This report is not an acceptance or approval of site activities. Test results and inspections are representative of our observations only while onsite at that specific time and location and may vary at other locations. The frequency of testing is based on timely scheduling of work by others and properly conveying progress of work in progress. At no time will TME be responsible for Safety considerations for other parties on the site.



**CONCRETE FIELD REPORT**

Project: Serenity Amenity Client: TriPointe Date: 01/23/26  
 City: Fuquay Arrived On-Site: 12:30 pm Left Site: 5:30 pm  
 Temperature: 47 Weather Conditions: Cloudy Number of Trips: 1  
 Material(s) Tested:  Slab  Foundation  Wall  Masonry  Other: CMU footers  
 Personnel: Austin G Notified Austin of Inland of results  
 Concrete Supplier: Eagle Rock Concrete Specified Strength: 3,000 psi Specified Slump: 5.0 inches  
 Concrete Strength on ticket: 3,000 psi

**TEST DATA**

Truck No.	Batch Time	Plant No.	Ticket No.	Size of Load	Sample	Slump (in)	Air %	Unit Wt. (pcf)	H2O Added (gallons)	Concrete Temp.	No. of Test Samples	Daily Set No.
186	13:10	3	122263	9.00	14:15	8.5	1.00	8.55	0.00	64	5	1

Daily Set No.	Sample Type	Specified Strength	Detailed Location
1	Concrete	3,000 psi	CMU wall footers.
		psi	
		psi	
		psi	
		psi	
		psi	

Slump was specified to be 5 inches but was 8.5 , 10 gallons of water was added after sample taken.

The above report is the field rendition of the author only and subject to review



FIELD REPORT ATTACHMENTS

Project: Serenity Amenity Client: TriPointe Date: 01/23/26

**Truck tickets** No.013838

American Owned, Locally Operated

919-596-7077 Orders  
919-781-3744 Office  
919-845-3080 Fax

CUSTOMER: 001556 POLYMER ORDER NUMBER: 200569 TIME: 12:44 PM DATE: 1/23/26 MOBILE: 152263


ROAD: AND H. CONCRETE CONSTRUCTION DELIVERY: STIRACILLE TERRACE FUGURY MARTIN

DELIVERY & SPECIAL INSTRUCTIONS


LEAVE PLANT	ARRIVE JOB	BEGIN POUR	FINISH POUR	LEAVE JOB SITE	ARRIVE PLANT
1:00	1:45	1:55	3:00		

WARNING: Concrete, mortar and grout products contain chemicals which may cause skin irritation, severe chemical burns or serious eye damage. Avoid contact with eyes and skin. Wash thoroughly with soap and water immediately after contact. Do not get concrete on your clothes. Do not get concrete on your skin. Do not get concrete on your hair. Do not get concrete on your shoes. Do not get concrete on your hands. Do not get concrete on your face. Do not get concrete on your neck. Do not get concrete on your arms. Do not get concrete on your legs. Do not get concrete on your feet. Do not get concrete on your hands. Do not get concrete on your face. Do not get concrete on your neck. Do not get concrete on your arms. Do not get concrete on your legs. Do not get concrete on your feet.


**CMU wall plans**

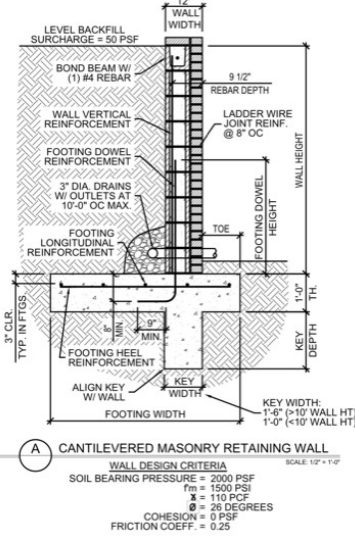

**CMU wall plans**

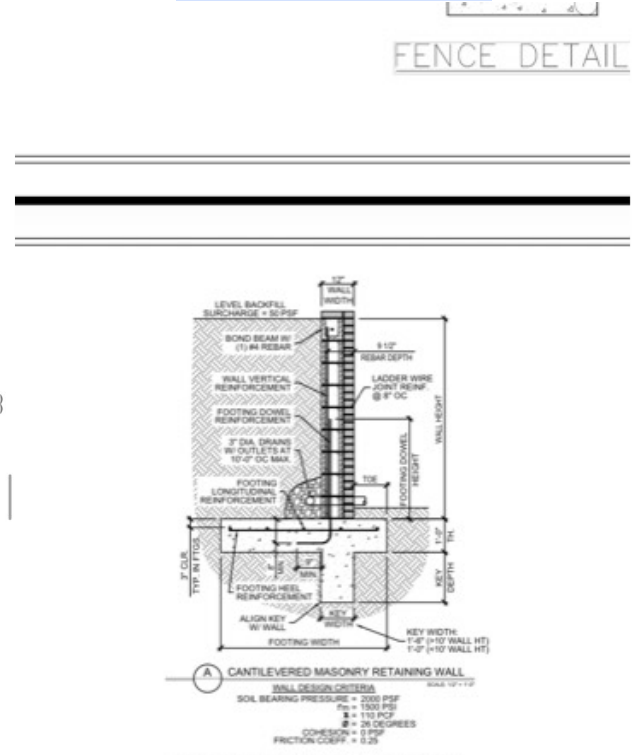


**Site plans**

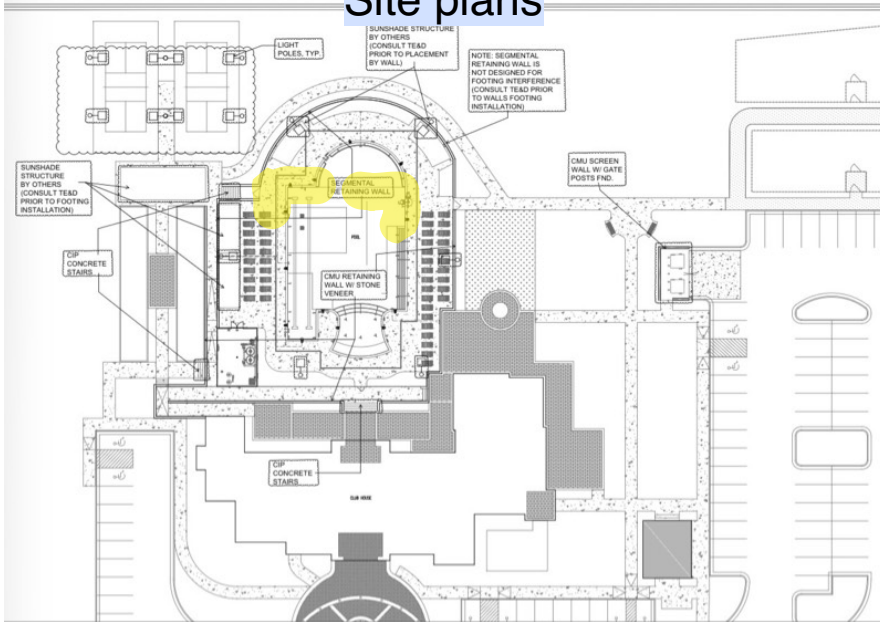

**RETAINING WALL DESIGN TABLE**

WALL HEIGHT	TOE	FOOTING WIDTH	KEY DEPTH	FTG. DOWEL HEIGHT	FOOTING DOWEL REINFORCEMENT	WALL VERTICAL REINFORCEMENT	FOOTING HEEL REINFORCEMENT	FOOTING LONGITUDINAL REINFORCEMENT
10'-0" TO 8'-0"	1'-3"	7'-4"	1'-4"	4'-4"	#5 @ 8" OC	#5 @ 16" OC	#5 @ 8" OC	#5 @ 14" OC
8'-0" TO 6'-0"	1'-4"	5'-4"	1'-4"	3'-4"	#5 @ 8" OC	#4 @ 16" OC	#4 @ 8" OC	#5 @ 14" OC
6'-0" TO 4'-0"	8"	3'-4"	1'-4"	3'-4"	#4 @ 16" OC	#4 @ 16" OC	#4 @ 8" OC	(1) #4 @ 9" OC
4'-0" TO 2'-0"	6"	2'-4"	8"	2'-4"	#4 @ 16" OC	#4 @ 24" OC	#4 @ 8" OC	(1) #4
2'-0" OR LESS	4"	2'-4"	N/A	FULL HEIGHT	#4 @ 24" OC	#4 @ 24" OC	#4 @ 12" OC	(1) #4 OR (2) #5

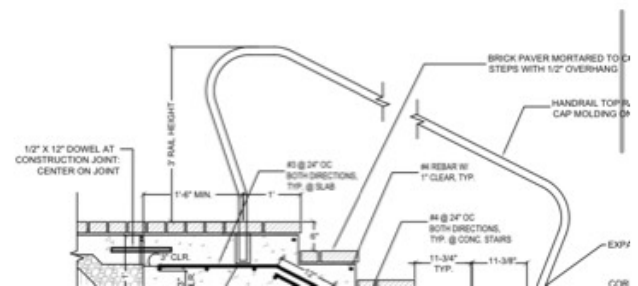

All locations should be considered approximate and were not surveyed.