


1848 Wake Forest Road
Raleigh, NC 27608
t. 919-605-1181
f. 919-573-9323
www.wdesignus.com



1/30/202

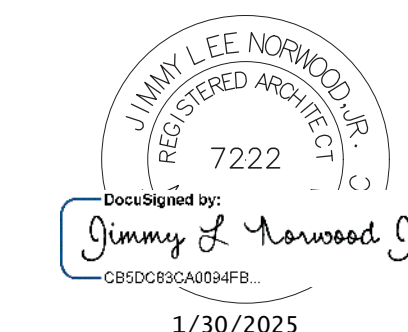

RENOVATION / ADDITION TO POOL BUILDING FOR:

RENOVATION / ADDITION TO POOL
CAMP AGAPE

1369 TYLER DEWAR LN
FLOQUAY-VARINA NC 27526

PROJECT NUMBER
224215

DATE
JANUARY 28, 2025

REVISIONS


TITLE SHEET

T001



*ELEVATION FOR ILLUSTRATIVE PURPOSES ONLY. NOT FOR CONSTRUCTION.

CAMP AGAPE POOL BLDG

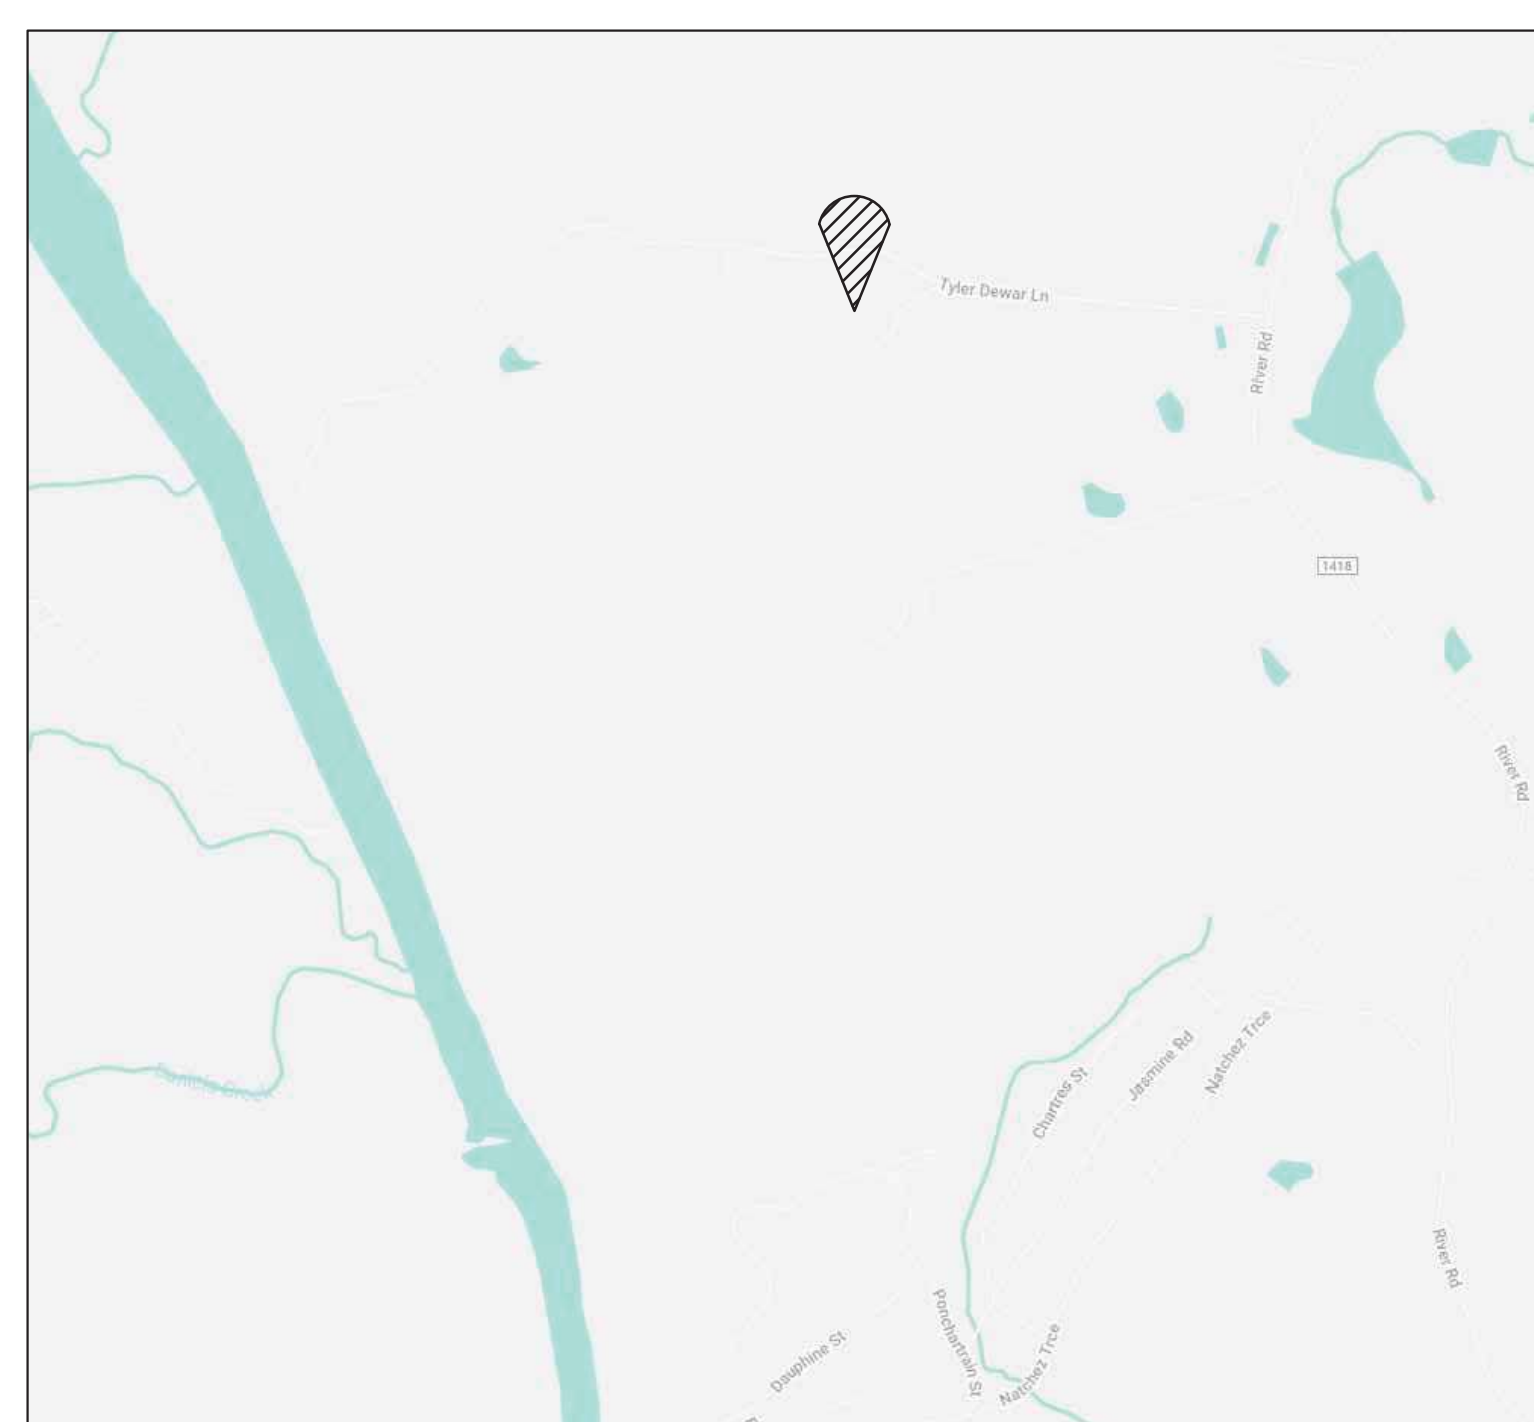

1369 TYLER DEWAR LN
FUQUAY VARINA, NORTH CAROLINA
PERMIT SET - 1/28/25

Architect:
Wilkinson Design, PLLC




Structural Engineer:
MARK S. ROY, P.E.

PM&E Engineer:
WILLIAM H. CLARK JR., P.E.

T001	TITLE SHEET
C001	BUILDING CODE SUMMARY
C002	UL ASSEMBLIES
C003	UL ASSEMBLIES
<u>ARCHITECTURAL:</u>	
A100	ARCHITECTURAL SITE PLAN
A101	DEMO PLAN
A101a	DEMO PHOTOS
A102	FLOOR PLAN
A200	ROOF PLAN
A300	EXTERIOR ELEVATIONS
A400	REFLECTED CEILING PLAN
A500	FINISH PLAN & SCHEDULE
A600	DOOR, WINDOW SCHEDULES
A700	SECTIONS
A800	ENLARGED DETAILS
A801	ENLARGED DETAILS
<u>STRUCTURAL:</u>	
S101	FOUNDATION PLAN, PLAN LEGEND & NOTES, SECTIONS & DETAILS
S102	ROOF FRAMING PLAN, LEGEND & NOTES, SECTIONS & DETAILS
S201	SHEAR WALL SECTIONS & DETAILS
S401	STRUCTURAL DESIGN CRITERIA, GENERAL STRUCTURAL NOTES & SCHEDULES
<u>PLUMBING:</u>	
P0	PLUMBING SPECIFICATIONS, NOTES & LEGEND
P1	FLOOR PLAN - WASTE/VENT, FIXTURE SCHED
P2	FLOOR PLAN - DOMESTIC WATER, SCHEDULE
P3	DETAILS
<u>MECHANICAL:</u>	
M0	SPECIFICATIONS, NOTES & LEGEND - HVAC
M1	FLOOR PLAN - HVAC
M2	DETAILS - HVAC
<u>ELECTRICAL:</u>	
E0	NOTES, LEGEND, SPECIFICATIONS, SCHED
E1	FLOOR PLAN - LIGHTING AND FIXTURE SCHED
E2	FLOOR PLAN - POWER/IT, SCHED
E3	DETAILS AND POWER RISER

Design No. P522
May 05, 2020
Unrestrained Assembly Rating — 1 Hr
Finish Rating — 25 Min (See Items 3 or 3A)
This design was evaluated using a load design method other than the Limit States Design Method (e.g., Working Stress Design Method). For jurisdictions employing the Limit States Design Method, such as Canada, a load restriction factor shall be used — See Guide [BXUV](#) or [BXUV7](#)

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

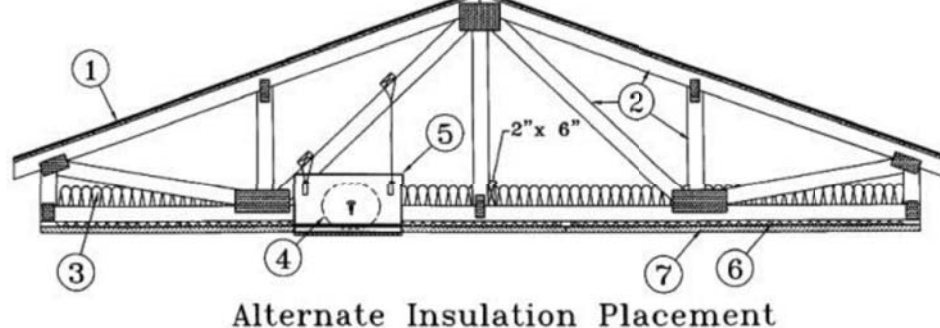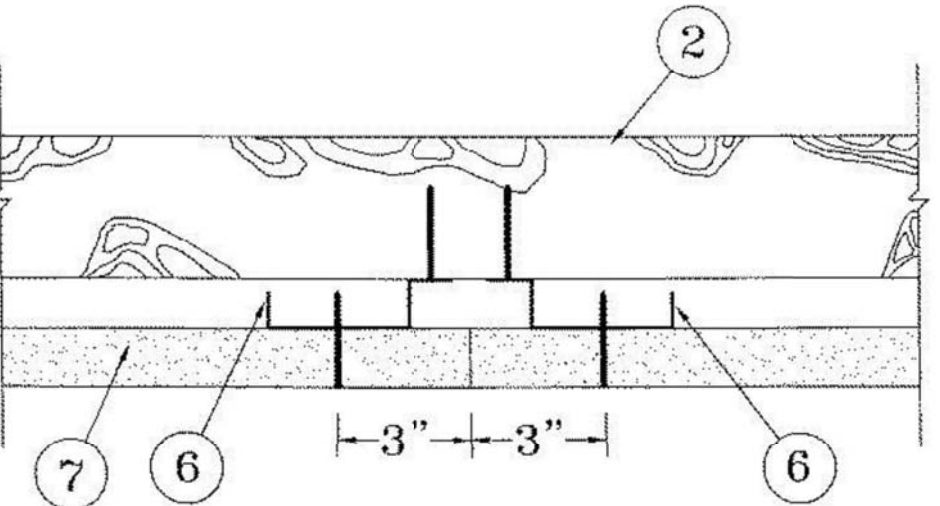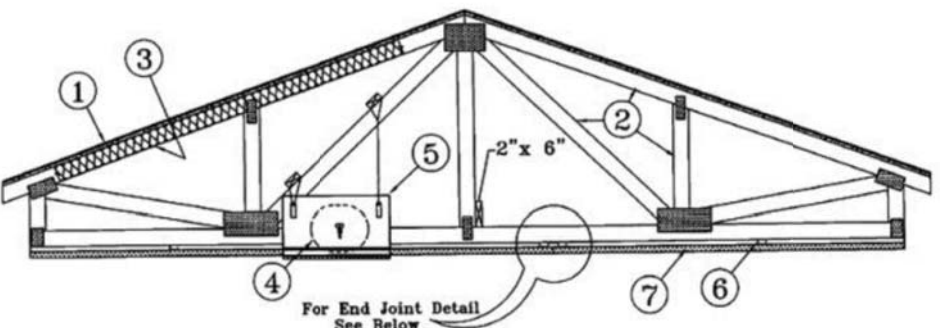

1. Roofing System* — Any UL Class A, 3 or C Roofing System (TGRU) or Prepared Roof Covering (TFWZ) acceptable for use over nom 15/32 in. thick wood structural panels, min. grade “C-D” or “Sheathing”, Nom 15/32 in. thick wood structural panels secured to trusses with No. 6d ringed shank nails spaced 12 in. OC along each truss. Staples having equal or greater withdrawal and lateral resistance strength may be substituted for the 6d nails. Construction adhesive may be used with either the nails or staples.

2. Trusses — Pitched or parallel chord wood trusses, spaced a max of 24 in. OC, fabricated from nom 2 by 4 lumber, with lumber oriented vertically or horizontally. Truss members secured together with min. C0355 in. thick galv steel plates. Plates have 5/16 in. long teeth projecting perpendicular to the plane of the plate. The teeth are in pairs facing each other (made by the same punch), forming a split tooth type plate. Each tooth has a chisel point on its outside edge. These points are diagonally opposite each other for each pair. The top half of each tooth has a twist for stiffness. The pairs are repeated on approximately 7/8 in. centers with four rows of teeth per inch of plate width. Where the truss intersects with the interior face of the exterior walls, the min truss depth shall be 5 1/4 in. with a min roof slope of 3/12 and a min. area in the plane of the truss of 21 sq ft. in. If the batts and blankets (Item 3) are used as shown in the above illustration (Alternate Insulation Placement) and are firmly packed about the intersection of the bottom chords and the plywood sheathing.

3. Batts and Blankets* — (Optional) — Required when Item 6B is used — Glass fiber insulation, secured to the wood structural panels with staples spaced 12 in. OC or to the trusses with 0.090 in. diam galv steel wires spaced 12 in. OC. Any glass fiber insulation bearing the UL Classification Marking as to Surface Burning Characteristics and/or Fire Resistance, having a min density of 0.5 pcf. As an option, the insulation may be fitted in the concealed space, draped over the resilient channel/gypsum board ceiling membrane when resilient channels and gypsum board attachment is modified as specified in Items 6 and 7. **When Steel Framing Members** (Item 6B) are used, max 3 1/2 in. thick insulation shall be draped between the furring channels (Item 6A) and gypsum board ceiling membrane, and friction-fitted between trusses and Steel Framing Members (Item 6B). The finished rating has only been determined when the insulation is secured to the decking.

3A. Fiber, Sprayed* — As an alternate to Item 3 (not evaluated for use with Item 6B) — Any thickness of spray-applied cellulose insulation material, having a min density of 0.5 lb/ft³, applied with water, over the resilient channel/gypsum board ceiling membrane when resilient channels and gypsum board attachment is modified as specified in Items 6 and 7. Fiber, Sprayed is applied with moisture in accordance with the application instructions supplied with the product. The finish rating when Fiber Sprayed is used has not been determined. Alternate application method: The fiber is applied without water or adhesive in accordance with the application instructions supplied with a minimum density of 0.5 lb/ft³ over the resilient channel/gypsum board ceiling membrane when resilient channels and gypsum board attachment is modified as specified in Items 6 and 7. Alternate application method: The fiber is applied without water or adhesive to a nominal density of 3.5 lb/ft³ behind netting (Item 5) stapled to the rafters. The netting is stapled at both lower edges of the rafters creating a cavity to accept the cellulose fiber.

U S GREENFIBER L L C — IN573S, IN574S, IN575OLD, and SANCTUARY for use with wet or dry application. IN551OLD, IN5515LD, IN5541LD, IN573S, IN5765LD, and IN5773LD are to be used for dry application only.

3B. Foamed Plastic* — (As an alternate to Item 3 or 3A, Not Shown) — Spray foam insulation applied directly to the underside of the underside of the roofing system (Item 1). Spray foam insulation installed to a maximum thickness of 10 in. at a nominal 0.5 lb/ft³ density, while maintaining a minimum 8-1/2 in. clearance between the spray foam insulation and the gypsum board (Item 7). When spray foam insulation is used, resilient channels (Item 6) shall be installed maximum 12 in. OC, with channels adjacent to butt joints of gypsum board (Item 7) installed at 6 in. OC to allow for maximum 3 in. spacing off ends of the gypsum board joints. Gypsum board (Item 7) to be installed using 1-1/4 in. long Type S screws, spaced maximum 8 in. OC, and butted end joints shall be staggered min. 2 ft within the assembly, and occur midway between the continuous furring channels. If used with a fire damper (Items 5 through 5K) in the concealed space, no clearance is necessary between damper housing and spray foam insulation. Not evaluated for use with Items 6A through 6F.

SES FOAM INC — Sucraseal

3C. Cavity Insulation - Batts and Blankets* or Fiber, Sprayed* — (As described above) in Items 3 and 3A — (For Use with Item 7B, Not Shown) — Min. 3-1/2 in. thick with no limit on maximum thickness fitted in the concealed space, draped over the resilient channel (Item 6G)/gypsum board (Item 7B) ceiling membrane.

3D. Foamed Plastic* — (As alternate to Item 3, 3A, or 3B, Not Shown) — Spray foam insulation applied directly to the underside of the roofing system (Item 1). Spray foam insulation installed to a maximum thickness of 10 in. at a nominal 0.5 lb/ft³ or 2.0 lb/ft³ density, depending on the product installed. When spray foam insulation is installed, resilient channels (Item 6) shall be installed maximum 12 in. OC, with channels adjacent to butt joints of gypsum board (Item 7) spaced maximum 3 in. away from gypsum butt joints. Gypsum board (Item 7) to be installed using minimum 1-1/4 in. long Type S screws, spaced maximum 8 in. OC, and butted end joints shall be staggered min. 2 ft within the assembly, and occur midway between the continuous furring channels. If used with a fire damper (Items 5 through 5H) in the concealed space, no clearance is necessary between damper housing and spray foam insulation. Not evaluated for use with Items 6A through 6F.

BASF CORP — Enercite® NM, Enercite® G, FE178®, Spraytite® 178, Spraytite® 81206, Walltite® 200, Walltite® US, Walltite® US-N, and Walltite® HP+

3E. Foamed Plastic* — (As an alternate to Item 3, 3A, 3B, 3C, or 3D, Not Shown) — Spray foam insulation applied directly to the underside of the underside of the roofing system (Item 1). Spray foam insulation installed to a maximum thickness of 17 in. at a nominal 0.5 lb/ft³ density, while maintaining a minimum 1-1/2 in. clearance between the spray foam insulation and the gypsum board (Item 7). When spray foam insulation is used, resilient channels (Item 6) shall be installed maximum 12 in. OC, with channels adjacent to butt joints of gypsum board (Item 7) installed at 6 in. OC to allow for maximum 3 in. spacing off ends of the gypsum board joints. Gypsum board (Item 7) to be installed using 1-1/4 in. long Type S screws, spaced maximum 8 in. OC, and butted end joints shall be staggered min. 2 ft within the assembly, and occur midway between the continuous furring channels. If used with a fire damper (Items 5 through 5K) in the concealed space, no clearance is necessary between damper housing and spray foam insulation. Not evaluated for use with Items 6A through 6F.

SES FOAM INC — EasySeal5

3F. Foamed Plastic* — (As alternate to Item 3 - not to be used in combination with any alternates to Item 3) — Spray foam insulation applied directly to the underside of the roofing system (Item 1). Spray foam insulation installed to a

maximum thickness of 11 in. at a nominal 10 lb/ft³ - 2.5 lb/ft³ density, while maintaining a minimum 7 in. clearance between the spray foam insulation and the gypsum board (Item 7). When spray foam insulation is installed, resilient channels (Item 6) shall be installed maximum 12 in. OC, with channels adjacent to butt joints of gypsum board spaced maximum 3 in. away from gypsum butt joints. Gypsum board to be installed using minimum 1-1/4 in. long Type S screws, spaced maximum 8 in. OC, and butted end joints shall be staggered min. 2 ft within the assembly, and occur midway between the continuous furring channels. If used with a fire damper (Items 5 through 5G) in the concealed space, no clearance is necessary between damper housing and spray foam insulation. Only for use with Item 6 not evaluated for use with alternates to Item 6.

CARLISLE SPRAY FOAM INSULATION — SealTite Pro Closed Cell (CC), SealTite Pro Open Cell (OC), SealTite Pro CCX, SealTite Pro No Trim, and SealTite Pro One Zero.

4. Air Duct* — Any UL Class D or Class 1 flexible air duct installed in accordance with the instructions provided by the damper manufacturer.

5. Ceiling Damper* — Max nom area, 324 sq in. Max square size, 18 in. by 18 in. rectangular sizes not to exceed 324 sq in. with a max width of 18 in. Max damper height is 14 in. Installed in accordance with manufacturers installation instructions provided with the damper. Max damper openings not to exceed 162 sq in. per 100 sq ft of ceiling area.

C&S AIR PRODUCTS — Model RD-521

POTTORFF — Model CFD-521

5A. Alternate Ceiling Damper* — Max nom area, 196 sq in. Max square size, 14 in. by 14 in. Rectangular sizes not to exceed 196 sq in. with a max width of 26 in. Max overall damper height is 7 in. Installed in accordance with the manufacturers installation instructions provided with the damper. Max damper openings not to exceed 98 sq in. per 100 sq ft of ceiling area.

C&S AIR PRODUCTS — Model RD-521-BT

POTTORFF — Model CFD-521-BT.

5B. Alternate Ceiling Damper* — Max nom area shall be 256 sq in. with the length not to exceed 24 in. and the width not to exceed 20 in. Max height of damper shall be 17 in. Aggregate damper openings shall not exceed 128 sq in. per 100 sq ft of ceiling area. Damper installed in accordance with the manufacturers installation instructions provided with the damper. A steel grille shall be installed in accordance with installation instructions.

C&S AIR PRODUCTS — Model RD-521-IP, RD-521-NP

POTTORFF — Models CFD-521-IP, CFD-521-NP

5C. Alternate Ceiling Damper* — Ceiling damper & fan assembly. Max nom area shall be 75 sq in. with the length not to exceed 8-7/16 in. and the width not to exceed 8-3/4 in. Max height of damper shall be 9-7/8 in. Aggregate damper openings shall not exceed 38 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with the damper. A plastic grille shall be installed in accordance with installation instructions.

DELTA ELECTRONICS INC — Models CRD2, GBR-CRD, ITG-CRD

one of the fan models described in, and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions.

5D. Alternate Ceiling Damper* — Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 75 sq in. with the length not to exceed 9-1/4 in. and the width not to exceed 9-3/4 in. Max height of damper shall be 9-7/8 in. Aggregate damper openings shall not exceed 45 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in, and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions.

DELTA ELECTRONICS INC — Model SIG-CRD

5E. Alternate Ceiling Damper* — For use with min 18 in. deep trusses. Max nom area shall be 144 sq in. with the length not to exceed 14 in. and the width not to exceed 12 in. Max height of damper shall be 17-7/8 in. Aggregate damper openings shall not exceed 74 sq in. per 100 sq ft of ceiling area. Damper installed in accordance with the manufacturer's installation instructions provided with the damper. A steel grille shall be installed in accordance with installation instructions.

C&S AIR PRODUCTS — Model RD-521-90, RD-521-NP90

POTTORFF — Models CFD-521-90, CFD-521-NOP9

5F. Alternate Ceiling Damper* — Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 131 sq in. with the length not to exceed 11-1/16 in. and the width not to exceed 11-7/8 in. Aggregate damper openings shall not exceed 66 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in, and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions.

DELTA ELECTRONICS INC — Model SMT-CRD

5G. Alternate Ceiling Damper* — Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 103 sq in. with the length not to exceed 10-1/8 in. and the width not to exceed 10-1/8 in. Aggregate damper openings shall not exceed 52 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in, and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions.

PANASONIC CORPORATION, PANASONIC CORPORATION OF NORTH AMERICA — Model PC-RD0SC5

5H. Alternate Ceiling Damper* — Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 133 sq in. with the length not to exceed 10-1/8 in. and the width not to exceed 11-1/8 in. Aggregate damper openings shall not exceed 57 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in, and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions.

BROAN-NUTONE L L C — Model RDP/LWT

5I. Alternate Ceiling Damper* — Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 79 sq in. with the length not to exceed 10 in. and the width not to exceed 7-15/16 in. Aggregate damper openings shall not exceed 40 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in, and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions.

BROAN-NUTONE L L C — Models RDJ1 and RDH

5J. Alternate Ceiling Damper* — Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 87 sq in. with the length not to exceed 9 in. and the width not to exceed 9-11/16 in. Aggregate damper openings shall not exceed 44 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in, and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions.

BROAN-NUTONE L L C — Model RDMWT

5K. Alternate Ceiling Damper* — Ceiling damper & fan assembly for use with min 18 in. deep trusses. Max nom area shall be 87 sq in. with the length not to exceed 9 in. and the width not to exceed 9-11/16 in. Aggregate damper openings shall not exceed 44 sq in. per 100 sq ft of ceiling area. Damper shall be installed in combination with one of the fan models described in, and in accordance with, the manufacturer's installation instructions provided with the damper. A plastic grille shall be installed in accordance with installation instructions.

BROAN-NUTONE L L C — Model RDMWT2

6. Furring Channels — Resilient channels formed of 25 MSG thick galv steel. Installed perpendicular to the trusses (Item 2), spaced a max of 16 in. OC when no insulation (Item 3 or 3A) is fitted in the concealed space, or a max of 12 in. OC when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the resilient channel/gypsum board ceiling membrane, or when insulation (Item 3B, 3D or 3E) is applied to the underside of the roofing system (Item 1). Two courses of resilient channel positioned 6 in. OC at wallboard butt-joints (3 in. from each end of wallboard). Channels oriented opposite at wallboard butt-joints. Channel clips overlapped 4 in. beneath wood trusses. Channels secured to each truss with 1-1/4 in. long Type S screws.

6A. Steel Framing Members* — (Not Shown) — As an alternate to Item 6, furring channels and Steel Framing Members as described below.

a. Furring Channels — Formed of No. 25 MSG galv steel, 2-9/16 in. or 2-23/32 in. wide by 7/8 in. deep, spaced 16 in. OC perpendicular to trusses when no insulation (Items 3 or 3A) is fitted in the concealed space or 12 in. OC when insulation (Items 3 or 3A) is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane or 24 in. OC when insulation (Items 3 or 3A) is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane and a second layer of gypsum board is attached as described in Item 7 for steel framing members. Channels secured to trusses as described in Item 6A. Ends of adjoining channels overlapped 6 in. and tied together with double strand of No. 18 SWG galv steel wire near each end of overlap.

b. Steel Framing Members — Used to attach furring channels (Item a) to trusses (Item 2). Clips spaced 48 in. OC. RSIC-1 and RSIC-1 (2.75) clips secured to alternating trusses with No. 8 by 2-1/2 in. coarse drywall screw through the center grommet. RSIC-V and RSIC-V (2.75) clips secured to alternating trusses with No. 8 by 1-1/2 in. coarse drywall screw through the center hole. Furring channels are friction fitted into clips. RSIC-1 and RSIC-V clips for use with 2-9/16 in. wide furring channels. RSIC-1 (2.75) and RSIC-V (2.75) clips for use with 2-23/32 in. wide furring channels.

PAC INTERNATIONAL L L C — Types RSIC-1, RSIC-V, RSIC-1 (2.75), RSIC-V (2.75)

6B. Steel Framing Members* — (Not Shown) — As an alternate to Items 6 and 6A.

a. Furring Channels — Hat-shaped furring channels, 7/8 in. deep by 2-5/8 in. wide at the base and 1-1/4 in. wide at the face, formed from No. 25 ga. galv steel, spaced max 16 in. OC perpendicular to trusses and Cold Rolled Channels (Item 6B). Furring channels secured to Cold Rolled Channels at every intersection with a 1/2 in. pan head self-drilling screw through each furring channel leg. Ends of adjoining channels overlapped 4 in. and tied together with two double strand No. 18 SWG galv steel wire ties, one at each end of overlap. Supplemental furring channels at base layer and outer layer gypsum board butt joints are not required. Batts and Blankets draped over furring channels as described in Item 3. Two layers of gypsum board attached to furring channels as described in Item 7.

b. Cold Rolled Channels — 1-1/2 in. by 1/2 in., formed from No. 16 ga. galv steel, positioned vertically and parallel to trusses, friction-fitted into the channel caddy on the Steel Framing Members (Item 6B). Adjoining lengths of cold rolled channels lapped min. 6 in. and wire-tied together with two double strand 18 SWG galv steel wire ties, one at each end of overlap.

c. Blocking — Where truss design does not permit direct, full contact of the hanger bracket, a piece of nominal 2 by 4 in. lumber (blocking), min. 6 in. long to permit full contact of the hanger bracket, to be secured vertically to the side of the truss (Item 2) at the top and bottom of the blocking at each Steel Framing Member (Item 6Bd) location.

d. Steel Framing Members* — Hangers spaced 48 in. OC, max along truss, and secured to the blocking (Item 6Bc) on alternating trusses with a single 5/16 in. by 2 in. hex head lag bolt or four #5 1-1/4 in. drywall screws through mounting hole(s) on the hanger bracket. The two 1/4 in. long steel teeth on the hanger are embedded in the side of the blocking. Hanger positioned on blocking and leveling bolt height adjusted such that furring channels are flush with bottom of trusses before gypsum board installation. Spring gauge of hanger chosen per manufacturer's instructions.

KINETICS NOISE CONTROL INC — Type ICW.

6C. Steel Framing Members* — (Not Shown) — As an alternate to Items 6, 6A and 6B.

a. Furring Channels — Formed of No. 25 MSG galv steel, 2-3/8 in. wide by 7/8 in. deep installed perpendicular to wood structural members. Channels spaced a max of 16 in. OC when no insulation (Item 3 or 3A) is fitted in the concealed space or a max of 12 in. OC when insulation (Item 3 or 3A) is fitted in the concealed space. Channels secured to trusses as described in Item 6C. Ends of adjoining channels overlapped 6 in. and tied together with double strand of No. 18 AWG galvanized steel wire near each end of overlap.

b. Steel Framing Members* — Used to attach furring channels (Item 6Ca) to trusses (Item 2). Clips secured to the bottom chord of each truss (24 in. OC) with one No. 8 by 2-1/2 in. long coarse drywall screw through center grommet. Furring channels are friction fitted into clips. Adjoining channels are overlapped as described in Item 6Ca. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping No. 6 framing screws, min 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Additional clips required to hold furring channel that supports the gypsum board butt joints, as described in Item 7.

PLUTE INC — Type Genie Clip

6D. Steel Framing Members* — (Not Shown) — As an alternate to Items 6, 6A, 6B and 6C.

a. Main runners — Installed perpendicular to trusses — Nom 10 or 12 ft long, 15/16 in. or 1-1/2 in. wide face, spaced 4 ft OC. Main runners hung a min of 2 in. from bottom chord of trusses with 12 SWG galv steel wire. Wires located a max of 48 in. OC.

b. Cross tees or channels — Nom 4 ft long, 15/16 in. or 1-1/2 in. wide face or cross channels, nom 4 ft long, 1-1/2 wide face, installed perpendicular to the main runners, spaced 16 in. OC. Additional cross tees or channels used at 8 in. from each side of butted gypsum board end joints. The cross tees or channels may be riveted or screw-attached to the wall angle or channel to facilitate the ceiling installation.

c. Wall angles or channels — Used to support steel framing member ends and for screw-attachment of the gypsum wallboard — Min 0.016 in. thick painted or galvanized steel angle with 1 in. legs or min. 0.016 in. thick painted or galvanized steel channel with a 1 by 1-1/2 by 1 in. profile, attached to walls at perimeter of ceiling with fasteners 16 in. OC.

CGC INC — Type DGL or RX

USG INTERIORS LLC — Type DGL or RX

6E. Alternate Steel Framing Members* — (Not Shown) — As an alternate to Items 6, 6A, 6B, and 6C, furring channels and Steel Framing Members as described below.

a. Furring Channels — Formed of No. 25 MSG galv steel, 2-5/8 in. wide by 7/8 in. deep, spaced 16 in. OC perpendicular to trusses. When insulation, Items 3 or 3A is used, the furring channel spacing shall be reduced to 12 in. OC. Channels secured to joists as described in Item b.

b. Steel Framing Members* — Used to attach furring channels (Item a) to the wood trusses (Item 2). Clips spaced at 48" OC and secured to the bottom of the trusses with one 2 in. Coarse Drywall Screw with 1 in. diam washer through the center hole. Furring channels are then friction fitted into clips. Ends of channels are overlapped 6" and tied together with double strand of No. 18 AWG galvanized steel wire. Additional clips are required to hold the Gypsum Butt joints as described in Item 7.

STUCCO BUILDING SYSTEMS — RESILMOUNT Sound Isolation Clips — Type A237 or A237R

6F. Steel Framing Members* — (Not Shown) — As an alternate to Items 6 through 6E. Not for use with Items 3 or 3A. Main runners nom 12 ft long, spaced 72 in. OC. Main runners suspended by min 12 SWG galv steel hanger wires spaced 48 in. OC. Cross tees, nom 6 ft long, installed perpendicular to main runners and spaced 24 in. OC. Additional 6 ft long cross tees required at each gypsum board end joint with butted gypsum board end joints centered between cross tees spaced 8 in. OC. The main runners and cross tees may be riveted or screw attached to the wall angle or channel to facilitate the ceiling installation.

USG INTERIORS LLC — Type DGL or RX

6G. Resilient Channels — For Use With Item 7B - Formed from min 25 MSG galv steel installed perpendicular to trusses and spaced 16 in. OC. Channels secured to each truss with 1-5/8 in. long Type 5 bugle head steel screws. Channels overlapped 4 in. at splices. Two channels, spaced 6 in. OC, oriented opposite each gypsum panel end joint.

7. Gypsum Board* — One layer of nom 5/8 in. thick by 48 in. wide boards, installed with long dimension parallel to trusses. Attached to the resilient channels using 1 in. long Type 5 bugle-head screws. Screws spaced a max of 12 in. OC along butted end-joints and in the field when no insulation (Item 3 or 3A) is fitted in the concealed space, or a max of 8 in. OC along butted end-joints and in the field when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the resilient channel/gypsum board ceiling membrane. When insulation (Item 3B, 3D or 3E) is installed in the concealed space, spray-applied to the underside of the roofing system (Item 1), screws are spaced a max of 8 in. OC along resilient channels, fasteners are increased in length to 1-1/4 in. and gypsum board butt joints shall be staggered min. 2 ft within the assembly, and occur between the main furring channels.

When Steel Framing Members (Item 6A or 6C) are used, sheets installed with long dimension perpendicular to furring channels and side joints of sheet located beneath trusses. Gypsum board screws are driven through channel spaced 12 in. OC in the field when no insulation (Item 3 or 3A) is fitted in the concealed space, or 8 in. OC in the field when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane. Gypsum board butt joints shall be staggered min. 2 ft within the assembly, and occur between the main furring channels. At the gypsum board butt joints, each end of the gypsum board shall be supported by a single length of furring channel equal to the width of the wallboard plus 5 in. on each end. The furring channels shall be spaced approximately 3-1/2 in. OC, and be attached to the trusses with one clip at each end of the channel. Screw spacing along the butt joint to attach the gypsum board to the furring channels shall be 8 in. OC. Second (outer) layer of gypsum board required when furring channels (Item 6A, a) are spaced 24 in. OC and insulation is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane. Outer layer of gypsum board attached to the furring channels using 1-5/8 in. long Type 5 bugle-head screws spaced 8 in. OC at butted joints and 12 in. OC in the field. Butted end joints of outer layer to be offset a minimum of 8 in. from base layer end joints. Butted side joints of outer layer to be offset minimum 18 in. from butted side joints of base layer.


When Steel Framing Members (Item 6B) are used, two layers of nom 5/8 in. thick, 4 ft wide gypsum board are installed with long dimensions perpendicular to furring channels (Item 6Bd). Base layer attached to the furring channels using 1 in. long Type 5 bugle head steel screws spaced 8 in. OC at butted end joints and 12 in. OC in the field of the board. Butted end joints centered on the continuous furring channels. Butted base layer end joints to be offset a min of 16 in. in adjacent courses. Outer layer attached to the furring channels using 1-5/8 in. long Type 5 bugle head steel screws spaced 8 in. OC at butted end joints and 12 in. OC in the field. Butted side joints centered on the continuous furring channels and offset a min of 16 in. from butted end joints of base layer. Butted side joints of outer layer to be offset min 16 in. from butted side joints of base layer.

When Steel Framing Members (Item 6B) are used, sheets installed with long dimension perpendicular to furring channels and side joints of sheet located beneath trusses. Gypsum board screws are driven through channel spaced 12 in. OC in the field when no insulation (Item 3 or 3A) is fitted in the concealed space, or 8 in. OC in the field when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane. Gypsum board butt joints shall be staggered min. 2 ft within the assembly, and occur between the main furring channels. At the gypsum board butt joints, each end of the gypsum board shall be supported by a single length of furring channel equal to the width of the wallboard plus 5 in. on each end. The furring channels shall be spaced approximately 3-1/2 in. OC, and be attached to the trusses with one clip at each end of the channel. Screw spacing along the butt joint to attach the gypsum board to the furring channels shall be 8 in. OC. Second (outer) layer of gypsum board required when furring channels (Item 6A, a) are spaced 24 in. OC and insulation is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane. Outer layer of gypsum board attached to the furring channels using 1-5/8 in. long Type 5 bugle-head screws spaced 8 in. OC at butted joints and 12 in. OC in the field. Butted end joints of outer layer to be offset a minimum of 8 in. from base layer end joints. Butted side joints of outer layer to be offset minimum 18 in. from butted side joints of base layer.

When Steel Framing Members (Item 6B) are used, sheets installed with long dimension perpendicular to furring channels and side joints of sheet located beneath trusses. Gypsum board screws are driven through channel spaced 12 in. OC in the field when no insulation (Item 3 or 3A) is fitted in the concealed space, or 8 in. OC in the field when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane. Gypsum board butt joints shall be staggered min. 2 ft within the assembly, and occur between the main furring channels. At the gypsum board butt joints, each end of the gypsum board shall be supported by a single length of furring channel equal to the width of the wallboard plus 5 in. on each end. The furring channels shall be spaced approximately 3-1/2 in. OC, and be attached to the trusses with one clip at each end of the channel. Screw spacing along the butt joint to attach the gypsum board to the furring channels shall be 8 in. OC. Second (outer) layer of gypsum board required when furring channels (Item 6A, a) are spaced 24 in. OC and insulation is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane. Outer layer of gypsum board attached to the furring channels using 1-5/8 in. long Type 5 bugle-head screws spaced 8 in. OC at butted joints and 12 in. OC in the field. Butted end joints of outer layer to be offset a minimum of 8 in. from base layer end joints. Butted side joints of outer layer to be offset minimum 18 in. from butted side joints of base layer.

When Steel Framing Members (Item 6B) are used, sheets installed with long dimension perpendicular to furring channels and side joints of sheet located beneath trusses. Gypsum board screws are driven through channel spaced 12 in. OC in the field when no insulation (Item 3 or 3A) is fitted in the concealed space, or 8 in. OC in the field when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane. Gypsum board butt joints shall be staggered min. 2 ft within the assembly, and occur between the main furring channels. At the gypsum board butt joints, each end of the gypsum board shall be supported by a single length of furring channel equal to the width of the wallboard plus 5 in. on each end. The furring channels shall be spaced approximately 3-1/2 in. OC, and be attached to the trusses with one clip at each end of the channel. Screw spacing along the butt joint to attach the gypsum board to the furring channels shall be 8 in. OC. Second (outer) layer of gypsum board required when furring channels (Item 6A, a) are spaced 24 in. OC and insulation is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane. Outer layer of gypsum board attached to the furring channels using 1-5/8 in. long Type 5 bugle-head screws spaced 8 in. OC at butted joints and 12 in. OC in the field. Butted end joints of outer layer to be offset a minimum of 8 in. from base layer end joints. Butted side joints of outer layer to be offset minimum 18 in. from butted side joints of base layer.

When Steel Framing Members (Item 6B) are used, sheets installed with long dimension perpendicular to furring channels and side joints of sheet located beneath trusses. Gypsum board screws are driven through channel spaced 12 in. OC in the field when no insulation (Item 3 or 3A) is fitted in the concealed space, or 8 in. OC in the field when insulation (Item 3 or 3A) is fitted in the concealed space, draped over the furring channel/gypsum board ceiling membrane. Gypsum board butt joints shall be staggered min. 2 ft within the assembly, and occur between the main furring channels. At the gypsum board butt joints, each end of the gypsum board shall be supported by a single length of furring channel equal to the width of the wallboard plus 5 in. on each end. The furring channels shall be spaced approximately 3-1/2 in. OC, and be attached to the trusses with one clip at each end of the channel. Screw spacing along the butt joint to attach the gypsum board to the furring channels shall be 8 in. OC. Second (outer) layer of gypsum board required when furring channels (Item 6A, a) are spaced 24 in. OC and insulation is

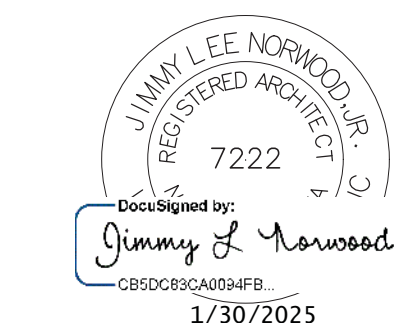

RENOVATION / ADDITION TO POOL BUILDING FOR:

CAMP AGAPE

1369 TYLER DEWAR LN
ELIQUAY-VARINA NC 27526


PROJECT NUMBER
224215


DATE
JANUARY 28, 2025

REVISIONS

[illegible]ARCHITECTURAL
SITE PLAN

A100

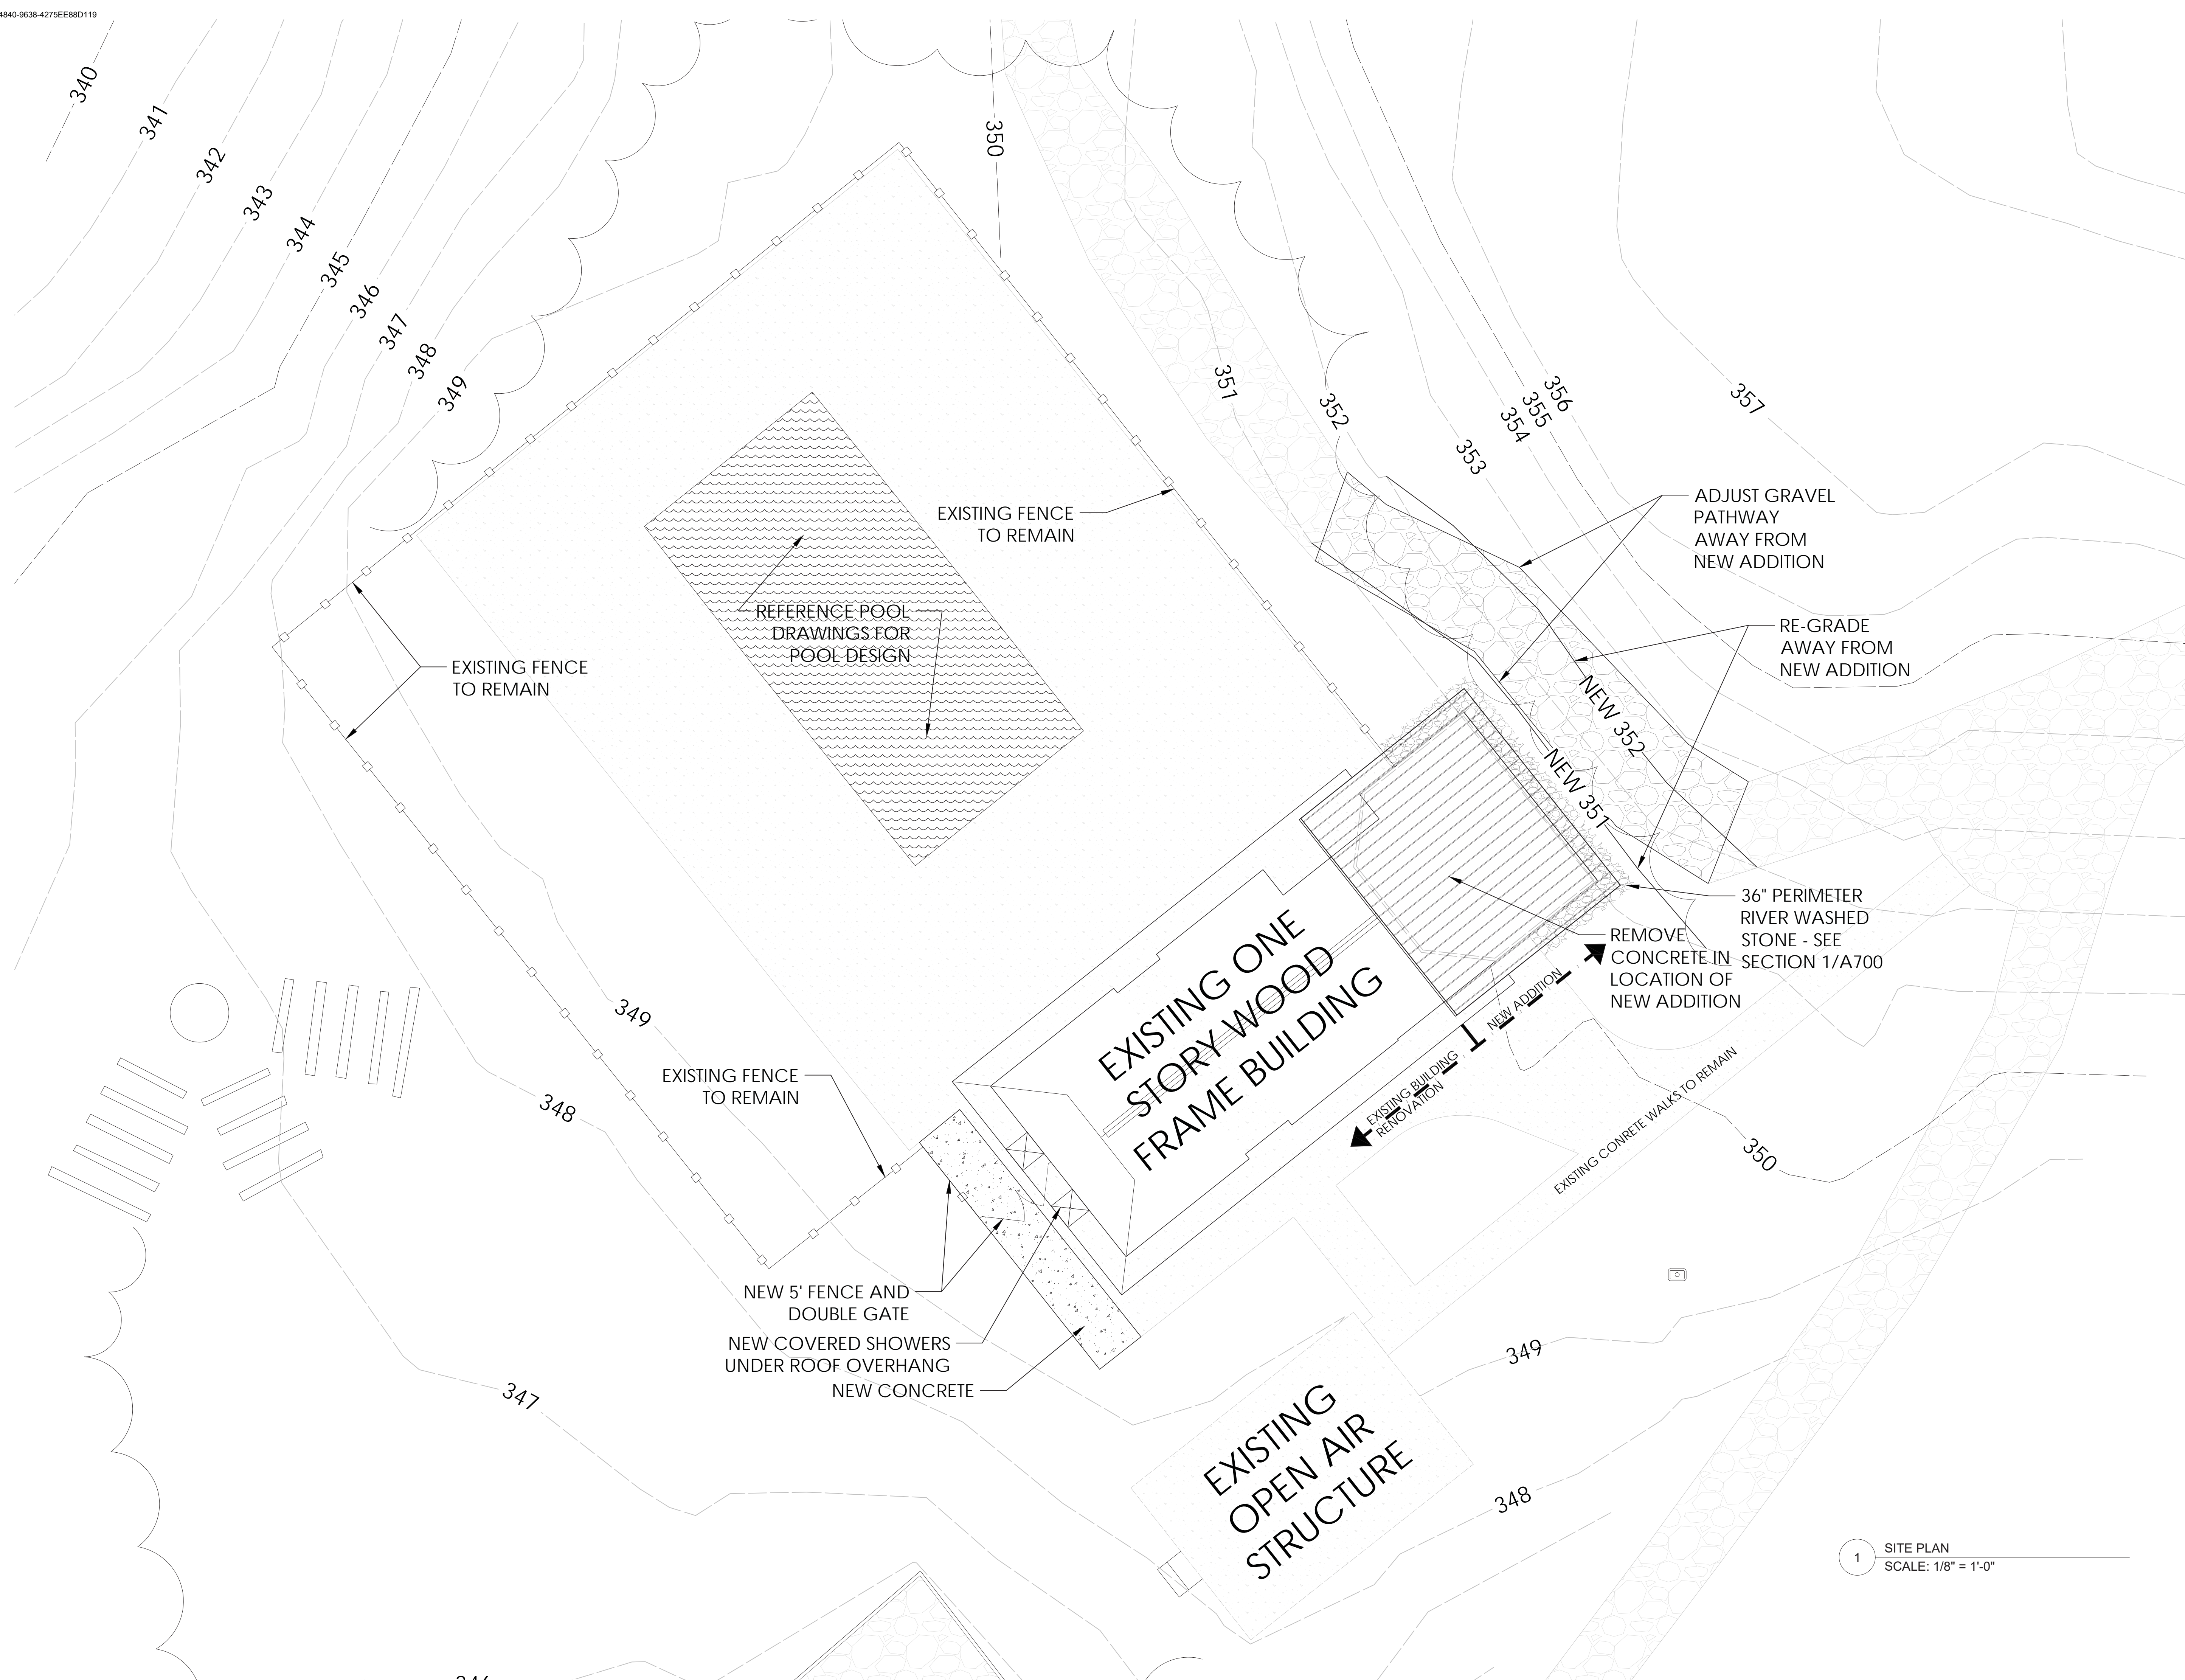

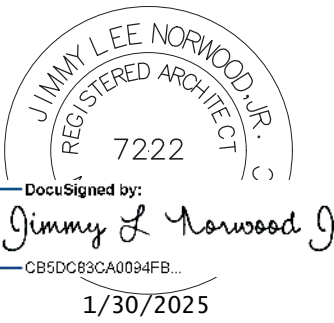

RENOVATION / ADDITION TO POOL BUILDING FOR:

CAMP AGAPE

1369 TYLER DEWAR LN
FUQUAY-VARINA NC 27526

PROJECT NUMBER
224215


DATE
JANUARY 28, 2025


REVISIONS

[illegible]

ROOF
PLAN


A200

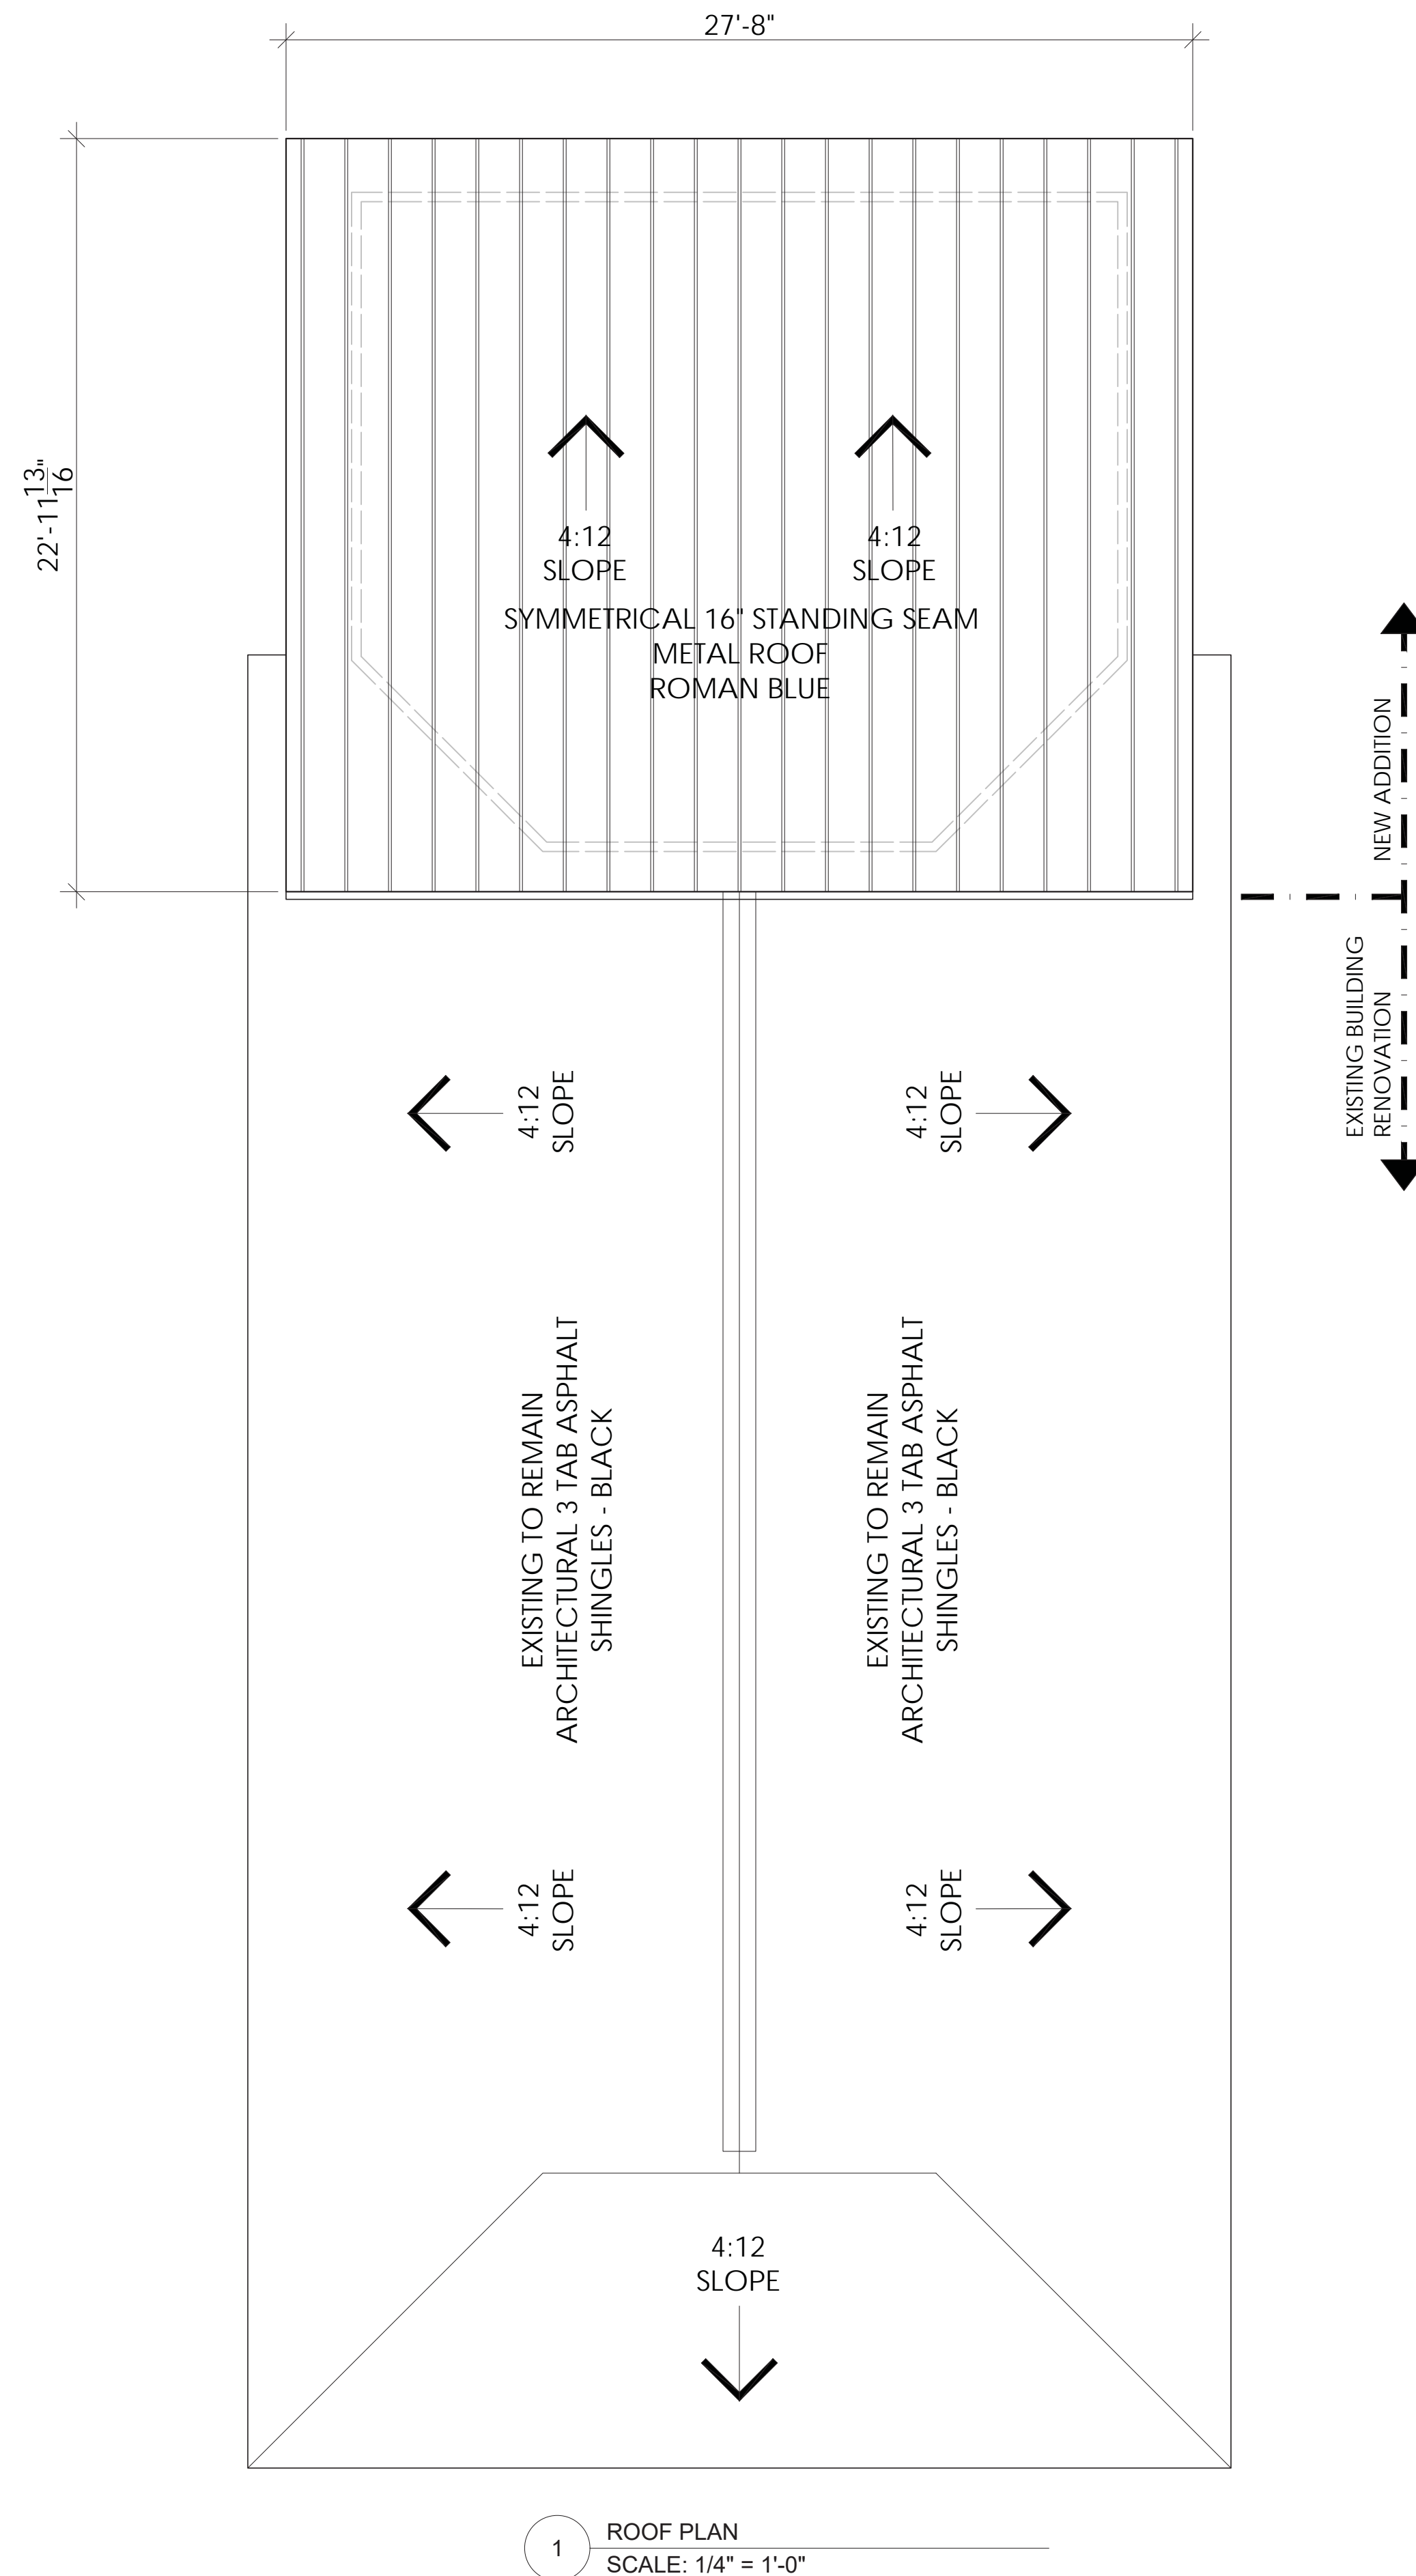

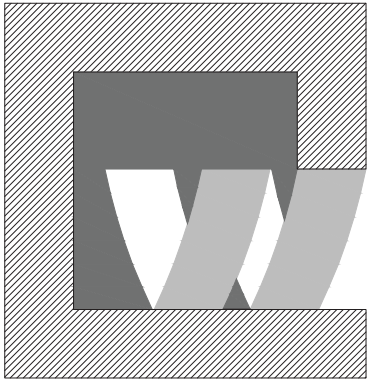

**WILKINSON
DESIGN PLLC**

1848 Wake Forest Road
Raleigh, NC 27608
t. 919-605-1181
f. 919-573-9323
www.wdesignus.com

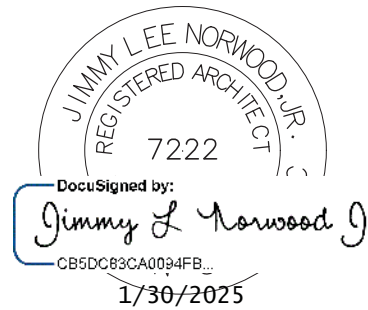

RENOVATION / ADDITION TO POOL BUILDING FOR:


CAMP AGAPE
1369 TYLER DEWAR LN
FUQUAY-VARINA NC 27526

PROJECT NUMBER
224215
DATE
JANUARY 28, 2025


REVISIONS

EXTERIOR
ELEVATIONS


A300

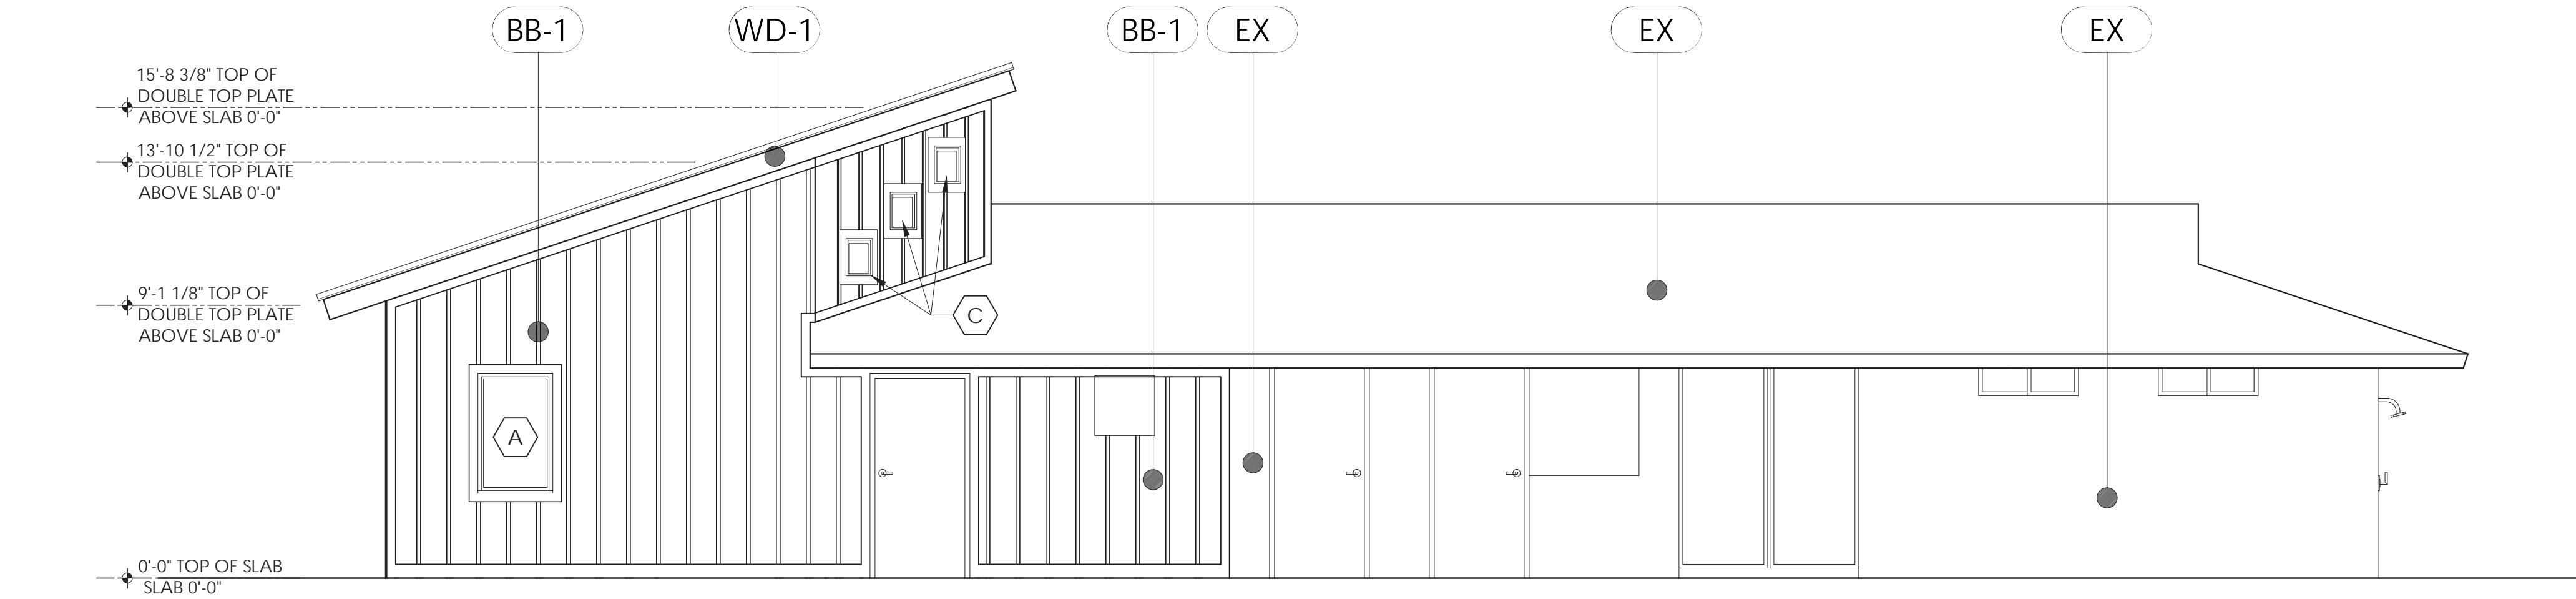


4 REAR ELEVATION
SCALE: 1/4" = 1'-0"

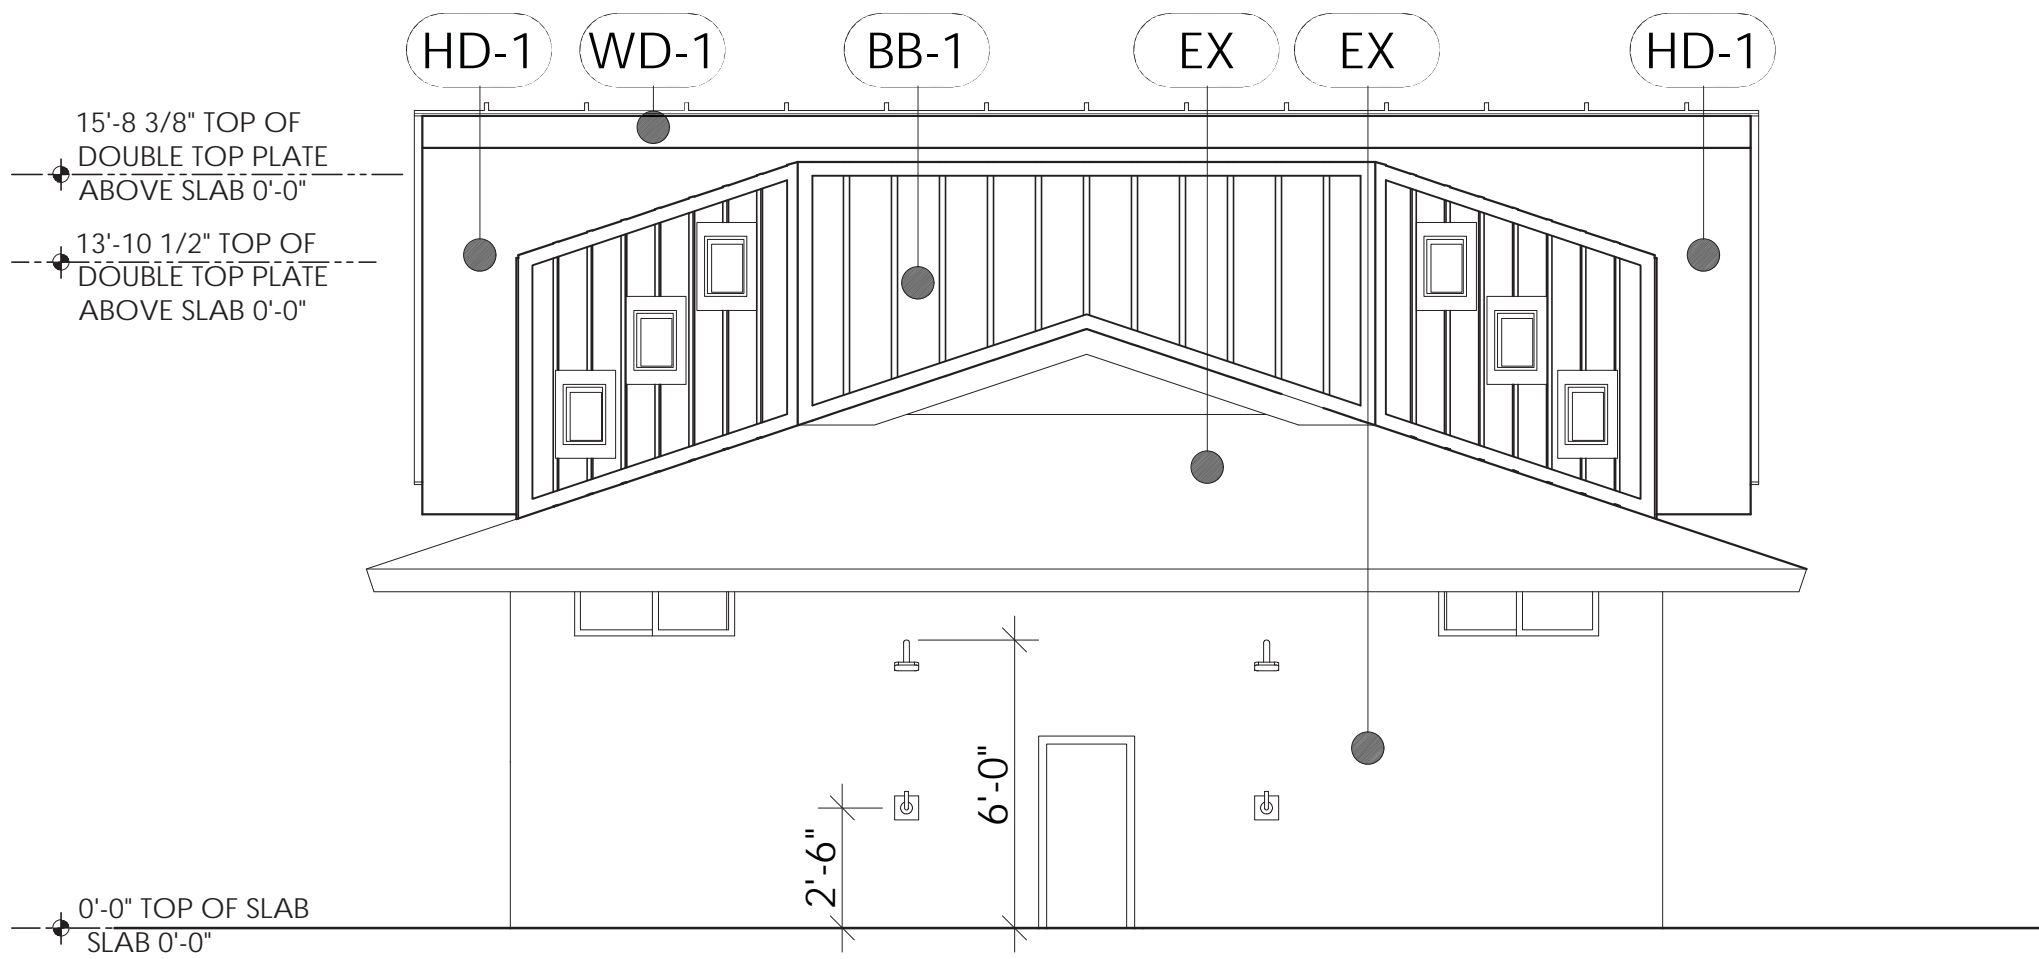

2 LEFT ELEVATION
SCALE: 1/4" = 1'-0"

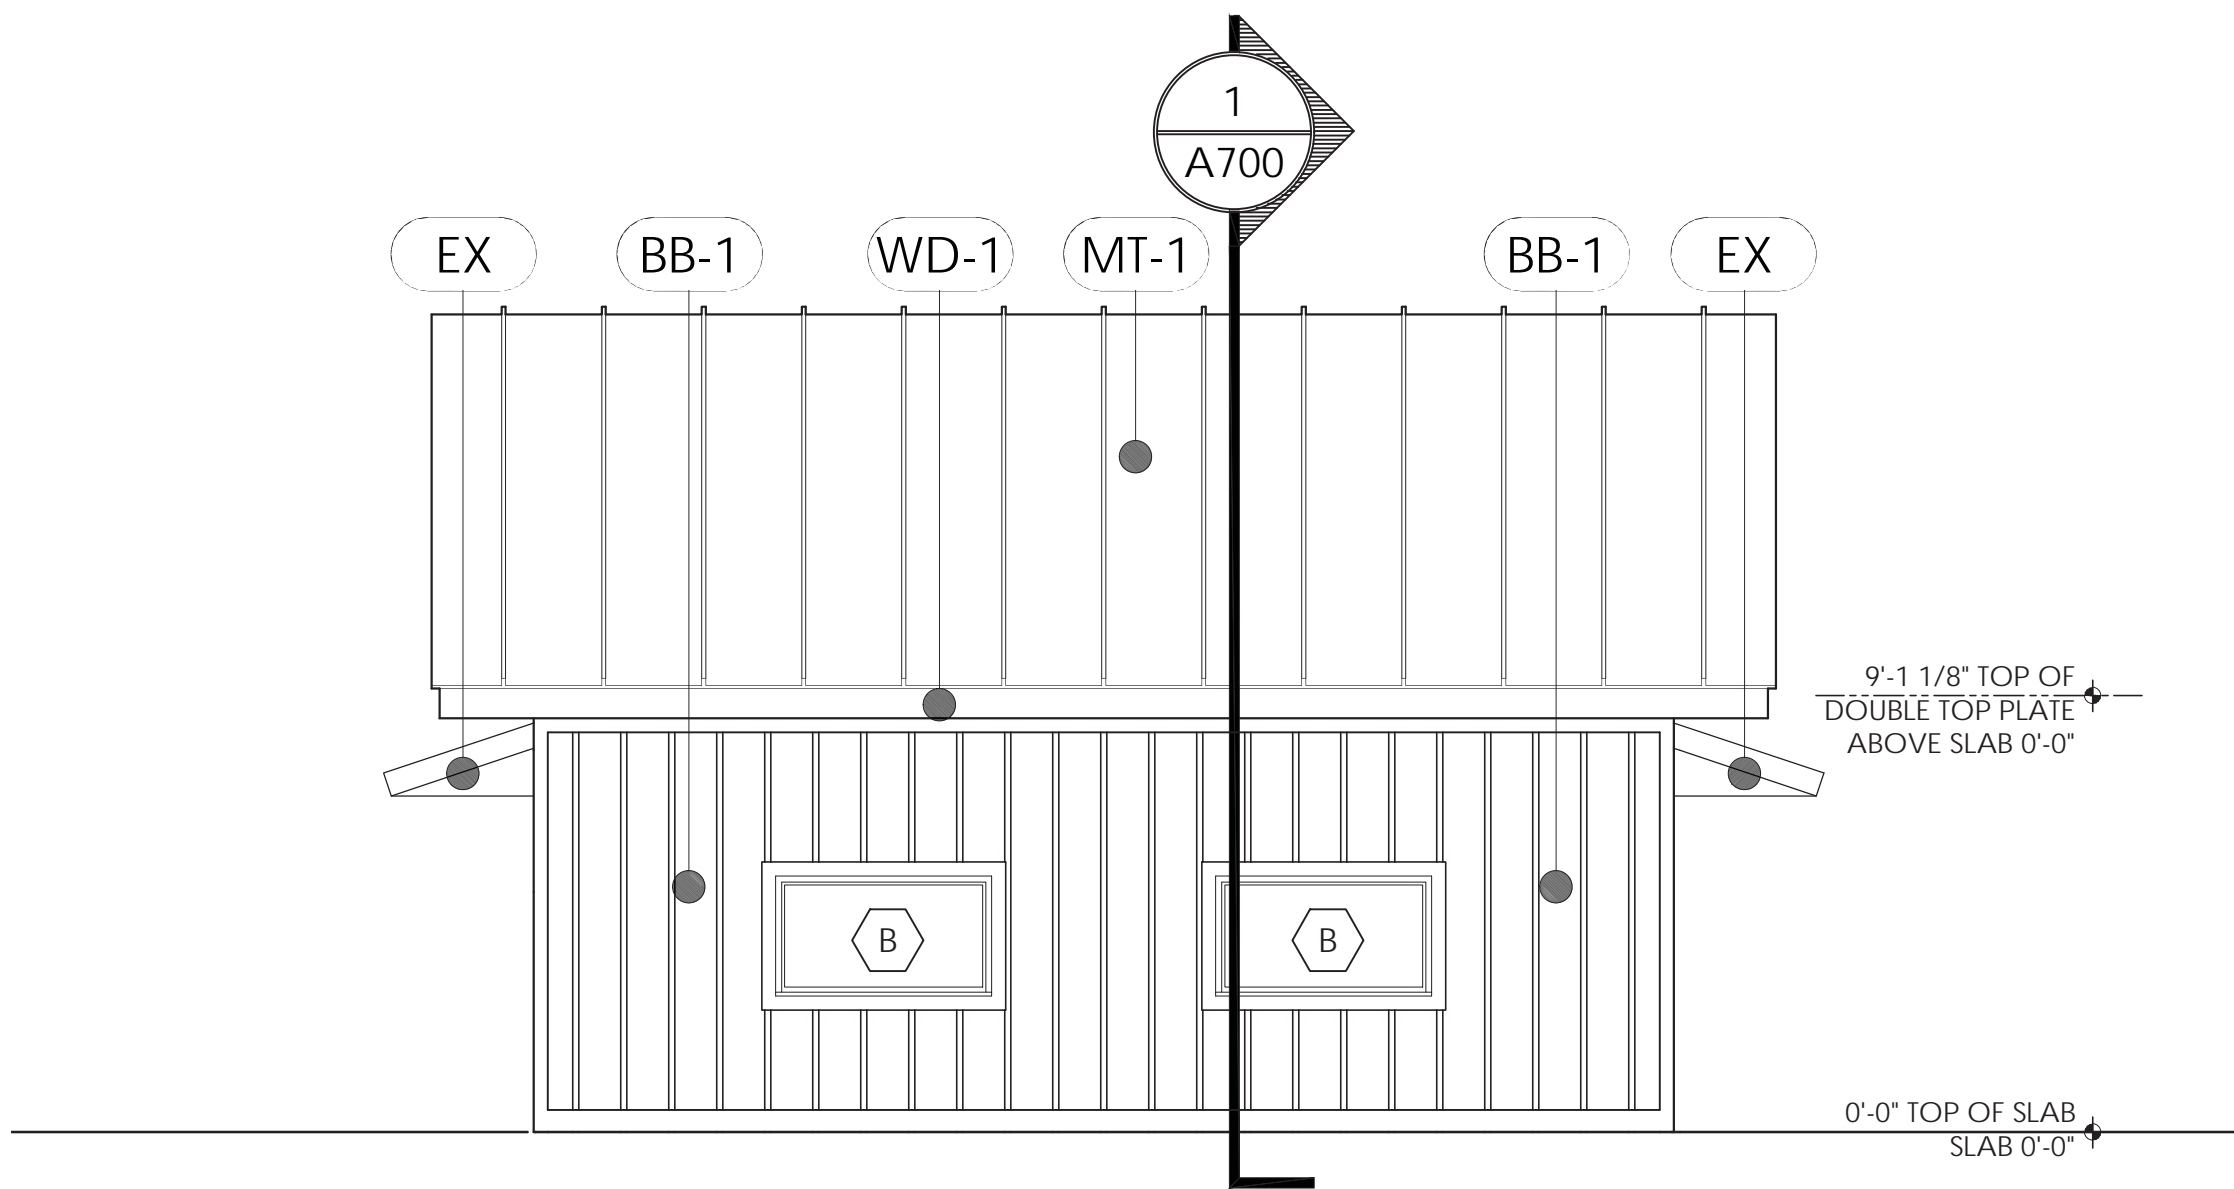

3 RIGHT ELEVATION
SCALE: 1/4" = 1'-0"

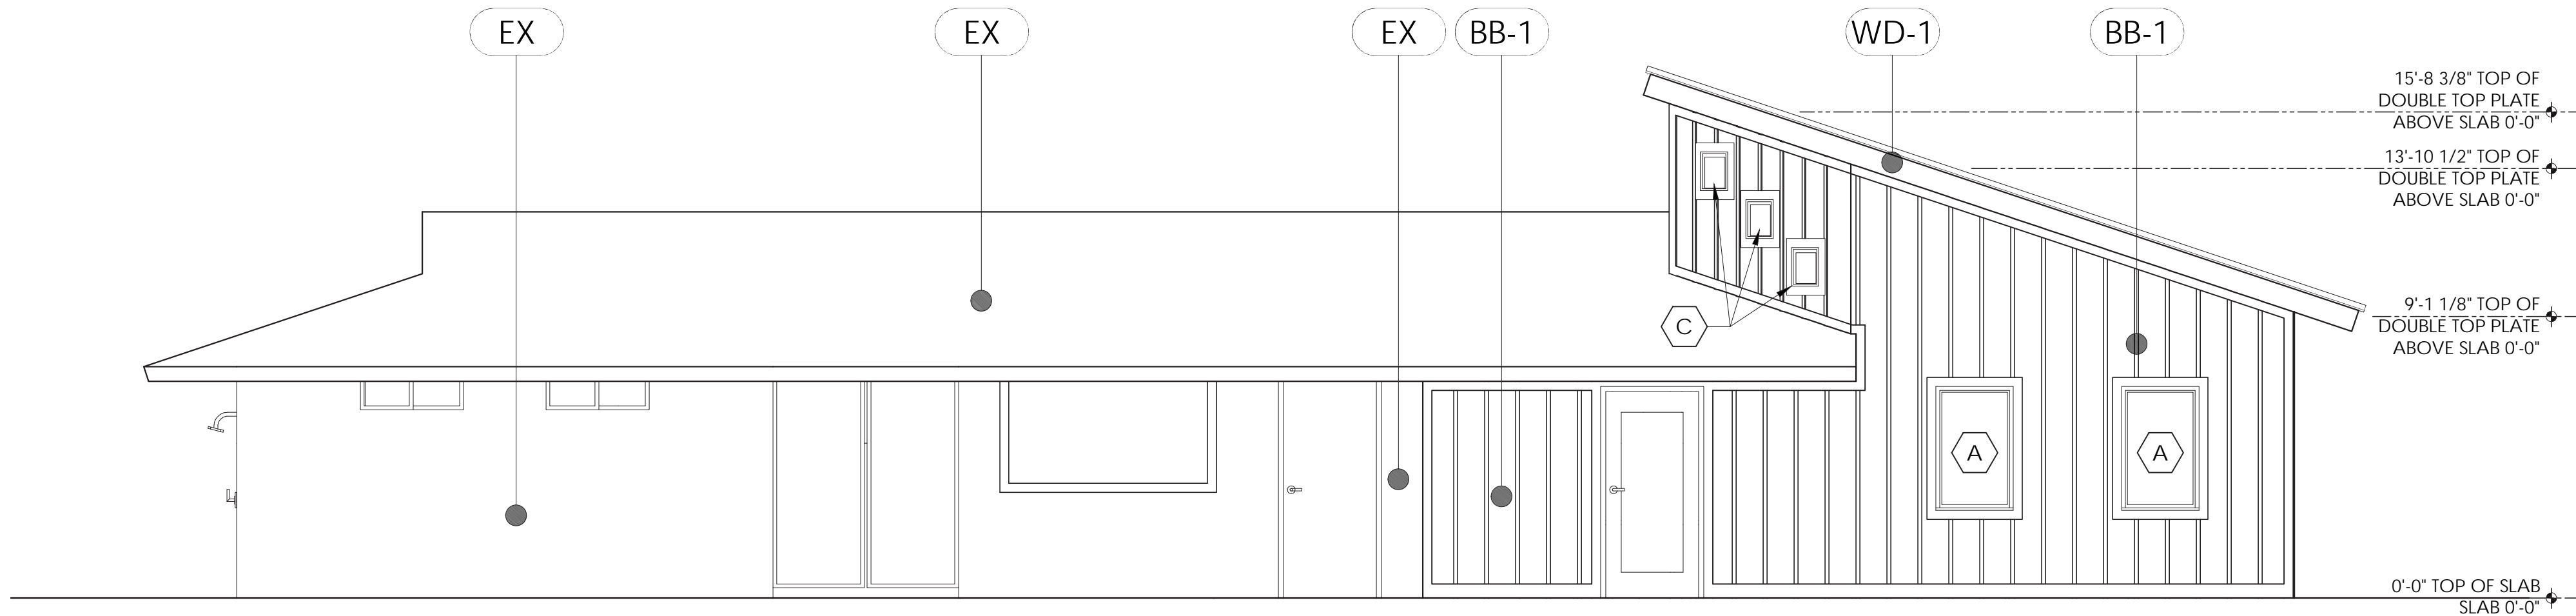


1 FRONT ELEVATION
SCALE: 1/4" = 1'-0"

ELEVATION FINISH LEGEND

EX	EXISTING FINISH TO REMAIN
BB-1	JAMES HARDIE SMOOTH BOARD 4"x10" WITH VERTICAL 2 1/2" EVERY 12" PAINT:
WD-1	EXTERIOR TRIM BOARD PAINT:
MT-1	SYMMETRICAL 16" STANDING SEAM METAL ROOF ROMAN BLUE
HD-1	JAMES HARDIE SMOOTH BOARD WITH CAULKED JOINTS PAINT:

SYMBOLS LEGEND

#	DOOR/FRAME LOCATION TYPICAL 4" WALL OFFSET FROM FACE OF STUD TO DOOR OPENING @ HINGE SIDE OF DOOR UNLESS OTHERWISE NOTED - SEE DOOR SCHEDULE
#	DOOR AND FRAME TO BE REMOVED DURING DEMO PHASE
A	VINYL WINDOWS - ELEVATIONS ON A600
[Symbol]	ALIGN FINISH MATERIALS
FE	WALL MOUNTED FIRE-EXTINGUISHER GC TO COORDINATE FINAL LOCATION IN FIELD W/ FIRE MARSHALL.
P#	SYMBOL DESIGNATES PHOTO LOCATION FOR DEMO PLANS
EX	"EX" DENOTES EXISTING TO REMAIN, REFERENCE FINISH PLAN FOR NEW FINISHES

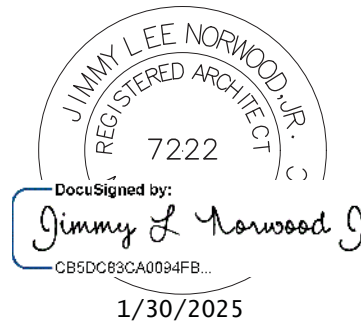

RENOVATION / ADDITION TO POOL BUILDING FOR:


CAMP AGAPE

1369 TYLER DEWAR LN
FUQUAY-VARINA NC 27526


PROJECT NUMBER
224215
DATE
JANUARY 28, 2025
REVISIONS

ENLARGED
DETAILS


A800

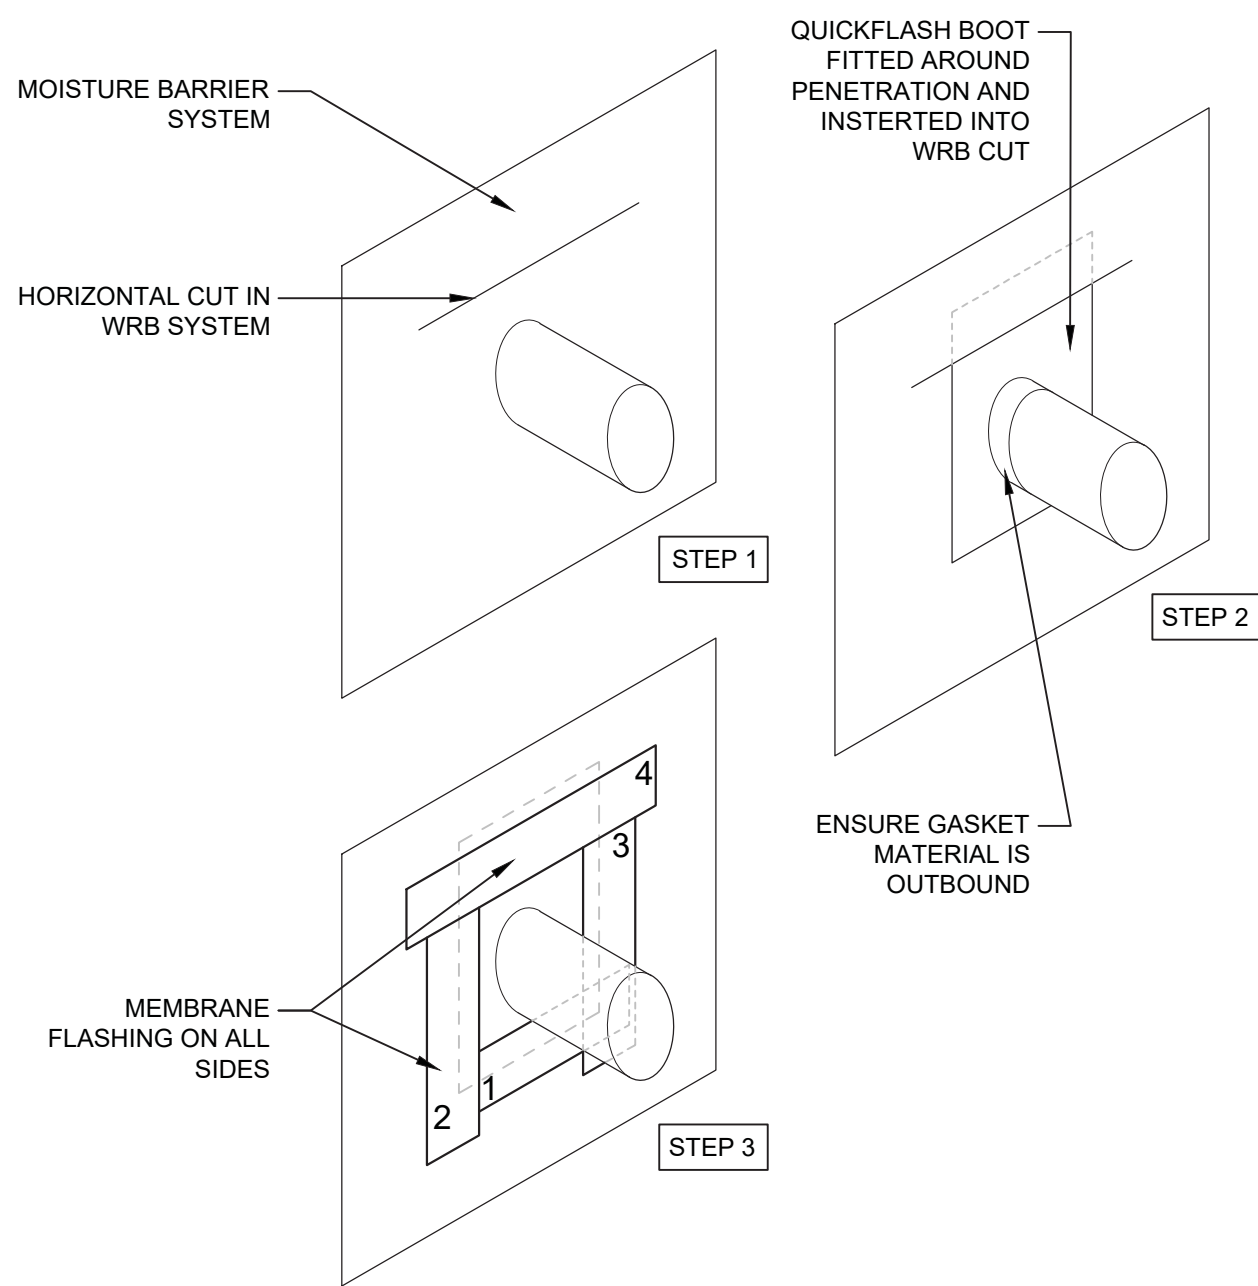


11 WRB - PENETRATION W/ QUICKFLASH
NOT TO SCALE

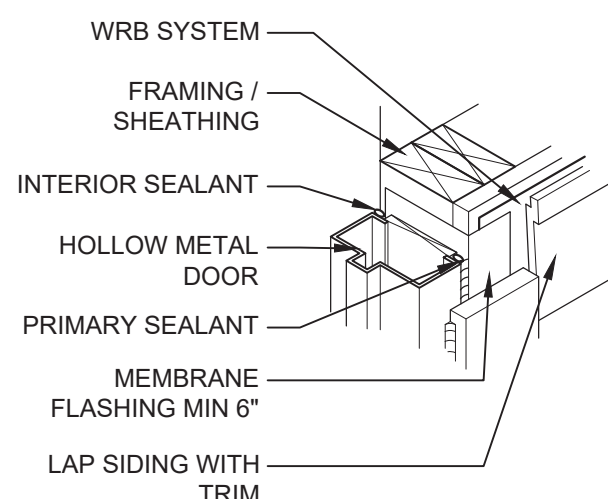


15 HM DOOR - JAMB W/ TRIM
NOT TO SCALE

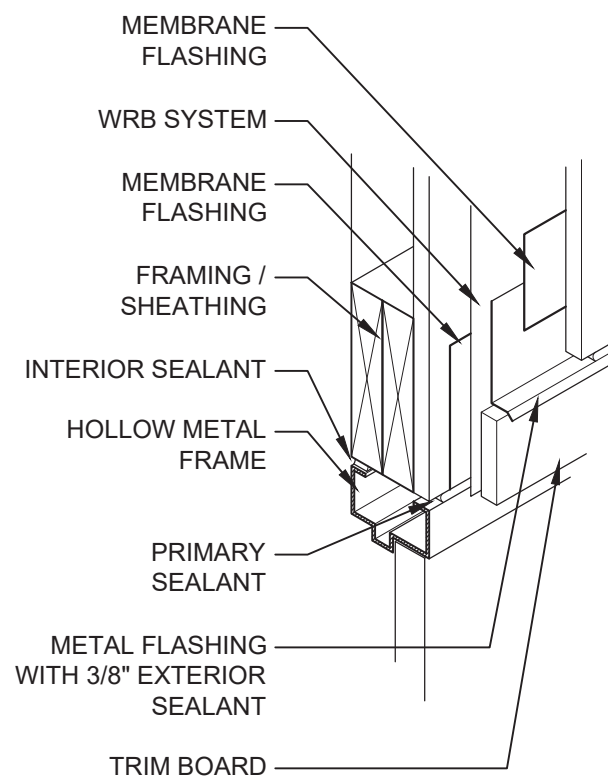


14 HM DOOR - HEAD W/ TRIM
NOT TO SCALE

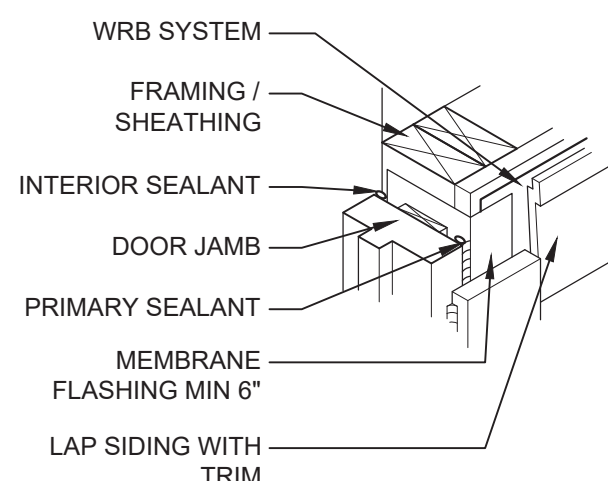


11 DOOR - JAMB W/ SEALANT AND TRIMBOARD
NOT TO SCALE

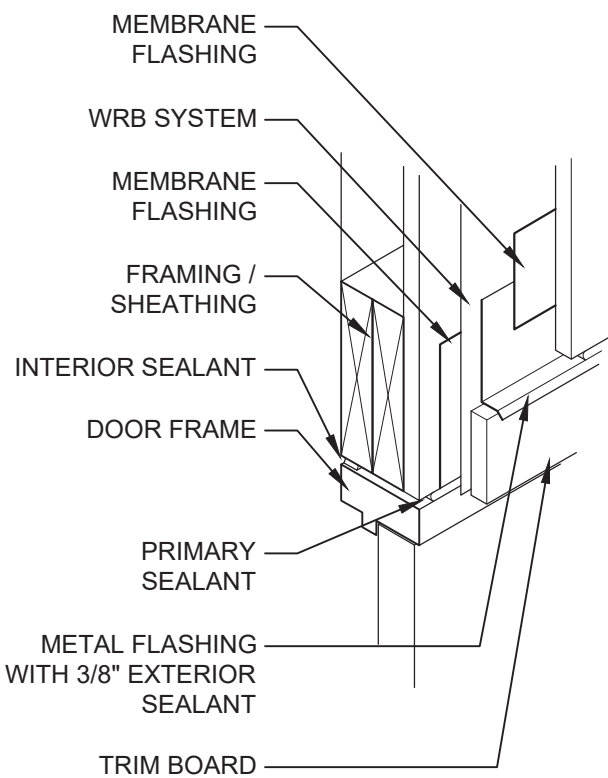


10 DOOR - HEAD W/ SEALANT AND TRIMBOARD
NOT TO SCALE

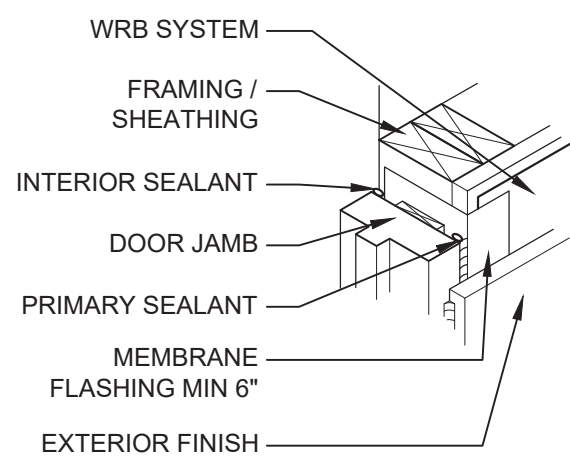


9 DOOR - JAMB W/ SEALANT - NO TRIM
NOT TO SCALE

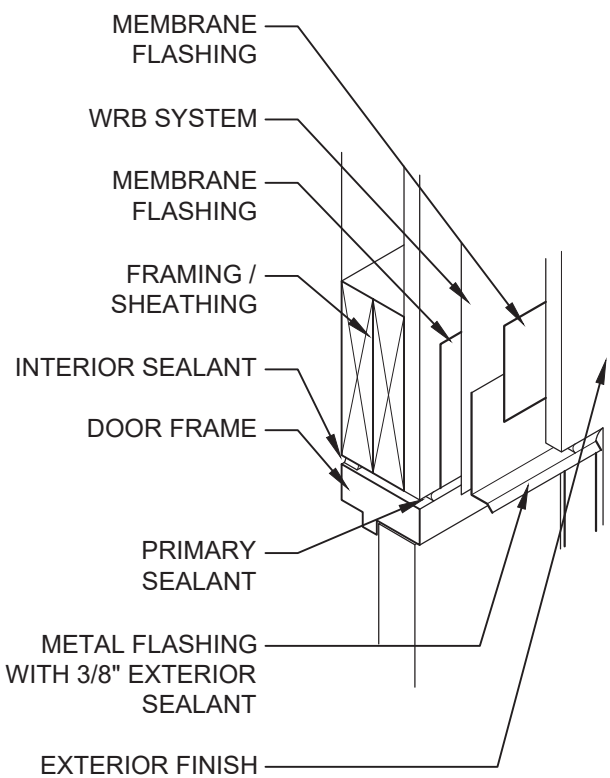


8 DOOR - HEAD W/ SEALANT - NO TRIM
NOT TO SCALE

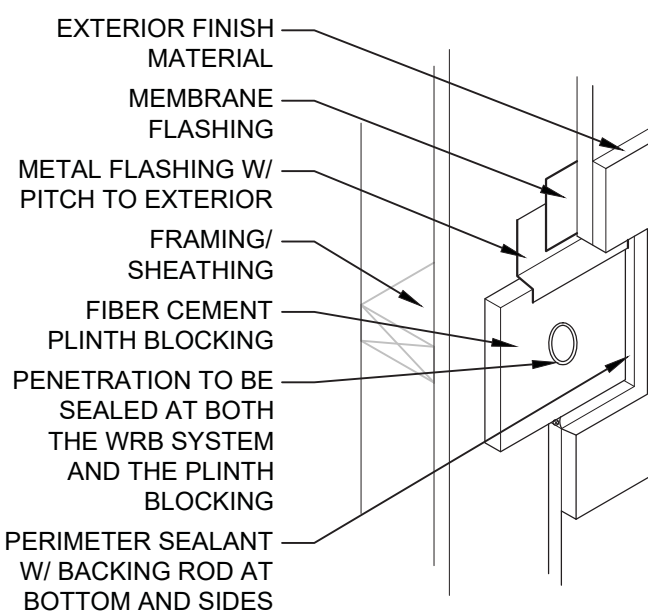








10 FIBER CEMENT - PLINTH / MOUNTING BLOCK
NOT TO SCALE

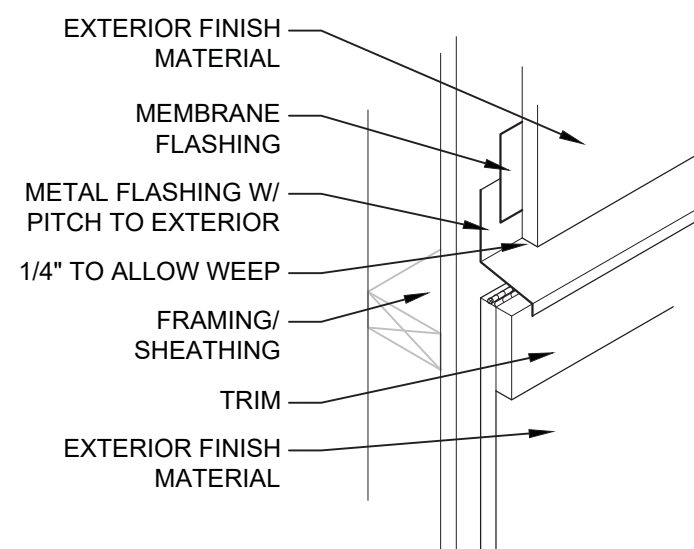

9 FIBER CEMENT - AT HORIZONTAL BAND
NOT TO SCALE

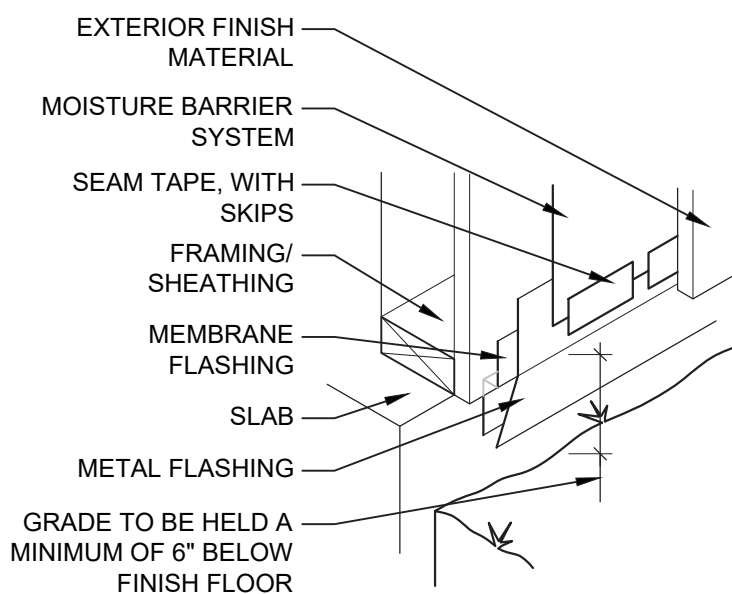




8 FIBER CEMENT - AT GRADE
NOT TO SCALE

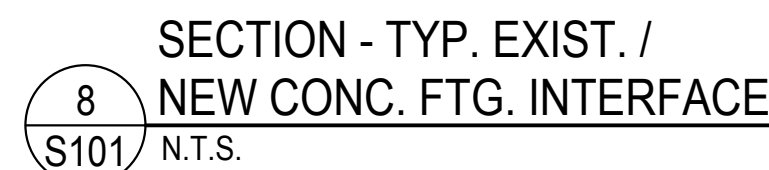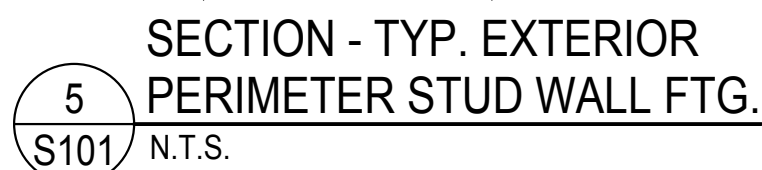

FOUNDATION PLAN NOTES:


1. SEE SHEET S401 FOR DESIGN CRITERIA, GENERAL STRUCTURAL NOTES & SCHEDULES.
2. DIMENSIONS SHOWN WITH "±" ARE EXISTING AND ARE SUBJECT TO FIELD VERIFICATION PRIOR TO ACCEPTANCE AS VALUED.
3. TOP OF SLAB REFERRED ELEVATION = "0'-0" UNLESS OTHERWISE NOTED. SEE ARCHITECTURAL AND CIVIL DRAWINGS FOR ACTUAL SITE ELEVATIONS.
4. CONCRETE FLOOR SLAB IS 4" THICK WITH 6 x 6 - W 21 x 2.1 WELDED WIRE FABRIC, TYPICAL EXCEPT AT MECHANICAL ROOMS WITH DEPRESSED SLAB. PROVIDE 10 MIL VAPOR BARRIER AND 4" COMPACTED GRANULAR BASE UNDER SLAB.
5. ALL EXTERIOR WALL STRIP FOOTINGS SHALL BE 2'-0" WIDE UNLESS OTHERWISE NOTED ON THE PLAN.
6. SEE DETAIL 4/S101 FOR TYPICAL FOOTING STEP.
7. THE TOP OF ALL EXTERIOR WALL STRIP FOOTINGS SHALL BE AT ELEVATION -1'-0", MINIMUM, UNLESS OTHERWISE NOTED ON THE PLAN.
8. OFFSET NEW COLUMN BASE PLATE FLUSH WITH COLUMN FACE TOWARDS EXISTING BUILDING. ALL ANCHOR BOLTS SHALL BE ON THE NEW-CONSTRUCTION FACE OF THE NEW COLUMN. MODIFY BASE PLATE SIZE IF REQUIRED.



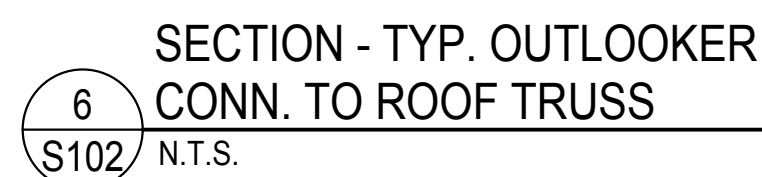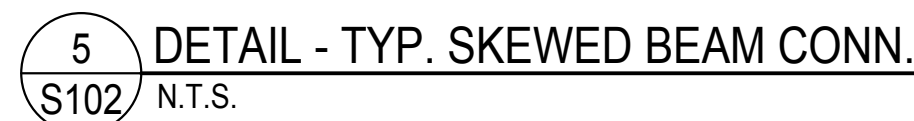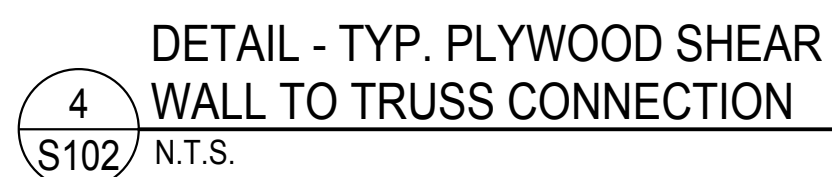


ROOF FRAMING PLAN NOTES:


1. SEE SHEET S401 FOR DESIGN CRITERIA, GENERAL STRUCTURAL NOTES AND SCHEDULES.
2. DIMENSIONS SHOWN WITH '±' ARE EXISTING AND ARE SUBJECT TO FIELD VERIFICATION PRIOR TO ACCEPTANCE AS VALID.
3. COORDINATE ROOF OPENINGS WITH MECHANICAL AND PLUMBING DRAWINGS.

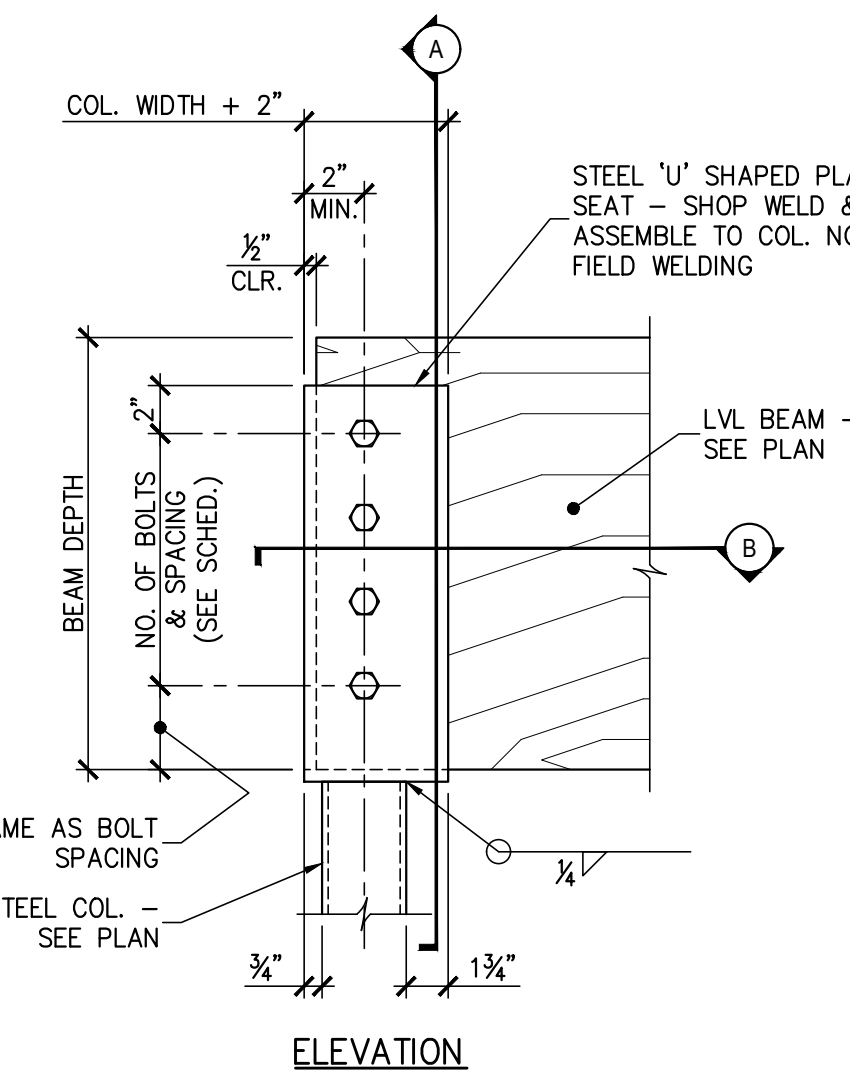


C:\Users\mikem\Desktop\RPA Projects\2024\2024288 Wilkinson Design - Camp Agape Pool House Addition-Renovation_Structural\2024288PNDN.dwg, S201, 1/21/2025 2:44:38 PM, mikem, DWG To PDF.pc3, ARCH full bleed D (24.00 x 36.00 Inches), 1:1

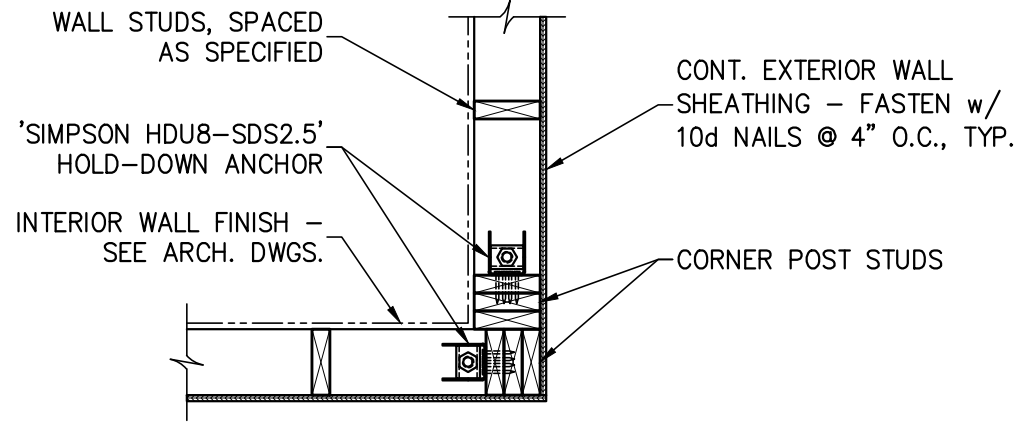

1
S201
PLAN DETAIL - TYP.
SHEAR WALL CORNER
N.T.S.

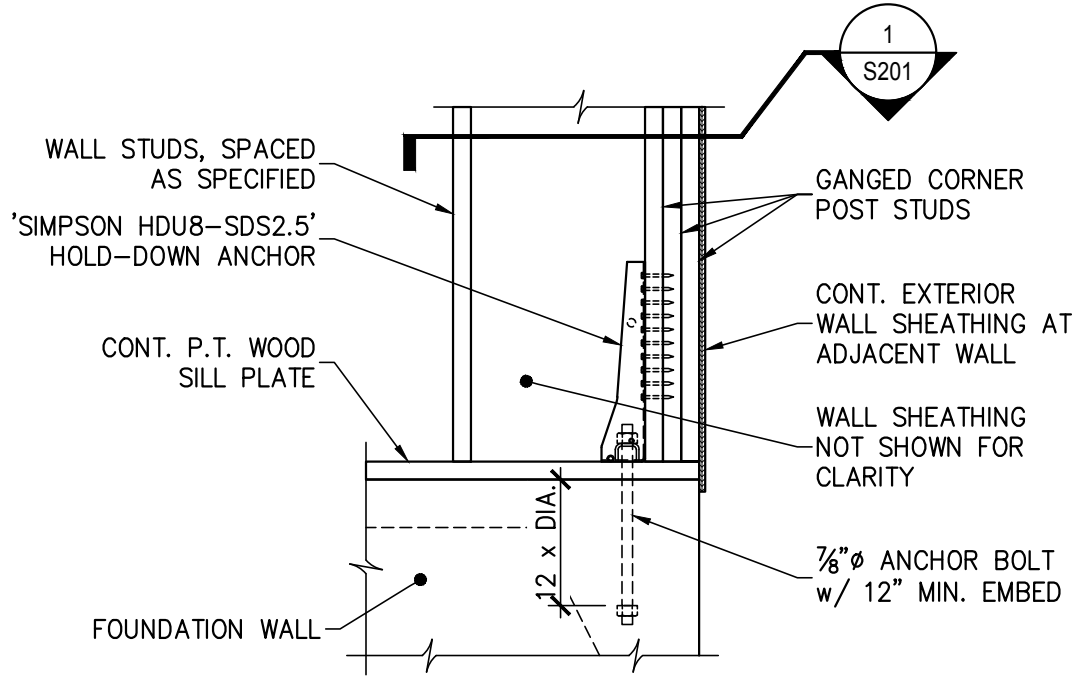


2
S201
DETAIL - TYP. HOLD-DOWN
ANCHOR AT BASE
N.T.S.

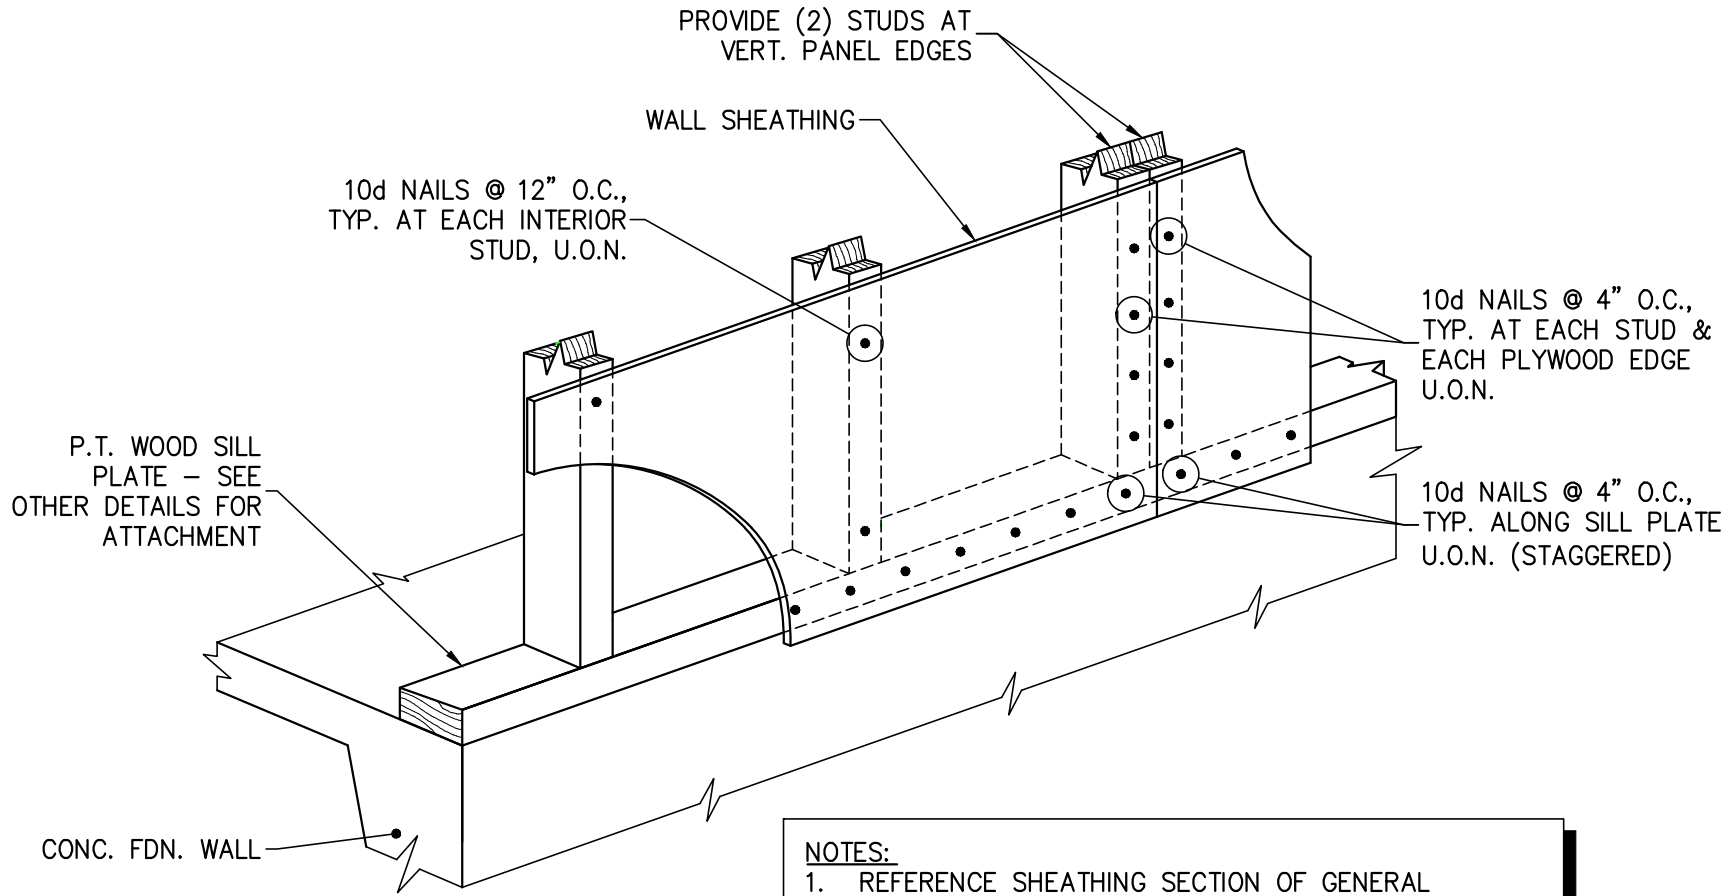


- NOTES:
1. REFERENCE SHEATHING SECTION OF GENERAL STRUCTURAL NOTES FOR ADDITIONAL INFORMATION. NO OSB SHALL BE USED AT SHEAR WALL LOCATIONS.
 2. PROVIDE DOUBLE SILL PLATE IF INDICATED ON OTHER WALL DETAILS AND/OR SECTIONS.


3
S201
DETAIL - TYP. SHEAR WALL BASE NAILING PATTERN
N.T.S.

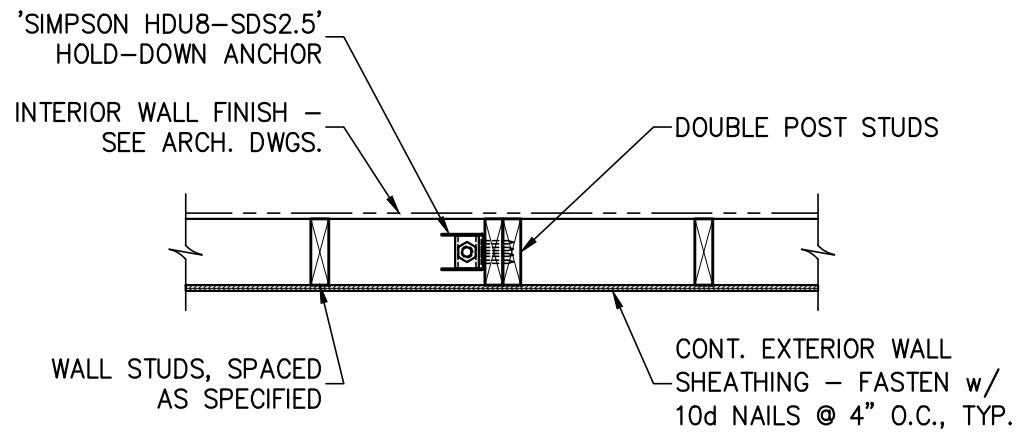

4
S201
PLAN SECTION -
TYP. SHEAR WALL
N.T.S.

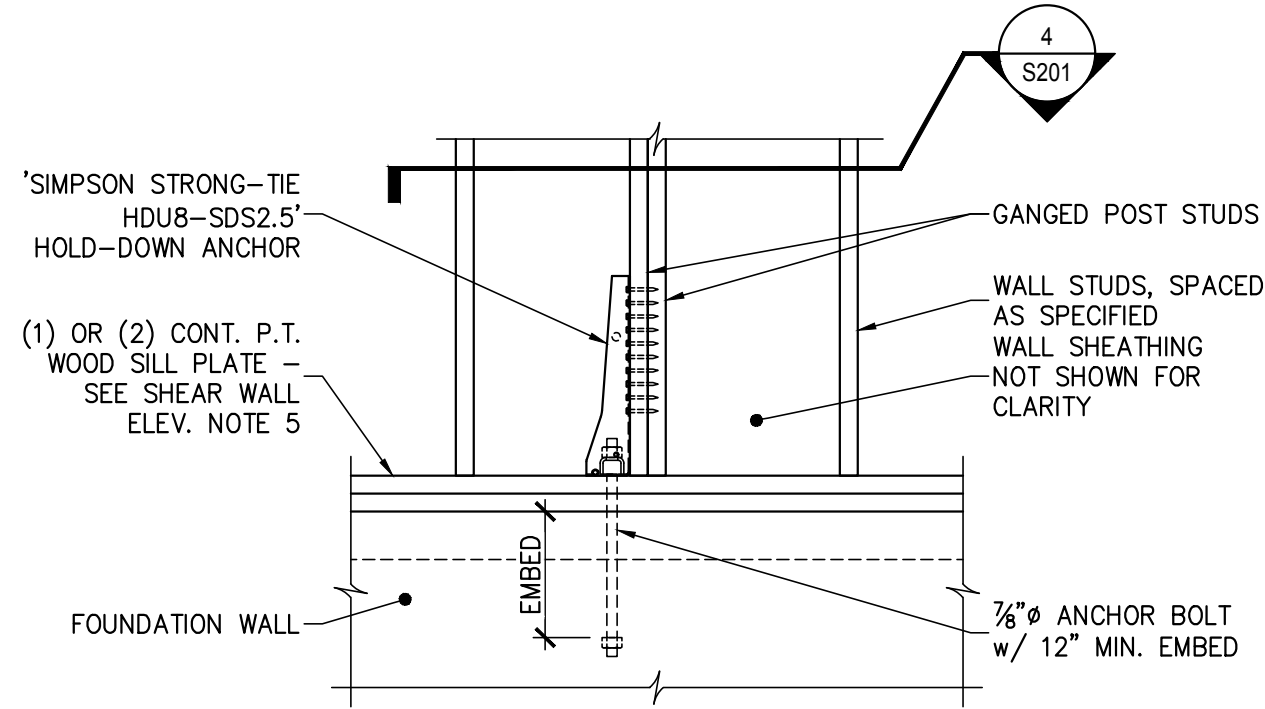


5
S201
DETAIL - TYP. HOLD-DOWN
ANCHOR AT SHEAR WALL BASE
N.T.S.

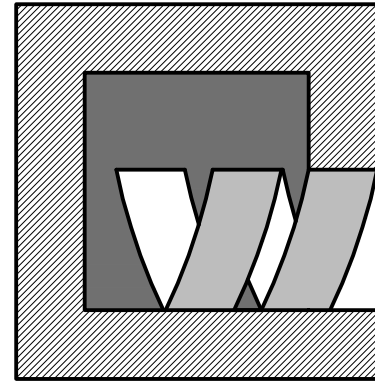

**WILKINSON
DESIGN PLLC**

1848 Wake Forest Road
Raleigh, NC 27608
t. 919-605-1181
f. 919-573-9323
www.wdesignus.com

RPA ENGINEERING, P.A.	
Structural Engineering Solutions	
Engineering License Certificate No. C-2734	Phone : 252-321-6027
1 Commerce Square	Fax : 252-355-2179
Suite 202	Washington, NC 27889
RPA Project No.: 2024288	

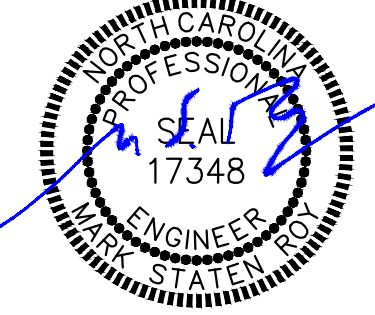

RENOVATION / ADDITION TO POOL BUILDING FOR:

CAMP AGAPE

1369 TYLER DEWAR LN
FUQUAY-VARINA NC 27526

PROJECT NUMBER
224215

DATE
JANUARY 21, 2025

REVISIONS

SHEAR WALL SECTIONS &
DETAILS

S201

C:\Users\mitem\Desktop\RPA Projects\2024\2024288 Wilkinson Design - Camp Agape Pool House Addition-Renovation_Structural\2024288NOTE.dwg, S401, 1/21/2025 2:48:01 PM, mitem, DWG To PDF.pc3, ARCH full bleed D (24.00 x 36.00 inches), 1:1

STRUCTURAL DESIGN CRITERIA:

1.

DESIGN LOADS:

1.1.

ROOF DEAD LOAD

MAX

MIN (FOR UPLIFT)

4 PSF

2 PSF

ROOFING & INSULATION

3 PSF

2 PSF

SHEATHING

5 PSF

3 PSF

ROOF FRAMING

3 PSF

0 PSF

PIPING, DUCT, ETC.

15 PSF

7 PSF

1.2.

LIVE LOADS

ROOF LIVE LOAD – ALL AREAS GREATER OF 20 PSF MINIMUM OR SNOW LOAD

1ST FLOOR LIVE LOAD

100 PSF

1.3.

SNOW LOAD

GROUND SNOW LOAD = 15 PSF (FUQUAY-VARINA, NC)

SNOW LOAD IMPORTANCE FACTOR: I = 1.0

SNOW EXPOSURE FACTOR = 1.0

SNOW THERMAL FACTOR = 1.0

ROOF SNOW LOAD = 12 PSF

BASIC DESIGN ROOF SNOW LOAD = 12 PSF

1.4.

WIND LOAD

BASIC WIND SPEED: Vult = 120 MPH (FUQUAY-VARINA, NC)

RISK CATEGORY: I X II III IV

WIND EXPOSURE CATEGORY: "C" (ASCE 7-10)

WIND BASE SHEAR (FOR WIFERS): Vx = 6K Vy = 4.5K

INTERNAL PRESSURE COEFFICIENT: ±0.55

1.5.

SEISMIC LOADS (N.C. STATE BLDG. CODE):

SEISMIC IMPORTANCE FACTOR: I = 1.0

RISK CATEGORY: I X II III IV

SEISMIC DESIGN CATEGORY: A B X C D

MAPPED SPECTRAL RESPONSE ACCELERATION: Ss 17.8 % S1 8.5 % g

SPECTRAL RESPONSE COEFFICIENTS: S08 19.0 % S01 13.6 %

SEISMIC RESPONSE COEFFICIENT: Cs 0.089

RESPONSE MODIFICATION FACTOR, R 2.0 (LIGHT FRAMED WALLS WITH WOOD SHEATHING)

SITE CLASSIFICATION: A B C X D E F

BASIC STRUCTURAL SYSTEM:

X BEARING WALL DUAL w/ SPECIAL MOMENT FRAME

BUILDING FRAME DUAL w/ INTERMEDIATE R/C OR SPECIAL STEEL

MOMENT FRAME INVERTED PENDULUM

SEISMIC BASE SHEAR Vx = 1K Vy = 1K

ANALYSIS PROCEDURE: SIMPLIFIED X EQUIVALENT LATERAL FORCE MODAL

ARCHITECTURAL, MECHANICAL COMPONENTS ANCHORED? YES X NO

LATERAL DESIGN CONTROL: EARTHQUAKE X WIND

ALL DESIGN LOADS ARE PER NORTH CAROLINA STATE BUILDING CODE 2018 EDITION.

WIND LOADS CONTROL THE LATERAL LOAD DESIGN. THE BUILDING UTILIZES SHEAR WALLS FOR LATERAL LOAD RESISTANCE.
2.

FOUNDATION DESIGN CRITERIA:

2.1.

MINIMUM FOOTING BEARING DEPTH BELOW GRADE IS 12 INCHES.

2.2.

FOUNDATION DESIGN IS BASED ON A PRESUMPTIVE SOIL BEARING CAPACITY OF 1,500 PSF.

2.3.

CONTRACTOR SHALL FIELD VERIFY THE SOIL BEARING CAPACITY PRIOR TO START OF CONSTRUCTION.
- GENERAL STRUCTURAL NOTES:
1.

GENERAL NOTES

1.1.

METHODS, PROCEDURES AND SEQUENCES OF CONSTRUCTION ARE THE RESPONSIBILITY OF THE CONTRACTOR.

1.2.

THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO MAINTAIN AND INSURE THE INTEGRITY OF THE STRUCTURE AT ALL STAGES OF CONSTRUCTION.

1.3.

THE CONTRACTOR SHALL REFER TO THE ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR SLEEVES, CURBS, INSERTS OR OPENINGS NOT HEREIN INDICATED.

1.4.

COORDINATE THESE DRAWINGS WITH THE ARCHITECTURAL, MECHANICAL, ELECTRICAL, PLUMBING AND CIVIL DRAWINGS.

1.5.

VERIFY ALL FLOOR AND ROOF OPENING SIZES AND LOCATIONS, EQUIPMENT PAD SIZES AND LOCATIONS, ANCHOR BOLT LAYOUTS, ETCETERA, WITH EQUIPMENT SELECTED.

1.6.

CONTRACTOR SHALL VERIFY ALL EXISTING CONSTRUCTION DIMENSIONS WHICH IMPACT NEW CONSTRUCTION PRIOR TO FABRICATING ANY REBAR, STEEL, TRUSSES, ETCETERA.

1.7.

DO NOT CUT, NOTCH, OR OTHERWISE MODIFY ANY STRUCTURAL MEMBERS UNLESS SPECIFICALLY INDICATED ON THE DRAWINGS WITHOUT APPROVAL OF THE ENGINEER OF RECORD.

1.8.

CUTTING OF STEEL MEMBERS AND INSTALLATION OF HOLES IN STEEL MEMBERS SHALL BE DONE BY CUTTING OR DRILLING. DO NOT USE TORCHES FOR CUTTING UNLESS APPROVED BY THE ENGINEER OF RECORD.

1.9.

CONTRACTOR IS RESPONSIBLE FOR DESIGN AND INSTALLATION OF ALL SHORING REQUIRED TO SUPPORT NEW AND EXISTING STRUCTURAL ELEMENTS.

2.

FOUNDATION

2.1.

ALL FOOTINGS SHALL BE ON UNDISTURBED SOIL OR 98% COMPACTED FILL PER ASTM D698.

2.2.

NO FOOTINGS OR SLABS SHALL BE POURED INTO OR AGAINST SUBGRADE CONTAINING FREE WATER, FROST, ICE OR LOOSE MATERIAL.

2.3.

EXCAVATIONS FOR FOOTINGS SHALL HAVE THE SIDES AND BOTTOMS TEMPORARILY LINED WITH 6 MIL. POLYETHYLENE IF PLACEMENT OF CONCRETE DOES NOT OCCUR WITHIN 24 HRS OF THE EXCAVATION OF THE FOOTING.

2.4.

ADVERSE FOUNDATION CONDITIONS NOTED DURING CONSTRUCTION SUCH AS SOFT SOILS, ORGANIC MATTER, ETCETERA, SHALL BE REPORTED TO THE ENGINEER BEFORE FURTHER CONSTRUCTION IS ATTEMPTED.

2.5.

IF UNDERMINING OF FOOTINGS OCCURS, FILL VOIDS WITH LEAN CONCRETE MIX. DO NOT ATTEMPT TO REPLACE AND RECOMPACT SOIL.

3.

REINFORCED CONCRETE MASONRY

3.1.

LOAD-BEARING MASONRY PIERS OR WALLS, FOUNDATION WALLS, AND ANY OTHER MASONRY SO DESIGNATED ON THE DRAWINGS, ARE CONSIDERED TO BE STRUCTURAL MASONRY.

3.2.

COMPRESSIVE STRENGTH OF MASONRY UNITS:

SOLID CLAY UNITS 8250 PSI

MINIMUM NET AREA 1900 PSI ON NET AREA

3.3.

MINIMUM NET AREA COMPRESSIVE STRENGTH OF CONCRETE MASONRY (Fm) IS 1,900 PSI.

3.4.

MORTAR SHALL BE TYPE "S" ASTM C270.

3.5.

GROUT FOR REINFORCED MASONRY SHALL BE FINE GROUT ASTM C476. MINIMUM 28 DAY COMPRESSIVE STRENGTH SHALL BE 3000 PSI. MAXIMUM HEIGHT TO WHICH MASONRY SHALL BE LAID BEFORE FILLING IS 6'-0". PROVIDE CLEANOUT OPENINGS AT THE BOTTOM OF EACH GROUT LIFT. CLEANOUT OPENINGS SHALL BE PROVIDED AT EACH CELL TO BE FILLED WITH GROUT.

3.6.

REINFORCING GRADE AND DETAILS FOR MASONRY, SHALL BE AS THAT FOR CONCRETE. TIE IN REBAR IN POSITION, AND PLACE CONCRETE AROUND REINFORCING DURING CONSTRUCTION OF MASONRY. DO NOT PUSH REINFORCING DOWN INTO PREVIOUSLY PLACED GROUT FILL. SET BOLTS SIMILARLY. TIE WYTHES WITH HORIZONTAL REINFORCING AS SPECIFIED.

3.7.

ALL CELLS BELOW GRADE SHALL BE FULLY GROUTED WITH MASONRY GROUT.

3.8.

PROVIDE HORIZONTAL JOINT REINFORCING AT 16" O.C. UNLESS OTHERWISE NOTED.

3.9.

PLACE ALL VERTICAL REINFORCING BARS IN CENTERS OF BLOCK CELLS UNLESS OTHERWISE NOTED.

3.10.

FILL ALL CELLS, AT VERTICAL REINFORCING, FULL HEIGHT WITH MASONRY GROUT.

3.11.

CONTRACTOR SHALL COORDINATE LOCATION OF ALL OPENINGS IN MASONRY. SEE ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR SIZE AND LOCATION OF OPENINGS.

3.12.

ALL MASONRY WORK PERFORMED, SHALL BE IN ACCORDANCE WITH ACI/ASCE 530. MASONRY CONSTRUCTION AND MATERIALS USED, SHALL CONFORM TO ALL REQUIREMENTS OF THESE CONTRACT DOCUMENTS.

3.13.

UNLESS OTHERWISE SHOWN, MASONRY WALLS SHALL HAVE VERTICAL CONTROL JOINTS AT A MAXIMUM SPACING OF 40'-0" ON CENTER FOR BRICK AND OF 25'-0" FOR CMU. THE JOINT SHALL BE FORMED USING PVC MATERIAL CONFORMING TO ASTM D2287, TYPE PVC 654-4. COORDINATE LOCATION OF JOINTS WITH THE ARCHITECTURAL ELEVATIONS.

3.14.

PLACE A CONTINUOUS HORIZONTAL CMU BOND BEAM AT EACH FLOOR, AND AT THE TOP OF THE WALL, AND AT INTERMEDIATE LOCATIONS AS REQUIRED TO PROVIDE A MAXIMUM VERTICAL SPACING OF 12'-0", UNLESS OTHERWISE NOTED ON THE PLAN.

4.

CONCRETE

4.1.

ALL PLACED CONCRETE, SHALL HAVE NORMAL WEIGHT COARSE AGGREGATES UNLESS OTHERWISE NOTED, AND SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH (f'c) AT 28 DAYS AS SHOWN ON THE CONCRETE MATERIALS SCHEDULE.

4.2.

GROUT FOR BASE PLATES SHALL BE NON-METALLIC, NON-SHRINKABLE GROUT, AND SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH, AT 28 DAYS, OF 5000 PSI.

4.3.

NO CALCIUM CHLORIDE SHALL BE USED IN ANY CONCRETE.

4.4.

CHAMFER ALL EXPOSED EXTERNAL CORNERS OF CONCRETE WITH ¾" x 45 DEGREE CHAMFER, UNLESS OTHERWISE NOTED.

4.5.

HORIZONTAL FOOTING AND HORIZONTAL WALL REINFORCING SHALL BE CONTINUOUS, AND SHALL HAVE 90 DEGREE BENDS AND EXTENSIONS, OR CORNER BARS OF EQUIVALENT SIZE LAPPED, WITH A CLASS B TENSION SPLICE, AT CORNERS AND INTERSECTIONS. TOP BAR CRITERIA SHALL APPLY IF 12" OR MORE OF FRESH CONCRETE IS PLACED BELOW BAR.

4.6.

SEE ARCHITECTURAL DRAWINGS FOR ALL WATERPROOFING / DAMPPROOFING DETAILS.

4.7.

ALL DOWELS SHALL MATCH SIZE AND NUMBER OF MAIN REINFORCING, UNLESS OTHERWISE NOTED ON THE DRAWINGS.

4.8.

SEE ARCHITECTURAL DRAWINGS FOR TYPE AND LOCATION OF FLOOR FINISHES.

4.9.

SEE MECHANICAL, ELECTRICAL, PLUMBING AND CIVIL DRAWINGS FOR ADDITIONAL WALL / SLAB OPENINGS NOT SHOWN ON THE STRUCTURAL DRAWINGS.

4.10.

ALL REINFORCING SHALL CONFORM TO ASTM A615, GRADE 60.

4.11.

WELDED WIRE FABRIC SHALL CONFORM TO ASTM A185.

4.12.

DETAIL AND FABRICATE REINFORCING STEEL IN ACCORDANCE WITH THE ACI DETAILING MANUAL.

4.13.

IN-PLACE REINFORCING STEEL SHALL BE REVIEWED BY THE ENGINEER PRIOR TO PLACEMENT OF CONCRETE.

4.14.

AT CORNERS AND INTERSECTIONS, PROVIDE BARS OF THE SAME NUMBER AND SIZE AS THE LONGITUDINAL BARS IN THE FOOTING.

4.15.

CONCRETE MATERIALS SHALL BE AS FOLLOWS:

4.15.1.

USE TYPE I/II PORTLAND CEMENT CONFORMING TO ASTM C150

4.15.2.

AGGREGATE SHALL CONFORM TO ASTM C33 (FINE AND COURSE AGGREGATES)

4.15.3.

AIR ENTRAINING ADMIXTURE SHALL CONFORM TO ASTM C260

4.15.4.

PLASTICIZER CAN BE USED TO IMPROVE WORKABILITY IF REQUIRED

4.16.

CONCRETE MIX DESIGN:

4.16.1.

MAXIMUM WATER/CEMENT RATIO – 0.50 FOR SLAB, 0.55 FOR FOOTINGS AND OTHER CONCRETE UNLESS OTHERWISE NOTED.

4.16.2.

SLUMP SHALL BE 4 INCHES TO 6 INCHES (WITHOUT PLASTICIZER)

4.16.3.

AIR ENTRAINMENT SHALL BE 4% TO 6% (EXTERIOR CONCRETE)

4.17.

CONCRETE SLAB SHALL BE CURED USING A WATER-BASED CURING COMPOUND. CURING COMPOUND SHALL BE APPLIED TO ALL HORIZONTAL SURFACES. ONCE THE SURFACE WATER DISSIPATES AND THE SURFACE IS NOT MARRED BY WALKING, APPLY PER MANUFACTURER'S SPECIFICATIONS.

4.18.

CONDUCT SLUMP, AIR, AND STRENGTH TESTS OF CONCRETE IN ACCORDANCE WITH THE FOLLOWING PROCEDURES:

4.18.1.

SECURE SAMPLES IN ACCORDANCE WITH "METHOD OF SAMPLING FRESH CONCRETE" (ASTM C 172). MOLD AND CURE FIVE SPECIMENS FROM EACH SAMPLE IN ACCORDANCE WITH "METHOD OF MAKING AND CURING CONCRETE COMPRESSION AND FLEXURE SPECIMENS IN THE FIELD" (ASTM C 31). FIVE SPECIMENS COMPRISE ONE TEST. TEST TWO SPECIMENS AT 7 DAYS (ASTM C 39). TEST TWO SPECIMENS AT 28 DAYS IN ACCORDANCE WITH "METHOD OF TEST FOR COMPRESSIVE STRENGTH OF MOLDED CONCRETE CYLINDERS" (ASTM C 39). TEST EVALUATION SHALL BE CONDUCTED IN ACCORDANCE WITH PROVISIONS OF ACI 318-14. KEEP ONE SPECIMEN IN RESERVE.

4.18.2.

MAKE ONE STRENGTH TEST FOR EACH 100 CUBIC YARDS OR FRACTION THEREOF FOR EACH MIX DESIGN OF CONCRETE PLACED IN ONE DAY, EXCEPT THAT IN NO CASE SHALL A GIVEN MIX DESIGN BE REPRESENTED BY LESS THAN THREE TESTS.

5.

WOOD FRAMING

5.1.

ALL STRUCTURAL WOOD MEMBERS SHALL BE No. 2 SOUTHERN YELLOW PINE, 19% MAXIMUM MOISTURE CONTENT, UNLESS OTHERWISE NOTED. INTERIOR NON BEARING PARTITIONS MAY BE No. 2 SPRUCE (SPF).

5.2.

ALL WOOD FRAMING, DIRECTLY EXPOSED TO WEATHER, OR IN DIRECT CONTACT WITH MASONRY, SOIL OR CONCRETE, SHALL BE PRESSURE TREATED, UNLESS OTHERWISE NOTED.

5.3.

ALL LVLS, DIRECTLY EXPOSED TO WEATHER, OR IN DIRECT CONTACT WITH MASONRY, SOIL OR CONCRETE, SHALL BE EXTERIOR GRADE, UNLESS NOTED OTHERWISE.

5.4.

ALL METAL CONNECTORS SHALL BE HOT DIP GALVANIZED. INSTALL ALL CONNECTORS PER THE MANUFACTURER'S RECOMMENDATIONS. METAL CONNECTOR DESIGNATIONS INDICATED ON PLANS, ARE FOR "SIMPSON STRONG-TIE" ANCHORS. ANCHORS FROM OTHER MANUFACTURERS MAY BE USED, PROVIDED THEY HAVE EQUIVALENT STRENGTH.

5.5.

ALL NAILED CONNECTIONS SHALL BE IN ACCORDANCE WITH NORTH CAROLINA STATE BUILDING CODE TABLE 2304.10.1, SEE 2018 NCBC – FASTENING SCHEDULE, UNLESS OTHERWISE NOTED.

5.6.

FRAMING CONNECTIONS THAT ARE BOLTED OR SCREWED, SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL DESIGN SPECIFICATION FOR WOOD.

5.7.

PROVIDE STUDS AND HEADERS AT ALL EXTERIOR WALLS AND INTERIOR BEARING WALLS AS FOLLOWS, UNLESS OTHERWISE NOTED:

OPENING WIDTH

STUDS

HEADER

0'-0" TO 6'-0"

2 KING STUDS, 1 JACK STUD

(2) 2 x 10 AT 2 x 4 WALL
(3) 2 x 10 AT 2 x 6 WALL

6'-1" TO 8'-0"

2 KING STUDS, 2 JACK STUDS

(2) 2 x 10 AT 2 x 4 WALL
(2) 2 x 10 AT 2 x 6 WALL

8'-1" TO 12'-0"

3 KING STUDS, 2 JACK STUDS

(2) 2 x 12 AT 2 x 4 WALL
(3) 2 x 12 AT 2 x 6 WALL

6.

WOOD DECKING/SHEATHING

6.1.

TONGUE AND GROOVE DECKING SHALL BE 3 x 6 NOMINAL No. 2 SOUTHERN YELLOW PINE, UNLESS OTHERWISE NOTED. FASTENING OF DECKING SHALL BE DONE AS FOLLOWS:
TOENAIL DECKING AT EACH SUPPORT WITH ONE 40d COMMON NAIL AND FACE NAIL WITH ONE 6 INCH SPIKE OR 60d COMMON NAIL. COURSES SHALL BE SPIKED TO EACH OTHER WITH 8 INCH SPIKES AT 30 INCH MAXIMUM SPACING THROUGH PRE-DRILLED EDGE HOLES PENETRATING TO A DEPTH OF APPROXIMATELY 4 INCHES INTO THE ADJACENT COURSE AND WITH ONE SPIKE AT A DISTANCE NOT EXCEEDING 10 INCHES FROM THE END OF EACH PIECE.

6.2.

WALL SHEATHING SHALL BE ½" PLYWOOD OR ORIENTED STRAND BOARD (OSB), UNLESS OTHERWISE NOTED. ATTACH WALL SHEATHING TO FRAMING WITH 10d NAILS AT 4" O.C. AT PANEL EDGES AND 12" O.C. AT INTERIOR MEMBERS. PROVIDE SOLID BLOCKING AT PANEL EDGES (48" O.C.).

6.3.

ROOF SHEATHING SHALL BE ½" PLYWOOD OR ORIENTED STRAND BOARD (OSB), UNLESS OTHERWISE NOTED. ATTACH ROOF SHEATHING TO FRAMING WITH 8d NAILS AT 4" O.C. AT PANEL EDGES AND 12" O.C. AT INTERIOR MEMBERS.

EXPOSED CONCRETE FINISH SCHEDULE		
AREA	FINISH	COMMENTS
BASEMENT WALLS	SMOOTH FORM	–
ALL EXTERIOR WALLS, CURBS, UNLESS OTHERWISE NOTED	SMOOTH FORM	–
EXTERIOR CONCRETE PAVEMENT, SIDEWALKS	COARSE BROOM	–
SLAB ON GRADE	TROWEL	–
EXT. EQUIP. PADS	COARSE BROOM	–
EXTERIOR STAIRS	COARSE BROOM	–
–	–	–

CONCRETE REBAR SPLICE SCHEDULE			
BAR SIZE	LAP LENGTH (in.)		
	f'c = 3000 psi	f'c = 4000 psi	f'c = 5000 psi
#4	22	19	17
#5	28	24	21
#6	32	29	26
#7	48	42	37
#8	55	48	43
#9	62	54	48
#10	68	60	53
#11	76	66	59

NOTES:

 - CONCRETE IS NORMAL WEIGHT CONCRETE. IF LIGHTWEIGHT CONCRETE IS USED, MULTIPLY LENGTHS IN TABLE BY 1.3.
 - BAR YIELD STRENGTH (fy) IS 60 KSI.
 - BAR SPACING AND COVER REQUIREMENTS OF ACI SECTION 25.4.2.2 ARE ASSUMED TO BE MET. IF NOT, MULTIPLY LENGTHS IN TABLE BY 1.5.
 - REDUCTION OF EXCESS REINFORCEMENT NOT TAKEN.
 - IF MORE THAN 12" OF FRESH CONCRETE IS CAST IN MEMBER BELOW HORIZONTAL SPLICE, MULTIPLY LENGTHS IN TABLE BY 1.3.

CONCRETE MATERIALS SCHEDULE		
LOCATION	MINIMUM COMPRESSIVE STRENGTH (AT 28 DAYS)	REMARKS
FOUNDATIONS	3000 PSI	–
SLAB ON GRADE	4000 PSI	–
WALLS	3000 PSI	–
EQUIPMENT PADS	3000 PSI	–
ELEVATED FLOOR SLAB	4000 PSI	LIGHTWEIGHT CONCRETE
CONCRETE FOR MASONRY CORES, BOND BEAMS	3000 PSI	ASTM C476 GROUT
MISCELLANEOUS	3000 PSI	–

BEND RADIUS (R)

4db – No.3 – No.8
5db – No.9 – No.11
6db – No.14 – No.18

CONCRETE SURFACE

HOOK DEVELOPMENT LENGTH (Ldh)
(CONCRETE EMBEDMENT)

LAP DISTANCE
(SEE LAP SPLICE SCHEDULE)

STANDARD HOOKS IN TENSION (PER ACI 318-02)			
HOOK DEVELOPMENT LENGTH Ldh (INCHES)			
BAR SIZE	f'c 3000 psi	f'c 4000 psi	f'c 5000 psi
#3	9	7	7
#4	11	10	9
#5	14	12	11
#6	17	15	13
#7	19	17	15
#8	22	19	17
#9	25	22	19
#10	28	24	22
#11	31	26	24

NOTES:

 - CONCRETE IS NORMAL WEIGHT CONCRETE. IF LIGHTWEIGHT CONCRETE IS USED, MULTIPLY LENGTHS IN TABLE BY 1.3.
 - BAR YIELD STRENGTH (fy) IS 60 KSI.
 - SIDE COVER REQUIREMENTS OF ACI SECTION 25.4.3.2 ARE ASSUMED TO NOT BE MET.
 - TIE OR STIRRUP REQUIREMENTS OF ACI SECTION 25.4.3.2 ARE ASSUMED TO NOT BE MET.
 - REDUCTION OF EXCESS REINFORCEMENT IS NOT TAKEN.
 - HOOK DEVELOPMENT LENGTH IS VALID FOR 180° HOOKS ALSO.

db = BAR DIAMETER

**WILKINSON
DESIGN PLLC**

1848 Wake Forest Road
Raleigh, NC 27608
t. 919-605-1181
f. 919-573-9323
www.wdesignus.com

RPA ENGINEERING, P.A.
Structural Engineering Solutions
Engineering License Certificate No. C-2734
1 Commerce Square
Suite 202
Washington, NC 27889
Phone : 252-321-6027
Fax : 252-355-2179
RPA Project No.: 2024288

RENOVATION / ADDITION TO POOL BUILDING FOR:

CAMP AGAPE

1369 TYLER DEWAR LN
FUQUAY-VARINA NC 27526

PROJECT NUMBER
224215

DATE
JANUARY 21, 2025

REVISIONS

STRUCTURAL DESIGN
CRITERIA, GENERAL
STRUCTURAL NOTES &
SCHEDULES








S401



THIS DRAWING IS THE PROPERTY OF RPA ENGINEERING, P.A. ANY USE, REUSE, REPRODUCTION, DISPLAY OR SALE OF THIS DRAWING WITHOUT WRITTEN CONSENT OF RPA ENGINEERING, P.A. IS STRICTLY PROHIBITED. (COPYRIGHT, RPA ENGINEERING, P.A. 2025)

PLUMBING SPECIFICATIONS	
<p>GENERAL:</p> <p>THESE PERMIT DRAWINGS DESCRIBE DIAGRAMMATICALLY, AND IN GENERAL TERMS, THE INTENDED SCOPE OF WORK AS UNDERSTOOD BY THE ENGINEER. THE ENGINEER CREATED THE DRAWINGS, INCLUDING PLANS, DIAGRAMS, SPECIFICATIONS, AND NOTES, FOR THE EXPRESS PURPOSE OF DESCRIBING THE PROJECT TO THE LOCAL INSPECTIONS AUTHORITY'S PLANS REVIEW STAFF FOR THEIR USE IN GRANTING A BUILDING PERMIT.</p> <p>THE CONTRACTOR SHALL BE RESPONSIBLE FOR FULLY UNDERSTANDING THE ACTUAL FIELD CONDITIONS OF THE PROJECT SITE AND THE SCOPE OF WORK AS EXPRESSED BY THE PARTY TO WHOM THE CONTRACTOR HAS CONTRACTED TO PERFORM THE WORK. THEREFORE, THE CONTRACTOR SHALL REVIEW THESE DOCUMENTS THOROUGHLY FOR ALL CONFLICTS, AND FOR ANY ASPECT OF THE WORK SHOWN IN THESE DOCUMENTS THAT IS AT VARIANCE WITH THE CONTRACTOR'S UNDERSTANDING OF THE WORK. THE CONTRACTOR SHALL PERFORM ALL WORK NECESSARY TO COMPLETE THE FACILITY OWNER'S INTENDED SCOPE OF WORK FOR THE PROJECT.</p> <p>THE CONTRACTOR SHALL PERFORM ALL WORK ACCORDING TO ALL RELEVANT CODES, ALL JURISDICTION STANDARDS, AND THE MOST CURRENT INTERPRETATIONS OF THE CODE AS STATED BY THE AUTHORITY HAVING JURISDICTION. IF ANYTHING IS NECESSARY FOR THE COMPLETE, PROPER, AND SAFE INSTALLATION, OPERATION, AND FUNCTION OF THE WORK DESCRIBED IN THESE DOCUMENTS, THE CONTRACTOR SHALL PROVIDE IT EVEN IF NOT CLEARLY INDICATED IN THESE DOCUMENTS.</p> <p>THE CONTRACTOR SHALL SUPPLEMENT THESE CONTRACT DOCUMENTS WITH ALL DETAILS OF CONSTRUCTION; ALL MATERIAL, DEVICE, AND EQUIPMENT INSTALLATION INSTRUCTIONS; ANY NEEDED MANUFACTURER, SUPPLY HOUSE, AND VENDOR ASSISTANCE; SHOP DRAWINGS, AND FIELD INSTALLATION DRAWINGS NECESSARY TO COMPLETE THE PROJECT.</p> <p>DETERMINE THE ACTUAL FIELD CONDITIONS AND INSTALLATION DETAILS. FULLY COORDINATE EVERY DEVICE AND EQUIPMENT AND THE RESPECTIVE LOCATIONS FOR EQUIPMENT, DEVICES, AND MATERIALS AMONG ALL CONTRACTOR TRADES AND WITH THE OWNER, IF NECESSARY. INSTALL EVERY PIECE OF EQUIPMENT AND ALL CONTROL DEVICES WITH ALL CODE--REQUIRED AND MANUFACTURER--RECOMMENDED SERVICING CLEARANCES, FREE OF OBSTRUCTIONS, AND WITHOUT CONFLICT WITH OTHER EQUIPMENT OR BUILDING ELEMENTS.</p> <p>CONTRACTOR COORDINATION AND PRICING:</p> <p>VISIT THE SITE OF THIS PROJECT AS OFTEN AS NECESSARY TO BECOME THOROUGHLY FAMILIAR WITH ALL EXISTING FIELD CONDITIONS AND THE FULL EXTENT OF THE WORK TO BE PERFORMED. VERIFY EVERY ASPECT OF THE PROPOSED WORK AS DESCRIBED OR IMPLIED BY THESE CONTRACT DOCUMENTS PRIOR TO SUBMITTING A PRICE FOR THIS WORK.</p> <p>REVISE ANY ORIGINAL PRICING PRESENTED PRIOR TO THE CONTRACTOR'S RECEIPT OF THESE DRAWINGS TO SHOW ALL ADJUSTMENTS TO THE PRICE. THE CONTRACTOR'S RISK INCLUDES ANY COST INCURRED PRIOR TO OBTAINING ALL CLARIFICATIONS TO THESE DOCUMENTS, OR TO THE DESIGNER'S OR OWNER'S INTENT.</p> <p>THE ENGINEER DID NOT INDEPENDENTLY VERIFY ALL EXISTING FIELD CONDITIONS. DETERMINE ALL MISSING INFORMATION RELEVANT TO THE PERMITTED WORK. TAKE ACTUAL FIELD MEASUREMENTS AT THE JOB SITE INSTEAD OF SCALING THE DRAWINGS. THE SYMBOLS AND DIAGRAMS SHOWN HAVE NO DIMENSIONAL SIGNIFICANCE AND DO NOT SHOW EVERY APPLICABLE NECESSARY FOR COMPLETE INSTALLATION AND CONFIGURATION. THE DRAWINGS SHOW APPROXIMATE LOCATIONS FOR ALL EQUIPMENT, DEVICES, AND MATERIALS. DETERMINE FINAL LOCATIONS IN THE FIELD BASED UPON ACTUAL CONSTRUCTION.</p> <p>BRING ALL CONTRACT DOCUMENT--RELATED OMISSIONS, DISCREPANCIES, AND CONFLICTS TO THE ENGINEER'S ATTENTION PRIOR TO COMMENCING WORK AND INCURRING ANY COSTS FOR LABOR OR MATERIALS. WHERE THE ENGINEER HAS NO POST--DESIGN AND CONSTRUCTION ASSISTANCE RESPONSIBILITIES TO THE PROJECT, TAKE ALL FIELD--DISCOVERED CONFLICTS AND INTERFERENCES TO THE GENERAL CONTRACTOR'S ATTENTION FOR RESOLUTION BY THE RESPECTIVE TRADES.</p> <p>SUBMIT ALL REQUESTS FOR INFORMATION (RFI) WITH WRITTEN COMMENTS DEFINING THE INFORMATION AND ASSISTANCE NEEDED. DOCUMENT THE REQUEST WITH RELEVANT INFORMATION FROM THE PLANS AND SPECIFICATIONS.</p> <p>QUALIFICATIONS AND STANDARDS OF WORKMANSHIP:</p> <p>PERFORM ALL WORK USING EXPERIENCED, SKILLED CRAFTSMEN LICENSED IN THEIR RESPECTIVE TRADES, AND COMPETENT TO PERFORMED THE WORK INVOLVED WITH THIS PROJECT.</p> <p>ALL WORK AND MATERIALS SHALL CONFORM TO THE APPLICABLE LOCAL, STATE, AND NATIONAL CODES (INCLUDING OSHA), AS THE ABSOLUTE MINIMUM ACCEPTABLE QUALITY STANDARD, COMPLY WITH THE LATEST EDITION OF THE STATE BUILDING CODE AND THESE SPECIFICATIONS.</p> <p>DEMOLITION:</p> <p>REMOVE ALL EQUIPMENT, DEVICES, AND MATERIALS NOT INTENDED TO REMAIN AND OBSTRUCTING NEW WORK. MECHANICALLY SECURE ALL ABANDONED EXISTING EQUIPMENT, FIXTURES, VALVES, DEVICES, PIPING, TUBING, ETC. WHEN DEMOLISHING PIPING, CONDUITS, WIRING, AND CABLING, REMOVE ALL PORTIONS BACK TO THE NEAREST POINT THAT REMAINS IN SERVICE. PROVIDE ALL DEVICES, CAPS, VALVES, FITTINGS, INSULATION, ETC., NECESSARY TO RESTORE TO SERVICE THE EXISTING PIPING, CONDUITS, WIRING, AND CABLES AFFECTED BY THIS WORK. RECONNECT, CLEAN, REPAIR, PURGE, STERILIZE, PRIME, TEST, ADJUST, BALANCE, ETC., AS NECESSARY ALL EXISTING EQUIPMENT, FIXTURES, DEVICES, PIPING, CONTROLS, ETC., TO BE LEFT IN SERVICE OR REUSED.</p> <p>MATERIALS AND METHODS:</p> <p>PROVIDE ALL CUTTING AND PATCHING NECESSARY TO PROPERLY INSTALL ALL WORK. FOR WORK IN--PROGRESS, LEAVE IN SAFE CONDITION ALL FLOORS, WALLS, CEILINGS, FINISH MATERIALS, OR ANY PART OF THE BUILDING OR PREMISES THAT MUST BE CHANGED OR REPLACED. REPAIR ANY DAMAGE DONE TO EXISTING EQUIPMENT, DEVICES, OR MATERIALS.</p> <p>DO NOT CUT, NOTCH, OR BORE A FRAMING MEMBER IN EXCESS OF LIMITATIONS SPECIFIED IN THE CODE. DO NOT CUT, NOTCH, OR BORE ANY STRUCTURAL BEAMS AND COLUMNS UNDER ANY CIRCUMSTANCES.</p> <p>DO NOT SUPPORT PIPES ON BLOCKS ON GRADE.</p> <p>PERFORM ALL TRENCHING AND BACKFILLING IN A SAFE MANNER. PROTECT THE STABILITY OF ALL STRUCTURES (OR ANY PART THEREOF) AND ANY WORK INSTALLED BY OTHER TRADES. EXCAVATE TRENCHES BELOW THE INSTALLATION LEVEL OF THE PIPE SUCH THAT THE BOTTOM OF THE TRENCH DOES NOT FORM THE BED FOR THE PIPE OR RACEWAY.</p> <p>AT THE BOTTOM OF ANY TRENCH, STABILIZE SOFT MATERIALS OF POOR LOAD--BEARING QUALITY BY OVER--EXCAVATING A MINIMUM OF TWO PIPE DIAMETERS AND BACKFILLING WITH FINE GRAVEL, CRUSHED STONE, OR A CONCRETE FOUNDATION TO THE INSTALLATION LEVEL OF THE PIPE OR CONDUIT BOTTOM. TAP SAND INTO PLACE FOR ANY CONCRETE FOUNDATION INSTALLED SO AS TO PROVIDE UNIFORM LOAD--BEARING SUPPORT ABOVE THE CONCRETE FOR THE PIPE/CONDUIT BETWEEN JOINTS.</p> <p>REMOVE ROCK ENCOUNTERED IN TRENCHING TO A MINIMUM OF 3 INCHES BELOW THE INSTALLATION OF THE BOTTOM OF THE PIPE/CONDUIT, AND BACKFILL THE TRENCH SHALL BE BACKFILLED TO THE INSTALLATION LEVEL OF THE BOTTOM OF THE PIPE WITH SAND TAMPED IN PLACE SO AS TO PROVIDE UNIFORM LOAD--BEARING SUPPORT FOR THE PIPE BETWEEN JOINTS. THE PIPE, INCLUDING THE JOINTS, SHALL NOT REST ON ROCK AT ANY POINT.</p> <p>BURIED PIPING SHALL BE SUPPORTED THROUGHOUT ITS ENTIRE LENGTH. PROVIDE SOLID AND CONTINUOUS LOAD--BEARING SUPPORT BETWEEN JOINTS. PROVIDE BELL HOLES, HUB HOLES, AND COUPLING HOLES WHERE CONNECTING PIPES.</p> <p>BACKFILL THE TRENCH TO THE INSTALLATION LEVEL OF THE BOTTOM OF THE PIPE WITH SAND OR FINE GRAVEL PLACED IN LAYERS OF 6--INCHES MAXIMUM DEPTH. BACKFILL SHALL BE FREE FROM DISCARDED CONSTRUCTION MATERIAL AND DEBRIS. LOOSE EARTH FREE FROM ROCKS, BROKEN CONCRETE, AND FROZEN CHUNKS SHALL BE PLACED IN THE TRENCH IN 6--INCH LAYERS AND TAMPED IN PLACE UNTIL THE CROWN OF THE PIPE IS COVERED BY 12 INCHES OF TAMPED EARTH. THE BACKFILL UNDER AND BESIDE THE PIPE SHALL BE COMPACTED FOR PIPE SUPPORT. BACKFILL SHALL BE BROUGHT UP EVENLY ON BOTH SIDES OF THE PIPE SO THAT THE PIPE REMAINS ALIGNED.</p> <p>MATERIAL AND PRODUCT STANDARDS:</p> <p>PROVIDE ONLY NEW MATERIALS, DEVICES, FIXTURES, AND EQUIPMENT LISTED AND LABELED (FOR THE USE INTENDED) BY AN APPROVED THIRD PARTY LABORATORY SERVICE APPROVED BY THE STATE, SUCH AS UNDERWRITER'S LABORATORIES, INC, CSA, ETL AND OTHERS. DO NOT USE UNLISTED AND UNLABELED PRODUCTS.</p> <p>PROVIDE APPROPRIATELY LABELED AND APPROPRIATELY RATED EQUIPMENT ENCLOSURES AND PRODUCTS FOR EACH LOCATION. USE PROVIDE NEMA 3R OR BETTER AND/OR WET LOCATION LABELED ENCLOSURES FOR ALL EQUIPMENT AND PRODUCTS INSTALLED ANYWHERE OUTDOORS OR AT INDOOR WASH DOWN LOCATIONS.</p> <p>UTILITY AND BUILDING OWNER'S REPRESENTATIVE COORDINATION:</p> <p>COMPLY WITH ALL MUNICIPAL, STATE, AND/OR UTILITY REGULATIONS FOR SERVICE CONNECTIONS AND METERING PROVISIONS.</p> <p>FULLY COORDINATE WITH THE GAS AND WATER UTILITIES TO PROVIDE SERVICES TO THE FACILITY. PROVIDE ANY NECESSARY VAULTS, CONCRETE PADS, OR UNDERGROUND PIPES AND PROVISIONS REQUESTED BY THE UTILITY. THE OWNER WILL PAY FOR ALL SERVICE CONNECTION, LINE EXTENSION, AND IMPACT FEES DIRECTLY TO THE APPROPRIATE UTILITY OR JURISDICTION.</p> <p>PROVIDE TEMPORARY SERVICES AS NECESSARY TO SUPPORT ALL CONSTRUCTION ACTIVITIES.</p> <p>SUBMITTALS AND TESTING:</p> <p>SUBMIT A LIST OF ALL PLUMBING FIXTURES, EQUIPMENT, AND DEVICES MATCHING THE ENGINEER'S BASIS OF DESIGN. SUBMIT ELECTRONIC SHOP DRAWINGS AND CATALOG DATA FOR ALL PLUMBING FIXTURES, EQUIPMENT, DEVICES, MATERIALS, AND INSULATIONS THAT DO NOT.</p> <p>RETAIN ALL RETAIN INSTALLATION INSTRUCTIONS, MANUFACTURER'S PACKING DOCUMENTS, ETC., FOR ALL LIFE SAFETY RELATED EQUIPMENT AS EVIDENCE TO THE AUTHORITY HAVING JURISDICTION THAT THE CORRECT MATERIALS AND DEVICES WERE USED IN THE CONSTRUCTION, PENETRATION, AND SEALING OF PENETRATION IN ALL RATED ASSEMBLIES.</p> <p>CONFORM TO ALL LOCAL, STATE, AND NATIONAL CODES, AND WITH THE REQUESTS OF THE LOCAL INSPECTOR FOR TESTS AND COMPONENT TESTING. CONTRACTOR SHALL PAY THE FULL COST OF ANY DESTRUCTIVE TESTING NECESSARY TO DEMONSTRATE COMPLIANCE WITH THESE DRAWINGS AND CODE.</p> <p>AS A MINIMUM, TURN "ON" AND "OFF", SWITCH, CHANGE MODES, AND VERIFY SEQUENCES OF OPERATION FOR ALL DEVICES, EQUIPMENT, AND SYSTEMS TO DEMONSTRATE PROPER INSTALLATION AND SATISFACTORY OPERATION.</p>	<p>PERMITS, WARRANTY AND INSPECTIONS:</p> <p>OBTAIN ANY PAY FOR ANY AND ALL REQUIRED PERMITS, INSPECTIONS, CERTIFICATES OF INSPECTIONS AND APPROVAL, AND THE LIKE AND SHALL DELIVER SUCH CERTIFICATES TO THE OWNER. NOTIFY THE ARCHITECT AND ENGINEER OF ALL SCHEDULED INSPECTIONS.</p> <p>WARRANT ALL MATERIALS, EQUIPMENT, AND WORKMANSHIP SHOWN OR IMPLIED BY THESE DOCUMENTS TO BE FREE OF DEFECTS FOR A PERIOD OF ONE YEAR, STARTING FROM THE TIME OF ACCEPTANCE BY THE BUILDING OWNER. IF WITHIN ONE YEAR AFTER THE ACCEPTANCE DATE ANY WORK OR EQUIPMENT IS FOUND TO BE DEFECTIVE, CORRECT IT PROMPTLY AT NO COST TO THE BUILDING OWNER.</p> <p>SCOPE OF WORK:</p> <p>PROVIDE ALL WORK, EQUIPMENT, SERVICES, LABOR, AND MATERIALS NECESSARY FOR THE INSTALLATION OF COMPLETE AND FUNCTIONAL WASTE, VENT, DOMESTIC COLD WATER, AND GAS SYSTEMS AS DESCRIBED OR IMPLIED BY THE CONTRACT DOCUMENTS.</p> <p>PIPING, PIPE FITTINGS, PIPE HANGERS/SUPPORTS, & INSULATION:</p> <p>FOR UNDERGROUND WATER PIPING, PROVIDE SEAMLESS COPPER TUBING, TYPE K, ASTM B--88 OR SCHEDULE 80 CPVC, ASTM F--44--1 WITH APPROVED SOLVENT. INSTALL UNDERGROUND WATER PIPING WITH THE TOP OF THE PIPE A MINIMUM OF 12" BELOW GRADE.</p> <p>FOR ABOVEGROUND WATER PIPING, PROVIDE SCHEDULE 40 C--PVC PIPING ASTM D1784, ASTM F480, AND NSF 14 AND 61. USE SCHEDULE 80 C--PVC FITTINGS ASTM D1784, ASTM F439, ASTM F437, AND NSF 14 AND 61. INSTALL ABOVEGROUND WATER PIPING INSIDE THE THERMAL ENVELOPE AND ON THE HEATED SIDE OF ANY EXTERIOR WALLS AND INSULATED CEILINGS. C--PVC DOMESTIC WATER PIPING MAY BE INSTALLED IN RETURN AIR PLENUMS ONLY WHERE THE PIPING WILL REMAIN FILLED WITH WATER AND UNDER PRESSURE.</p> <p>AT THE CONTRACTOR'S OPTION, PROVIDE SEAMLESS COPPER TUBING, ASTM B--88--61, TYPE L, HARD DRAWN COPPER FOR ABOVEGROUND WATER PIPING. USE WROUGHT METAL SOLDERED JOINT FITTINGS ANSI B16.22.</p> <p>AT THE CONTRACTOR'S OPTION, PROVIDE CROSS--LINKED POLYETHYLENE (PEX) PLASTIC TUBING LISTED FOR WATER SERVICE AND BRANCH WATER PIPING. FLARE PIPING ENDS USING A TOOL SPECIFICALLY DESIGNED FOR THAT TASK. PROVIDE METALLIC LOCK RINGS CONFORMING TO THE MANUFACTURER'S TECHNICAL REQUIREMENTS FOR PIPING JOINTS. USE INSERT FITTINGS CONFORMING TO ASTM F 1974.</p> <p>FOR NATURAL GAS PIPING, PROVIDE SCHEDULE 40, BLACK STEEL WITH MALLEABLE IRON FITTINGS. FOR 2 PSI SYSTEMS, PROVIDE VENT--LESS REGULATORS FOR ALL GAS--FIRED APPLIANCES.</p> <p>FOR SANITARY WASTE AND VENT PIPING, PROVIDE ABS, DWV, AND/OR PVC SCHEDULE 40.</p> <p>INSTALL ALL PLASTIC PIPING PER ASTM D2321 AND FOLLOWING THE MANUFACTURER'S PUBLISHED RECOMMENDATIONS.</p> <p>FOR PVC DWV INSTALLATIONS, PROVIDE SCHEDULE 40 SOLID WALL OR COMPOSITE WALL, PVC PIPING AND FITTINGS CONFORMING TO ASTM D2665.</p> <p>WHEN MAKING JOINTS, FOLLOW THE MANUFACTURER'S PUBLISHED RECOMMENDATIONS INCLUDE USE OF PURPLE PRIMER CONFORMING TO ASTM F656 FOLLOWED BY NON--PURPLE SOLVENT CEMENT CONFORMING TO ASTM D2564.</p> <p>INSTALL PIPING AND RELATED ITEMS NEATLY WITH ROUTES GENERALLY CHOSEN TO BE PARALLEL AND PERPENDICULAR TO BUILDING LINES. ARRANGE PIPING FOR EASY ACCESS TO ALL VALVES, TRAPS, AND CLEANOUTS.</p> <p>INSTALL WATER PIPING IN EXTERIOR WALLS AND INSULATED ROOF/CEILINGS ON THE HEATED SIDE OF THE INSULATION.</p> <p>FOR HORIZONTAL WASTE PIPING, INSTALL 2--1/2" OR SMALLER PIPING WITH A SLOPE OF 1/4" PER LINEAR FOOT OR MORE. INSTALL 3" OR LARGER PIPING WITH A SLOPE OF 1/8" PER LINEAR FOOT OR MORE.</p> <p>SLEEVE ALL PENETRATIONS OF MASONRY OR POUR--IN--PLACE FOUNDATIONS, CONCRETE SLABS, OR CASIT--IN--PLACE CONCRETE WALLS WITH COATED OR WRAPPED METAL SLEEVES OF 0.025" MINIMUM THICKNESS.</p> <p>AT THE BASE OF WASTE AND WASTE/VENT STACKS, SUPPORT THE PIPING WEIGHT WITH THE BUILDING STRUCTURE, VIRGIN OR COMPACTED EARTH, OR OTHER SUITABLE MATERIALS.</p> <p>PROVIDE HANGERS, ANCHORS, AND</p>

GENERAL PLUMBING NOTES:

1. PREPLAN ALL WORK PRIOR TO ORDERING, PURCHASING, OR FABRICATING ANY PART OF THE WORK DESCRIBED BY THIS DRAWING.
2. IMMEDIATELY NOTIFY THE ENGINEER OF ANY CONFLICTS WITH EXISTING FIELD CONDITIONS OR THE WORK OF OTHER TRADES.
3. RESOLVE ALL CONFLICTS PRIOR TO INCURRING ANY MATERIAL OR LABOR EXPENSES.
4. COMPLY WITH THE MANUFACTURER'S TECHNICAL INSTRUCTIONS WHEN INSTALLING PLUMBING FIXTURES, MATERIALS, AND DEVICES.
5. PROVIDE ALL APPURTENANCES NECESSARY TO PROPERLY INSTALL FIXTURES, EQUIPMENT, DEVICES, PIPING, MATERIALS, ETC.
6. VERIFY PLUMBING FIXTURES TO BE INSTALLED AGAINST THE ARCHITECT'S ROOM FINISHES AND RESOLVE ALL CONFLICTS AND CLEARANCE ISSUES BEFORE ORDERING FIXTURES.
7. LOCATE FIXTURES AND EQUIPMENT GENERALLY AS SHOWN ON THE PLANS; HOWEVER, COORDINATE LOCATIONS WITH ACTUAL FIELD CONDITIONS TO PRESERVE ALL CODE-REQUIRED AND MANUFACTURER - REQUESTED SERVICE CLEARANCES.
8. COORDINATE WITH GENERAL TRADE TO ENSURE THAT ACCESSIBLE FIXTURE PLACEMENTS COMPLY WITH THE ADA AND ACCESSIBLE PROVISIONS OF THE CODE. INSTALL ACCESSIBLE SINKS AND LAVATORIES NO HIGHER THAN 34" AFF. ALL ACCESSIBLE SINK DEPTHS SHALL NOT EXCEED 6". INSTALL HANDLES ON WATER CLOSETS SO THAT THE HANDLE IS ON THE WIDE SIDE OF THE ROOM OR STALL. CONTRACTOR SHALL CONFIRM IN FIELD.
9. COORDINATE ROUTING OF ALL PIPING WITH BUILDING STRUCTURE AND WITH THE WORK OF OTHER TRADES. INSTALL PIPING SO AS TO PREVENT STRAINS AND STRESSES THAT WOULD BREAK PIPING OR CHANGE SLOPE. SUPPORT PIPING PASSING THROUGH OR UNDER WALLS AS NECESSARY TO PREVENT BREAKAGE. OFFSET VENT PIPING AROUND BEAMS AND JOISTS AS NECESSARY.
10. ANY PIPING THAT PASSES WITHIN 12" UNDER A FOOTING OR THROUGH A FOUNDATION WALL SHALL BE PROVIDED WITH A PIPE SLEEVE BUILT INTO THE FOUNDATION WALL. THE SLEEVE SHALL BE TWO PIPE SIZES LARGER THAN THE PIPE PASSING THROUGH THE WALL. UNDER NO CIRCUMSTANCES IS A PIPE ALLOWED TO BE RUN UNDER A PIER FOOTING.
11. THE TOP OF WATER PIPING, INSTALLED BELOW GRADE OUTSIDE OF THE BUILDING, SHALL BE BELOW THE FROST LINE AND NOT LESS THAN 12" BELOW FINISHED GRADE. WASTE AND SOIL PIPING SHALL HAVE A MINIMUM COVER OF 3". NO TRAPS OF SOIL OR WASTE PIPE SHALL BE INSTALLED OR PERMITTED OUTSIDE OF A BUILDING, OR CONCEALED IN OUTSIDE WALLS, OR IN ANY PLACE WHERE SUBJECTED TO FREEZING TEMPERATURES.
12. MINIMIZE ALL ROOF PENETRATIONS. ALL JOINTS AT THE ROOF AROUND VENT PIPES SHALL BE MADE WATERTIGHT BY USE OF APPROVED FLASHINGS AND FLASHING MATERIALS THAT CONFORM TO THE ROOF INSTALLER'S REQUIREMENTS. EXTERIOR WALL OPENINGS SHALL BE MADE WATER TIGHT. REUSE EXISTING VTRs WHERE THE VTR REMAINS IN GOOD CONDITION AND IS WATER-TIGHT.
13. WHERE PASSING THROUGH MASONRY OR OTHER CORROSIVE MATERIALS, METALLIC PIPING SHALL BE PROTECTED FROM CORROSION WITH SHEATHING OR WRAPPING. ONCE APPLIED, THE COVERINGS SHALL ALLOW FOR EXPANSION AND CONTRACTION TO PREVENT ANY RUBBING ACTION.
14. ALL ANNULAR SPACES BETWEEN SLEEVES AND PIPES SHALL BE FILLED OR TIGHTLY CAULKED IN AN APPROVED MANNER. FOR PENETRATIONS OF FIRE-RATED ASSEMBLIES, PROVIDE UL-LISTED PENETRATION DETAILS SELECTED FOR THE SPECIFIC FIRE-RATED ASSEMBLY AND PENETRATING MATERIALS.
15. WHERE AT AN EXTERIOR WALL, INSTALL ALL WATER PIPING ON HEATED SIDE OF THE WALL INSULATION AND WITHIN THE THERMAL ENVELOPE OF THE BUILDING. INSULATE ALL COLD AND HOT WATER PIPING IN UNCONDITIONED ROOMS AND SPACES, AND WHERE NOT INSIDE THE THERMAL ENVELOPE OF THE BUILDING WITH R-6.5 OR HIGHER INSULATION. ALL INSULATION PRODUCTS SHALL BE FOAM WRAP INSULATION SECURED 24" ON CENTER OR SELF-SEALING PRODUCTS OF SPECIFIED R-VALUE. TAPE/SEAL END PIECE JOINTS OF ADJACENT SEGMENTS.
16. PROVIDE SHUTOFF BALL VALVES FOR EVERY BRANCH WATER LINE.
17. PROVIDE HOT WATER TEMPERING VALVES ON ALL SINKS AND LAVATORIES. SET HOT WATER TEMPERATURE FOR 110F.
18. SEE ARCHITECTURAL COVERSHEET FOR MINIMUM FACILITIES CALCULATION.
19. FOR HORIZONTAL WASTE PIPING, INSTALL 2½" OR SMALLER PIPING WITH A SLOPE OF ¼" PER LINEAR FOOT OR MORE. INSTALL 3" OR LARGER PIPING WITH A SLOPE OF ⅛" PER LINEAR FOOT OR MORE.

PLUMBING LEGEND	
	NEW VENT PIPING
	NEW WASTE PIPING
	NEW COLD WATER PIPE
	NEW HOT WATER PIPE
	BALL VALVE
LH	LAVATORY (ACCESSIBLE)
WCH	WATER CLOSET (ACCESSIBLE)
CO	CLEANOUT
	CONNECT TO EXISTING
	KEY NOTE NUMBER
VTR	VENT THROUGH ROOF

RENOVATION/ADDITION TO POOL BUILDING FOR:		PROJECT NO: 2430	
CAMP AGAPE		DATE: 11/19/24	
1369 TYLER DEWAR LN		CAD DWG FILE: P_2430	
FUQUAY VARINA, NORTH CAROLINA 27526		DRWN BY: WHCCHKD BY: WHC	
			
WILLIAM H. CLARK, JR., PE 4732 PORCHAVEN LN, APEX, NC 27539 PHONE: 919-740-3826 WHCLARK2001@GMAIL.COM		WILLIAM H. CLARK, JR., PE 4732 PORCHAVEN LN, APEX, NC 27539 PHONE: 919-740-3826 WHCLARK2001@GMAIL.COM	
PLBG NOTES, LEGEND, AND SPECIFICATIONS		P0	



- ### NOTES KEYED TO PLAN:
- 1) REPLACE EXISTING WATER COOLER. DEMOLISH EXISTING WATER COOLER AND REWORK SUPPORTS AND WALL FOR NEW WATER COOLER. COORDINATE EXISTING RECEPTACLE LOCATION WITH THE ELECTRICAL TRADE AND ADJUST AS NECESSARY TO CONCEAL BEHIND WATER COOLER IN THE MANUFACTURER'S APPROVED LOCATION. SET SPOUT AT ADA HEIGHT.
 - 2) REPLACE HAND SINK. DEMOLISH EXISTING HAND SINK AND REWORK WALL AND SUPPORTS FOR NEW HAND SINK. REWORK WASTE/VENT PIPING CONNECTIONS FOR NEW SINK.
 - 3) REPLACE WATER CLOSET. DEMOLISH EXISTING WATER CLOSET AND REWORK FLOOR AND ROUGH-IN FOR NEW WATER CLOSET.
 - 4) DEMOLISH EXISTING SHOWER AND INSTALL NEW WATER CLOSET. COORDINATE FLOOR ROUGH-IN WITH GENERAL CONTRACTOR WORK.
 - 5) INSTALL NEW OUTDOOR SHOWER. PROVIDE NEW DRAIN AND CONNECT TO EXISTING PIPING. COORDINATE ROUGH-IN AND WALL MODIFICATIONS WITH GENERAL CONTRACTOR.
 - 6) REUSE EXISTING PIPING AND FIXTURE CONNECTIONS IF POSSIBLE FOR NEW FIXTURE. EXTEND PIPING AS NEEDED.
 - 7) ASSUMED LOCATION OF EXISTING HOT AND COLD WATER PIPING.
 - 8) EXISTING WATER HEATER TO REMAIN.
 - 9) COORDINATE SLAB CUTS WITH GENERAL CONTRACTOR TO ROUTE NEW WASTE PIPING FOR THE WATER CLOSET AND HAND SINK TO THE EXISTING WASTE PIPING.
 - 0) NEW FLOOR DRAIN. COORDINATE EXACT LOCATION WITH POOL EQUIPMENT INSTALLERS.
 - 11) VERIFY THE SIZE OF THE EXISTING PUMP ROOM WASTE PIPING. COORDINATE WITH THE GENERAL CONTRACTOR TO CUT AND PATCH THE EXISTING SLAB TO REPLACE ALL 2" AND 3" WASTE PIPING AND TO CONNECT TO THE EXISTING 4" WASTE PIPING ON SITE.

PROJECT NO: 2430
DATE: 11/19/24
CAD DWG FILE: P_2430
DRWN BY: WHCCHKD BY: WHC

P1


RENOVATION/ADDITION TO POOL BUILDING FOR:

CAMP AGAPE

1369 TYLER DEWAR LN
FUQUAY VARINA, NORTH CAROLINA 27526


why?

WILLIAM H. CLARK, JR., PE
4732 PORCHAVEN LN, APEX, NC 27539
PHONE: 919-740-3626 WHCLARK2001@GMAIL.COM

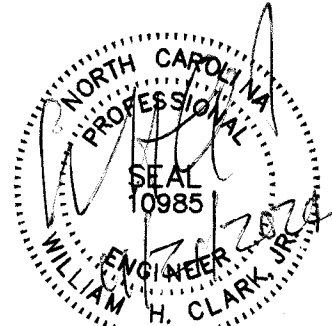

This drawing and the design shown are the property of WILLIAM H. CLARK, JR., P.E. The reproduction, copying or other use of this drawing without our written consent is prohibited. Copyright 2024 William H. Clark, Jr., P.E.

PLUMBING FIXTURE SCHEDULE							
FIXTURE	PARTS	BASIS OF DESIGN		PIPING SIZES			
		MANUFACTURER	MODEL NUMBER	HW	CW	WASTE	VENT
WATER CLOSET	WC	KOHLER	K3810-0	-	(TANK)1/2"	3"	2"
	SEAT	BEMIS	1500EC				
	SUPPLY	MCGUIRE	LF185				
	FLOOR MOUNTED, TOILET STYLE ABOVE, ELONGATED BOWL, 12" ROUGH-IN, WATERSENSE LABELED, SEAT AND SUPPLY ADA COMPLIANT. PLASTIC SEAT SHALL BE OPEN FRONT.						
LAVATORY	LH (WALL MOUNT)	AMERICAN STAND.	9024.904EC	1/2"	1/2"	2"	1-1/2"
	CARRIER (WALL MOUNT)	JAY R. SMITH	0700				
	FAUCET (PUBLIC)	BRIZO	METERED FAUCET				
	TRAP	MCGUIRE	8902				
	SUPPLY	MCGUIRE	LF165				
	SINGLE BOWL, MOUNTING INSTALLATION ABOVE, VITREOUS CHINA, 4" CENTERS, SINGLE CONTROL FAUCET, WATERSENSE LABELED, P-TRAP STOPS AND SUPPLY; ACCESSIBLE LAVATORY IS ADA COMPLIANT. METERED FAUCET (SENSOR OR PUSH HANDLE) SHALL BE ADJUSTABLE 10-30 SECOND FLOW-TIME.						
OUTDOOR SHOWER	ODS	TILED BY GC	TILED BY GC	1/2"	1/2"	2"	1-1/2"
	VALVE W/ INTERNAL STOPS	DELTA	R10000-UNWS				
	FAUCET (ODS)	DELTA	S1900-SS				
	WALL ELBOW / TRIM (ODS)	DELTA	S0560-SS / T13020-SS				
	FIBERGLASS, "OFFSET" CONTROLS IF NECESSARY; ONLY PRESSURE BALANCED MIXING VALVE W/ SCREW DRIVER STOPS. WATERSENSE LABELED AT MAX 2.0 GPM. ALL MIXING VALVES SHALL CONFORM WITH ASSE 1016 OR EQUAL W/ TEMPERATURE SET FOR 110F. COORDINATE W/ ARCHITECT ON ROUGH-IN BLOCKING FOR AND LOCATIONS OF ALL GRAB BARS AND REINFORCED SEATING. REFER TO PLANS FOR MULTIPLE SHOWERHEADS AND CONTROLS.						
ELECTRIC WATER COOLER (INDOOR)	EWK	ELKAY	LZSTL8WSLK	-	1/2"	2"	1-1/2"
	TRAP	McGUIRE	8902				
	SUPPLY	MCGUIRE	LF185				
	HIGH-LOW, WALL-MOUNTED ELECTRIC WATER COOLER W/BOTTLE FILLER, CONCEALED WALL HANGER, P-TRAP, AND SUPPLIES. INSTALL WITH ADA-REQUIRED APPROACH CLEARANCES AND SPOUT MOUNTING HEIGHTS. COORDINATE WITH ELECTRICAL TRADE TO CONCEAL RECEPTACLE BEHIND UNIT.						
BACKFLOW PREVENTER ASSEMBLY (REDUCED PRESSURE ZONE ASSEMBLY)	BFP (H ONLY)	WATTS	LF009M2QT	-	1"	-	-
	MSV	APOLLO	70-100				
	PRV (IF REQUIRED)	WATTS	LF223				
	STRAINER	WATTS	LF777				
	REDUCED PRESSURE ZONE ASSEMBLY. INSTALLED WITH MAIN SHUTOFF VALVE. IF STATIC PRESSURE AT BFP IS GREATER THAN 80 PSI, CONTRACTOR SHALL INSTALL WITH PRV. REFER TO PLUMBING BUILDING PLANS FOR BFP LOCATION AND SIZING, WHICH IS EQUAL TO THE INCOMING DOMESTIC WATER PIPE SIZE.						
FLOOR DRAIN	FD	SIOUX CHIEF	832-36PNR	-	-	3"	2"
FLOOR DRAIN, 5" DIAMETER, 3" TRAP/OUTLET							
FLOOR CLEAN OUT	CO	SIOUX CHIEF	834-4PNR	-	-	PER PLANS	-
FLOOR CLEAN OUT, ADJUSTABLE WITH STAINLESS STEEL COVER FOR CLEANOUT LOCATIONS WITHIN CONCRETE. ALL GREASE WASTE CLEAN OUTS SHALL BE MARKED TO DISTINGUISH FROM SANITARY SEWER CLEANOUTS.							
GENERAL FIXTURE NOTES				ALTERNATE MANUFACTURERS			
1. ALL FIXTURES SHALL BE WHITE UNLESS OTHERWISE DIRECTED BY THE ARCHITECT.				FAUCETS:			
2. ALL P-TRAPS MADE OF METAL SHALL BE 17 GA. MINIMUM.				CHINA:			
3. STAINLESS STEEL KITCHEN SINKS SHALL BE 20 GA. MINIMUM.				FIBERGLASS:			
4. FOR ACCESSIBLE FIXTURES, INSULATE ALL EXPOSED PIPING AND TRAPS WITH PLUMBEREX PRO-2000 SERIES, TRUEBRO LAV EZ SERIES, OR OTHER PRODUCT.				STAINLESS STEEL:			
5. INSTALL ACCESSIBLE SINKS AND LAVATORIES NO HIGHER THAN 34" AFF TO TOP OF SINK.				VALVES/BRASS:			
6. INSTALL HANDLES ON WATER CLOSETS SO THAT THE HANDLE IS ON THE WIDE SIDE OF THE ROOM OR STALL.				WATER HEATER:			
7. INSTALL ASSE 1070 VALVE ON HOT WATER PIPING AT ALL PUBLIC LAVATORIES AND SINKS. SET TO 110 F.				DELTA, MOEN OR SYMONS			
8. ALL P-TRAPS SHALL HAVE WET SEALS. PROVIDE TRAP PRIMERS WHERE INDICATED ON DRAWINGS.				MANSFIELD OR STERLING			
				CLARION OR AQUAGLASS			
				MOEN OR ELKAY			
				WILKINS OR WATTS			
				STATE OR AO SMITH			

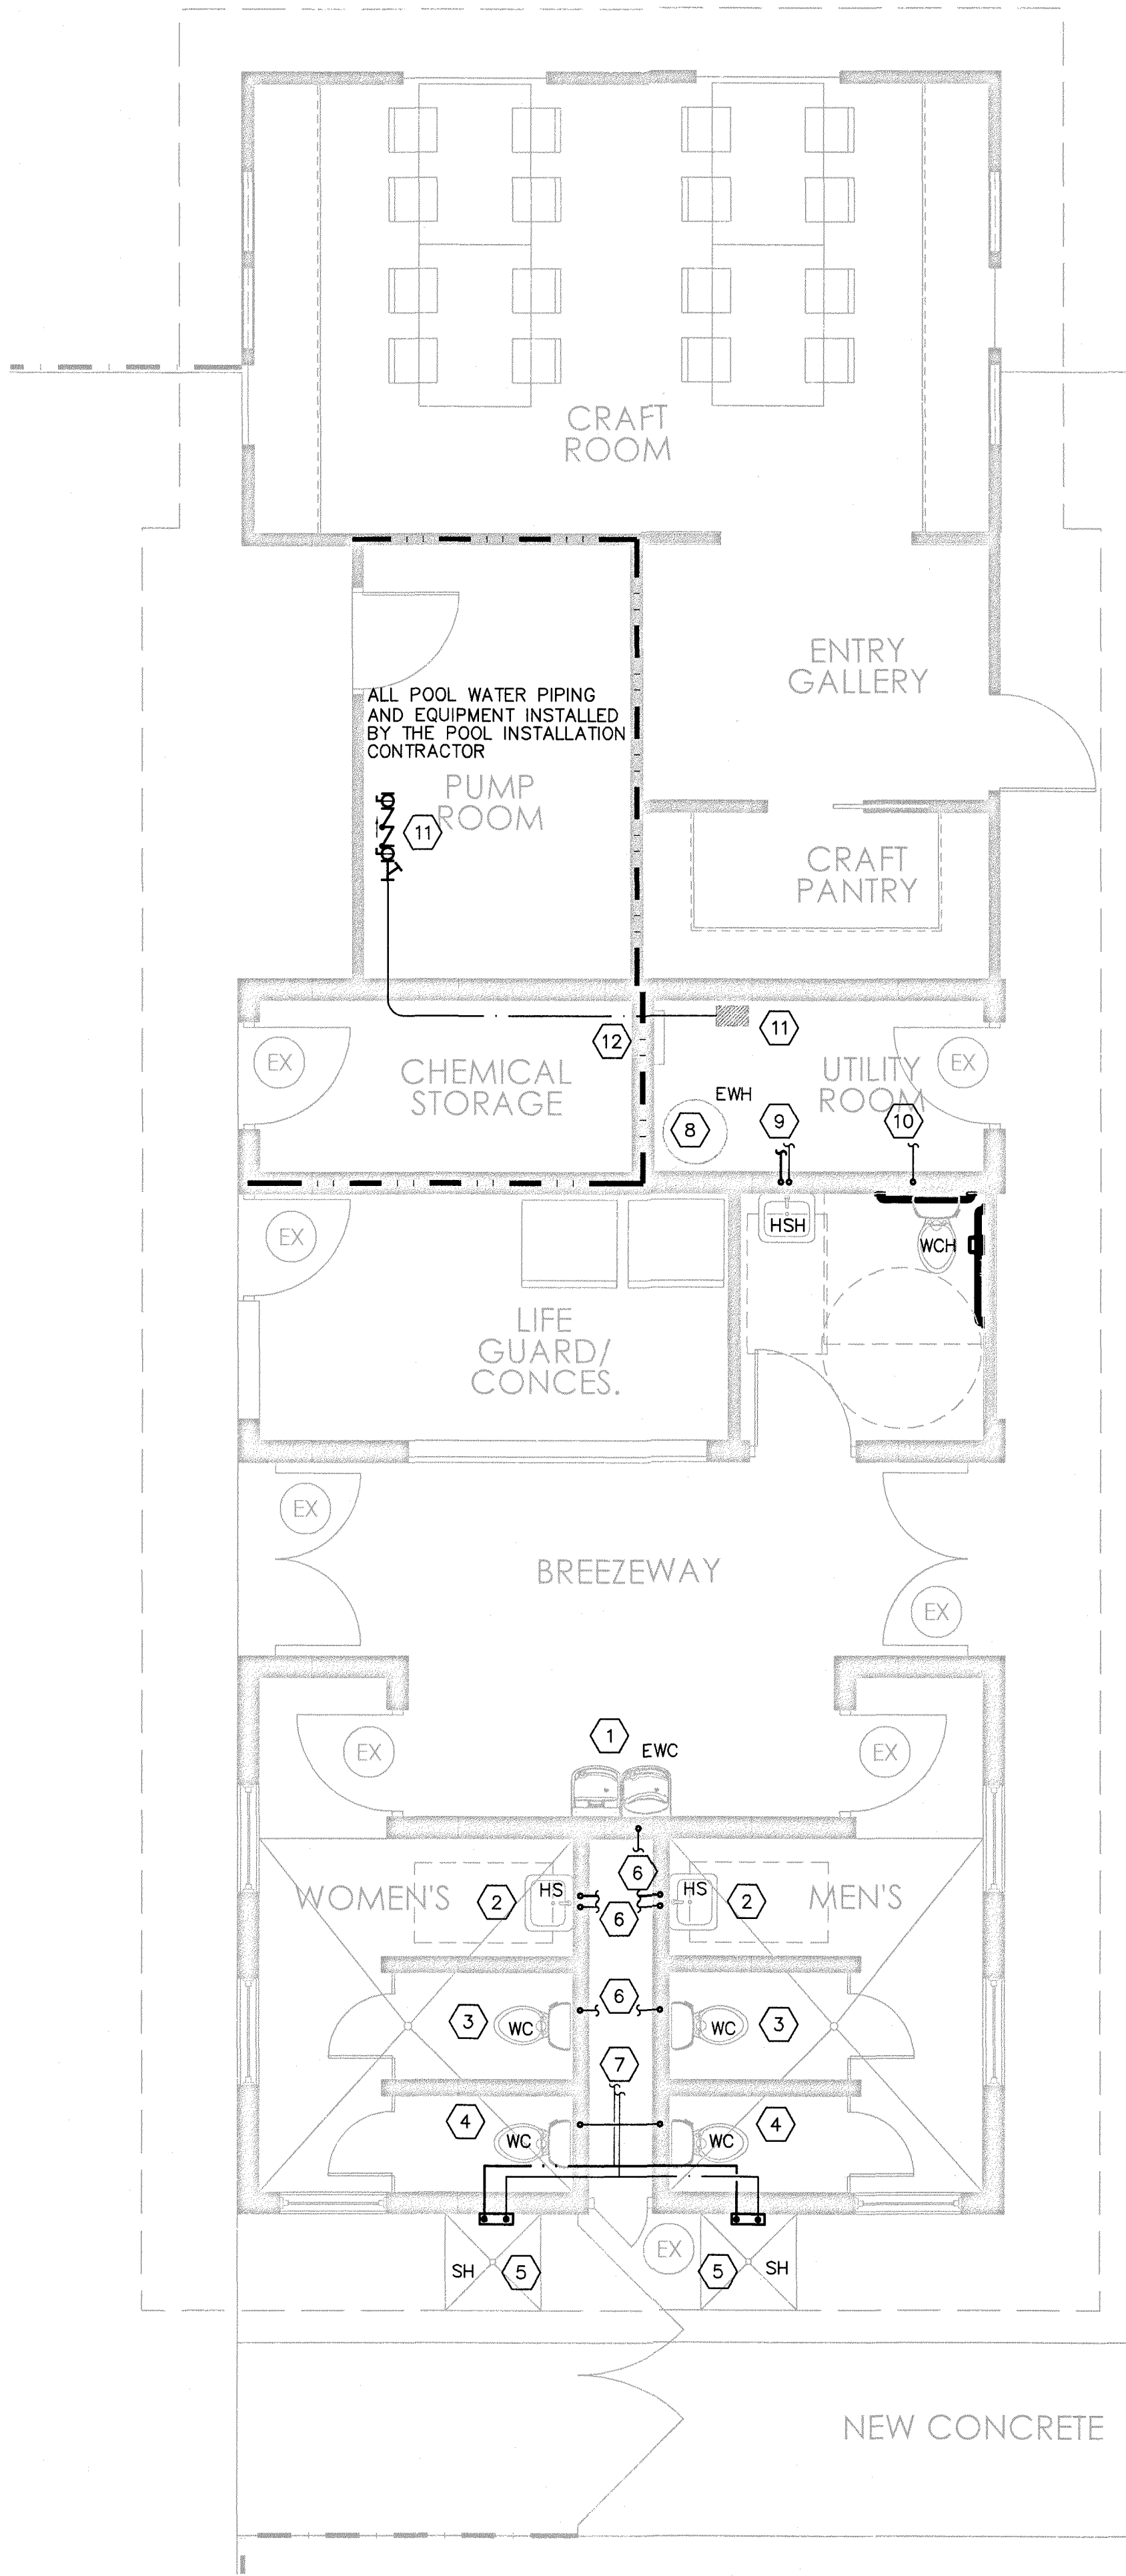

1
P2 PARTIAL FLOOR PLAN - DOMESTIC WATER
1/4" = 1' - 0"

GENERAL PLUMBING NOTES:

- SEE DRAWING P0 FOR GENERAL PLUMBING SPECIFICATIONS.
- SEE DRAWING P0 FOR GENERAL PLUMBING NOTES AND LEGEND
- SEE DRAWING P1 FOR FIXTURE LOAD SCHEDULE.
- VERIFY CONDITION OF MAIN WASTE PIPING. REPLACE PIPING SECTIONS AS NECESSARY. ADD CLEANOUTS AS NECESSARY.
- ALL HOT AND COLD WATER PIPING CONNECTIONS 1/2" UNLESS OTHERWISE NOTED. ALL MAIN DISTRIBUTION PIPING 3/4" UNLESS OTHERWISE NOTED.
- TRAP PRIMER WATER PIPING NOT SHOWN. REFER TO FIXTURE SCHEDULE FOR INSTALLATION LOCATIONS..

NOTES KEYED TO PLAN:

- REPLACE ELECTRIC WATER COOLER. DEMOLISH EXISTING WATER COOLER AND REWORK COLD WATER CONNECTION TO THE NEW WATER COOLER.
- REPLACE HAND SINK. DEMOLISH EXISTING HAND SINK AND REWORK EXISTING HOT AND COLD WATER CONNECTIONS FOR FOR THE NEW HAND SINK.
- REPLACE WATER CLOSET. DEMOLISH EXISTING WATER CLOSET AND REWORK EXISTING COLD WATER CONNECTION FOR THE NEW WATER CLOSET.
- DEMOLISH EXISTING SHOWER AND INSTALL NEW WATER CLOSET. DEMOLISH HOT WATER PIPING BACK TO POINT-OF-REUSE FOR NEW SHOWER. EXTEND THE COLD WATER PIPING AND REWORK THE COLD WATER CONNECTION TO THE NEW WATER CLOSET
- INSTALL NEW OUTDOOR SHOWER. EXTEND COLD WATER AND HOT WATER PIPING FROM THE CHASE TO NEW SHOWER LOCATION. PROVIDE SHOWERHEAD AND CONTROL MIXING VALVE.
- REUSE EXISTING PIPING AND FIXTURE CONNECTIONS IF POSSIBLE FOR NEW FIXTURE. EXTEND PIPING AS NEEDED.
- ASSUMED LOCATION OF EXISTING HOT AND COLD WATER PIPING.
- EXISTING WATER HEATER TO REMAIN. CLEAN, FLUSH, AND REPAIR AS NECESSARY.
- TAP MAIN HOT AND COLD WATER PIPING IN UTILITY ROOM AND EXTEND TO NEW HAND SINK IN NEW TOILET.
- TAP MAIN COLD WATER PIPING IN UTILITY ROOM AND EXTEND TO NEW WATER CLOSET IN NEW TOILET.
- EXISTING INCOMING WATER SERVICE AND MAIN SHUTOFF VALVE. TAP WITH 1" PIPING AND EXTEND TO NEW PUMP ROOM AND RPZ. CAP 1" WATER PIPING AT RPZ FOR FUTURE CONNECTION BY POOL EQUIPMENT INSTALLER.
- SUBMIT A PENETRATION DETAIL FOR THE THRU-WALL PENETRATION AND SEALING OF THE 1" WATER PIPE.


RENOVATION/ADDITION TO POOL BUILDING FOR:


CAMP AGAPE
1369 TYLER DEWAR LN
FUQUAY VARINA, NORTH CAROLINA 27526

PROJECT NO: 2430
DATE: 11/19/24
CAD DWG FILE: P_2430
DRWN BY:WHCCHKD BY:WHC

PLBG FLOOR
PLAN - DOMESTIC
WATER,
SCHEDULE


P2

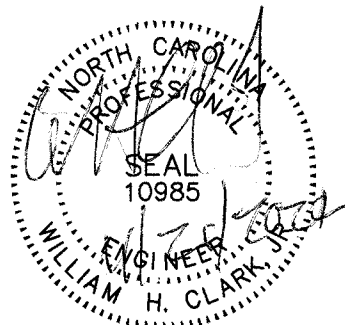

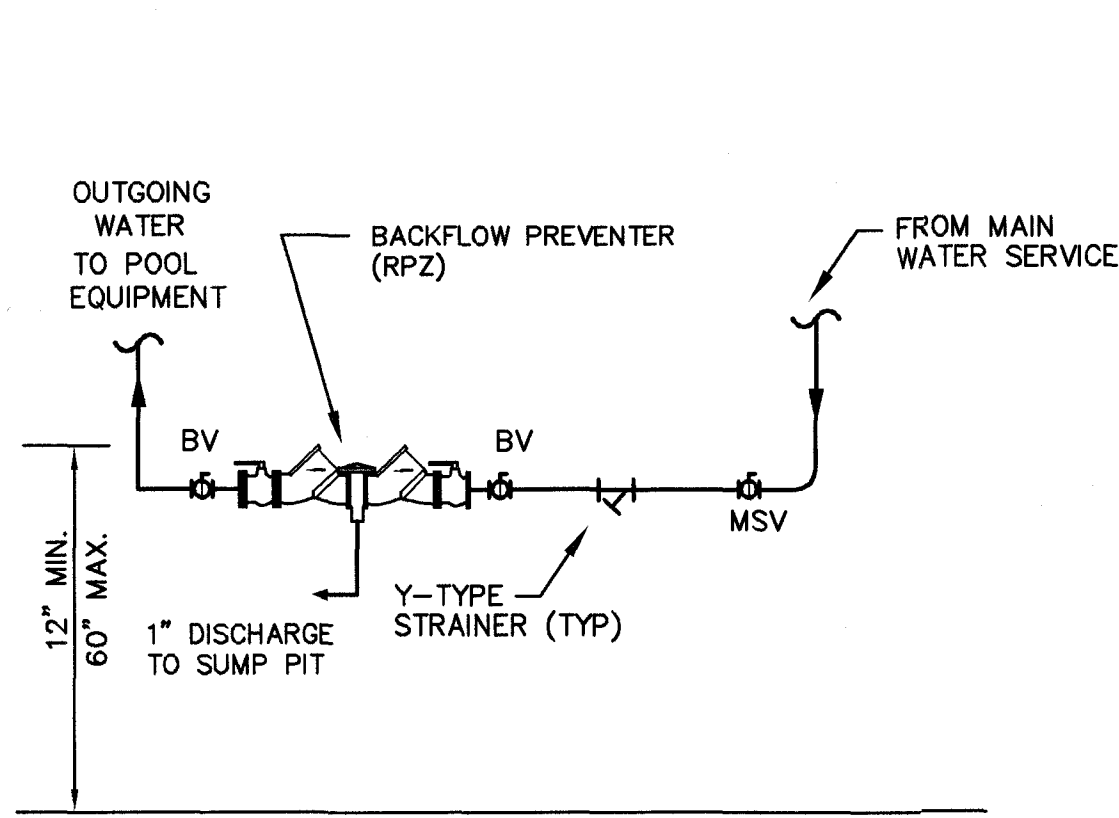


1
P3
NO SCALE

BACKFLOW PREVENTER (HORIZONTAL)

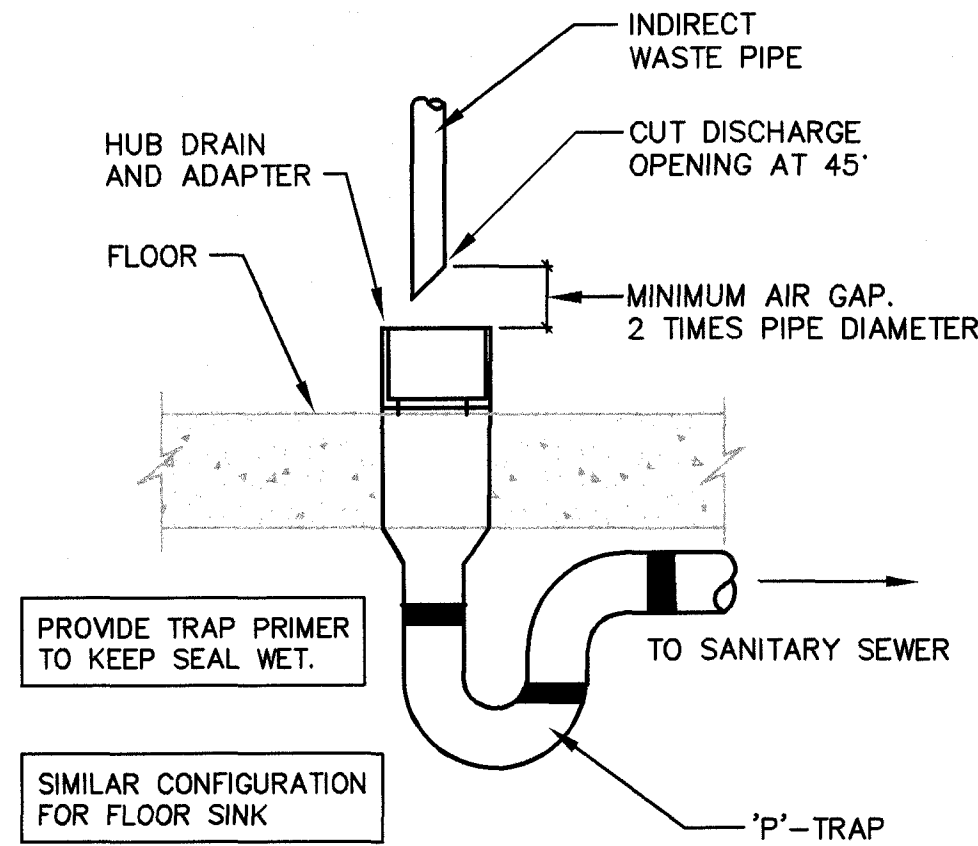


2
P3
NO SCALE

INDIRECT WASTE PIPING TO DRAIN OR FLOOR SINK

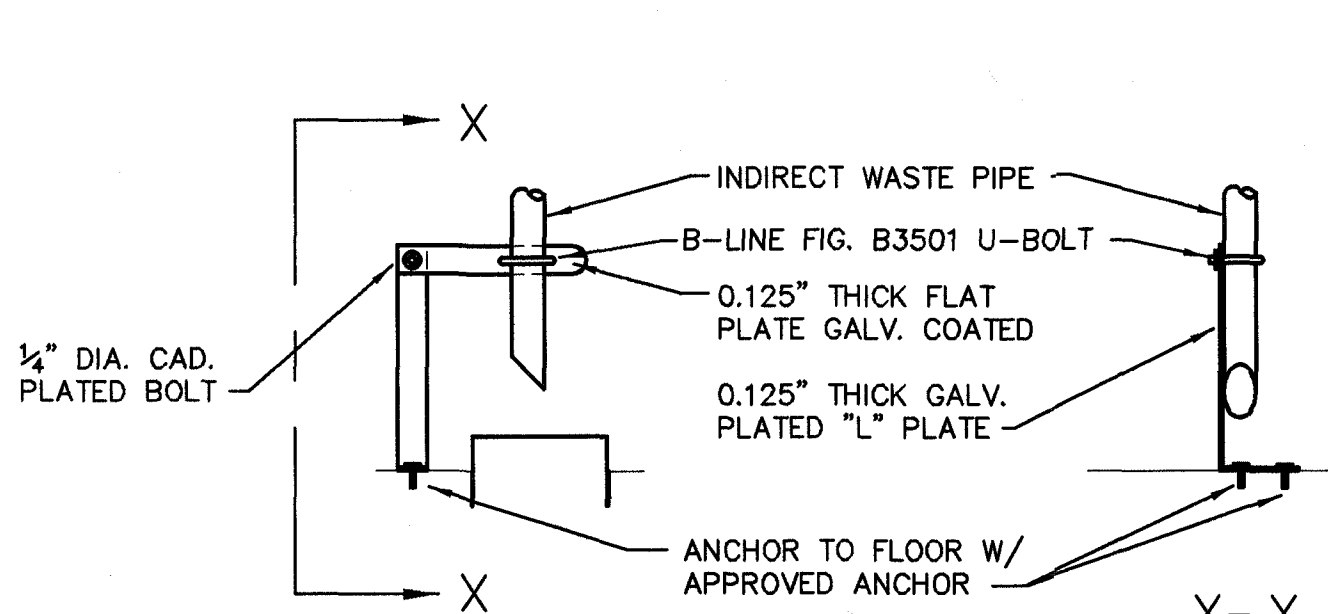


4
P3
NOT TO SCALE

INDIRECT WASTE BRACING

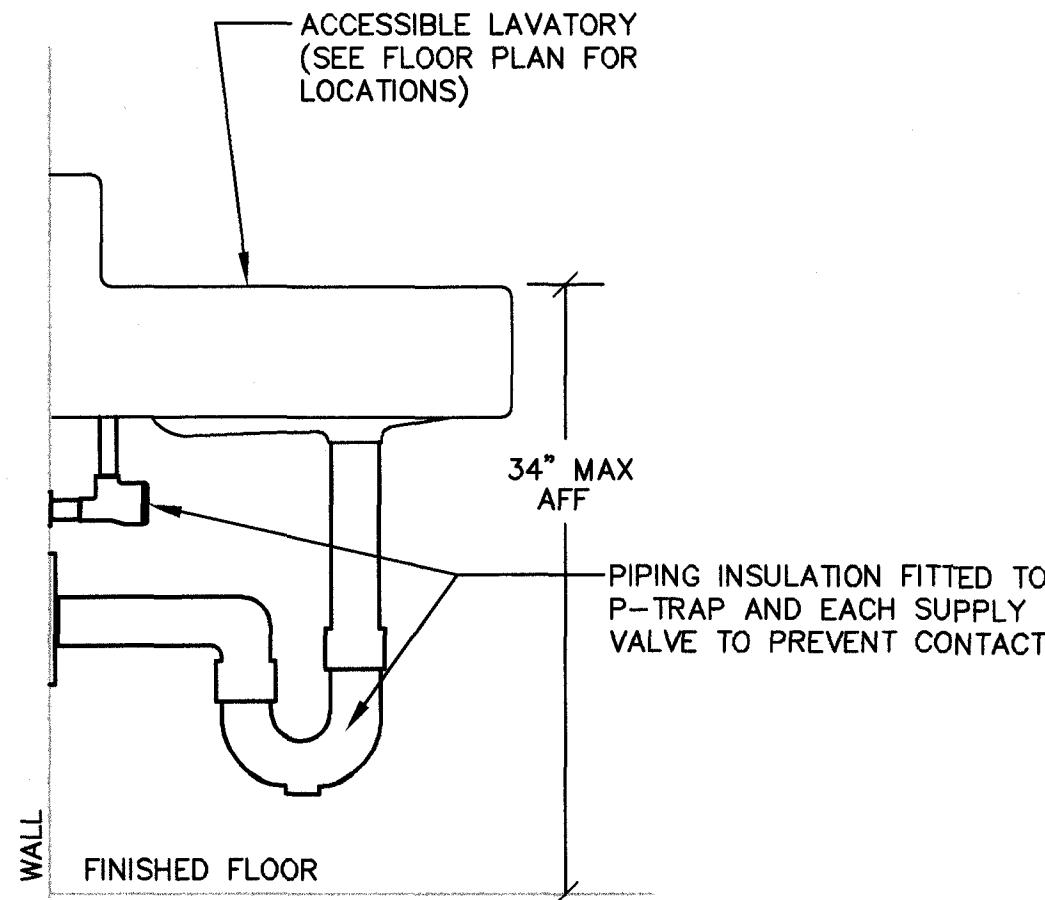


5
P3
NO SCALE

ACCESSIBLE SINK

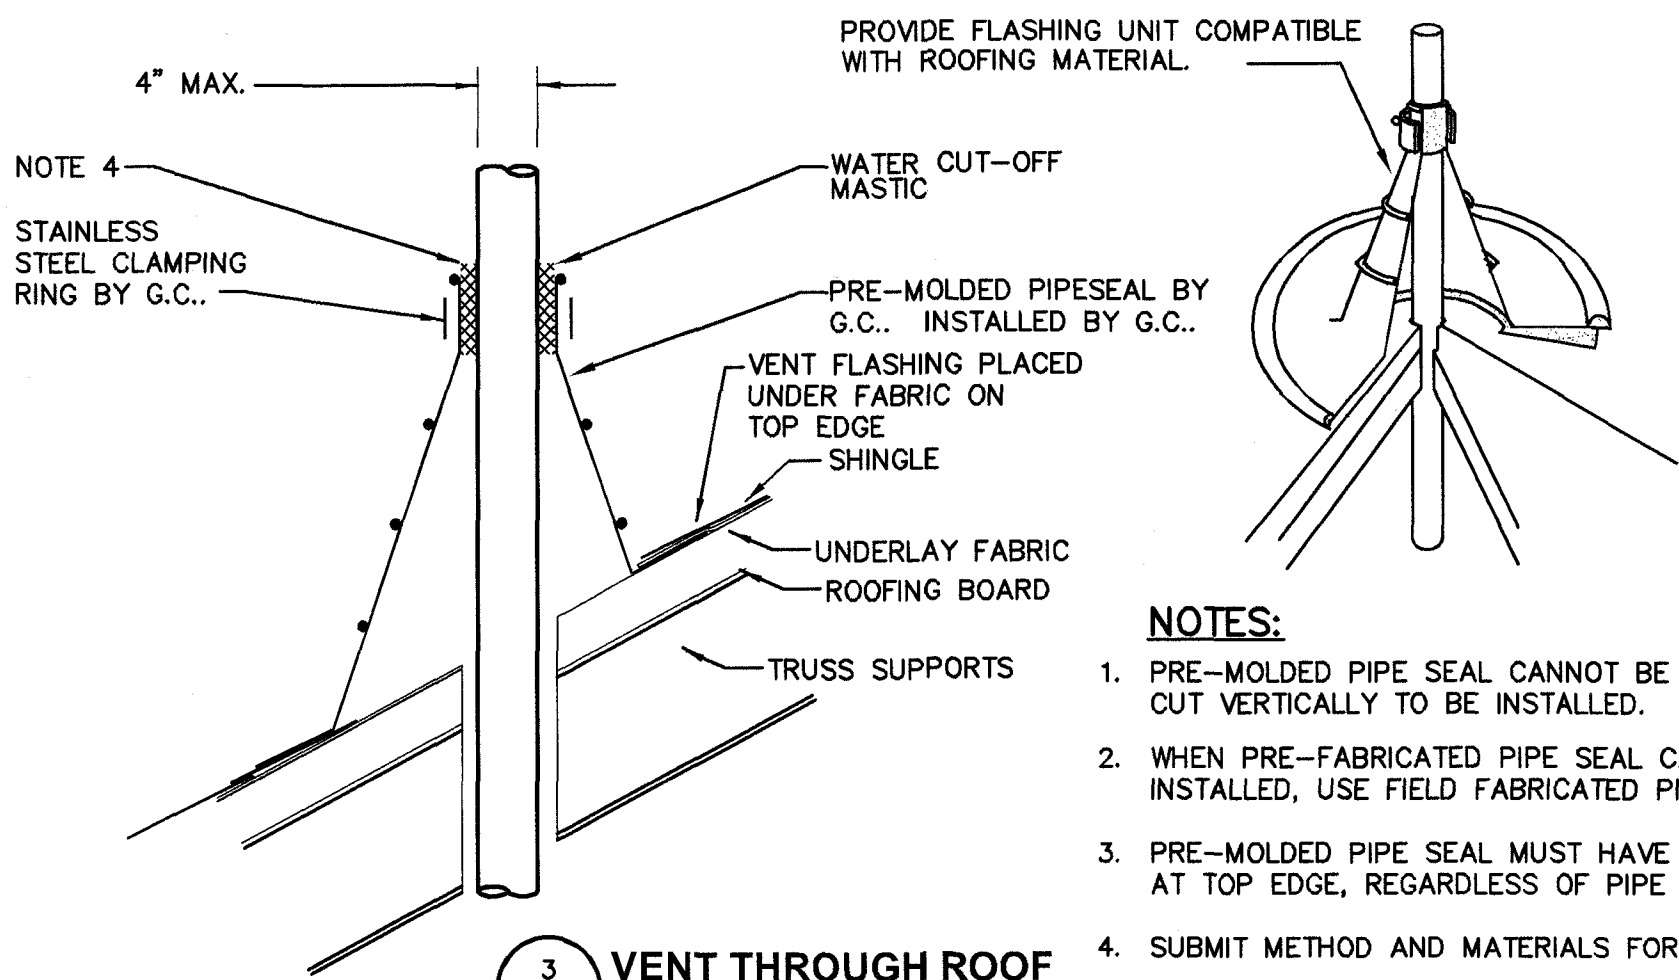

- NOTES:**
1. PRE-MOLDED PIPE SEAL CANNOT BE CUT VERTICALLY TO BE INSTALLED.
 2. WHEN PRE-FABRICATED PIPE SEAL CANNOT BE INSTALLED, USE FIELD FABRICATED PIPE SEAL.
 3. PRE-MOLDED PIPE SEAL MUST HAVE INTACT RIB AT TOP EDGE, REGARDLESS OF PIPE DIAMETER.
 4. SUBMIT METHOD AND MATERIALS FOR ACCEPTANCE.

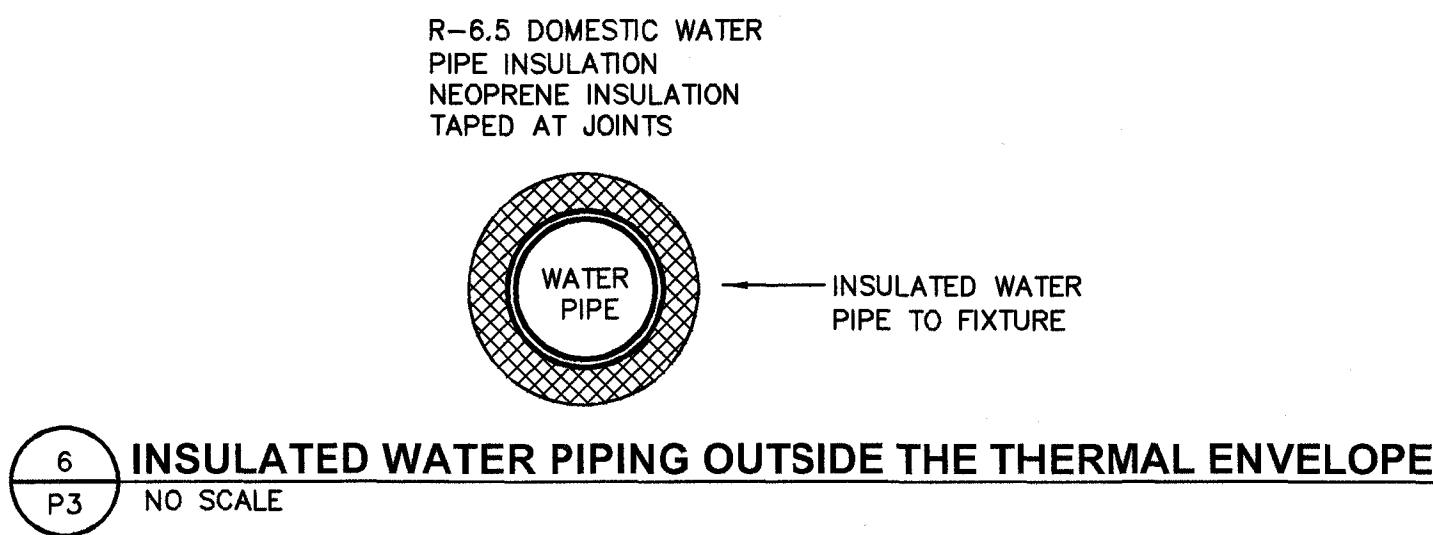

6
P3
NO SCALE

INSULATED WATER PIPING OUTSIDE THE THERMAL ENVELOPE

whcPE

WILLIAM H. CLARK, JR., PE
4732 PORCHAVEN LN, APEX, NC 27539
PHONE: 919-740-3028 WHCLARK2001@GMAIL.COM

SEAL
10989
WILLIAM H. CLARK, JR.
ENGINEER

RENOVATION/ADDITION TO POOL BUILDING FOR:

CAMP AGAPE

1369 TYLER DEWAR LN
FUQUAY VARINA, NORTH CAROLINA 27526

PROJECT NO:	2430
DATE:	11/19/24
CAD DWG FILE:	P_2430
DRWN BY:WHC CHKD BY:WHC	
PLBG DETAILS	
P3	

<div><div>HVAC SPECIFICATIONS</div><div><div>GENERAL:</div><div>THESE PERMIT DRAWINGS DESCRIBE DIAGRAMMATICALLY, AND IN GENERAL TERMS, THE INTENDED SCOPE OF WORK AS UNDERSTOOD BY THE ENGINEER. THE ENGINEER CREATED THE DRAWINGS, INCLUDING PLANS, DIAGRAMS, SPECIFICATIONS, AND NOTES, FOR THE EXPRESS PURPOSE OF DESCRIBING THE PROJECT TO THE LOCAL INSPECTIONS AUTHORITY'S PLANS REVIEW STAFF FOR THEIR USE IN GRANTING A BUILDING PERMIT.</div><div>THE CONTRACTOR SHALL BE RESPONSIBLE FOR FULLY UNDERSTANDING THE ACTUAL FIELD CONDITIONS OF THE PROJECT SITE AND THE SCOPE OF WORK AS EXPRESSED BY THE PARTY TO WHOM THE CONTRACTOR HAS CONTRACTED TO PERFORM THE WORK. THEREFORE, THE CONTRACTOR SHALL REVIEW THESE DOCUMENTS THOROUGHLY FOR ALL CONFLICTS, AND FOR ANY ASPECT OF THE WORK SHOWN IN THESE DOCUMENTS THAT IS AT VARIANCE WITH THE CONTRACTOR'S UNDERSTANDING OF THE WORK. THE CONTRACTOR SHALL PERFORM ALL WORK NECESSARY TO COMPLETE THE FACILITY OWNER'S INTENDED SCOPE OF WORK FOR THE PROJECT.</div><div>THE CONTRACTOR SHALL PERFORM ALL WORK ACCORDING TO ALL RELEVANT CODES, ALL REFERENCED STANDARDS, AND THE MOST CURRENT INTERPRETATIONS OF THE CODE AS STATED BY THE AUTHORITY HAVING JURISDICTION. IF ANYTHING IS NECESSARY FOR THE COMPLETE, PROPER, AND SAFE INSTALLATION, OPERATION, AND FUNCTION OF THE WORK DESCRIBED IN THESE DOCUMENTS, THE CONTRACTOR SHALL PROVIDE IT EVEN IF NOT CLEARLY INDICATED IN THESE DOCUMENTS.</div><div>THE CONTRACTOR SHALL SUPPLEMENT THESE CONTRACT DOCUMENTS WITH ALL DETAILS OF CONSTRUCTION; ALL MATERIAL, DEVICE, AND EQUIPMENT INSTALLATION INSTRUCTIONS; ANY NEEDED MANUFACTURER, SUPPLY HOUSE, AND VENDOR ASSISTANCE; SHOP DRAWINGS; AND FIELD INSTALLATION DRAWINGS NECESSARY TO COMPLETE THE PROJECT.</div><div>DETERMINE THE ACTUAL FIELD CONDITIONS AND INSTALLATION DETAILS. FULLY COORDINATE EVERY DEVICE AND EQUIPMENT AND THE RESPECTIVE LOCATIONS FOR EQUIPMENT, DEVICES, AND MATERIALS AMONG ALL CONTRACTOR TRADES AND WITH THE OWNER, IF NECESSARY. INSTALL EVERY PIECE OF EQUIPMENT AND ALL CONTROL DEVICES WITH ALL CODE-REQUIRED AND MANUFACTURER--RECOMMENDED SERVICING CLEARANCES, FREE OF OBSTRUCTIONS, AND WITHOUT CONFLICT WITH OTHER EQUIPMENT OR BUILDING ELEMENTS.</div><div>CONTRACTOR COORDINATION AND PRICING:</div><div>VISIT THE SITE OF THIS PROJECT AS OFTEN AS NECESSARY TO BECOME THOROUGHLY FAMILIAR WITH ALL EXISTING FIELD CONDITIONS AND THE FULL EXTENT OF THE WORK TO BE PERFORMED. VERIFY EVERY ASPECT OF THE PROPOSED WORK AS DESCRIBED OR IMPLIED BY THESE CONTRACT DOCUMENTS PRIOR TO SUBMITTING A PRICE FOR THIS WORK.</div><div>USE THESE DRAWINGS, THE INFORMATION OBTAINED FROM SITE VISITS, AND OWNER INPUT TO DETERMINE PRICE. BECAUSE CURRENT CODES REQUIREMENTS BASED UPON INTERPRETATIONS WILL VARY FROM JURISDICTION TO JURISDICTION, PROVIDE A CONTINGENCY AMOUNT IN YOUR PRICE FOR MINOR DISCRETIONARY CHANGES REQUESTED FOR BY THE OWNER, TENANT, ARCHITECT, ENGINEER, INSPECTOR, OR ANOTHER TRADE.</div><div>REVISE ANY ORIGINAL PRICING PRESENTED PRIOR TO THE CONTRACTOR'S RECEIPT OF THESE DRAWINGS TO SHOW ALL ADJUSTMENTS TO THE PRICE. THE CONTRACTOR'S RISK INCLUDES ANY COST INCURRED PRIOR TO OBTAINING ALL CLARIFICATIONS TO THESE DOCUMENTS, OR TO THE DESIGNER'S OR OWNER'S INTENT.</div><div>THE ENGINEER DID NOT INDEPENDENTLY VERIFY ALL EXISTING FIELD CONDITIONS. DETERMINE ALL MISSING INFORMATION RELEVANT TO THE PERMITTED WORK. TAKE ACTUAL FIELD MEASUREMENTS AT THE JOB SITE INSTEAD OF SCALING THE DRAWINGS. THE SYMBOLS AND DIAGRAMS SHOWN HAVE NO DIMENSIONAL SIGNIFICANCE AND DO NOT SHOW EVERY APPURTENANCE NECESSARY FOR A COMPLETE INSTALLATION AND CONFIGURATION. THE DRAWINGS SHOW APPROXIMATE LOCATIONS FOR ALL EQUIPMENT, DEVICES, AND MATERIALS. DETERMINE FINAL LOCATIONS IN THE FIELD BASED UPON ACTUAL CONSTRUCTION.</div><div>BRING ALL CONTRACT DOCUMENT-RELATED OMISSIONS, DISCREPANCIES, AND CONFLICTS TO THE ENGINEER'S ATTENTION PRIOR TO COMMENCING WORK AND INCURRING ANY COSTS FOR LABOR OR MATERIALS. WHERE THE ENGINEER HAS NO POST-DESIGN AND CONSTRUCTION ASSISTANCE RESPONSIBILITIES TO THE PROJECT, TAKE ALL FIELD-DISCOVERED CONFLICTS AND INTERFERENCES TO THE GENERAL CONTRACTOR'S ATTENTION FOR RESOLUTION BY THE RESPECTIVE TRADES.</div><div>SUBMIT ALL REQUESTS FOR INFORMATION (RFI) WITH WRITTEN COMMENTS DEFINING THE INFORMATION AND ASSISTANCE NEEDED. DOCUMENT THE REQUEST WITH RELEVANT INFORMATION FROM THE PLANS AND SPECIFICATIONS. THE ENGINEER MAY REJECT ANY POORLY PREPARED OR INADEQUATELY DOCUMENTED RFI AND ANY RFI SHOWING FAILED COORDINATION AMONG TRADES OR A POOR UNDERSTANDING OF THE PROJECT SCOPE/DESIGN INTENT.</div><div>INFORM THE ENGINEER OF ANY DEVIATIONS MADE FROM THE PERMITTED DRAWINGS. WHERE THE CONTRACTOR DEVIATES FROM THE PERMITTED WORK WITHOUT ENGINEERING PARTICIPATION, THE ENGINEER MAY CHARGE APPROPRIATE FEES FOR ANY LETTERS OF ACCEPTANCE REQUIRED BY THE FIELD INSPECTORS.</div><div>QUALIFICATIONS AND STANDARDS OF WORKMANSHIP:</div><div>PERFORM ALL WORK USING EXPERIENCED, SKILLED CRAFTSMEN LICENSED IN THEIR RESPECTIVE TRADES, AND COMPETENT TO PERFORMED THE WORK INVOLVED WITH THIS PROJECT.</div><div>ALL WORK AND MATERIALS SHALL CONFORM TO THE APPLICABLE LOCAL, STATE, AND NATIONAL CODES (INCLUDING OSHA). AS THE ABSOLUTE MINIMUM ACCEPTABLE QUALITY STANDARD, COMPLY WITH THE LATEST EDITION OF THE NORTH CAROLINA STATE BUILDING CODE AND THESE SPECIFICATIONS.</div><div>DEMOLITION:</div><div>REMOVE ALL EQUIPMENT, DEVICES, AND MATERIALS NOT INTENDED TO REMAIN AND OBSTRUCTING NEW WORK. MECHANICALLY SECURE ALL ABANDONED EXISTING EQUIPMENT, FIXTURES, VALVES, DEVICES, PIPING, TUBING, ETC. WHEN DEMOLISHING PIPING, CONDUITS, WIRING, AND CABLING, REMOVE ALL PORTIONS BACK TO THE NEAREST POINT THAT REMAINS IN SERVICE. PROVIDE ALL DEVICES, CAPS, VALVES, FITTINGS, INSULATION, ETC., NECESSARY TO RESTORE TO SERVICE THE EXISTING PIPING, CONDUITS, WIRING, AND CABLES AFFECTED BY THIS WORK. RECONNECT, CLEAN, REPAIR, PURGE, STERILIZE, PRIME, TEST, ADJUST, BALANCE, ETC., AS NECESSARY ALL EXISTING EQUIPMENT, FIXTURES, DEVICES, PIPING, CONTROLS, ETC., TO BE LEFT IN SERVICE OR REUSED.</div><div>MATERIALS AND METHODS:</div><div>PROVIDE ALL CUTTING AND PATCHING NECESSARY TO PROPERLY INSTALL ALL WORK. FOR WORK IN-PROGRESS, LEAVE IN SAFE CONDITION ALL ROOFS, WALLS, FLOOR MATERIALS, OR ANY PART OF THE BUILDING OR PREMISES THAT MUST BE CHANGED OR REPLACED. REPAIR ANY DAMAGE DONE TO EXISTING EQUIPMENT, DEVICES, OR MATERIALS.</div><div>DO NOT CUT, NOTCH, OR BORE A FRAMING MEMBER IN EXCESS OF LIMITATIONS SPECIFIED IN THE CODE. DO NOT CUT, NOTCH, OR BORE ANY STRUCTURAL BEAMS AND COLUMNS UNDER ANY CIRCUMSTANCES.</div><div>PERFORM ALL TRENCHING AND BACKFILLING IN A SAFE MANNER. PROTECT THE STABILITY OF ALL STRUCTURES (OR ANY PART THEREOF) AND ANY WORK INSTALLED BY OTHER TRADES. EXCAVATE TRENCHES BELOW THE INSTALLATION LEVEL OF THE PIPE SUCH THAT THE BOTTOM OF THE TRENCH DOES NOT FORM THE BED FOR THE PIPE OR RACEWAY.</div><div>AT THE BOTTOM OF ANY TRENCH, STABILIZE SOFT MATERIALS OF POOR LOAD-BEARING QUALITY BY OVER-EXCAVATING A MINIMUM OF TWO PIPE DIAMETERS AND BACKFILLING WITH FINE GRAVEL, CRUSHED STONE, OR A CONCRETE FOUNDATION TO THE INSTALLATION LEVEL OF THE PIPE OR CONDUIT BOTTOM. TAP SAND INTO PLACE FOR ANY CONCRETE FOUNDATION INSTALLED SO AS TO PROVIDE UNIFORM LOAD-BEARING SUPPORT ABOVE THE CONCRETE FOR THE PIPE/CONDUIT BETWEEN JOINTS.</div><div>REMOVE ROCK ENCOUNTERED IN TRENCHING TO A MINIMUM OF 3 INCHES BELOW THE INSTALLATION OF THE BOTTOM OF THE PIPE/CONDUIT, AND BACKFILL THE TRENCH SHALL BE BACKFILLED TO THE INSTALLATION LEVEL OF THE BOTTOM OF THE PIPE WITH SAND TAMPED IN PLACE SO AS TO PROVIDE UNIFORM LOAD-BEARING SUPPORT FOR THE PIPE BETWEEN JOINTS. THE PIPE, INCLUDING THE JOINTS, SHALL NOT REST ON ROCK AT ANY POINT.</div><div>BURIED PIPING SHALL BE SUPPORTED THROUGHOUT ITS ENTIRE LENGTH. PROVIDE SOLID AND CONTINUOUS LOAD-BEARING SUPPORT BETWEEN JOINTS. PROVIDE BELL HOLES, HUB HOLES, AND COUPLING HOLES WHERE CONNECTING PIPES.</div><div>BACKFILL THE TRENCH TO THE INSTALLATION LEVEL OF THE BOTTOM OF THE PIPE WITH SAND OR FINE GRAVEL PLACED IN LAYERS OF 6-INCHES MAXIMUM DEPTH. BACKFILL SHALL BE FREE FROM DISCARDED CONSTRUCTION MATERIAL AND DEBRIS. LOOSE EARTH FREE FROM ROCKS, BROKEN CONCRETE, AND FROZEN CHUNKS SHALL BE PLACED IN THE TRENCH IN 6-INCH LAYERS AND TAMPED IN PLACE UNTIL THE CROWN OF THE PIPE IS COVERED BY 12 INCHES OF TAMPED EARTH. THE BACKFILL UNDER AND BESIDE THE PIPE SHALL BE COMPACTED FOR PIPE SUPPORT. BACKFILL SHALL BE BROUGHT UP EVENLY ON BOTH SIDES OF THE PIPE SO THAT THE PIPE REMAINS ALIGNED.</div><div>WHEN INSTALLING PIPE BY TUNNELING, JACKING, OR A COMBINATION OF BOTH, PROTECT THE PIPE FROM DAMAGE DURING INSTALLATION AND FROM SUBSEQUENT UNEVEN LOADING. WHEN USING EARTH TUNNELS, PROVIDE ADEQUATE SUPPORTING STRUCTURES TO PREVENT FUTURE SETTLING OR CAVING.</div><div>RESTORE ALL DAMAGED EXISTING WALKS, WALLS, PAVED AREAS, OR GRADED AREAS TO THEIR FINAL FINISH APPEARANCE.</div><div>MATERIAL AND PRODUCT STANDARDS:</div><div>PROVIDE ONLY NEW MATERIALS, DEVICES, FIXTURES, AND EQUIPMENT. PROVIDE ONLY PRODUCTS LISTED AND LABELED BY AN NC-APPROVED THIRD PARTY LABORATORY SERVICE SUCH AS UNDERWRITER'S LABORATORIES, INC, CSA, ETL AND OTHERS. INSTALL ALL PRODUCTS BASED ON THE MANUFACTURER'S INTENDED USE. DO NOT DEVIATE FROM PRODUCT LISTING LIMITATIONS WHICH CAN BE MORE RESTRICTION THAN THE CODE.</div><div>PROVIDE APPROPRIATELY RATED AND LABELED EQUIPMENT ENCLOSURES AND PRODUCTS FOR EACH LOCATION. PROVIDE NEMA 3R OR BETTER AND WET LOCATION LABELED ENCLOSURES FOR ALL EQUIPMENT AND PRODUCTS INSTALLED ANYWHERE OUTDOORS OR AT INDOOR WASH-DOWN LOCATIONS.</div></div></div> <div><div>UTILITY AND BUILDING OWNER'S REPRESENTATIVE COORDINATION:</div><div>COMPLY WITH ALL MUNICIPAL, STATE, AND/OR UTILITY REGULATIONS FOR SERVICE CONNECTIONS AND METERING PROVISIONS.</div><div>FULLY COORDINATE WITH THE GAS UTILITY TO PROVIDE SERVICE TO THE FACILITY. PROVIDE ANY NECESSARY UNDERGROUND PIPES, SLEEVES, AND OTHER PROVISIONS REQUESTED BY THE UTILITY. THE OWNER WILL PAY FOR ALL SERVICE CONNECTION, LINE EXTENSION, AND IMPACT FEES DIRECTLY TO THE APPROPRIATE UTILITY OR JURISDICTION.</div><div>COORDINATE ALL UTILITY OUTAGES AND BUILDING SYSTEMS DOWN-TIME THAT WILL IMPACT BUILDING TENANTS WITH THE AUTHORIZED REPRESENTATIVE OF THE BUILDING OWNER.</div><div>AS CONSTRUCTION PROCEEDS, COORDINATE ALL BUILDING SYSTEMS DOWN-TIME THAT WILL IMPACT OTHER TRADES WITH THE GENERAL CONTRACTOR.</div><div>PROVIDE TEMPORARY SERVICES AS NECESSARY TO SUPPORT ALL CONSTRUCTION ACTIVITIES.</div><div>SUBMITTALS AND TESTING:</div><div>SUBMIT A LIST OF ALL HVAC EQUIPMENT AND DEVICES MATCHING THE ENGINEER'S BASIS OF DESIGN. SUBMIT ELECTRONIC SHOP DRAWINGS AND CATALOG DATA FOR ALL HVAC EQUIPMENT, DEVICES, PIPING, AND INSULATIONS THAT DO NOT.</div><div>PROVIDE THE BUILDING OWNER WITH THREE (3) COPIES OF O&M MANUALS CONTAINING INFORMATION REQUIRED BY THE STATE ENERGY CODE.</div><div>RETAIN ALL RETAIN INSTALLATION INSTRUCTIONS, MANUFACTURER'S PACKING DOCUMENTS, ETC., FOR ALL LIFE SAFETY RELATED EQUIPMENT AS EVIDENCE TO THE AUTHORITY HAVING JURISDICTION THAT THE CORRECT MATERIALS AND DEVICES WERE USED IN THE CONSTRUCTION, PENETRATION, AND SEALING OF THE PENETRATION FOR ALL RATED ASSEMBLIES.</div><div>CONFORM TO ALL LOCAL, STATE, AND NATIONAL CODES, AND WITH THE REQUESTS OF THE LOCAL INSPECTOR FOR TESTS AND COMPONENT TESTING. CONTRACTOR SHALL PAY THE FULL COST OF ANY DESTRUCTIVE TESTING NECESSARY TO DEMONSTRATE COMPLIANCE WITH THESE DRAWINGS AND CODE.</div><div>AS A MINIMUM, TURN "ON" AND "OFF", SWITCH, CHANGE MODES, AND VERIFY SEQUENCES OF OPERATION FOR ALL DEVICES, EQUIPMENT, AND SYSTEMS TO DEMONSTRATE PROPER INSTALLATION AND SATISFACTORY OPERATION.</div><div>PERMITS, WARRANTY, AND INSPECTIONS:</div><div>OBTAIN AND PAY FOR ANY AND ALL REQUIRED PERMITS, INSPECTIONS, CERTIFICATES OF INSPECTIONS AND APPROVAL, AND THE LIKE AND SHALL DELIVER SUCH CERTIFICATES TO THE OWNER. NOTIFY THE ARCHITECT AND ENGINEER OF ALL SCHEDULED INSPECTIONS.</div><div>DO NOT USE INSTALLED HVAC EQUIPMENT TO "DRY OUT" THE BUILDING. THE MANUFACTURER COULD VOID THE PRODUCT WARRANTY FOR THE EQUIPMENT OR PRODUCT BASED UPON DAMAGE, MOLD, AND/OR MILDEW ISSUE ARISING FROM UNINTENDED USE OF THE EQUIPMENT.</div><div>WARRANT ALL MATERIALS, EQUIPMENT, AND WORKMANSHIP SHOWN OR IMPLIED BY THESE DOCUMENTS TO BE FREE OF DEFECTS FOR A PERIOD OF ONE YEAR, STARTING FROM THE TIME OF ACCEPTANCE BY THE BUILDING OWNER. IF WITHIN ONE YEAR AFTER THE ACCEPTANCE DATE ANY WORK OR EQUIPMENT IS FOUND TO BE DEFECTIVE, CORRECT IT PROMPTLY AT NO COST TO THE BUILDING OWNER.</div><div>SCOPE OF WORK:</div><div>PROVIDE ALL WORK, EQUIPMENT, SERVICES, LABOR, AND MATERIALS NECESSARY FOR THE INSTALLATION OF COMPLETE AND FULLY FUNCTIONAL MECHANICAL AND GAS SYSTEMS AS DESCRIBED OR IMPLIED BY THE CONTRACT DOCUMENTS.</div><div>PIPING, PIPE FITTINGS, PIPE HANGERS/SUPPORTS, & INSULATION:</div><div>PROVIDE TYPE "ACR" HARD DRAWN COPPER REFRIGERANT PIPING CONFORMING TO ANSI B-31.5 OR ASTM B280 AND DELIVERED TO THE JOB SITE IN PRE-DETERMINED LENGTH "LINE SETS".</div><div>PROVIDE SCHEDULE 40, BLACK STEEL WITH MALLEABLE IRON FITTINGS FOR NATURAL GAS PIPING. FOR 2 PSI SYSTEMS, PROVIDE VENT-LESS REGULATORS FOR ALL GAS-FIRED APPLIANCES. FOR 5 PSI SYSTEMS, PROVIDE REGULATORS FOR ALL GAS-FIRED APPLIANCES AND VENT THE REGULATOR TO THE EXTERIOR. PROVIDE ANSI Z21.80 REGULATORS LISTED FOR INDOOR OR OUTDOOR USE AS APPROPRIATE.</div><div>PROVIDE WROUGHT METAL SOLDER JOINT TYPE COPPER PIPE FITTINGS CONFORMING TO ANSI B16.22.</div><div>INSTALL PIPING AND RELATED ITEMS NEATLY. CHOOSE ROUTES PARALLEL AND PERPENDICULAR TO BUILDING LINES. ARRANGE PIPING TO ALLOW PROPER RETURN OF OIL TO THE COMPRESSOR. PROVIDE TRAPS WHERE NECESSARY FOR OIL FLOW.</div><div>REAM PIPING TO REMOVE ALL BURRS, FINs, AND FOREIGN MATERIALS. THOROUGHLY CLEAN ALL PIPING BEFORE SOLDERING. DURING SOLDERING, PURGE PIPING WITH NITROGEN. USE ONLY SILVER SOLDER WITH NON-CORROSIVE FLUX.</div><div>PROVIDE P-TRAPS ON EACH CONDENSATE DRAIN. ARRANGE ALL PIPING/CONNECTIONS TO EQUIPMENT FOR EASY SERVICING OF THE TRAP AND EVAPORATOR FAN. MAINTAIN ACCESS TO ALL VALVES AND EQUIPMENT.</div><div>DO NOT TO EXCEED 5'-0" FOR SPACE HANGERS AND SUPPORTS. PROVIDE PIPE COVERING PROTECTION SADDLES AT ALL SUPPORTS FOR INSULATED PIPING. USE CLAMPS AND METAL STRAPS TO SECURE REFRIGERANT LINES. FOR OTHER PIPING, USE 10-GAUGE SHEET METAL SADDLES MEASURING ONE-HALF THE CIRCUMFERENCE OF THE INSULATION AND A MINIMUM OF 12 INCHES LONG.</div><div>TEST ALL REFRIGERANT EQUIPMENT NOT TESTED AT THE FACTORY BY SHUT OFF THE EQUIPMENT FROM THE REST OF THE SYSTEM AND TESTING. TEST PIPING SYSTEMS AFTER COMPLETING INSTALLATION AND BEFORE APPLYING ANY PIPE INSULATIONS. REMOVE ALL CONTROLS AND OTHER APPARATUS (THAT MIGHT BE DAMAGED BY THE TEST PRESSURE) BEFORE THE TESTING.</div><div>TEST REFRIGERANT PIPING AT 150 PSIG WITH DRY NITROGEN FOR 24 HOURS WITHOUT LOSS OF PRESSURE. CHECK EACH JOINT FOR LEAKS WITH A SOAP SOLUTION. CONTINUE TESTING AND REPAIR UNTIL DETERMINING NO LOSS OF PRESSURE. AFTER SATISFACTORY NITROGEN PRESSURE TESTING, CONNECT HIGH VACUUM PUMPS (DO NOT USE COMPRESSOR) TO THE SYSTEM USING ISOLATION VALVES. TRIPLE EVACUATE THE SYSTEM: FIRST TIME TO 1500 MICRONS, SECOND TIME TO 1000 MICRONS, AND THE THIRD TIME TO 500 MICRONS - ALL AT AN AMBIENT SYSTEM TEMPERATURE GREATER THAN 36F FOR 12 HOURS MINIMUM. AFTER THIS, BREAK THE VACUUM IN THE SYSTEM BY CHARGING THE SYSTEM WITH REFRIGERANT.</div><div>COORDINATE WITH SPLIT SYSTEM EQUIPMENT MANUFACTURERS TO PROPERLY SIZE REFRIGERANT LINES FOR THE ACTUAL LENGTHS AND HEIGHTS OF LIFT. EVEN IF NOT NOTED ON THESE PLANS, PROVIDE ALL ADDITIONAL EQUIPMENT FEATURES AND PIPING SPECIALTIES NECESSARY TO ENSURE PROPER EQUIPMENT OPERATION GIVEN THE ACTUAL CHARACTERISTICS OF THE INSTALLATION. USE ONLY PIPING SPECIALTIES COMPATIBLE WITH THE REFRIGERANT USED, SIZED AND RATED FOR THE SYSTEM CAPACITIES, HAVING SOLDERED CONNECTIONS, AND MANUFACTURED BY HENRY, ALCO, SPORLAN, OR THE EQUIPMENT MANUFACTURER.</div><div>DUCTWORK AND DUCTWORK ACCESSORIES:</div><div>ROUND AND RECTANGULAR DUCTWORK SHALL BE FABRICATED FROM THE BEST QUALITY GALVANIZED SHEET STEEL, AND SHALL MEET THE GAUGES AND CONSTRUCTION METHODS INDICATED IN THE LATEST ASHRAE GUIDE AND BY SMACNA HVAC DUCT CONSTRUCTION STANDARDS FOR 2" WG DUCT CLASSIFICATION, LOW PRESSURE, LOW VELOCITY (UP TO 2000 FPM) DUCTWORK. RETURN AIR DUCTWORK SHALL BE SIZED, CONSTRUCTED, AND CONNECTED TO PROVIDE AN EVEN DISTRIBUTION OF AIR FLOW OVER THE ENTIRE FILER.</div><div>ALL JOINTS, LONGITUDINAL AND TRANSVERSE SEAMS, AND CONNECTIONS IN DUCTWORK SHALL BE SECURELY FASTENED AND SEALED WITH WELDS, GASKETS, MASTIC (ADHESIVES), MASTIC-PLUS-EMBEDDED-FABRIC SYSTEMS OR TAPES. TAPES AND MASTICS USED TO SEAL DUCTWORK SHALL CONFORM TO UL 181A FOR MARKING AND LABELING. TAPES AND MASTICS USED TO SEAL FLEXIBLE AIR DUCTS AND CONNECTORS SHALL CONFORM TO UL181B FOR MARKING AND LABELING. DUCT CONNECTIONS TO FLANGES OF AIR DISTRIBUTION SYSTEM EQUIPMENT SHALL BE SEALED AND MECHANICALLY FASTENED.</div><div>ALL EXPOSED DUCTWORK SHALL BE PRIME-PAINTED READY FOR FINISHED PAINTING BY GENERAL CONTRACTOR.</div><div>FLEXIBLE AIR DUCTS SHALL BE FOIL TYPES U.L. #181 CLASS 1 LISTED.</div><div>SEAL THE SPACES AROUND ALL DUCTWORK PENETRATIONS IN AN APPROVED MANNER. FLEXIBLE DUCTS SHALL NOT PASS THROUGH ANY FLOOR, WALL, OR CEILING.</div><div>WHERE ALLOWED BY CODE, JOINTS BETWEEN DUCTWORK PIECES SHALL BE SEALED BY UL 181 MASTIC AND MESH TAPE OR AN EQUAL PRODUCT TO PROVIDE A COMPLETELY AIRTIGHT SYSTEM.</div><div>HANGERS AND SUPPORTS FOR DUCTWORK SHALL BE METAL BANDS, ANGLES, AND/OR RODS FOR METAL DUCTWORK AND NYLON STRAPS FOR FOIL AND VINYL FLEXIBLE DUCTWORK. SIZE AND INSTALL PER ASHRAE AND SMACNA STANDARDS. THE DISTANCE BETWEEN SUPPORTS SHALL NOT EXCEED 10'.</div><div>DAMPERS, TRANSITIONS, AND DIFFUSERS/GRILLES:</div><div>INSTALL BALANCING DAMPERS, TURNING VANES, DUCT TRANSITIONS, ETC., GENERALLY WHERE SHOWN ON THE DRAWINGS, IN EVERY BRANCH DUCT OR AT EVERY DIFFUSER/GRILLE, AND WHERE REQUIRED FOR PROPER AIR FLOW CONTROL. LOCATE ALL SERVICE PANELS, ACCESS PANELS, AND DAMPER HANDLES ON BOTTOM OF THE DUCTWORK FOR EASY ACCESS FROM FLOOR.</div><div>REGISTERS AND GRILLES SHALL CONFORM WITH THE SCHEDULE. ACCEPTABLE MANUFACTURERS - METALAIRE, J & J REGISTER, TITUS, OR HART & COOLEY.</div><div>PROVIDE WALL-- AND/OR ROOF--COMPATIBLE AIR INTAKE AND EXHAUST CAPS WITH BACKDRAFT DAMPERS. PROVIDE INSECT SCREENS FOR INTAKE VENTS BUT NOT EXHAUST DISCHARGE CAPS.</div><div>INSULATIONS:</div><div>PROVIDE DUCTWORK INSULATION COVERINGS AND LININGS WITH FLAME-SPREAD RATINGS OF 0-25 AND SMOKE-DEVELOPMENT RATINGS OF 0-50 WHEN TESTED PER ASTM E 84/ASTM E 2231 AND ASTM C 411. INSULATE EACH DUCT NOT WITHIN THE CONDITIONED SPACE IT SERVES. PROVIDE FIBERGLASS BLANKET COVERED BY A VAPOR RETARDER. PROVIDE MINIMUM INSULATION INSTALLED VALUE R-8.0 IN CRAWL SPACE. PROVIDE VAPOR RETARDERS WITH MAXIMUM PERMEANCE OF 0.05 PERM OR 2 MILS THICK ALUMINUM FOIL. WE ACCEPT UNCOVERED INSULATION MATERIALS WITH A PERMEANCE OF 0.05 PERM OR LESS.</div><div>FOLLOW THE TECHNICAL INSTRUCTIONS OF THE INSULATION MANUFACTURER TO INSTALL DUCT COVERINGS AND LINERS. DO NOT INSTALL INSULATION ON DUCTWORK WITHIN THE PENETRATION OF A FIRE-RATED ASSEMBLY. INSULATE UP TO THE WALL OR ROOF PENETRATION. ALL JOINTS AND SEAMS IN THE VAPOR RETARDER SHALL BE SEALED. PRESSURE-SENSITIVE TAPE SHALL NOT BE USED AS THE PRIMARY SEALANT.</div></div>	<div><div>GENERAL MECHANICAL NOTES:</div><div><div>1. PREPLAN ALL WORK PRIOR TO PURCHASING, ORDERING, OR FABRICATING ANY PART OF THE WORK DESCRIBED ON THESE DRAWINGS.</div><div>2. IMMEDIATELY NOTIFY THE ENGINEER OF ANY CONFLICTS WITH EXISTING FIELD CONDITIONS OR THE WORK OF OTHER TRADES.</div><div>3. RESOLVE ALL CONFLICTS PRIOR TO INCURRING ANY MATERIAL OR LABOR EXPENSES.</div><div>4. COMPLY WITH THE MANUFACTURER'S TECHNICAL INSTRUCTIONS WHEN INSTALLING MECHANICAL EQUIPMENT, DEVICES, DUCTWORK, GRILLES, REGISTERS, DIFFUSERS, AND OTHER MATERIALS.</div><div>5. PROVIDE ALL APPURTENANCES NECESSARY TO PROPERLY INSTALL EQUIPMENT, DEVICES, DUCTWORK, GRILLES, REGISTERS, DIFFUSERS, AND OTHER MATERIALS.</div><div>6. VERIFY EACH GRILLE, REGISTER, AND DIFFUSER TO BE INSTALLED AGAINST THE OWNER'S ROOM FINISHES AND RESOLVE ALL CONFLICTS BEFORE ORDERING.</div><div>7. LOCATE NEW DEVICES, DUCTWORK, GRILLES, DIFFUSERS, AND OTHER MATERIALS GENERALLY AS SHOWN ON THE PLANS; HOWEVER, COORDINATE LOCATIONS WITH ACTUAL FIELD CONDITIONS TO PRESERVE ALL CODE-REQUIRED AND MANUFACTURER-REQUESTED SERVICE CLEARANCES.</div><div>8. COORDINATE THE ROUTING OF ALL NEW DUCTWORK AND PIPING WITH THE BUILDING STRUCTURE AND WITH THE WORK OF OTHER TRADES.</div><div>9. ALL DUCTWORK DIMENSIONS ARE GIVEN IN INCHES AND ARE NET CLEAR, INTERIOR DIMENSIONS.</div><div>10. ALL NEW DUCTWORK NOT WITHIN THE CONDITIONED SPACE SHALL BE INSULATED WITH R-8.0.</div><div>11. PROVIDE AIR TURNING DEVICES AT EACH SUPPLY DUCT ELBOW AND BRANCH TAKE OFF. PROVIDE BALANCING AND SPLITTER DAMPERS AS SHOWN ON THE PLANS AND WHERE NECESSARY FOR SYSTEM BALANCING. ALL TURNING VANES SHALL BE DOUBLE-THICKNESS.</div><div>12. PROVIDE PROGRAMMABLE THERMOSTAT CONTROLS FOR PROPER AND SATISFACTORY SYSTEM OPERATION. ALL PORTIONS OF WALL-MOUNTED THERMOSTATS SHALL BE NO HIGHER THAN 46" AFF.</div><div>13. PROVIDE OUTSIDE AIR INTAKE HOODS AND EXHAUST AIR DISCHARGE HOODS THAT ARE COMPATIBLE WITH THE EXISTING WALL CONSTRUCTION. PROVIDE INSECT SCREENS AND BACKDRAFT DAMPERS FOR OUTSIDE AIR HOODS AND BACKDRAFT DAMPERS ONLY FOR EXHAUST AIR HOODS. DAMPERS SHALL CLOSE WHEN THE AIR HANDLING UNIT OR EXHAUST FAN IS "OFF".</div><div>14. BALANCE HVAC SYSTEMS TO THE CFM QUANTITIES SHOWN ON THESE DRAWINGS. PROVIDE A CONTRACTOR-GENERATED REPORT OF FINAL UNIT SETTINGS AND AIRFLOW VALUES. ALTERNATIVELY, THE CONTRACTOR CAN COORDINATE WITNESSING BY THE ENGINEER-OF-RECORD.</div><div>15. UPON COMPLETION OF THE PROJECT, TEST AND VERIFY ALL EQUIPMENT AS OPERATING SATISFACTORILY.</div></div></div>

MECHANICAL LEGEND

↑

A100

↑

↑

↑

EF-#

10x12

T

W

↑

↑

↗

SUPPLY SIDEWALL GRILLE STEEL 12x6 (150 CFM) W/ HORIZONTAL ADJUSTABLE FACE BARS, MTD TO DUCT, HART & COOLEY 831

EXHAUST AIR DISCHARGE WALL CAP BROAN WVK2A

OUTSIDE AIR INTAKE AIR VENT MASTER FLOW

CEILING-MOUNTED EXHAUST FAN

THERMOSTAT

SUPPLY/RETURN AIR LOW PRESSURE DUCTWORK - SHEET METAL

SQUARE ELBOW WITH TURNING VANES

BALANCING DAMPER

AIR FLOW DIRECTION(S)

RENOVATION/ADDITION TO POOL BUILDING FOR:

CAMP AGAPE

1369 TYLER DEWAR LN

FUQUAY VARINA, NORTH CAROLINA 27526

PROJECT NO: 2430

DATE: 11/19/24

CAD DWG FILE: M_2430

DRWN BY:WHCCHKD BY:WHC

HVAC NOTES, LEGEND, AND SPECIFICATIONS

MO

Copyright 2024 William H. Clark, Jr., PE. The reproduction, copying or other use of this drawing without our written consent is prohibited.

Copyright 2024 William H. Clark, Jr., PE.


WHCPE

WILLIAM H. CLARK, JR., PE


4752 PORCHAVEN LN., APEX, NC 27539

PHONE: 919-740-3626 WHCLARK2001@GMAIL.COM

NORTH CAROLINA PROFESSIONAL ENGINEER SEAL 10985 WILLIAM H. CLARK, JR.

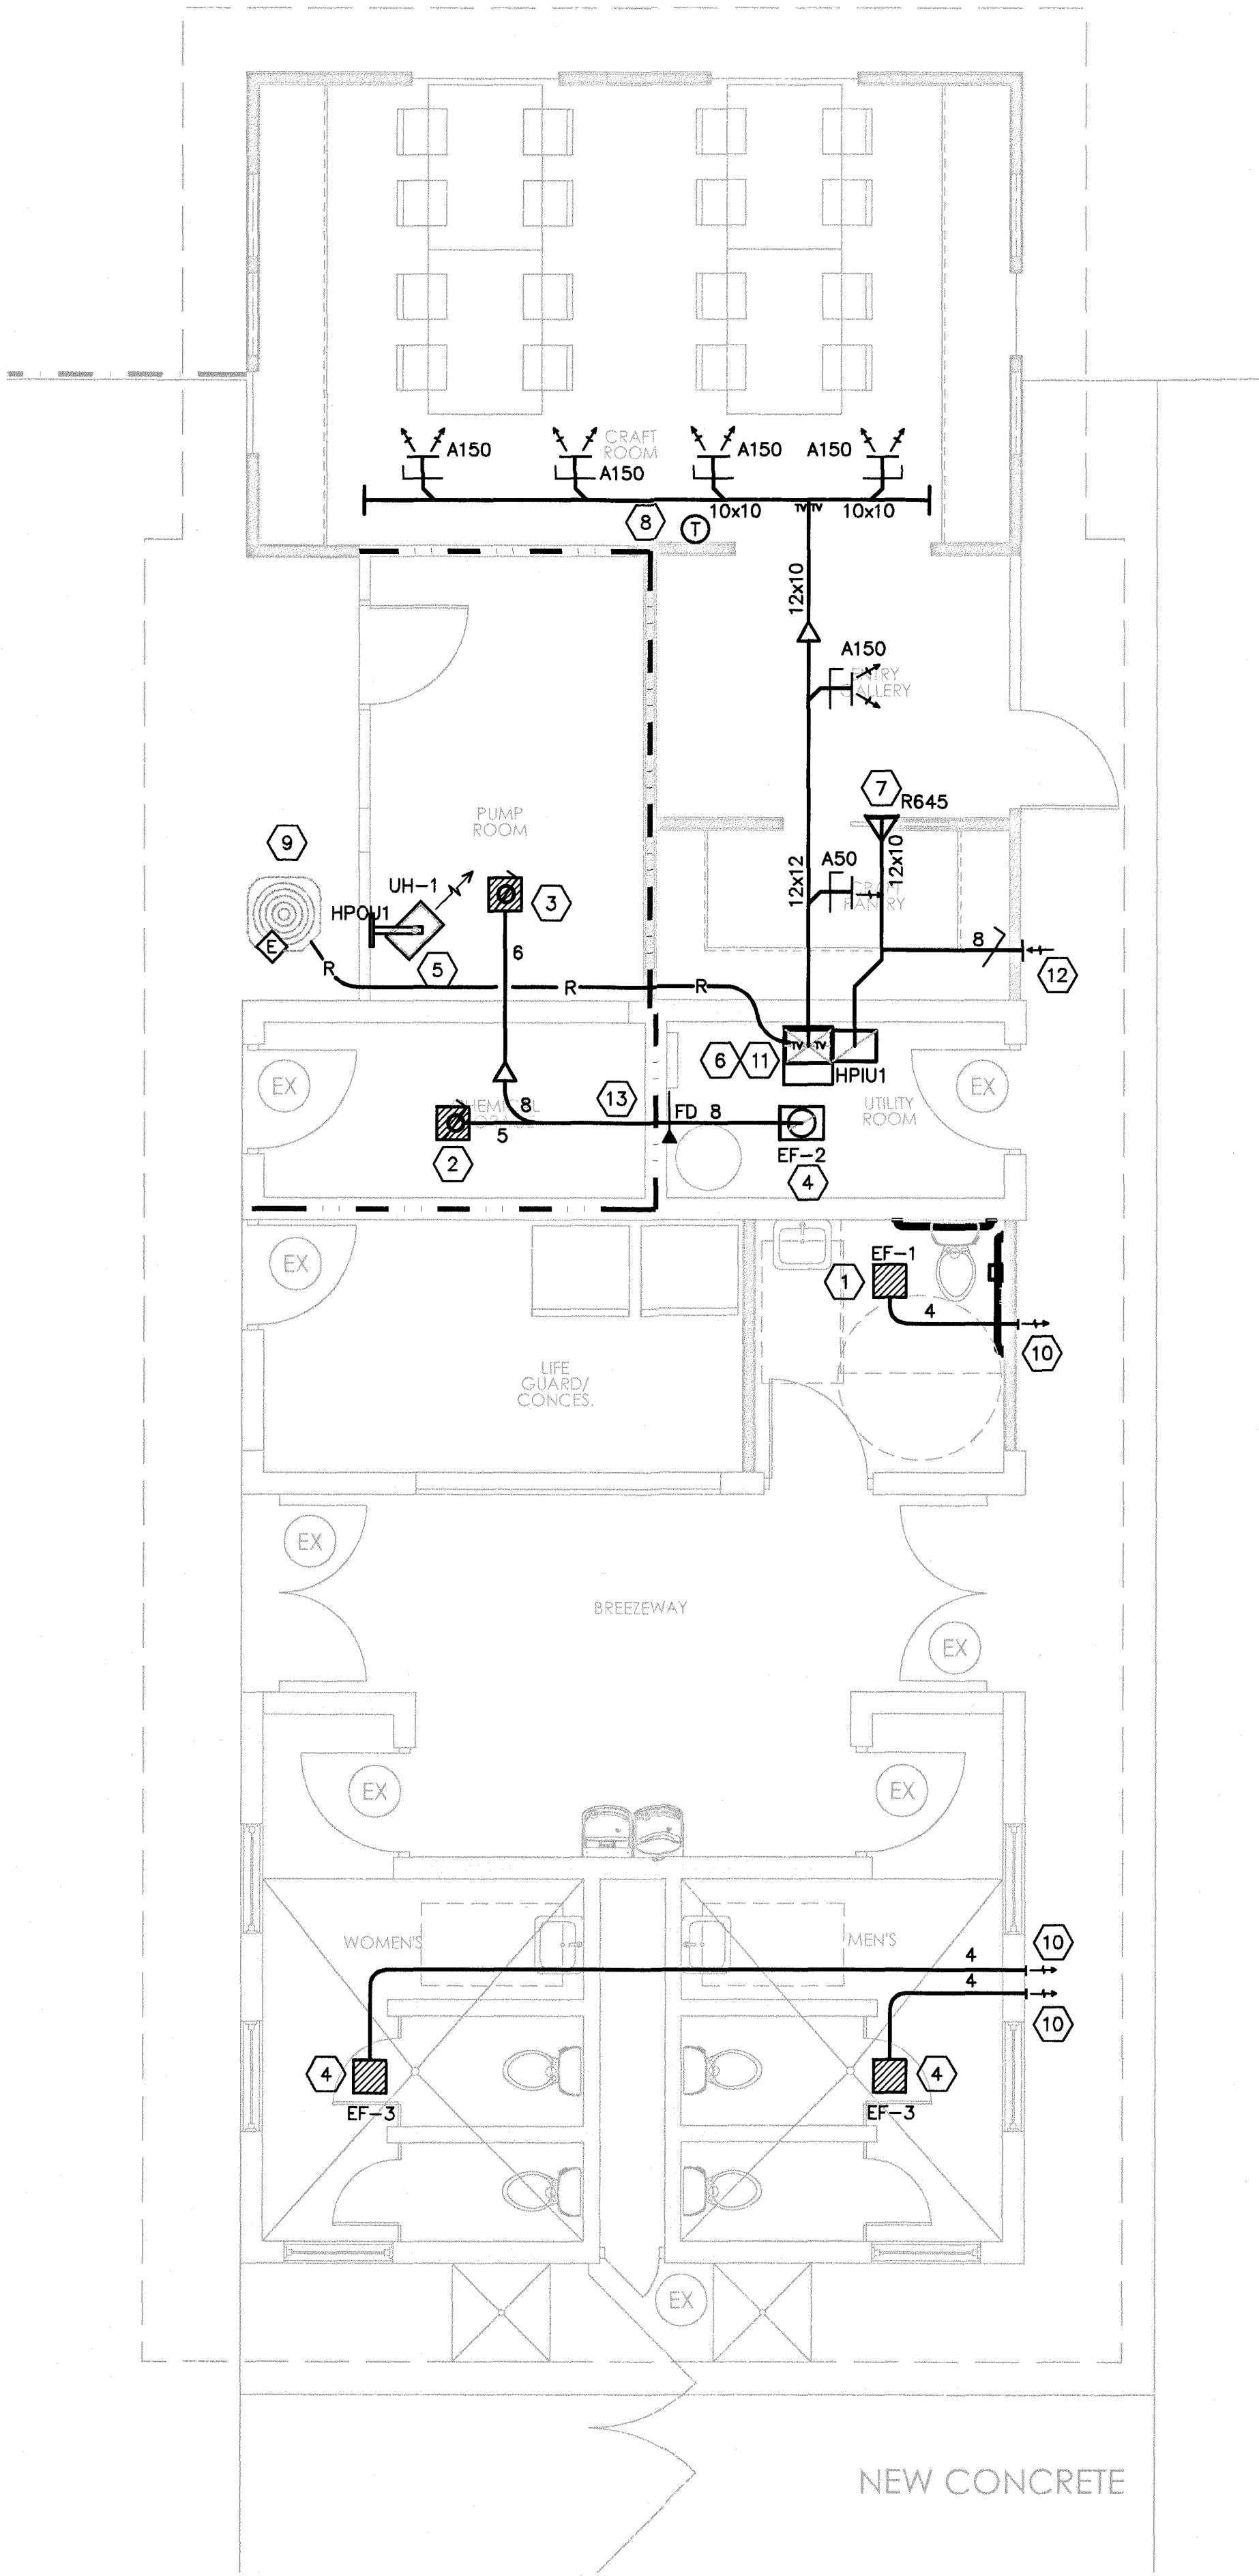

1 FLOOR PLAN -HVAC
1/4" = 1' - 0"

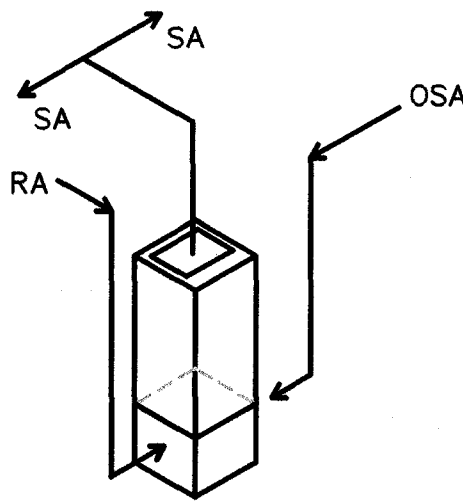

HPIU-1

2 SCHEMATIC REPRESENTATION OF HPIU AND DUCTWORK
M1 NO SCALE

EXHAUST AND OUTSIDE AIR REQUIREMENTS

EXHAUST:

1 TOILET WITH (1) WATER CLOSET
EXHAUST @ 50 CFM = 80 CFM (EF-1) PROVIDED.

POOL CHEMICAL AND PUMP ROOMS
EXHAUST @ 10 AC/HR = 264 CFM = 300 CFM (EF-2) PROVIDED

2 TOILETS WITH (2) WATER CLOSETS
EXHAUST @ 100 CFM = 110 CFM (EF-3) EA PROVIDED.

OUTSIDE AIR:

CRAFT AREA @ 20/1000, 10/PERSON, 0.18/SF (264 SF)
6 PEOPLE AND 108 CFM

MAIN ENTRY @ 10/1000, 5/PERSON, 0.06/SF (87 SF)
1 PEOPLE AND 11 CFM

STORAGE @ 0 PEOPLE 0.06/SF (56 SF)
0 PEOPLE AND 4 CFM

TOTAL REQUIRED = 123 CFM/0.8 EFF = 154 CFM
TOTAL PROVIDED 155 CFM

EQUIPMENT SPECIFICATIONS

HPIU-1: GOODMAN AMST24BP13*/HKTSN501*, R-32 COIL, MULTI-POSITION, MULTI-SPEED, ECM-BASED AIR HANDLER, NOMINAL 840 CFM @ 0.9 S.P. AT MID-SETTING, 5 KW HEAT STRIP, AND INTERNAL TXV. (MCA/MOCP = 30.8/35)

HPOU FEATURES AND ACCESSORIES: SINGLE-POINT ELECTRICAL CONNECTION, FRONT ACCESSIBLE FOR SERVICING, FRONT CONTROLS, FILTER RACK, R-32 REFRIGERANT LINE SET AND CONNECTIONS W/1.5" INSULATION, DRAIN PAN, 1" GRAVITY DRAIN PIPE TO EXTERIOR WALL, CONDENSATE P-TRAP W/SHUTOFF SWITCH, AND PROGRAMMABLE THERMOSTAT.

HPOU-1: GOODMAN GLZ4S4BA1810A* R-32 SPLIT SYSTEM OUTDOOR HEAT PUMP, NOMINALLY-RATED WITH HPIU INDOOR UNIT 17.4 MBH TOTAL, 12.5 SENSIBLE, AND 4.9 MBH LATENT, (MCA/MOCP = 11.2/15)

HPOU FEATURES AND ACCESSORIES: TOP AND SIDE MAINTENANCE ACCESS, HIGH-EFFICIENCY COMPRESSOR, SINGLE-SPEED PSC CONDENSOR FAN MOTOR, FILTER DRIER, SUCTION LINE ACCUMULATOR, COMPRESSOR CRANKCASE HEATER, HIGH-CAPACITY MUFFLER, HIGH- AND LOW-PRESSURE SWITCHES, OUTDOOR LOCKOUT OF SUPPLEMENTARY HEAT STRIPS (35F-40F), AND PAD.

* VERIFY HEAT PUMP EQUIPMENT SELECTIONS AND EXACT MODEL NUMBERS WITH SUPPLIER BASED ON 75F INDOOR DRY BULB, 63F WB, AND 95F OUTDOOR DB.

UH-1: RAYWALL 21WD5T01 UNIT HEATER, NEMA 4X, CORROSION-RESISTANT, OFF-HEAT-FAN SWITCH, PILOT LIGHT, LV CONTROLS WITH HIGH TEMPERATURE LIMITS, INLET GRILLE FAN GUARD, OUTLET GRILLE WITH LOUVERS. 5 KW, 240V/1P,

EF-1: BROAN HBB0RL CEILING-MOUNTED EXHAUST FAN 80 CFM, 120V/1P

EF-2: TWIN CITY FIBERGLASS 10WA UPBLAST ROOF-MOUNTED VENTILATOR, CORROSION RESISTANT, PVC BIRDSCREEN, FABRIC BACKDRAFT DAMPER, DUCT ADAPTER, AND ROOF CURB. NOMINAL 300 CFM @.25 SP, 120V/1P

EF-3: BROAN HB110RL CEILING-MOUNTED EXHAUST FAN 110 CFM, 120V/1P

GENERAL MECHANICAL NOTES:

- SEE GENERAL MECHANICAL SPECIFICATIONS ON DRAWING MO.
- SEE GENERAL MECHANICAL NOTES AND LEGEND ON DRAWING MO.
- DEMOLISH ALL EXISTING MECHANICAL SYSTEMS IN THE BUILDING.
- ENSURE ALL SOURCES OF BUILDING EXHAUST ARE MINIMUM 10' HORIZONTALLY FROM ALL OUTSIDE AIR INTAKES.
- CONFIRM EQUIPMENT SELECTIONS WITH SUPPLIERS FOR A COORDINATED SYSTEM. SUBSTITUTE MANUFACTURERS AND MODELS ALLOWED IF PRE-ACCEPTED BY THE ENGINEER.

NOTES KEYED TO PLAN

- UNDERCUT DOOR BY 1" ABOVE FINISHED FLOOR FOR RETURN AIR.
- SET EXHAUST AIR VOLUME DAMPER FOR 200 CFM (MIN. 10 AC/HR CONTINUOUS OPERATION).
- SET EXHAUST AIR VOLUME DAMPER FOR 100 CFM (MIN. 10 AC/HR CONTINUOUS OPERATION)
- FAN ON ROOF DIRECTS EXHAUST AWAY FROM POOL
- COORDINATE LOCATION WITH POOL EQUIPMENT INSTALLERS.
- MAINTAIN 36" CLEARANCE FROM FRONT OF PANEL.
- NOMINAL 18x14 AIR GRILLE ABOVE DOOR FOR RETURN AIR.
- COORDINATE DUCT HEIGHT IN ROOM WITH ARCHITECT. POSITION DUCT CLOSE TO WALL.
- OUTDOOR UNIT ON PAD. SEE SPECIFICATION FOR REFRIGERATION SYSTEM CHARGING REQUIREMENTS.
- ROUTE EXHAUST DUCT TO EXTERIOR WALL AS SHOWN AND TERMINATE IN DISCHARGE CAP WITH BACKDRAFT DAMPER AND BIRD SCREEN. MAINTAIN MINIMUM 10' DISTANCE FROM ALL AIR INTAKES. FAN OPERATED BY LIGHT SWITCH.
- ROUTE CONDENSATE PIPES FOR AIR HANDLER AND DRAIN PAN TO FLOOR DRAIN IN ROOM.
- OUTSIDE AIR INTAKE AND DUCTWORK TO HPIU RETURN. SET OUTSIDE AIR VOLUME DAMPER FOR 155 CFM.
- SUBMIT A PENETRATION DETAIL FOR THE THRU-WALL PENETRATION AND SEALING OF THE REFRIGERANT LINE SET, INSULATION, AND WIRING.

RENOVATION/ADDITION TO POOL BUILDING FOR:


CAMP AGAPE

1369 TYLER DEWAR LN
FUQUAY VARINA, NORTH CAROLINA 27526

PROJECT NO: 2430
DATE: 11/19/24
CAD DWG FILE: M_2430
DRWN BY:WHC CHKD BY:WHC

HVAC FLOOR
PLAN AND
SCHEDULES


M1

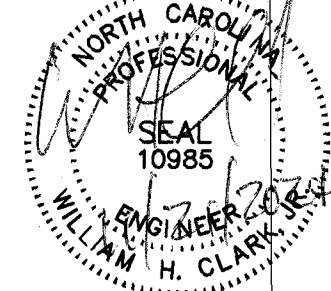


whcPE

WILLIAM H. CLARK, JR., PE
4732 PORCHAVEN LN, APEX, NC 27539
PHONE: 919-740-3626 WHCLARK2001@GMAIL.COM

This drawing and the design shown are the property of WILLIAM H. CLARK, JR., PE. The reproduction, copying or other use of this drawing without our written consent is prohibited. Copyright 2024 William H. Clark, Jr., PE.

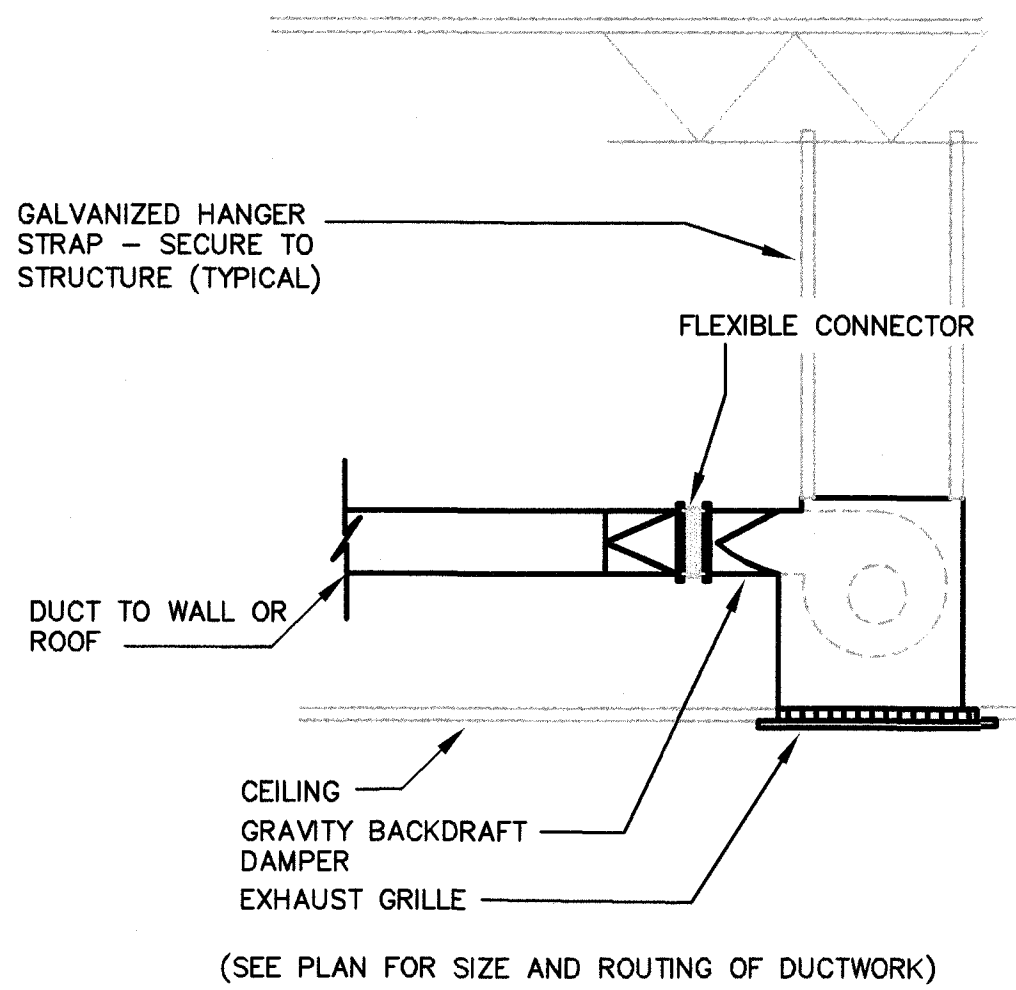


4
M2
CEILING EXHAUST FAN
NO SCALE

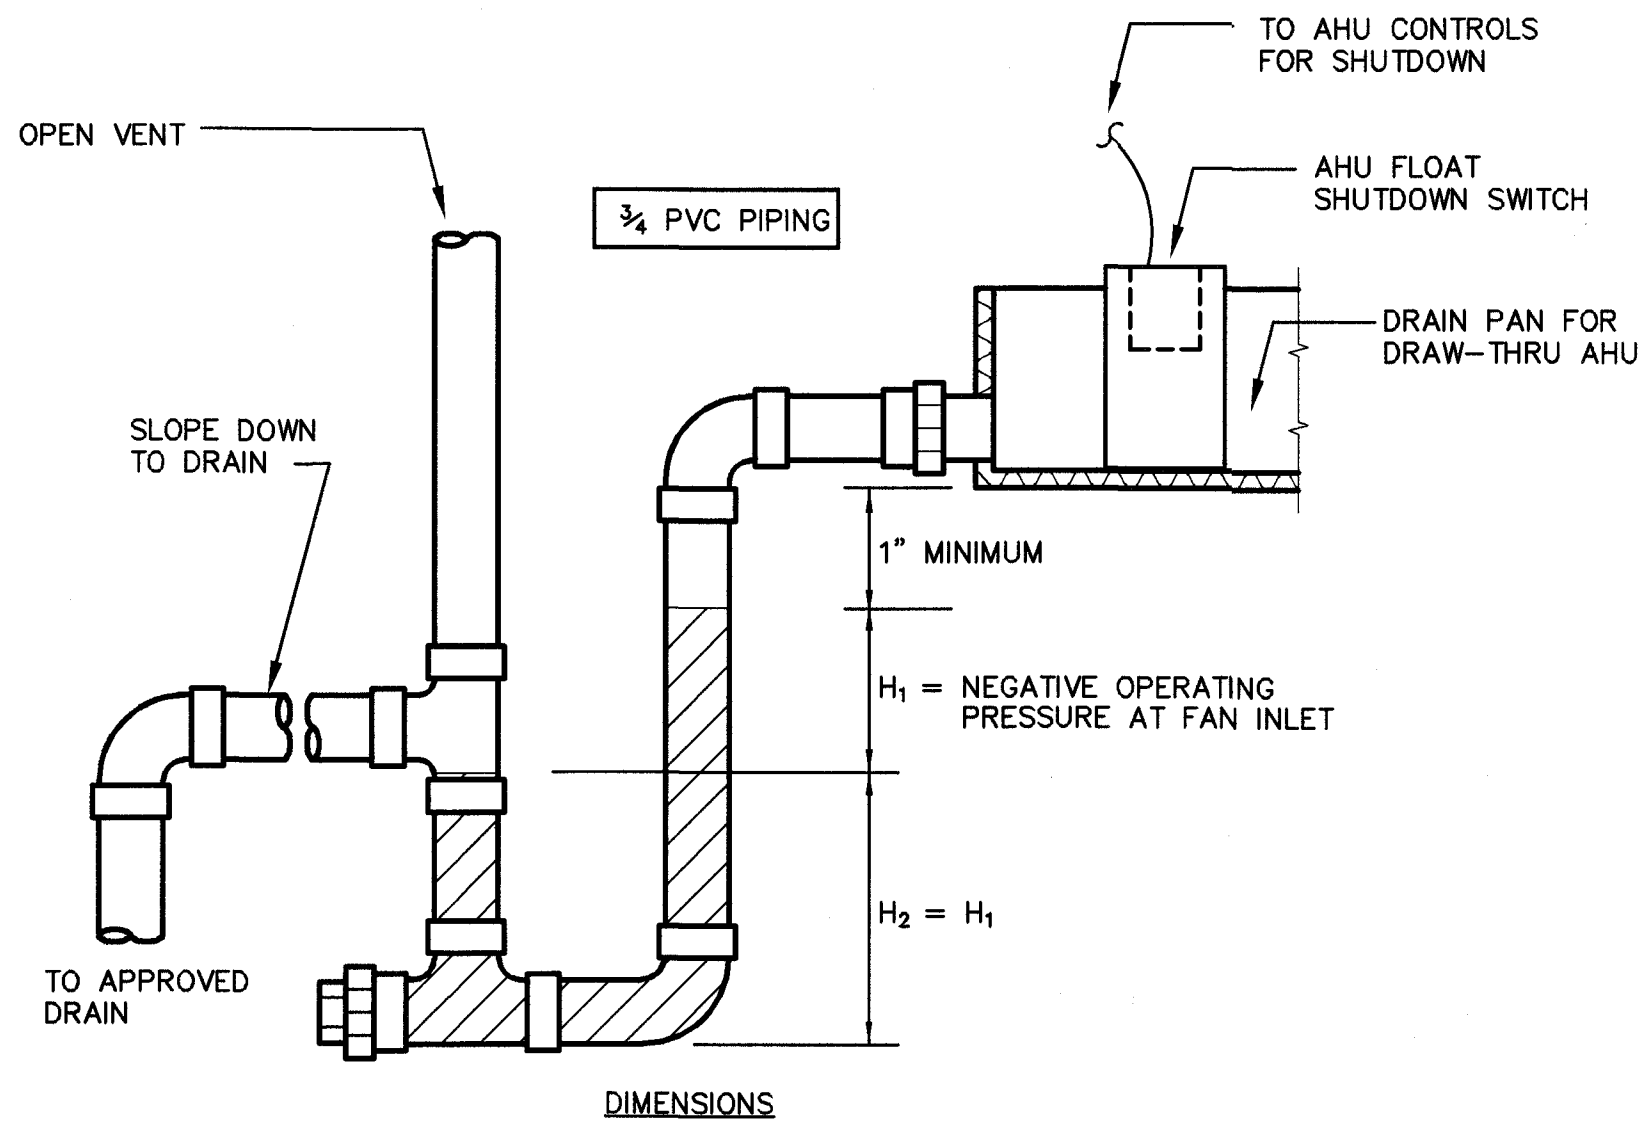


H ₁ PIPE DISTANCE	
MIN. PIPE SIZE	MAX. COIL LOAD (TONS)
3/4"	2
1"	5
1 1/4"	30

PITCH HORIZONTAL DRAIN LINE 1" IN 10 FEET

1
M2
CONDENSATE PIPING - DRAW THRU AHU
NO SCALE

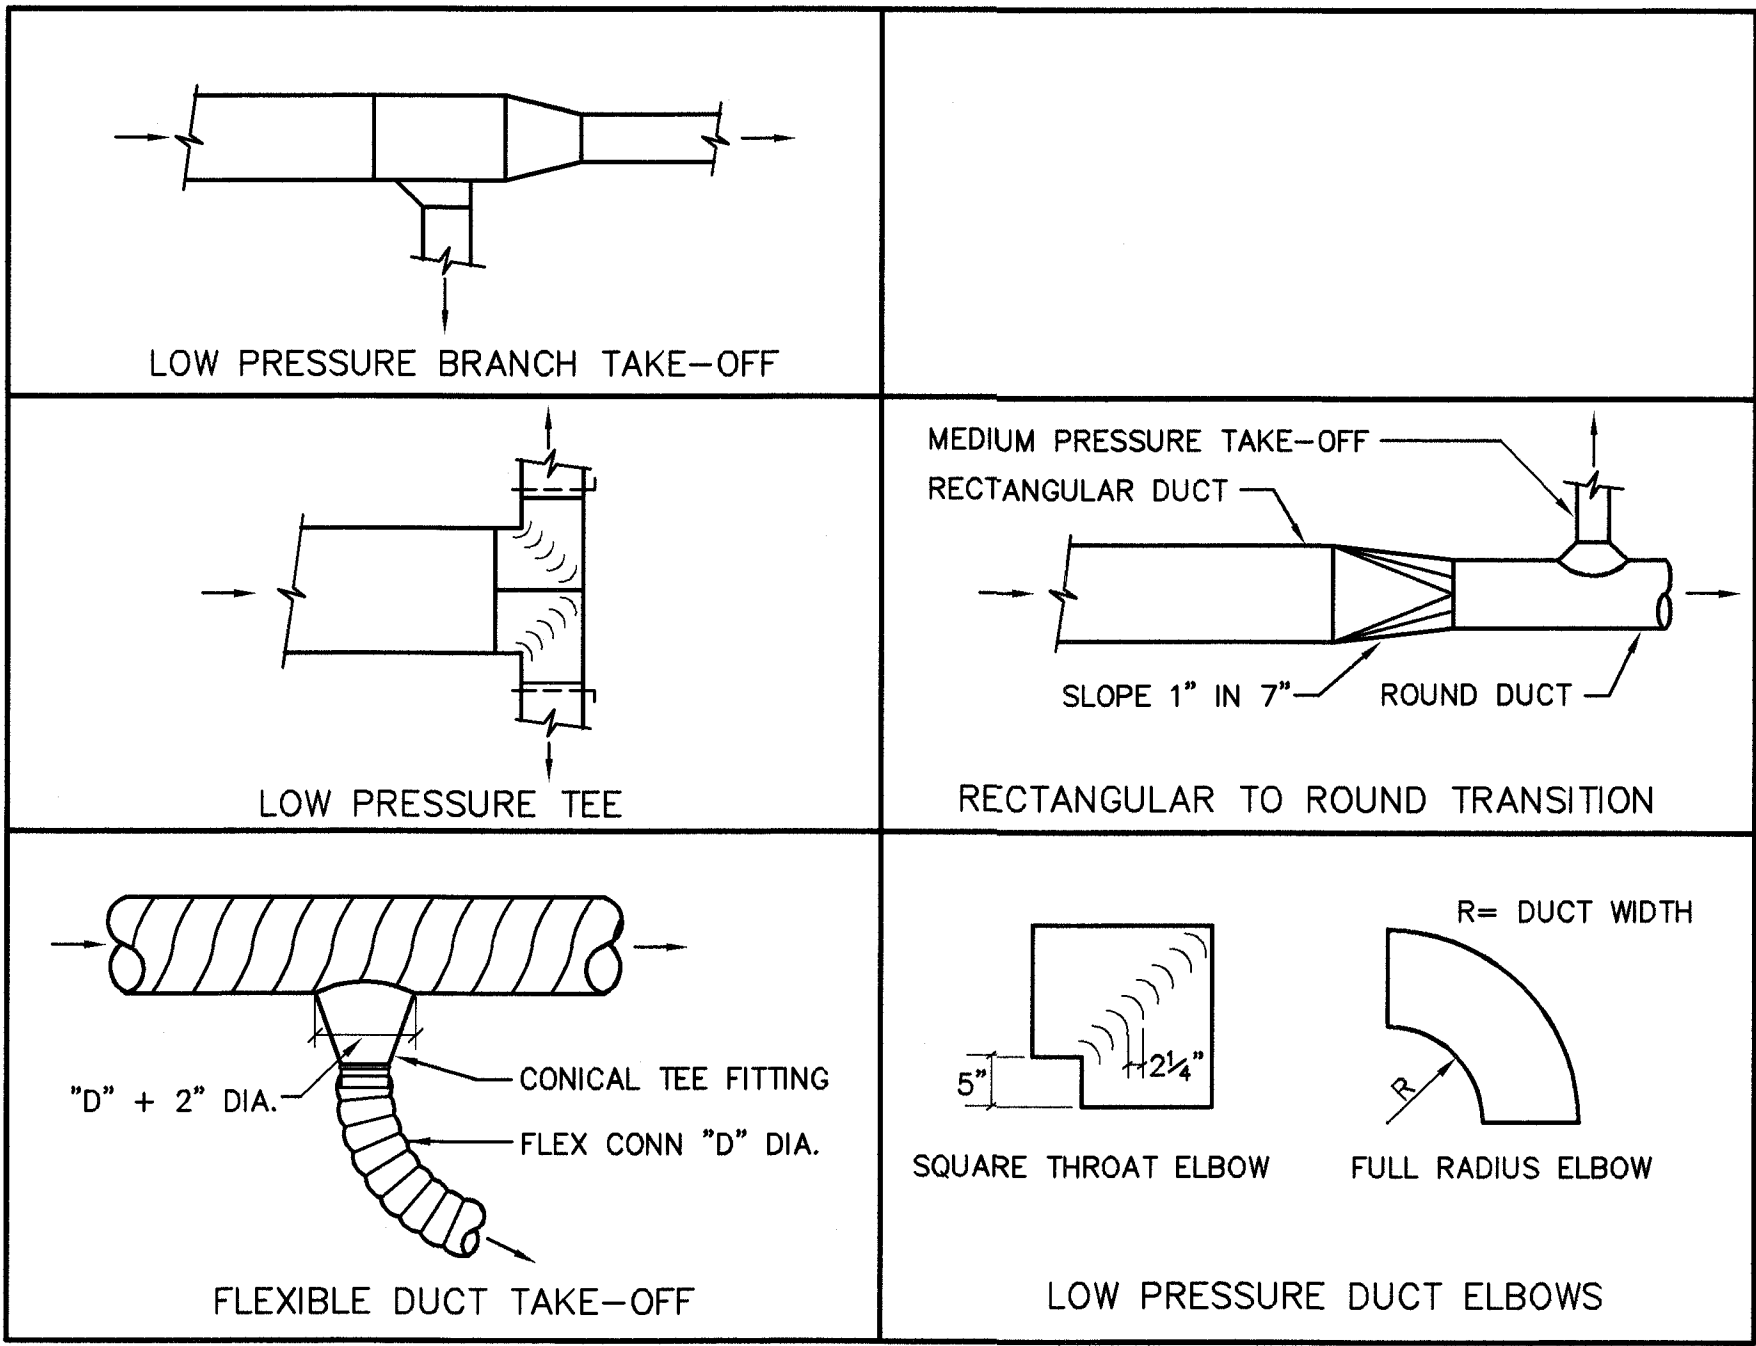


5
M2
DUCT FITTINGS
NO SCALE

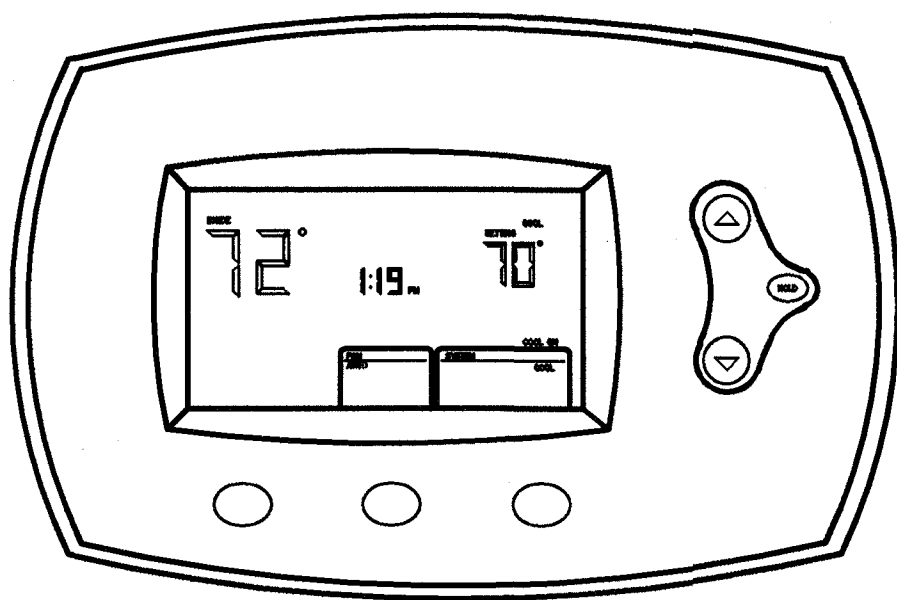


NOTES:
1. DIGITAL AND PROGRAMMABLE.
2. ADAPTIVE RECOVERY
3. HEAT PUMP OPERATION


2
M2
DIGITAL/PROGRAMMABLE THERMOSTAT (TYP)
NO SCALE

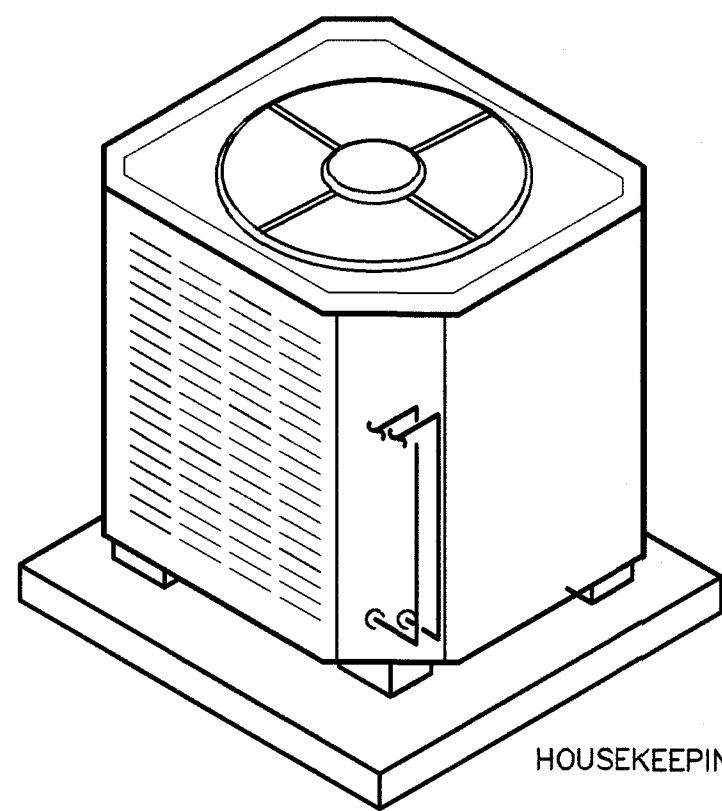

3
M2
TYPICAL OUTDOOR HEAT PUMP
NOT TO SCALE:

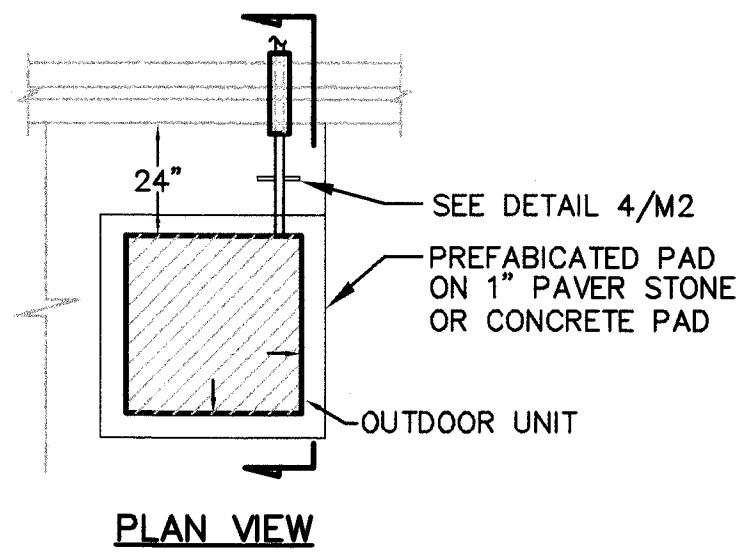

LEAVE A NOMINAL 1/4" SPACE AT PIPING FACE AND FILL WITH CLOSED CELL NEOPRENE FOAM INSULATION TO PROVIDE BACKING FOR SILICONE CAULKING

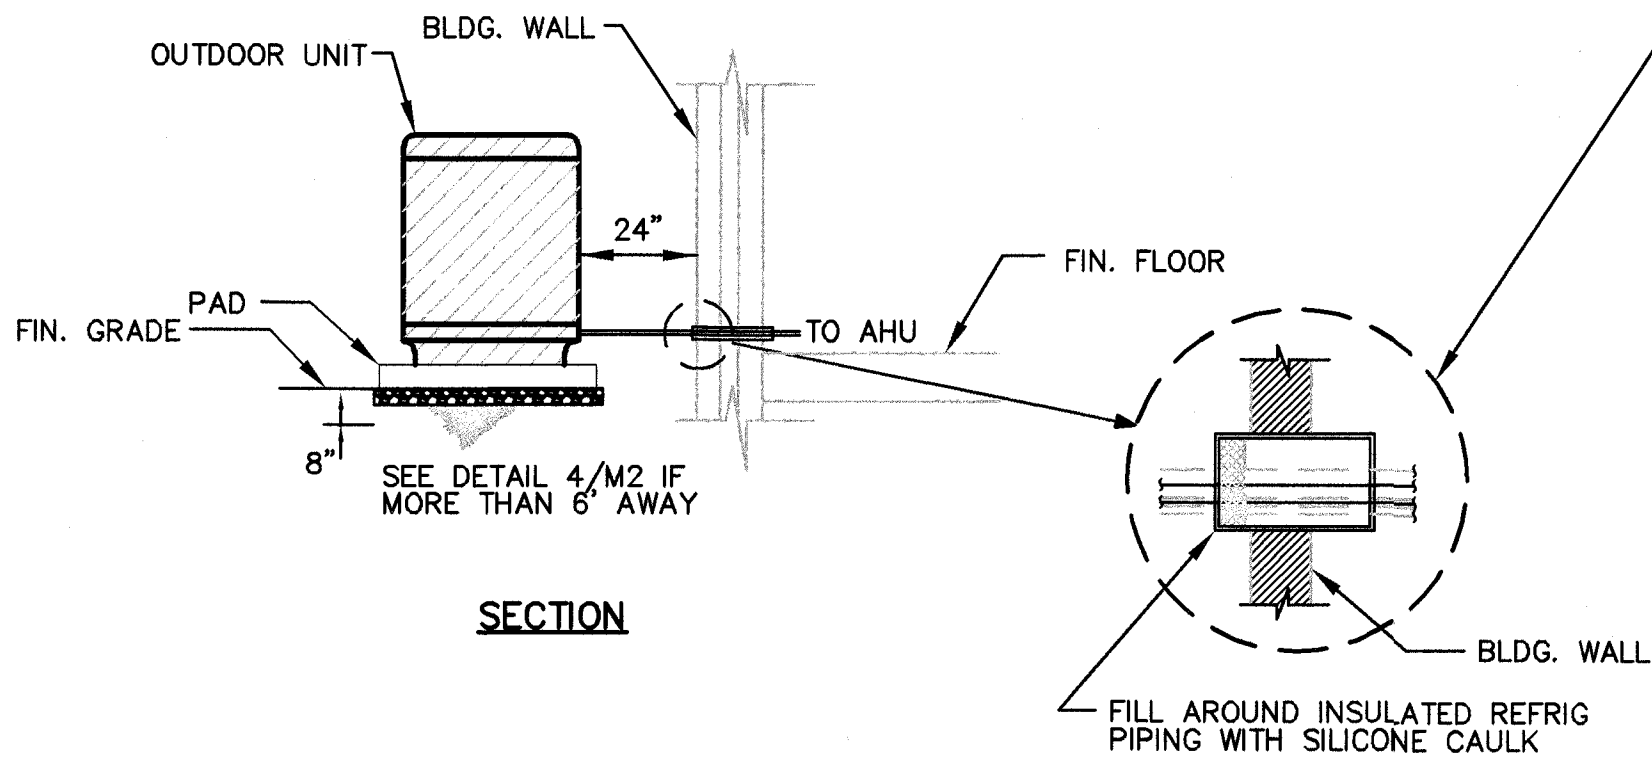

6
M2
OUTDOOR CONDENSING UNIT AND REFRIGERANT PIPING
NOT TO SCALE:

RENOVATION/ADDITION TO POOL BUILDING FOR:


CAMP AGAPE

1369 TYLER DEWAR LN
FUQUAY VARINA, NORTH CAROLINA 27526

PROJECT NO: 2430
DATE: 11/19/24
CAD DWG FILE: M_2430
DRWN BY:WHCCHKD BY:WHC

HVAC
DETAILS

M2

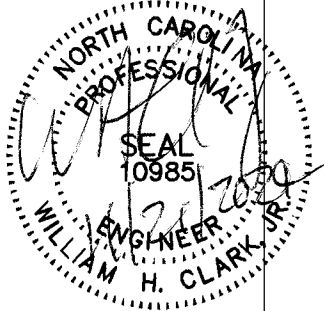

whcPE

WILLIAM H. CLARK, JR., PE
4732 PORCHAVEN LN, APEX, NC 27539
PHONE: 919-740-3826 WHCLARK2001@GMAIL.COM

This drawing and the design shown are the property of WILLIAM H. CLARK, JR., PE. The reproduction, copying or other use of this drawing without our written consent is prohibited. Copyright 2024 William H. Clark, Jr., PE.

ELECTRICAL SPECIFICATIONS	
<p>GENERAL: THESE PERMIT DRAWINGS DESCRIBE DIAGRAMMATICALLY, AND IN GENERAL TERMS, THE INTENDED SCOPE OF WORK AS UNDERSTOOD BY THE ENGINEER. THE ENGINEER CREATED THE DRAWINGS, INCLUDING PLANS, DIAGRAMS, SPECIFICATIONS, AND NOTES, FOR THE EXPRESS PURPOSE OF DESCRIBING THE PROJECT TO THE LOCAL INSPECTIONS AUTHORITY'S PLANS REVIEW STAFF FOR THEIR USE IN GRANTING A BUILDING PERMIT.</p> <p>THE CONTRACTOR SHALL BE RESPONSIBLE FOR FULLY UNDERSTANDING THE ACTUAL FIELD CONDITIONS OF THE PROJECT SITE AND THE SCOPE OF WORK AS EXPRESSED BY THE PARTY TO WHOM THE CONTRACTOR HAS CONTRACTED TO PERFORM THE WORK. THEREFORE, THE CONTRACTOR SHALL REVIEW THESE DOCUMENTS THOROUGHLY FOR ALL CONFLICTS, AND FOR ANY ASPECT OF THE WORK SHOWN IN THESE DOCUMENTS THAT IS AT VARIANCE WITH THE CONTRACTOR'S UNDERSTANDING OF THE WORK. THE CONTRACTOR SHALL PERFORM ALL WORK NECESSARY TO COMPLETE THE FACILITY OWNER'S INTENDED SCOPE OF WORK FOR THE PROJECT.</p> <p>THE CONTRACTOR SHALL PERFORM ALL WORK ACCORDING TO ALL RELEVANT CODES, ALL REFERENCED STANDARDS, AND THE MOST CURRENT INTERPRETATIONS OF THE CODE AS STATED BY THE AUTHORITY HAVING JURISDICTION. IF ANYTHING IS NECESSARY FOR THE COMPLETE, PROPER, AND SAFE INSTALLATION, OPERATION, AND FUNCTION OF THE WORK DESCRIBED IN THESE DOCUMENTS, THE CONTRACTOR SHALL PROVIDE IT EVEN IF NOT CLEARLY INDICATED IN THESE DOCUMENTS.</p> <p>SUPPLEMENT THESE CONTRACT DOCUMENTS WITH ALL DETAILS OF CONSTRUCTION; ALL MATERIAL, DEVICE, AND EQUIPMENT INSTALLATION INSTRUCTIONS; ANY NEEDED MANUFACTURER, SUPPLY HOUSE, AND VENDOR ASSISTANCE; SHOP DRAWINGS, AND FIELD INSTALLATION DRAWINGS NECESSARY TO COMPLETE THE PROJECT.</p> <p>DETERMINE THE ACTUAL FIELD CONDITIONS AND INSTALLATION DETAILS. FULLY COORDINATE EVERY DEVICE AND EQUIPMENT AND THE RESPECTIVE LOCATIONS FOR EQUIPMENT, DEVICES, AND MATERIALS AMONG ALL CONTRACTOR TRADES AND WITH THE OWNER, IF NECESSARY. INSTALL EVERY PIECE OF EQUIPMENT AND ALL CONTROL DEVICES WITH ALL CODE--REQUIRED AND MANUFACTURER--RECOMMENDED SERVICING CLEARANCES, FREE OF OBSTRUCTIONS, AND WITHOUT CONFLICT WITH OTHER EQUIPMENT OR BUILDING ELEMENTS.</p> <p>CONTRACTOR COORDINATION AND PRICING: VISIT THE SITE OF THIS PROJECT AS OFTEN AS NECESSARY TO BECOME THOROUGHLY FAMILIAR WITH ALL EXISTING FIELD CONDITIONS AND THE FULL EXTENT OF THE WORK TO BE PERFORMED. VERIFY EVERY ASPECT OF THE PROPOSED WORK AS DESCRIBED OR IMPLIED BY THESE CONTRACT DOCUMENTS PRIOR TO SUBMITTING A PRICE FOR THIS WORK.</p> <p>USE THESE DRAWINGS, THE INFORMATION OBTAINED FROM SITE VISITS, AND OWNER INPUT TO DETERMINE PRICE. BECAUSE CURRENT CODES REQUIREMENTS BASED UPON INTERPRETATIONS WILL VARY FROM JURISDICTION TO JURISDICTION,</p> <p>REVISE ANY ORIGINAL PRICING PRESENTED PRIOR TO THE CONTRACTOR'S RECEIPT OF THESE DRAWINGS TO SHOW ALL ADJUSTMENTS TO THE PRICE. THE CONTRACTOR'S RISK INCLUDES ANY COST INCURRED PRIOR TO OBTAINING ALL CLARIFICATIONS TO THESE DOCUMENTS, OR TO THE DESIGNER'S OR OWNER'S INTENT.</p> <p>THE ENGINEER DID NOT INDEPENDENTLY VERIFY ALL EXISTING FIELD CONDITIONS. DETERMINE ALL MISSING INFORMATION RELEVANT TO THE PERMITTED WORK. TAKE ACTUAL FIELD MEASUREMENTS AT THE JOB SITE INSTEAD OF SCALING THE DRAWINGS. THE SYMBOLS AND DIAGRAMS SHOWN HAVE NO DIMENSIONAL SIGNIFICANCE AND DO NOT SHOW EVERY APPURTENANCE NECESSARY FOR A COMPLETE INSTALLATION AND CONFIGURATION. THE DRAWINGS SHOW APPROXIMATE LOCATIONS FOR ALL EQUIPMENT, DEVICES, AND MATERIALS. DETERMINE FINAL LOCATIONS IN THE FIELD BASED UPON ACTUAL CONSTRUCTION.</p> <p>BRING ALL CONTRACT DOCUMENT--RELATED OMISSIONS, DISCREPANCIES, AND CONFLICTS TO THE ENGINEER'S ATTENTION PRIOR TO COMMENCING WORK AND INCURRING ANY COSTS FOR LABOR OR MATERIALS. WHERE THE ENGINEER HAS NO POST--DESIGN AND CONSTRUCTION ASSISTANCE RESPONSIBILITIES TO THE PROJECT, TAKE ALL FIELD--DISCOVERED CONFLICTS AND INTERFERENCES TO THE GENERAL CONTRACTOR'S ATTENTION FOR RESOLUTION BY THE RESPECTIVE TRADES.</p> <p>SUBMIT ALL REQUESTS FOR INFORMATION (RFI) WITH WRITTEN COMMENTS DEFINING THE INFORMATION AND ASSISTANCE NEEDED. DOCUMENT THE REQUEST WITH RELEVANT INFORMATION FROM THE PLANS AND SPECIFICATIONS.</p> <p>INFORM THE ENGINEER OF ANY DEVIATIONS MADE FROM THE PERMITTED DRAWINGS.</p> <p>QUALIFICATIONS AND STANDARDS OF WORKMANSHIP: PERFORM ALL WORK USING EXPERIENCED, SKILLED CRAFTSMEN LICENSED IN THEIR RESPECTIVE TRADES, AND COMPETENT TO PERFORMED THE WORK INVOLVED WITH THIS PROJECT.</p> <p>ALL WORK AND MATERIALS SHALL CONFORM TO THE APPLICABLE LOCAL, STATE, AND NATIONAL CODES (INCLUDING OSHA). AS THE ABSOLUTE MINIMUM ACCEPTABLE QUALITY STANDARD, COMPLY WITH THE LATEST EDITION OF THE NORTH CAROLINA STATE BUILDING CODE AND THESE SPECIFICATIONS.</p> <p>DEMOLITION: REMOVE ALL EXISTING EQUIPMENT, DEVICES, AND MATERIALS NOT INTENDED TO REMAIN AND OBSTRUCTING NEW WORK. MECHANICALLY SECURE ALL ABANDONED EXISTING EQUIPMENT, FIXTURES, VALVES, DEVICES, PIPING, TUBING, ETC. WHEN DEMOLISHING PIPING, CONDUITS, WIRING, AND CABLING,</p> <p>MATERIALS AND METHODS: PROVIDE ALL CUTTING AND PATCHING NECESSARY TO PROPERLY INSTALL ALL WORK. FOR WORK IN--PROGRESS, LEAVE IN SAFE CONDITION ALL FLOORS, WALLS, CEILINGS, FINISH MATERIALS, OR ANY PART OF THE BUILDING OR PREMISES THAT MUST BE CHANGED OR REPLACED. REPAIR ANY DAMAGE DONE TO EXISTING EQUIPMENT, DEVICES, OR MATERIALS.</p> <p>DO NOT CUT, NOTCH, OR BORE A FRAMING MEMBER IN EXCESS OF LIMITATIONS SPECIFIED IN THE CODE. DO NOT CUT, NOTCH, OR BORE ANY STRUCTURAL BEAMS AND COLUMNS UNDER ANY CIRCUMSTANCES.</p> <p>MATERIAL AND PRODUCT STANDARDS: PROVIDE ONLY NEW MATERIALS, DEVICES, FIXTURES, AND EQUIPMENT LISTED AND LABELED (FOR THE USE INTENDED) BY AN APPROVED THIRD PARTY LABORATORY SERVICE APPROVED BY THE STATE, SUCH AS UNDERWRITER'S LABORATORIES, INC, CSA, ETL AND OTHERS. DO NOT USE UNLISTED AND UNLABELED PRODUCTS.</p> <p>PROVIDE APPROPRIATELY LABELED AND APPROPRIATELY RATED EQUIPMENT ENCLOSURES AND PRODUCTS FOR EACH LOCATION. USE PROVIDE NEMA 3R OR BETTER AND/OR WET LOCATION LABELED ENCLOSURES FOR ALL EQUIPMENT AND PRODUCTS INSTALLED ANYWHERE OUTDOORS OR AT INDOOR WASH--DOWN LOCATIONS.</p> <p>UTILITY AND BUILDING OWNER'S REPRESENTATIVE COORDINATION: COMPLY WITH ALL MUNICIPAL, STATE, AND/OR UTILITY REGULATIONS FOR SERVICE CONNECTIONS AND METERING PROVISIONS. FULLY COORDINATE WITH THE POWER, TELEPHONE, AND CATV UTILITIES TO PROVIDE SERVICES TO THE FACILITY. PROVIDE ANY NECESSARY UNDERGROUND PIPES, SLEEVES, AND OTHER PROVISIONS REQUESTED BY THE UTILITY. THE OWNER WILL PAY FOR ALL SERVICE CONNECTION, LINE EXTENSION, AND IMPACT FEES DIRECTLY TO THE APPROPRIATE UTILITY OR JURISDICTION.</p> <p>PROVIDE TEMPORARY SERVICES AS NECESSARY TO SUPPORT ALL CONSTRUCTION ACTIVITIES.</p> <p>SUBMITTALS AND TESTING: SUBMIT A LIST OF ALL ELECTRICAL EQUIPMENT, FIXTURES, AND DEVICES MATCHING THE ENGINEER'S BASIS OF DESIGN. SUBMIT ELECTRONIC SHOP DRAWINGS AND CATALOG DATA FOR ALL ELECTRICAL EQUIPMENT, LIGHT FIXTURES, DEVICES, AND MATERIALS THAT DO NOT.</p> <p>RETAIN ALL INSTALLATION INSTRUCTIONS, MANUFACTURER'S PACKING DOCUMENTS, ETC., FOR ALL LIFE SAFETY RELATED EQUIPMENT AS EVIDENCE TO THE AUTHORITY HAVING JURISDICTION THAT THE CORRECT MATERIALS AND DEVICES WERE USED IN THE CONSTRUCTION, PENETRATION, AND SEALING OF PENETRATION IN ALL RATED ASSEMBLIES.</p> <p>CONFORM TO ALL LOCAL, STATE, AND NATIONAL CODES, AND WITH THE REQUESTS OF THE LOCAL INSPECTOR FOR TESTS AND COMPONENT TESTING. CONTRACTOR SHALL PAY THE FULL COST OF ANY DESTRUCTIVE TESTING NECESSARY TO DEMONSTRATE COMPLIANCE WITH THESE DRAWINGS AND CODE.</p> <p>AS A MINIMUM, TURN "ON" AND "OFF", SWITCH, CHANGE MODES, AND VERIFY SEQUENCES OF OPERATION FOR ALL DEVICES, EQUIPMENT, AND SYSTEMS TO DEMONSTRATE PROPER INSTALLATION AND SATISFACTORY OPERATION.</p> <p>PERMITS, WARRANTY AND INSPECTIONS: OBTAIN AND PAY FOR ANY AND ALL REQUIRED PERMITS, INSPECTIONS, CERTIFICATES OF INSPECTIONS AND APPROVAL, AND THE LIKE AND SHALL DELIVER SUCH CERTIFICATES TO THE OWNER. NOTIFY THE ARCHITECT AND ENGINEER OF ALL SCHEDULED INSPECTIONS.</p> <p>WARRANT ALL MATERIALS, EQUIPMENT, AND WORKMANSHIP SHOWN OR IMPLIED BY THESE DOCUMENTS TO BE FREE OF DEFECTS FOR A PERIOD OF ONE YEAR, STARTING FROM THE TIME OF ACCEPTANCE BY THE BUILDING OWNER. IF WITHIN ONE YEAR AFTER THE ACCEPTANCE DATE ANY WORK OR EQUIPMENT IS FOUND TO BE DEFECTIVE, CORRECT IT PROMPTLY AT NO COST TO THE BUILDING OWNER.</p> <p>SCOPE OF WORK: PROVIDE ALL WORK, EQUIPMENT, SERVICES, LABOR, AND MATERIALS NECESSARY TO INSTALL COMPLETE AND FULLY FUNCTIONAL ELECTRICAL SYSTEMS AS DESCRIBED OR IMPLIED BY THE CONTRACT DOCUMENTS.</p> <p>CONDUITS: PROVIDE 1/2" MINIMUM SIZE, ZINC--COATED EMT CONDUIT, EXCEPT IN WET, DAMP, OR WASHDOWN AREAS. PROVIDE ZINC--COATED RIGID STEEL (GRS) OR IMMEDIATE METALLIC CONDUIT (IMC) FOR THOSE AREAS.</p> <p>PROVIDE STEEL, SET SCREW OR COMPRESSION TYPE, EMT FITTINGS.</p> <p>PROVIDE STEEL COMPRESSION TYPE FLEXIBLE CONDUIT CONNECTORS.</p> <p>SECURE CONDUITS USING MANUFACTURED, GALVANIZED STRAPS. DO NOT USE THE WIRE.</p> <p>ROUTE ALL CONDUIT CONGEALED (WHERE POSSIBLE) ABOVE CEILINGS, IN WALLS OR CASEWORK, OR BELOW GRADE. ROUTE ALL CONDUITS PARALLEL OR PERPENDICULAR TO STRUCTURAL ELEMENTS AND IN GROUPS. PROVIDE SINGLE DEPTH AND TIGHT AGAINST THE STRUCTURE. GROUPINGS WHEN INSTALLING INSTALLING CONDUITS AT THE ROOF OR CEILING.</p>	<p>USE RIGID NONMETALLIC CONDUIT ONLY FOR THE SECONDARY UNDERGROUND SERVICE, THE UNDERGROUND TELEPHONE SERVICE CONDUIT, AND BRANCH CIRCUITS AND TELEPHONE SYSTEM CONDUITS LOCATED BELOW THE CONCRETE FLOOR SLAB ON GRADE OR BURIED ON THE EXTERIOR OF THE BUILDING. PROVIDE SCHEDULE 40 MINIMUM POLYVINYL CHLORIDE (PVC) RACEWAYS UL LISTED FOR USE WITH 75C CONDUCTORS. INSTALL ALL RACEWAYS PER ALL CODES, THE UTILITY COMPANY REGULATIONS, AND THE MANUFACTURER'S INSTRUCTIONS.</p> <p>PROVIDE ALL OF THE PVC CONDUIT SYSTEM COMPONENTS FROM THE SAME MANUFACTURER. PROVIDE PRODUCTS SPECIFICALLY LISTED AND LABELED FOR THE INTENDED USE. MAKE ALL FIELD BENDS ACCORDING TO THE MANUFACTURER'S INSTRUCTIONS AND UL REQUIREMENTS. REPLACE ANY PVC COMPONENTS HEATED WITH A TORCH. PVC SHALL NOT PENETRATE SLAB ON GRADE FOR ANY REASON; USE GRS OR IMC CONDUIT FOR ALL SLAB PENETRATIONS.</p> <p>PROVIDE PULL CORDS IN ALL EMPTY CONDUITS.</p> <p>IN CONCRETE AND METAL INTERIOR CONSTRUCTION, PROVIDE GALVANIZED STEEL OUTLET BOXES.</p> <p>PROVIDE CAST BOXES WITH GASKETED COVERS IN ALL INTERIOR WET AREAS AND ON THE EXTERIOR OF THE BUILDING.</p> <p>USE OUTLET BOXES SIZES NO LESS THAN 4"x2"x2" DEEP. VERIFY ALL ELECTRICAL BOX MODEL NUMBERS CONFORM TO THE LISTING OF APPROVED MODEL NUMBERS GIVEN IN THE RESPECTIVE UL STANDARD.</p> <p>WIRING: PROVIDE COPPER, SOLID, THHN/THWN, CONDUCTOR SIZES #10 AWG OR #12 AWG. IT IS ACCEPTABLE TO PROVIDE STRANDED ALUMINUM CONDUCTORS FOR ALL LARGER SIZES; HOWEVER, WHERE NOT SPECIFICALLY SHOWN ON THE DRAWINGS, ASSUME THE DESIGN SHOWS COPPER CONDUCTORS. ALSO, SOME HVAC EQUIPMENT MAY REQUIRE COPPER CONDUCTORS OR COPPER CONDUCTOR CONNECTIONS IN LARGER SIZES. CONTROL CIRCUIT CONDUCTORS MAY BE #14 AWG SOLID COPPER. INSTALL ALL INDIVIDUAL POWER AND CONTROLS CONDUCTORS IN CONDUITS.</p> <p>FOR BRANCH CIRCUITS USING MC CABLE, PROVIDE APPROVED CONNECTORS. IN PATIENT CARE AREAS, "HOSPITAL GRADE" TYPE MC CABLES WITH THE REDUNDANT GROUND.</p> <p>USE TYPE NM ROMEX CABLING WHERE APPROVED BY THE LOCAL AUTHORITY AND NOT PART OF A "PLACE OF ASSEMBLY".</p> <p>USE TYPE SER OR TYPE MC ALUMINUM SERVICE ENTRANCE CABLES FOR ALL DWELLING UNIT LOAD CENTERS. PROVIDE TYPE MC CABLES IN LIEU OF SER CABLES IN TYPE 1 AND TYPE 2 CONSTRUCTION. PREPLAN AND VERIFY TYPE SER AND MC CABLE ROUTES PRIOR TO INSTALLATION.</p> <p>CONTROLS WIRING FOR EQUIPMENT PROVIDED BY THE ANOTHER TRADE SHALL BE PROVIDED BY THE TRADE FURNISHING THE EQUIPMENT IN STRICT ACCORDANCE WITH THESE SPECIFICATIONS.</p> <p>ALL 240/120 VAC CONDUCTORS SHALL BE COLOR--CODED BLACK, RED, WHITE, AND GREEN FOR PHASES A, B, NEUTRAL, AND GROUND RESPECTIVELY.</p> <p>FULLY COORDINATE WITH THE OTHER TRADES TO DETERMINE THE POWER REQUIREMENTS AND CONNECTION POINTS FOR EQUIPMENT FURNISHED BY OTHERS. PROVIDE ELECTRICAL POWER TO EACH PIECE OF EQUIPMENT BASED UPON THE MANUFACTURER'S WIRING DIAGRAMS AND UNIT MOUNTED NAMEPLATES.</p> <p>VERIFY THAT THE ELECTRICAL CHARACTERISTICS OF EACH CIRCUIT ENERGIZING THE EQUIPMENT.</p> <p>TEST ALL ALL CONDUCTORS AND CABLES FOR CONTINUITY AND GROUND BEFORE ENERGIZING. REPLACE ALL FAULTY CONDUCTORS.</p> <p>GROUND THE CONDUIT AND NEUTRAL CONDUCTORS OF THE ELECTRICAL SYSTEM WITH ALL INSTALLED GROUNDING ELECTRODE SYSTEMS CONFORMING TO NEC 250. BOND THE ELECTRICAL SERVICE TO ALL OTHER SYSTEMS AND PIPING WHICH MIGHT BECOME ENERGIZED. THESE WOULD INCLUDE THE TELEPHONE, CATV, DATA, GAS AND OTHER METALLIC PIPING SYSTEMS.</p> <p>THE CONDUIT SYSTEM AND NEUTRAL CONDUCTORS SHALL BE BONDED TOGETHER ONLY AT THE SERVICE ENTRANCE EQUIPMENT. GROUNDING AT THE SERVICE ENTRANCE SHALL COMPLY WITH NEC ARTICLE 250.</p> <p>PROVIDE AN INSULATED EQUIPMENT GROUNDING CONDUCTOR IN EVERY NON--SERVICE RACEWAY SIZED FOR THE CIRCUIT(S) CONTAINED.</p> <p>DEVICES: PROVIDE COMMERCIAL SPECIFICATION GRADE RECEPTACLES. THE COLOR SHALL BE SELECTED BY THE ARCHITECT FROM THE MANUFACTURER'S STANDARD COLORS. PROVIDE NEMA 5--20R RECEPTACLES UNLESS OTHERWISE NOTED.</p> <p>PROVIDE QUIET OPERATING SWITCHES RATED FOR THE CIRCUIT VOLTAGE AND 20A.</p> <p>IN WET LOCATIONS, PROVIDE GFCI TYPE RECEPTACLES, EXTERIOR BOXES WITH GASKETS, AND WEATHERPROOF EXTRA--DUTY, "IN--USE" COVERS.</p> <p>FOR EXTERIOR AND INTERIOR DAMP LOCATIONS AND ABOVE COUNTERS NEAR SINKS, PROVIDE GFCI RECEPTACLES WITH APPROPRIATE COVER PLATE.</p> <p>PROVIDE A SINGLE MULTI--GANG BOX AND DEVICE PLATE FOR ALL GROUP--MOUNTED WIRING DEVICES.</p> <p>PROVIDE PLASTIC TYPE COVERPLATES. PROVIDE "IN--USE" COVERS FOR ALL EXTERIOR RECEPTACLES.</p> <p>POWER EQUIPMENT: PROVIDE DEAD--FRONT SAFETY TYPE LOAD CENTER, WALL--MOUNTED WITH FULL HEIGHT, ALUMINUM BUSSING, NOMINAL 20 INCHES WIDE CABINET, HINGED/LOCKABLE DOOR, AND PANEL DIRECTORY.</p> <p>PROVIDE MOLDED CASE, BOLT--ON (OR PLUG--IN FOR LOAD CENTERS) CIRCUIT BREAKERS WITH AUTOMATIC THERMAL MAGNETIC OPERATION, CALIBRATED FOR 40C, OR AMBIENT COMPENSATING. PROVIDE MULTIPLE--POLE BREAKERS WITH A COMMON TRIP FOR 2 OR MORE BRANCH CIRCUITS HAVING DEVICES OR EQUIPMENT ON THE SAME YOKE.</p> <p>PROVIDE GROUND FAULT PROTECTED (GPE) BREAKERS WHERE REQUIRED BY CODE (NEC 210.13 AND 230.95). IN PARTICULAR, PROVIDE TYPE GPE BREAKERS FOR HOT BOXES AND INACCESSIBLE RECEPTACLE LOCATIONS REQUIRING GROUND FAULT PROTECTION.</p> <p>PROVIDE GENERAL DUTY, QUICK--MAKE, QUICK--BREAK, TYPE SAFETY SWITCHES OF THE SIZE AND FUSE AMPACITY AS DENOTED ON THE DRAWINGS. PROVIDE GROUND BUS, SOLID NEUTRAL (WHEN CIRCUIT HAS A NEUTRAL), CLASS RK--5 DUAL ELEMENT TIME DELAY FUSES, REJECTION TYPE FUSE HOLDERS, AND NEMA RATED ENCLOSURE.</p> <p>PROVIDE ASTRONOMICAL TYPE TIME SWITCHES WITH NEMA 1 ENCLOSURE. SWITCH FUNCTION SHALL INCLUDE ADJUSTABLE COMBINATION 7--DAY AND SEASONAL DAYLIGHT PROGRAM SCHEDULES WITH AT LEAST 10 HOURS RESERVE POWER TO RETAIN PROGRAMMING DURING POWER OUTAGES.</p> <p>PROVIDE LUGS, TERMINALS, AND ENCLOSURES FOR POWER EQUIPMENT RATED FOR 75C CONDUCTORS.</p> <p>LIGHTING EQUIPMENT: PROVIDE ALL LIGHT FIXTURES COMPLETE WITH LAMPS, ALL NECESSARY ACCESSORIES, AND AS DESCRIBED ON THE DRAWINGS. COORDINATE ALL CONSTRUCTION DETAILS SUCH AS PROPER FIXTURE TRIM WITH CEILING CONSTRUCTION. PROVIDE LED DRIVERS FOR ALL LED FIXTURES AND LED REPLACEMENT LAMPS FOR ALL INCANDESCENT FIXTURES.</p> <p>OTHER REQUIREMENTS: LABEL THE SERVICE DISCONNECT, PANEL, EQUIPMENT, AND EQUIPMENT DISCONNECTS. PROVIDE PRINTED POWER EQUIPMENT DIRECTORIES.</p> <p>PROVIDE A PERMANENT PLAQUE WITH THE CALCULATED FAULT CURRENT FOR THE BUILDING.</p> <p>MARK BOXES WITH CIRCUIT NUMBERS FOR CONDUCTORS CONTAINED WITHIN THE BOX.</p> <p>PROVIDE FUSES FOR ALL EQUIPMENT REQUIRING FUSES AND LAMPS FOR EVERY LIGHT FIXTURE.</p> <p>VERIFY THE GROUNDING OF ALL ELECTRICAL EQUIPMENT.</p> <p>FURNISH AND INSTALL ANY MISCELLANEOUS SUPPORTS, FASTENERS, MOUNTS, HANGERS, SIDE BRACES, ETC., NECESSARY TO SECURELY ANCHOR AND SUPPORT ELECTRICAL EQUIPMENT, RACEWAYS, AND CABLE BUNDLES. PROVIDE BLOCKING IN WALLS AND ADDITIONAL SUPPORTS IN CEILINGS WHERE LIGHT FIXTURES AND OTHER EQUIPMENT CANNOT BE SUPPORT BY GENERAL CONSTRUCTION.</p> <p>AT PROJECT CLOSEOUT, TEST ALL EQUIPMENT FOR PROPER OPERATION.</p> <p>PROGRAM ALL TIME SWITCH AND LIGHTING CONTROL EQUIPMENT SETTINGS. COORDINATE WITH THE ENGINEER--OF--RECORD OR DESIGNATED REPRESENTATIVE TO SET ALL ELECTRONIC OVERCURRENT DEVICES.</p> <p>DELIVER TO THE OWNER ALL ENGINEER--REVIEWED SHOP DRAWINGS, CUTSHEETS, OPERATIONS/ MAINTENANCE MANUALS FOR ALL POWER EQUIPMENT, LIGHT FIXTURES, AND LIGHTING CONTROLS DEVICES AND EQUIPMENT. PROVIDE OPERATING SEQUENCES FOR ALL LIGHTING CONTROL DEVICES.</p>

GENERAL ELECTRICAL NOTES:

- PREPLAN ALL WORK PRIOR TO PURCHASING, ORDERING, OR FABRICATING ANY PART OF THE WORK DESCRIBED BY THIS DRAWING.
- IMMEDIATELY NOTIFY THE ENGINEER OF ANY CONFLICTS WITH EXISTING FIELD CONDITIONS OR THE WORK OF OTHER TRADES.
- RESOLVE ALL CONFLICTS PRIOR TO INCURRING ANY MATERIAL OR LABOR EXPENSES.
- LOCATE EQUIPMENT GENERALLY AS SHOWN ON THE PLANS; HOWEVER, COORDINATE LOCATIONS WITH ACTUAL FIELD CONDITIONS TO OBTAIN ALL CODE--REQUIRED AND MANUFACTURER--REQUESTED SERVICE CLEARANCES.
- COMPLY WITH THE MANUFACTURER'S TECHNICAL INSTRUCTIONS WHEN INSTALLING EQUIPMENT, DEVICES, AND MATERIALS.
- PROVIDE ALL APPURTENANCES NECESSARY TO PROPERLY INSTALL EQUIPMENT, DEVICES, AND MATERIALS.
- WHERE RECEPTACLES ARE MOUNTED ABOVE COUNTERS, LOCATE RECEPTACLE CLOSEST TO CORNER OF ROOM SO THAT THE RECEPTACLE IS 3' OR MORE FROM CORNER TO MEET ADA REQUIREMENTS.
- COORDINATE THE EXACT LOCATIONS AND POINTS--OF--CONNECTION FOR EQUIPMENT FURNISHED BY OTHERS WITH THE RESPECTIVE TRADE AND/OR EQUIPMENT INSTALLER.
- VERIFY EACH LIGHT FIXTURE AGAINST THE ARCHITECT'S ROOM FINISHES AND RESOLVE ALL CONFLICTS BEFORE ORDERING LIGHT FIXTURES.
- COORDINATE WITH THE CEILING INSTALLER TO SECURELY SUPPORT THE WEIGHT OF ALL LIGHT FIXTURES FROM THE CEILING SYSTEM. USE APPROVED CLIPS TO CLAMP RECESSED, LAY--IN LIGHT FIXTURES TO THE CEILING GRID TO PREVENT MOVEMENT.
- EXIT SIGNS SHALL HAVE DIRECTIONAL ARROWS AS SHOWN ON THE DRAWING.
- CONNECT EXIT SIGNS AND EGRESS LIGHT FIXTURES DIRECTLY TO THE LOCAL LIGHTING CIRCUIT BUT AHEAD OF ANY SWITCHES OR DIMMERS. WHERE THE LOCAL LIGHTING CIRCUIT IS PHASE--PHASE, PROVIDE NEUTRAL CONDUCTOR FOR PHASE--NEUTRAL SIGNS AND EGRESS FIXTURES.
- ALL CONDUITS STUBBED THROUGH A WALL SHALL BE CAPPED OR SEALED WITH FOAM.
- ALL CONDUIT AND PIPING PENETRATIONS OF NONRATED ASSEMBLIES SHALL BE DRAFT--STOPPED USING DRYWALL COMPOUND AND OR MINERAL WOOL.
- ALL JUNCTION AND PULL BOXES SHALL BE SECURELY INSTALLED WITH COVERS INSTALLED
- INFORMATION TECHNOLOGY (IT) LOW VOLTAGE CABLING SHALL BE SECURED UP IN THE CEILING SPACE AND NOT LAID OVER TOP OF THE CEILING TILES.
- PROVIDE LOW TEMPERATURE LAMPS AND BALLASTS FOR FIXTURES INSTALLED IN ALL EXTERIOR LOCATIONS AND INTERIOR UNHEATED AREAS.
- STARTERS, CONTROLS, AND CONTROLS WIRING FOR EQUIPMENT FURNISHED BY OTHER TRADES SHALL BE PROVIDED BY THE TRADE FURNISHING THE EQUIPMENT UNLESS OTHERWISE NOTED ON THE ELECTRICAL DRAWINGS. THE ELECTRICAL TRADE SHALL WIRE THROUGH ANY LINE VOLTAGE CONTROLS DEVICES TO MAKE FINAL CONNECTIONS AT EQUIPMENT FURNISHED BY OTHERS.
- THE ELECTRICAL TRADE SHALL PROVIDE DISCONNECTS FOR ALL EQUIPMENT FURNISHED BY OTHERS. FUSE ALL DISCONNECTS AT THE EQUIPMENT NAMEPLATE MAXIMUM OVER CURRENT PROTECTION RATING (MOCPT). COORDINATE THE MOUNTING OF DISCONNECTS TO SIDES OF HVAC EQUIPMENT WITH THE HVAC TRADE SO AS TO MAINTAIN ACCESS TO THE EQUIPMENT.
- REFER TO PANEL SCHEDULE AND POWER RISER DIAGRAM FOR ALL CONDUIT, CONDUCTOR, AND CIRCUIT BREAKER SIZES.

ELECTRICAL LEGEND	
	CIRCUIT HOMERUN
	1x4 SURFACE MOUNTED LED FIXTURE
	4" FLUSH MOUNTED FIXTURE
	THREE--WAY SWITCH
	DUPLEX RECEPTACLE NEMA 5--20R. 'V' DENOTES VENDING.
	DUPLEX RECEPTACLE ABOVE COUNTER NEMA 5--20R
	DISCONNECT SWITCH
	TELEPHONE OUTLET -- 3/4" EMPTY CONDUIT WITH PULLSTRING STUBBED UP 6" ABOVE FINISHED CEILING
	SURFACE MOUNTED PANELBOARD
	EQUIPMENT CONNECTION. PROVIDE APPROVED DISCONNECTING MEANS PER NEC AND ACTUAL NAMEPLATE DATA. COORDINATE LOCATION AND TYPE OF CONNECTION WITH EQUIPMENT SUPPLIER.
	MANUAL MOTOR STARTER SWITCH W/ OVERLOADS
	MOTOR, NUMBER INDICATES HORSEPOWER "F" DENOTES FRACTIONAL HP LESS THAN 1/2
	GROUND FAULT CIRCUIT INTERRUPTER
	GROUND FAULT PROTECTED AT BREAKER
	WEATHER PROOF
	EXISTING


This drawing and the design shown are the property of WILLIAM H. CLARK, JR., P.E. The reproduction, copying or other use of this drawing without our written consent is prohibited. Copyright 2024 William H. Clark, Jr., P.E.

RENOVATION/ADDITION TO POOL BUILDING FOR:

PROJECT NO: 2430
DATE: 11/19/24
CAD DWG FILE: E_2430
DRWN BY:WHC CHKD BY:WHC

ELEC NOTES,
LEGEND,
SPECIFICATIONS,
SCHEDULES

E0

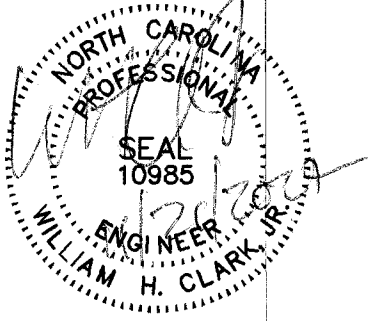

CAMP AGAPE



1369 TYLER DEWAR LN
FUQUAY VARINA, NORTH CAROLINA 27526

whcPE

WILLIAM H. CLARK, JR., PE
4732 PORCHAVEN LN., APEX, NC 27559

PHONE: 919-740-3826 WHCLARK2001@GMAIL.COM

LIGHTING FIXTURE SCHEDULE							
MARK	DESCRIPTION	LAMPS/ FIXTURE	LAMP TYPE	BALLAST TYPE	BALLAST/ FIXTURE	WATTS/ FIXTURE	NOTES
A	6" LED WAFER FIXTURE HALO HLBSL6099FS351EMWR	LED ARRAY	LED 3500K	LED DRIVER	1	12.5	793 LUMENS, IC RATED, WET LABEL SWITCHABLE COLOR, DIMMABLE EXCEPT FOR FIXTURES MARKED "EG"
B	4' LED LINEAR TRACK WITH ADJUSTABLE FIXTURES HAMPTON BAY 804679	LED ARRAY	LED 3500K	LED DRIVER	1	30	MAX 2400 W, COMPATIBLE WITH HAMPTON BAY LED 81 SERIES TRACK HEADS PROVIDE 3 HEADS FOR EACH TRACK
C	LED 4' ENCLOSED SURFACE MOUNT COMMERCIAL ELECTRIC WR4840K40LWL	LED ARRAY	LED 3500K	LED DRIVER	1	48	4000 LUMENS
D1	SURFACE MTD LED FIBERGLASS FIXTURE COLUMBIA LXEM4-35WV-RA-EDU	1	LED ARRAY	LED DRIVER	----	60	
D2	SURFACE MTD LED FIBERGLASS FIXTURE COLUMBIA LXEM4-35HL-RA-EDU	1	LED ARRAY	LED DRIVER	1	18	
F	LED 8' SUSPENDED ENCLOSED FIXTURE LITHONIA LL81000LM80CR35KEPDMIN10_MVOLT_WH	LED ARRAY	LED 3500K	LED DRIVER	1	79	10000 LUMENS, DIMMABLE TO 10% SUSPENDED AT 8'-6" AFF
							NOTES: 1. ALL BALLASTS SHALL HAVE A MINIMUM 90% POWER FACTOR RATING 2. SEE RCP NOTES ON ARCHITECT'S A400 DRAWING.

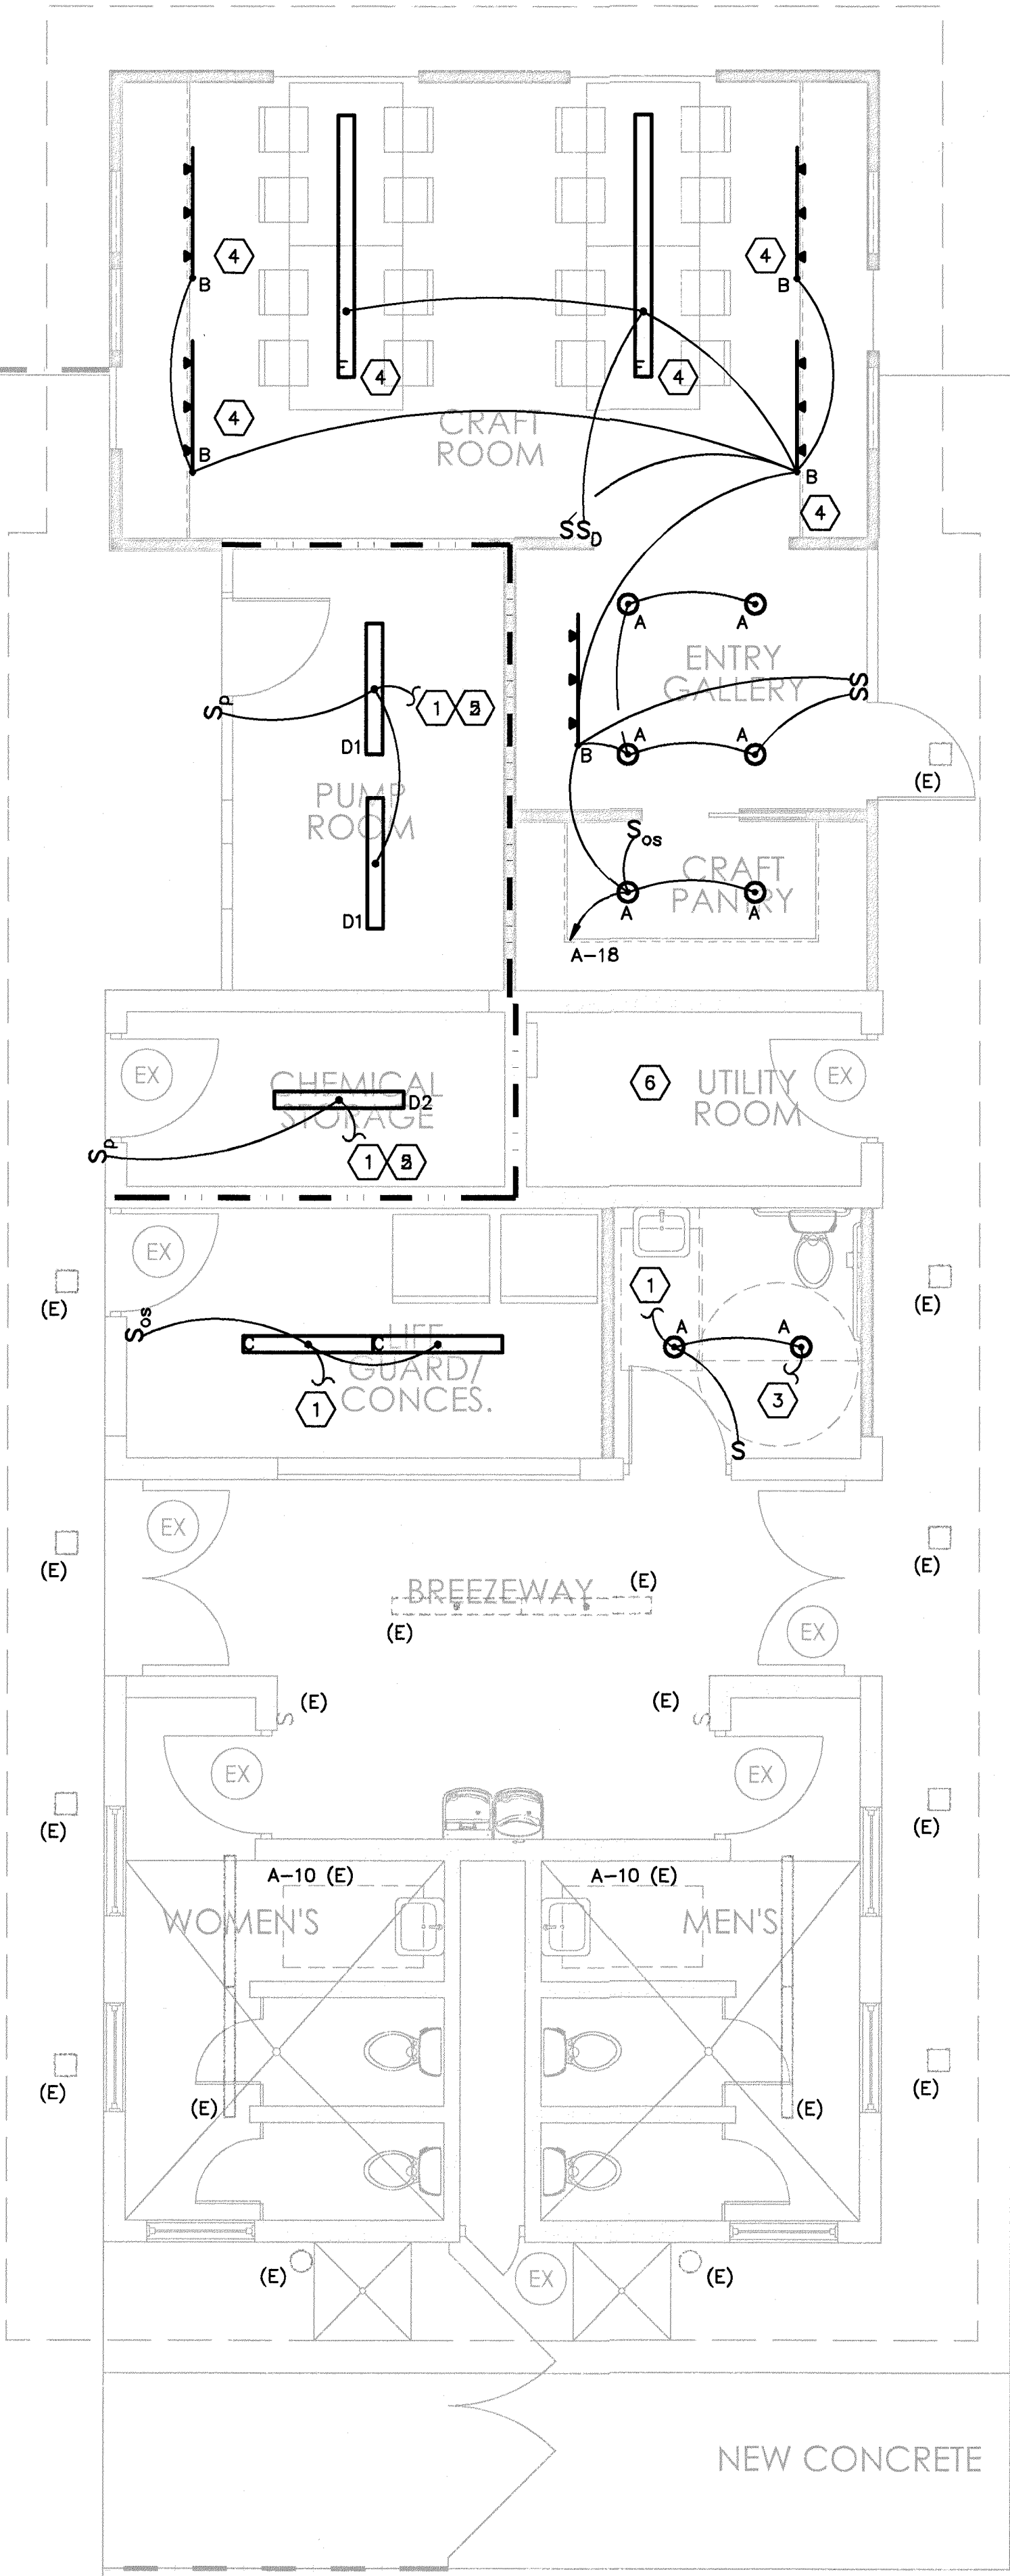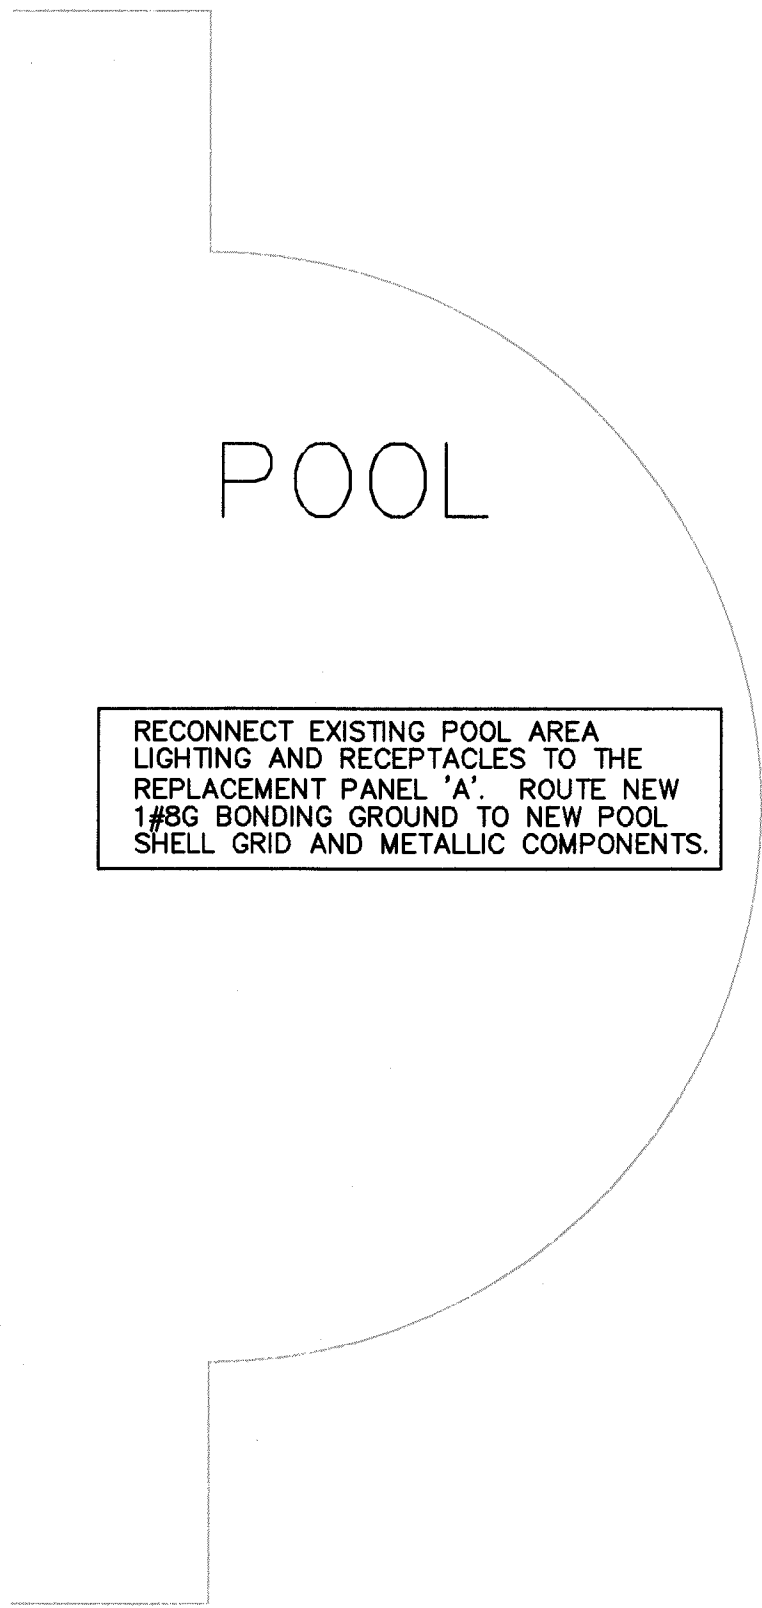

1 FLOOR PLAN - LIGHTING
1/4" = 1' - 0"

GENERAL LIGHTING NOTES:

- SEE GENERAL ELECTRICAL SPECIFICATIONS ON DRAWING E0.
- SEE GENERAL ELECTRICAL NOTES AND LEGEND ON DRAWING E0.
- INVESTIGATE ALL EXISTING WIRING TO REMAIN AND DETERMINE CONDITION. RECONNECT EXISTING WIRING TO THE NEW PANEL BY EXTENDING THE CIRCUIT WITH SAME SIZE CONDUCTORS AS NECESSARY. SEPARATE CIRCUITS WHERE APPROPRIATE TO CONFORM TO THE NEW PANEL SCHEDULE.

NOTES KEYED TO PLAN

- CONNECT TO EXISTING LIGHTING CIRCUIT IN VICINITY.
- SUBMIT A PENETRATION DETAIL FOR THE THRU-WALL PENETRATION AND SEALING OF THE CONDUITS IF EXISTING CIRCUIT IS OUTSIDE FIRE-RATED AREA.
- TO EXHAUST FAN CONTROLLED BY LIGHT SWITCH.
- SEE LIGHT FIXTURE SCHEDULE AND ARCHITECT'S RCP FOR MOUNTING HEIGHTS.
- COORDINATE FIXTURE LOCATIONS TO AVOID CONFLICTS WITH EQUIPMENT AND RACKS. COORDINATE WITH OWNER AND POOL INSTALLER TO CHOOSE LOCATIONS FOR MAXIMUM ILLUMINATION OF PRODUCTS AND EQUIPMENT TO BE MAINTAINED.
- NO LIGHTING CHANGES IN THIS ROOM.

RENOVATION/ADDITION TO POOL BUILDING FOR:

CAMP AGAPE
1369 TYLER DEWAR LN
FUQUAY VARINA, NORTH CAROLINA 27526

PROJECT NO: 2430
DATE: 11/19/24
CAD DWG FILE: E_2430
DRWN BY:WHCCHKD BY:WHC

**ELEC FLOOR
PLAN - LIGHTING
AND FIXTURE
SCHEDULE**

E1

whcPE

WILLIAM H. CLARK, JR., PE
4732 PORCHAVEN LN, APEX, NC 27539
PHONE: 919-740-3626 WHCLARK2001@GMAIL.COM


PROFESSIONAL
SEAL
10985
ENGINEER
WILLIAM H. CLARK, JR.

GENERAL POWER NOTES:

- SEE GENERAL ELECTRICAL SPECIFICATIONS ON DRAWING E0.
- SEE GENERAL ELECTRICAL NOTES AND LEGEND ON DRAWING E0.
- INVESTIGATE ALL EXISTING WIRING TO REMAIN AND DETERMINE CONDITION. RECONNECT EXISTING WIRING TO THE NEW PANEL BY EXTENDING THE CIRCUIT WITH SAME SIZE CONDUCTORS AS NECESSARY. SEPARATE CIRCUITS WHERE APPROPRIATE TO CONFORM TO THE NEW PANEL SCHEDULE.
- FOR THE POOL SCOPE OF WORK, PROVIDE ALL WIRING PER NEC 680 INCLUDING BONDING/GROUNDING OF THE POOL SHELL, POOL WATER, POOL EQUIPMENT, LIGHTS, WITH A COMMON BONDING GRID.
- USE NONMETALLIC PIPING WITH INSULATED GROUNDING CONDUCTORS. PROVIDE #8 BONDING CONDUCTOR FROM THE POOL SHELL AND POOL LIGHTS TO THE POOL BONDING GRID, THE PANEL 'A' EQUIPMENT GROUND BAR, AND PUMP MOTOR.
- GROUND FAULT PROTECTION SHALL BE PROVIDED ON ALL ELECTRICAL CIRCUITS WITHIN THE POOL AREA INCLUDING ALL ACCESSORY EQUIPMENT, ELECTRIC DRINKING FOUNTAINS, AND BATH HOUSE/MINIMUM TOILET FACILITY RECEPTACLES. JUNCTION BOXES MUST BE ABOVE THE POOL WATER LEVEL AND MUST NOT BE A TRIP HAZARD.
- PROVIDE APPROVED CONNECTIONS FOR ALL CONDUCTORS.
- LOCATION OF ALL PUMPS, OUTLETS, EQUIPMENT, ETC, SHALL BE VERIFIED WITH POOL EQUIPMENT SUPPLIER PRIOR TO ROUGH-IN. NOTIFY ENGINEER IMMEDIATELY OF ANY ADDITIONAL REQUIREMENTS BY POOL EQUIPMENT SUPPLIER.

NOTES KEYED TO PLAN

- EMERGENCY PHONE LOCATION WITH 911 ACCESS AND EMERGENCY POWER OFF SWITCH. COORDINATE EXACT LOCATION WITH RULES. PROVIDE SIGNAGE FOR PHONE TO READ: "EMERGENCY PHONE. FOR EMERGENCY, DIAL 911. POOL PHONE NUMBER, POOL STREET ADDRESS." PROVIDE SIGNAGE FOR EPO SWITCH TO READ: "EMERGENCY POWER OFF"
- 1#8CUG TO POOL SHELL. REFER TO POOL DESIGNER'S DRAWINGS FOR EXACT LOCATION OF CONNECTIONS. SEE POOL DRAWING SP-3.
- FANS SHALL RUN CONTINUOUSLY.
- CONNECT NEW EXHAUST FANS TO THE LIGHTING CIRCUIT. FAN CONTROLLED BY LIGHT SWITCH.
- REFER TO POOL DESIGNER'S DRAWINGS FOR EXACT LOCATION OF ALL EQUIPMENT AND POINTS OF CONNECTION IN POOL EQUIPMENT ROOM. COORDINATE DISCONNECTING MEANS AND LOCATIONS WITH FINAL EQUIPMENT LOCATIONS AND INSTALLATION. NOTIFY THE ENGINEER IMMEDIATELY OF ANY CONFLICTS.
- PROVIDE SCHEDULE 40 PVC CONDUITS AND BOXES FOR ALL CIRCUITS WITHIN THIS ROOM. LIQUIDTIGHT FLEXIBLE NONMETALLIC CONDUITS ALLOWED FOR CONNECTIONS.
- CONNECT TO LIGHTING CIRCUIT IN VICINITY (UNSWITCHED).

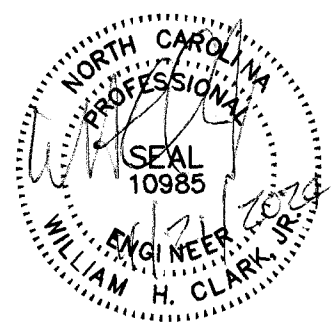

RENOVATION/ADDITION TO POOL BUILDING FOR:

CAMP AGAPE

1369 TYLER DEWAR LN
FUQUAY VARINA, NORTH CAROLINA 27526

PROJECT NO: 2430

DATE: 11/19/24

CAD DWG FILE: E_2430

DRWN BY:WHCCHKD BY:WHC

ELEC FLOOR
PLAN - PWR/IT
AND SCHEDULE

E2

PANEL A

CCT	LOAD	DESCRIPTION	C	G	W	CB	CCT	CCT	CB	W	G	C	DESCRIPTION	LOAD	CCT
1	2040	POOL PUMP (NEW) GFP	1/2	10	10	35	1	2	20	12	12	1/2	GFCI RECEPT BELOW(EXTG)	360	2
3	2040	" "	--	--	10	2P	3	4	20	12	12	1/2	VENDING RECEPTS(REUSE) GFP	1000	4
5	2250	WATER HEATER (EXTG)	1/2	10	10	30	5	6	20	12	12	1/2	BATH HAND DRYER(EXTG)	1000	6
7	2250	" "	--	--	10	2P	7	8	20	12	12	1/2	LIGHTING (EXTG)	600	8
9	600	WATER COOLER (REUSE)	1/2	12	12	20	9	10	20	12	12	1/2	BATH LITES(EXTG)	400	10
11	1120	SHELTER (EXTG)	1/2	12	12	20	11	12	20	12	12	1/2	OVERHEAD LIGHTS(EXTG)	400	12
13	1580	LIGHTS AND RECEPTS(EXTG)	1/2	12	12	20	13	14	20	12	12	1/2	PUMP RM RECEPT/MISC	540	14
15	540	NEW RECEPTACLES CONCESSIONS	1/2	12	12	20	15	16	20	12	12	1/2	RECEPT CRAFTS RM (NEW)	1080	16
17	350	EF-2	1/2	12	12	20	17	18	20	12	12	1/2	CRAFT RM/GALLERY LIGHTS	683	18
19	3696	HPIU-1 (BREAKER LOCK)	3/4	10	8	35	19	20	--	--	--	--	SPACE ONLY	0	20
21	3696	" "	--	--	8	2P	21	22	--	--	--	--	SPACE ONLY	0	22
23	1344	HPOU-1	1/2	12	12	15	23	24	--	--	--	--	SPACE ONLY	0	24
25	1344	" "	--	--	12	2P	25	26	--	--	--	--	SPACE ONLY	0	26
27	2500	UH-1	1/2	10	10	30	27	28	--	--	--	--	SPACE ONLY	0	28
29	2500	" "	--	--	10	2P	29	30	--	--	--	--	SPACE ONLY	0	30

240	/ 120 V	150	A MINIMUM BUS SIZE	SURFACE	MOUNTING
1	PHASE	150	MCB	NEMA 1	ENCLOSURE
3	WIRE	10,000	MINIMUM AIC RATING	GROUND BAR	

- NOTES:
- REPLACE EXTG PANEL. RELOCATE EXISTING CIRCUITS NOT AFFECTED BY THIS WORK TO THE NEW PANEL.
 - PROVIDE HACR RATED BREAKERS FOR MOTOR AND HVAC LOADS.
 - VERIFY NEUTRAL CONDUCTOR REQUIREMENTS FOR EACH CIRCUIT. COLOR-CODE ALL CONDUCTORS.
 - PROVIDE PRINTED DIRECTORY WITH ROOM NAMES. PROVIDE GFP ON VENDING AND POOL BREAKERS.
 - PROVIDE A SHUNT TRIP ON THE MAIN BREAKER WITH COIL-CLEARING CONTACTS FOR EPO FUNCTION.

CONNECTED LOADS	
PHASE A:	17.3 KVA
PHASE B:	16.6 KVA
TOTAL:	33.9 KVA
DEMAND:	141.3 A

NOTE TO CONTRACTOR

ELECTRICAL CONTRACTOR SHALL CLOSELY COORDINATE ALL WORK WITH POOL INSTALLER TO PROVIDE ALL APPURTENANCES NECESSARY FOR FULLY FUNCTIONAL POOL EQUIPMENT ROOM AND DECK AREA PER POOL DESIGNER AND OWNER'S SPECIFICATIONS.

NOTIFY THE ENGINEER IMMEDIATELY OF ANY CONFLICTS.

ALL FIXTURES AND CONDUITS IN THE CHEMICAL STORAGE ROOM SHALL BE LISTED CORROSION RESISTANT

ALL EQUIPMENT AND CONDUITS IN THE POOL EQUIPMENT ROOM SHALL BE LISTED CORROSION RESISTANT

POOL

RECONNECT EXISTING POOL AREA LIGHTING AND RECEPTACLES TO THE REPLACEMENT PANEL 'A'. ROUTE NEW 1#8G BONDING GROUND TO NEW POOL SHELL GRID AND METALLIC COMPONENTS.

1 FLOOR PLAN - POWER/IT
E2 1/4" = 1' - 0"


WIRING DEVICE MOUNTING HEIGHTS:

IN GENERAL, MOUNT ALL WIRING DEVICES AT:


- 48" MAX ABOVE FINISHED FLOOR (AFF) TO HIGHEST OPERABLE PART FOR ALL THERMOSTATS.
- 48" MAX AFF TO HIGHEST OPERABLE PART IN "ON" POSITION FOR ALL LIGHT SWITCHES.
- 15" MIN AFF TO CENTERLINE OF LOWEST RECEPTACLE (OR 18" MIN TO CENTERLINE OF BOX) FOR ALL WALL RECEPTACLES.
- 48" MAX AFF TO CENTERLINE OF HIGHEST RECEPTACLE.

MOUNT BATHROOM RECEPTACLES AT:


- 44" MAX AFF TO CENTERLINE OF HIGHEST RECEPTACLE.
- 12" MIN FROM ANY OBSTRUCTION.
- 12" MAX FROM LEADING EDGE OF VANITY COUNTER OR SINK, IF ON SIDE WALL.

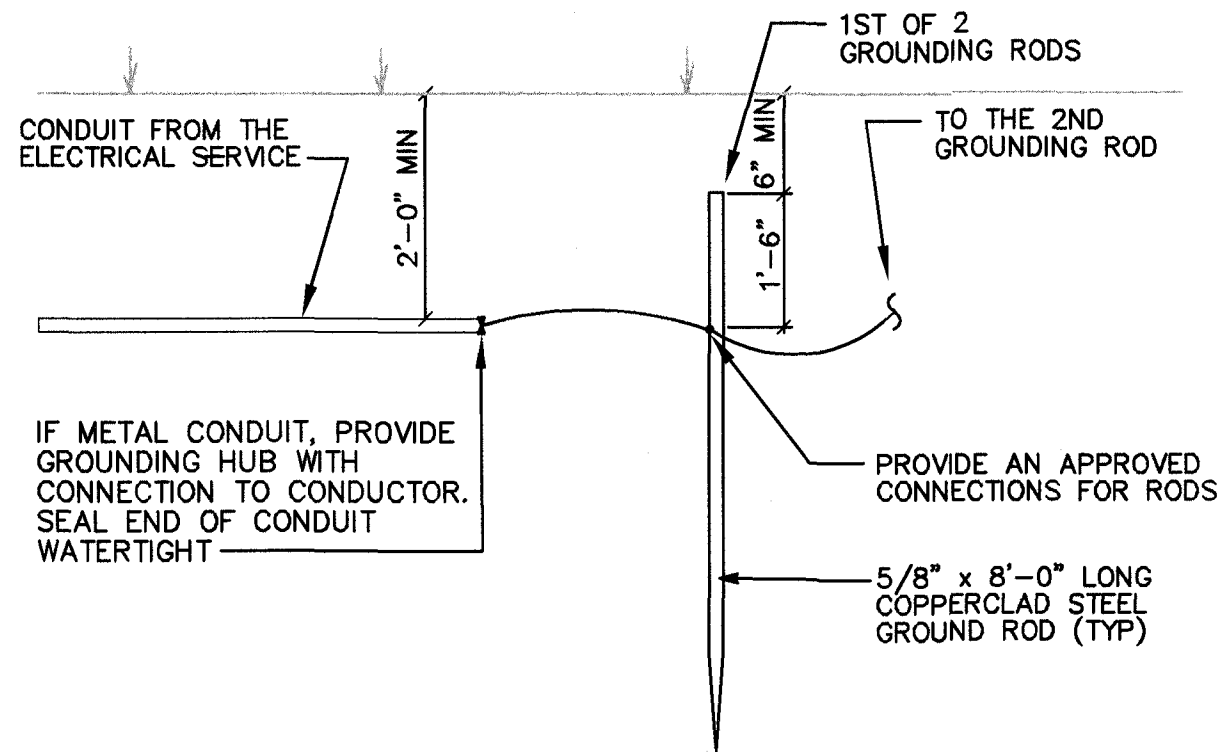


1 GROUND RODS AT SERVICE
E3 NO SCALE

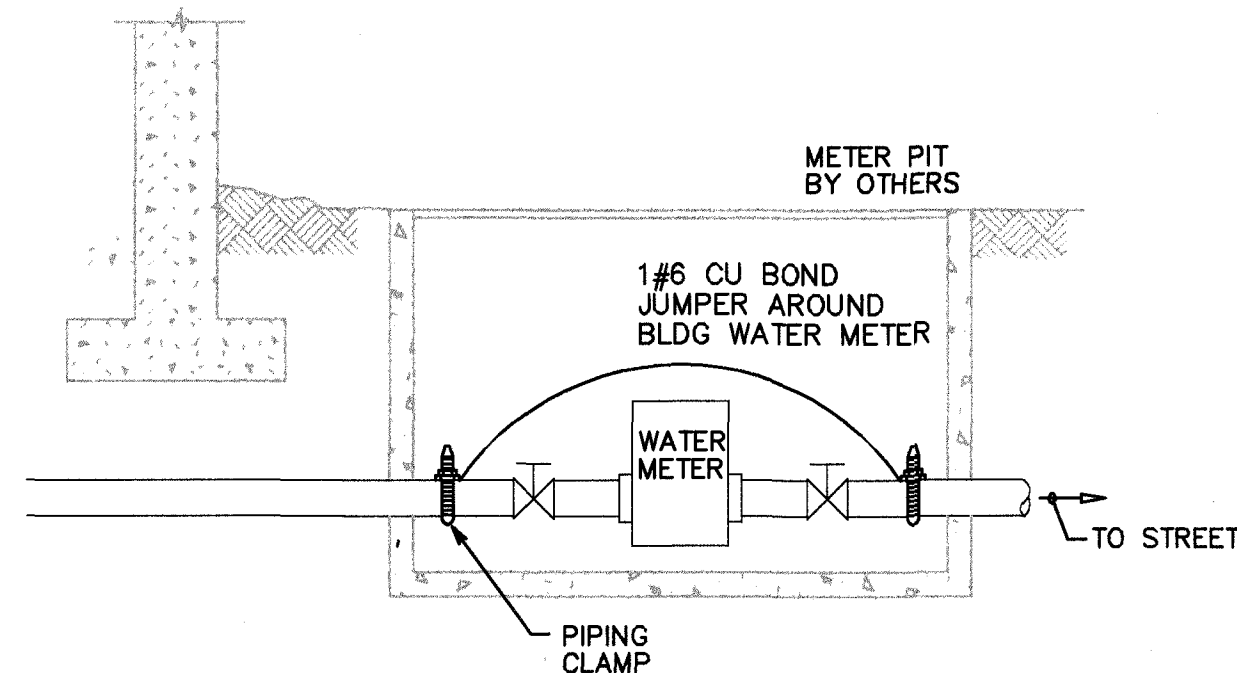


2 GROUNDING AT WATER METER
E3 NO SCALE

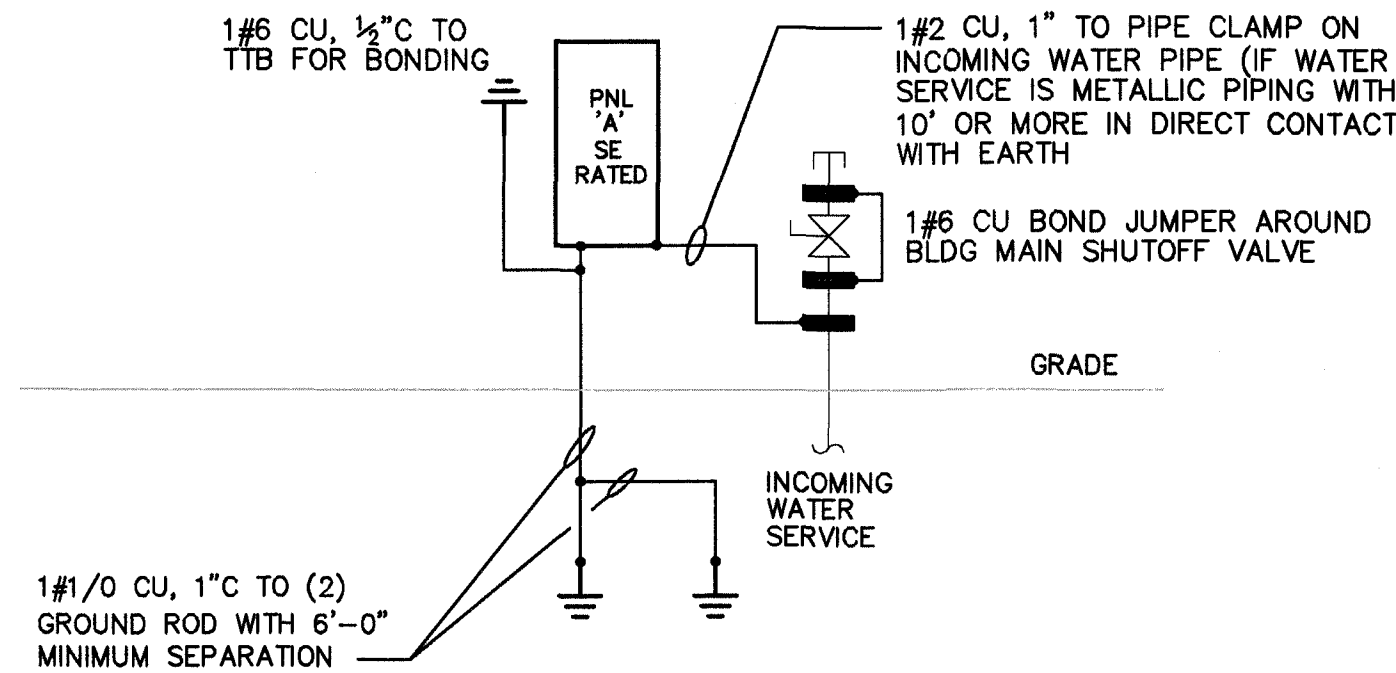

3 BUILDING SERVICE GROUNDING
E3 NO SCALE

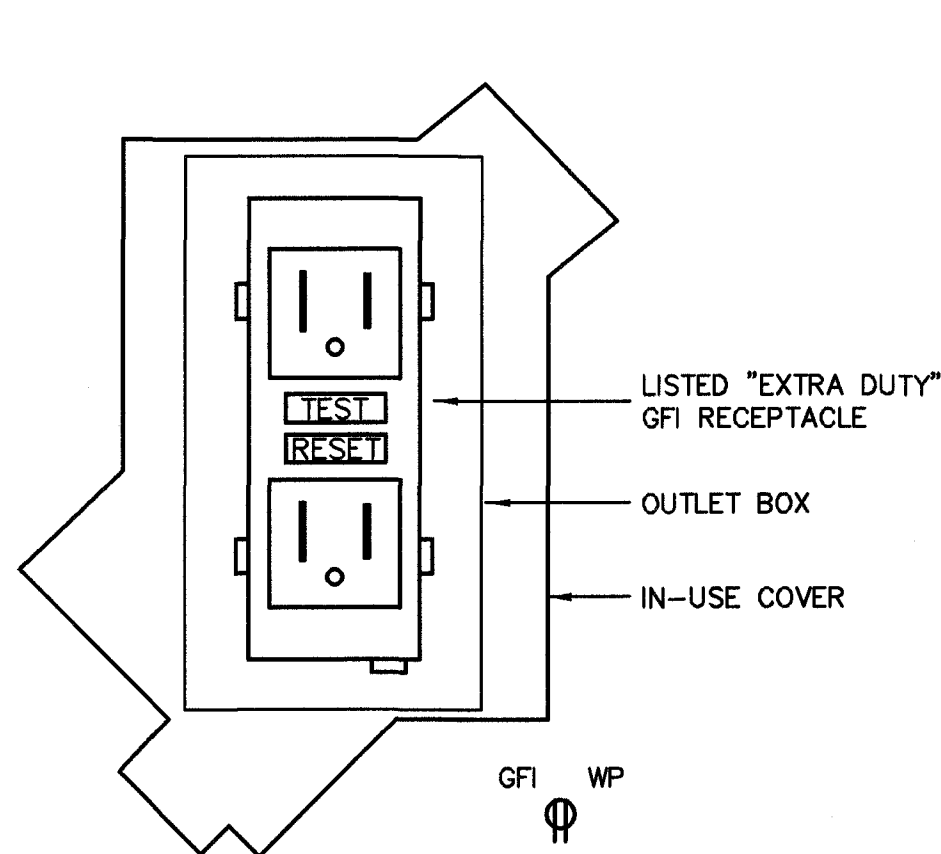

4 EXTERIOR RECEPTACLE
E3 NO SCALE

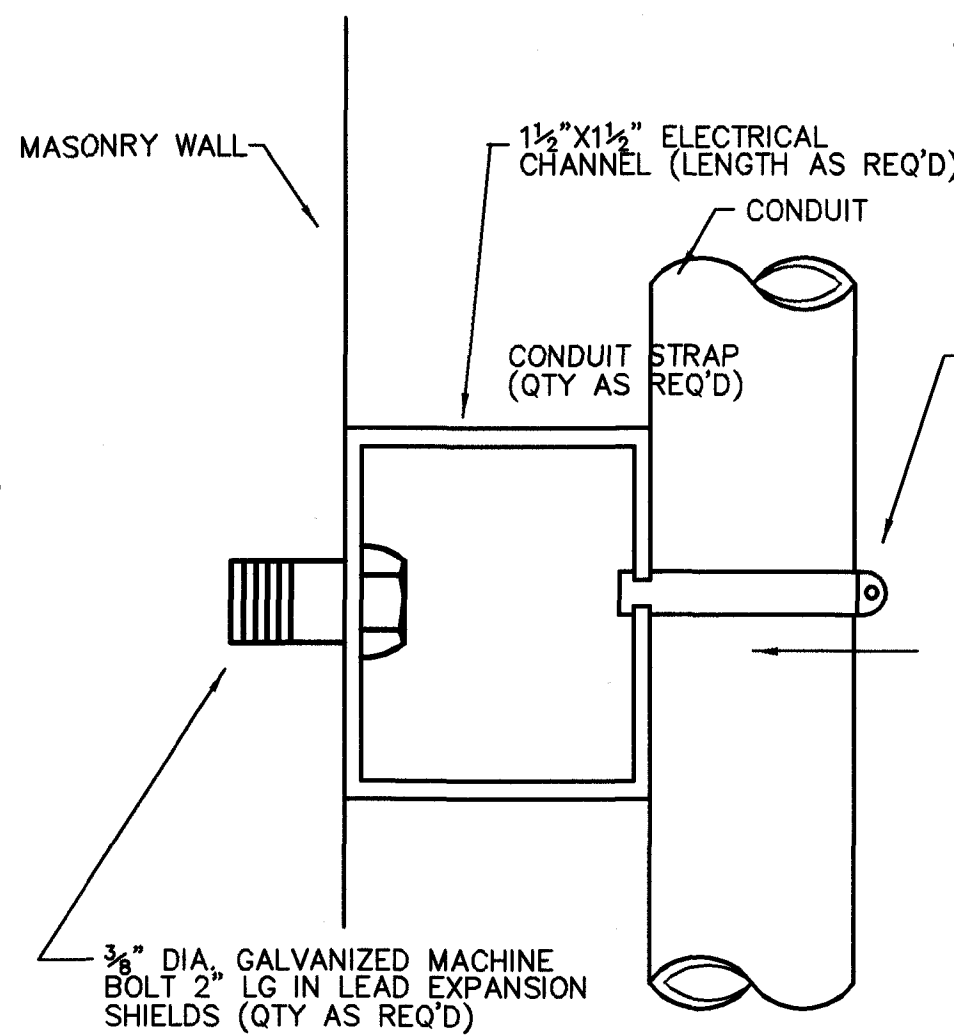

7 CONDUIT SUPPORT
E3 NO SCALE

FAULT CURRENT PLAQUE


PRIOR TO ENERGIZING EQUIPMENT, PROVIDE A DURABLE, PERMANENTLY ATTACHED, AND LEGIBLY MARKED PLAQUE AT EACH SERVICE ENTRANCE. PLAQUE SHALL READ:

MAX. FAULT CURRENT = XX.XXX AMPERES
CALCULATION MADE = XX/XX/XX


TO COMPLETE THE PLAQUE TEXT, FURNISH THE ENGINEER-OF-RECORD WITH THE ACTUAL UTILITY TRANSFORMER SIZE AND THE CONDUCTOR SIZE, QUANTITY PER PHASE, AND LENGTH OF UTILITY-INSTALLED SERVICE CONDUCTORS FROM THE TRANSFORMER TO THE SERVICE EQUIPMENT.

NOTES:


1. BENDS ALL CONDUCTORS WITH A UNIFORM RADIUS NEVER TOUCHING THE PANEL ENCLOSURE.
2. BEND CONDUCTORS TO THE BACK CORNER OF THE PANEL ENCLOSURE AND THEN FORWARD TO THE CIRCUIT BREAKER TERMINAL.
3. TIE WRAP CONDUCTORS IN GROUPS AND AT REGULAR INTERVALS TO FORM NEAT, ORDERLY WIRE BUNDLES.
4. CLEAN THE ENCLOSURE OF ALL DEBRIS AND UNUSED MATERIALS.
5. PROVIDE A TYPED DIRECTORY OF CIRCUITS ACCURATELY DENOTING ROOMS SERVED.
6. WHEN FINISHED, PANEL SHALL PRESENT A CLEAN, NEAT, AND ORDERLY APPEARANCE.

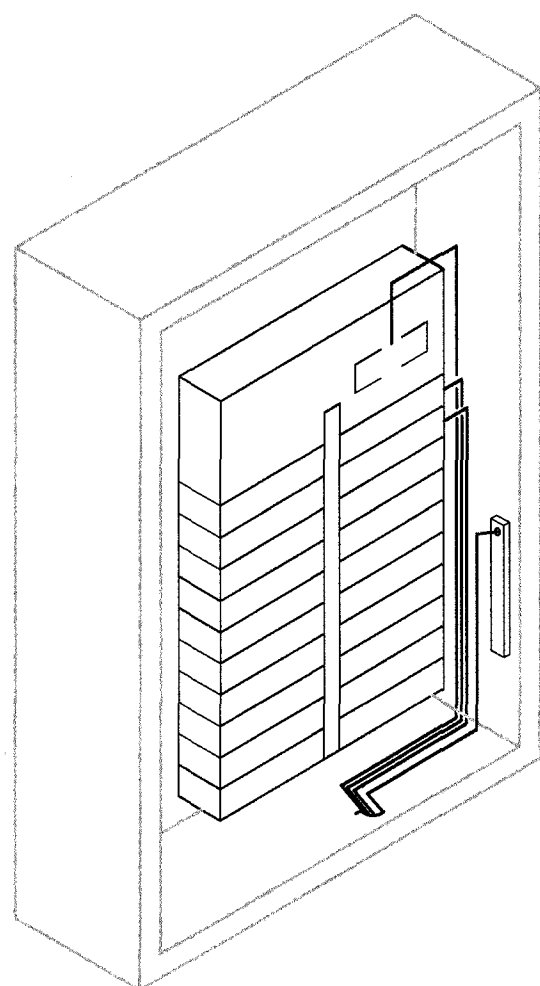

5 PANEL WIRING
E3 NO SCALE

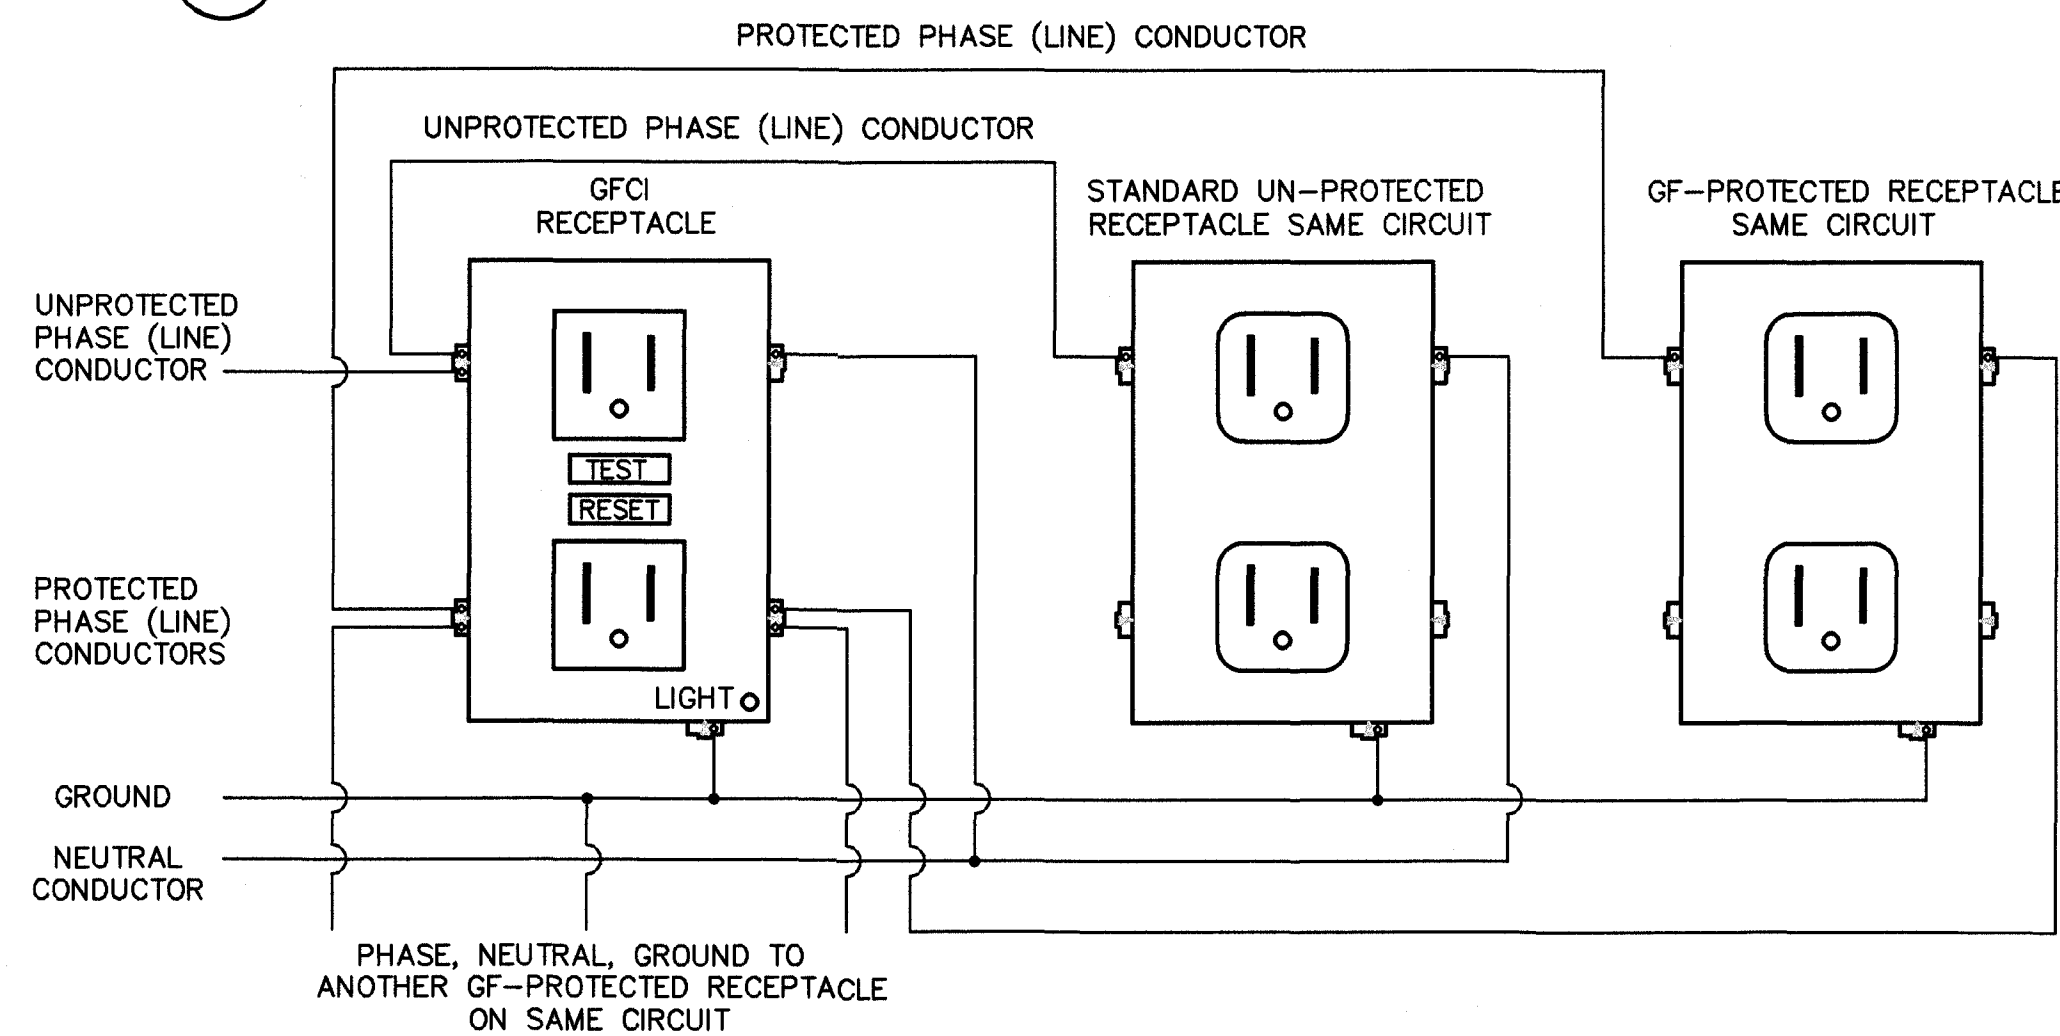


6 MULTIPLE RECEPTACLES GFCI-PROTECTION
E3 NO SCALE

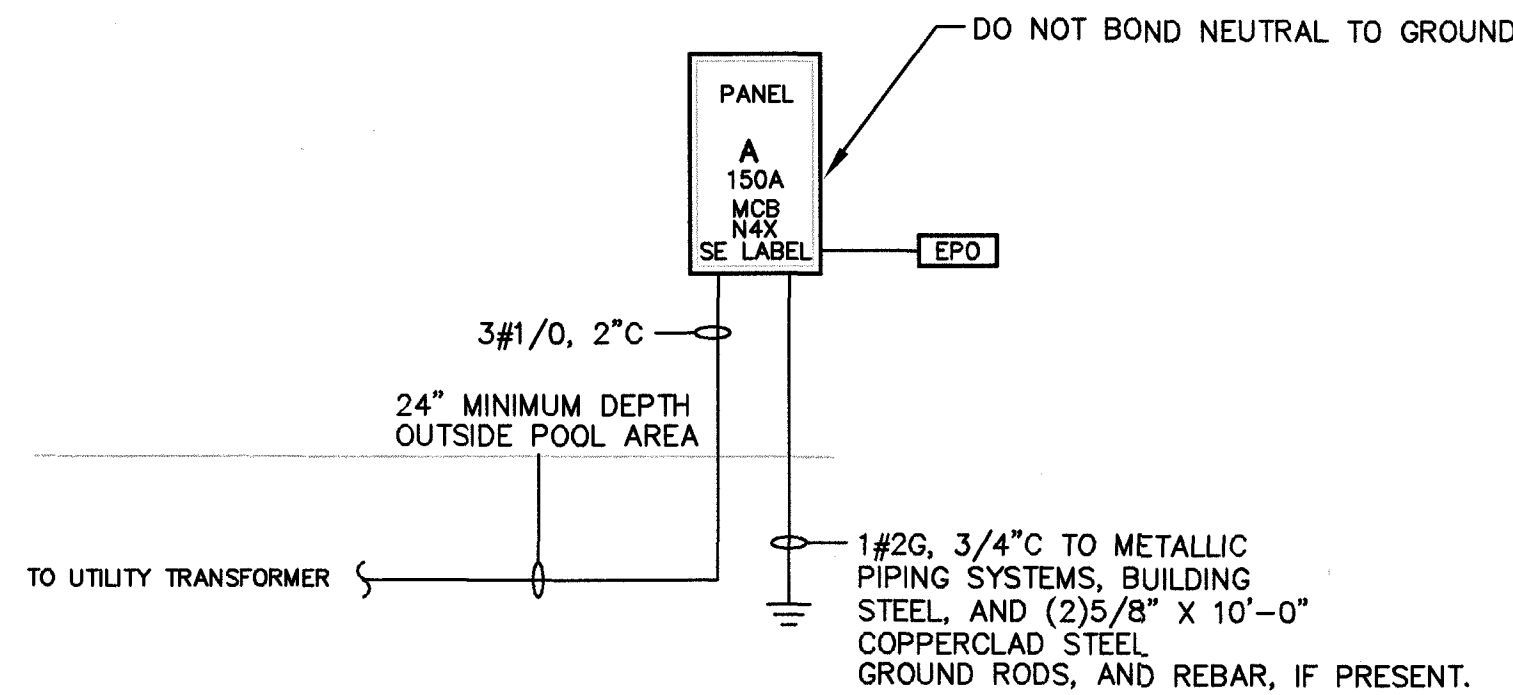

2 POOL BUILDING POWER RISER
EP.01 NO SCALE

8 ELECTRICAL POWER RISER (240/120V, 1P, 3W)
E3 NO SCALE

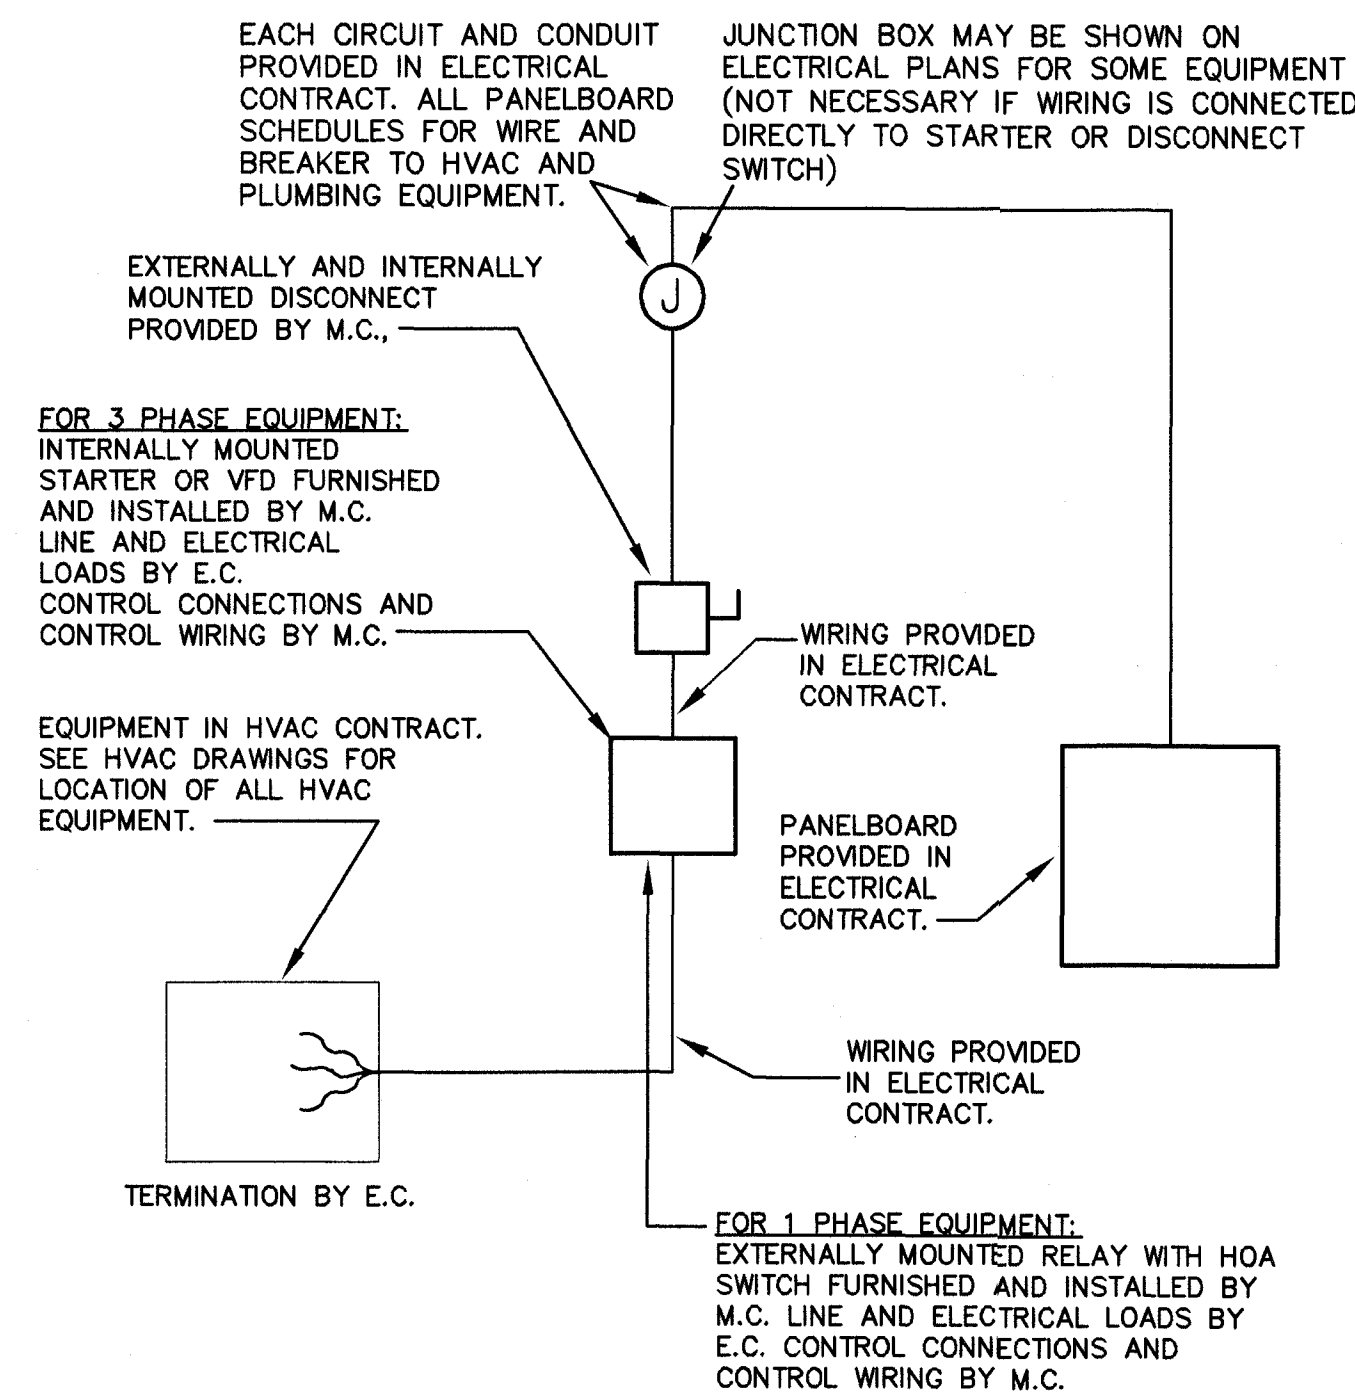

** A COMBINATION STARTER MAY BE USED IN LIEU OF A SEPARATE DISCONNECT SWITCH AND STARTER

9 HVAC/PLUMBING/POOL/ELECTRICAL EQUIPMENT CONNECTIONS
E3 NO SCALE

This drawing and the design shown are the property of WILLIAM H. CLARK, JR., P.E. The reproduction, copying or other use of this drawing without our written consent is prohibited. Copyright 2024 William H. Clark, Jr., P.E.


RENOVATION/ADDITION TO POOL BUILDING FOR:

PROJECT NO:	2430
DATE:	11/19/24
CAD DWG FILE:	E_2430
DRWN BY:WHCCHKD BY:WHC	

ELEC DETAILS
AND
POWER RISER

E3

whcPE
WILLIAM H. CLARK, JR., P.E.
4732 PORCHAVEN LN, APEX, NC 27539
PHONE: 919-740-3626 WHCLARK2001@GMAIL.COM

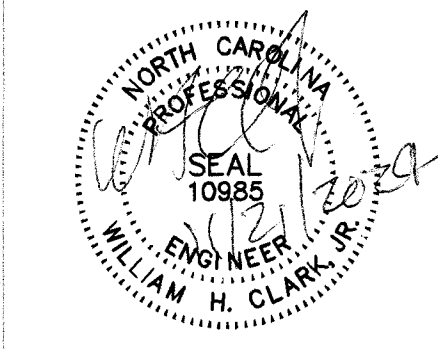

CAMP AGAPE
1369 TYLER DEWAR LN
FUQUAY VARINA, NORTH CAROLINA 27526