

FP-1 FIRE PROTECTION PLAN
FP-2 FIRE SPRINKLER REQUIREMENTS
FA-1 FIRE ALARM PLAN - FLOOR PLAN
FA-2 FIRE ALARM RISER/NOTES & MATRIX

P1	PLUMBING NOTES
P2	PLUMBING – WATER PLAN
P3	PLUMBING – WASTE PLAN
P4	ISOMETRIC WATER RISER DIAGRAM
P5	ISOMETRIC WASTE RISER DIAGRAM

410 DENIM DRIVE
ERWIN, NC 28339

STE GENERAL CONTRACTORS LLC
TOMMY McLEOD CELL: 910-890-3979
TOMMY McLEOD EMAIL: stegc.tommy@gmail.com
SHANE'S CELL: 910-591-9727
SHANE'S EMAIL: stegc.shane@gmail.com
OFFICE PHONE: 910-891-5465

UNDERGOING AN ALTERATION LEVEL III BY REMOVING THE TEMPORARY STRUCTURE IN THE REAR OF THE BUILDING AND REBUILDING A NEW STRUCTURED WALL AND ROOF REPAIR. THERE WILL BE NEW ELECTRICAL, PLUMBING, AND MECHANICAL SYSTEMS. CONSTRUCTING NEW INTERIOR WALLS, FINISHES, AND NEW LAY-IN CEILING.


EXISTING BUILDING	2018 NC EXISTING BUILDING CODE
BUILDING	2018 NC BUILDING CODE
PLUMBING	2018 NC PLUMBING CODE
MECHANICAL	2018 NC MECHANICAL CODE
ELECTRICAL	2020 NATIONAL ELECTRICAL CODE (NFPA-70)
FIRE PREVENTION	2018 NC FIRE CODE
ENERGY	2018 NC ENERGY CONSERVATION CODE
ACCESSIBILITY	ICC A117.1-2009 AND THE AMERICANS WITH DISABILITIES ACT (ADAAG)

A circular map showing the intersection of S 10th St, E H St, and 410 Denim Dr. A building labeled 'BHUC(NEW)' is shown with 'NO WORK' signs on the adjacent streets.

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM



0' 0" 4' 8' 12' 16' 20' 24' 28' 32' 36' 40' 44' 48' 52' 56' 60' 64' 68' 72' 76' 80' 84' 88' 92' 96' 100' 104' 108' 112' 116' 120' 124' 128' 132' 136' 140' 144' 148' 152' 156' 160' 164' 168' 172' 176' 180' 184' 188' 192' 196' 200' 204' 208' 212' 216' 220' 224' 228' 232' 236' 240' 244' 248' 252' 256' 260' 264' 268' 272' 276' 280' 284' 288' 292' 296' 300' 304' 308' 312' 316' 320' 324' 328' 332' 336' 340' 344' 348' 352' 356' 360' 364' 368' 372' 376' 380' 384' 388' 392' 396' 400' 404' 408' 412' 416' 420' 424' 428' 432' 436' 440' 444' 448' 452' 456' 460' 464' 468' 472' 476' 480' 484' 488' 492' 496' 500' 504' 508' 512' 516' 520' 524' 528' 532' 536' 540' 544' 548' 552' 556' 560' 564' 568' 572' 576' 580' 584' 588' 592' 596' 600' 604' 608' 612' 616' 620' 624' 628' 632' 636' 640' 644' 648' 652' 656' 660' 664' 668' 672' 676' 680' 684' 688' 692' 696' 700' 704' 708' 712' 716' 720' 724' 728' 732' 736' 740' 744' 748' 752' 756' 760' 764' 768' 772' 776' 780' 784' 788' 792' 796' 800' 804' 808' 812' 816' 820' 824' 828' 832' 836' 840' 844' 848' 852' 856' 860' 864' 868' 872' 876' 880' 884' 888' 892' 896' 900' 904' 908' 912' 916' 920' 924' 928' 932' 936' 940' 944' 948' 952' 956' 960' 964' 968' 972' 976' 980' 984' 988' 992' 996' 1000'

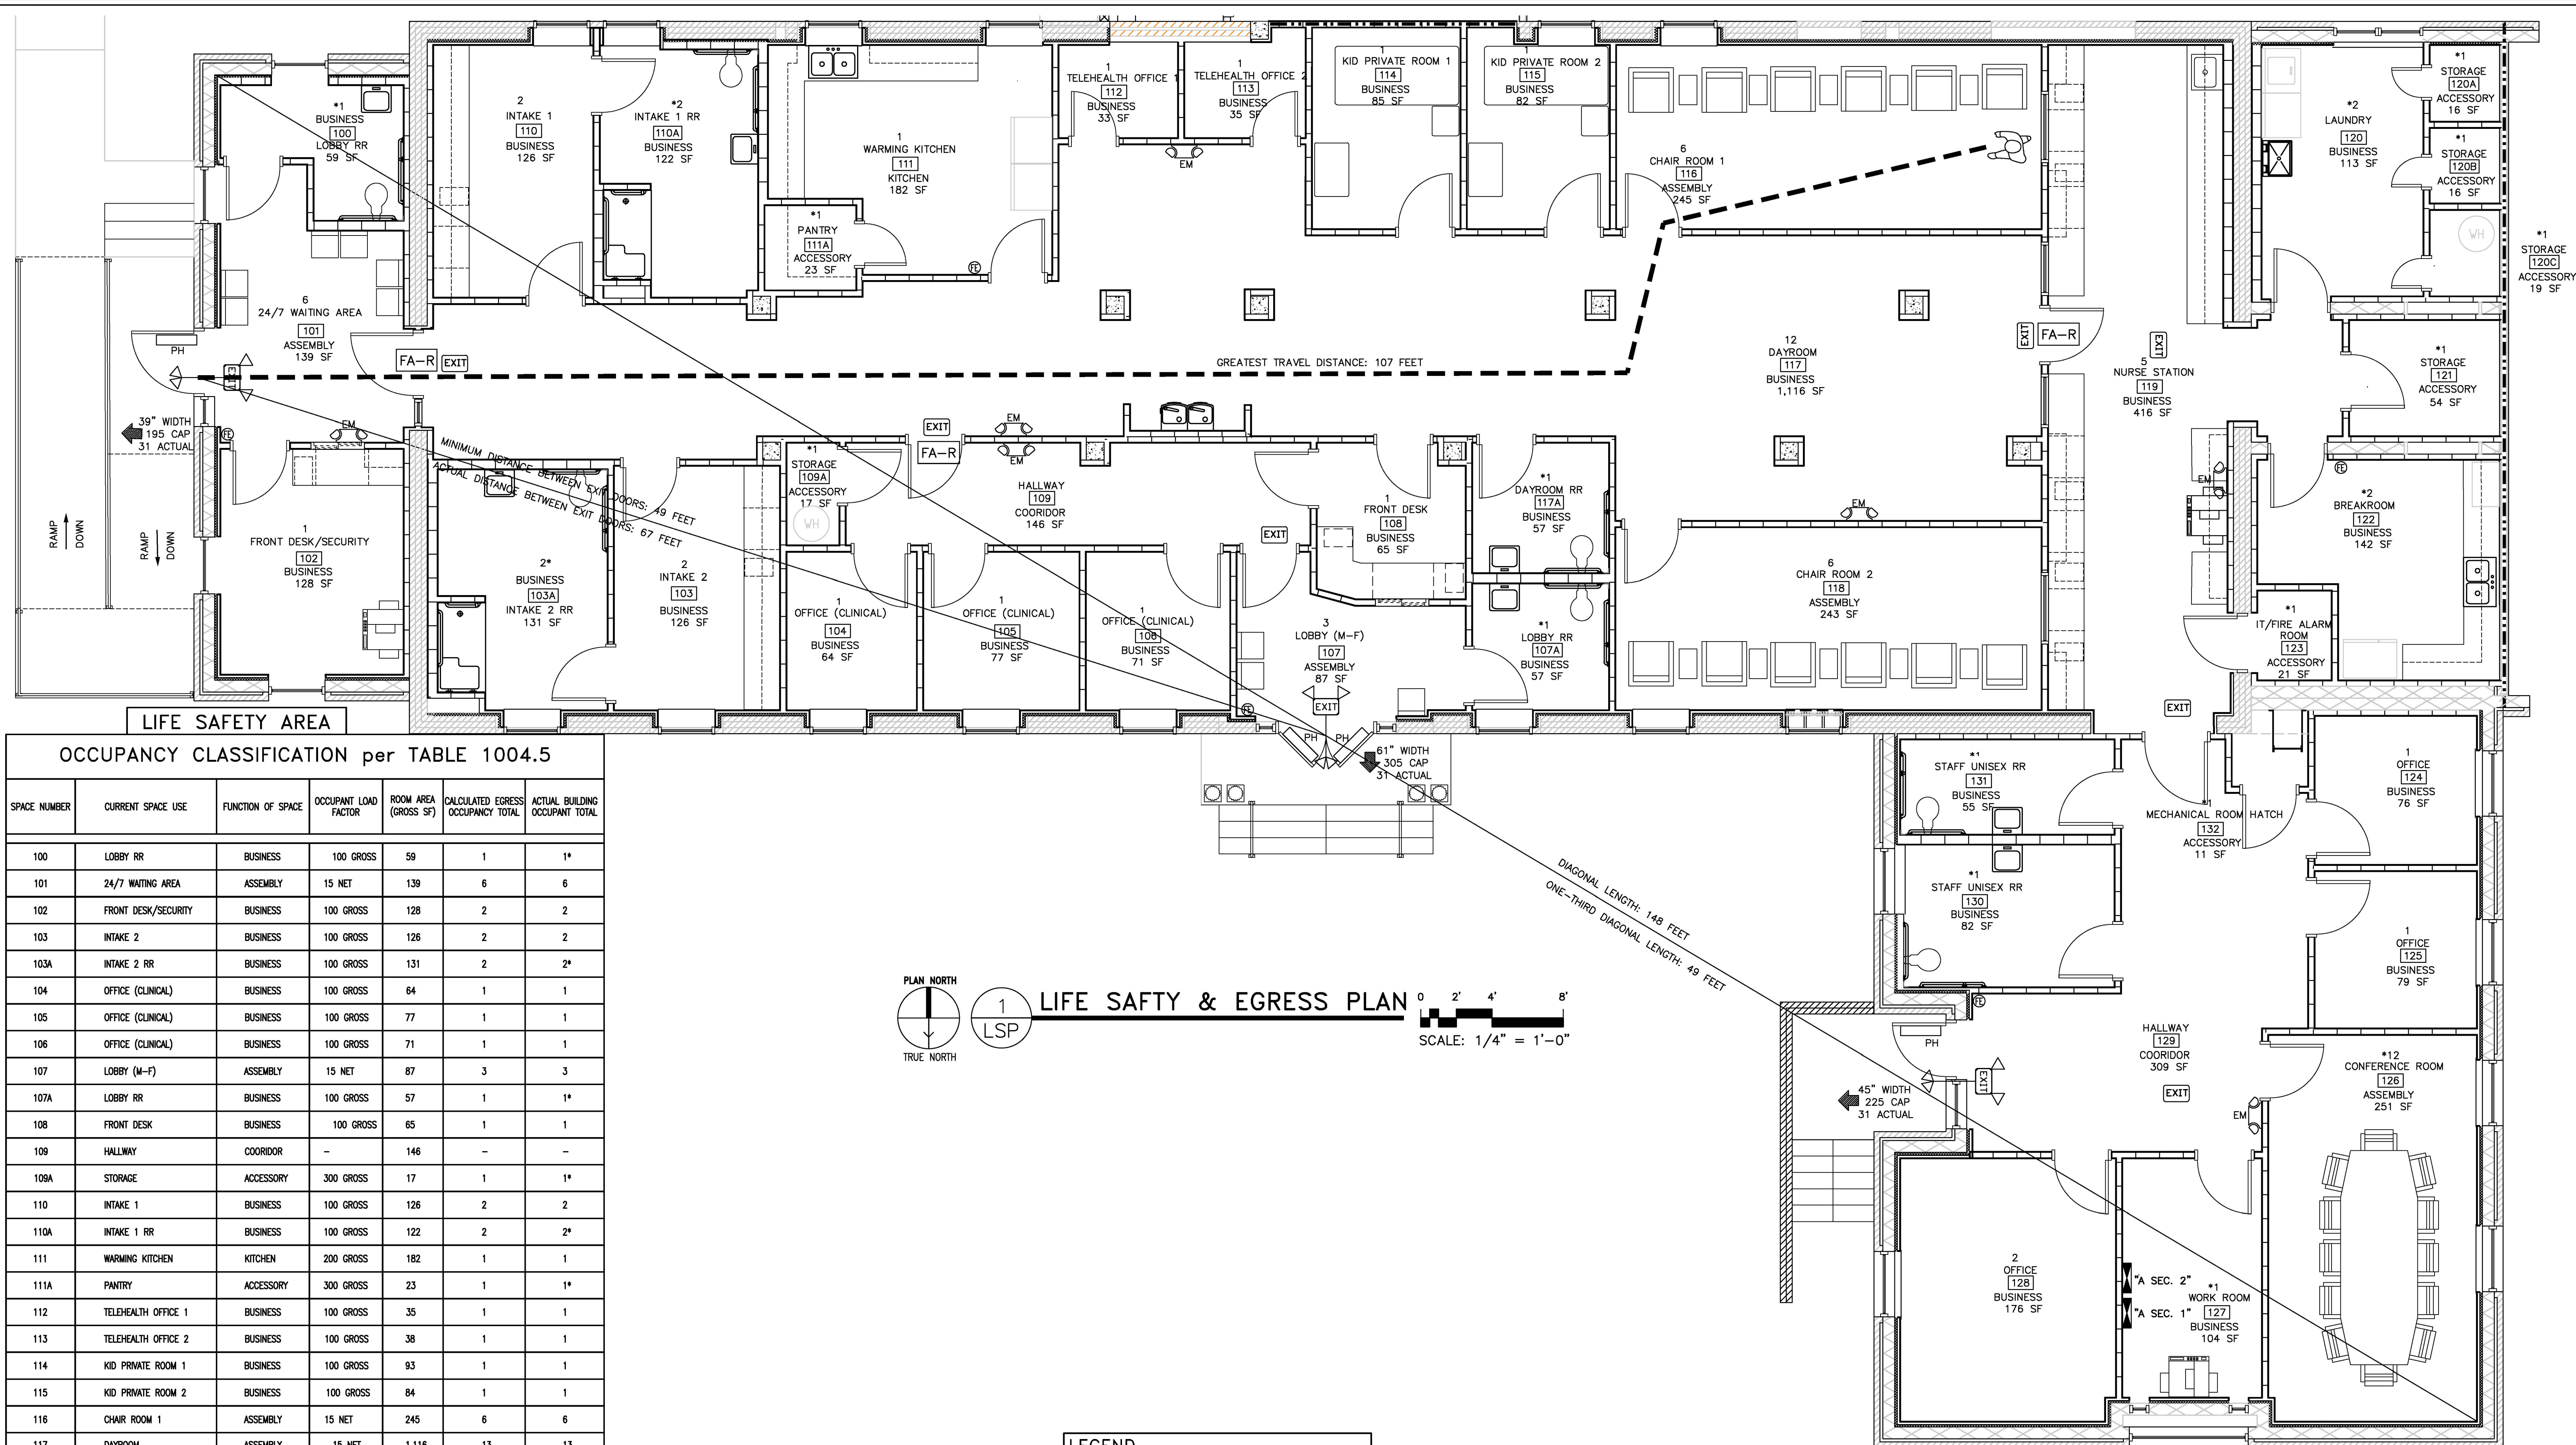

OCCUPANCY CLASSIFICATION per TABLE 1004.5

SPACE NUMBER	CURRENT SPACE USE	FUNCTION OF SPACE	OCCUPANT LOAD FACTOR	ROOM AREA (GROSS SF)	CALCULATED EGRESS OCCUPANCY TOTAL	ACTUAL BUILDING OCCUPANT TOTAL
100	LOBBY RR	BUSINESS	100 GROSS	59	1	1*
101	24/7 WAITING AREA	ASSEMBLY	15 NET	139	6	6
102	FRONT DESK/SECURITY	BUSINESS	100 GROSS	128	2	2
103	INTAKE 2	BUSINESS	100 GROSS	126	2	2
103A	INTAKE 2 RR	BUSINESS	100 GROSS	131	2	2*
104	OFFICE (CLINICAL)	BUSINESS	100 GROSS	64	1	1
105	OFFICE (CLINICAL)	BUSINESS	100 GROSS	77	1	1
106	OFFICE (CLINICAL)	BUSINESS	100 GROSS	71	1	1
107	LOBBY (M-F)	ASSEMBLY	15 NET	87	3	3
107A	LOBBY RR	BUSINESS	100 GROSS	57	1	1*
108	FRONT DESK	BUSINESS	100 GROSS	65	1	1
109	HALLWAY	COORRIDOR	-	146	-	-
109A	STORAGE	ACCESSORY	300 GROSS	17	1	1*
110	INTAKE 1	BUSINESS	100 GROSS	126	2	2
110A	INTAKE 1 RR	BUSINESS	100 GROSS	122	2	2*
111	WARMING KITCHEN	KITCHEN	200 GROSS	182	1	1
111A	PANTRY	ACCESSORY	300 GROSS	23	1	1*
112	TELEHEALTH OFFICE 1	BUSINESS	100 GROSS	35	1	1
113	TELEHEALTH OFFICE 2	BUSINESS	100 GROSS	38	1	1
114	KID PRIVATE ROOM 1	BUSINESS	100 GROSS	93	1	1
115	KID PRIVATE ROOM 2	BUSINESS	100 GROSS	84	1	1
116	CHAIR ROOM 1	ASSEMBLY	15 NET	245	6	6
117	DAYROOM	ASSEMBLY	15 NET	1,116	13	13
117A	DAYROOM RR	BUSINESS	100 GROSS	57	1	1*
118	CHAIR ROOM 2	ASSEMBLY	15 NET	243	6	6
119	NURSE STATION	BUSINESS	100 GROSS	416	5	5
120	LAUNDRY ROOM	BUSINESS	100 GROSS	113	2	2*
120A	STORAGE	ACCESSORY	300 GROSS	16	1	1*
120B	STORAGE	ACCESSORY	300 GROSS	16	1	1*
120C	STORAGE	ACCESSORY	300 GROSS	19	1	1*
121	STORAGE	ACCESSORY	300 GROSS	54	1	1*
122	STAFF BREAKROOM	BUSINESS	100 GROSS	130	2	2*
123	MECHANICAL	ACCESSORY	300 GROSS	71	1	1*
124	OFFICE	BUSINESS	100 GROSS	76	1	1
125	OFFICE	BUSINESS	100 GROSS	79	1	1
126	CONFERENCE ROOM	ASSEMBLY	15 NET	251	12	12*
127	WORK ROOM	BUSINESS	100 GROSS	61	1	1*
128	OFFICE	BUSINESS	100 GROSS	176	2	2
129	HALLWAY	COORRIDOR	-	328	-	-
130	STAFF UNISEX RR	BUSINESS	100 GROSS	90	1	1*
131	STAFF UNISEX RR	BUSINESS	100 GROSS	60	1	1*
132	MECHANICAL ROOM HATCH	ACCESSORY	300 GROSS	11	1	1*

WORST CASE OCCUPANT CHART		
A	TOTAL OCCUPANT COUNT CALCULATED BY SPACES	92
B	TOTAL OCCUPANT COUNT CALCULATED FOR BUSINESS USE @100 SF (6,511/100)	66
C	OCCUPANT LOAD BASED UPON TOTAL NUMBER OF CUSTOMERS AND WAITING SPACE	55

*EGRESS CAPACITY SHALL BE BASED UPON CALCULATION A OR 92 PERSONS

LEGEND	
SYMBOL	DESCRIPTION
FA-R	FIRE ALARM ACTIVATED DOOR RELEASE, DELAYED EGRESS, PER UL-294
PH	PANIC HARDWARE
ABC	ABC FIRE EXTINGUISHER CABINET SUGGESTED LOCATION
61" WIDTH 305 CAP 31" ACTUAL	TRAVEL DISTANCE WITH NOTED DISTANCE.
EXIT	EGRESS DOOR EXIT WIDTH POTENTIAL EGRESS CAPACITY ACTUAL EGRESS CAPACITY
EXIT	EXIT SIGN
EM	EMERGENCY EGRESS LIGHTING (SEE ELECTRICAL LIGHTING PLAN)
EXIT	EXIT SIGN WITH EMERGENCY LIGHTING WITH REMOTE HEADS (ETR)
ROOM LABEL	DESCRIPTION
10	OCCUPANT TOTAL
ENTRY 101	ROOM NAME ROOM NUMBER
MERCANTILE	FUNCTION TYPE
100 SF	SPACE AREA

GOOD HOPE BEHAVIORAL URGENT CARE ALTERATION LEVEL III (BUSINESS):

GROSS SQUARE FOOTAGE OF EXISTING BUILDING: 6,522 SQ. FT.
TYPE OF CONSTRUCTION: III-B
BUILDING IS TO BE USED AS A B (BUSINESS)

OCCUPANT LOAD FOR CALCULATING EGRESS CAPACITY: 92
SPACE OCCUPANCY BY NET SF = 55 (PER 1004.1.1)
(SEE TABLE ON THIS SHEET FOR INDIVIDUAL SPACE TOTALS)
TOTAL OCCUPANT LOAD OF BUILDING (WORST CASE) = 92 PERSONS
92 OCCUPANTS ÷ 0.2/OCCUPANT = 18.4" REQUIRED: 66+88+52 = 186" PROVIDED
GREATEST TRAVEL DISTANCE SHOWN: 107 FEET. (PER 1017)
MAXIMUM ALLOWABLE TRAVEL DISTANCE: 300 FEET (PER TABLE 1017.2)
THE COMMON PATH OF TRAVEL IS LESS THAN 30 FEET. (PER 1029.6)
THERE ARE NO DEAD END CORRIDORS OVER 50 FEET. (PER 1020.4)

THIS BUILDING IS PROTECTED BY FIRE SPRINKLERS
THERE IS A FIRE ALARM SYSTEM
NUMBER OF EXITS REQUIRED: TWO(2) (TABLE 1006.2.1)
(MAXIMUM COMMON PATH OF EGRESS TRAVEL DISTANCE FOR BUSINESS USE WITH FIRE SPRINKLER IS 100 FEET, TABLE 1006.2.1)
NUMBER OF EXITS PROVIDED: THREE(3) EXISTING: ONE(1) ACCESSIBLE TWO(2) INACCESSIBLE
DOORS DO HAVE DELAYED EGRESS LOCKS (PER 1010.1.9.7)
DOORS DO HAVE ELECTROMAGNETIC EGRESS LOCKS (PER 1010.1.9.9)
DOORS DO NOT HAVE HOLD OPEN DEVICES.
EXIT DOORS REQUIRE PANIC HARDWARE.
NO. OF FIRE EXTINGUISHERS PROVIDED:
PROVIDE FIVE (5) NEW FIRE EXTINGUISHER WITH CABINETS IN THIS BUILDING.
FIRE EXTINGUISHER FOR CLASS A FIRE HAZARDS REQUIRE NO GREATER THAN 75 FT OF MAXIMUM TRAVEL DISTANCE IN LOW, ORDINARY AND EXTRA HAZARD OCCUPANCY.

LEGEND:

1 HOUR RATED WALL - - - - -
2 HOUR RATED WALL (EXISTING TO REMAIN) - - - - -

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

J. E. JENKINS
CONSULTING ENGINEERS, P.A.
OFFICE IN: FERRIS SPRINGS, NORTH CAROLINA
NORTH CAROLINA CORPORATION NUMBER C-3030
CAPITAL PROJECTS
P.O. BOX 507

DESIGNED/CHECKED BY: KID

DRAWN BY: TS SAN, ED, BT, JC, JDI

PROJECT #: 2025-01-16

DATE: 25 JULY 2025

FINAL DRAWING [] FOR REVIEW PURPOSES ONLY

PRELIMINARY [] FOR DESIGN DEVELOPMENT ONLY

FINAL DRAWING [X] FOR CONSTRUCTION

OWNER/TENANT: GOOD HOPE BEHAVIORAL URGENT CARE

410 DENIM DRIVE, ERWIN, NC 28339

CONTRACTOR/BUILDER: STE GENERAL CONTRACTORS LLC

100 TILGHMAN DRIVE, DANN, NC 28334

PROJECT: ALTERATION LEVEL III - GOOD HOPE BEHAVIORAL URGENT CARE

410 DENIM DRIVE, ERWIN, NC 28339

SHEET: LIFE SAFETY & EGRESS PLAN

LSP



EXISTING CONDITIONS
PERFORM BUILDING DEMOLITION PER G15 DRAWINGS
CONCRETE
POURING & CASTING OF CONCRETE FOOTINGS
(SEE STRUCTURAL DRAWINGS)
POURING & CASTING OF CONCRETE STOOP AND STEPS NEAR THE SPRINKLER RISER ROOM IN REAR
SAW CUT AND CORE DRILL CONCRETE FOR MECHANICAL AND PLUMBING

MASONRY FACADE OF EXTERIOR WALLS
CONSTRUCTION OF FOUNDATION
CONSTRUCTION OF BRICK VENEER SYSTEMS WITH ACCENT BRICK

INSTALLATION OF EXTERIOR LOAD BEARING WALLS
INSTALLATION OF PRE-ENGINEERED WOOD TRUSSES
BLOCKING FOR WALL MOUNTED ACCESSORIES
BLOCKING FOR CABINETRY
INSTALLATION OF METAL FRAMING/FURRING STUDS
WINDOW SILL FRAMING
TRUSSES WITH PLYWOOD

THERMAL INSULATION OF METAL TRUSS ROOF W/ R-49 CLOSED CELL SPRAY FOAM
THERMAL INSULATION OF WOOD TRUSS ROOF W/ R-42 CLOSED CELL SPRAY FOAM
THERMAL INSULATION OF EXTERIOR WALLS WITH R-9.5 CONT. INSULATION (TWO (2) LAYERS OF 2.0" POLYSTY)
THERMAL INSULATION OF EXTERIOR WALL WITH R-13 IN THE SPRINKLER RISER ROOM(METAL STUD FRAMING)
THRU-WALL FLASHING AT OPENINGS AND WALL BASE

INSTALLATION OF ONE (1) HOLLOW METAL EXTERIOR DOOR & FRAME, INSTALLATION OF METAL INTERIOR FRAMES & INTERIOR WOOD DOORS, MECHANICAL ACCESS LADDER, ALUMINUM-FRAMED ENTRANCE, AND DOOR HARDWARE (MATCH EXISTING HARDWARE)
INSTALLATION OF INTERIOR WINDOWS
INSTALLATION OF REPLACEMENT EXTERIOR WINDOW (SEE SHEET G5)

APPLICATION OF GYPSUM BOARD, CERAMIC/PORCELAIN TILING, VINYL BASE, LVP, EXTERIOR EIFS, VINYL AND ALUMINUM TRIM, ACOUSTICAL CEILINGS, WALL/CEILING PAINTING, ROOM SIGNAGE, & INTERIOR FINISHING

INSTALLATION OF MANUFACTURED WOOD CASEWORK & COUNTERTOPS

INSTALLATION OF TOILET PARTITIONS AND RESTROOM ACCESSORIES (SEE SHEETS G13.1–G13.5)

INSTALLATION OF LIFE SAFETY DIRECTORIES/SIGNAGE, FIRE EXTINGUISHER BRACKETS, & EGRESS LIGHTING

INSTALLATION OF WALL-MOUNTED RESTROOM FIXTURES, MIRRORS, DISPENSERS, HANDRAILS, & BRAILLE SIGNAGE.

ROUGH IN INSULATED HVAC DUCTWORK W/ RETURNS & NOISE/VIBRATION CONTROL.
 INSTALLATION OF FANS/CASINGS, GRILLES/SUPPORTS, INDOOR AIR-HANDLING UNITS, & AIR-SOURCE UNITARY HEAT PUMPS, SPLIT SYSTEM UNITS.
 VOLUME/CONTROL DAMPERS, MOTORIZED DAMPERS, FIRE DAMPERS, AND BACKDRAFT DAMPERS.
 INSTALLATION OF THERMOSTATS.
 PROVIDE DRYER VENT FROM LAUNDRY
 TESTING, ADJUSTING, BALANCING OF HVAC SYSTEM.

ROUGH IN MEDIUM-VOLTAGE CABLES, & CONTROL/COMMUNICATION/SIGNAL WIRING
INSTALLATION OF RACEWAY & BOXES FOR ELECTRICAL/COMMUNICATION SYSTEMS, LIGHTING CONTROLS, PANEL BOARDS, WIRING DEVICES, ENCLOSED SWITCHES & CIRCUIT BREAKERS,
INTERIOR/EXTERIOR LIGHTING, SERVICE
GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS
LOW VOLTAGE ROUGH-IN FOR DATA, INTERNET, CAMERA SYSTEM.

ROUGH IN WATER SUPPLY LINES W/ INSULATION
ROUGH IN SANITARY SEWER LINES & VENT PIPING
INSTALLATION OF WATER CLOSETS, LAVATORIES, UTILITY SINK, HI-LO WATER COOLERS.
INSTALLATION OF KITCHEN SINKS, AND FLOOR DRAINS.
INSTALLATION OF WATER HEATERS, EQUIPMENT STANDS, DRAIN PANS, EXPANSION TANK, RE-CIRCULATION PUMP.

INSTALLATION OF SECURITY SYSTEM.
INSTALLATION OF FIRE ALARM EQUIPMENT WHICH MONITORED BY A CENTRAL STATION.
INSTALLATION OF SMOKE DETECTORS, HEAT DETECTORS, FLOW SWITCH.
INSTALLATION OF CARBON MONOXIDE DETECTOR IN KITCHEN AREA.

INSTALLATION OF 2X2 LAY-IN ACOUSTICAL CEILING
INSTALLATION OF VINYL COATED 2X2 LAY-IN CEILING IN WARMING KITCHEN, BREAKROOM AND RESTROOM AREAS.

ROUGH-IN MAIN WATER LINE FOR THE SPRINKLER SYSTEM TO RISER ROOM
INSTALLATION OF WATER SUPPLY LINES FOR THE FIRE SPRINKLER SYSTEM THROUGH OUT THE BUILDING
PROVIDE CONCEALED SPRINKLER HEADS FOR ALL ROOMS & SPACES
PROVIDE UPRIGHT SPRINKLERS IN ATTIC SPACES

1. THE DRAWINGS SHOW THE EXISTING BUILDING SHELL FOLLOWING COMPLETE INTERIOR DEMOLITION. THESE DRAWINGS PROVIDE ORIGINAL CONSTRUCTION DETAILS FROM FIELD SURVEY.
2. THE DRAWINGS INDICATE ORIGINAL CONSTRUCTION OF STRUCTURAL MEMBERS AND FRAMING.
3. THE DRAWINGS INDICATE AREAS WHERE DEMOLITION OF ELEMENTS OR SURFACES IS RESTRICTED.
4. COORDINATE ALL FLOOR AND ATTIC PENETRATIONS IN ADVANCE AND OBTAIN ENGINEER APPROVAL PRIOR TO CUTTING ANY OPENINGS THROUGH FLOOR AND ATTIC SLABS.
5. USE CARE IN DEMOLITION OF EXTERIOR WALLS FOR WALL PENETRATIONS DUE TO HVAC EQUIPMENT INSTALLATION.
6. THE EXISTING WINDOWS WERE REPLACED WITH NEW. USE CARE NOT TO DAMAGE EXISTING REPLACEMENT WINDOWS.
7. SEE SHEET G5 FOR LOCATION OF WINDOW SASH THAT REQUIRES REPLACEMENT.

THIS PROJECT CONSISTS OF A LEVEL-III ALTERATION AND CHANGE OF USE. THE PREVIOUS USE WAS AN INSTITUTIONAL USE (HOSPITAL). THE NEW USE SHALL BE A BEHAVIORAL URGENT CARE (BUSINESS USE).

--SEE EXISTING BUILDING PLANS FOR WALLS, FLOORING, DOORS, AND OTHER EQUIPMENT TO BE REMAIN. SEE CALLOUT PLAN FOR NEW FLOOR PLAN INFORMATION. SEE DIMENSIONED FLOOR PLAN FOR NEW FLOOR PLAN DIMENSIONS. CONTRACTOR SHALL COORDINATE CONSTRUCTION OF NEW WALLS WITH EXISTING BUILDING SHELL.


MECHANICAL: THE MECHANICAL SCOPE OF WORK INCLUDES THE ROUGH IN INSULATED HVAC DUCTWORK WITH SUPPORTS & NOISE/VIBRATION CONTROL. INSTALLATION OF FANS/CASINGS, GRILLES/RETURNS, INDOOR AIR-HANDLING UNITS, & AIR-SOURCE UNITARY HEAT PUMPS. SPLIT SYSTEM UNITS. INSTALLATION OF VOLUME/CONTROL DAMPERS, MOTORIZED DAMPERS, FIRE DAMPERS, AND BACKDRIFT DAMPERS. INSTALLATION OF ECONOMIZER WITH BAROMETRIC RESET DAMPERS. CONTROL SYSTEMS AND THERMOSTATS TESTING, ADJUSTING, BALANCING OF HVAC SYSTEM. MECHANICAL COORDINATE WITH ELECTRICAL AND PLUMBING. GENERAL DRAWINGS FOR THE EXISTING STRUCTURAL CEILING SYSTEM FOR ALLOWABLE AREAS OF DUCT PENETRATIONS.

ELECTRICAL: THE ELECTRICAL CODE OF WORK INCLUDES THE COMPLETE REPLACEMENT OF THE BUILDING'S ELECTRICAL SYSTEM, AS IT WAS PREVIOUSLY STRIPPED OF ALL COMPONENTS, INCLUDING LIGHTING, RECEPTACLES, CONDUITS, SERVICE EQUIPMENT, AND THE ORIGINAL PAD-MOUNTED TRANSFORMER. A NEW 400A, 3-PHASE, 4-WIRE 208-120V SERVICE ENTRANCE SHALL BE INSTALLED TO THE BUILDING. THE NEW SERVICE SHALL BE FED UNDERGROUND FROM A NEW POLE-MOUNTED TRANSFORMER. NEW INSTALLATION OF INTERIOR LIGHTING, RECEPTACLES, AND BRANCH CIRCUITS FOR EQUIPMENT; LOW-VOLTAGE FOR DEVICES; AND A FIRE ALARM SYSTEM, THE ELECTRICAL SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH THE EXISTING STRUCTURAL FOUNDATION AND CEILING SYSTEM FOR ALLOWABLE AREAS OF PIPE/CONDUIT PENETRATIONS.

==PLUMBING: THE PLUMBING SCOPE OF WORK INCLUDES THE COMPLETE REPLACEMENT OF THE PLUMBING SYSTEM FOR AN EXISTING COLD SHELL BUILDING, WHERE ALL EXISTING WATER SERVICE, WATER AND WASTE PIPING, AND PLUMBING FIXTURES HAVE BEEN REMOVED, PROVIDING NEW DOMESTIC WATER AND SANITARY SEWER LINES TO SERVE THE BUILDING'S NEW LAYOUT. INSTALLATION OF A NEW WATER METER AND BACKFLOW PREVENTER (TO BE COORDINATED WITH THE SITE PLAN), NEW WATER AND WASTE PIPING FOR ALL PLUMBING FIXTURES, A WATER HEATER WITH A RECIRCULATION SYSTEM, AND A COMPLETE VENT SYSTEM EXTENDED TO THE ROOF. ALL CONNECTIONS TO THE EXISTING BUILDING SHALL BE MADE AS REQUIRED. THE PLUMBING CONTRACTOR SHALL COORDINATE WITH THE GENERAL CONTRACTOR FOR THE EXISTING STRUCTURAL FOUNDATION AND CEILING SYSTEM FOR ALLOWABLE AREAS OF PIPE PENETRATIONS.

1. THE DRAWINGS ARE DIAGRAMMATIC IN NATURE AND MAY NOT SHOW ALL DETAILS OF THE DETAILS, MATERIALS AND METHODS REQUIRED TO COMPLETE CONSTRUCTION. THE DRAWING PACKAGE AS A WHOLE SHOULD BE USED TO UPTF THE SPACE AS DESCRIBED. THERE ARE NO TECHNICAL SPECIFICATIONS INCLUDED IN THESE CONSTRUCTION DOCUMENTS. THE PLANS DO NOT INCLUDE FINISH MATERIALS AND COLORS OF SELECTED ITEMS. MATERIAL SELECTIONS AND COLORS SHALL BE COORDINATED WITH OWNER.
2. THE EXISTING INTERIOR SURFACES OF EXTERIOR WALLS AND OTHER INTERIOR WALLS THAT ARE TO REMAIN SHALL BE PATCHED WITH GWS MUD AND OR SPACKLING TO OBTAIN A UNIFORM AND MATCHING FINISH. ALL NEW WALLS SHALL BE FINISHED TO A SIMILAR LEVEL. 4 FINISH GRADE.
3. EXISTING FLOORS SHALL BE SAW-CUT WITH WET DIAMOND BLADES FOR NEW PLUMBING ROUGH-INS. THESE FLOORS SHALL BE PROPERLY BACKFILLED AND FINISHED FLUSH WITH THE ORIGINAL FLOOR SURFACES.
4. DIMENSIONS ARE TO FINISHED FACE OF INTERIOR STUD WALLS UNLESS OTHERWISE NOTED.
5. THE CONTRACTOR SHALL COORDINATE ALL WORK AND ADJUST TO THE ACTUAL CONDITIONS ENCOUNTERED IN THE FIELD. COORDINATION OF WORK BETWEEN THE VARIOUS TRADES IS ALSO REQUIRED. THE CONTRACTOR SHALL NOTIFY THE DESIGN PROFESSIONAL OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK.
6. THE CONTRACTOR SHALL COORDINATE WORK, TRADES, AND SHALL VERIFY DIMENSIONS, MEANS AND METHODS OF CONSTRUCTION, EXISTING CONDITIONS AND PROPOSED NEW CONSTRUCTION PRIOR TO COMMENCING ANY WORK, MATERIAL ORDERING, OR FABRICATION.
7. WORK SHALL BE FIRST CLASS TO THE ENTIRE SATISFACTION OF THE OWNER.
8. COORDINATE ALL ELECTRICAL/PLUMBING/MECHANICAL ROUGH-IN FOR THE EXISTING BUILDING. DO NOT CUT OR MODIFY EXISTING FRAMING OR BUILDING ELEMENTS WITHOUT APPROVAL OF OWNER AND DESIGN PROFESSIONALS.
9. ALL NEW INTERIOR WALLS ARE DETAILS ON THE PLANS.
10. PATCH & REPAIR: THE CONTRACTOR SHALL PATCH AND/OR REPAIR WITH NEW ANY WORK DAMAGED OR DISTURBED CAUSED BY THE CONTRACTOR AS A RESULT OF PROVIDING FOR OR INSTALLING NEW WORK SHOWN ON THE CONTRACT DOCUMENTS.
11. CAULK ALL PENETRATION, OUTLETS, ETC. ON ALL DEMISING PARTITIONS. LEAVE ALL WORK COMPLETE AND READY FOR THE INTENDED USE.
12. ALL CONSTRUCTION MATERIALS AND DEBRIS WILL BE REMOVED FROM THE SITE UPON COMPLETION. THE CONTRACTOR SHALL PROVIDE CLEANING SERVICES FOR THE OWNER SPACE AND DELIVER THE PROJECT COMPLETED.
13. PROVIDE BLOCKING IN WALLS AT MILLWORK, HARDWARE & ACCESSORIES LOCATIONS. BLOCKING CAN BE WOOD.
14. CONSTRUCTION TO COMPLY WITH ALL STATE AND LOCAL CODES.

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

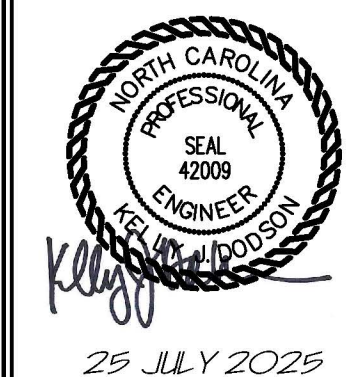

DESIGNED/CHECKED BY:	KJD
DRAWN BY:	TS,SAN,GD,BT,JC,JDL
PROJECT #:	2025-01-16
DATE:	

FINAL DRAWING ☐ FOR REVIEW PURPOSES ONLY
PRELIMINARY ☐ FOR DESIGN DEVELOPMENT ONLY
FINAL DRAWING ☒ FOR CONSTRUCTION

OWNER/TENANT:
GOOD HOPE HOSPITAL
410 DENIM DRIVE, EDWIN, NC 28359

CONTRACTOR/BUILDER:
STE GENERAL CONTRACTORS, LLC

[illegible]

PROJECT:
ALTERATION LEVEL III - GOOD HOPE BEHAVIORAL URGENT CARE

410 DENIM DRIVE, ERWIN, NC 28339


SHEET:
EXISTING BUILDING LAYOUT AND OUTLINE SPECS

G 1






THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

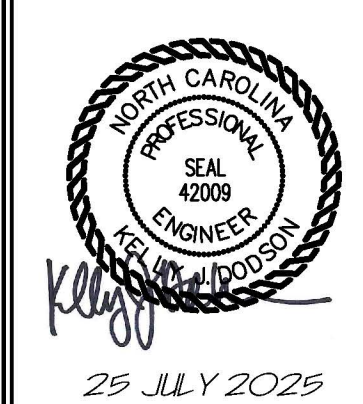[illegible]


G2.2

0 2' 4' 8' 12' 16' 20' 24' 28' 32' 36' 40' 44' 48' 52' 56' 60' 64' 68' 72' 76' 80' 84' 88' 92' 96' 100' 104' 108' 112' 116' 120' 124' 128' 132' 136' 140' 144' 148' 152' 156' 160' 164' 168' 172' 176' 180' 184' 188' 192' 196' 200' 204' 208' 212' 216' 220' 224' 228' 232' 236' 240' 244' 248' 252' 256' 260' 264' 268' 272' 276' 280' 284' 288' 292' 296' 300' 304' 308' 312' 316' 320' 324' 328' 332' 336' 340' 344' 348' 352' 356' 360' 364' 368' 372' 376' 380' 384' 388' 392' 396' 400' 404' 408' 412' 416' 420' 424' 428' 432' 436' 440' 444' 448' 452' 456' 460' 464' 468' 472' 476' 480' 484' 488' 492' 496' 500' 504' 508' 512' 516' 520' 524' 528' 532' 536' 540' 544' 548' 552' 556' 560' 564' 568' 572' 576' 580' 584' 588' 592' 596' 600' 604' 608' 612' 616' 620' 624' 628' 632' 636' 640' 644' 648' 652' 656' 660' 664' 668' 672' 676' 680' 684' 688' 692' 696' 700' 704' 708' 712' 716' 720' 724' 728' 732' 736' 740' 744' 748' 752' 756' 760' 764' 768' 772' 776' 780' 784' 788' 792' 796' 800' 804' 808' 812' 816' 820' 824' 828' 832' 836' 840' 844' 848' 852' 856' 860' 864' 868' 872' 876' 880' 884' 888' 892' 896' 900' 904' 908' 912' 916' 920' 924' 928' 932' 936' 940' 944' 948' 952' 956' 960' 964' 968' 972' 976' 980' 984' 988' 992' 996' 1000'

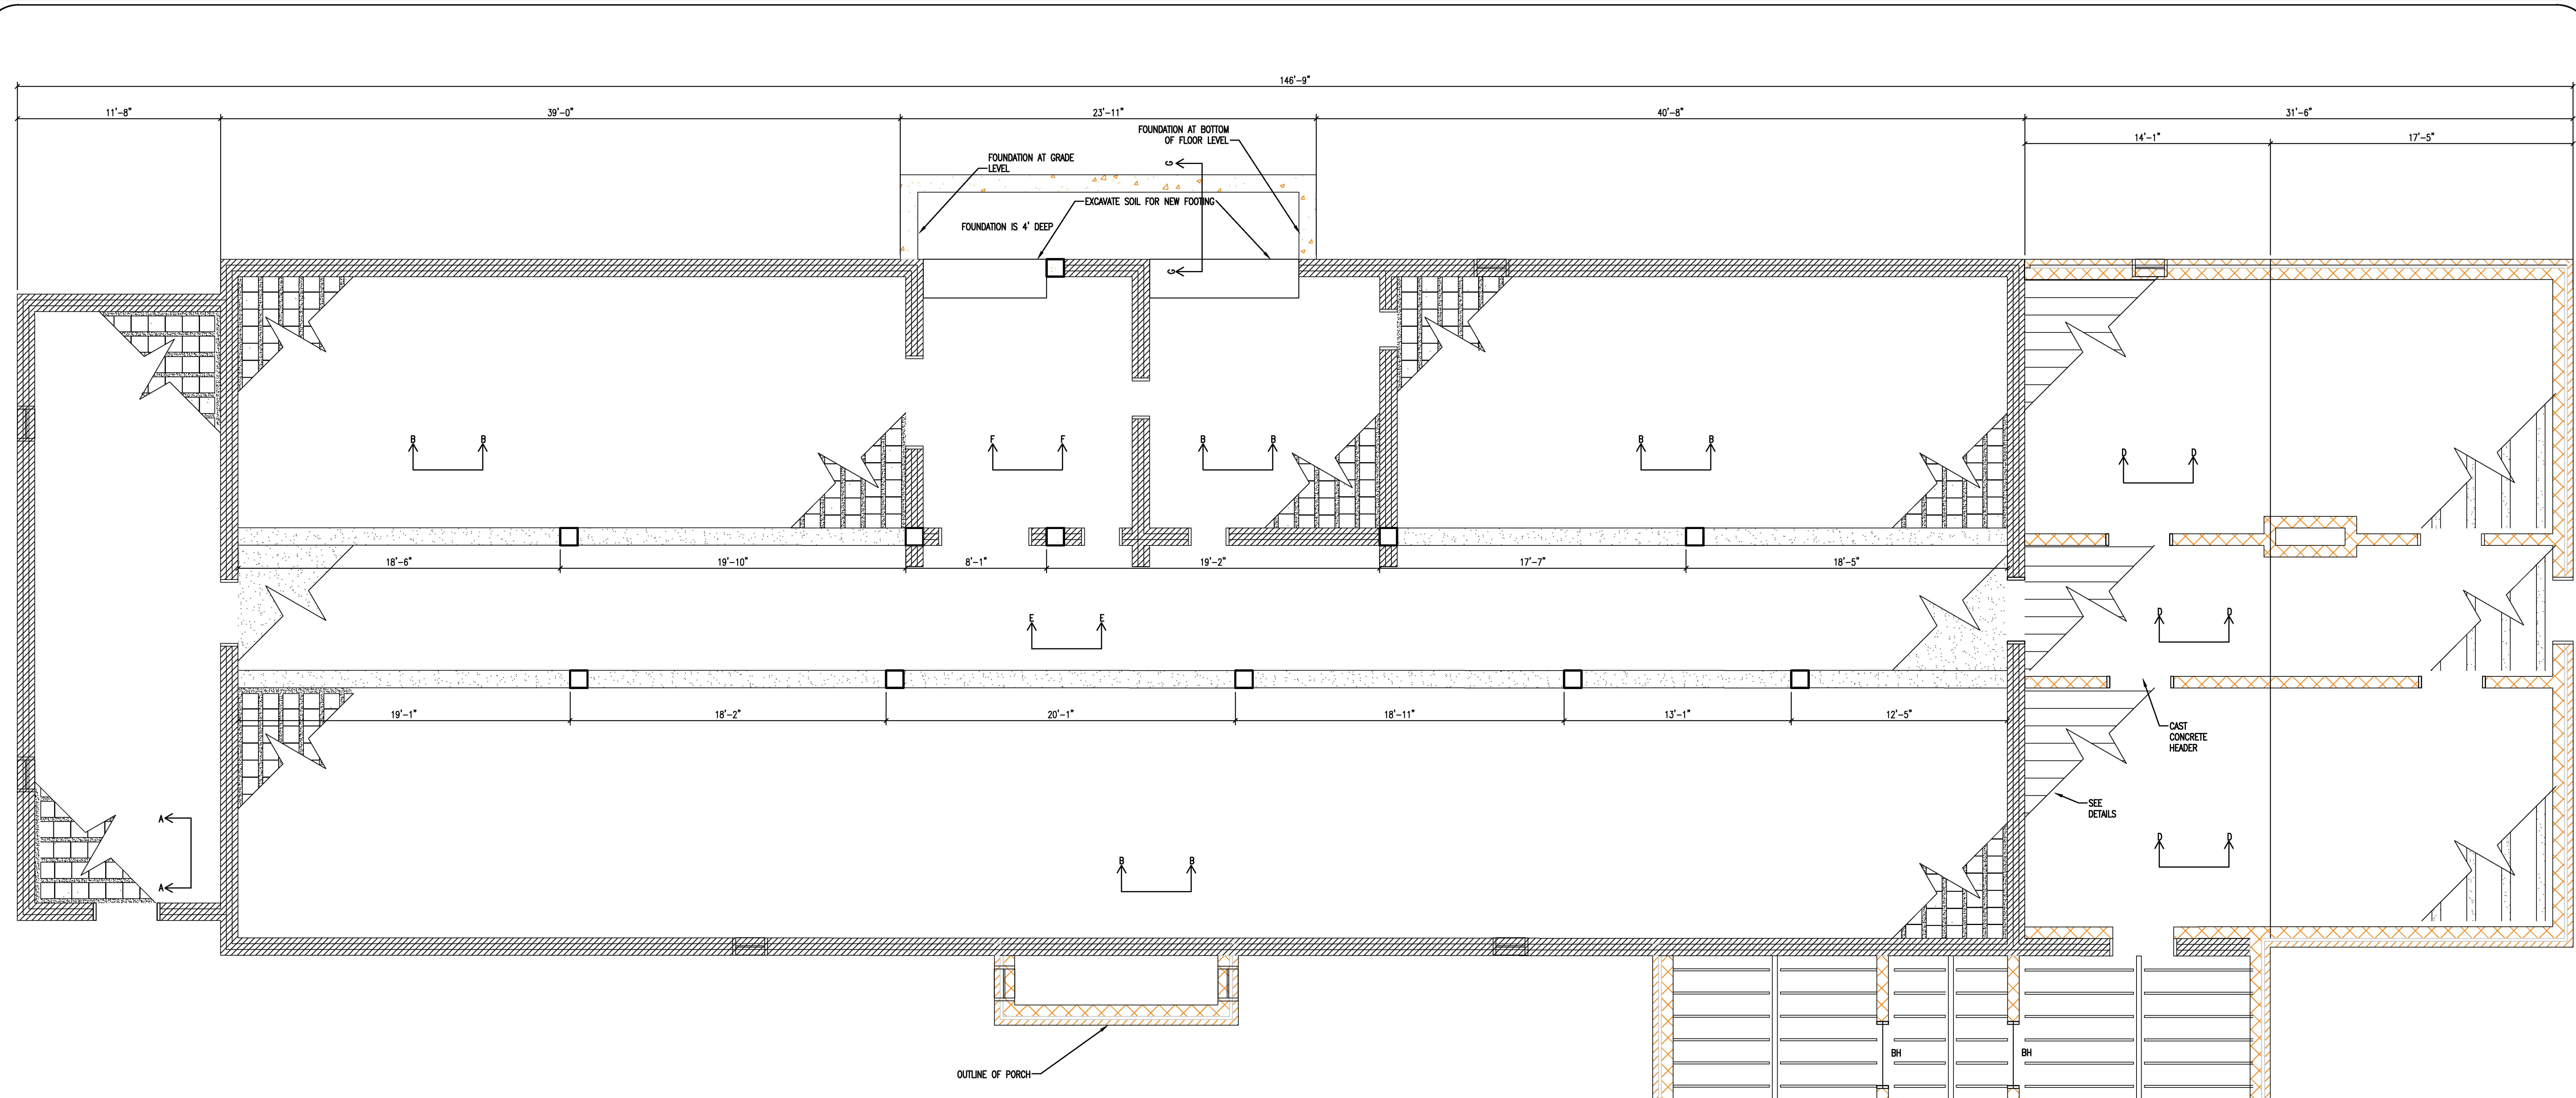

TAG	DETAIL	DESCRIPTION	AREA
A-A		4" CONCRETE 4" HOLLOW TILE	LEFT PORCH SECTION
B-B		6" CONCRETE 6" HOLLOW TILE	TYPICAL FLOOR SECTION
C-C		8" LIGHT-GAGE STRUCTURED FLOOR JOIST, 3/4" FORM DECK, 3-1/4" CONCRETE SLAB	RIGHT SIDE ADDITION SECTION
D-D		3-1/4" CONCRETE SLAB 4" PRECAST HOLLOW CONCRETE TILE AND PRE-CAST INVERTED CONCRETE TEE	RIGHT SIDE FLOOR SECTION
E-E		7-1/4" REINFORCED CONCRETE	CORRIDOR FLOOR SECTION
F-F		5" REINFORCED CONCRETE	BOILER BASEMENT SECTION
G-G		NEW FLOOR SLAB, SEE DETAILS	STORAGE ROOM SECTION

2 FLOOR SLAB SECTIONS
G2.3

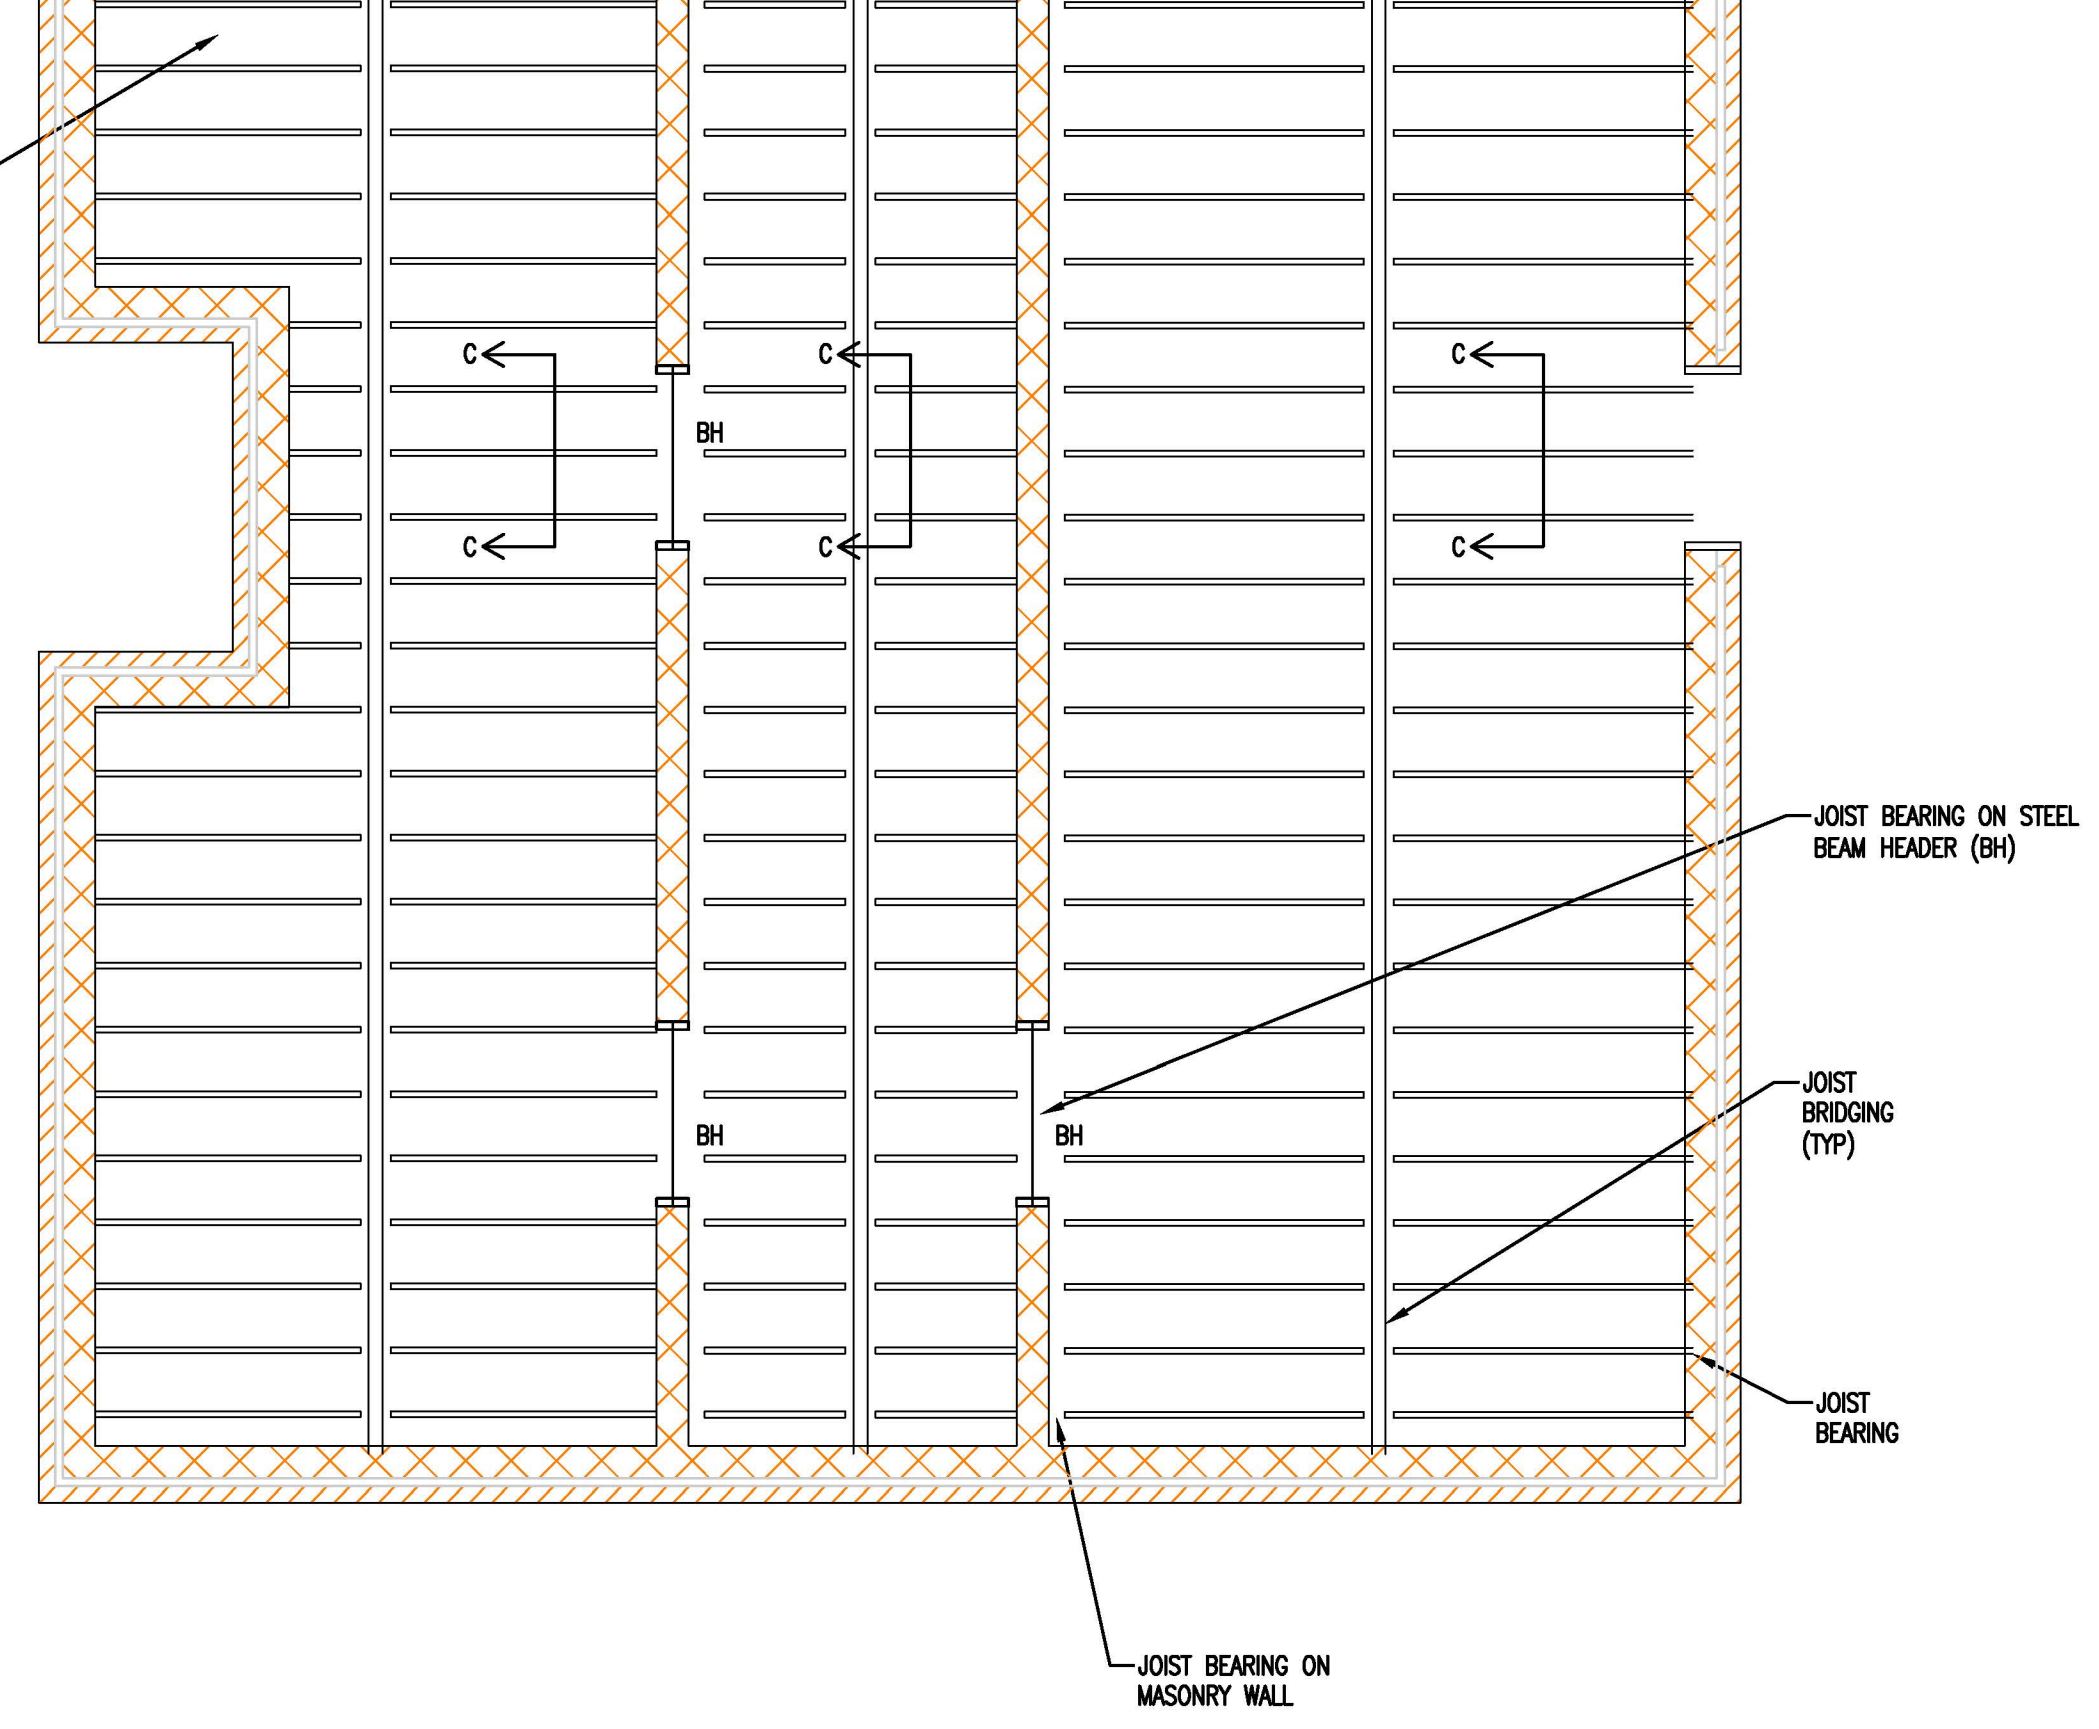

1 GROUND FLOOR FRAMING PLAN
G2.3
SCALE: 1/4" = 1'-0"

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

J. JENKINS
CONSULTING ENGINEERS, P.A.
OFFICE IN: RICHMOND SPRINGS, NORTH CAROLINA
NORTH CAROLINA CORPORATION NUMBER C-3030
CAPITAL PROJECTS, LLC
P.O. BOX 5507

DESIGNED/CHECKED BY: KJD
DRAWN BY: TS, SAN, ED, BT, JC, JDL
PROJECT #: 2025-01-16
DATE: 25 JULY 2025

FINAL DRAWING [] FOR REVIEW PURPOSES ONLY
PRELIMINARY [] TOP/DESIGN DEVELOPMENT ONLY
FINAL DRAWING [] FOR CONSTRUCTION
OWNER/CLIENT: HOSPITAL
CONTRACTOR/BUILDER: STE GENERAL CONTRACTORS LLC
100 TILGHMAN DRIVE, DALL, NC 28334

PROJECT: ALTERATION LEVEL III - GOOD HOPE BEHAVIORAL URGENT CARE
410 DENIM DRIVE, ERWIN, NC 28339

SHEET: EXISTING GROUND FLOOR FRAMING PLAN

G2.3





THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM



DRAWN BY:	KJD
-----------	-----

TS,SAN,GD,BT,JC,JDL

PROJECT #: 2025-01-16

DATE: 2023-01-10

PRELIMINARY ☐ FOR DESIGN DEVELOPMENT ONLY
FINAL DRAWING ☒ FOR CONSTRUCTION

OWNER/TENANT:

GOOD HOPE HOSPITAL
410 DENIM DRIVE, ERWIN, NC 28339

CONTRACTOR/BUILDER:
STE GENERAL CONTRACTORS LLC

		<
--	--	---

ALTERATION LEVEL III - GOOD HOPE BEHAVIORAL URGENT CARE


410 DENIM DRIVE, ERWIN, NC 28339

SHEET: _____


BUILDING ELEVATIONS

G3


0 4' 8' 12' 16' 20' 24' 28' 32' 36' 40' 44' 48' 52' 56' 60' 64' 68' 72' 76' 80' 84' 88' 92' 96' 100' 104' 108' 112' 116' 120' 124' 128' 132' 136' 140' 144' 148' 152' 156' 160' 164' 168' 172' 176' 180' 184' 188' 192' 196' 200' 204' 208' 212' 216' 220' 224' 228' 232' 236' 240' 244' 248' 252' 256' 260' 264' 268' 272' 276' 280' 284' 288' 292' 296' 300' 304' 308' 312' 316' 320' 324' 328' 332' 336' 340' 344' 348' 352' 356' 360' 364' 368' 372' 376' 380' 384' 388' 392' 396' 400' 404' 408' 412' 416' 420' 424' 428' 432' 436' 440' 444' 448' 452' 456' 460' 464' 468' 472' 476' 480' 484' 488' 492' 496' 500' 504' 508' 512' 516' 520' 524' 528' 532' 536' 540' 544' 548' 552' 556' 560' 564' 568' 572' 576' 580' 584' 588' 592' 596' 600' 604' 608' 612' 616' 620' 624' 628' 632' 636' 640' 644' 648' 652' 656' 660' 664' 668' 672' 676' 680' 684' 688' 692' 696' 700' 704' 708' 712' 716' 720' 724' 728' 732' 736' 740' 744' 748' 752' 756' 760' 764' 768' 772' 776' 780' 784' 788' 792' 796' 800' 804' 808' 812' 816' 820' 824' 828' 832' 836' 840' 844' 848' 852' 856' 860' 864' 868' 872' 876' 880' 884' 888' 892' 896' 900' 904' 908' 912' 916' 920' 924' 928' 932' 936' 940' 944' 948' 952' 956' 960' 964' 968' 972' 976' 980' 984' 988' 992' 996' 1000'

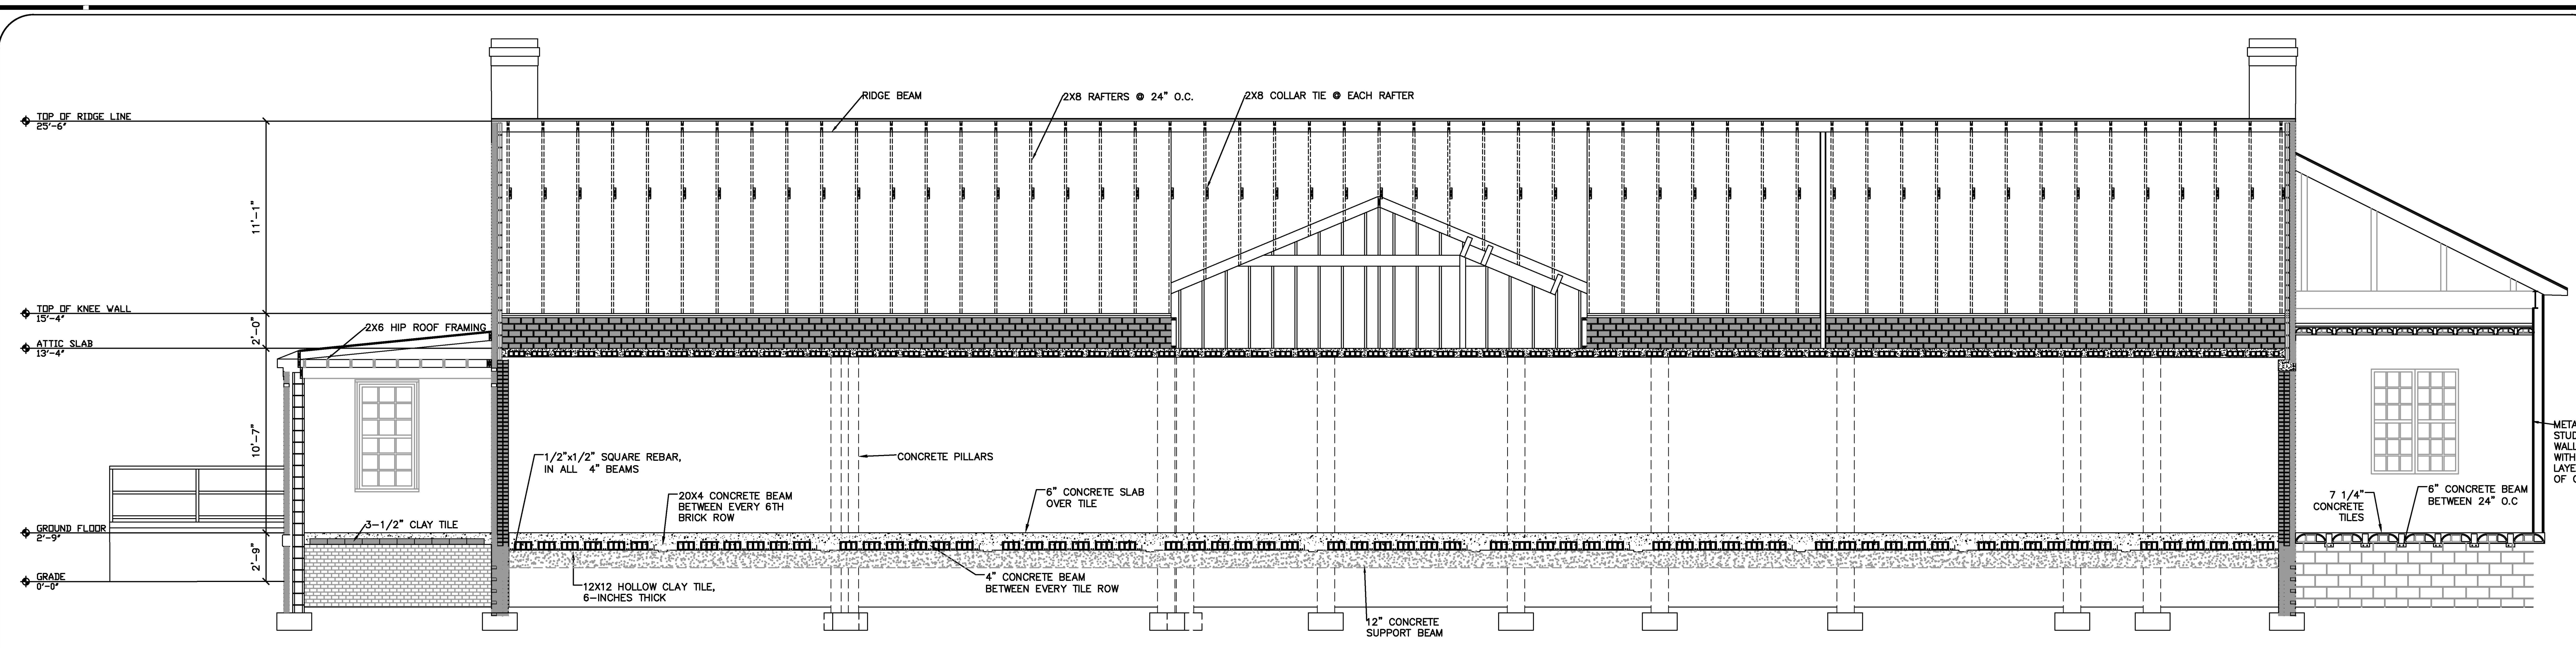


1 BUILDING SECTION A
SCALE: 1/4" = 1'-0"

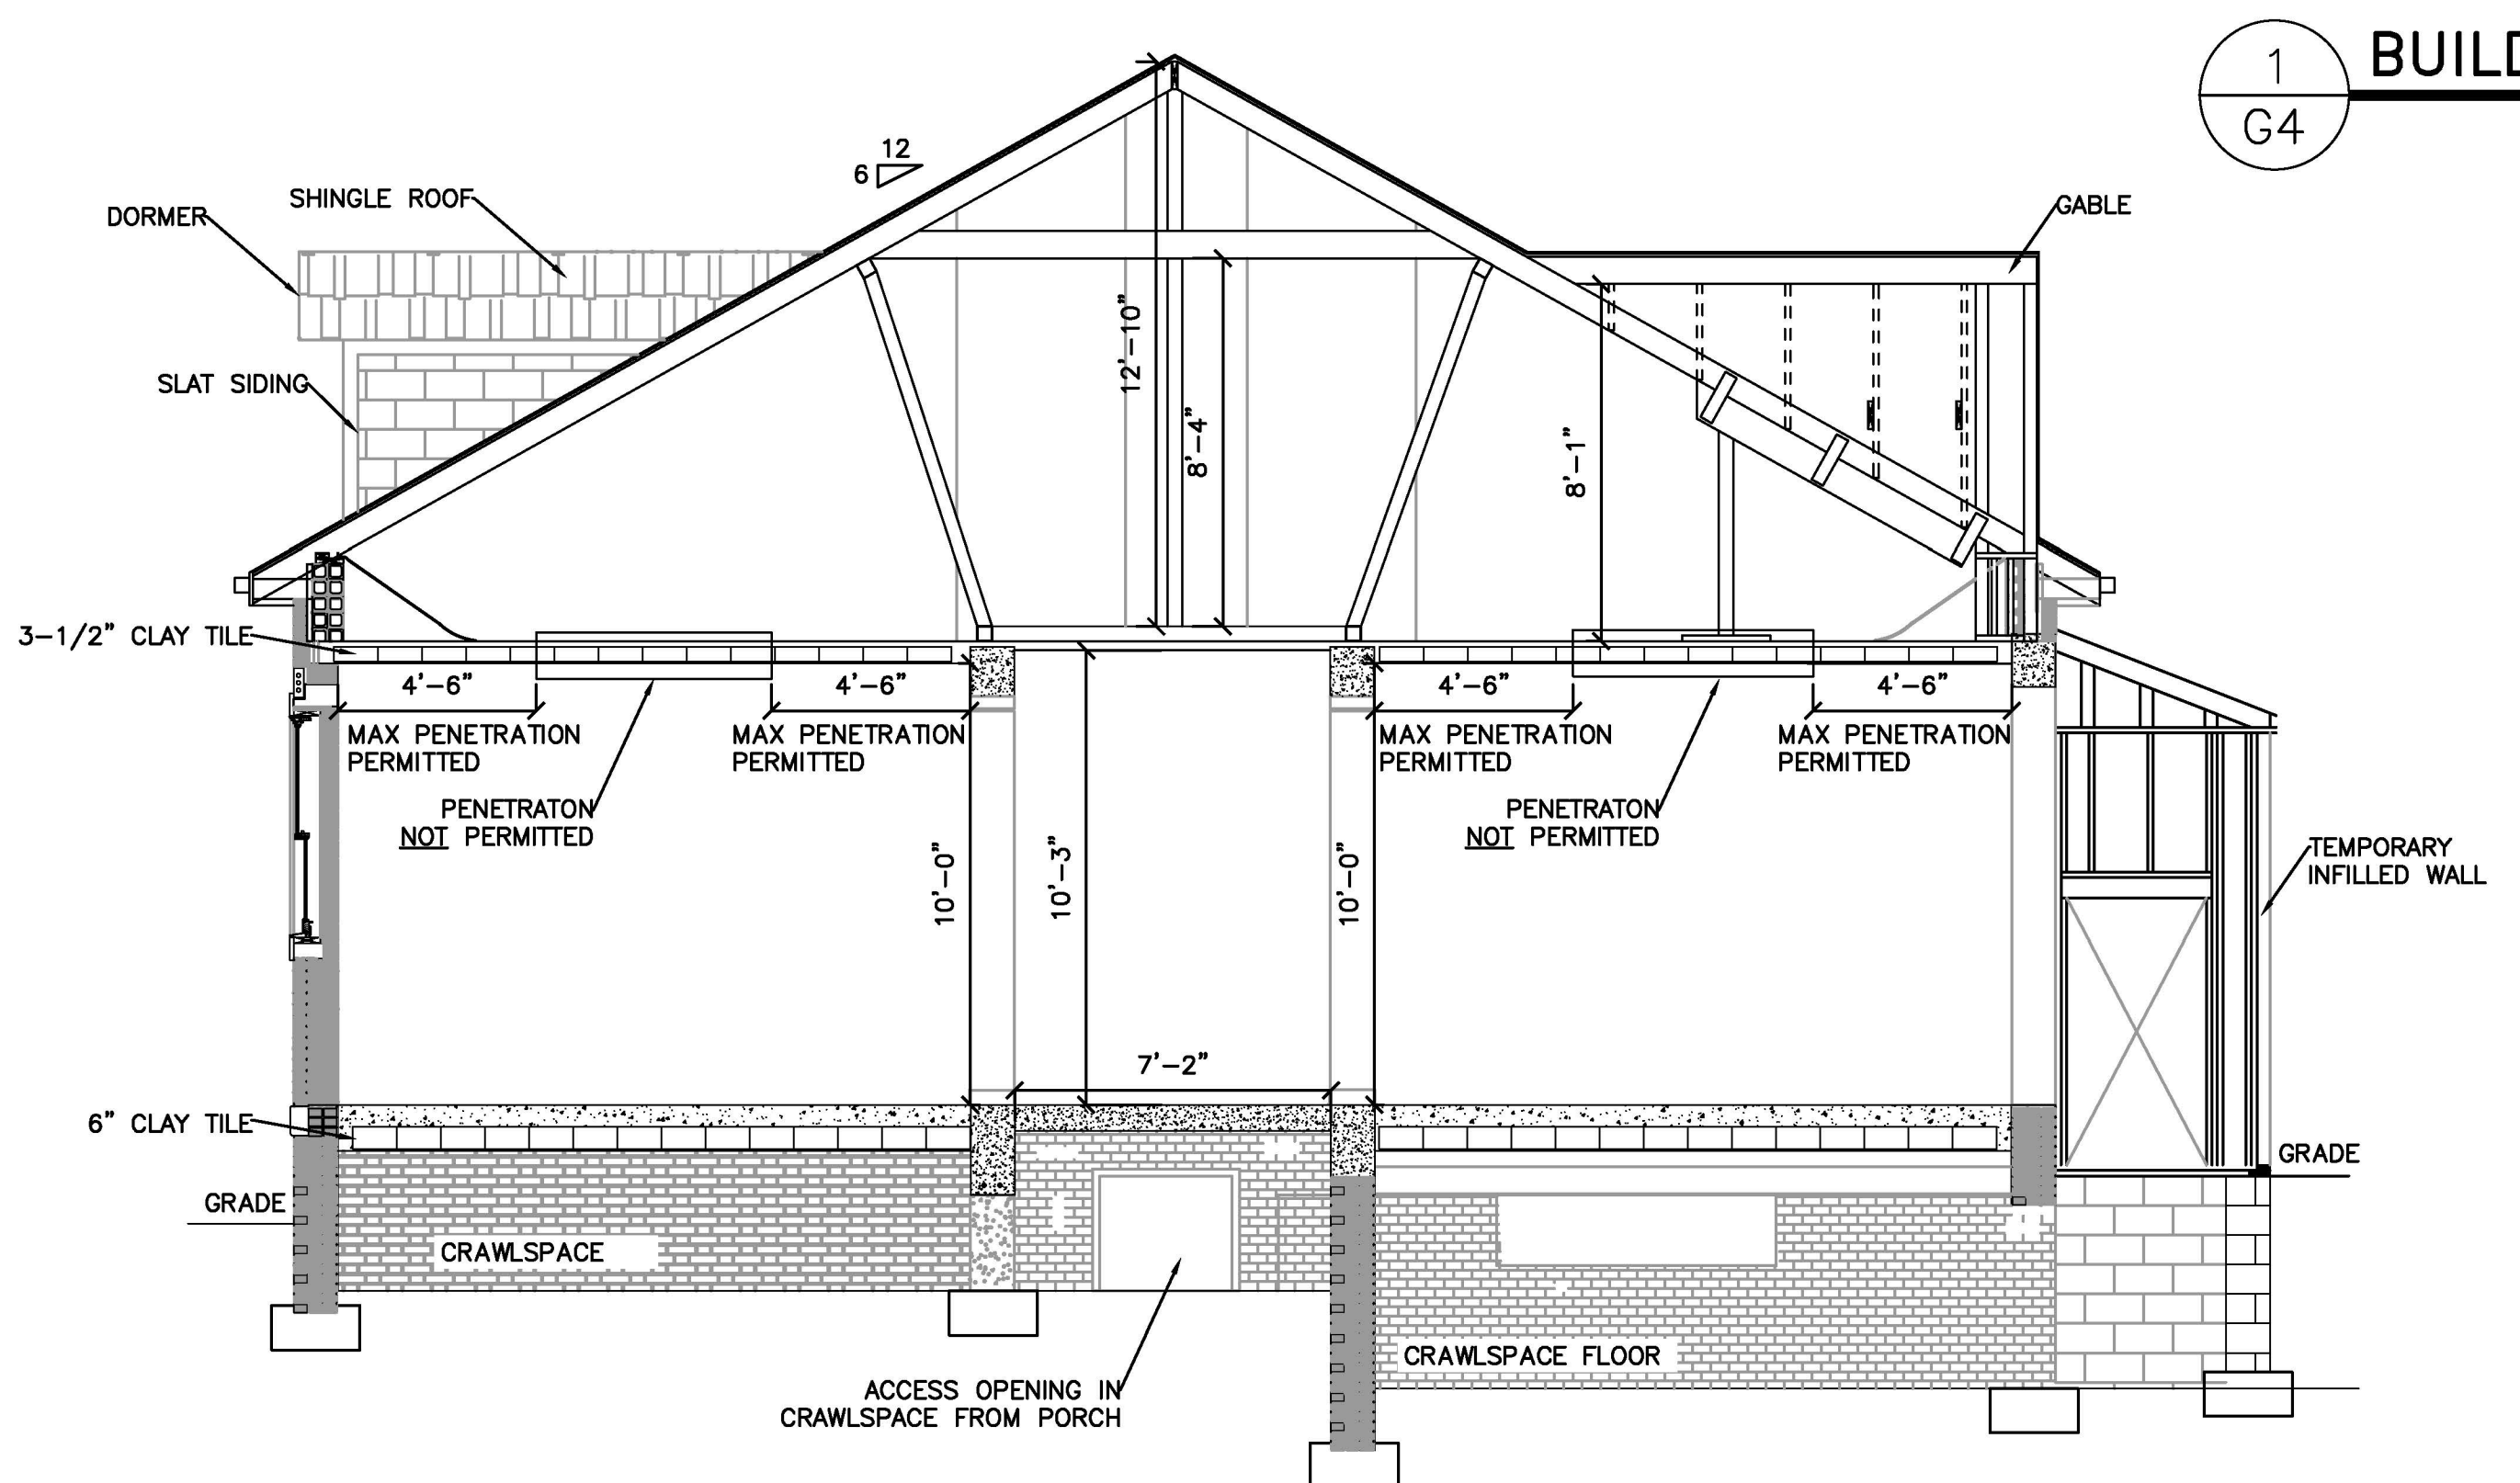


2 BUILDING SECTION B
SCALE: 1/4" = 1'-0"

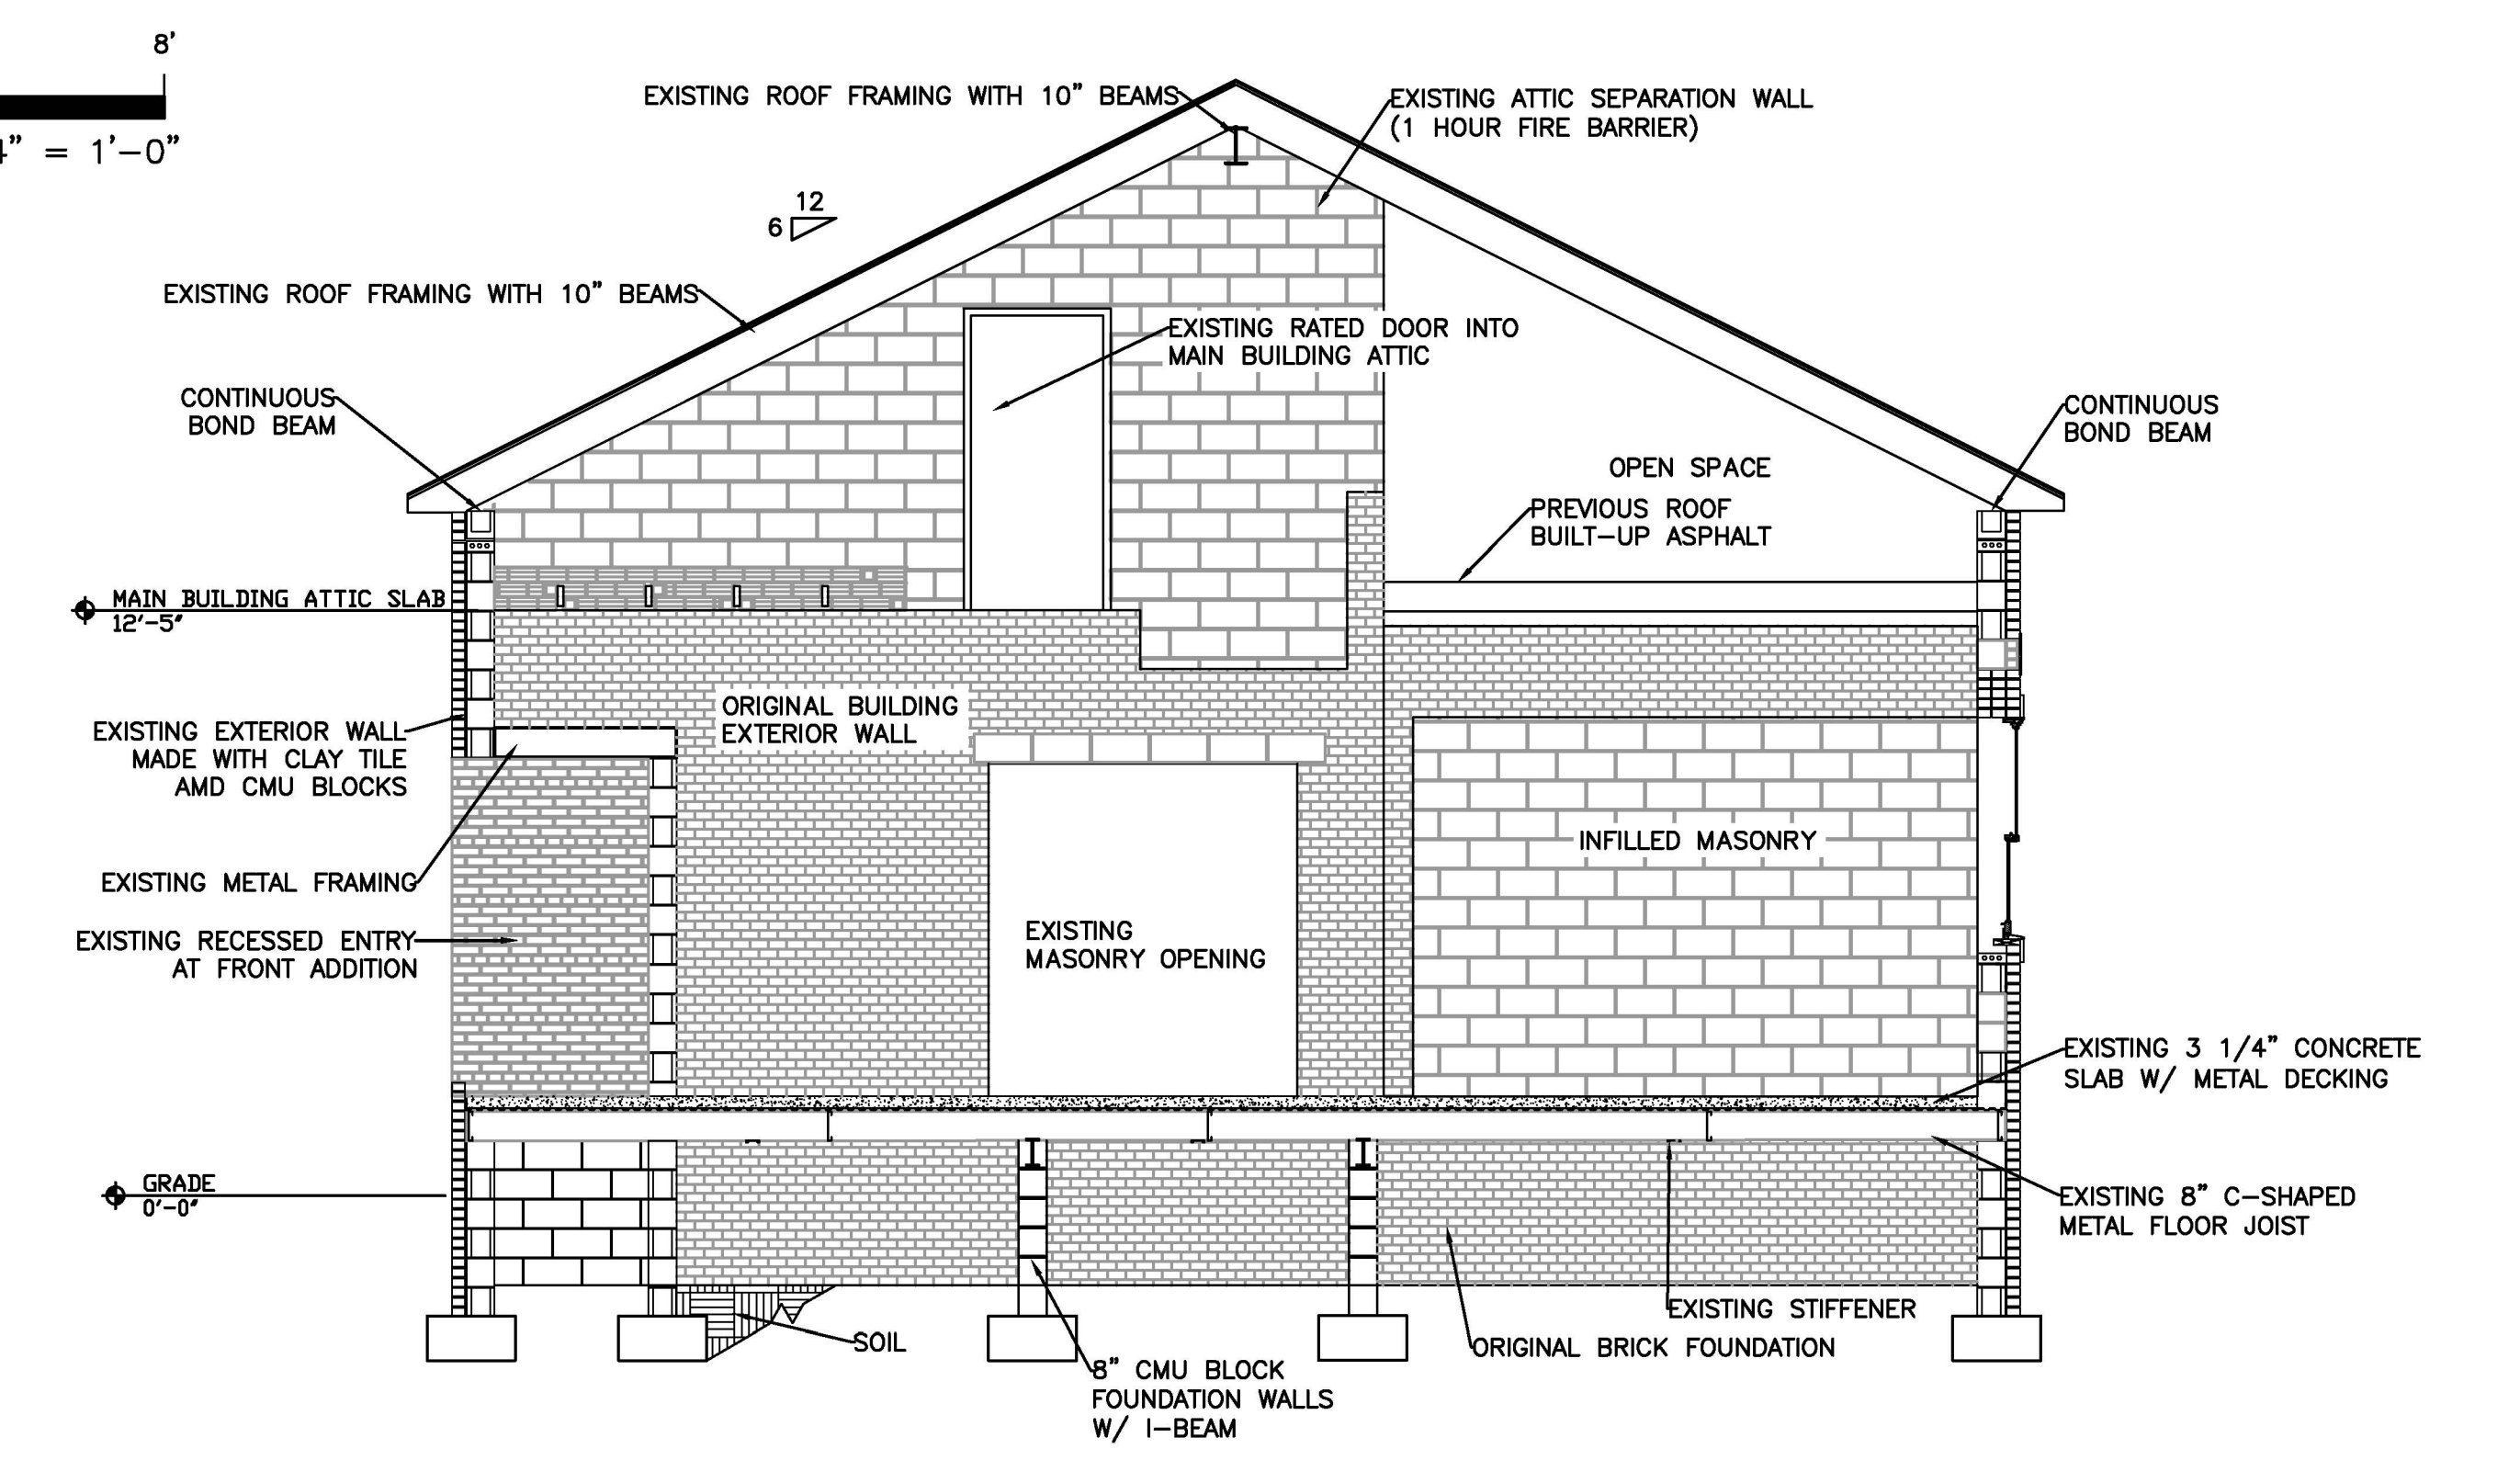

3 BUILDING SECTION C
SCALE: 1/4" = 1'-0"

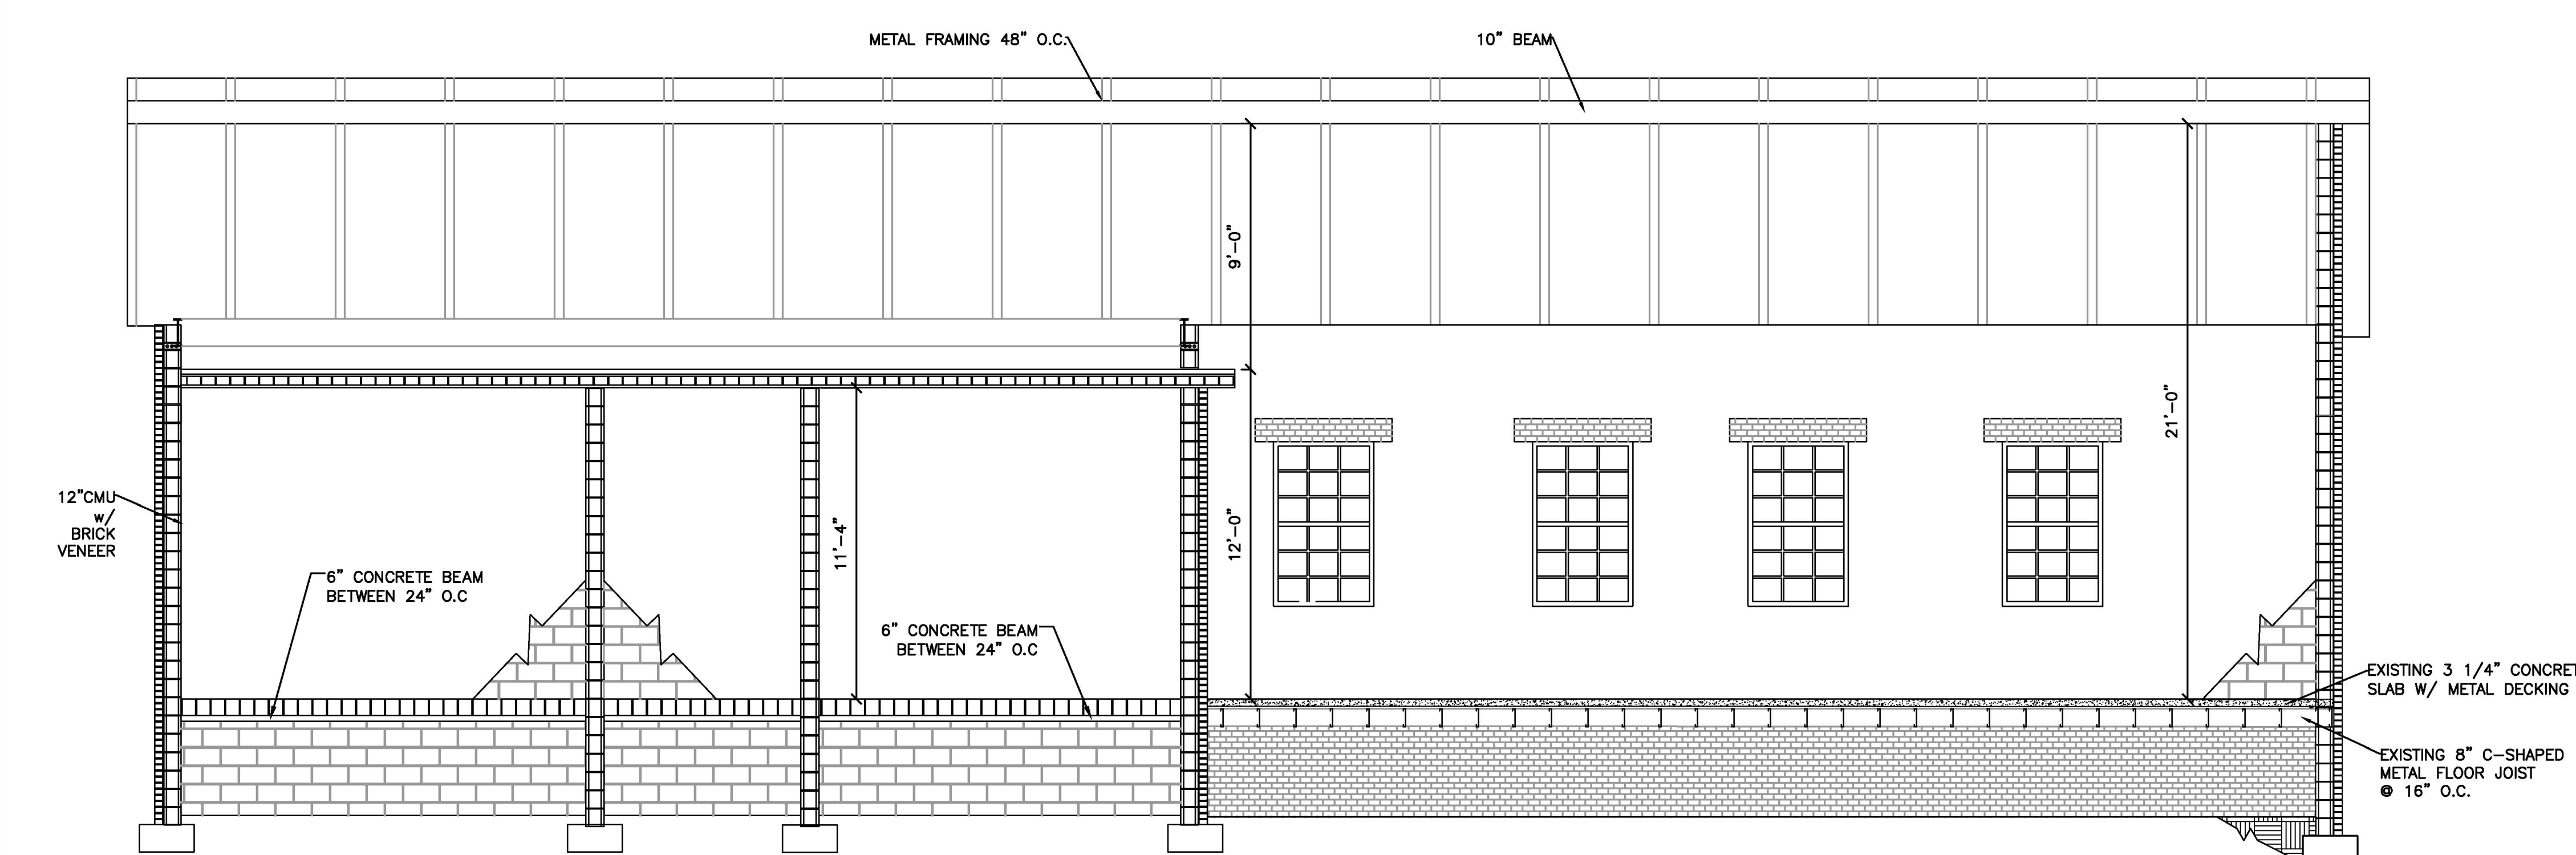

4 BUILDING SECTION D
SCALE: 1/4" = 1'-0"

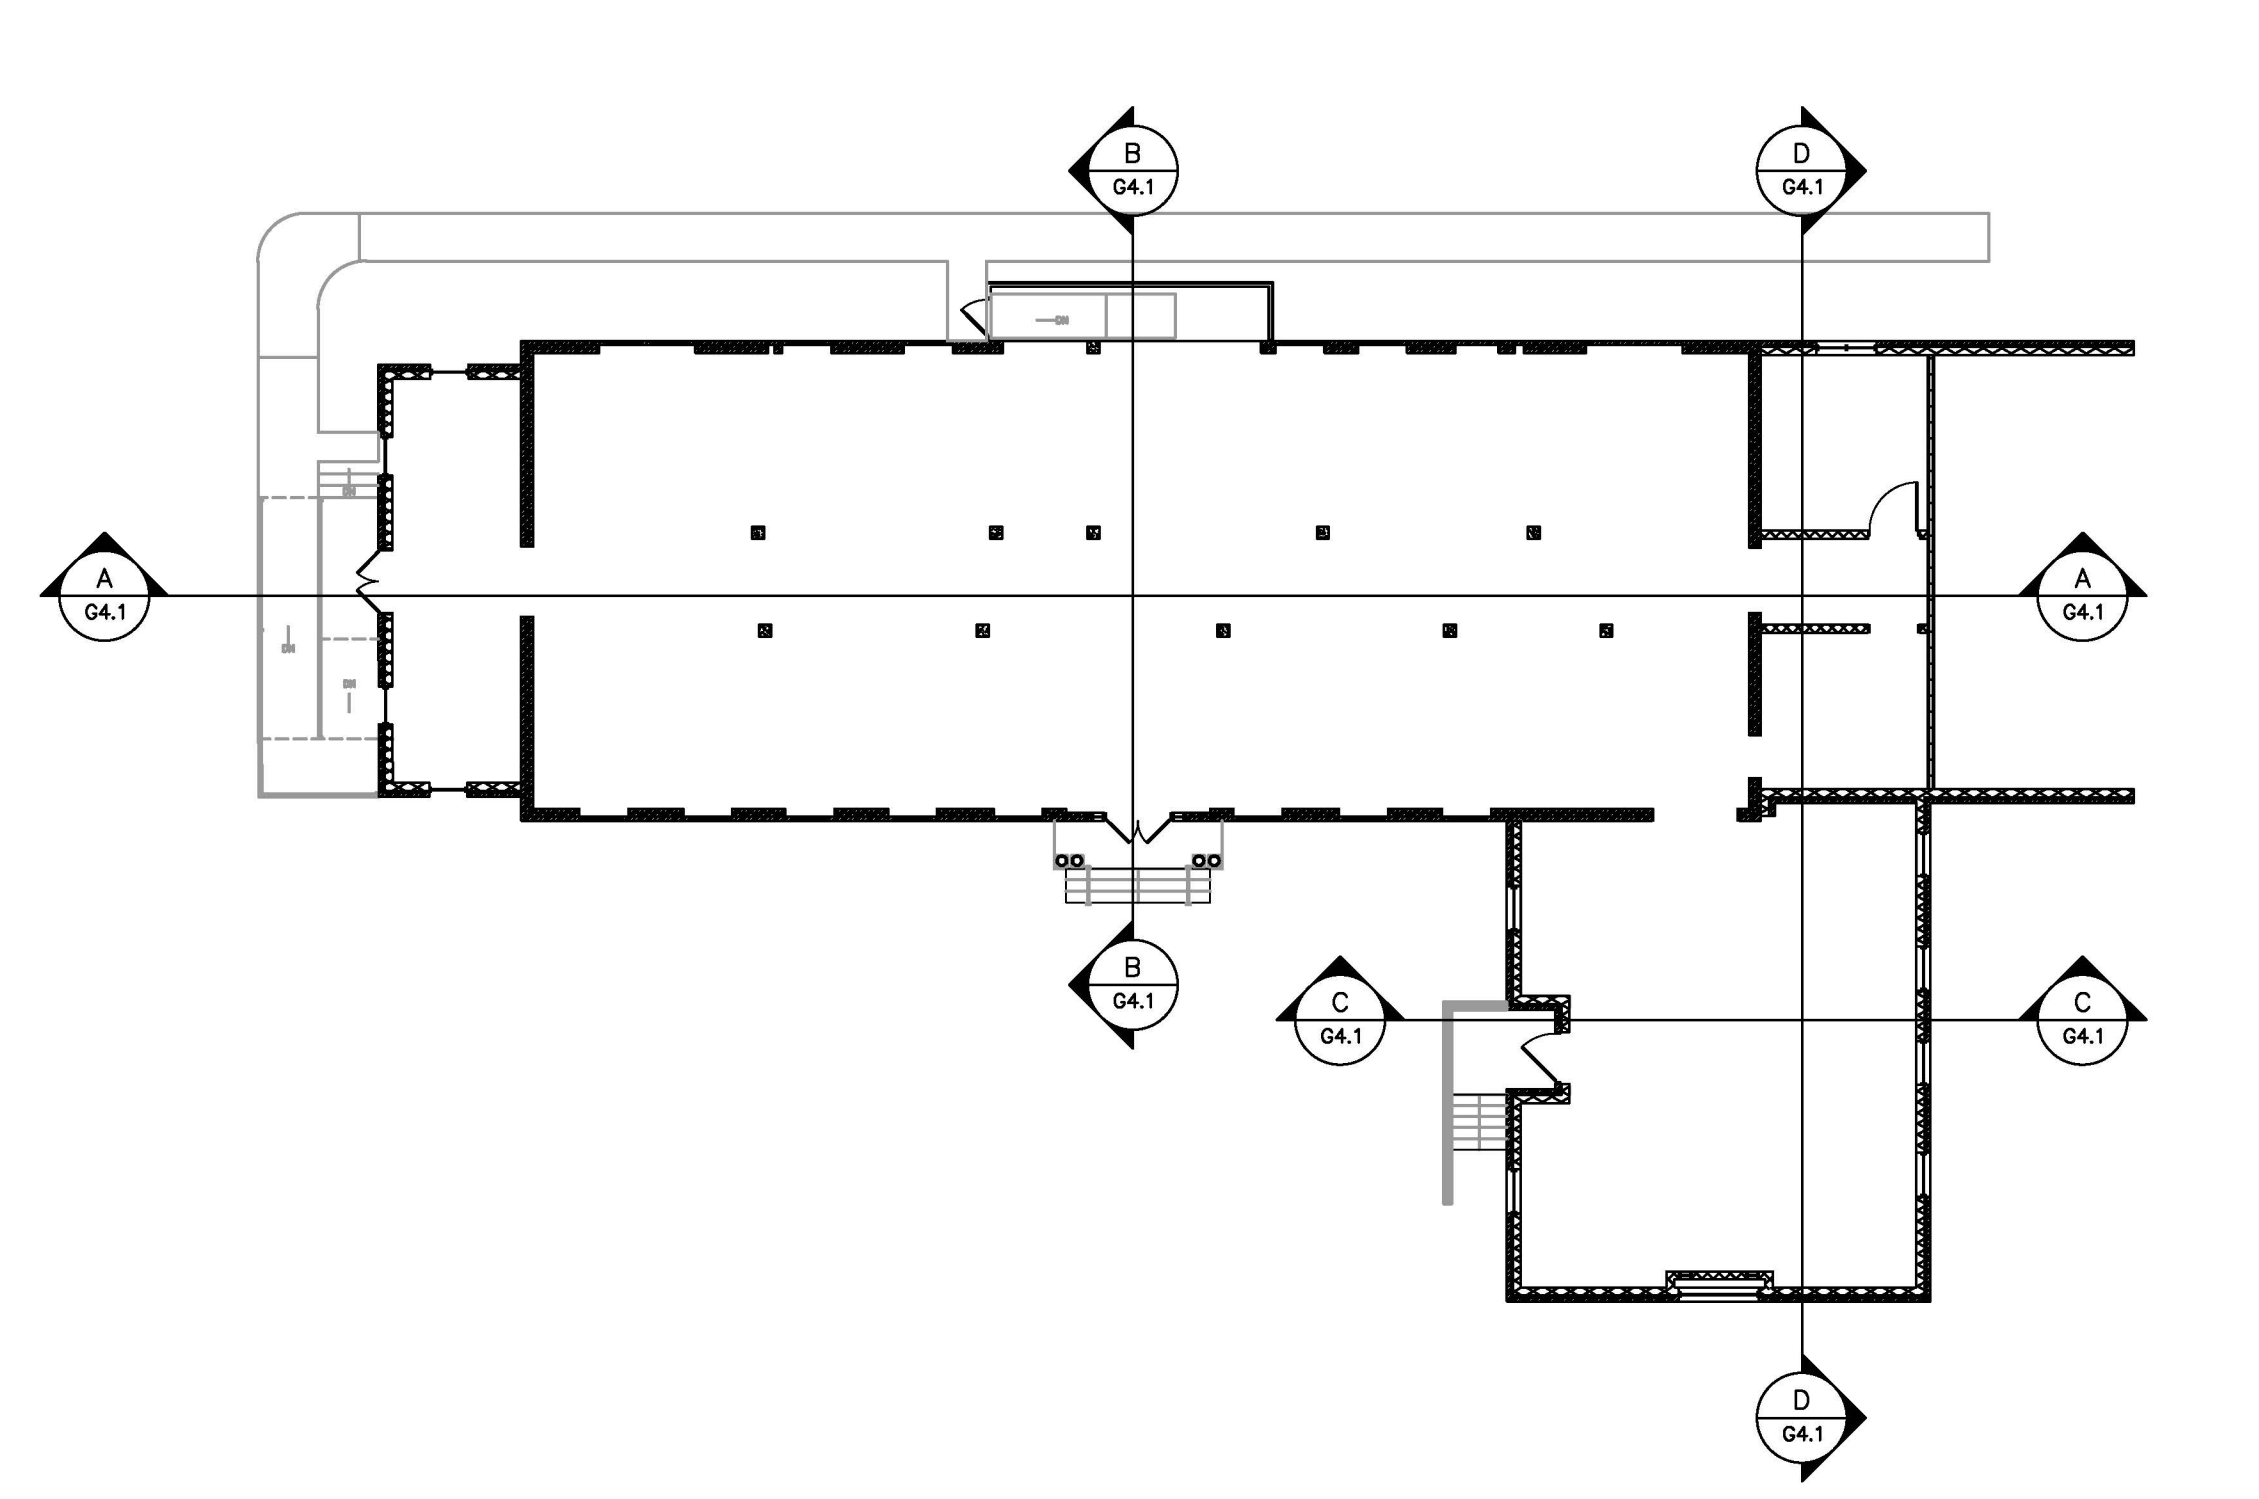

5 SECTION KEY PLAN
SCALE: 1/16" = 1'-0"

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

J. JENKINS
CONSULTING ENGINEERS, P.A.
OFFICE IN GREENSBORO, NORTH CAROLINA
NORTH CAROLINA CORPORATION NUMBER 03030
CAPITAL PROJECTS
P.O. BOX 5907
GREENSBORO, NC 27402

J. JENKINS
CONSULTING ENGINEERS, P.A.
OFFICE IN GREENSBORO, NORTH CAROLINA
NORTH CAROLINA CORPORATION NUMBER 03030
CAPITAL PROJECTS
P.O. BOX 5907
GREENSBORO, NC 27402

DESIGNED/CHECKED BY: **KJD**

DRAWN BY: **TS, SAN, GD, BT, JC, JDL**

PROJECT #: **2025-01-16**

DATE: **25 JULY 2025**

FINAL DRAWING ☐ FOR REVIEW PURPOSES ONLY

PRELIMINARY ☐ FOR DESIGN DEVELOPMENT ONLY

FINAL DRAWING ☒ FOR CONSTRUCTION

OWNER/CLIENT: **GOOD HOPE HOSPITAL**

CONTRACTOR/BUILDER: **STE GENERAL CONTRACTORS LLC**



100 TILGHMAN DRIVE, DANN, NC 28334









PROJECT: **ALTERATION LEVEL III - GOOD HOPE BEHAVIORAL URGENT CARE**

410 DENIM DRIVE, ERWIN, NC 28339

SHEET: **EXISTING BUILDING SECTIONS & DETAILS**

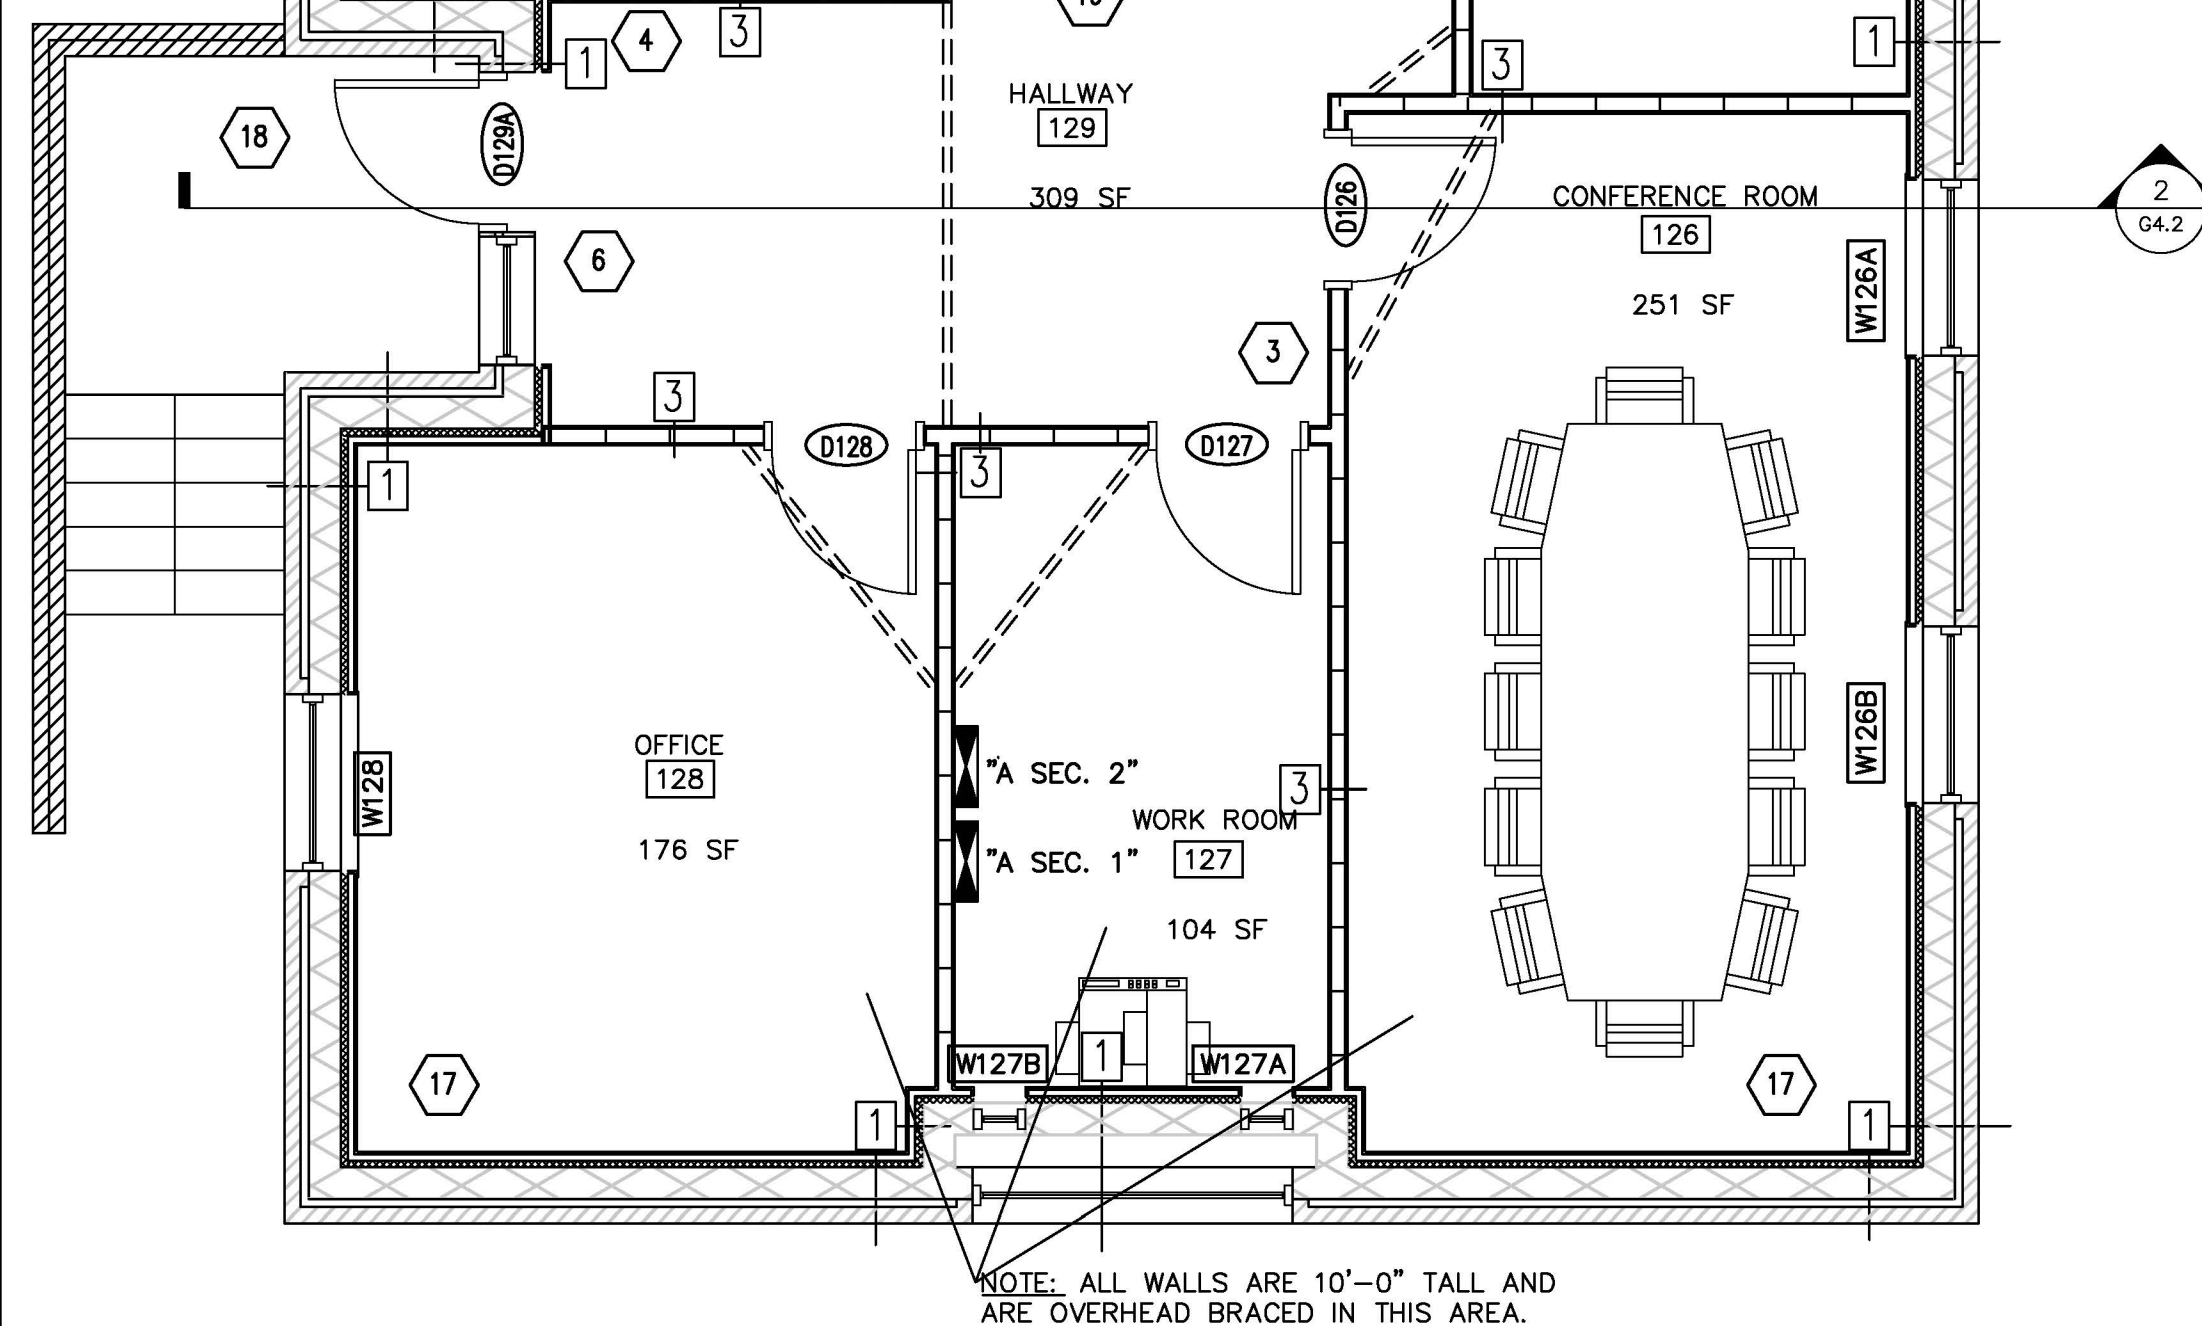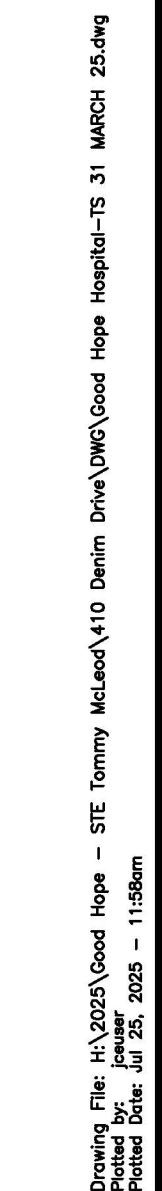
G4

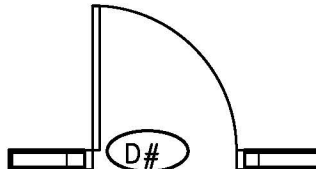


SYMBOL LEGEND	
SYMBOL	DESCRIPTION
1ST GRADE 	ROOM NAME ROOM NUMBER
	WALL TYPE, SEE WALL LEGEND, THIS SHEET
	DETAIL NUMBER SECTION / DETAIL TAG SHEET NUMBER
 	WINDOW & WINDOW NUMBER SEE WINDOW SCHEDULE FOR DETAILS
+2'-4" 	SPOT ELEVATIONS
	DOOR & DOOR NUMBER SEE DOOR SCHEDULE FOR DETAILS
	ELECTRICAL PANEL

BUILDING CONSTRUCTION KEYED NOTES

1	PATCH & PREPARE CONCRETE FLOOR SURFACES BY GRINDING HIGH SPOTS AND FILLING LOW SPOTS, WITH ARDEX CONCRETE PATCH OR EQUIVALENT NON-SHRINK PATCH. FLOORS SHALL BE FLAT TO 1/8-INCH WHEN MEASURED WITH A 10-FOOT STRAIGHT EDGE.
2	SAW CUT THE EXISTING MASONRY FOR INSTALLATION OF NEW HOLLOW METAL FRAME FOR DOOR AND SIDE LIGHT. FRAME SHALL BE SET AND MASONRY LAID TO THE FRAME, TO THE EXISTING MASONRY ROUGH OPENING. DOOR SHALL BE 42-INCHES WIDE AND 94-INCHES TALL. SEE DOOR SCHEDULE FOR ADDITIONAL REQUIREMENTS.
3	CONSTRUCT NEW INTERIOR PARTITION WALLS WITH METAL STUDS AND GYPSUM WALL BOARD. SEE WALL TAGS AND WALL SECTIONS AND DETAILS. WALLS SHALL EXTEND TO THE ATTIC DECK ABOVE.
4	PROVIDE RESTROOM WALLS WITH INTERIOR SOUND-DEADENING INSULATION TYPE BATTS BETWEEN THE STUDS *PROVIDE OWNER WITH OPTION FOR INSTALLATION OF SOUND-DEADENING BATTS IN ALL INTERIOR PARTITIONS.
5	PROVIDE METAL STUD FRAMING AT EXISTING WINDOWS TO ALLOW FOR JAMB, HEAD AND SILL FINISHES. SEE DETAILS G10.1 TYPICAL OF ALL WINDOWS.
6	PROVIDE NEW DOOR THRESHOLD AT EXTERIOR DOOR TO PROVIDE FLUSH TRANSITION FROM EXTERIOR CONCRETE SLAB AND INTERIOR FINISHED FLOORING. REPLACE DOOR, HARDWARE, SIDELIGHT AND TRANSOM GLAZING.
7	PROVIDE NEW ATTIC ACCESS LADDER MOUNTED TO THE WALL IN ROOM 132. SEE DETAILS G15.3.
8	PROVIDE NEW DOOR FRAME OR CASED OPENING FRAME IN EXISTING MASONRY OPENING.
9	PROVIDE FIXED GLASS OBSERVATION WINDOWS AT NURSES STATION EAST WALL.
10	PROVIDE HORIZONTAL SLIDING WINDOWS FOR SERVICE AT FRONT DESKS 102 & 108.
11	PROVIDE METAL STUD FRAMING TO WRAP EXISTING CONCRETE COLUMNS.
12	PROVIDE 12" x 1" THICK WALL GUARDS (CHAIR RAIL) AT 42" HEIGHT.
13	PROVIDE MILL WORK AT NURSES STATION, INTAKE ROOMS, FRONT DESKS, STAFF BREAKROOM, PANTRY, & WARMING KITCHEN. SEE DETAILS ON G14.1
14	INSTALL NEW MASONRY HEADER ABOVE NEW DOOR AND FRAME. OPTIONAL SQUEEZE LITEL MAY BE USED. SEE DETAIL ON G2.1.
15	REMOVE EXISTING DOOR AND ABANDON THE METAL DOOR FRAMES. INFILL WALL OPENING WITH NEW METAL STUD PARTITION.
16	MAINTAIN THE EXISTING MASONRY CHASE FOR INSTALLATION OF HVAC LINE SETS. SEAL PENETRATIONS AT FLOOR SLAB AND ATTIC SLAB PRIOR TO FURRING OVER CHASE.
17	INSTALL NEW WALL INSULATION (R-9.5 CONTINUOUS INSULATION) ON EXTERIOR WALL SURFACES FROM FLOOR TO ROOF FRAMING. INSULATE THE EXTERIOR KNEE WALL ABOVE THE ATTIC SLAB.
18	PRESSURE WASH AND REPAIR MASONRY STEPS, STOOP, AND RAMP AT EXISTING ENTRANCES. PRIME AND PAINT HANDRAILS.
19	INSTALL R-19 (MINIMUM) INSULATION BATTS IN METAL JOIST FLOOR FRAMING SYSTEM IN THE RIGHT-FRONT ADDITION AREA.
20	PROVIDE OWNER WITH A PROPOSAL FOR OPTIONAL SOUND-BATT INSTALLATION IN ALL INTERIOR WALLS FOR SOUND DEADENING. SEE KEYED NOTE #4.
21	INSTALL 1/4" STEEL PLATE OVER ATTIC ACCESS OPENING
22	INSTALL 45MIN. RATED DOOR IN EXISTING FRAME LOCATED ON ATTIC FLOOR
23	ALL NEW INTERIOR PARTITION WALLS IN THIS AREA SHALL BE OVERHEAD BRACED WITH 6-INCH METAL STUDS ATTACHED TO TOP PLATE OF PARTITION

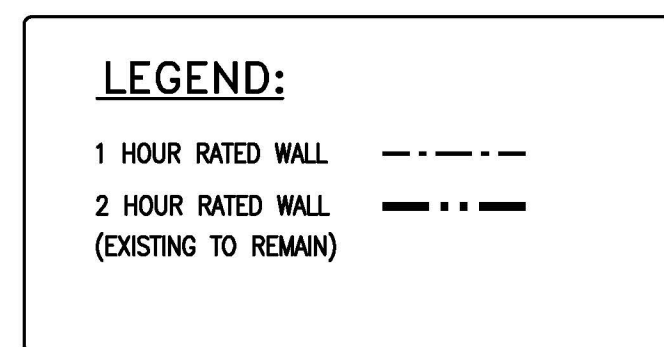

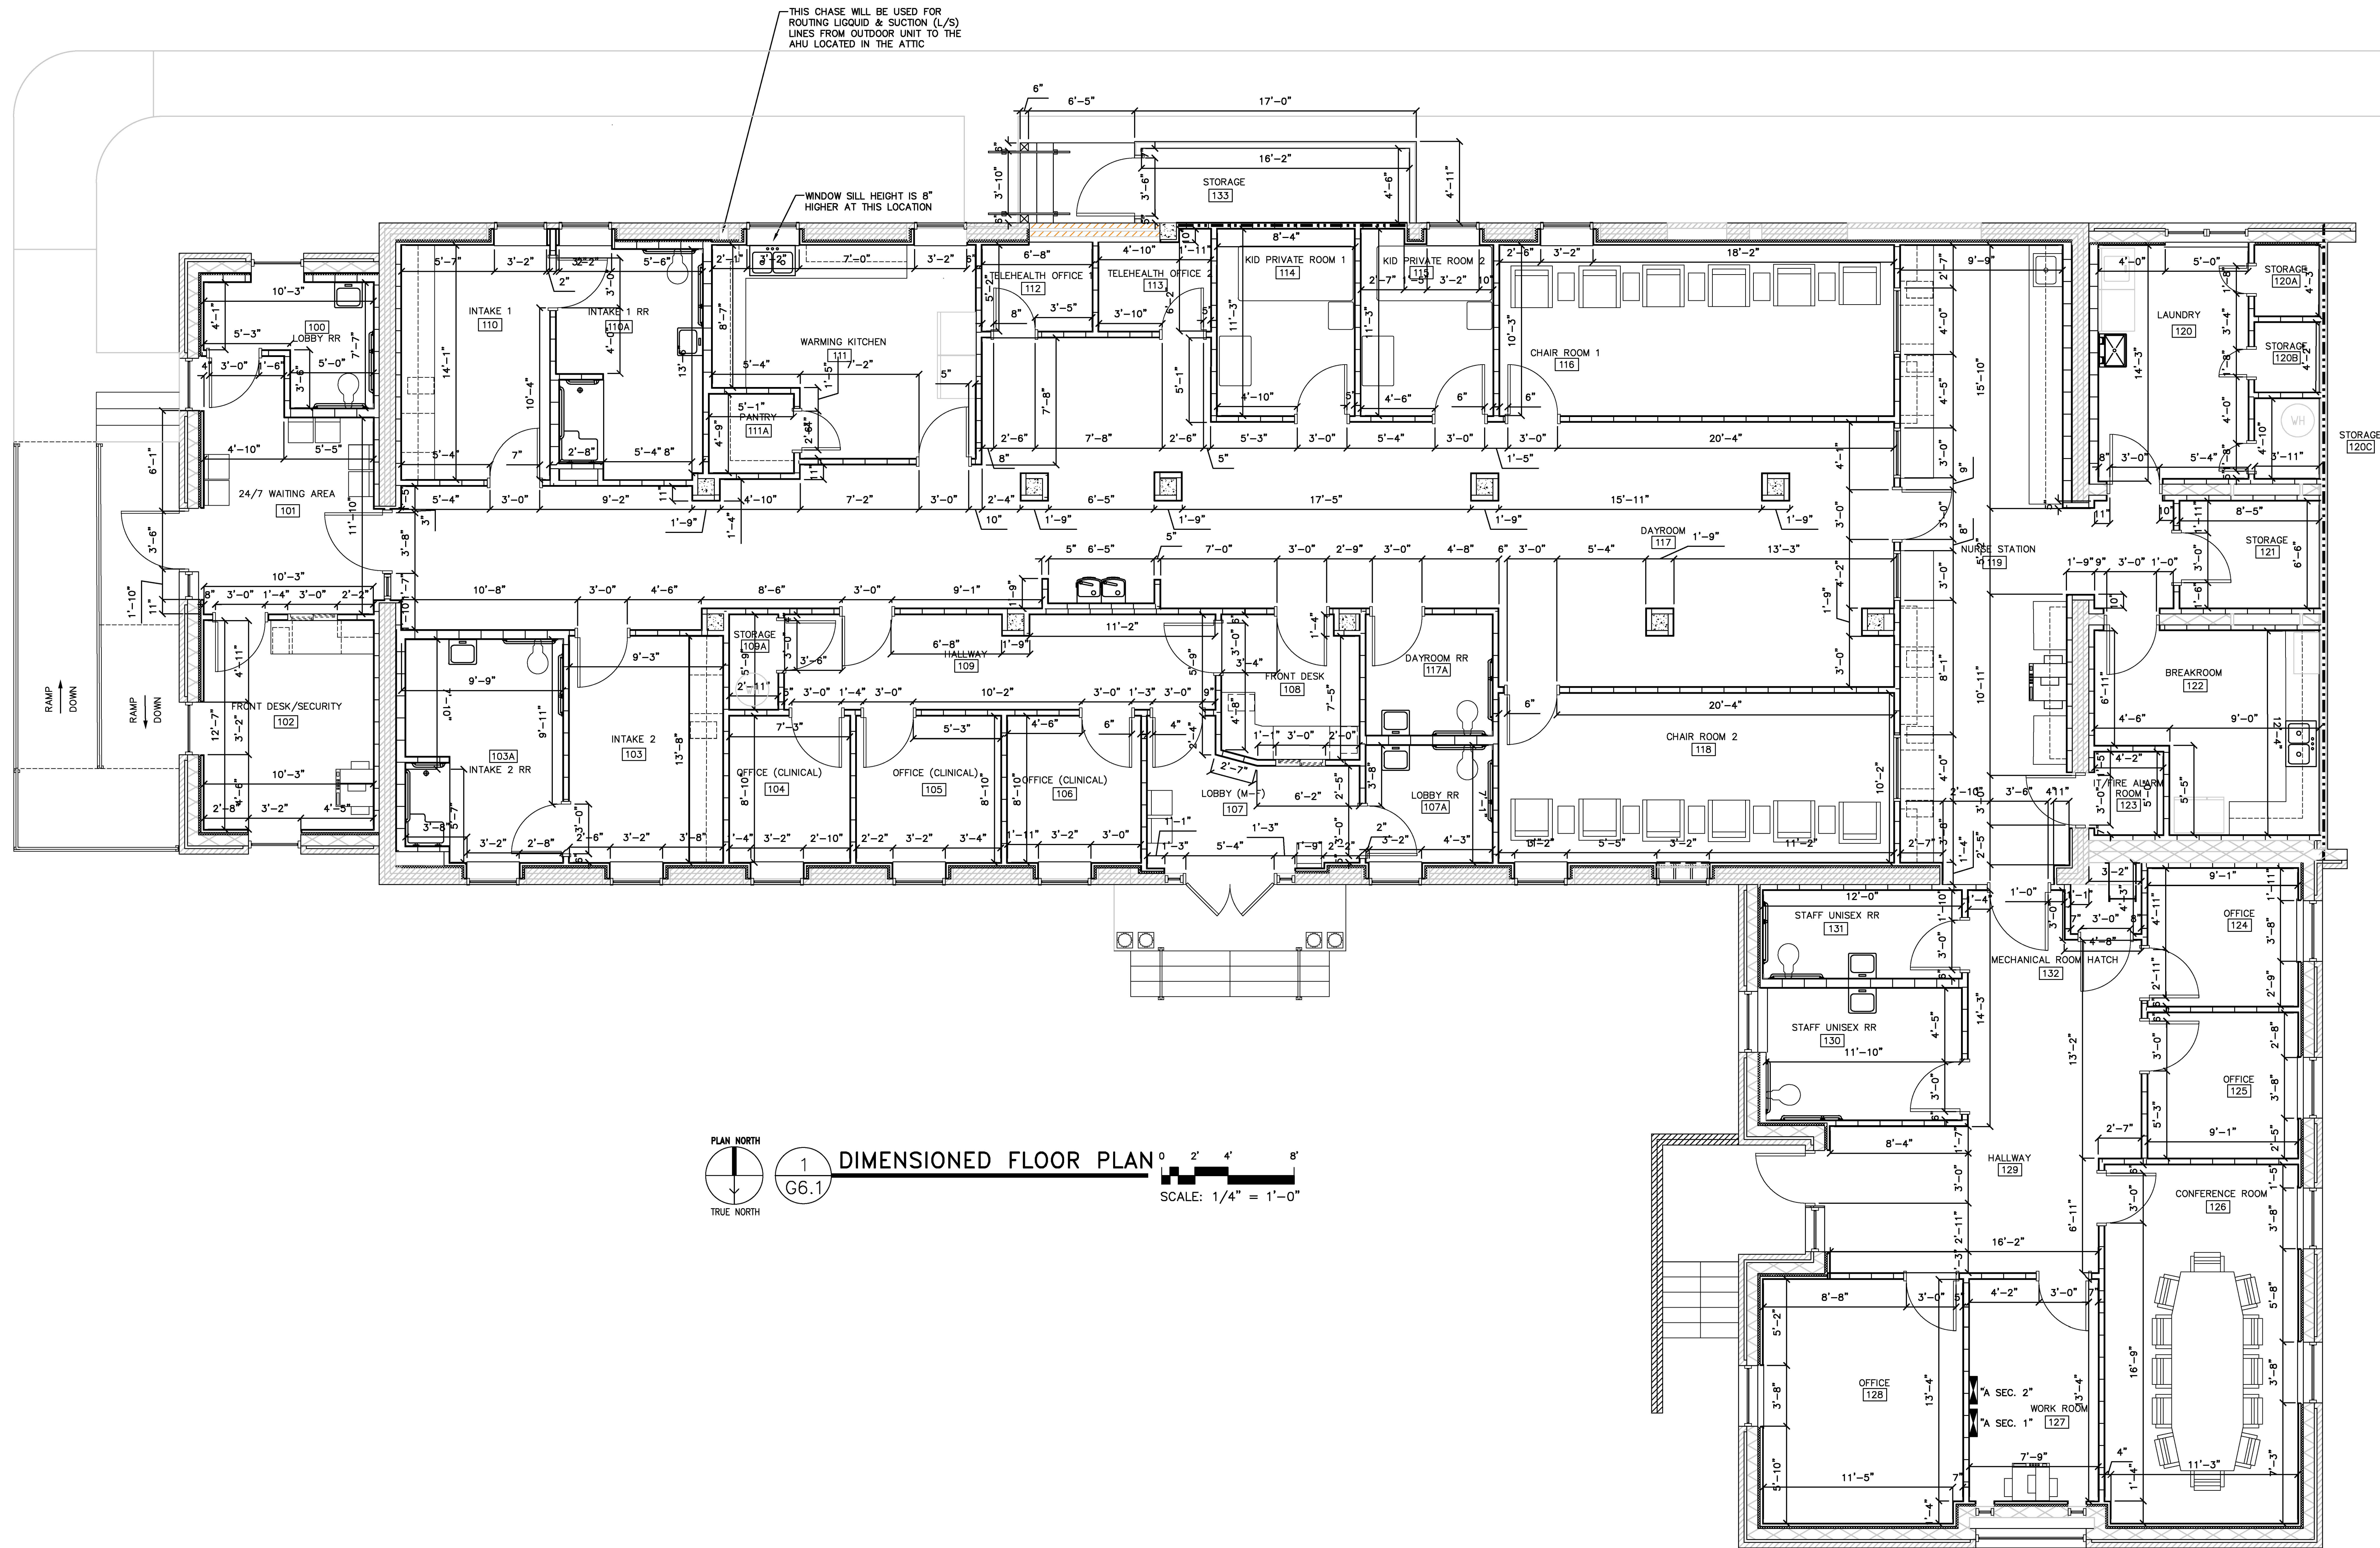


Drawing File: H:\2025\Good Hope - STE Tommy McLeod\410 Denrim Drive\DWG\Good Hope Hospital-TS 31 MARCH 25.dwg



1
G6.1

DIMENSIONED FLOOR PLAN

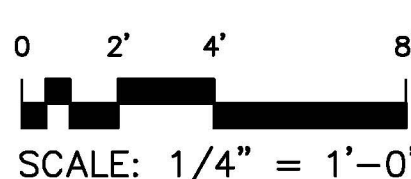

25 JULY 2025

DESIGNED/CHECKED BY: KJD
DRAWN BY: TS,SAN,GD,BT,JC,JDL
PROJECT #: 2025-01-16
DATE: 25 JULY 2025

FINAL DRAWING ☐ FOR REVIEW PURPOSES ONLY
PRELIMINARY ☐ FOR DESIGN DEVELOPMENT ONLY
FINAL DRAWING ☒ FOR CONSTRUCTION

OWNER/TENANT:
GOOD HOPE HOSPITAL
410 DENN DRIVE, ERWIN, NC 28539

CONTRACTOR/BUILDER:
STE GENERAL CONTRACTORS LLC.
400 W. BURNING TREE DRIVE, NO. 400-2002


[illegible]

PROJECT: **ALTERATION LEVEL III - GOOD HOPE BEHAVIORAL URGENT CARE**
 410 DENIM DRIVE, ERWIN, NC 28339

SHEET: **DIMENSIONED FLOOR PLAN**

G6.1

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

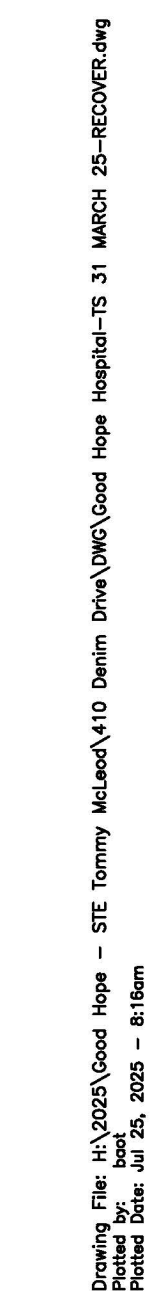

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM



LEGEND:		
LVP - LUXURY VINYL PLANK	ACT - ACOUSTICAL CEILING TILE	HM - HOLLOW METAL
PR - PRIMER	BL - BLINDS	W - WOOD
B - BASE COAT	ETR - EXISTING TO REMAIN	BR - BRICK
F - FINISH COAT	C - CONCRETE	FR - FIRE RATED
PVC-F - POLY VINYL FLEXIBLE	CH - CHAIR RAIL	GL - GLASS
CER - CERAMIC TILE	OWB - GYPSUM WALL BOARD	V - VINYL
	SC - SEALED CONCRETE	HM - MOISTURE RESISTANT GWS
		SSS - SOUND SURFACE SILL
		EXP - EXPOSED (UNFINISHED)



JENKINS
CONSULTING ENGINEERS, PA
OFFICE IN EUREKA SPRINGS, NORTH CAROLINA
1000 MARTIN RD. FAYETTEVILLE, NC 28411-1002
CORPORATION MAILING ADDRESS
OFFICE 910.662.724
FAX 910.638.5907



25 JULY 2025

DESIGNED/CHECKED BY:	KJD
DRAWN BY:	TS,SAN,GD,BT,JC,JDL
PROJECT #:	2025-01-16
DATE:	

FINAL DRAWING ☐ FOR REVIEW PURPOSES ONLY
PRELIMINARY ☐ FOR DESIGN DEVELOPMENT ONLY
FINAL DRAWING ☒ FOR CONSTRUCTION

OWNER/TENANT:
GOOD HOPE HOSPITAL
410 DEAN DRIVE, ERMING, NC 28339

CONTRACTOR/BUILDER:
SITE GENERAL CONTRACTORS LLC.

[illegible]

PROJECT: **ALTERATION LEVEL III - GOOD HOPE BEHAVIORAL URGENT CARE**
410 DENIM DRIVE, ERWIN, NC 28339


ET: FINISH SCHEDULE

G8



NOTES:

1. ALL EXTERIOR WINDOWS ARE EXISTING.
2. ALL INTERIOR WINDOWS ARE NEW.

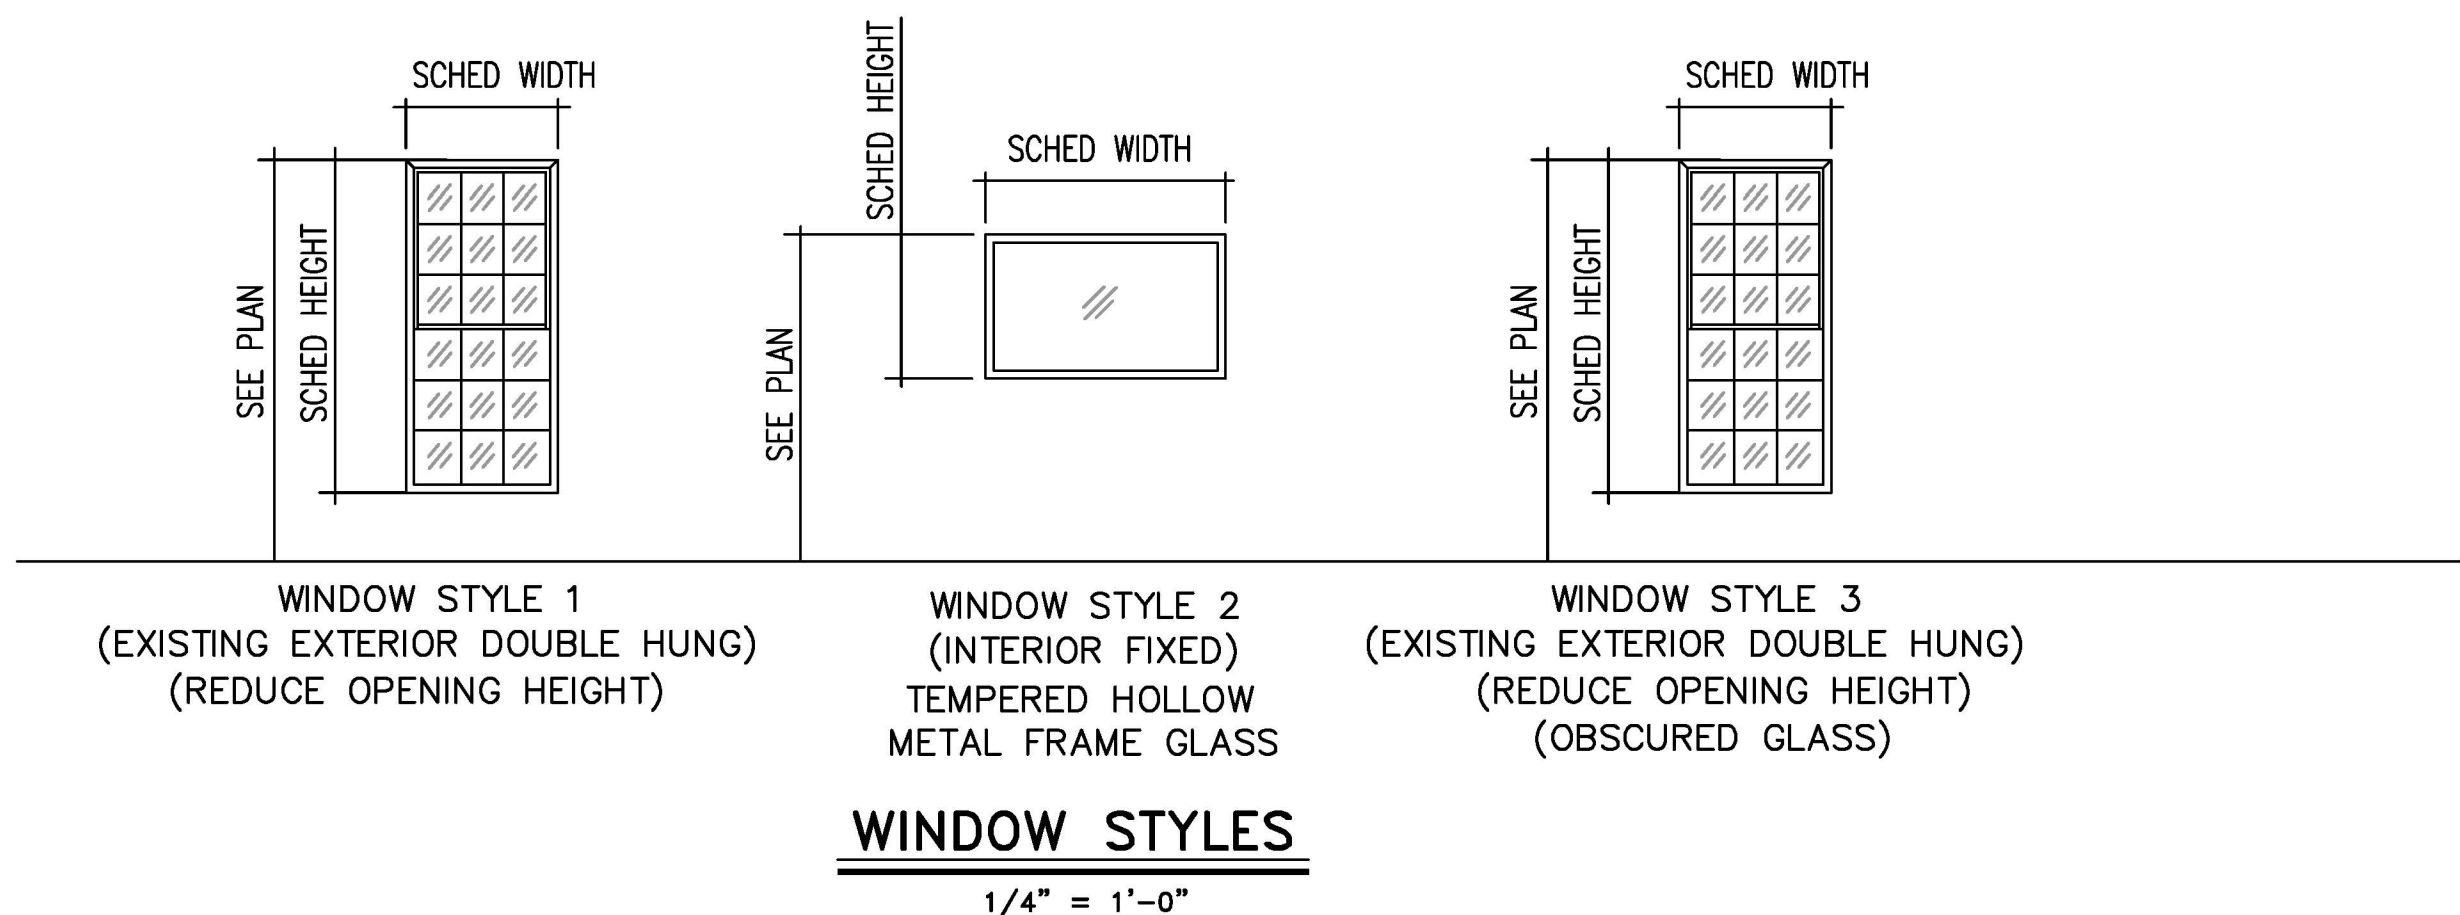


NOTES:

1. APPLY 2 COATS OF SEMI-GLOSS TO ALL METAL DOORS, ALL WOOD DOORS SHALL BE PRE-FIT AND PRE-FINISHED.
2. ALL EXIT DOORS TO BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF A KEY, TOOL, SPECIAL KNOWLEDGE OF EFFORT. ALL HARDWARE MUST BE DIRECT ACTING REQUIRING NOT MORE THAN ONE OPERATION.
3. DOOR HANDLES, PULLS, LATCHES, LOCKS AND OTHER OPERABLE PARTS ON ACCESSIBLE DOORS SHALL HAVE A SHAPE THAT IS EASY TO GRASP WITH ONE HAND AND DOES NOT REQUIRE THUMB GRASPING, PINCHING OR TWISTING OF THE WRIST TO OPERATE. OPERABLE PARTS OF SUCH HARDWARE SHALL BE 34" MINIMUM TO 48" MAXIMUM ABOVE THE FLOOR PER ICC/ANSI A177.1-2009 SECTIONS 404.2.6& 404.2.7
4. G.C. TO REVIEW ALL HARDWARE SETS WITH OWNER BEFORE INSTALLATION.
5. PROVIDE TRANSITION STRIPS AT ALL FLOORING MATERIAL CHANGES. POSITION AT CENTER OF DOOR.
6. ALL WOOD DOORS SHALL BE 20-MINUTE, SOLID CORE.
7. ALL PANIC HARDWARE SHALL BE UL LISTED.
8. ALL NEW HARDWARE TO BE LEVER ADA ACCEPTABLE.
9. ALL THRESHOLD TO MEET ADA SPECIFICATIONS
10. DELAYED AND EGRESS HARDWARE SHALL BE IN ACCORDANCE WITH UL-294 PUBLICATIONS.

Diagram illustrating five door styles (A through E) with their respective dimensions and features:

- DOOR STYLE A:** Solid door with a handle. Dimensions: SCHED WIDTH, SCHED HEIGHT.
- DOOR STYLE B:** Solid door with a handle. Dimensions: SCHED WIDTH, SCHED HEIGHT, COORD, w, hw, and a 40-degree angle.
- DOOR STYLE C:** Solid door with a handle. Dimensions: SCHED WIDTH, SCHED HEIGHT.
- DOOR STYLE D:** Door with a handle and a diagonal line. Dimensions: SCHED WIDTH, SCHED HEIGHT.
- DOOR STYLE E:** Door with a handle and a grid pattern. Dimensions: SCHED WIDTH, SCHED HEIGHT.

$$1/4'' = 1'-0''$$


JENKINS
CONSULTING ENGINEERS, PA
OFFICE IN EUREMA SPRINGS, NORTH CAROLINA
1000 MARTIN RD. FAYETTEVILLE, NC 28411-1002
CORPORATION MAILING ADDRESS: 1000 MARTIN RD.
OFFICE 910.362.1724
FAX 910.368.5907



25 JULY 2025

DESIGNED/CHECKED BY:	KJD
DRAWN BY:	TS,SAN,GD,BT,JC,JDL
PROJECT #:	2025-01-16
DATE:	

FINAL DRAWING ☐ FOR REVIEW PURPOSES ONLY
PRELIMINARY ☐ FOR DESIGN DEVELOPMENT ONLY
FINAL DRAWING ☒ FOR CONSTRUCTION








OWNER/TENANT:
GOOD HOPE HOSPITAL
410 DENIM DRIVE, DRYIN, NC 28339


CONTRACTOR/BUILDER:
STE GENERAL CONTRACTORS LLC

PROJECT: **ALTERATION LEVEL III - GOOD HOPE BEHAVIORAL URGENT CARE**
410 DENIM DRIVE, ERWIN, NC 28339

APPENDIX I: WINDOW & DOOR SCHEDULES




G9

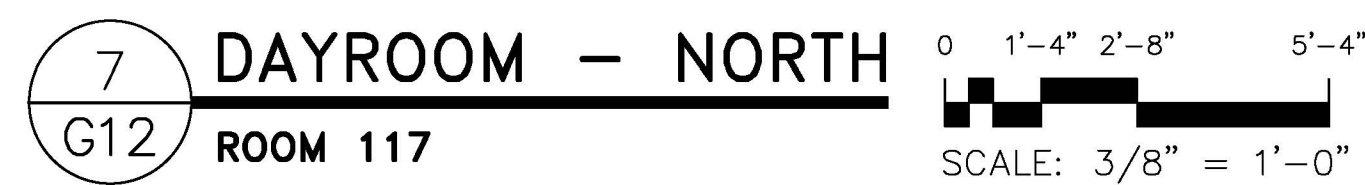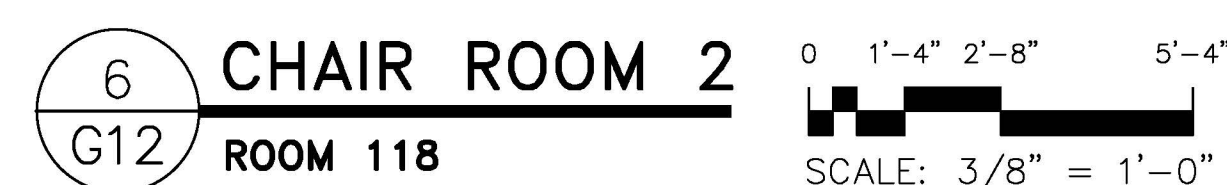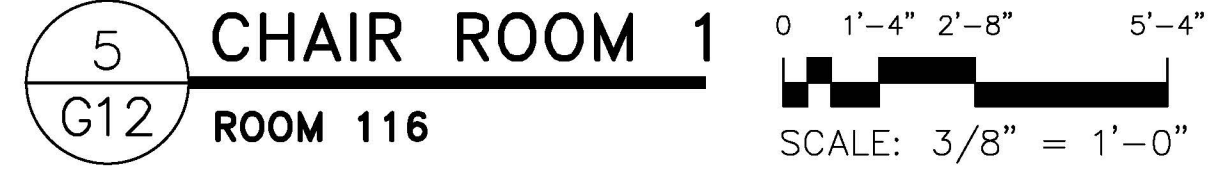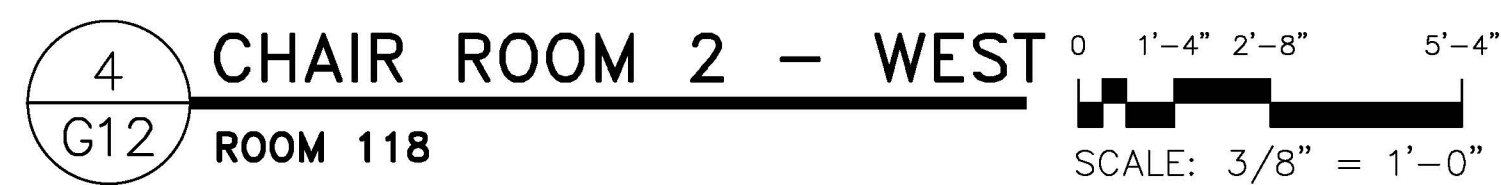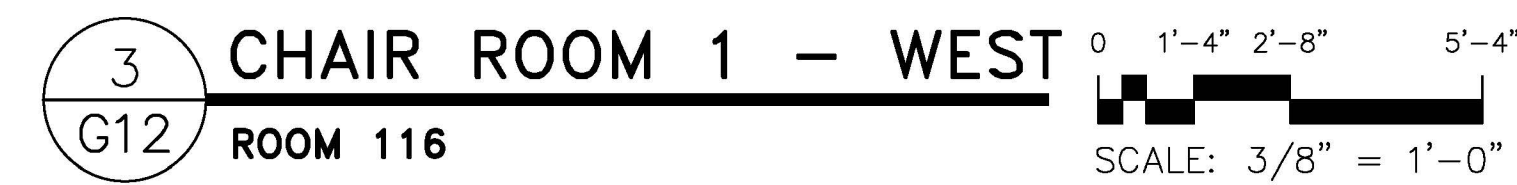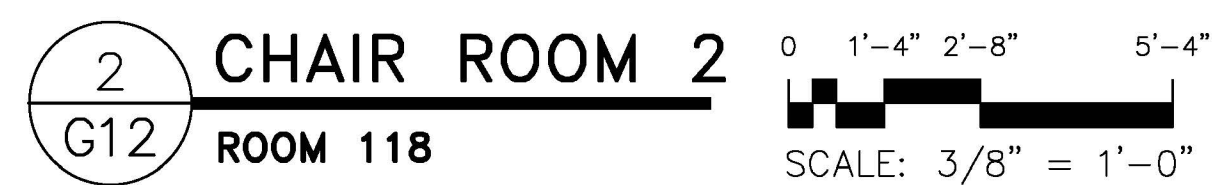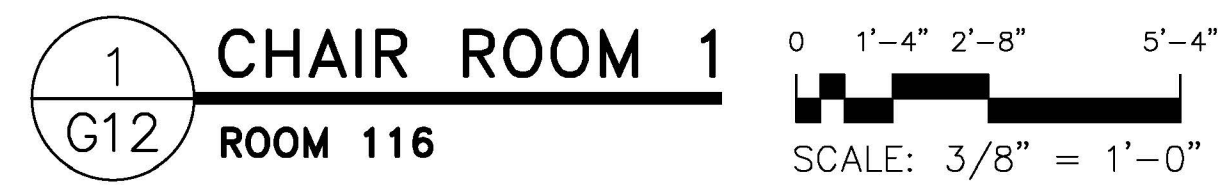




1. PROVIDE BLOCKING AT ALL WALL MOUNTED ACCESSORIES.
2. GRAB BARS, FASTENERS AND MOUNTING DEVICES SHALL BE INSTALLED PER ADA REQUIREMENTS.
3. INSTALL AT LOCATIONS REQUIRED AND AS SHOWN ON DRAWINGS.
4. ALL TOILET ACCESSORIES TO BE SELECTED BY OWNER
5. ALL TOILET ACCESSORIES TO BE INSTALLED BY CONSTRUCTOR
6. ALL LAVATORIES & SINKS SHALL HAVE PROTECTIVE COVERING ATTACHED TO THE SUPPLY & DRAIN LINES BELOW THE FIXTURES

GYPHUM WALL BOARD SHALL BE MOISTURE RESISTANT IN RESTROOM

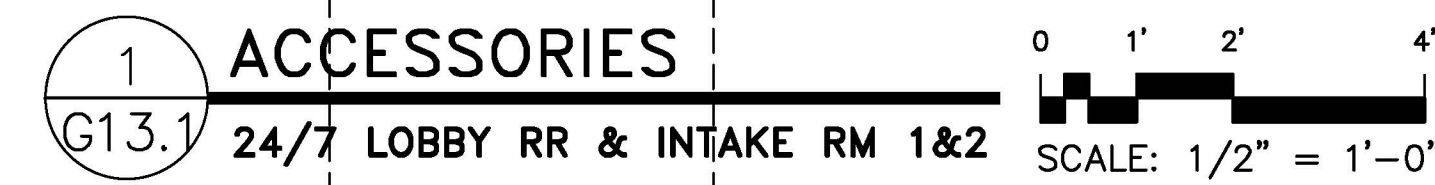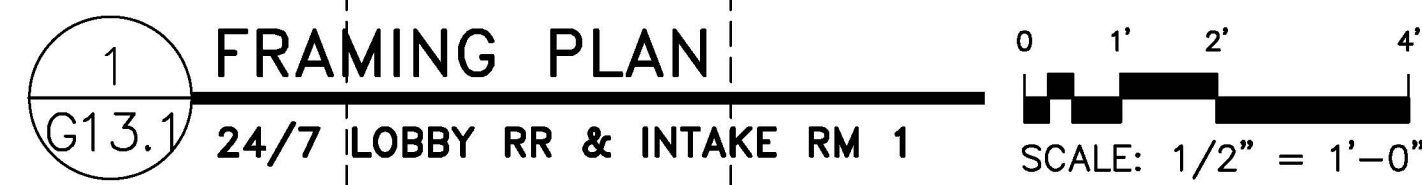

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM



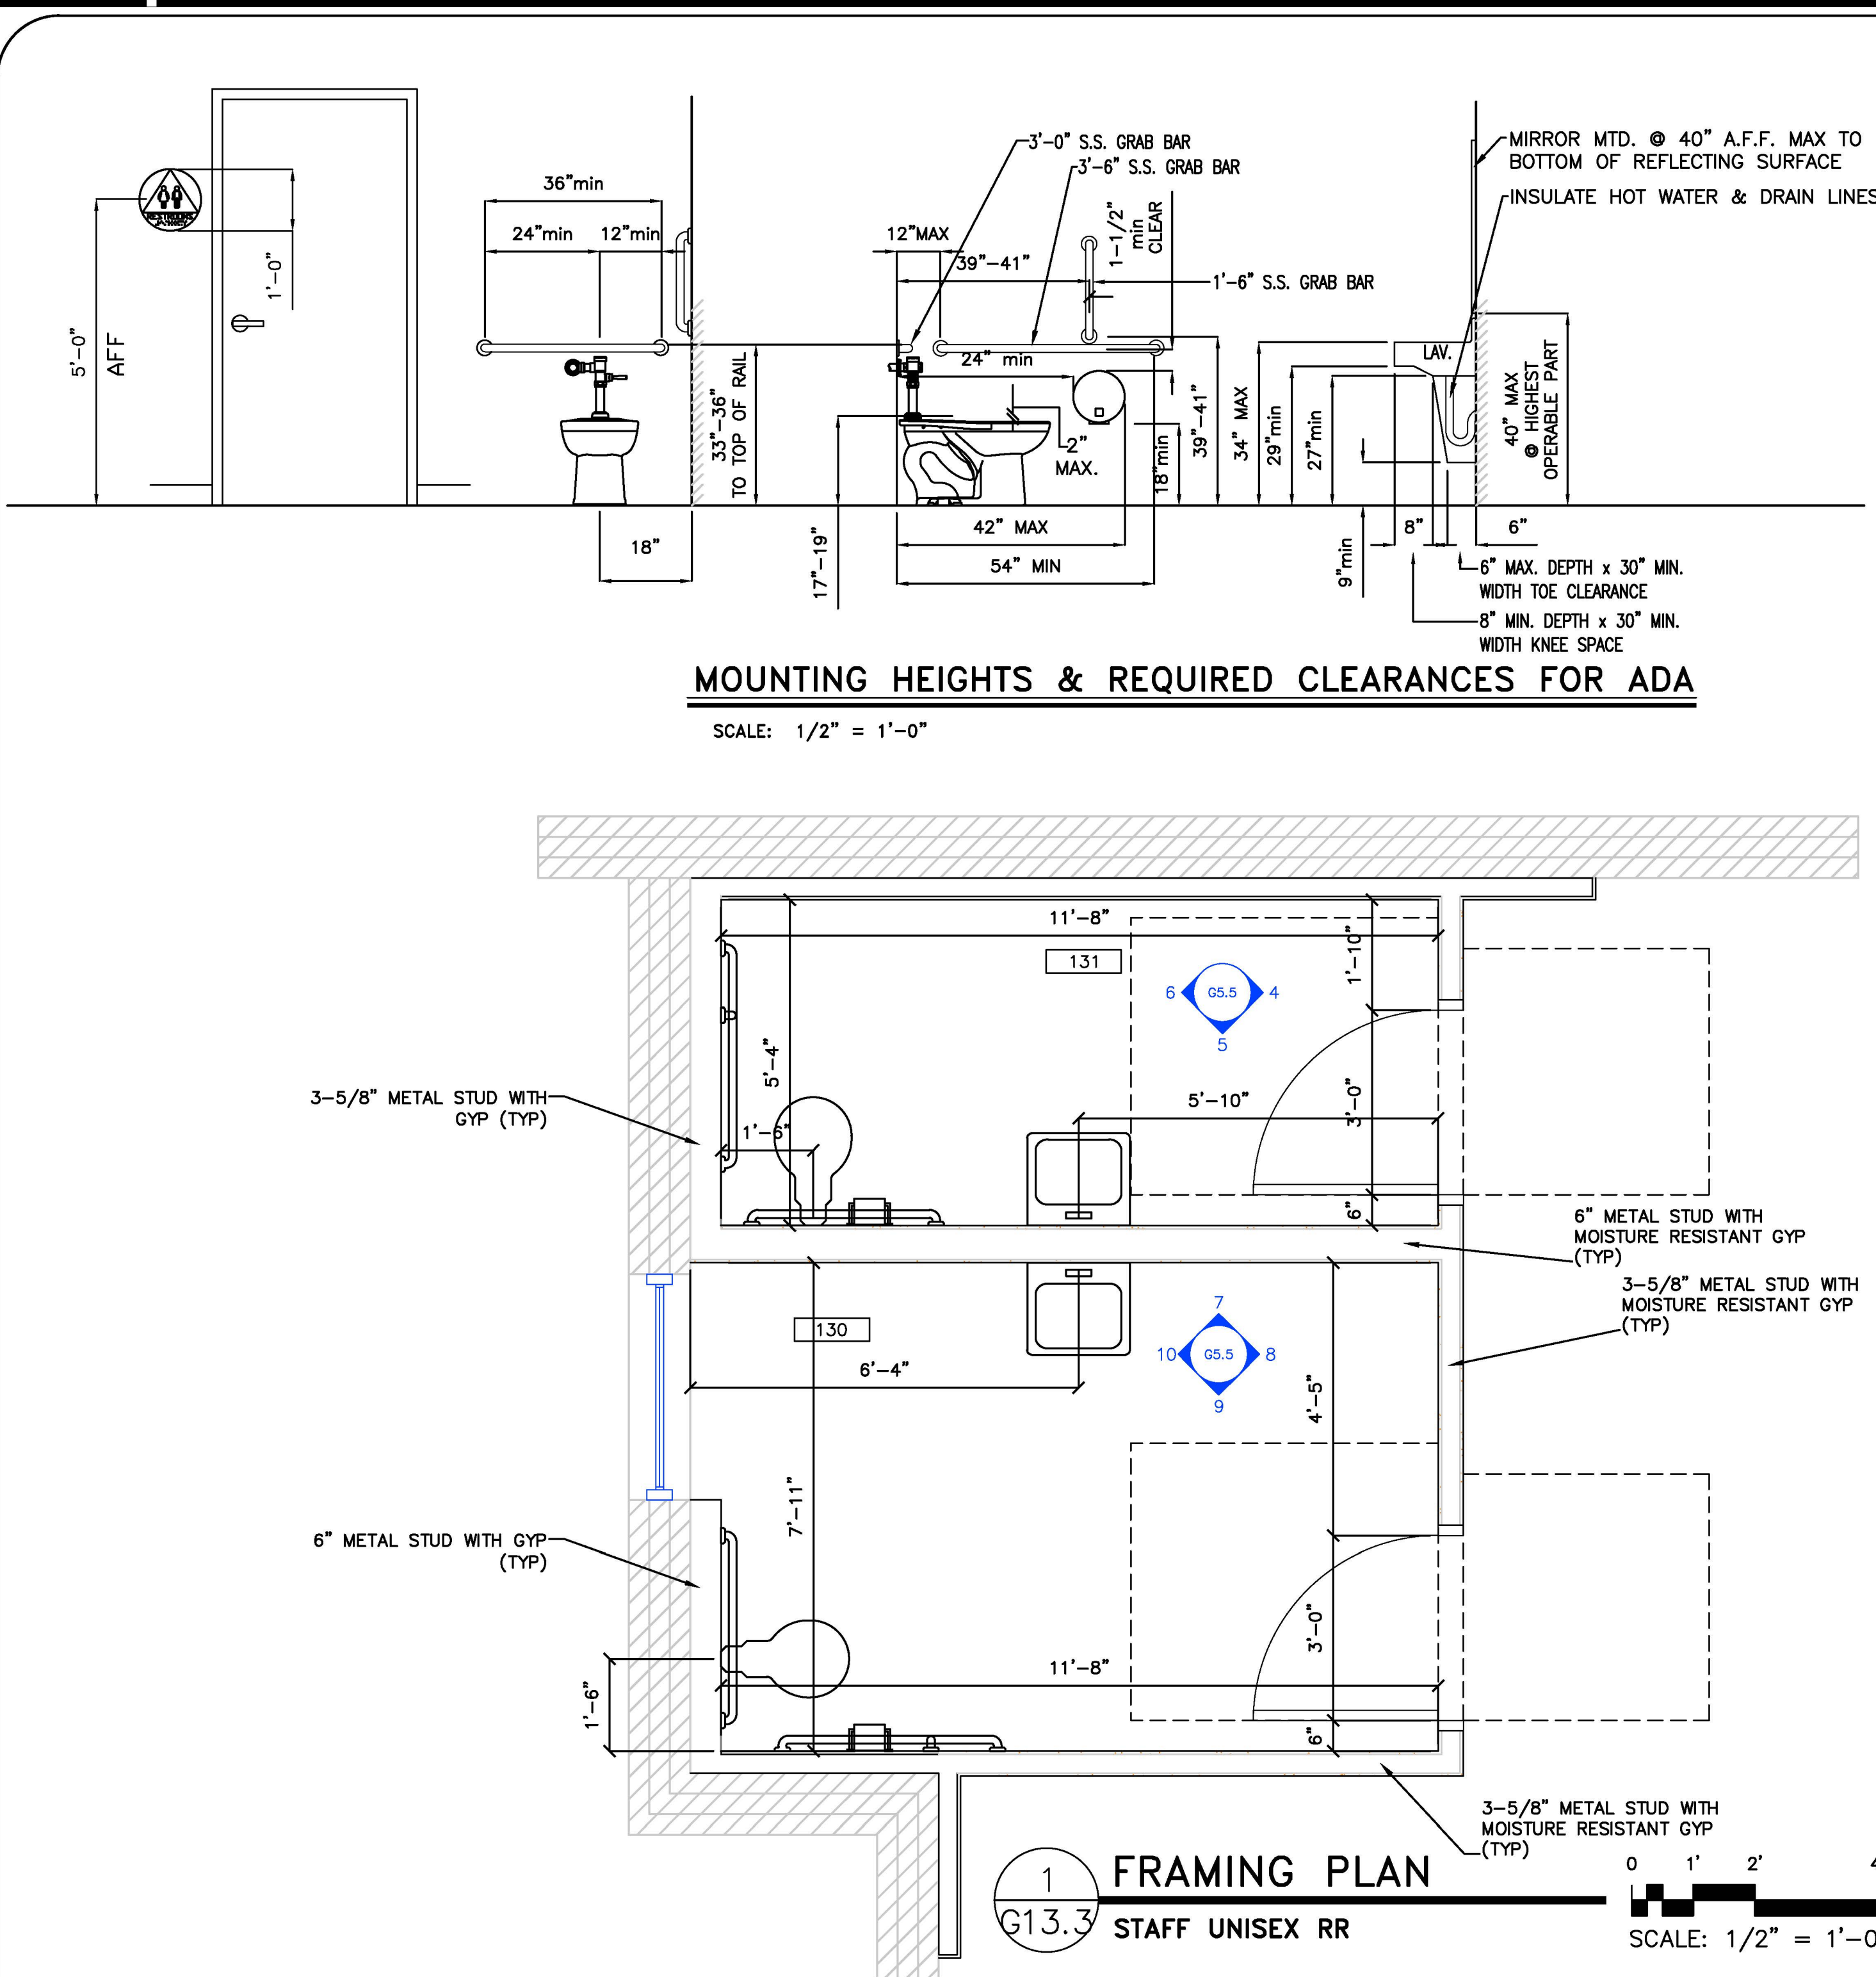

- SEE SHEET P1 FOR PLUMBING FIXTURE SCHEDULE.
SEE SHEET G13.1, G13.2, G13.3 FOR FLOOR FRAMING.
- GYPHUM WALL BOARD SHALL BE MOISTURE RESISTANT IN RESTROOM

3-5/8" METAL STUD WITH GYP (TYP)

6" METAL STUD WITH GYP (TYP)

6" METAL STUD WITH MOISTURE RESISTANT GYP (TYP)

3-5/8" METAL STUD WITH MOISTURE RESISTANT GYP (TYP)

RR-105
RR-103
RR-106
RR-104
RR-107
RR-100
RR-101
RR-102

131



RR-100
RR-101
RR-102
RR-107
RR-104
RR-105
RR-106
RR-103

130

ACCESSORIES

STAFF UNISEX RR

SCALE: 1/2" = 1'-0"

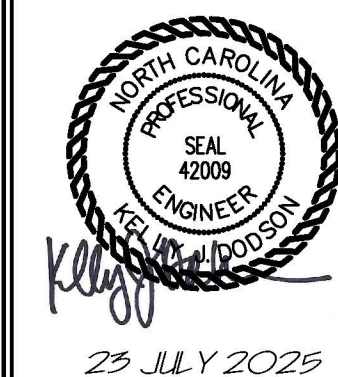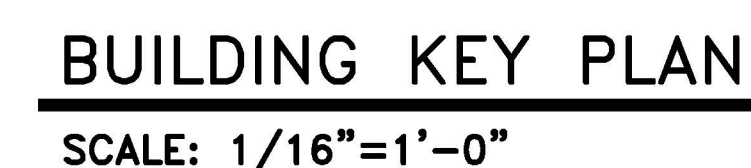


FINAL DRAWING <input checked="" type="checkbox"/> FOR REVIEW PURPOSES ONLY	DESIGNED / CHECKED BY: KLID
FINAL DRAWING <input type="checkbox"/> FOR CONSTRUCTION ONLY	DRAWN BY: TS.SAN.GD.BT.IC.IDJ.
PROJECT NAME: GOOD HOPE HOSPITAL	PROJECT #: 2025-01-16
410 DENIM DRIVE, DENIM, NC 28539	DATE: 03 JULY 2025
CONTRACTOR / BUILDER: STE GENERAL CONTRACTORS LLC.	



1. PROVIDE BLOCKING AT ALL WALL MOUNTED ACCESSORIES.
2. GRAB BARS, FASTENERS AND MOUNTING DEVICES SHALL BE INSTALLED PER ADA REQUIREMENTS.
3. INSTALL AT LOCATIONS REQUIRED AND AS SHOWN ON DRAWINGS.
4. ALL TOILET ACCESSORIES TO BE SELECTED BY OWNER
5. ALL TOILET ACCESSORIES TO BE INSTALLED BY CONSTRUCTOR
6. ALL LAVATORIES & SINKS SHALL HAVE PROTECTIVE COVERING ATTACHED TO THE SUPPLY & DRAIN LINES BELOW THE FIXTURES

SEE SHEET P1 FOR PLUMBING FIXTURE SCHEDULE.
SEE SHEET G13.1, G13.2, G13.3 FOR FLOOR FRAMING.

GYPSON WALL BOARD SHALL BE MOISTURE RESISTANT IN RESTROOM

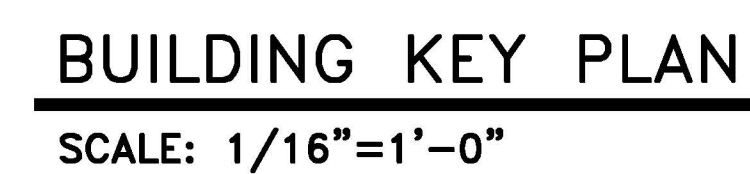

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM



PRELIMINARY ☐ FOR DESIGN DEVELOPMENT ONLY
FINAL DRAWING ☐ FOR CONSTRUCTION

OWNER/TENANT:
GOOD HOPE HOSPITAL
410 DENIM DRIVE, EDWIN, NC 28339


CONTRACTOR/BUILDER:
STE GENERAL CONTRACTORS LLC.

[illegible]

410 DENIM DRIVE, ERWIN, NC 28339

ADA RESTROOM DETAILS

G13.4















1. PROVIDE BLOCKING AT ALL WALL MOUNTED ACCESSORIES.
2. GRAB BARS, FASTENERS AND MOUNTING DEVICES SHALL BE INSTALLED PER ADA REQUIREMENTS.
3. INSTALL AT LOCATIONS REQUIRED AND AS SHOWN ON DRAWINGS.
4. ALL TOILET ACCESSORIES TO BE SELECTED BY OWNER
5. ALL TOILET ACCESSORIES TO BE INSTALLED BY CONSTRUCTOR
6. ALL LAVATORIES & SINKS SHALL HAVE PROTECTIVE COVERING ATTACHED TO THE SUPPLY & DRAIN LINES BELOW THE FIXTURES

SEE SHEET P1 FOR PLUMBING FIXTURE SCHEDULE.
SEE SHEET G13.1, G13.2, G13.3 FOR FLOOR FRAMING.













GYPSON WALL BOARD SHALL BE MOISTURE RESISTANT IN RESTROOM



SCALE: 1/16"=1'-0"

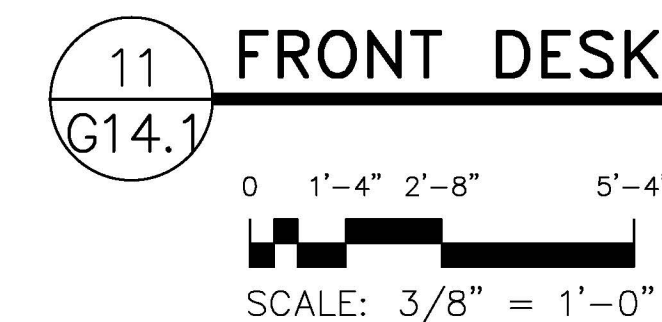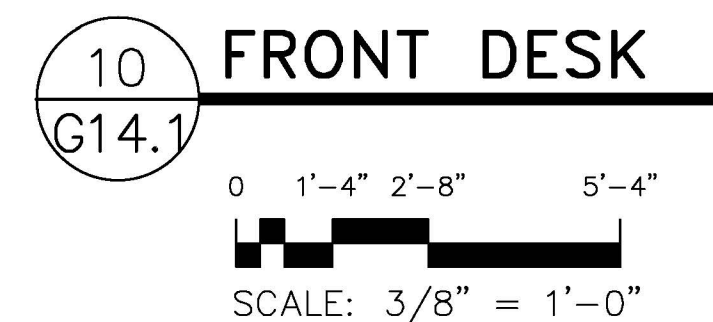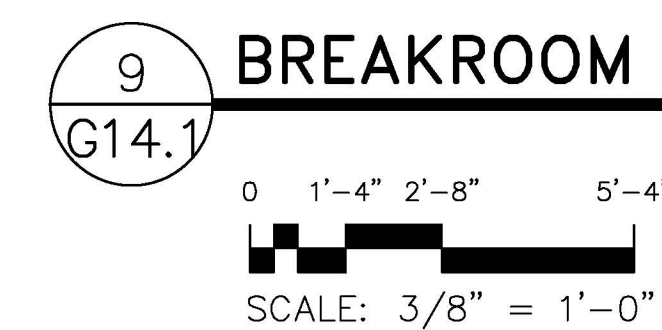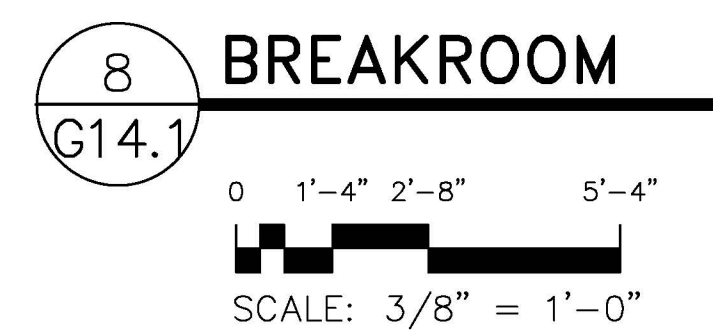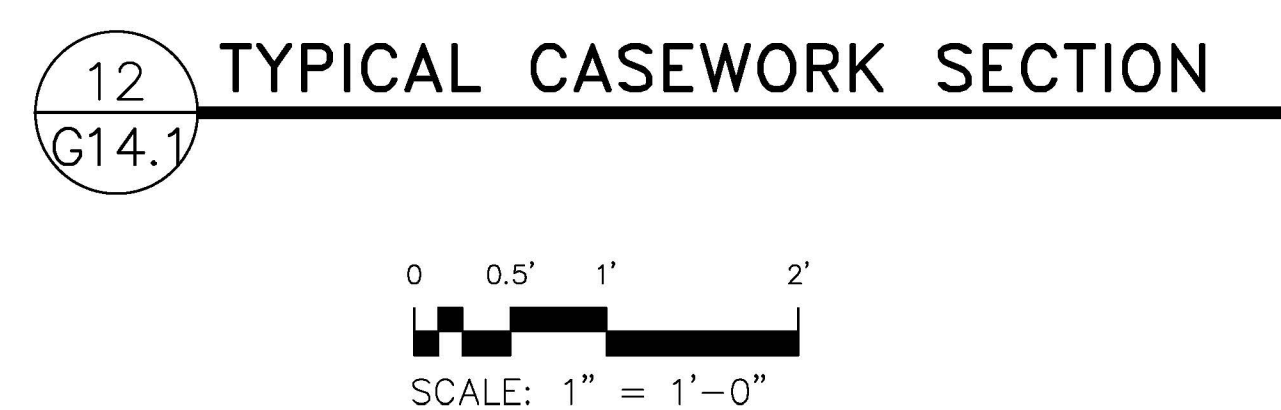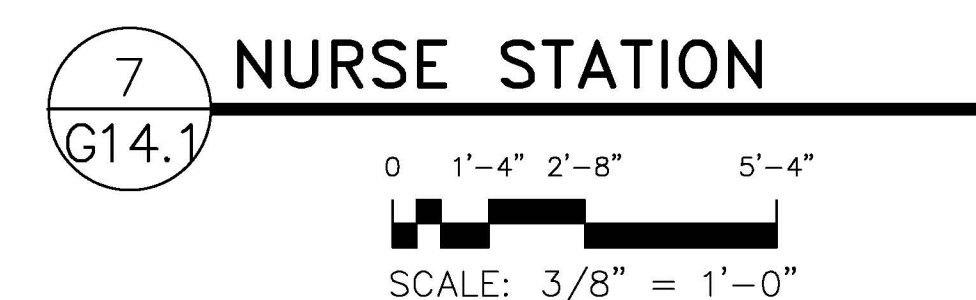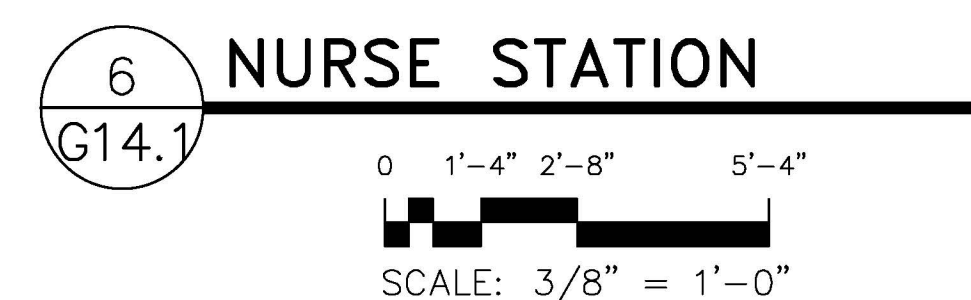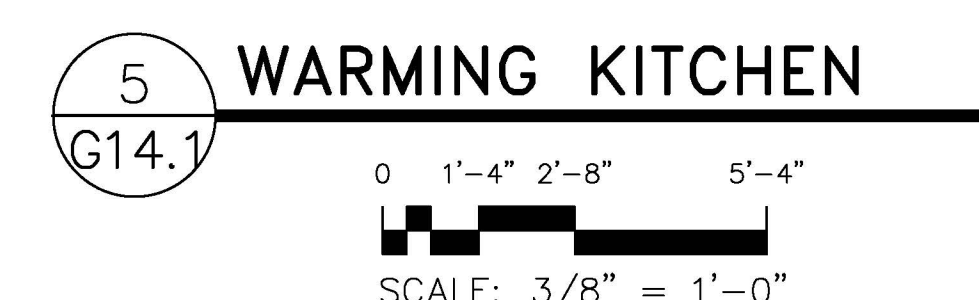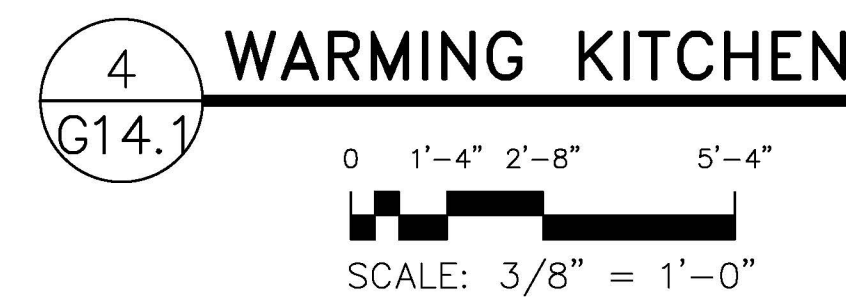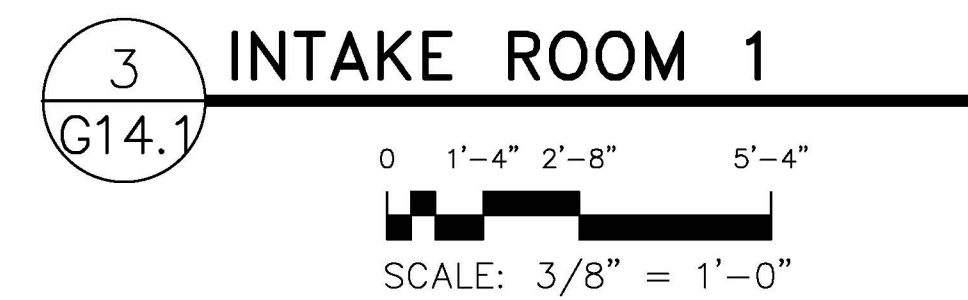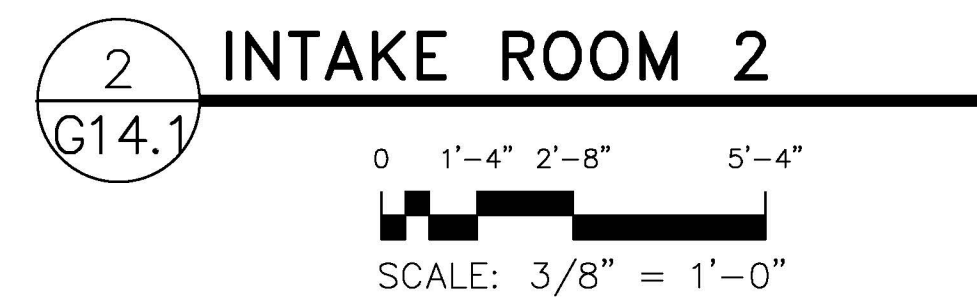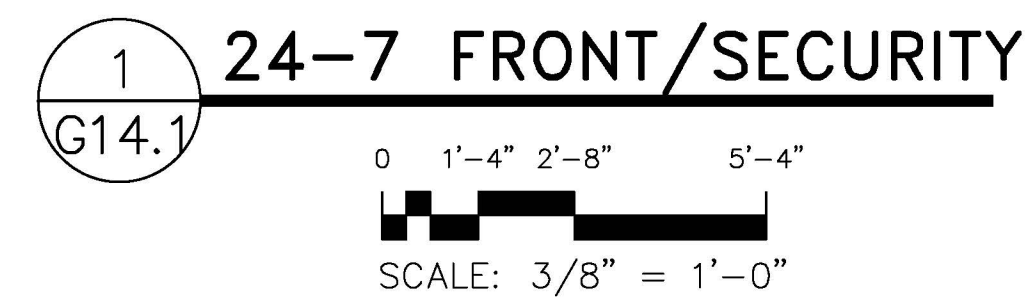

8' 0" 1'-0" 2'-0" 3'-0" 4'-0" 5'-0" 6'-0" 7'-0" 8'-0" 9'-0" 10'-0" 11'-0" 12'-0" 13'-0" 14'-0" 15'-0" 16'-0" 17'-0" 18'-0" 19'-0" 20'-0" 21'-0" 22'-0" 23'-0" 24'-0" 25'-0" 26'-0" 27'-0" 28'-0" 29'-0" 30'-0" 31'-0" 32'-0" 33'-0" 34'-0" 35'-0" 36'-0" 37'-0" 38'-0" 39'-0" 40'-0" 41'-0" 42'-0" 43'-0" 44'-0" 45'-0" 46'-0" 47'-0" 48'-0" 49'-0" 50'-0" 51'-0" 52'-0" 53'-0" 54'-0" 55'-0" 56'-0" 57'-0" 58'-0" 59'-0" 60'-0" 61'-0" 62'-0" 63'-0" 64'-0" 65'-0" 66'-0" 67'-0" 68'-0" 69'-0" 70'-0" 71'-0" 72'-0" 73'-0" 74'-0" 75'-0" 76'-0" 77'-0" 78'-0" 79'-0" 80'-0" 81'-0" 82'-0" 83'-0" 84'-0" 85'-0" 86'-0" 87'-0" 88'-0" 89'-0" 90'-0" 91'-0" 92'-0" 93'-0" 94'-0" 95'-0" 96'-0" 97'-0" 98'-0" 99'-0" 100'-0"

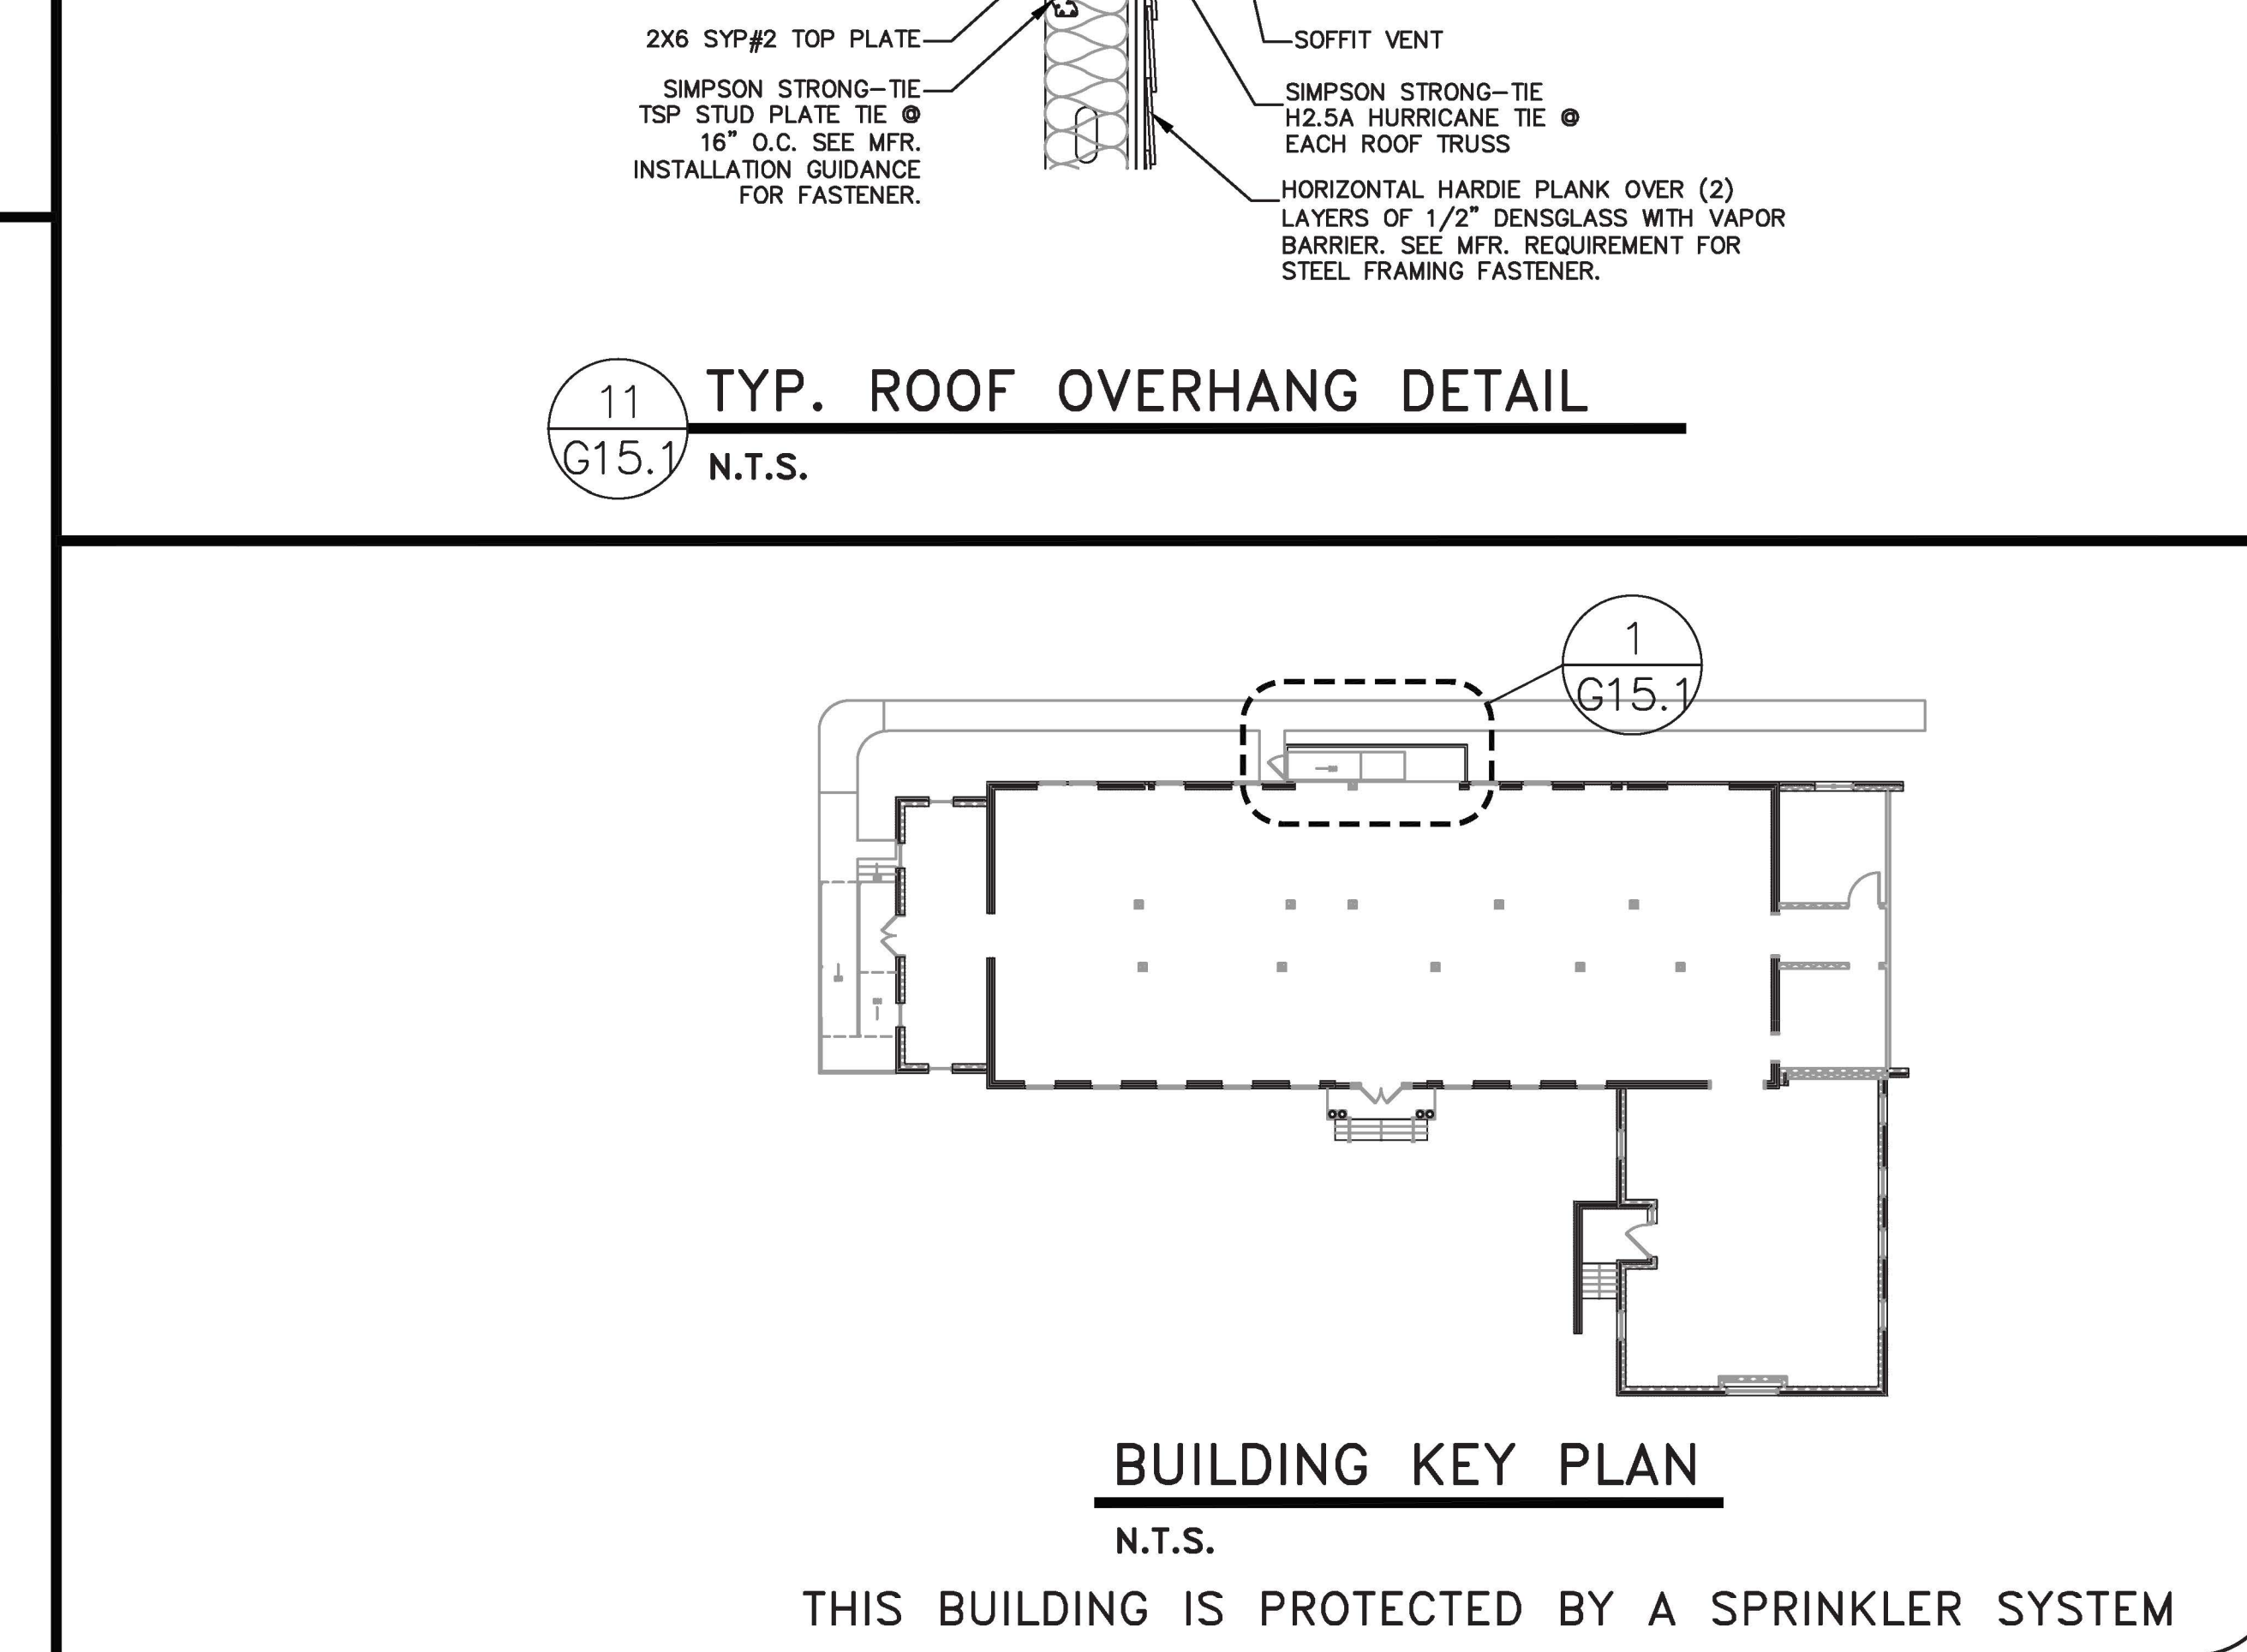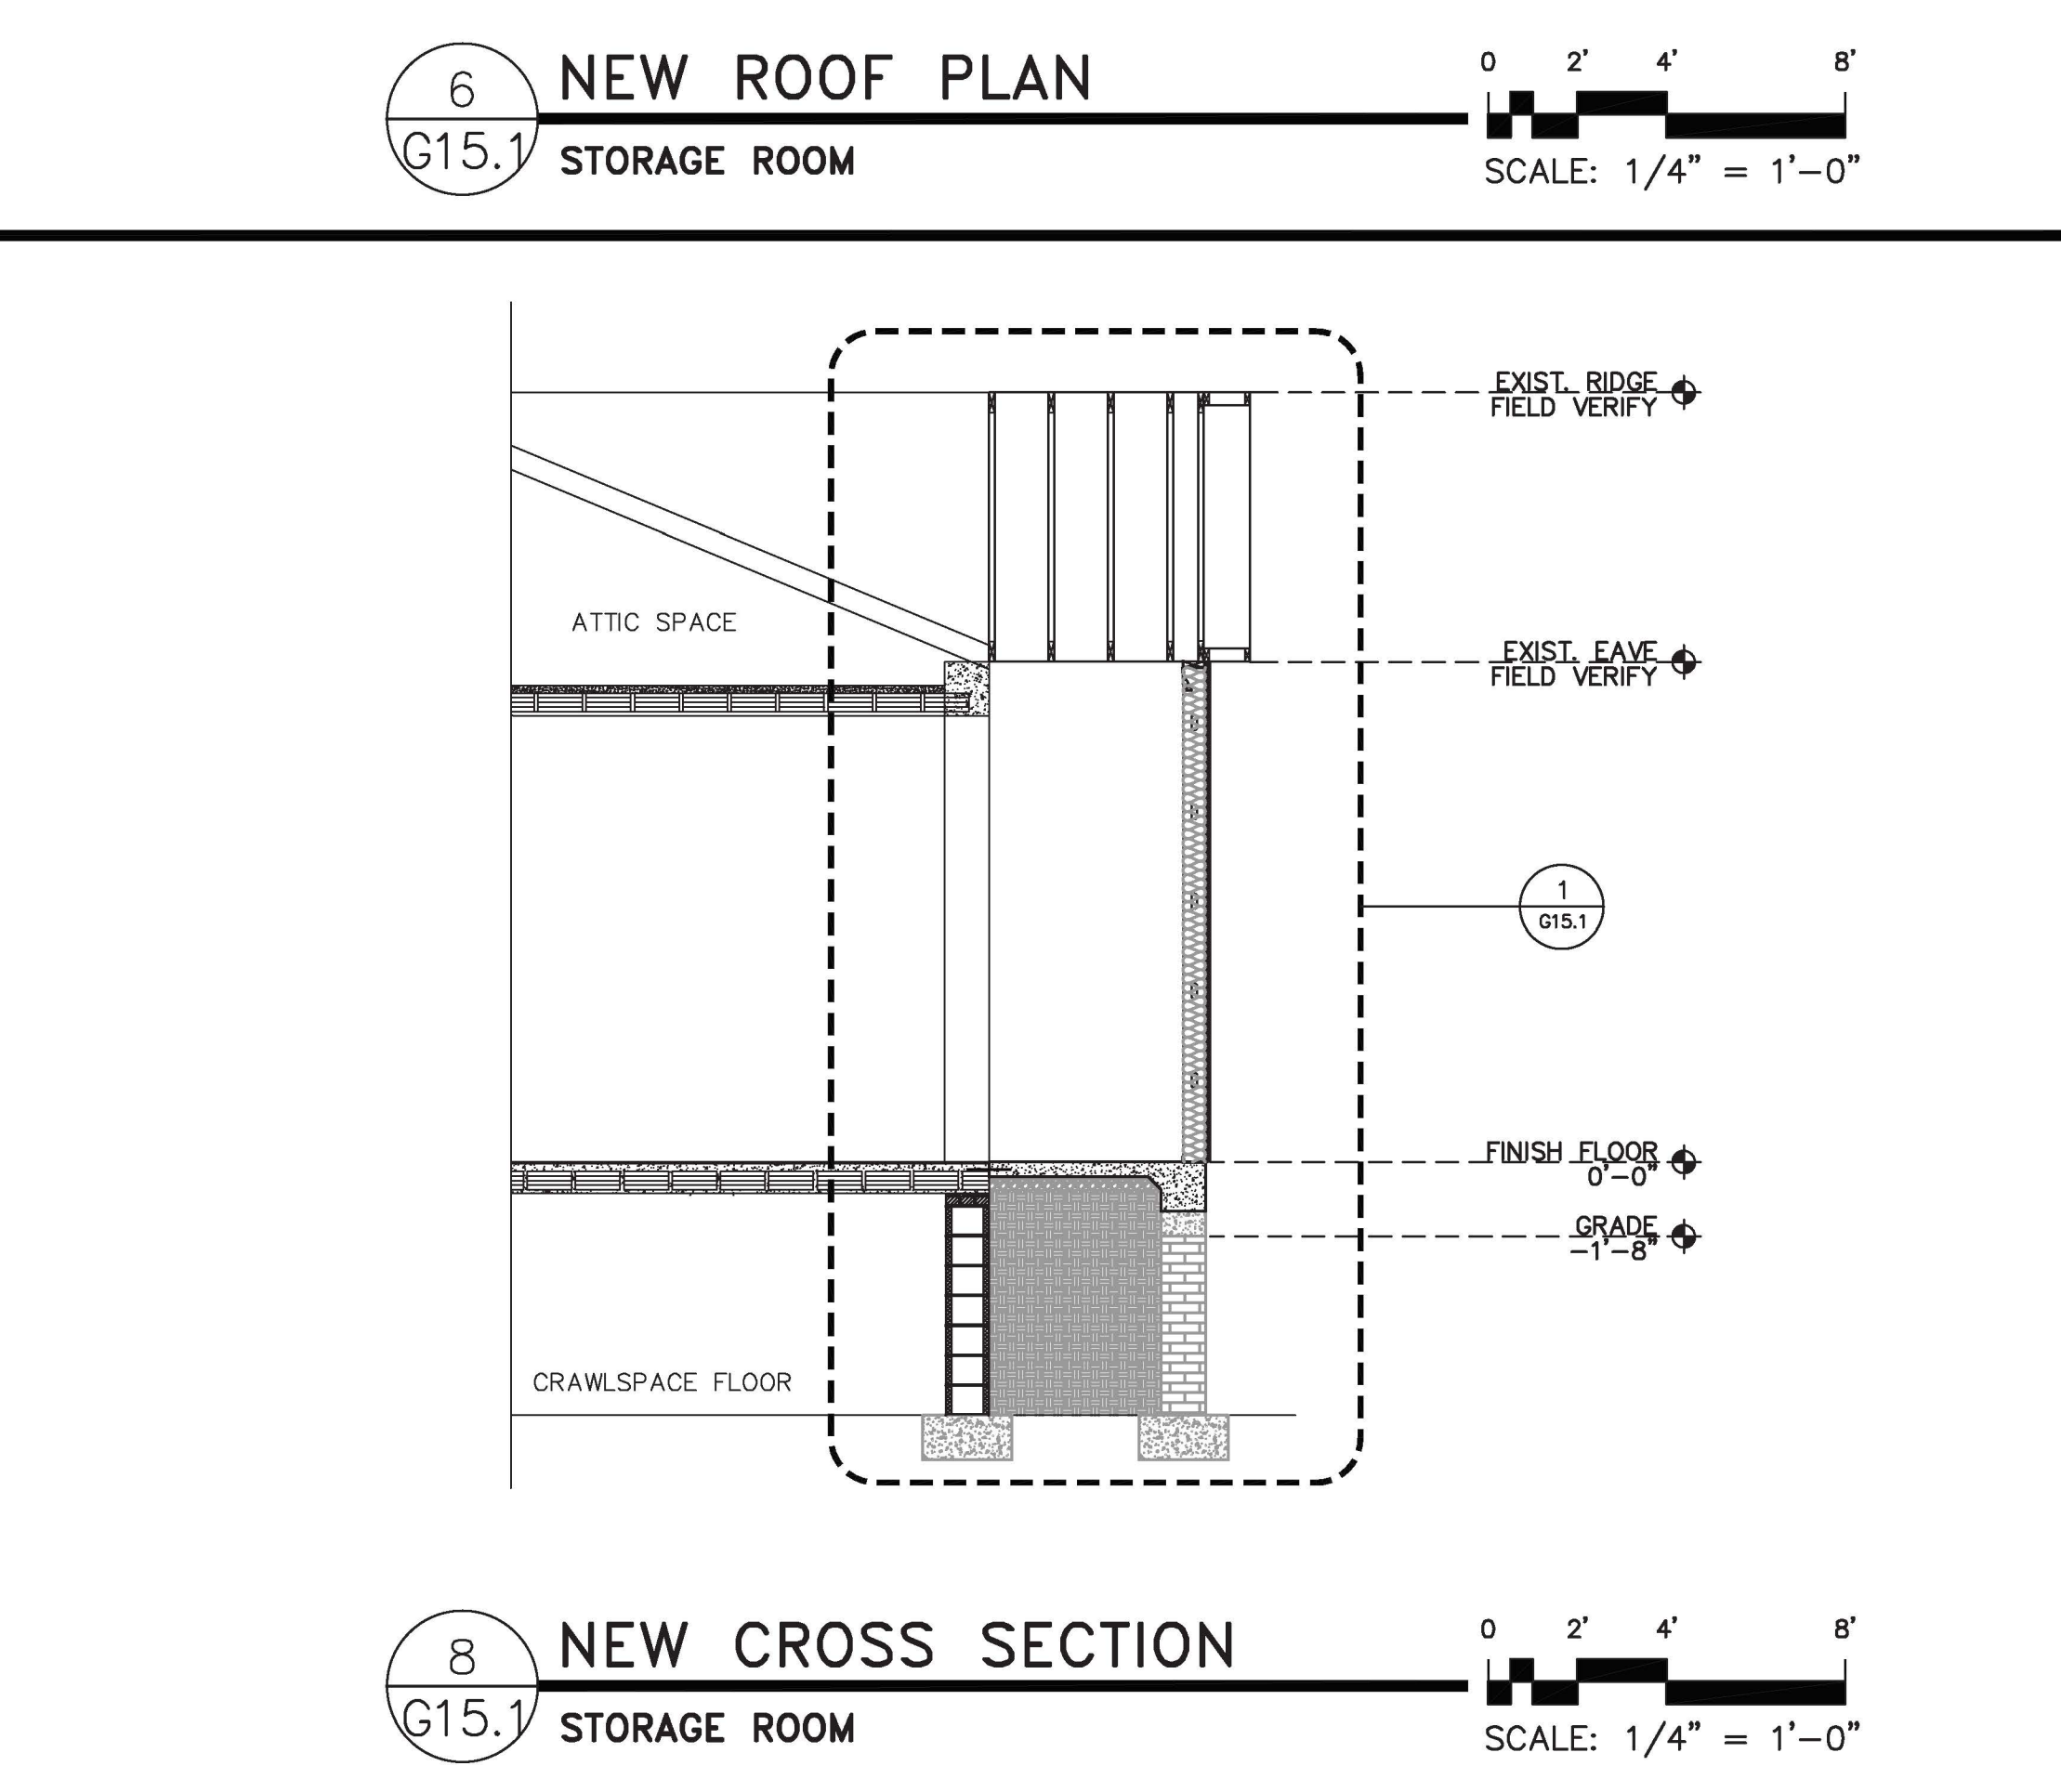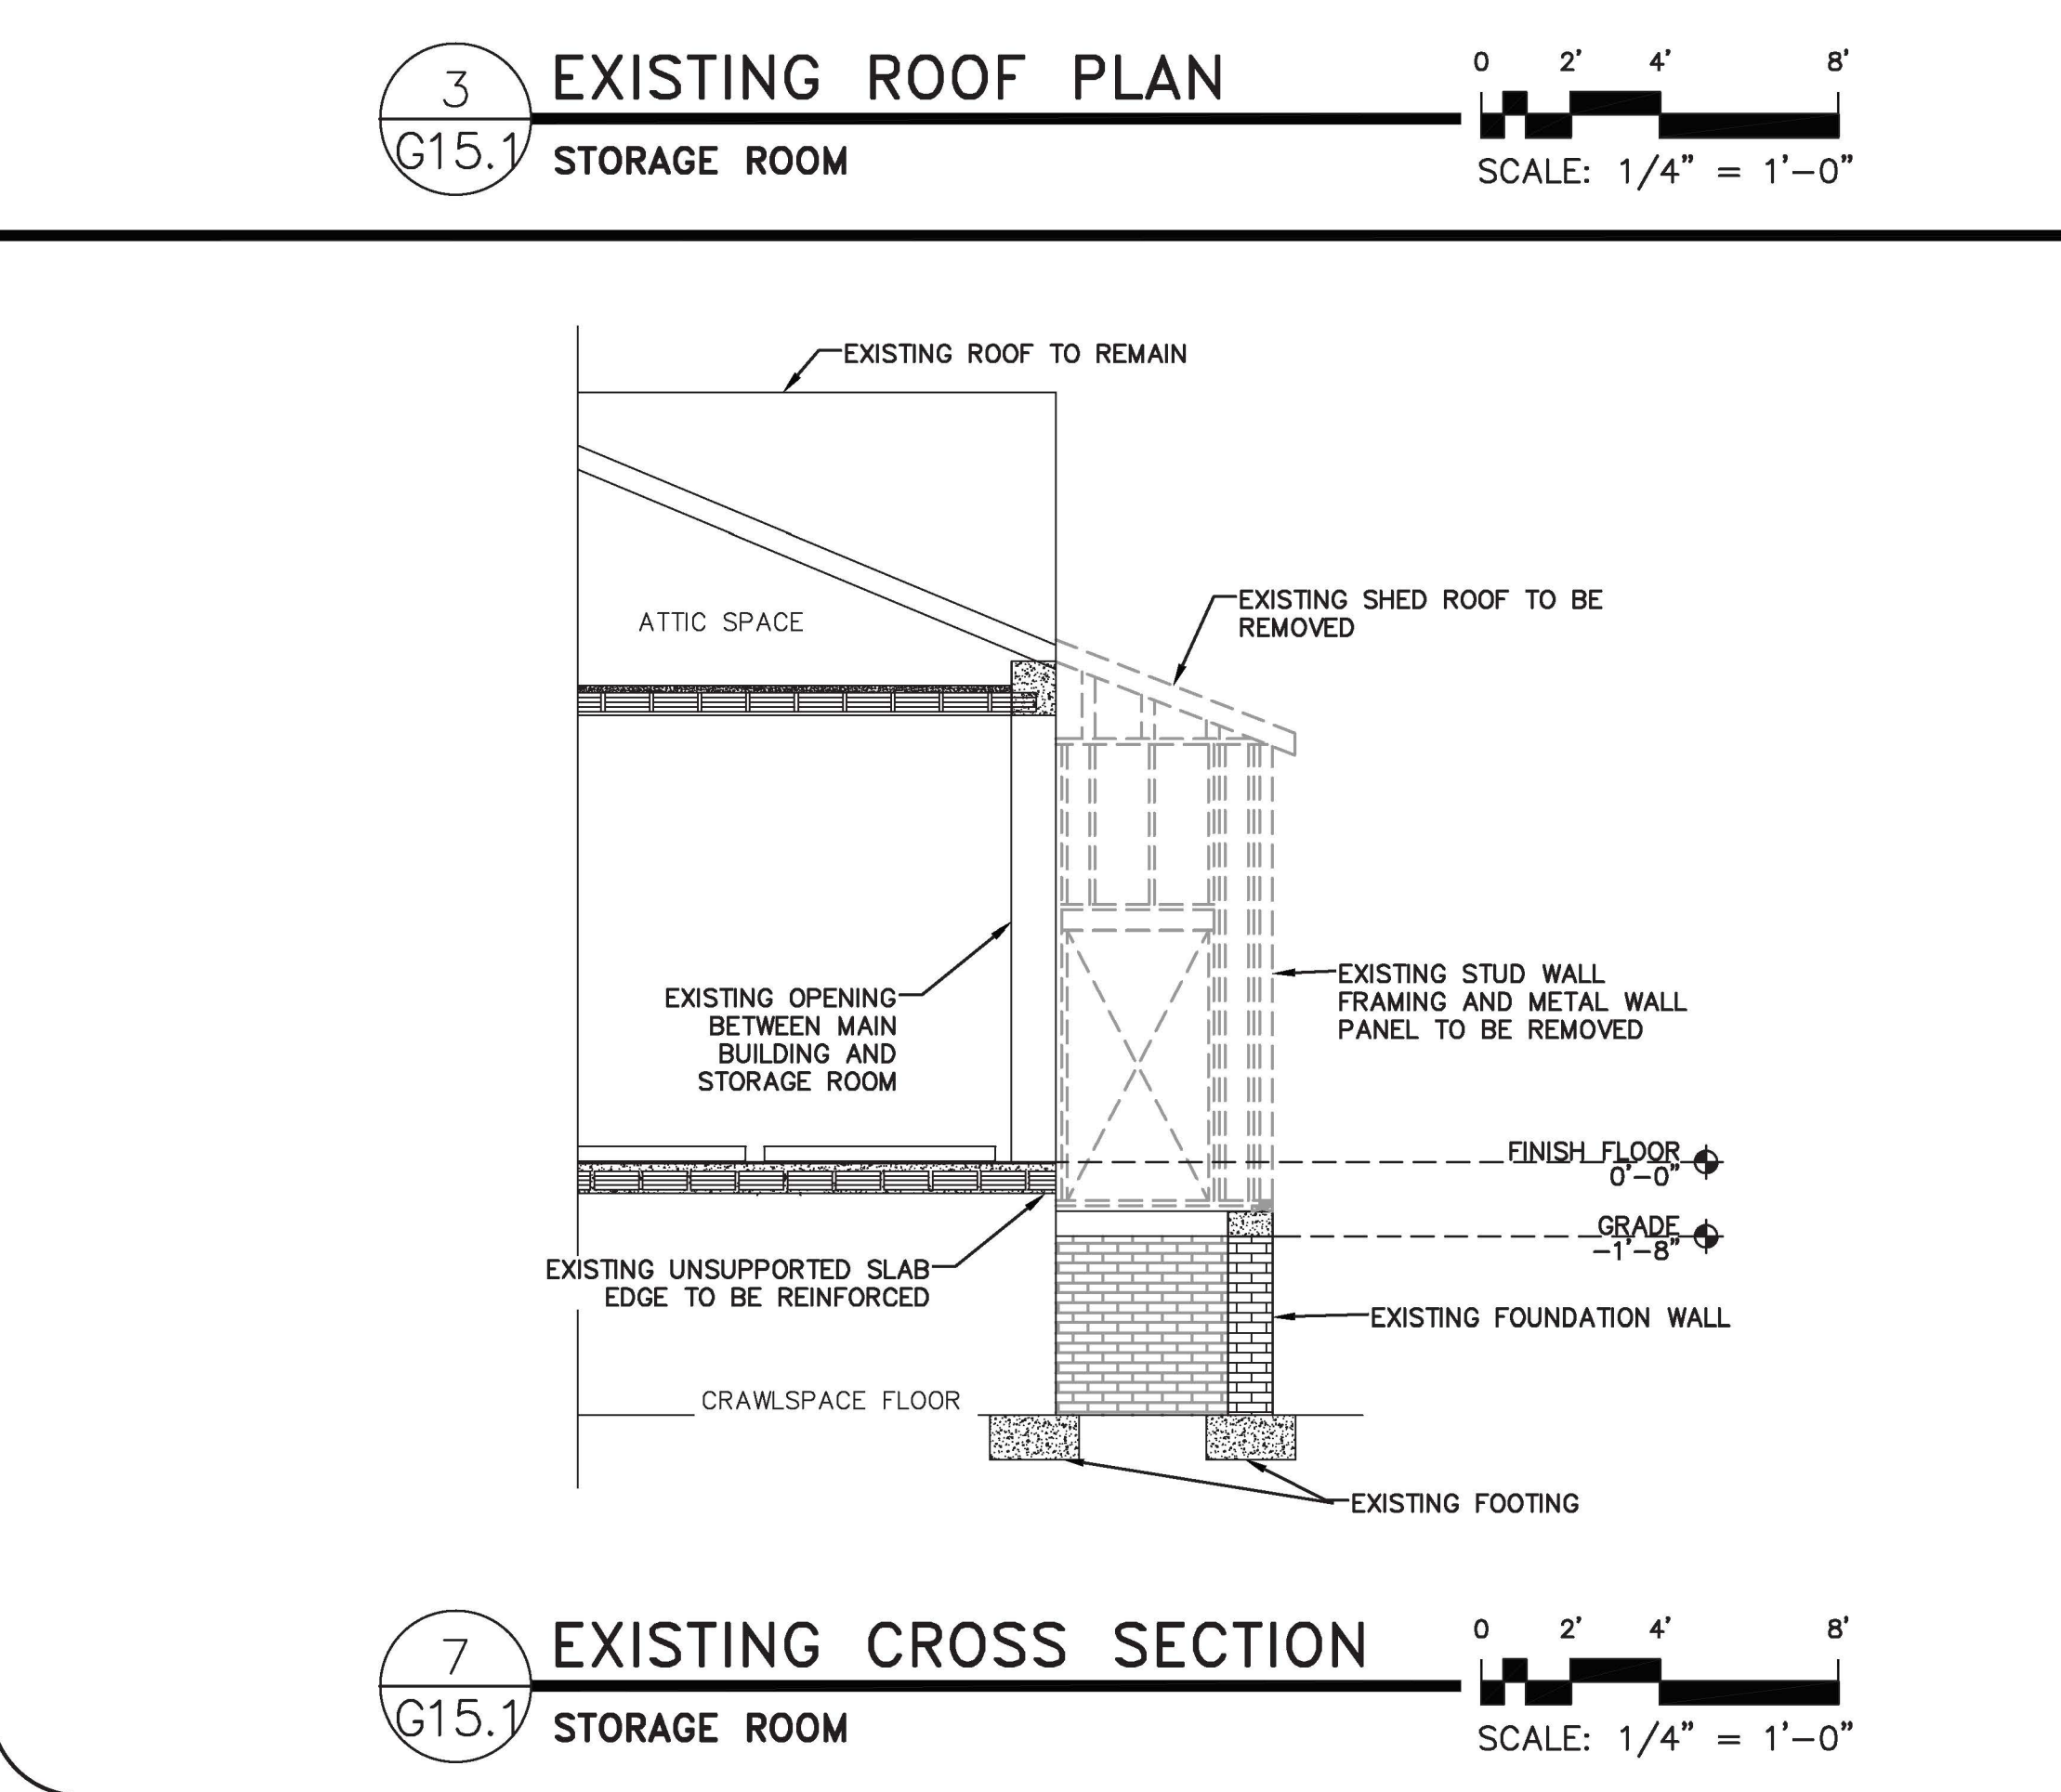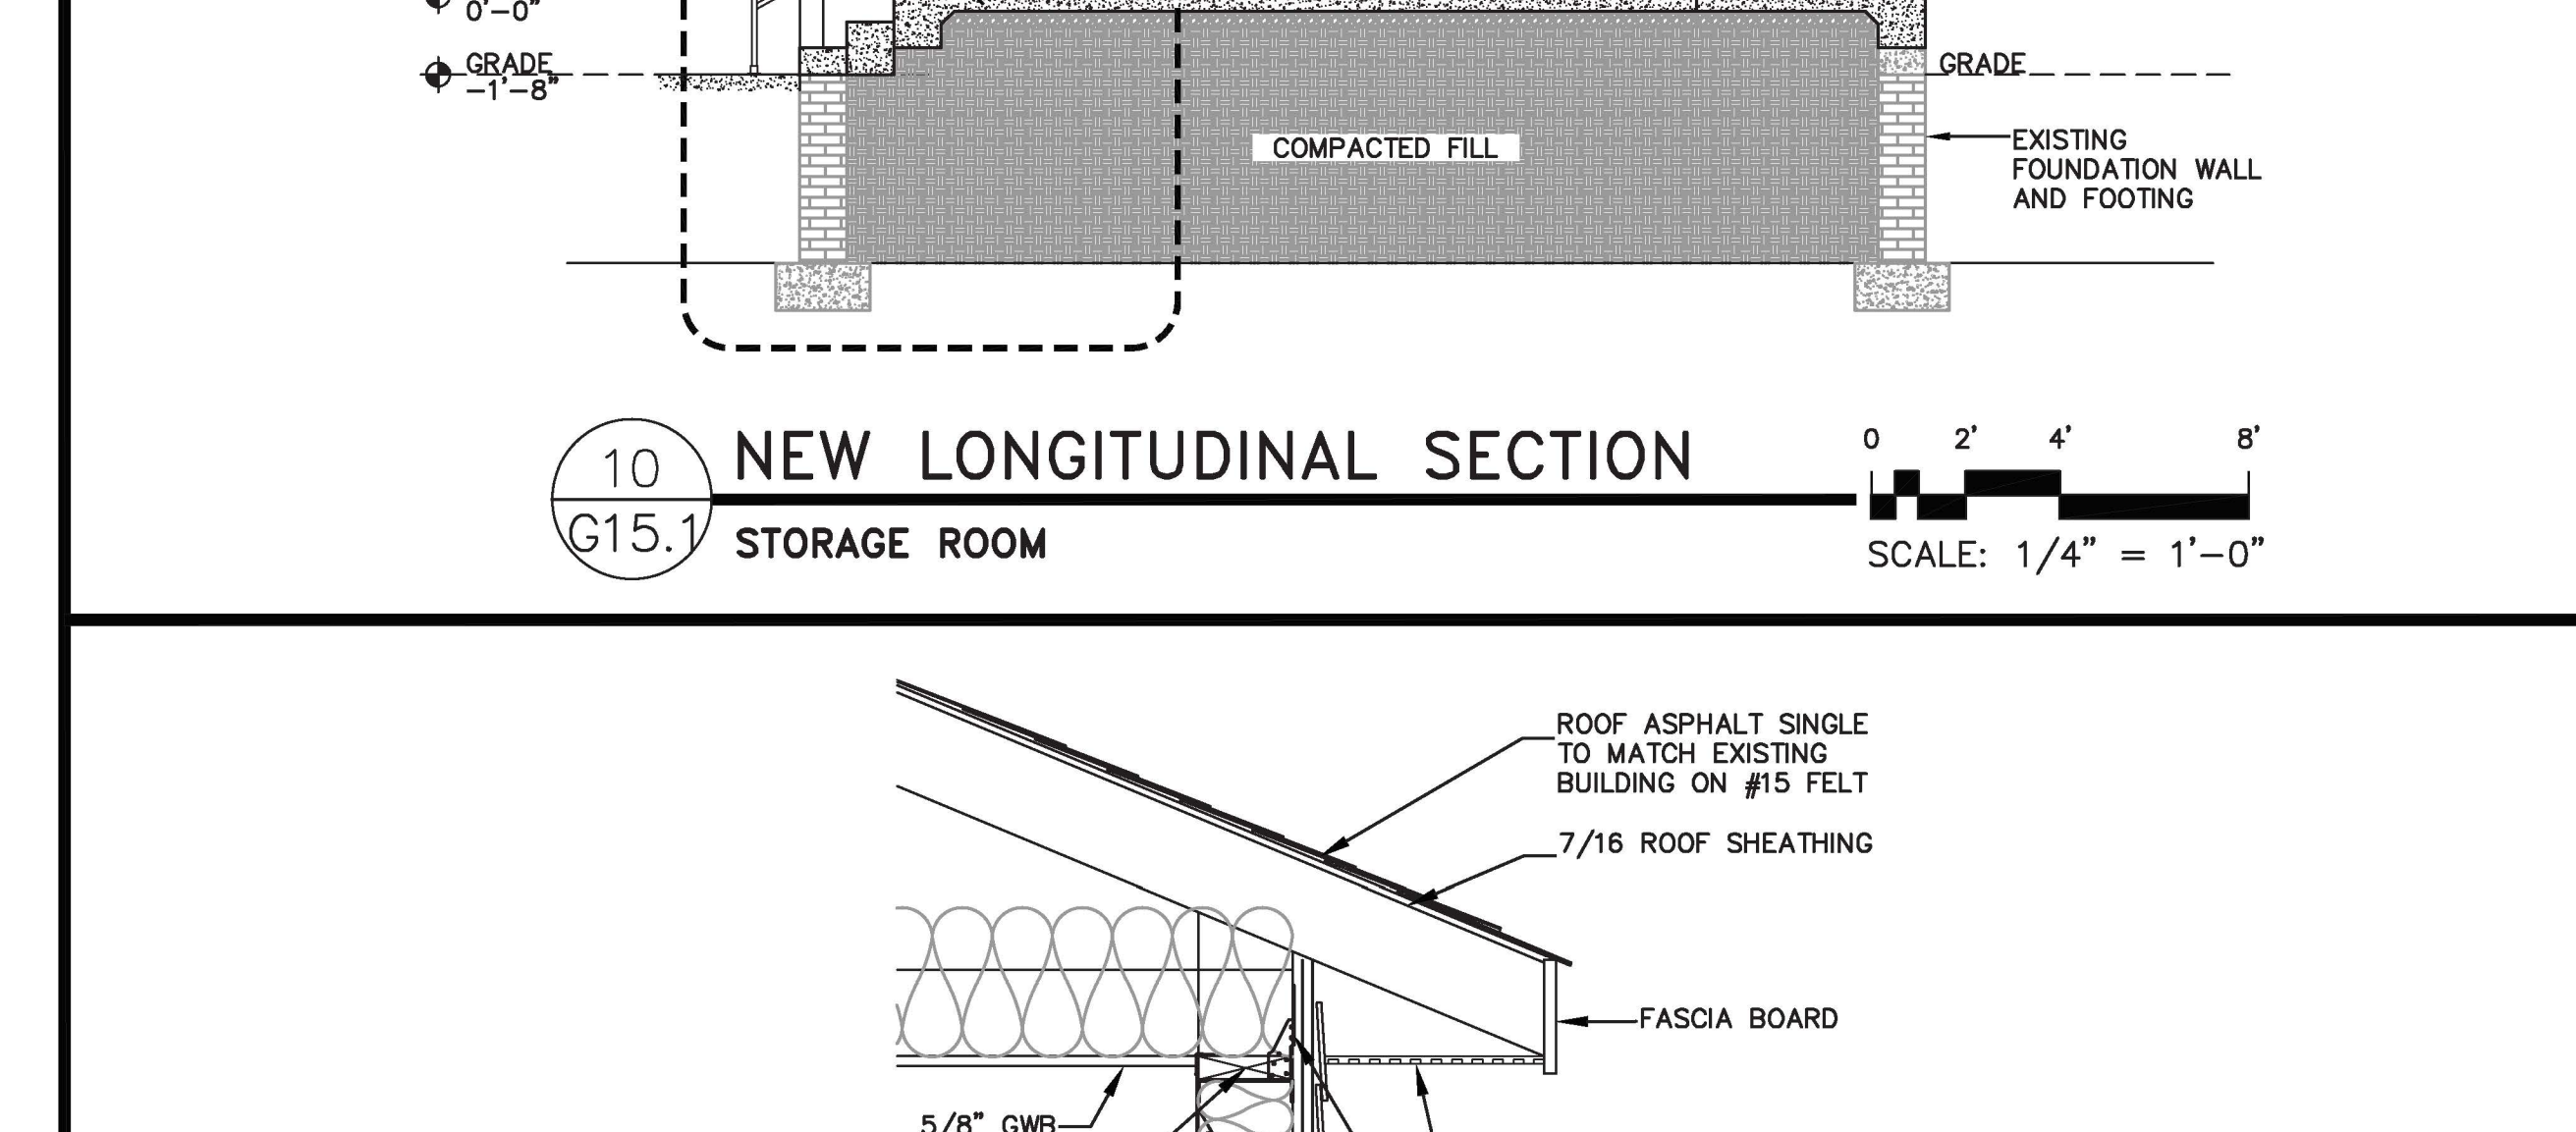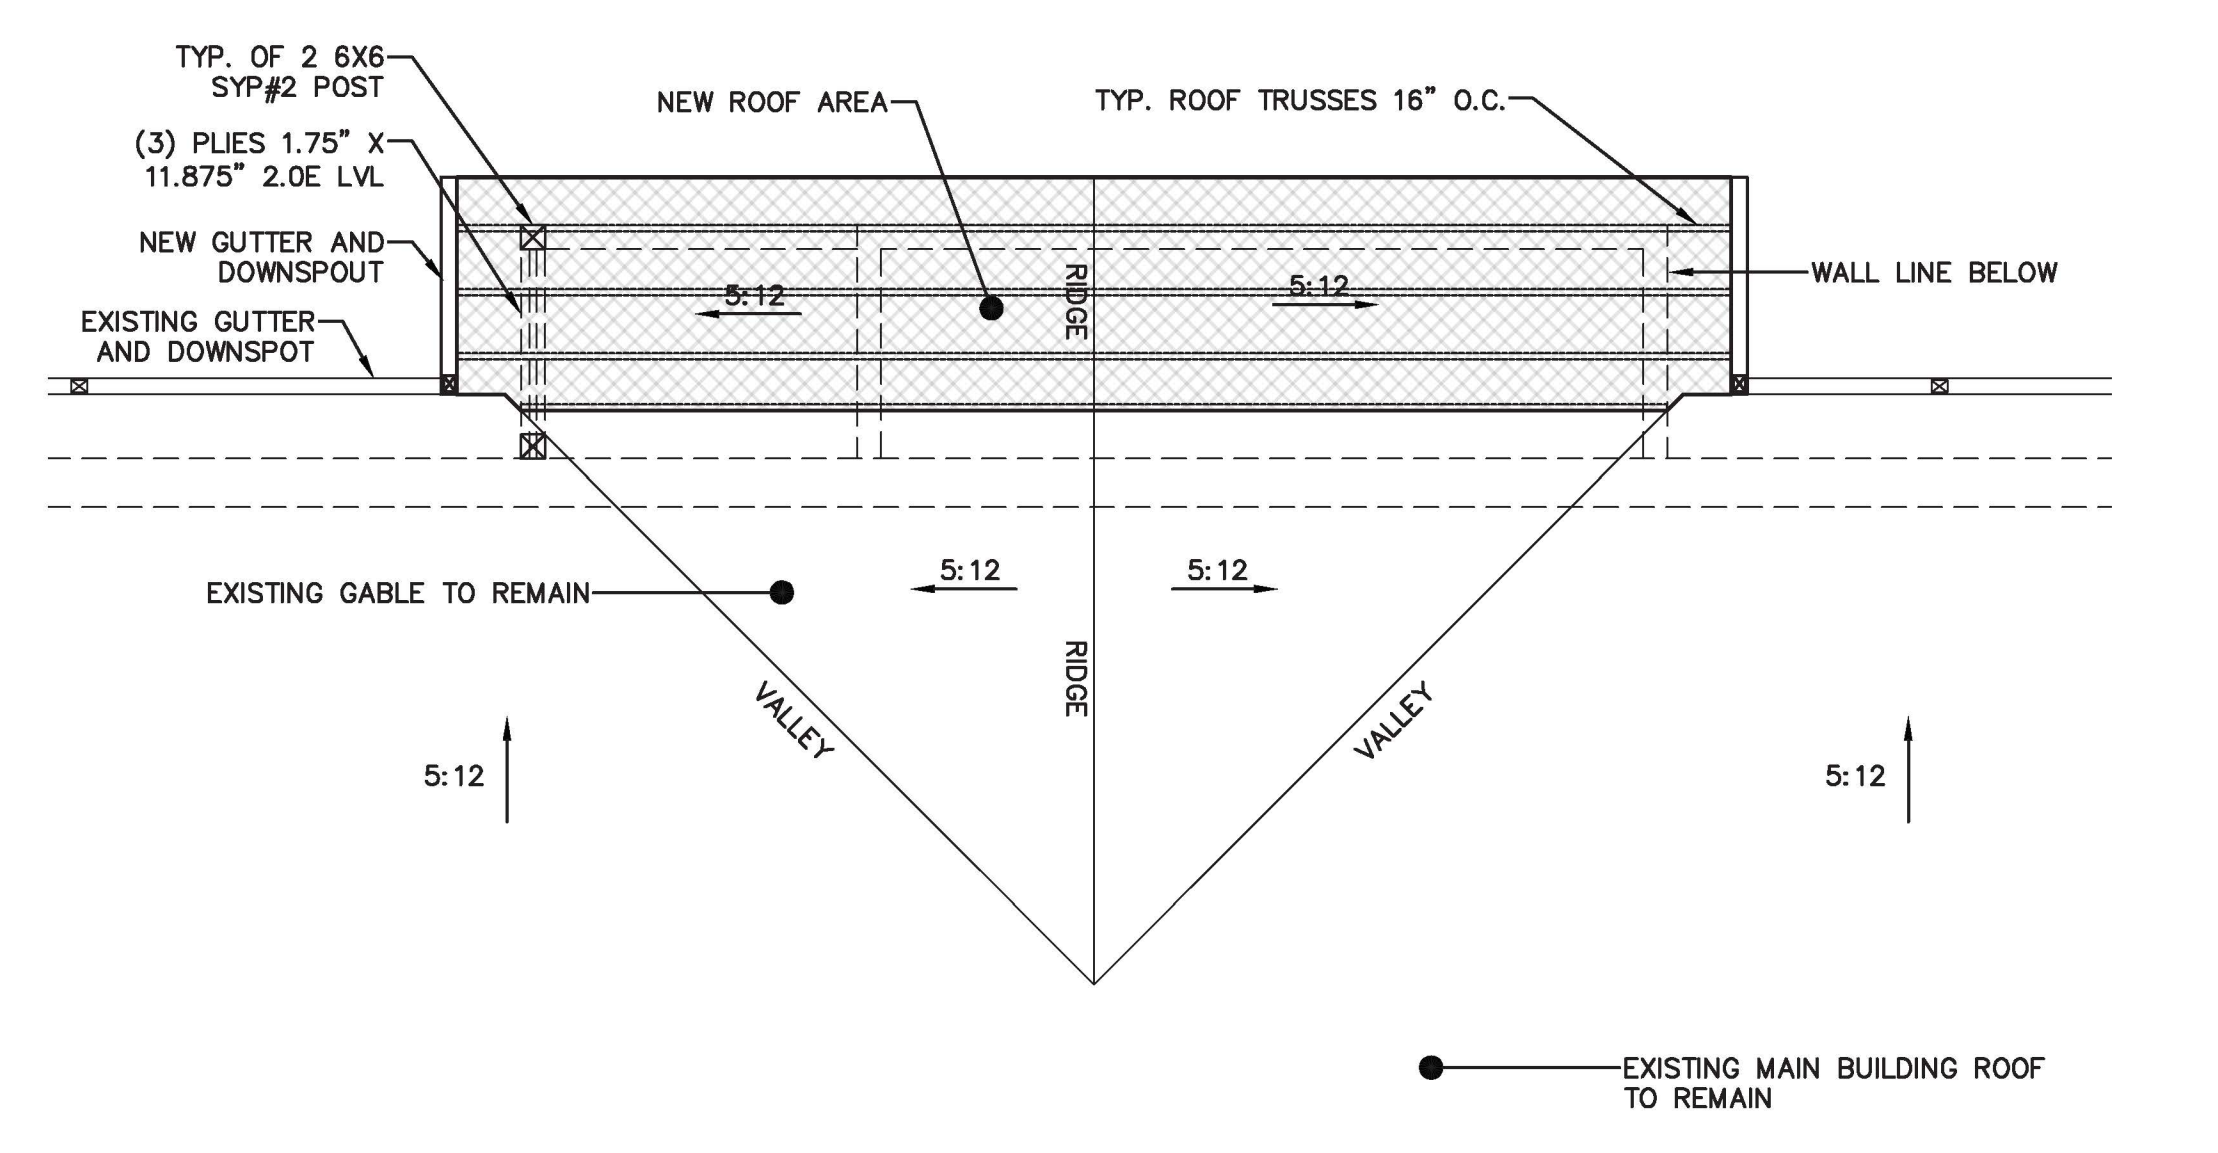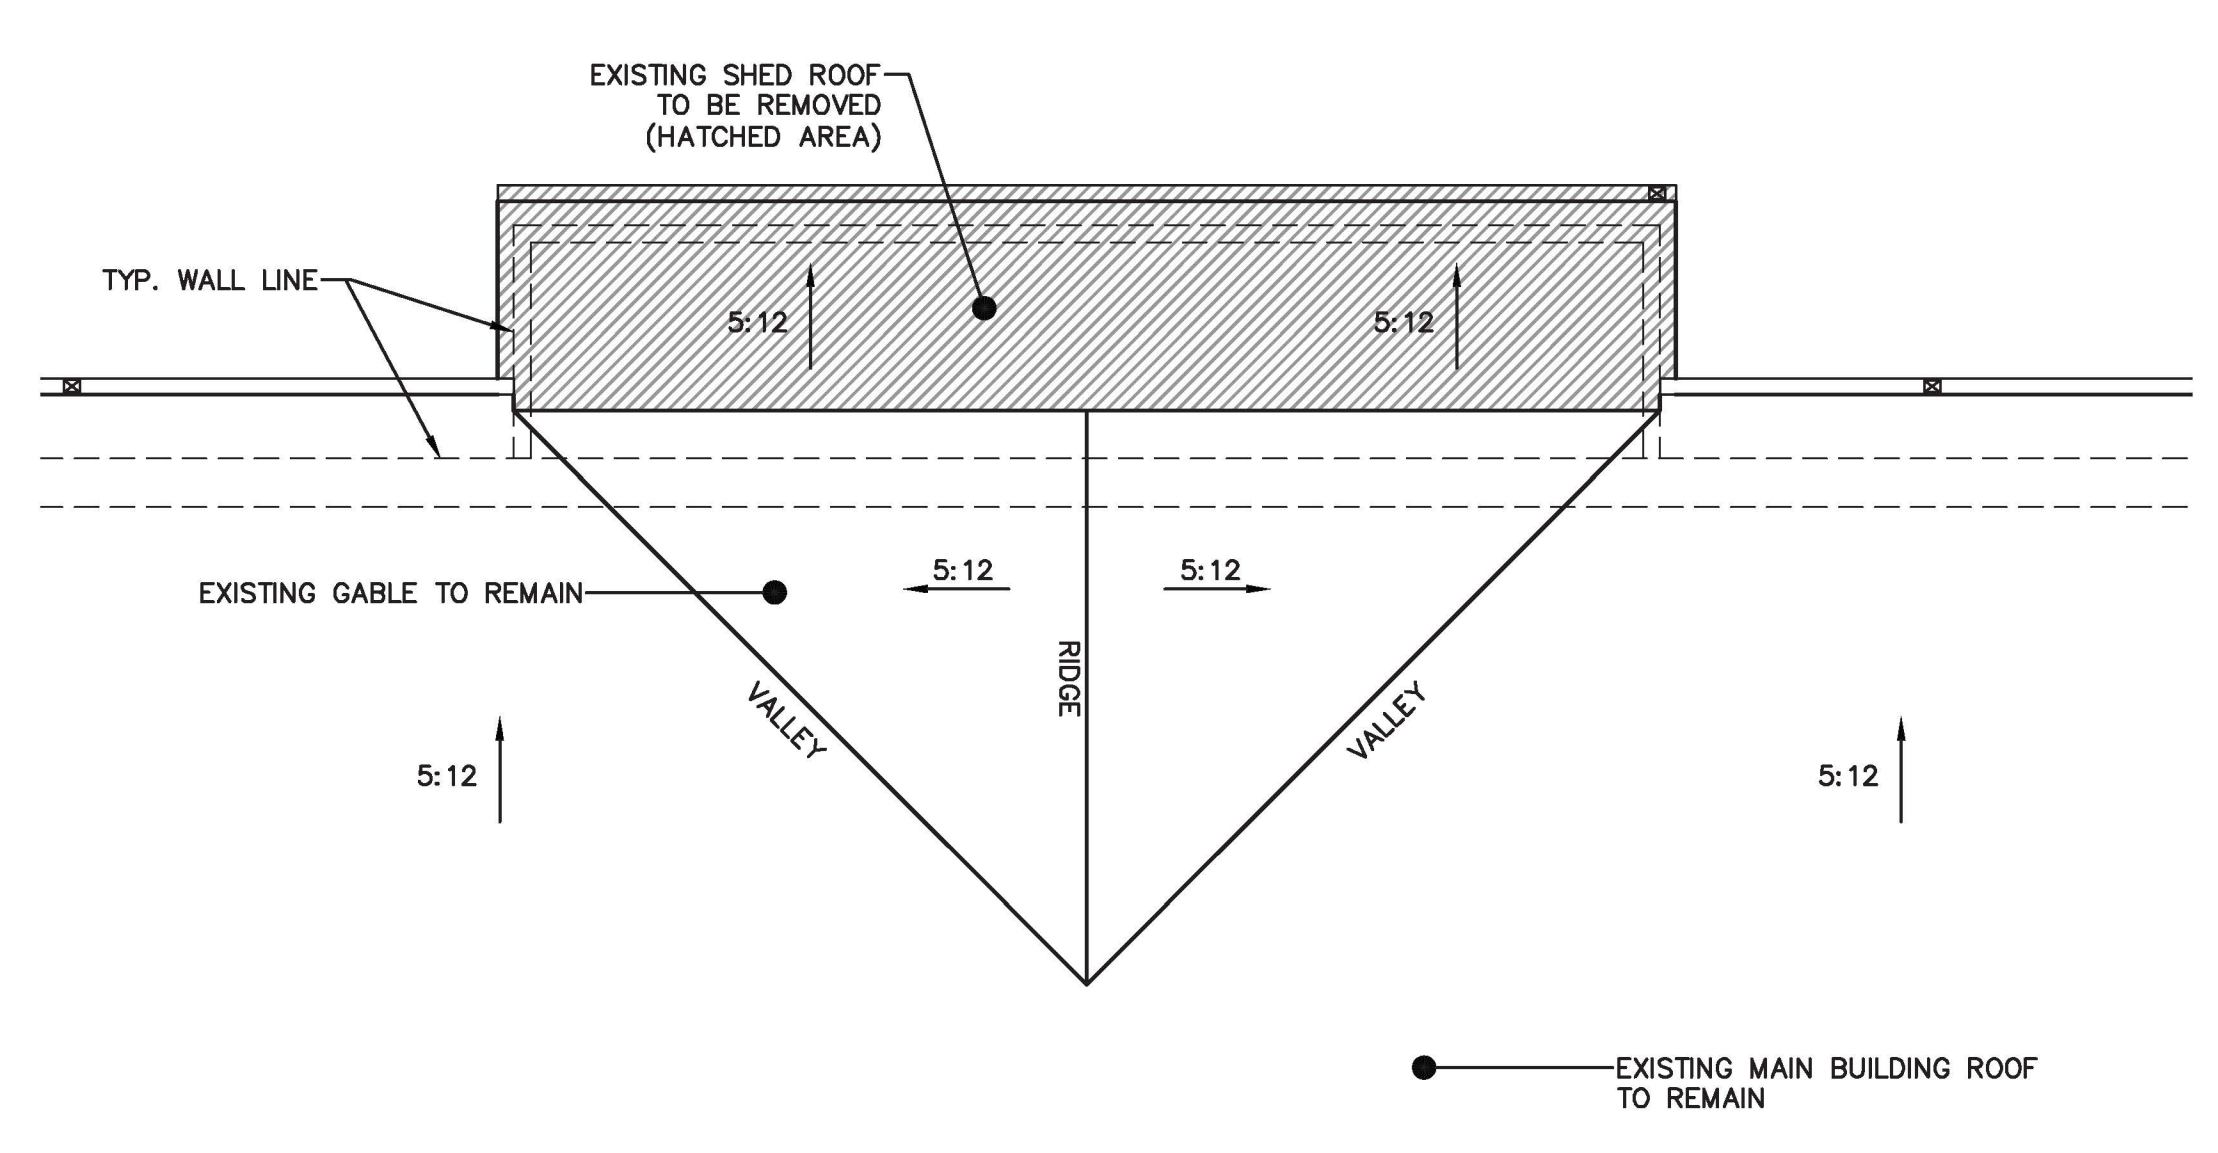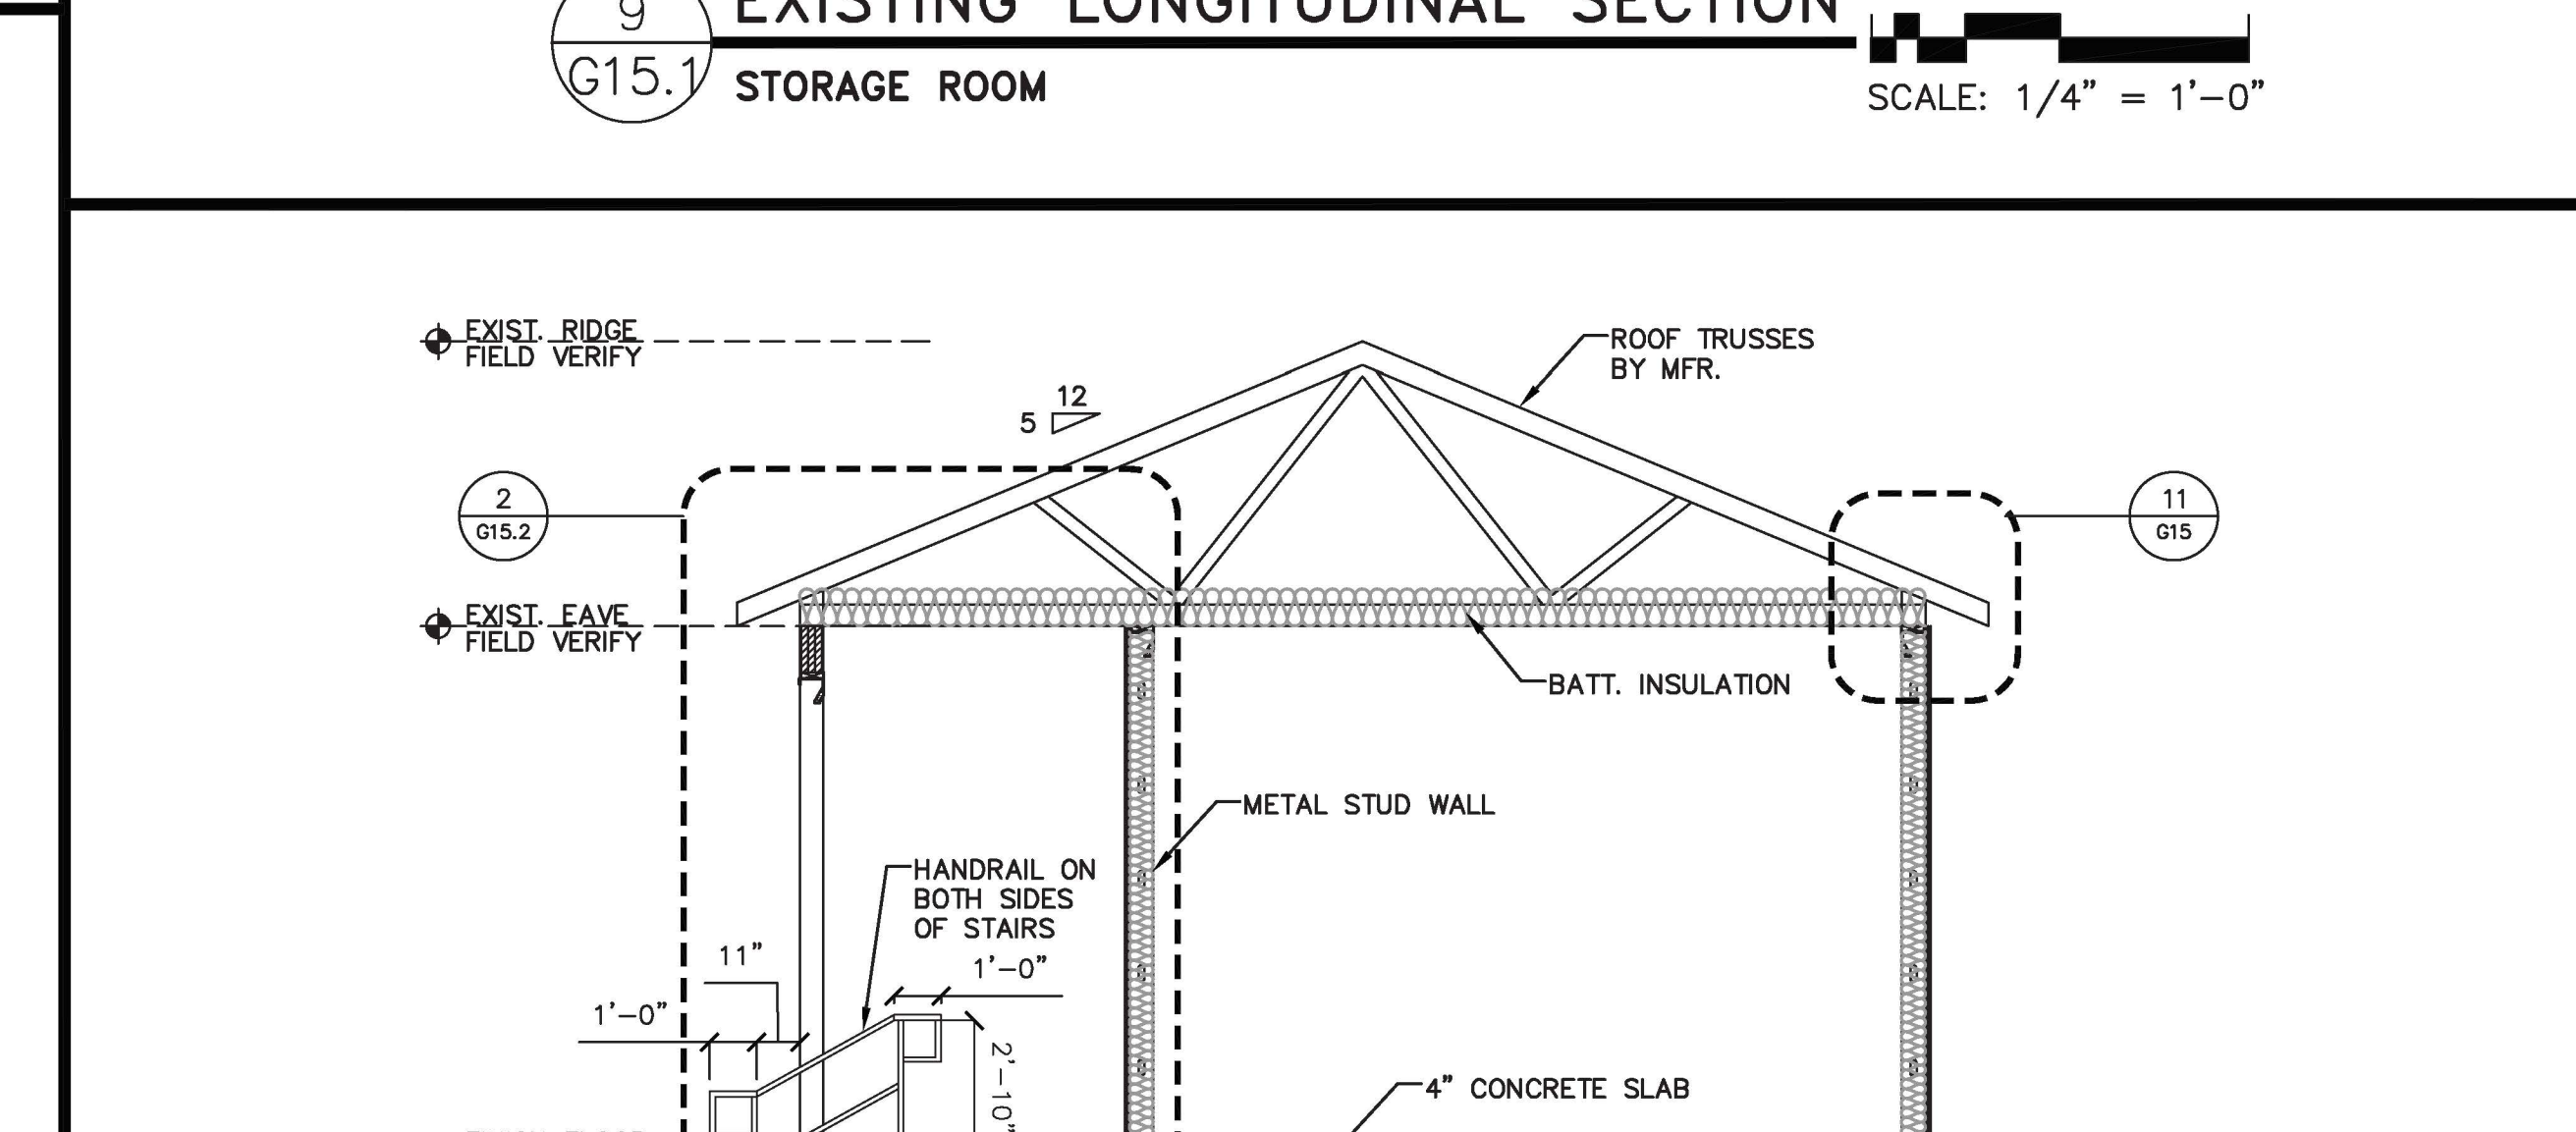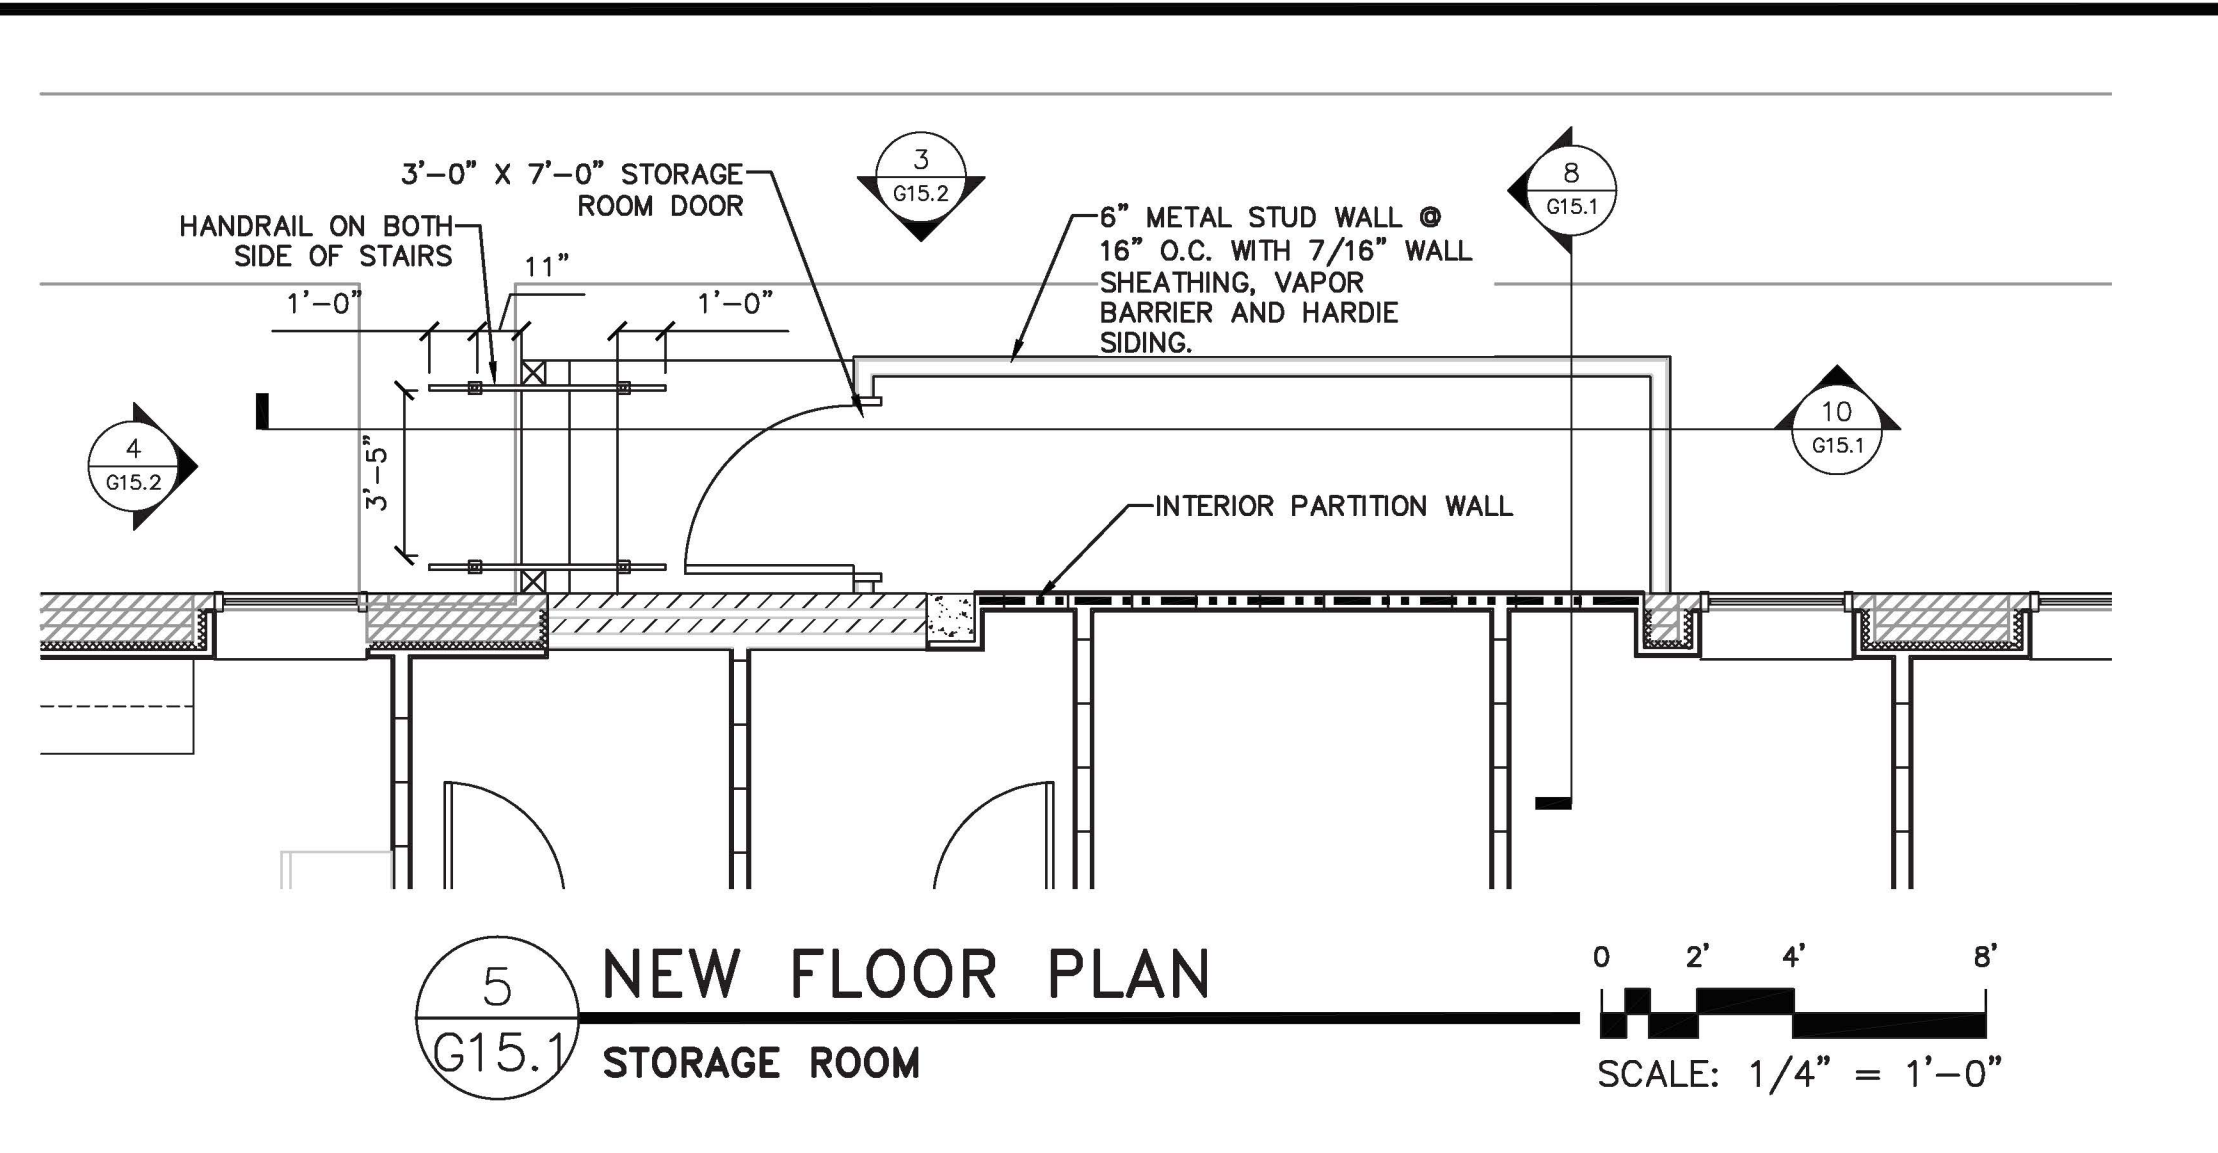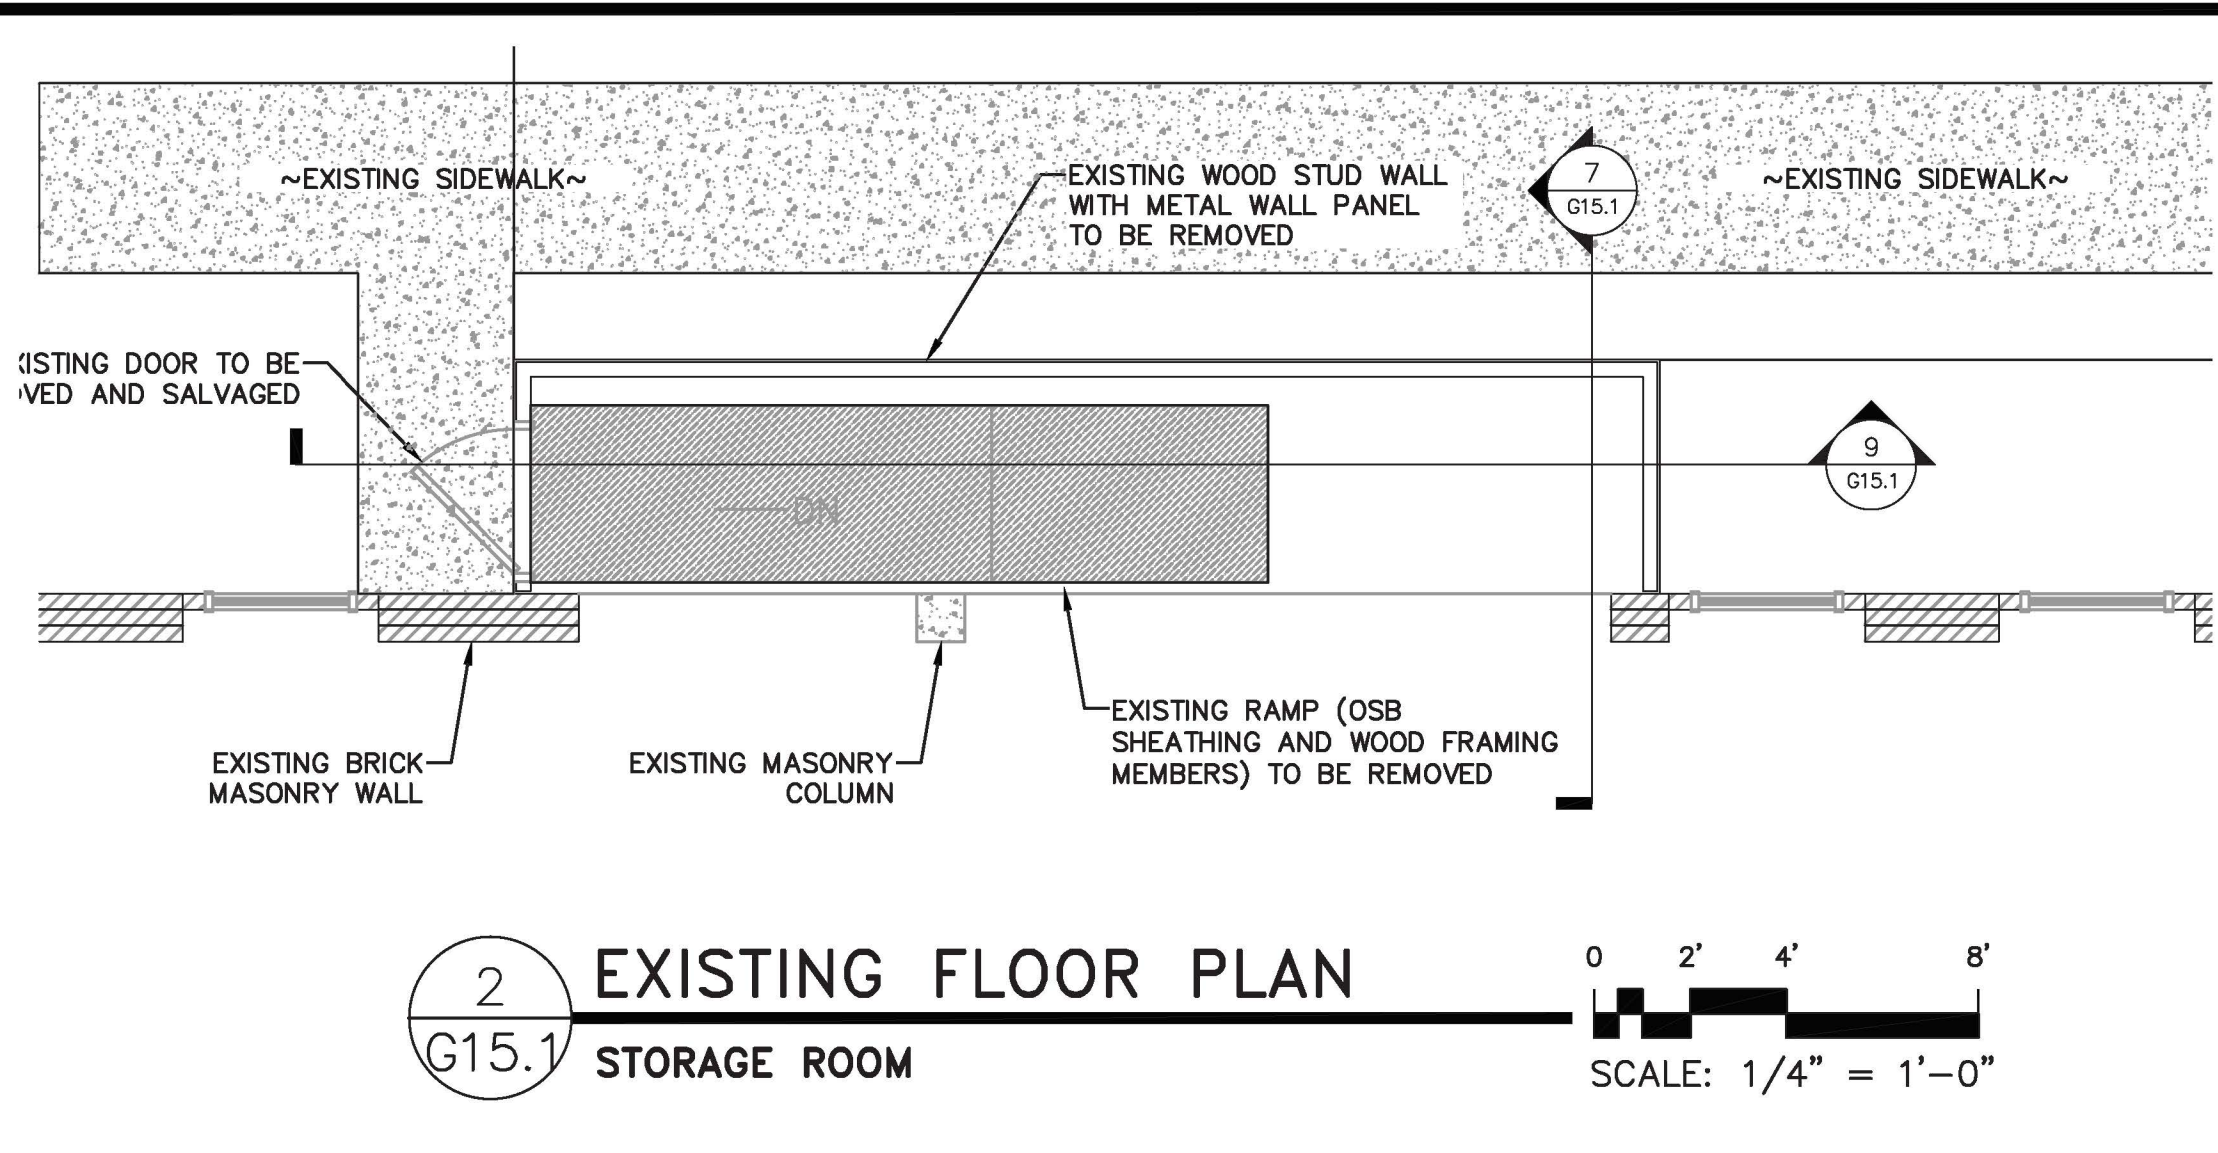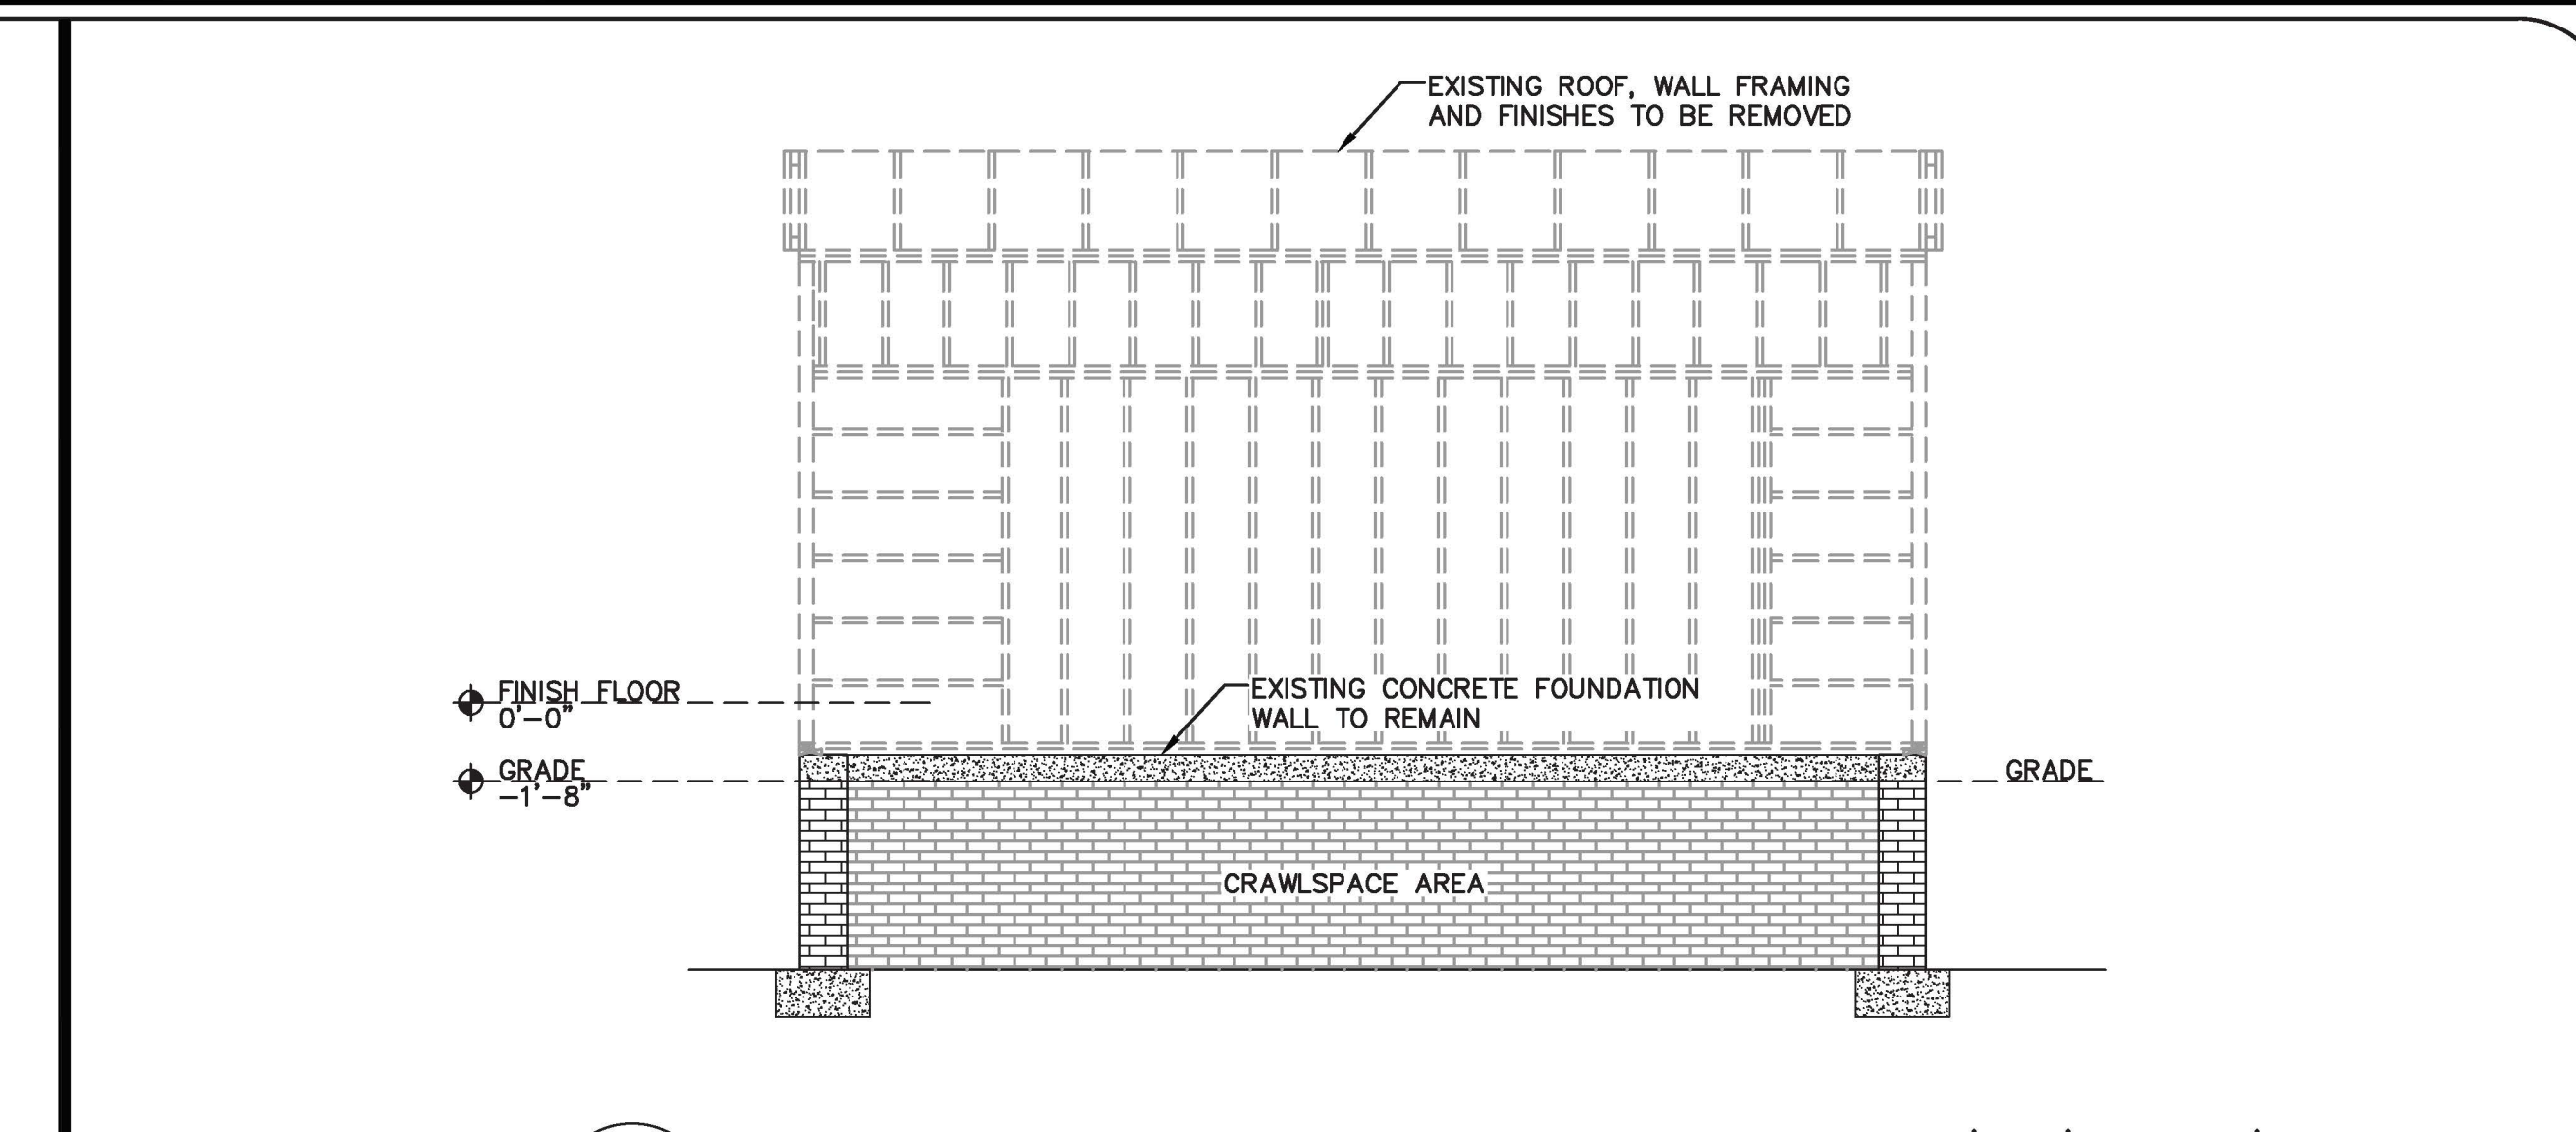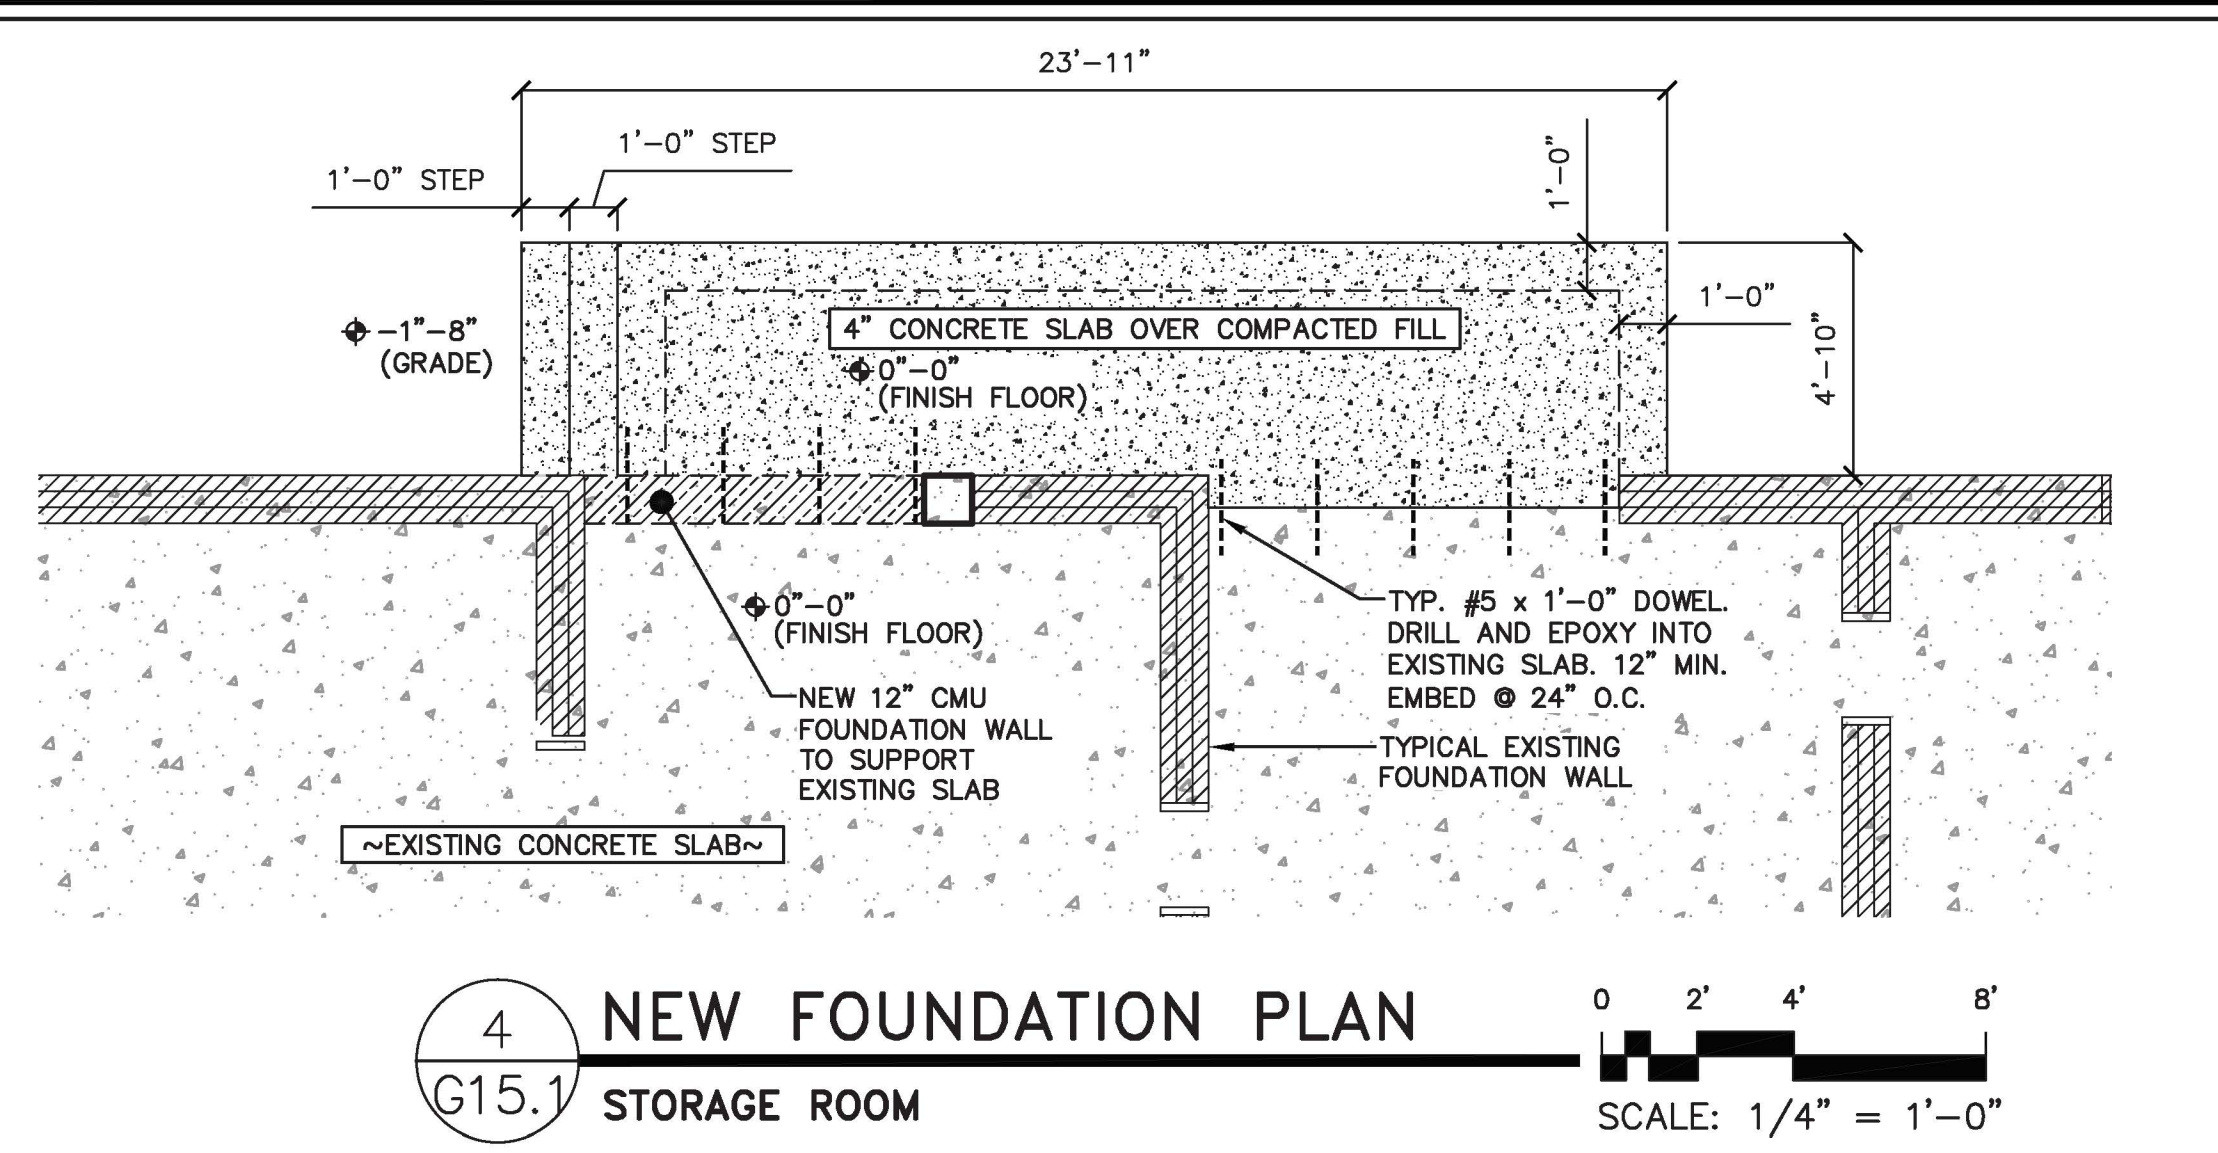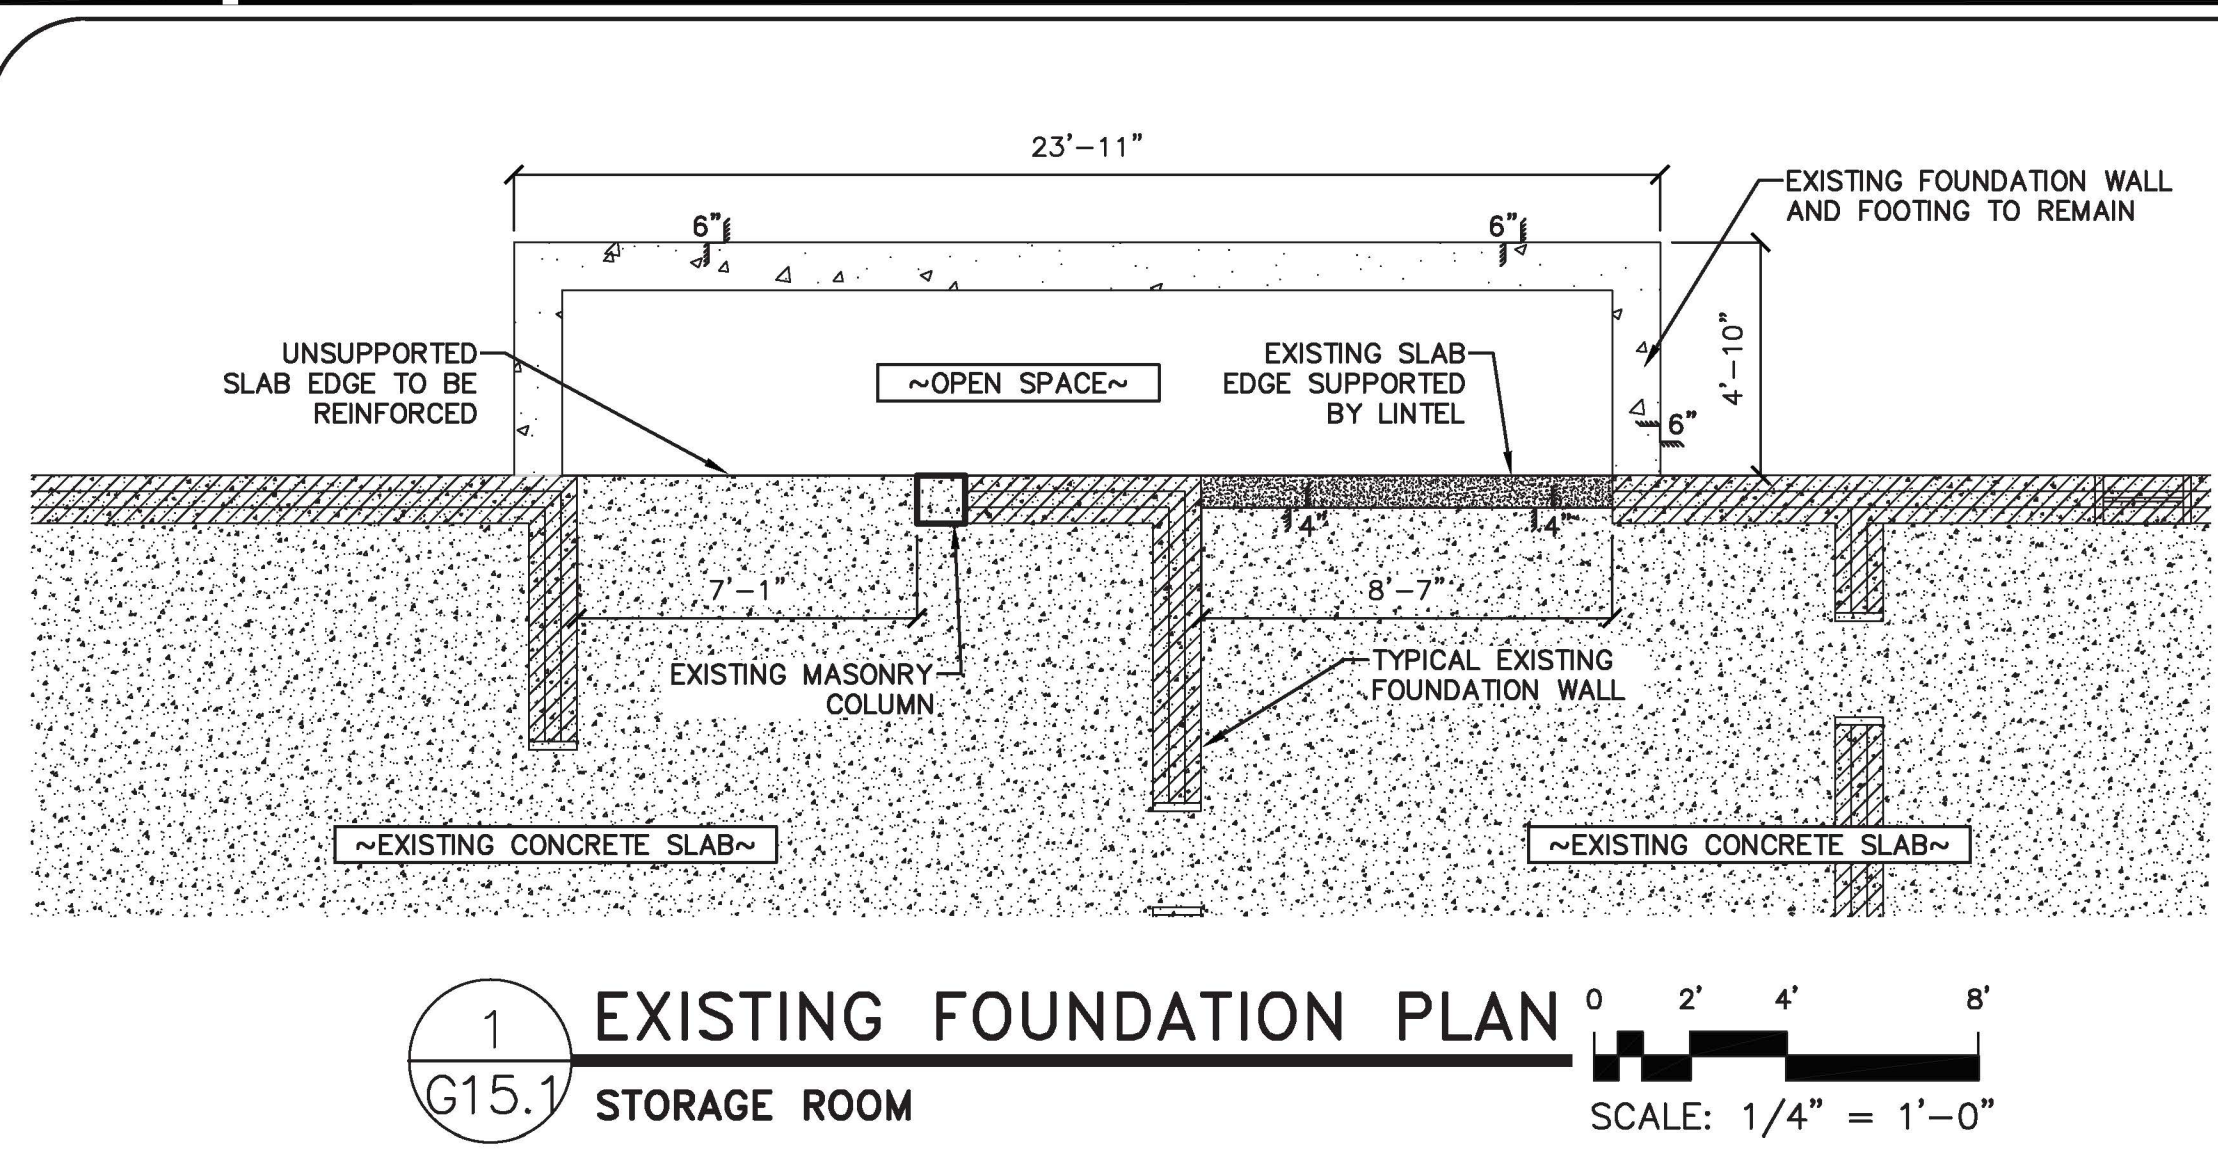

JENKINS
CONSULTING ENGINEERS, P.A.
1008 MARSHALL RD. SUITE 100
FAVETTEVILLE, NC 28110-0002
OFFICE PHONE: 704.835.9977
FAX: 704.835.9977

25 JULY 2025


DESIGNED/CHECKED BY:	KJD
DRAWN BY:	TS, SAN, GD, BT, JC, JDL
PROJECT #:	2025-01-16
DATE:	25 JULY 2025
FINAL DRAWING () FOR REVIEW PURPOSES ONLY	
PRELIMINARY () TOP DESIGN DEVELOPMENT ONLY	
FINAL DRAWING () FOR CONSTRUCTION	
OWNER / FINANCIAL:	GOOD HOPE HOSPITAL
CONTRACTOR / BUILDER:	STE GENERAL CONTRACTORS LLC
410 DENIM DRIVE, ERWIN, NC 28339	
100 TULSA DRIVE, DUNN, NC 28344	
DATE:	
BY:	
DESCRIPTION:	


PROJECT: ALTERATION LEVEL III - GOOD HOPE BEHAVIORAL URGENT CARE

410 DENIM DRIVE, ERWIN, NC 28339

SHEET: EXISTING/NEW FLOOR PLAN & SECTIONS (STORAGE ROOM)

G15.1

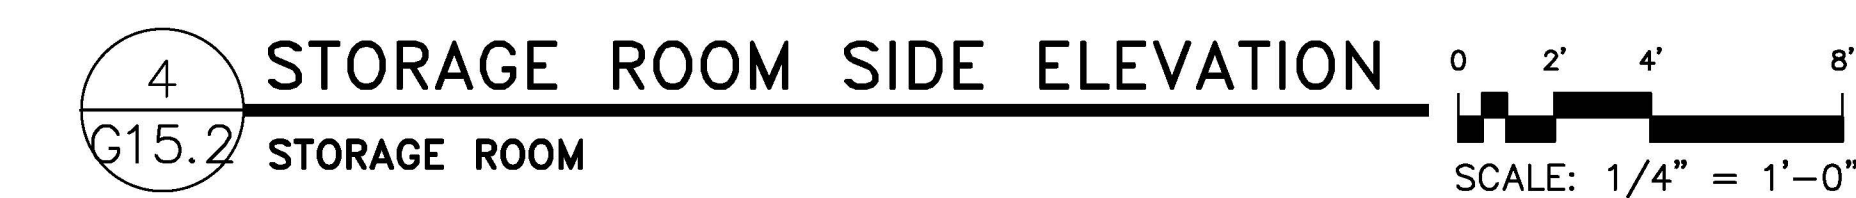

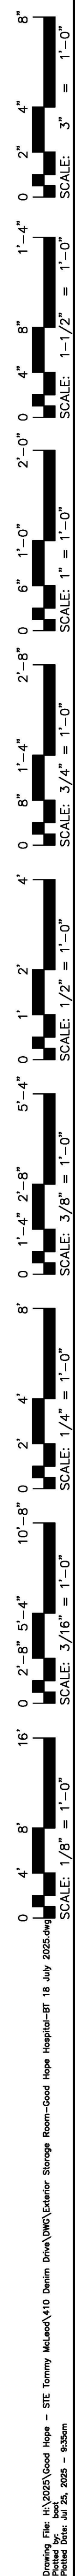


MISC. LIGHT-GAUGE FLOOR FRAMING:

1. SPANS BASED ON CONTINUOUS LATERAL SUPPORT OF THE COMPRESSION FLANGE.
2. WEB PUNCHOUTS WERE NOT CONSIDERED FOR SHEAR OR WEB CRIPPLING. SHEAR AND WEB CRIPPLING REDUCTION FACTORS MAY BE REQUIRED FOR WEB PUNCHOUT, PER ICC-ES ACCEPTANCE CRITERIA AC408, APPENDIX B.
3. WEB CRIPPLING CAPACITY IS BASED ON A 3.5 INCH BEARING LENGTH AND TOP AND INTERIOR SUPPORTS.
4. FOR TWO EQUAL SPANS, THE SPAN IS THE DISTANCE FROM EITHER END SUPPORT TO THE CENTER SUPPORT.
5. JOIST MUST BE BRACED AGAINST ROTATION AT ALL SUPPORTS BY BRACK, WEB STIFFENER, OR BLOCKING.

SPAN (FT)	MINIMUM NUMBER OF ROWS
UP TO 16 FT	1 ROW AT MID-SPAN
16 FT TO 24 FT	2 ROWS AT 1/3 POINTS
24 FT TO 32 FT	3 ROWS AT 1/4 POINTS

DESIGN LOADS:	
LIVE LOAD:	100psf
DEAD LOAD:	10psf

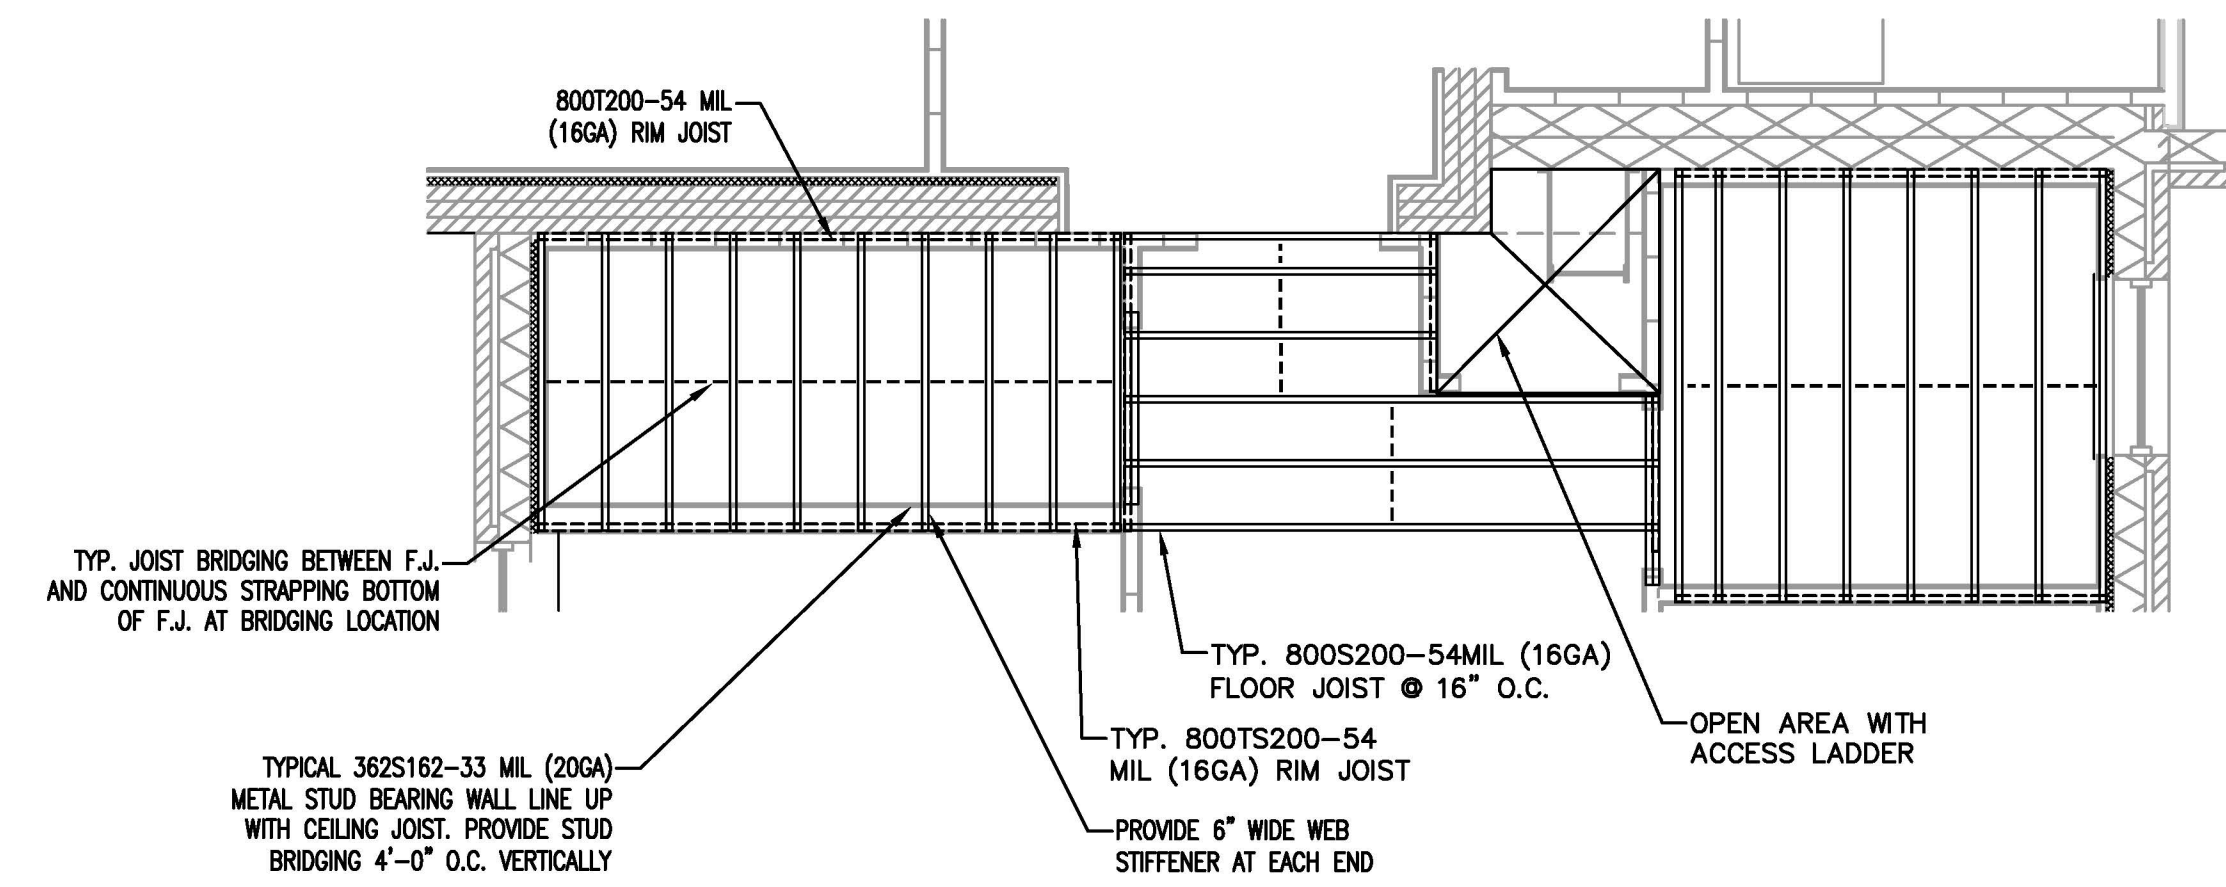


FRAMING PLAN
EQUIPMENT PLATFORM

1
G15.3

0 2' 4' 8'



SCALE: 1/4" = 1'-0"

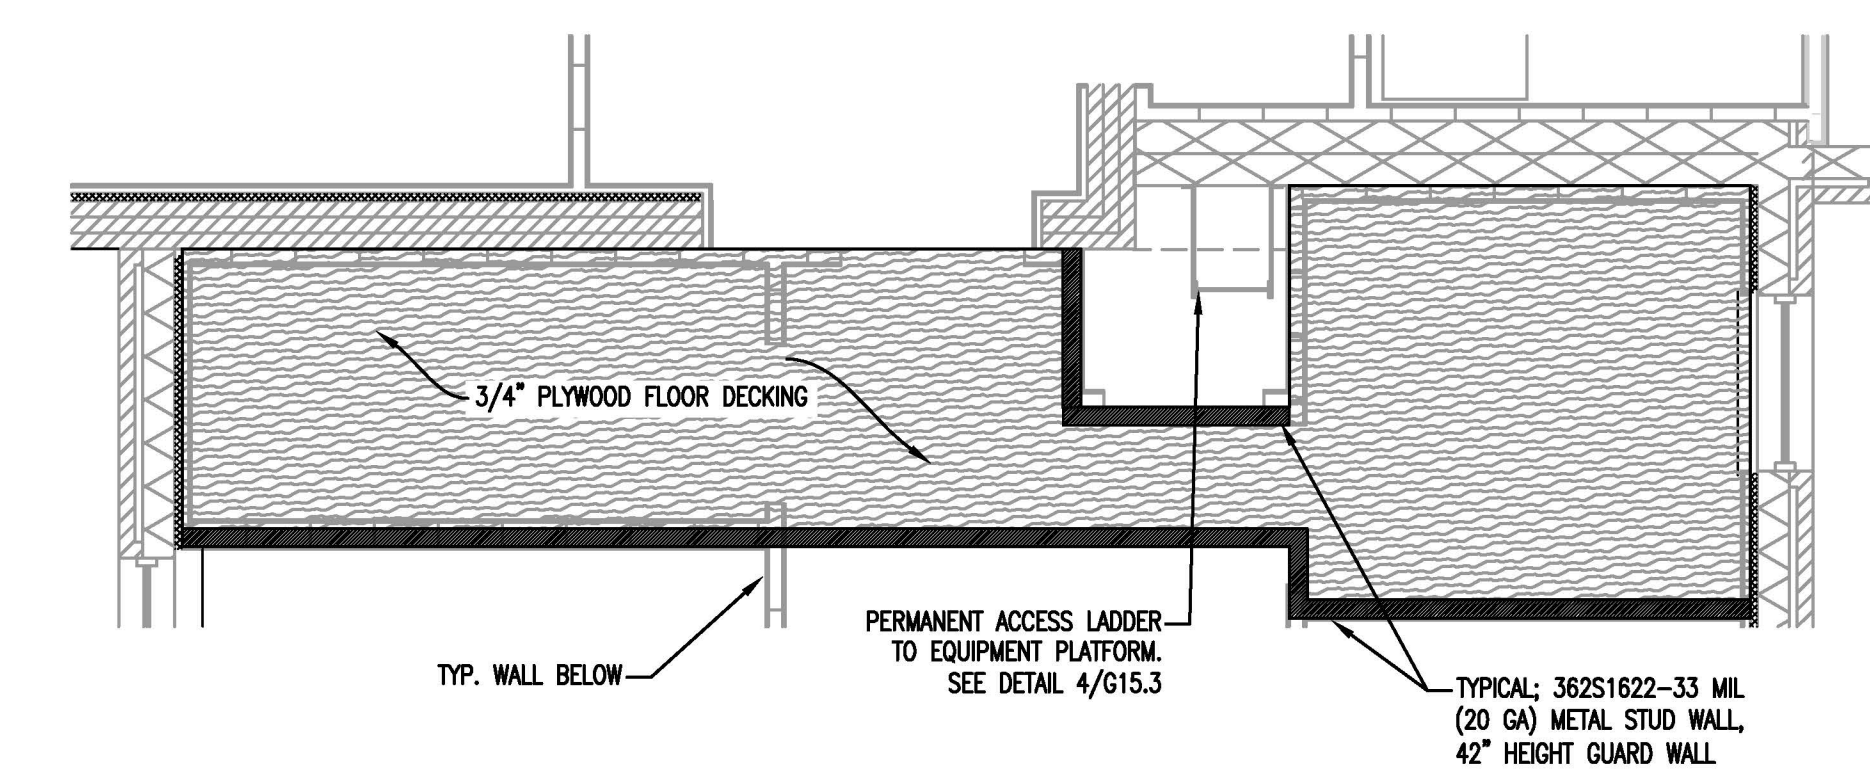

EQUIPMENT PLATFORM PLAN

0 2' 4' 8'

SCALE: 1/4" = 1'-0"

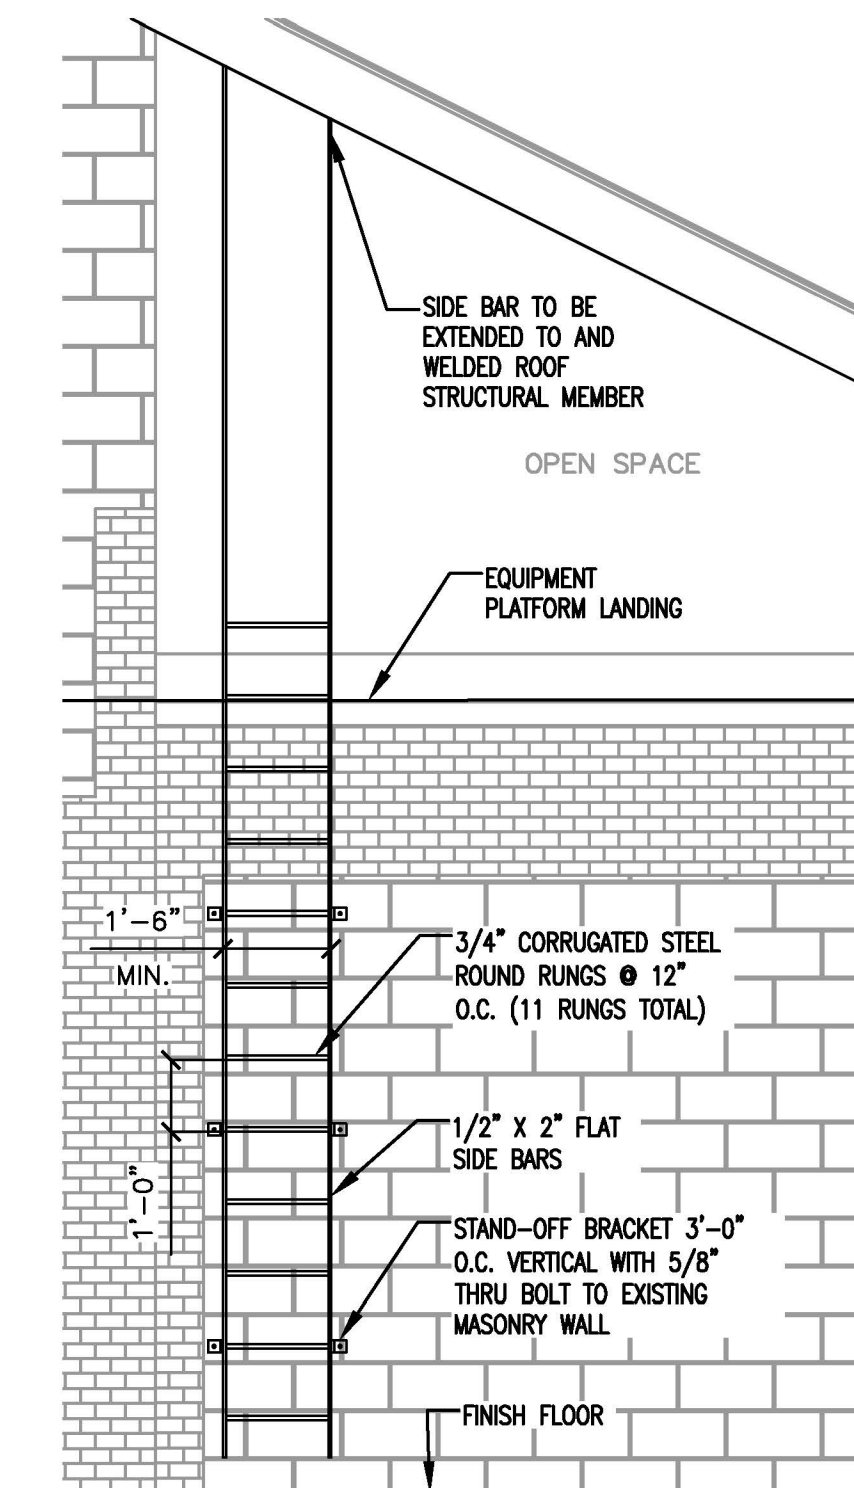
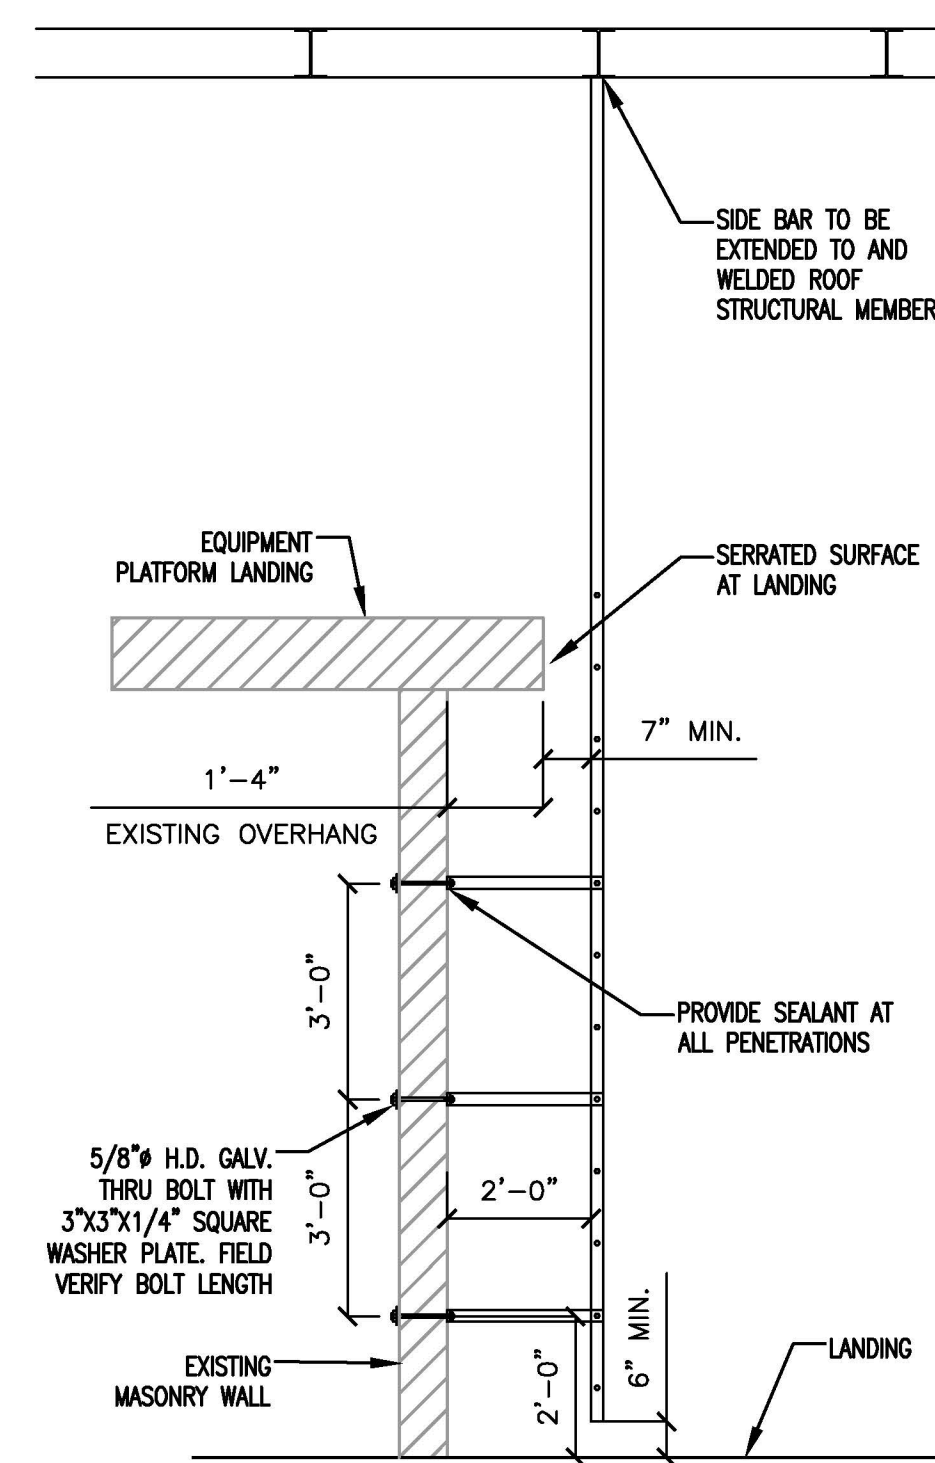


4 EQUIPMENT PLATFORM ACCESS LADDER


15.3

0 1'-4" 2'-8" 5'-4"


SCALE: 3/8" = 1'-0"

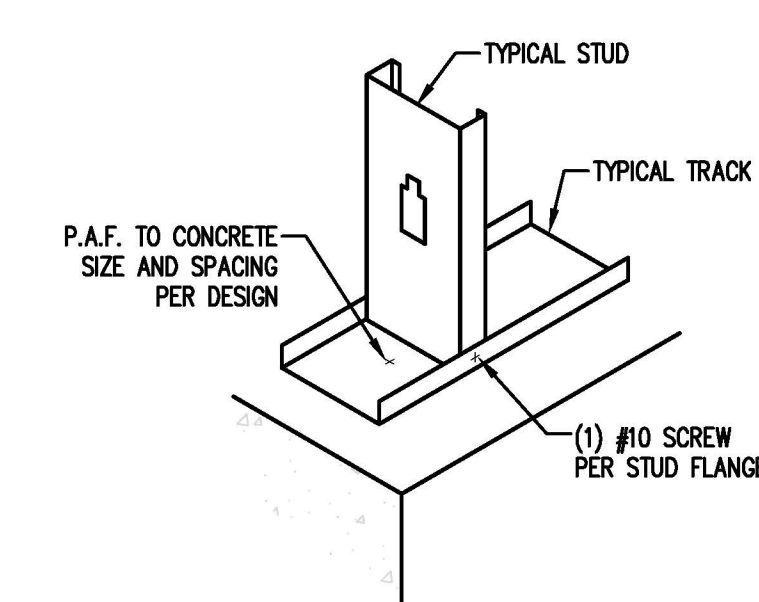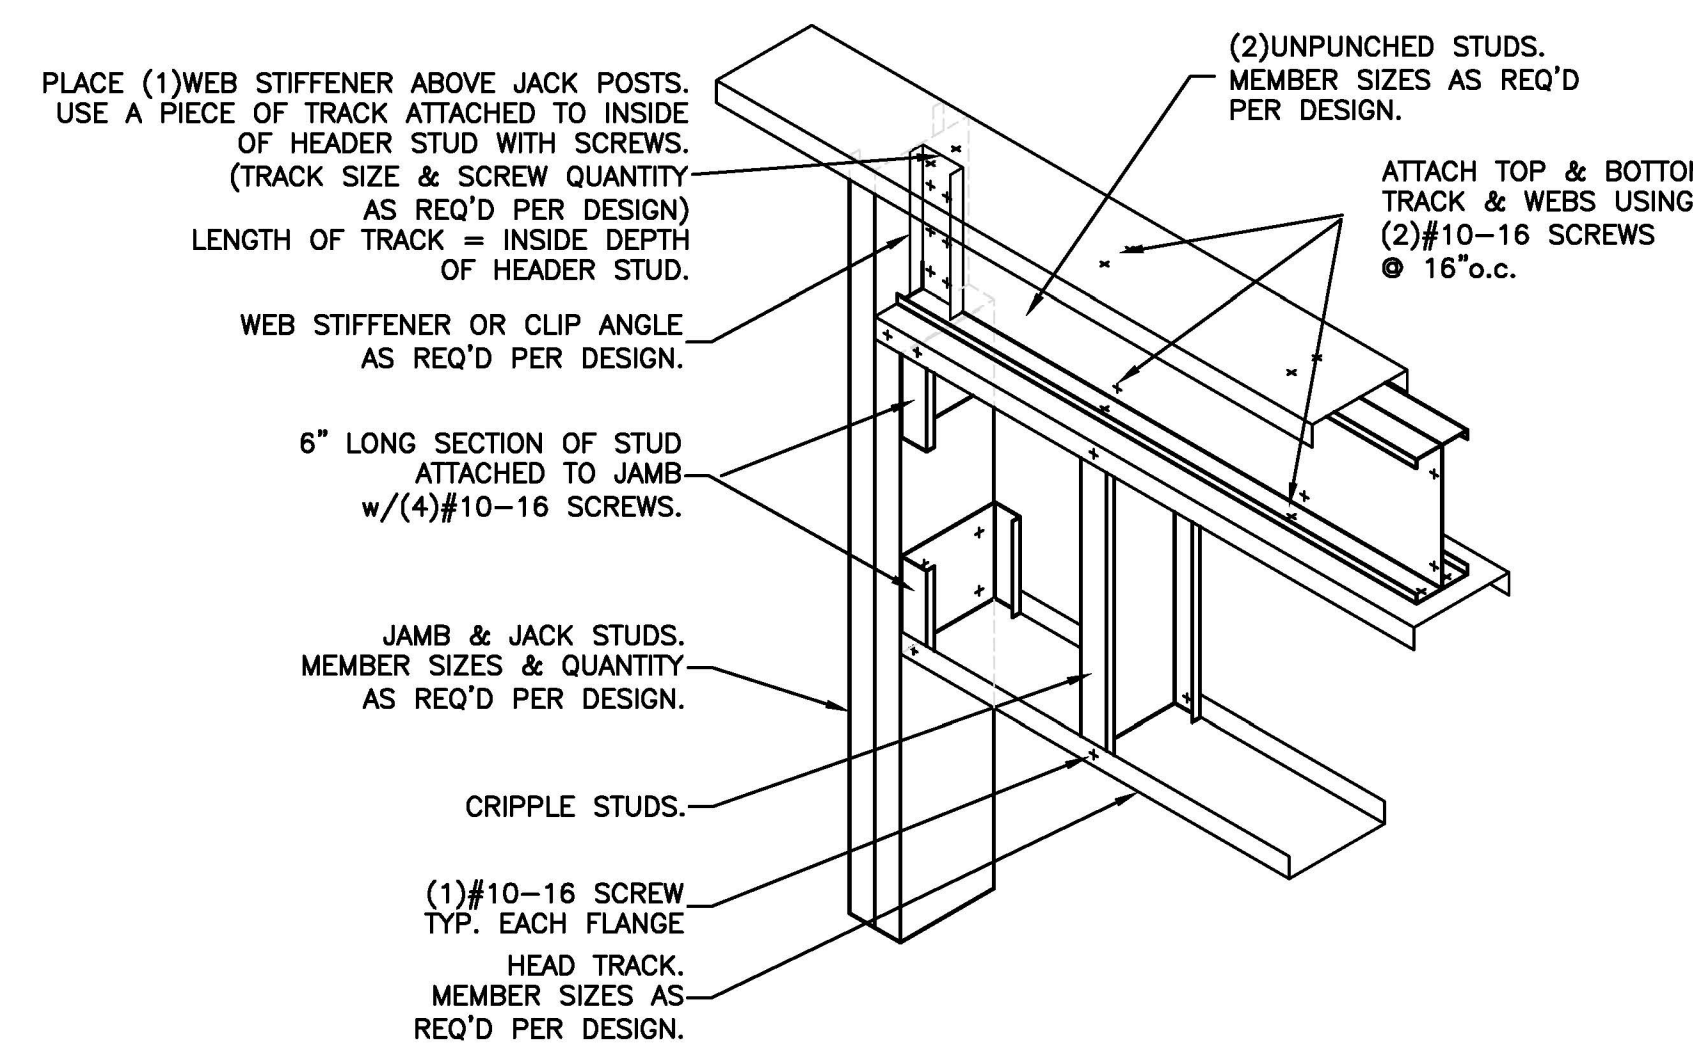


STUD BASE DETAIL

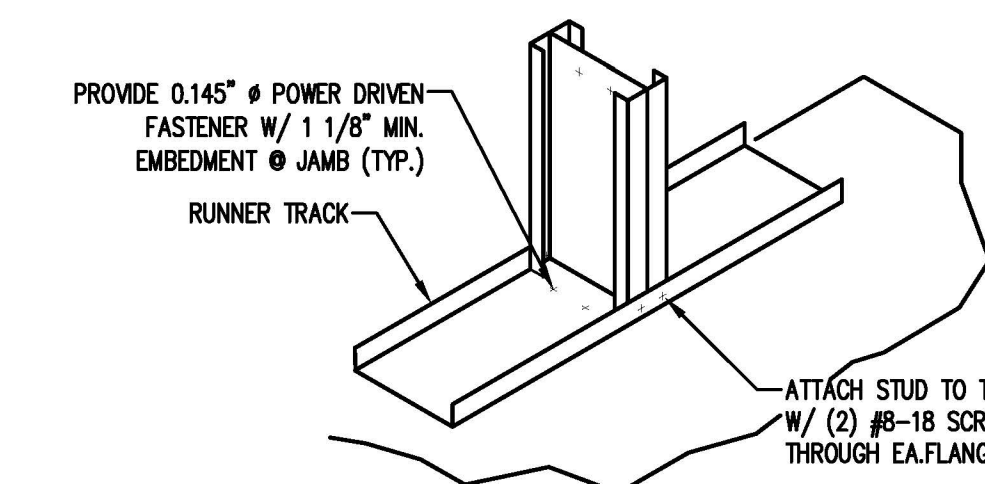

ANCHORAGE AT JAMB


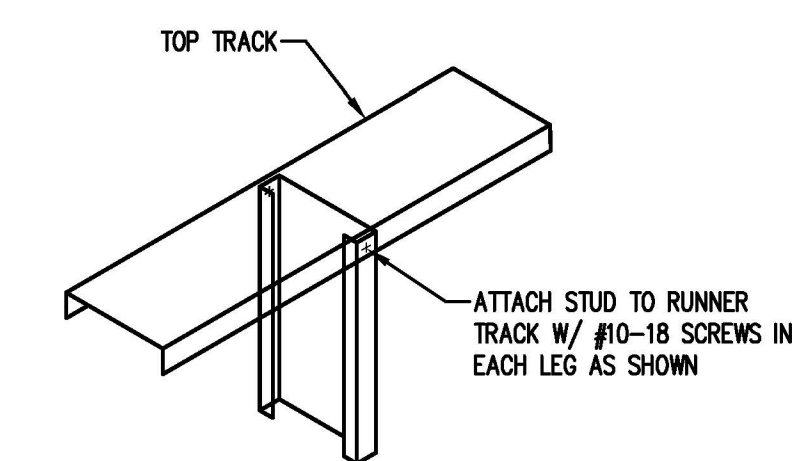


TOP TRACK CONNECTION

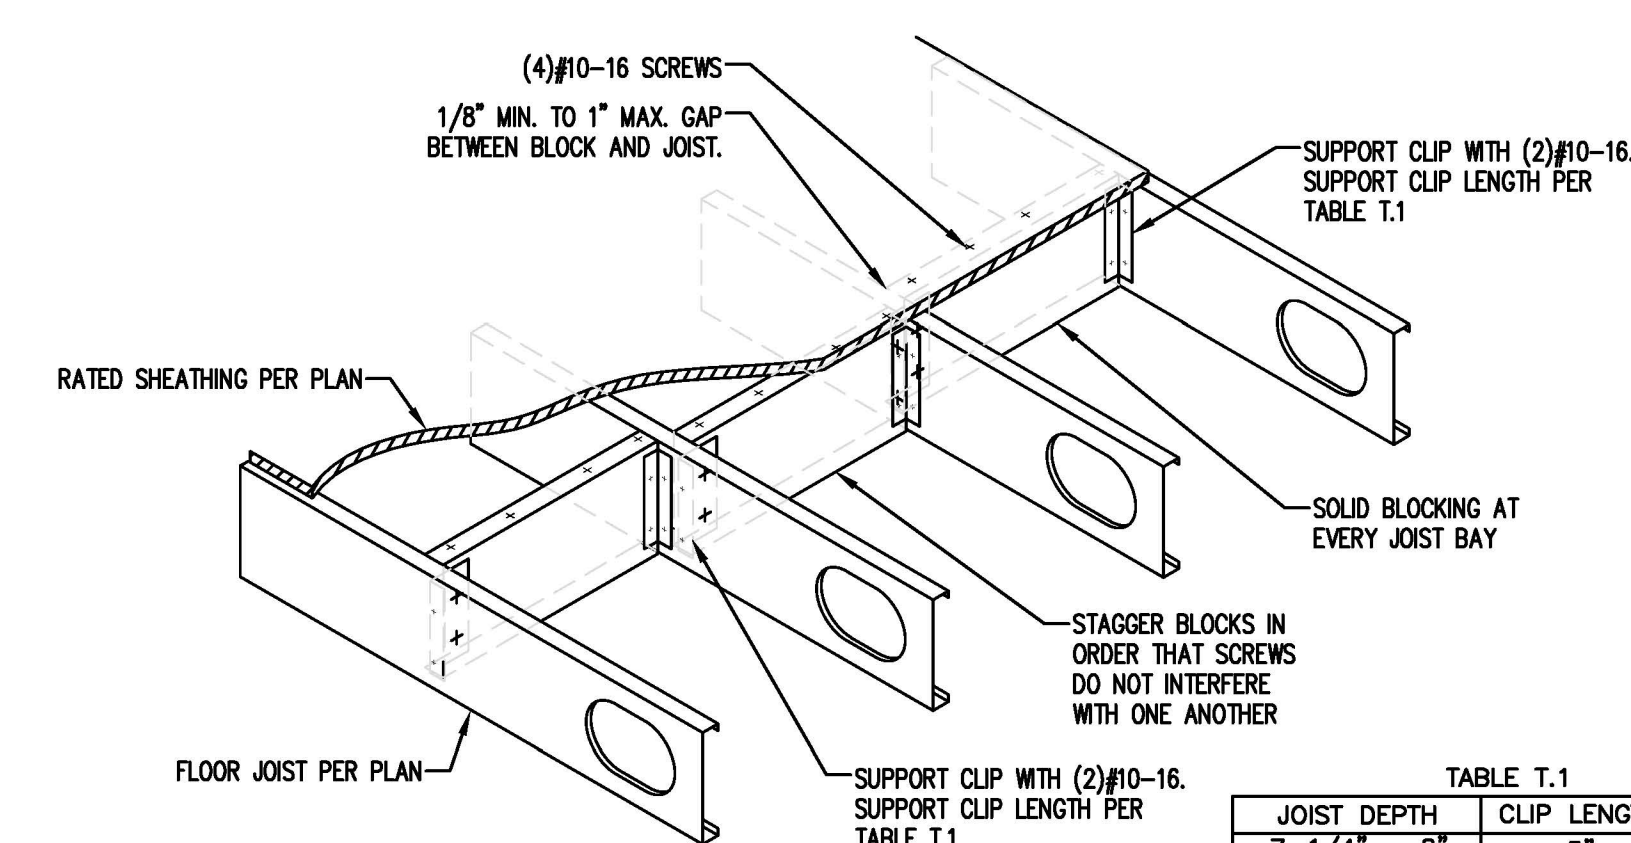


JOIST BRIDGING – SOLID BLOCKING

JOIST DEPTH	CLIP LENGTH (X)
7-1/4" - 8"	5"
9-1/4" - 10"	7"
11-1/4" - 14"	9"

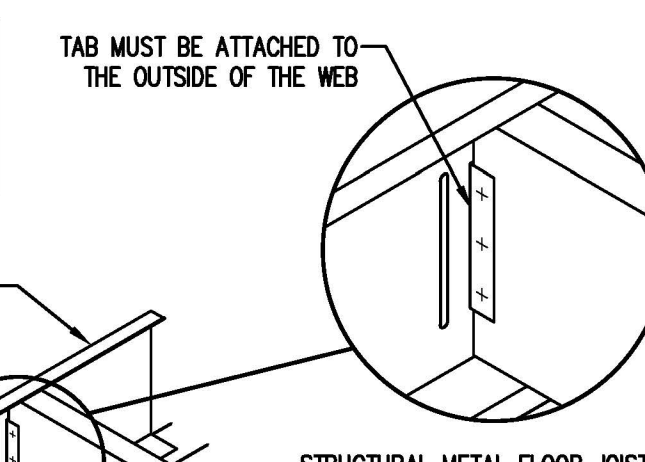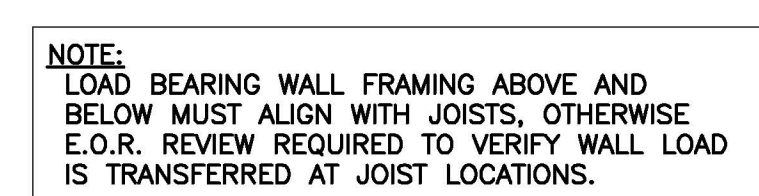


RIM TRACK DETAIL

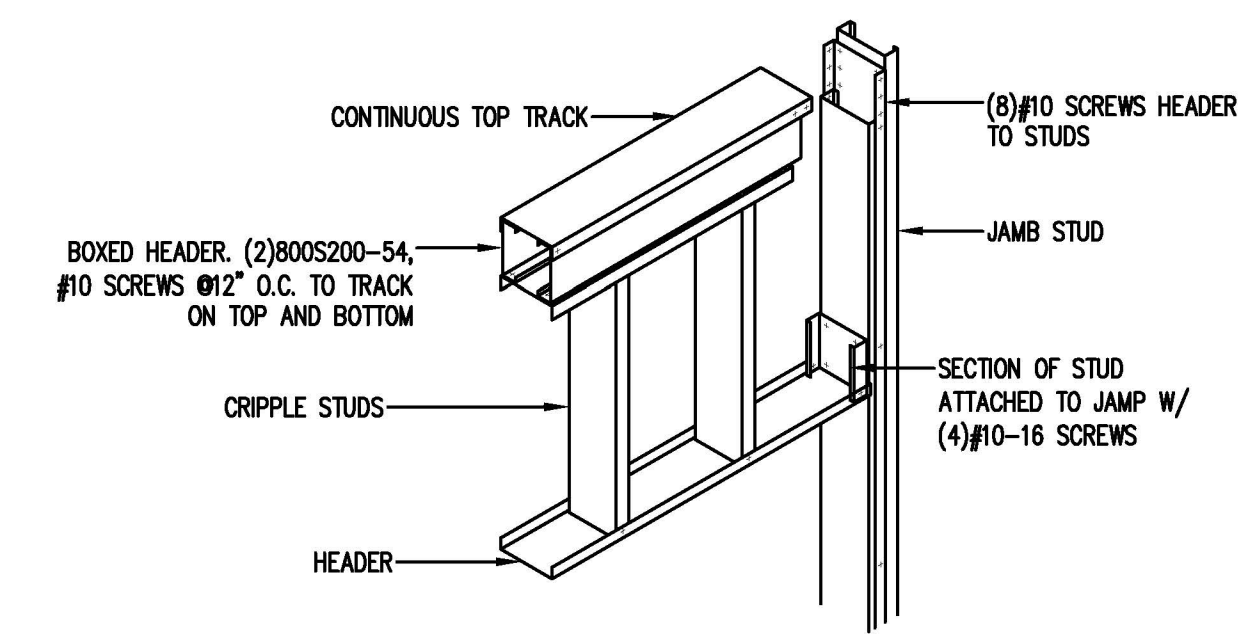

LOAD BEARING JAMB AND HEADER DETAIL

3 TYPICAL COLD-FORMED METAL STUD DETAILS
G15.3 N.T.S. T

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

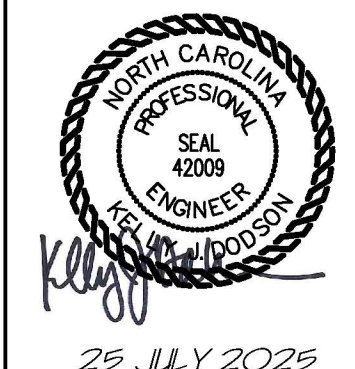[illegible]

PROJECT: ALTERATION LEVEL III - GOOD HOPE BEHAVIORAL URGENT CARE
410 DENIM DRIVE, ERWIN, NC 28339
SHEET: EQUIPMENT PLATFORM PLAN & DETAILS

G15.3

0' 4" 8" 12" 16" 20" 24" 28" 32" 36" 40" 44" 48" 52" 56" 60" 64" 68" 72" 76" 80" 84" 88" 92" 96" 100" 104" 108" 112" 116" 120" 124" 128" 132" 136" 140" 144" 148" 152" 156" 160" 164" 168" 172" 176" 180" 184" 188" 192" 196" 200" 204" 208" 212" 216" 220" 224" 228" 232" 236" 240" 244" 248" 252" 256" 260" 264" 268" 272" 276" 280" 284" 288" 292" 296" 300" 304" 308" 312" 316" 320" 324" 328" 332" 336" 340" 344" 348" 352" 356" 360" 364" 368" 372" 376" 380" 384" 388" 392" 396" 400" 404" 408" 412" 416" 420" 424" 428" 432" 436" 440" 444" 448" 452" 456" 460" 464" 468" 472" 476" 480" 484" 488" 492" 496" 500" 504" 508" 512" 516" 520" 524" 528" 532" 536" 540" 544" 548" 552" 556" 560" 564" 568" 572" 576" 580" 584" 588" 592" 596" 600" 604" 608" 612" 616" 620" 624" 628" 632" 636" 640" 644" 648" 652" 656" 660" 664" 668" 672" 676" 680" 684" 688" 692" 696" 700" 704" 708" 712" 716" 720" 724" 728" 732" 736" 740" 744" 748" 752" 756" 760" 764" 768" 772" 776" 780" 784" 788" 792" 796" 800" 804" 808" 812" 816" 820" 824" 828" 832" 836" 840" 844" 848" 852" 856" 860" 864" 868" 872" 876" 880" 884" 888" 892" 896" 900" 904" 908" 912" 916" 920" 924" 928" 932" 936" 940" 944" 948" 952" 956" 960" 964" 968" 972" 976" 980" 984" 988" 992" 996" 1000'

SPLIT-SYSTEM HEAT PUMP UNIT SCHEDULE														
GENERAL INFORMATION					COMPRESSOR		OUTDOOR FAN			REFRIGERANT			ELECTRICAL	
TAG	MANUFACTURER & MODEL #	TONS	LOCATION	DIMENSIONS (IN.) H x W x D	WEIGHT (NET LBS.)	COUNT	TYPE	R.L.A. - L.R.A.	COUNT	MOTOR HP	MOTOR R.P.M.	MOTOR F.L.A.	TYPE	GAS LINE (IN.)
HP-1	TRANE - 5TW4048A3000A	4	EXT. PAD	45-1/8 x 37-1/4 x 34-1/4	251	1	SCROLL	12.2 - 120.4	1	1/3	850	2.8	R-454B	7/8
HP-2	TRANE - 5TW4048A3000A	4	EXT. PAD	45-1/8 x 37-1/4 x 34-1/4	251	1	SCROLL	12.2 - 120.4	1	1/3	850	2.8	R-454B	7/8
HP-3	TRANE - 5TW4048A3000A	4	EXT. PAD	45-1/8 x 37-1/4 x 34-1/4	251	1	SCROLL	12.2 - 120.4	1	1/3	850	2.8	R-454B	7/8

SPLIT-SYSTEM AIR HANDLER UNIT SCHEDULE																					
GENERAL INFORMATION					INDOOR FAN					REFRIGERANT			HEATER		ELECTRICAL						
TAG	MANUFACTURER & MODEL #	TONS	LOCATION	DIMENSIONS (IN.) H x W x D	WEIGHT (NET LBS.)	SUPPLY CFM	OA CFM	BLOWER TYPE	MOTOR TYPE	MOTOR R.P.M.	MOTOR F.L.A.	TYPE	GAS LINE (IN.)	LIQUID LINE (IN.)	MODEL #	CAPACITY KW BTUH	VOLTS	PHASE	M.C.A.	FEEDER (CU. FT. 5 C)	
AH-1	TRANE - STEMS06A415A	4	ATTIC	57-3/8 x 23-1/2 x 21-1/8	174	1600	320	DIRECT	VARIABLE SPEED	1050	6.8	R-454B	7/8	3/8	BA1YTR1508BRK	5.76 19,700	208	3	43	45	(3)Ø & (1)Ø GND IN 3/4" COND.
AH-2	TRANE - STEMS06A415A	4	ATTIC	57-3/8 x 23-1/2 x 21-1/8	174	1600	430	DIRECT	VARIABLE SPEED	1050	6.8	R-454B	7/8	3/8	BA1YTR1508BRK	5.76 19,700	208	3	43	45	(3)Ø & (1)Ø GND IN 3/4" COND.
AH-3	TRANE - STEMS06A415A	4	UTILITY MEZZANINE	57-3/8 x 23-1/2 x 21-1/8	174	1600	340	DIRECT	VARIABLE SPEED	1050	6.8	R-454B	7/8	3/8	BA1YTR1508BRK	5.76 19,700	208	3	43	45	(3)Ø & (1)Ø GND IN 3/4" COND.


MINI SPLIT OUTDOOR UNIT SCHEDULE									
GENERAL INFORMATION					COOLING/REFRIGERANT			ELECTRICAL	
TAG	MANUFACTURER & MODEL #	LOCATION	DIMENSIONS (IN.) H x W x D	WEIGHT (NET LBS.)	BTU	TYPE	GAS LINE (IN.)	LIQUID LINE (IN.)	FEEDER (CU. 75 C)
MSO-1	MITSUBISHI - MUY-GX09NL	EXT. PAD	21-5/8 x 31-1/2 x 11-1/4	77	9000	R-454B	3/8	1/4	240 1 12 25 (2) #10 & (1) #10 GND IN 3/4" COND.

MINI SPLIT INDOOR UNIT SCHEDULE									
GENERAL INFORMATION					COOLING/REFRIGERANT			ELECTRICAL	
TAG	MANUFACTURER & MODEL #	LOCATION	DIMENSIONS (IN.) H x W x D	WEIGHT (NET LBS.)	SUPPLY CFM	TYPE	GAS LINE (IN.)	LIQUID LINE (IN.)	FEEDER (CU. 75 C)
MSI-1	MITSUBISHI - MSY-GX18NL	IT CLOSET	13-1/2 x 43-5/16 x 10-1/8	37	400	R-454B	3/8	1/4	240 1 POWER FROM OUTDOOR UNIT "MSO-1"

***NOTE: PROVIDE CONDENSATION PUMP FOR INDOOR UNIT

EXHAUST FAN SCHEDULE														
GENERAL INFORMATION			FAN INFORMATION			ELECTRICAL INFORMATION					MISCELLANEOUS INFORMATION			
TAG	MANUFACTURER & MODEL #	LOCATION	EXHAUST CFM	MAKEUP CFM	ESP INCHES	SONES	FAN TYPE	FAN HP	FAN FLA	FAN WATT	UNIT VOLTS	UNIT PHASE	MCA	MOCP
EF-1	GREENHECK - SP-A110-QD	100 - LOBBY RR	75	N/A	0.25	1.5	CENTRIFUGAL	N/A	N/A	19 W	120	1	N/A	N/A
EF-2	GREENHECK - SP-A110-QD	110A - INTAKE 1 RR	75	N/A	0.25	1.5	CENTRIFUGAL	N/A	N/A	19 W	120	1	N/A	N/A
EF-3	GREENHECK - SP-A110-QD	103A - INTAKE 2 RR	75	N/A	0.25	1.5	CENTRIFUGAL	N/A	N/A	19 W	120	1	N/A	N/A
EF-4	GREENHECK - SP-A110-QD	117A - DAYROOM RR	75	N/A	0.25	1.5	CENTRIFUGAL	N/A	N/A	19 W	120	1	N/A	N/A
EF-5	GREENHECK - SP-A110-QD	107A - LOBBY RR	75	N/A	0.25	1.5	CENTRIFUGAL	N/A	N/A	19 W	120	1	N/A	N/A
EF-6	GREENHECK - SP-A110-QD	131 - STAFF UNISEX RR	75	N/A	0.25	1.5	CENTRIFUGAL	N/A	N/A	19 W	120	1	N/A	N/A
EF-7	GREENHECK - SP-A110-QD	130 - STAFF UNISEX RR	75	N/A	0.25	1.5	CENTRIFUGAL	N/A	N/A	19 W	120	1	N/A	N/A

KEYED NOTES FOR EXHAUST FAN UNITS: APPLIED FOR ALL EXHAUST FAN UNITS ABOVE
1. 6" EXHAUST DUCT CONNECTION
2. FAN SHALL BE SWITCHED WITH RESTROOM LIGHTING
3. EQUIVALENT SELECTED BY BUILDING OWNER

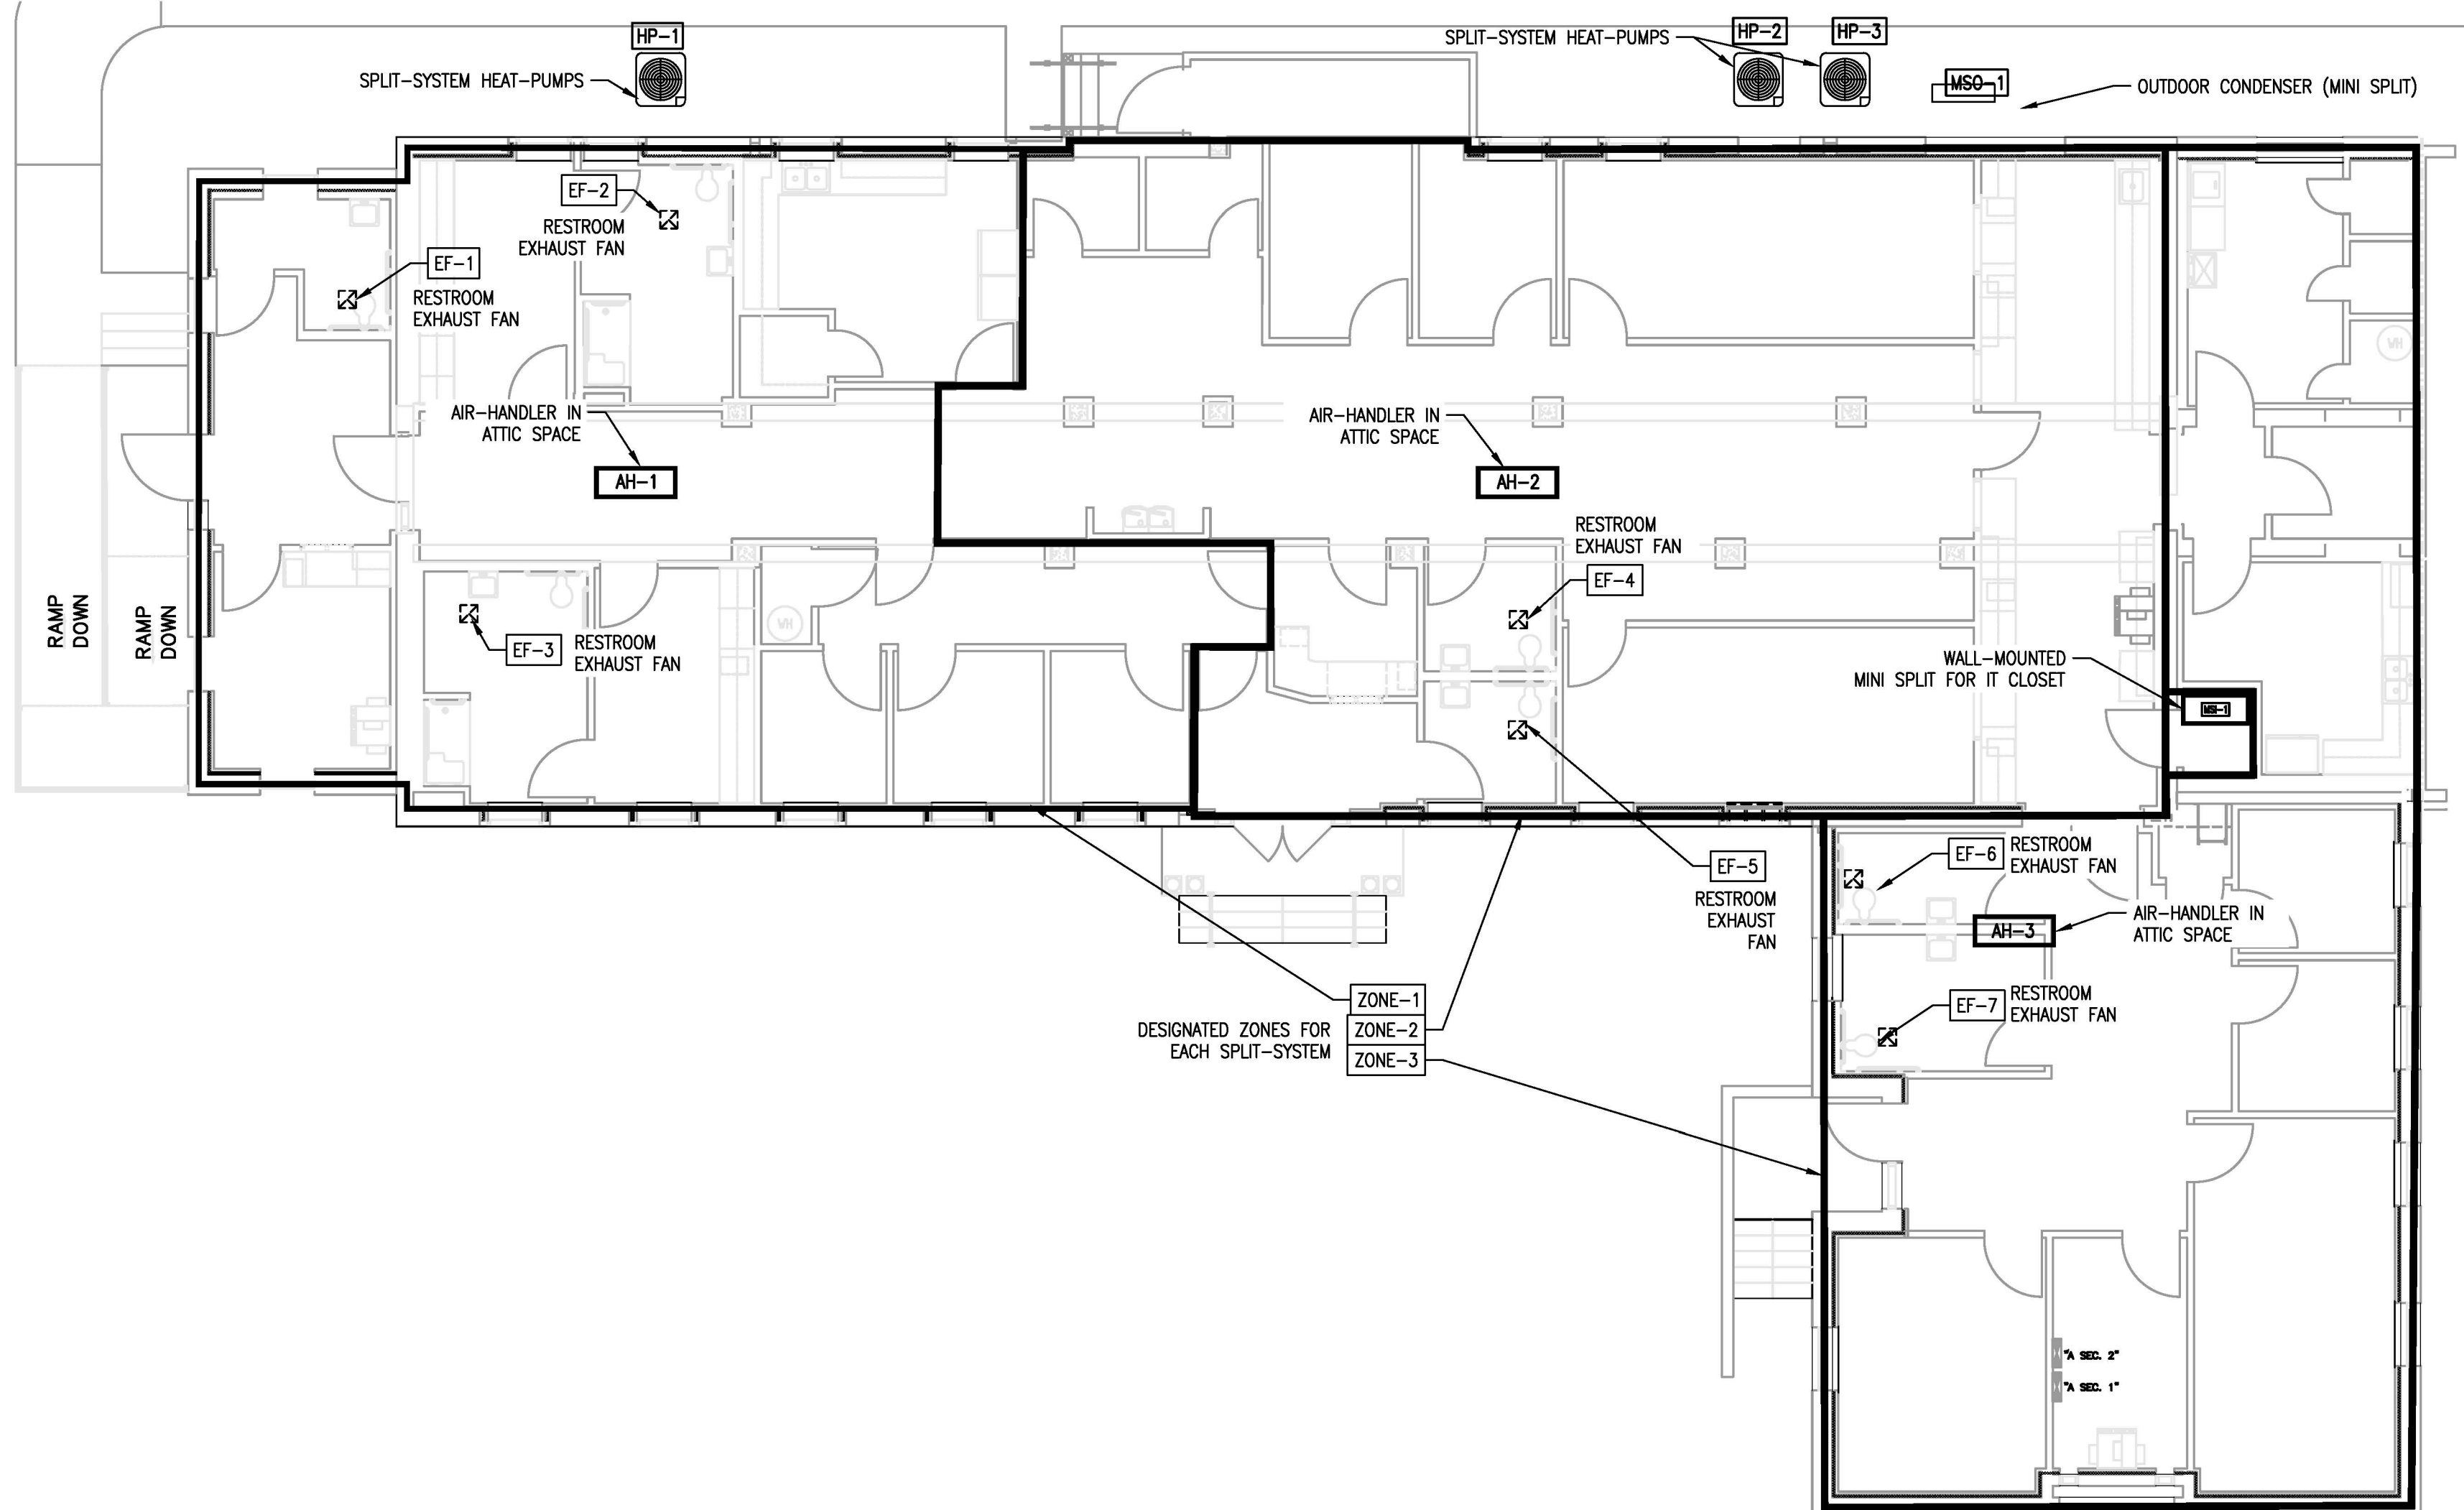

1 M1 HVAC PLAN - SCOPE OF WORK

MECHANICAL SCOPE OF WORK

THIS MECHANICAL SCOPE OF WORK INCLUDES THE INSTALLATION OF-

- THREE (3) NEW 4-TON HEAT PUMP (HP) SPLIT-SYSTEMS
- CONCRETE EQUIPMENT PADS FOR OUTDOOR HP UNITS
- SUPPORT FRAMING & VIBRATION ISOLATORS FOR ATTIC AIR HANDLER (AH) UNITS
- SECONDARY DRAIN PANS & FLOAT SWITCHES FOR AH CONDENSATE
- INSULATED HVAC DUCTWORK W/ SUPPORTS & NOISE/VIBRATION CONTROL FOR SUPPLY AND RETURN AIR DISTRIBUTION

NOTE: DUCTWORK WILL PENETRATE HOLLOW TILE ATTIC FLOOR. THE STRUCTURAL INTEGRITY OF THE EXISTING FLOORS MUST BE MAINTAINED. ALL TRADES SHALL INSPECT EXISTING FIELD CONDITIONS, REVIEW AS-BUILT & STRUCTURAL DOCUMENTATION IN THIS PLAN SET, & COORDINATE LOCATION/ROUTING OF ROUGH-INS PRIOR TO SAWCUTTING DUCT PENETRATIONS IN THE EXISTING CONSTRUCTION.

- VOLUME/CONTROL/BALANCING/FIRE DAMPERS, SUPPLY DIFFUSERS, & RETURN GRILLES PER LAYOUT.
- PROGRAMMABLE THERMOSTATS & CONTROLS
- RETROFIT/REPAIR & CONDENSATE PIPING
- CONTROLS & ELECTRICAL COORDINATION
- TESTING, ADJUSTING, BALANCING OF HVAC SYSTEM.

DESCRIPTION AND SEQUENCE OF OPERATION OF HVAC SYSTEM

THE HVAC SYSTEM CONSISTS OF:

- EQUIPMENT TO PROVIDE CONSTANT VOLUME HEATING/COOLING/VENTILATION TO ALL SPACES:
- SPLIT SYSTEM UNITS
- (3) 4-TON HEAT PUMP/AIR HANDLER

OCCUPIED OPERATION

- THE SUPPLY FANS SHALL RUN CONTINUOUSLY TO PROVIDE THE REQUIRED VENTILATION RATE.
- SEE VENTILATION CALCULATIONS ON SHEET M3.
- IN COOLING MODE, A RISE IN TEMPERATURE BEYOND SET POINT OF PROGRAMMABLE T-STAT WILL RESULT IN ACTIVATION OF DX COOLING CYCLE UNTIL DESIRED TEMPERATURE IS REACHED.
- IN HEATING MODE, A SIGNAL FROM T-STAT WILL ACTIVATE GAS HEATING UNTIL DESIRED TEMPERATURE IS REACHED.

UNOCCUPIED OPERATION

- THE SUPPLY FAN SHALL BE INDEXED OFF AND GRAVITY OR MOTORIZED OUTSIDE AIR DAMPER SHALL BE CLOSED.
- PROGRAMMABLE THERMOSTATS AND REMOTE SENSORS SHALL PROVIDE CONTROL OF EACH UNIT.

EXHAUST FAN OPERATION

- THE RESTROOM EXHAUST FANS SHALL BE SWITCHED WITH LIGHTING FOR TOILETS.

APPENDIX B MECHANICAL DESIGN SUMMARY

PROJECT NAME: GOOD HOPE

MECHANICAL SYSTEMS, SERVICE SYSTEMS AND EQUIPMENT

METHOD OF COMPLIANCE: ☒ PRESCRIPTIVE ☐ ENERGY COST BUDGET

MECHANICAL SUMMARY

MECHANICAL SYSTEMS, SERVICE SYSTEMS AND EQUIPMENT

THERMAL ZONE: ZONE 4 NORTH CAROLINA

WINTER DRY BULB: 17.0 F

SUMMER DRY BULB: 87.0 F

INTERIOR DESIGN CONDITIONS

WINTER DRY BULB: 65 F

SUMMER DRY BULB: 78 F

RELATIVE HUMIDITY: 50%

BUILDING HEATING LOAD: 298.6 MBH

BUILDING COOLING LOAD: 174.9 MBH

NEW MECHANICAL SPACING CONDITIONING SYSTEM

UNITARY

DESCRIPTION OF UNIT: 4-TON SPLIT SYSTEM

HEATING EFFICIENCY: 8.0 HSPF (8.0 HSPF MINIMUM EFFICIENCY, TABLE C403.2.3 (2))

COOLING EFFICIENCY: 14 SEER (14 SEER MINIMUM EFFICIENCY, TABLE C403.2.3 (2))

SIZE CATEGORY OF UNIT: 5.0 TON (< 65,000 BTU/H)

DESIGNER STATEMENT: TO THE BEST OF MY KNOWLEDGE AND BELIEF, THE DESIGN OF THIS BUILDING COMPLIES WITH THE MECHANICAL SYSTEMS, SERVICE SYSTEMS AND EQUIPMENT REQUIREMENTS OF THE INTERNATIONAL ENERGY CODE. THE HVAC UNIT QUALITIES AS MORE EFFICIENT MECHANICAL EQUIPMENT DESCRIBED IN THE CODE.

SIGNED: *Buddy Jenkins*

NAME: BUDDY JENKINS

TITLE: ENGINEER

MECHANICAL NOTES

ALL WORK SHALL BE IN ACCORDANCE WITH THE NORTH CAROLINA MECHANICAL CODE 2018 EDITION, ASHRAE, SMACNA, AND NFPA.

STRUCTURAL MEMBERS OF THE BUILDING SHALL NOT BE CUT IN ANY MANNER FOR THE INSTALLATION OF ANY EQUIPMENT UNLESS PRIOR APPROVAL IS OBTAINED.

THE MECHANICAL CONTRACTOR IS RESPONSIBLE FOR COORDINATING THE LOCATIONS AND ROUTING OF ALL DUCTWORK, PIPING, AND EQUIPMENT WITH OTHER TRADES TO AVOID CONFLICT.

THE MECHANICAL CONTRACTOR SHALL MAKE A COMPLETE REVIEW OF THE MECHANICAL PLANS, SCHEDULES, AND DETAILS PRIOR TO INSTALLATION OF THE MECHANICAL SYSTEMS AND REVIEW ANY CONFLICTS WITH THE GENERAL CONTRACTOR.

THE MECHANICAL CONTRACTOR SHALL COORDINATE WITH OTHER TRADES INVOLVED IN THIS PROJECT PRIOR TO INSTALLATION OF HIS EQUIPMENT, SO AS TO AVOID CONFLICTS DURING CONSTRUCTION AND ALLOW FOR OPTIMUM WORKING SPACE AND MAINTENANCE. THINK OF OTHER CONTRACTORS AND THEIR REQUIREMENTS IN VERTICAL CHASES AND WALL MOUNT SPACE.

ALL CONTRACTORS TO FOLLOW THIS ORDER OF PRIORITY:

- STORM AND SANITARY SEWER LINES
- DUCTWORK AND HVAC SYSTEMS
- HOT AND COLD WATER LINES
- RIGID CONDUIT
- CABLE

THE MECHANICAL CONTRACTOR SHALL COORDINATE SIZE AND LOCATION OF ALL PENETRATIONS (PERTAINING TO HIS WORK) THROUGH THE ROOF, WALLS, FLOORS WITH THE GENERAL CONTRACTOR. ANY WATERPROOFING AROUND THE OPENINGS TO BE COMPLETED BY THE GENERAL CONTRACTOR.

THE MECHANICAL CONTRACTOR SHALL PROVIDE AND INSTALL HIS OWN SUPPORT DEVICES. ALL LOCATIONS SHALL BE COORDINATED WITH THE GENERAL CONTRACTOR AND OTHER SUBCONTRACTORS PRIOR TO INSTALLATION. ALL PLATFORMS AND WALKWAYS IN 2ND FLOOR SPACES ARE PROVIDED BY THE GENERAL CONTRACTOR. THE MECHANICAL CONTRACTOR TO COORDINATE THE LOCATION AND DIMENSIONS OF ALL PLATFORMS IN THE 2ND FLOOR WITH THE GENERAL CONTRACTOR.

ALL EQUIPMENT HAVING ROTATING OR MOVING PARTS SHALL HAVE VIBRATION ISOLATORS TO ELIMINATE TRANSMISSION OF OBJECTIONABLE NOISE TO OTHER MATERIAL OR EQUIPMENT.

WHERE OUTSIDE AIR INTAKE DUCTWORK CONNECTS TO OUTSIDE AIR LOUVER, THE INSIDE FACE OF THE DUCTWORK SHALL BE PRIMED AND PAINTED WITH (2) COATS OF FLAT BLACK TO PREVENT DUCTWORK FROM BEING VISIBLE.

THE MECHANICAL CONTRACTOR SHALL PROVIDE NAMEPLATES FOR IDENTIFICATION OF ALL EQUIPMENT. THE NAMEPLATES SHALL BE LAMINATED PHENOLIC PLASTIC, BLACK FRONT AND BACK WITH WHITE CORE, WHITE ENGRAVED LETTERS (1/4" MINIMUM) ETCHED INTO THE WHITE CORE. NAME TAGS TO BE MOUNTED WITH SELF-TAPPING SHEET METAL SCREWS.

ALL EQUIPMENT MATERIALS AND WORKMANSHIP SHALL BE GUARANTEED TO BE FREE OF DEFECTS FOR A PERIOD OF ONE YEAR AFTER FINAL ACCEPTANCE OF THE WORK OR IN ACCORDANCE WITH THE PARTICULAR MANUFACTURER'S STANDARD GUARANTEE IF LONGER. ANY FAULTY MATERIAL OR WORKMANSHIP OR FAILURE OF ANY PART OF THE SYSTEM DURING NORMAL OPERATIONS UNDER THIS GUARANTEE SHALL BE CORRECTED WITHOUT COST TO THE OWNER.

THE MECHANICAL CONTRACTOR SHALL CLEAN ALL OF HIS EQUIPMENT PRIOR TO FINAL CLOSE OUT OF THIS PROJECT TO BE FREE OF ANY DIRT OR DEBRIS IN DRAIN PANS, CONDENSATE DRAINS, CONDENSING UNIT COILS, AND ETC.

ALL EQUIPMENT SHALL BE LOCATED AND INSTALLED TO PROVIDE MAXIMUM SPACE FOR MAINTENANCE AND SERVICE.

PROVIDE EQUIPMENT SUPPORT PAD FOR ALL BASE MOUNTED EQUIPMENT. PAD SHALL BE 4" HIGH OR PREFABRICATED CONCRETE PAD FOR ALL CONDENSING UNITS, AND PACKAGE UNITS, 4" MINIMUM FROM EQUIPMENT EDGE TO END OF PAD ON ALL SIDES.

THE MECHANICAL CONTRACTOR SHALL CONFIRM ALL BREAKER AND DISCONNECT SIZES OF HIS EQUIPMENT WITH THE ELECTRICAL CONTRACTOR PRIOR TO ORDERING ANY EQUIPMENT FOR THIS PROJECT.

CONDENSATE DRAINS SHALL BE A MINIMUM OF 3/4" Ø PVC PIPE. A P-TRAP SHALL BE INSTALLED IN PIPE AT THE UNIT. ALL CONDENSATE LINES SHALL BE SLOPED AS INDICATED ON PLANS.

SEE SHEET P2.2 FOR HVAC CONDENSATE PIPING LAYOUT.

INSTALL FLEXIBLE DUCT CONNECTION AT SUPPLY AND RETURN DUCTWORK CONNECTIONS TO ALL AIR HANDLING UNITS, FAN BOXES, ETC.

DESIGN CRITERIA NOTES:

ALL SUPPLY, RETURN, EXHAUST AND OUTDOOR AIR DUCTWORK (WITH THE EXCEPTION OF COMMERCIAL KITCHEN DUCTWORK) SHALL BE SIZED AT 0.08" PER 100'-0" OF DUCT FOR EXTERNAL STATIC PRESSURE. ALL DUCTWORK SHALL BE 1" WG PRESSURE CLASS.

ECONOMIZERS ARE REQUIRED FOR ANY HVAC SYSTEM WITH A COOLING CAPACITY OF 65,000 BTU/HR OR GREATER (NCECC 503.3.1)

CORRIDORS SHALL NOT SERVE AS SUPPLY, RETURN, EXHAUST, RELIEF OR VENTILATION AIR DUCTS. CORRIDORS MAYBE BE USED FOR MAKEUP AIR PROVIDED TO TOILET AREAS FOR EXHAUST MAKEUP PROVIDING THE CORRIDOR IS PROVIDED WITH AN OUTSIDE AIR RATE GREATER THAN THE MAKEUP REQUIRED FOR EXHAUST. (NCMC 601.2)

HVAC SYSTEM SHALL HAVE PROGRAMMABLE THERMOSTAT CAPABLE OF OFF HOUR CONTROLS (NIGHT SETBACK) TO MAINTAIN NO MORE THAN 85°F OR NO LESS THAN 55°F (NCECC 503.2.4.3, 503.2.4.3.1 & 503.2.4.3.2)

THE MECHANICAL CONTRACTOR SHALL PROVIDE AND INSTALL A DUCT MOUNTED SMOKE DETECTOR IN THE RETURN AIR DUCT AT EACH UNIT IN ACCORDANCE WITH NORTH CAROLINA BUILDING CODE EDITION 2018. THE MECHANICAL CONTRACTOR TO WIRE FROM THE DETECTOR TO EACH UNIT.

DUCTWORK NOTES:

ALL DUCTWORK, PIPING, EQUIPMENT, ETC. SHALL BE SUPPORTED FROM THE BUILDING SUPPORT STRUCTURE AND NOT THE ROOF.

ALL DUCT LAYOUT AND LOCATIONS ARE SHOWN DIAGRAMMATIC. THE MECHANICAL CONTRACTOR SHALL VISIT THE SITE AND FAMILIARIZE HIMSELF WITH THE BUILDING CONDITIONS AND COORDINATE THE DUCT LAYOUT WITH ALL CONTRACTORS PRIOR TO INSTALLATION.

ALL DUCTWORK SHALL BE CONSTRUCTED OF SHEET METAL IN ACCORDANCE WITH ASHRAE & SMACNA. DUCT SIZES SHOWN ARE NET FREE AREA REQUIRED.

VOLUME OR SPLITTER DAMPERS SHALL BE INSTALLED WHERE NECESSARY TO GUIDE AND CONTROL THE AIR FLOW. TURNING VANES ARE REQUIRED IN ALL ELBOWS AND AIR DEFLECTION DEVICES WILL BE INSTALLED WHERE REQUIRED FOR A BALANCED SYSTEM. PROVIDE SHEET METAL SLEEVES AND COLLARS WHERE DUCTS PASS THRU WALLS.

ALL DUCTS SHALL BE AIR TIGHT, RIGID AND FREE FROM VIBRATION AND NOISE. ALL LAP JOINTS SHALL BE IN THE DIRECTION OF FLOW AND SEALED WITH DUCT SEALER. (NCMC (603.9) & NCECC (503.2.7))

FLEXIBLE DUCT RUNS SHALL NOT EXCEED 12'-0" IN LENGTH. FLEXIBLE DUCT SHALL BE SUPPORTED EVERY 5'-0". MAXIMUM SAG IS A 1/2" INCH PER FOOT OF SPACING BETWEEN SUPPORTS. SADDLE MATERIAL IN CONTACT WITH THE FLEXIBLE DUCT SHALL BE WIDE ENOUGH SO THAT IT DOES NOT REDUCE THE INTERNAL DIAMETER OF THE DUCT. THE SADDLE MUST COVER ONE-HALF THE CIRCUMFERENCE OF THE OUTSIDE DIAMETER OF THE FLEXIBLE DUCT AND FIT NEATLY AROUND THE LOWER HALF OF THE DUCT'S OUTER CIRCUMFERENCE.

PROVIDE PERMANENT MANUAL DAMPERS IN ALL SUPPLY AND RETURN AIR DUCTS AT THE MAIN TRUNK LINE FOR SYSTEM BALANCING. THE MECHANICAL CONTRACTOR IS RESPONSIBLE FOR BALANCING THE AIR DISTRIBUTION SYSTEM AFTER THE SYSTEM HAS BEEN INSTALLED AND EQUIPMENT IS OPERATING. MANUAL DAMPERS ARE REQUIRED TO BE INSTALLED IN THE RETURN AIR DUCT IF THE DUCT IS RETURNING AIR FROM INDIVIDUAL ROOMS. MANUAL DAMPERS ARE NOT REQUIRED IF THE DUCT IS RETURNING AIR FROM CENTRALLY LOCATED FILTER/RETURN GRILLES.

THE OUTSIDE AIR INTAKE DUCTWORK SHALL BE HARD ROUND DUCT, FLEXIBLE DUCT WILL NOT BE ACCEPTED. SEE PLAN FOR DUCT SIZE.

ALL OUTSIDE AIR INTAKE DUCTS SHALL HAVE A FILTER BOX TO HOUSE A MINIMUM OF 16 IN. X 20 IN. X 2 IN. THICK FILTER. U.N.O. AT EACH AIR HANDLING UNIT EITHER IN THE 2ND FLOOR OR CRAWL SPACE. THE FILTER BOX SHALL HAVE A HINGED DOOR THAT IS GASKETED TO MAINTAIN A AIRTIGHT SEAL WITH A THUMBSCREW TO ACCESS THE FILTER.

THE OUTSIDE AIR FILTER SHALL BE THE H-E 40 AS MANUFACTURED BY PURALATOR PRODUCTS AIR FILTRATION COMPANY, OR APPROVED EQUAL. AIR FILTER SHALL BE (2) TWO INCHES DEEP, MEDIUM EFFICIENCY, PLEATED MEDIA, DISPOSABLE PANEL TYPE. THE FILTER MEDIA SHALL BE SELF-EXTINGUISHING NON-WOVEN COTTON AND SYNTHETIC FIBERS. THE FILTER MEDIA SHALL BE BONDED TO A 28-GAUGE CORROSION RESISTANT, ALUMINUM SUPPORT GRID WITH A 95% OPEN FACE AREA.

THE MECHANICAL CONTRACTOR SHALL PROVIDE THREE (3) SETS OF FILTERS FOR EACH NEW AIR DISTRIBUTION UNIT:

- 1ST SET FOR INITIAL INSTALLATION OF EQUIPMENT & DUCTWORK ROUGH-IN
- 2ND SET FOR TEST & BALANCING
- 3RD SET FOR THE CLIENT/OWNER AFTER FINAL INSPECTION

DUCT/PIPING INSULATION NOTES:

PER 2018 NC ENERGY CONSERVATION CODE C403.2.9-

SUPPLY AND RETURN AIR DUCTS AND PLENUMS SHALL BE INSULATED WITH A MINIMUM OF R-6 INSULATION WHERE LOCATED IN UNCONDITIONED SPACES INSIDE THE BUILDING.

WHERE LOCATED OUTDOORS, SUPPLY AND RETURN DUCTS SHALL BE INSULATED WITH A MINIMUM OF R-8 INSULATION.

WHERE LOCATED WITHIN A BUILDING ENVELOPE ASSEMBLY, SUCH AS A WALL OF THE BUILDING THERMAL ENVELOPE, THE DUCT OR PLENUM SHALL BE SEPARATED FROM THE BUILDING EXTERIOR OR UNCONDITIONED SPACE BY A MINIMUM OF R-6.

EXCEPTION: WHERE LOCATED WITHIN EQUIPMENT, DUCTS, AIR HANDLERS AND FILTER BOXES SHALL BE SEALED. JOINTS AND SEAMS SHALL COMPLY WITH SECTION 603.9 OF THE INTERNATIONAL MECHANICAL CODE.

ACCEPTABLE MANUFACTURER(S) ARE:

JOHNSON MANVILLE.

LIQUID AND SUCTION PIPING TO AND FROM AIR HANDLING UNITS SHALL BE INSULATED WITH 1-1/2" THICK PIPE INSULATION IN ACCORDANCE WITH TABLE 503.2.8 OF THE NC ENERGY CODE 2018 EDITION.

ALL FLEXIBLE DUCT REQUIRING INSULATION SHALL HAVE A VALUE OF AT LEAST R-6.0. THE FLEXIBLE DUCT SHALL BE ATCO RUBBER PRODUCTS, INC. UPC NO. 036 OR APPROVED EQUAL WITH A REINFORCED METALLIZED POLYESTER JACKET. THE INNER CORE IS ARTIFICIAL AND IS DESIGNED FOR LOW TO MEDIUM OPERATING PRESSURES IN HVAC SYSTEMS. AIR DUCT CONNECTIONS AND JOINTS SHALL BE MADE PER INSTALLATION INSTRUCTIONS OUTLINED BY ATCO.

OUTSIDE AIR INTAKE DUCTWORK AND EXHAUST DUCTWORK IS TO BE UNINSULATED.

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

DESIGNED/CHECKED BY: *Buddy Jenkins*

DRAWN BY: TSAN GO, B.T.C., J.D.

PROJECT #: 2025-01-16

DATE: 25 JULY 2025

FINAL DRAWING ☐ FOR REVIEW PURPOSES ONLY

PRELIMINARY ☐ FOR DESIGN DEVELOPMENT

FINAL DRAWING ☒ FOR CONSTRUCTION

OWNER/TENANT: GOOD HOPE HOSPITAL

410 DENIM DRIVE, ERWIN, NC 28339

CONTRACTOR/BUILDER: SITE GENERAL CONTRACTORS LLC.

150 TOWNHALL DRIVE, DOWNS, NC 28324

PROJECT: GOOD HOPE BEHAVIORAL HOSPITAL RENOVATION

410 DENIM DRIVE, ERWIN, NC 28339


SHEET: MECHANICAL SUMMARY AND EQUIPMENT SCHEDULES

M1



M2







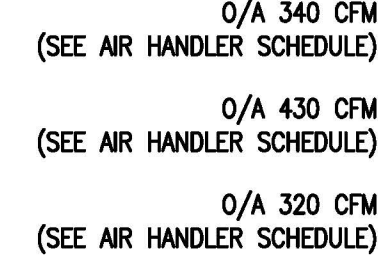


ROOM NUMBER	ROOM NAME	OCCUPANCY CLASSIFICATION	NET SQUARE FOOTAGE (A ₂)	CEILING HEIGHT IN FEET (CgHt)	VOLUME (CF) A/CtHght	SUPPLY AIR (CFM)	AIR CHANGES PER HOUR (ACH ₅)	OCCUPANCY DENSITY PER 1000 NET SQ. FT.	OCCUPANTS (P ₂)	OUTSIDE AIR CFM PER PERSON (R _p)	OUTSIDE AIR CFM PER SQ. FT. (R _a)	(R _p P ₂)	(R _a A ₂)	G.A. CFM REQUIRED (Zone) R _p P ₂ + R _a A ₂	ZONE O.A. AIR FLOW (E ₂)	ADJUSTED O.A. Vol = Vbz/E ₂	EXHAUST CFM REQUIRED
100	LOBBY RR	LOBBIES/PREFUNCTION	59	8.5	501.5	100	11.96	30	2	7.5	0.06	13.28	3.54	16.82	0.8	21.02	
101	WAITING AREA	LOBBIES/PREFUNCTION	139	8.5	1181.5	100	5.08	30	4	7.5	0.06	31.28	8.34	39.62	0.8	49.52	
102	FRONT DESK	RECEPTION AREAS	127	8.5	1079.5	100	5.56	30	4	5.0	0.06	19.05	7.62	26.67	0.8	33.34	
103	INTAKE 2 OFFICE	OFFICE SPACES	79	8.5	671.5	100	8.94	5	0	5.0	0.06	1.98	4.74	6.72	0.8	8.39	
103A	INTAKE 2 RR	RESTROOM—PUBLIC	79	8.5	671.5	100	8.94	0	0	0.0	0	0.00	0.00	0.00	0.8	0.00	70 PER FLUSHING FIXTURE
104	OFFICE CLINICAL	OFFICE SPACES	79	8.5	671.5	100	8.94	5	0	5.0	0.06	1.98	4.74	6.72	0.8	8.39	
105	OFFICE CLINICAL	OFFICE SPACES	79	8.5	671.5	100	8.94	5	0	5.0	0.06	1.98	4.74	6.72	0.8	8.39	
106	OFFICE CLINICAL	OFFICE SPACES	79	8.5	671.5	100	8.94	5	0	5.0	0.06	1.98	4.74	6.72	0.8	8.39	
109	HALLWAY	CORRIDOR	63	8.5	535.5	100	11.20	0	0	0.0	0.06	0.00	3.78	3.78	0.8	4.73	
110	INTAKE 1	OFFICE SPACES	260	8.5	2210	100	2.71	5	1	5.0	0.06	6.50	15.60	22.10	0.8	27.63	
110A	INTAKE 1 RR	RESTROOM—PUBLIC	125	8.5	1062.5	100	5.65	0	0	0.0	0	0.00	0.00	0.00	0.8	0.00	70 PER FLUSHING FIXTURE
111	WARMING KITCHEN	KITCHENS (COOKING)	168	8.5	1428	1000	42.02	0	0	0.0	0.00	0.00	0.00	0.00	0.8	0.00	1 PER SQ. FT.
117(1)	DAYROOM	DAY ROOM	558	8.5	4743	100	1.27	30	17	5.0	0.06	83.70	33.48	117.18	0.8	146.48	
TOTALS						2200			29					OUTSIDE AIR SUB-TOTAL (A)		316.28	EXHAUST AIR SUB-TOTAL (B)
													TOTAL OUTSIDE AIR CFM REQUIRED — USE LARGEST (A OR B) VALUE			316.28	
													TOTAL OUTSIDE AIR CFM PROVIDED			320	

ROOM NUMBER	ROOM NAME	OCCUPANCY CLASSIFICATION	NET SQUARE FOOTAGE (A ₂)	CEILING HEIGHT IN FEET (CgHt)	VOLUME (CF) A ₂ ×CgHt	SUPPLY AIR (CFM)	AIR CHANGES PER HOUR (ACH/5)	OCCUPANCY DENSITY PER 1000 NET SQ. FT.	OCCUPANTS (P ₂)	OUTSIDE AIR CFM PER PERSON (R _p)	OUTSIDE AIR CFM PER SQ. FT. (R _a)	(R _p P ₂)	(R _a A ₂)	O.A. CFM REQUIRED (N ₂) Ra×A ₂	ZONE O.A. AIR FLOW (E ₂) ^a	ADJUSTED O.A. Vol = V ₂ /E ₂	EXHAUST CFM REQUIRED
107	LOBBY (M-F)	LOBBIES/PREFUNCTION	71	8.5	603.5	100	9.94	30	2	7.5	0.06	15.98	4.26	20.24	0.8	25.29	
108	LOBBY RR	LOBBIES/PREFUNCTION	59	8.5	501.5	100	11.96	30	2	7.5	0.06	13.28	3.54	16.82	0.8	21.02	
109	FRONT DESK	LOBBIES/PREFUNCTION	139	8.5	1181.5	100	5.08	30	4	7.5	0.06	31.28	8.34	39.62	0.8	49.52	
112	TELEHEALTH OFFICE 1	RECEPTION AREAS	127	8.5	1079.5	100	5.56	30	4	5.0	0.06	19.05	7.82	26.67	0.8	33.34	
113	TELEHEALTH OFFICE 2	OFFICE SPACES	79	8.5	671.5	100	8.94	5	0	5.0	0.06	1.98	4.74	6.72	0.8	8.39	
114	KID PRIVATE ROOM 1	RESTROOM—PUBLIC	79	8.5	671.5	100	8.94	0	0	0.0	0	0.00	0.00	0.00	0.8	0.00	70
115	KID PRIVATE ROOM 2	OFFICE SPACES	79	8.5	671.5	100	8.94	5	0	5.0	0.06	1.98	4.74	6.72	0.8	8.39	PER FLUSHING FIXTURE
116	CHAIR ROOM 1	OFFICE SPACES	79	8.5	671.5	100	8.94	5	0	5.0	0.06	1.98	4.74	6.72	0.8	8.39	
117(2)	DAYROOM	OFFICE SPACES	79	8.5	671.5	100	8.94	5	0	5.0	0.06	1.98	4.74	6.72	0.8	8.39	
117A	DAYROOM RR	LOBBIES/PREFUNCTION	71	8.5	603.5	100	9.94	30	2	7.5	0.06	15.98	4.26	20.24	0.8	25.29	
118	CHAIR ROOM 2	CORRIDOR	63	8.5	535.5	100	11.20	0	0	0.0	0.06	0.00	3.78	3.78	0.8	4.73	
119	NURSE STATION	SCIENCE LABS	430	8.5	3655	100	1.64	25	11	10.0	0.18	107.50	77.40	184.90	0.8	231.13	
TOTALS						1000			13					OUTSIDE AIR SUB-TOTAL (A)		423.89	EXHAUST AIR SUB-TOTAL (B)
														TOTAL OUTSIDE AIR CFM REQUIRED — USE LARGEST (A OR B) VALUE		423.89	
														TOTAL OUTSIDE AIR CFM PROVIDED		430	

ROOM NUMBER	ROOM NAME	OCCUPANCY CLASSIFICATION	NET SQUARE FOOTAGE (A _z)	Ceiling Height in Feet (CgHt)	VOLUME (CF) A _c Hgt	SUPPLY AIR (CFM)	AIR CHANGES PER HOUR (ACH) ₅	OCCUPANCY DENSITY PER 1000 NET SQ. FT.	OCCUPANTS (P _z)	OUTSIDE AIR CFM PER PERSON (R _p)	OUTSIDE AIR CFM PER SQ. FT. (R _a)	(Rp/Pz)	(Rate)	G.A. CFM REQUIRED (Voz = R _p P _z + R _a Z)	ZONE O.A. AIR FLOW (E _z)	ADJUSTED O.A. Voz = Vbz/Ez	EXHAUST CFM REQUIRED
120	LAUNDRY	COMMERCIAL LAUNDRY	139	8.5	1181.5	100	5.08	0	1	25.0	0	34.75	0.00	34.75	0.8	43.44	
121	STORAGE	STORAGE ROOM	69	8.5	579	100	10.38	0	0	0.0	0.12	0.00	8.16	8.16	0.8	10.20	
122	BREAKROOM	KITCHENS (PRIVATE)	154	8.5	1309	100	4.58	0	0	0.0	0	0.00	0.00	0.00	0.8	0.00	100
123	HALL	CORRIDOR	44	8.5	374	100	16.04	0	0	0.0	0.06	0.00	2.64	2.64	0.8	3.30	
124	OFFICE	OFFICE SPACES	95	8.5	807.5	100	7.43	5	0	5.0	0.06	2.38	5.70	8.08	0.8	10.09	
125	OFFICE	OFFICE SPACES	93	8.5	790.5	100	7.59	5	0	5.0	0.06	2.33	5.58	7.91	0.8	9.88	
126	CONFERENCE ROOM	CONFERENCE/MEETING	289	8.5	2456.5	100	2.44	50	14	5.0	0.06	72.25	17.34	89.59	0.8	111.99	
127	WORK ROOM	KITCHENS (PRIVATE)	70	8.5	595	100	10.08	0	0	0.0	0	0.00	0.00	0.00	0.8	0.00	100
128	OFFICE	OFFICE SPACES	213	8.5	1810.5	101	3.35	5	1	5.0	0.06	5.33	12.78	18.11	1.8	10.06	
129	HALLWAY	CORRIDOR	354	8.5	3009	102	2.03	0	0	0.0	0.06	0.00	21.24	21.24	2.8	7.59	
130	UNISEX RR	RESTROOM-PRIVATE	113	8.5	960.5	100	6.25	0	0	0.0	0	0.00	0.00	0.00	0.8	0.00	70
131	STAFF UNISEX RR	RESTROOM-PRIVATE	83	8.5	705.5	103	8.76	0	0	0.0	0	0.00	0.00	0.00	3.8	0.00	70
TOTALS						1500			26								
														OUTSIDE AIR SUB-TOTAL (A)		206.54	EXHAUST AIR SUB-TOTAL (B)
														TOTAL OUTSIDE AIR CFM REQUIRED - USE LARGEST (A OR B) VALUE			340
														TOTAL OUTSIDE AIR CFM PROVIDED			340


M4

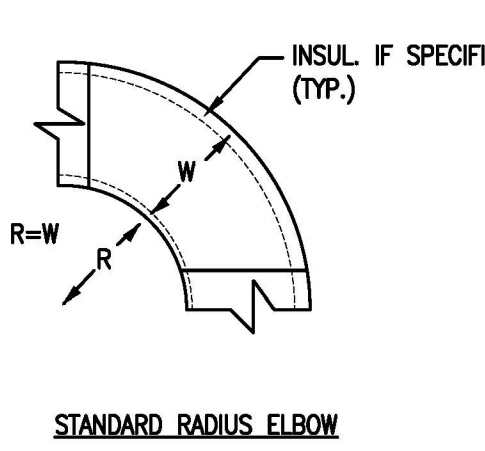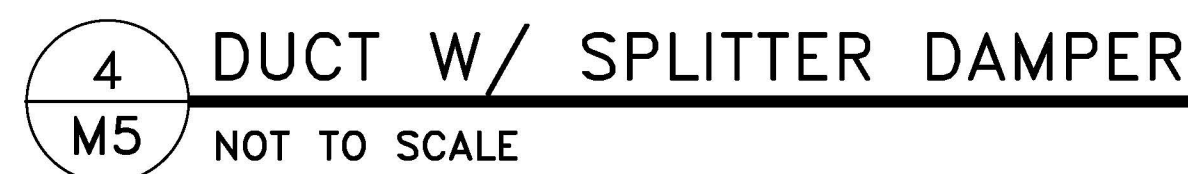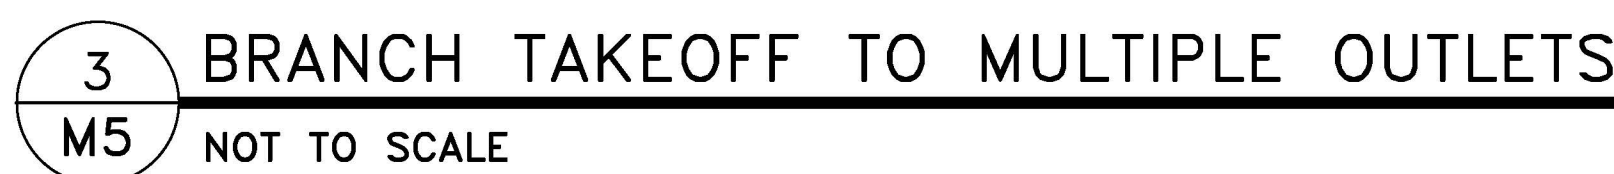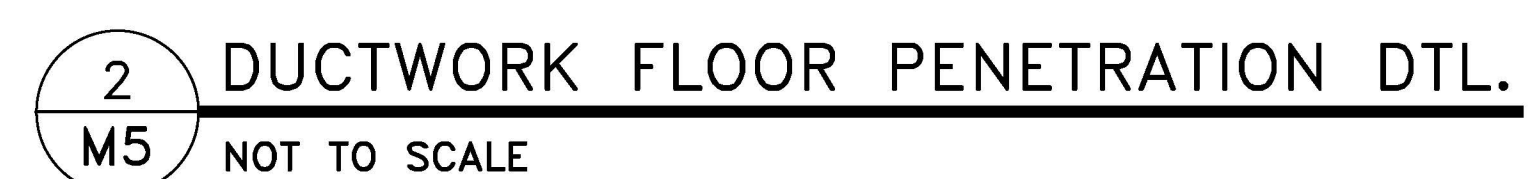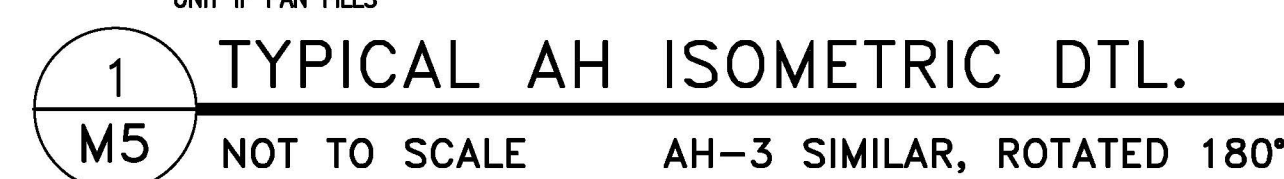


NOTE: ALL 90° TURNS IN SUPPLY & RETURN DUCTWORK SHALL BE STND. LONG RADIUS. USE SHORT RADIUS WITH VANES OR SQUARE WITH VANES AS SHOWN ONLY WITH APPROVAL OF ENGINEER



THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

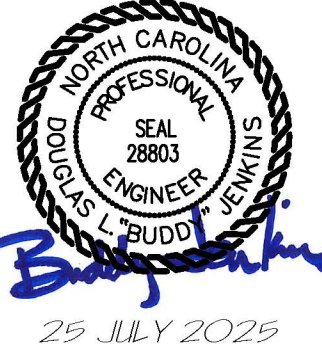

	DESIGNED/CHECKED BY:	TS, SANGHVI, TS, JCDL
	DRAWN BY:	
FINAL DRAWING [] FOR REVIEW PURPOSES ONLY PRELIMINARY [] FOR DESIGN DEVELOPMENT ONLY FINAL DRAWING [] FOR CONSTRUCTION	OWNER/TENANT:	GOOD HOPE HOSPITAL 410 E MAIN ST, WELLS, NC 28389
	CONTRACTOR/BUILDER:	SITE GENERAL CONTRACTORS LLC.
DATE:	PROJECT #:	2025-01-16
DATE:		25 JULY 2025

PROJECT: **GOOD HOPE BEHAVIORAL HOSPITAL RENOVATION**

410 DENIM DRIVE, ERWIN, NC 28339

MECHANICAL DETAILS

M5

ELECTRICAL NOTES:
ALL WORK SHALL BE IN ACCORDANCE WITH 2020 NEC.

WIRE AND CABLE SHALL BE INSULATED, TYPE THHN, 600 VOLTS, WITH COPPER CONDUCTORS. CONDUCTOR SIZES NO. 8 AWG AND LARGER MAY BE STRANDED. CONDUCTOR SIZES NO. 10 AWG AND SMALLER MAY BE SOLID OR STRANDED.

ROMEX CAN NOT BE USED IN THIS PROJECT. MC CAN BE USED.

ELECTRIC SHALL BE GALVANNEZED STEEL, TURNING 1/2-INCH MINIMUM SIZE, EQUAL TO FLOUTINITE BRAND OR APPROVED AND USED ONLY WITH HEXAGONAL ALL STEEL COMPRESSION FITTINGS. MC CABLE MAY BE SUBSTITUTED FOR CONDUIT, WEATHER DATA HERE, PERMITTED BY THE CODES AND APPROVED BY OWNER.

PLASTIC CONDUIT SHALL BE RHD, 3/4-INCH MINIMUM NOMINAL, HEAVY DUTY. CONDUIT SHALL BE USED FOR ALL WIRING. ALL CONDUIT SHALL BE EGC. CONDUIT SHALL BE THE SAME MATERIALS AND MANUFACTURER AS THE PLASTIC CONDUIT.

FLEXIBLE METAL CONDUIT SHALL BE 1/2-INCH MINIMUM SINGLE STRIP, STEEL. FLEXIBLE METAL CONDUIT SHALL BE 1/2-INCH MINIMUM LENGTH OF 22 INCHES FOR 1/2-INCH MINIMUM. FLEXIBLE METAL CONDUIT SHALL BE LIQUID TIGHT OR WATER TIGHT WITH PVC JOCKEY. WHERE USED IN DAMP, WET, OR OUTSIDE AREAS, AND LIQUID TIGHT OR WATER TIGHT CONNECTORS SHALL BE USED.

NO RECEPTACLES OR TELEPHONE OUTLETS ARE TO BE MOUNTED BACK TO BACK. KEEP AT LEAST 1/2 INCH CLEARANCE FROM WALLS AND CEILING.

ALL CONDUCTORS SHALL BE COPPER, WITH A MINIMUM SIZE OF #12 AWG EXCEPT FOR FIRE ALARM. THESE CONDUCTORS SHOULD COMPLY WITH NFPA REQUIREMENTS. FEEDERS SHALL BE ALUMINUM WHERE NOTED.

THE ELECTRICAL CONTRACTOR SHALL ASSIGN ALL UNIFORM, SMOKE DETECTORS, CEILING FAN MOTORS, AND ALL OTHERS TO BE INSTALLED. A UNIFORM PRESENTATION, FOLLOW THE REFLECTED CEILING PLAN (R/CP) PROVIDED.


CIRCUIT BREAKERS AND WIRE ARE SIZED FOR SPECIFIC EQUIPMENT. BEFORE ORDERING WIRE, BREAKERS, FIXTURES, CONDUIT, AND ETC. FOR THIS PROJECT, THE ELECTRICAL CONTRACTOR SHALL PROVIDE A LIST OF ALL EQUIPMENT TO BE INSTALLED FOR THE JOB AND VERIFY THE ELECTRICAL DATA FOR THE EQUIPMENT THAT WILL BE ACTUALLY INSTALLED. RECOMPUTE WIRE AND BREAKER SIZES IF REQUIRED BY THE NEC.

THE MOUNTING HEIGHTS AND LOCATIONS OF ALL WALL MOUNTED OUTLETS AND JUNCTION BOXES SHALL BE SHOWN ON THE ELECTRICAL SCHEDULE. THE ELECTRICAL CONTRACTOR AND OWNER PRIOR TO INSTALLATION FOR USE WITH ACTUAL EQUIPMENT.

ALL LIGHT SWITCHES, RECEPTACLES, WALL PLATES, TELEPHONE/COMPUTER OUTLET BOXES, AND CABLE OUTLET BOXES SHALL BE WHITE.

ELECTRICAL CONTRACTOR WILL PROVIDE AN IN-DEPTH REPORT OF ALL DEVICES AND EQUIPMENT TO BE INSTALLED. THIS SHALL ADOPT THE EQUIPMENT PERMITTED BY THE LOCAL GOVERNING CODES. UNACCEPTABLE WORKMANSHIP OR MATERIALS SHALL BE REPLACED AT THE ELECTRICAL CONTRACTORS EXPENSE.

THE ELECTRICAL CONTRACTOR SHALL REFER TO THE DRAWINGS FOR FLOOR PLAN AND BUILDING ELEVATION DIMENSIONS.

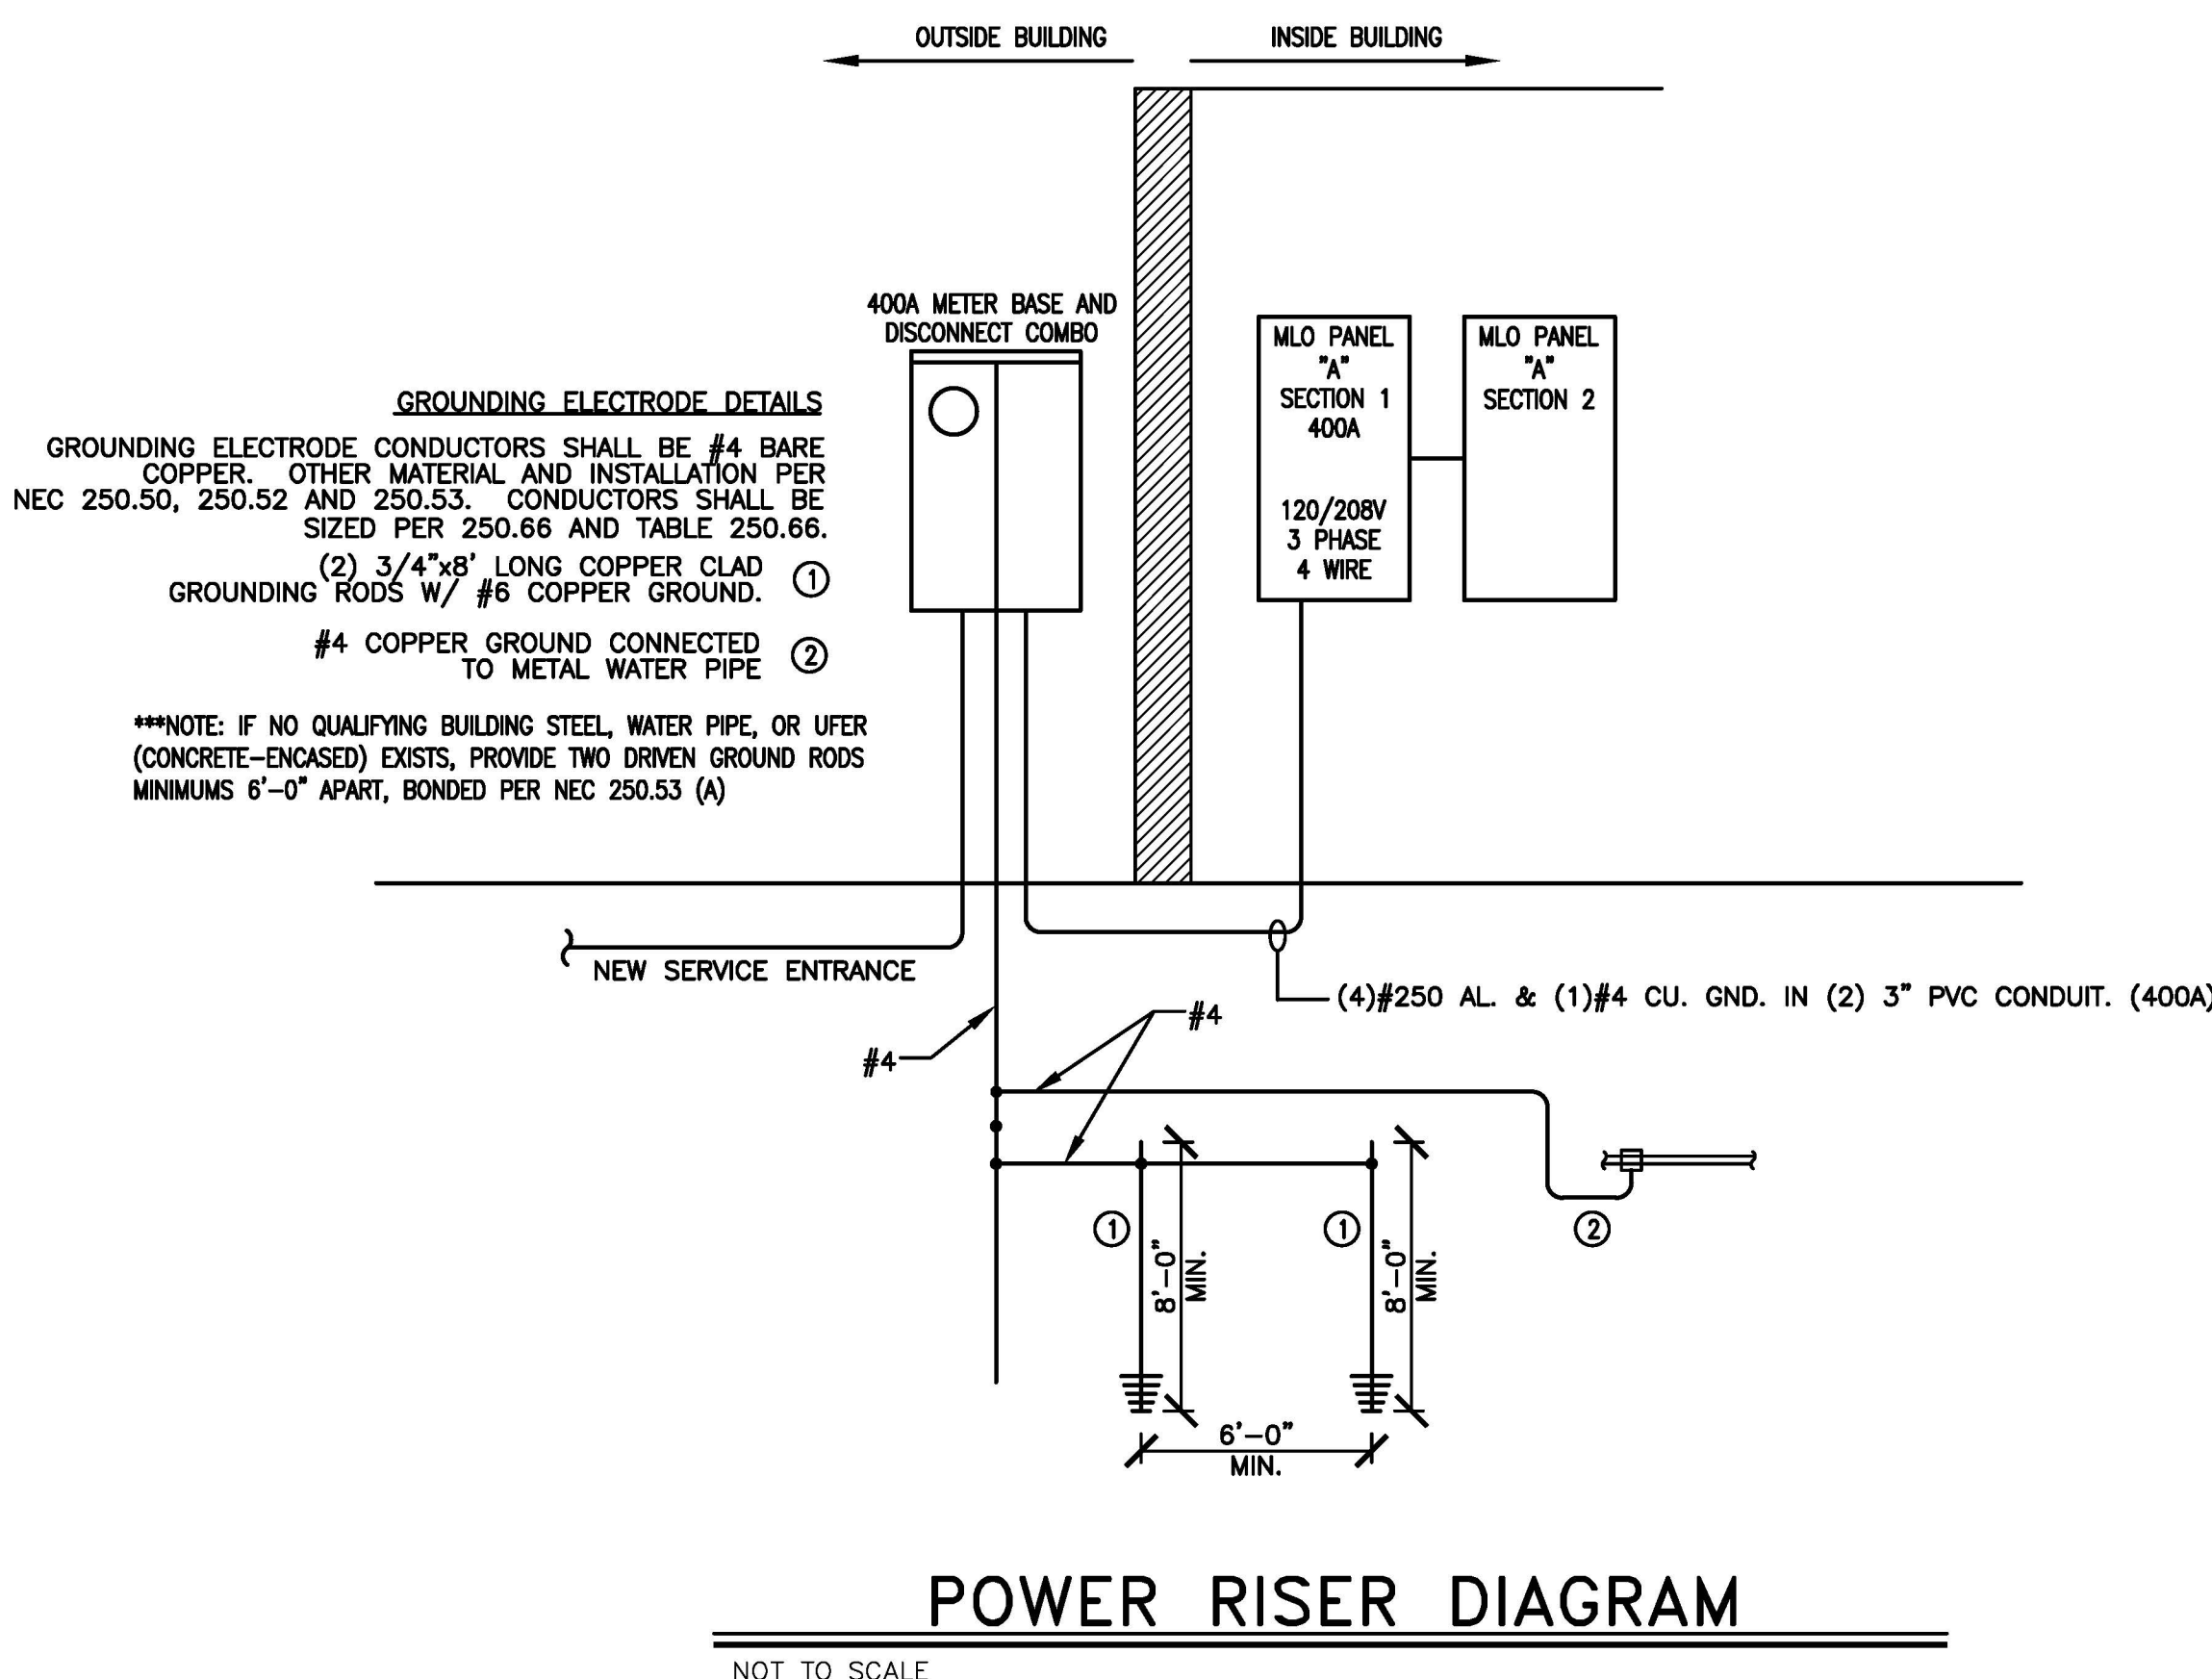[illegible]

PROJECT NAME: GOOD HOPE BEHAVIORAL URGENT CARE

ELECTRICAL SUMMARY

ELECTRICAL SYSTEM AND EQUIPMENT

METHOD OF COMPLIANCE:

ENERGY CODE:	X	PRESCRIPTIVE	PERFORMANCE
ASHRAE 90.1:		PRESCRIPTIVE	PERFORMANCE

LIGHTING SCHEDULE (EACH FIXTURE TYPE)
LAMP TYPE REQUIRED IN FIXTURE LED
NUMBER OF LAMPS IN FIXTURE (SEE FIXTURE SCHEDULE)
BALLAST TYPE USED IN THE FIXTURE ELECTRONIC
NUMBER OF BALLASTS IN FIXTURE 1
TOTAL WATTAGE PER FIXTURE VARIES PER FIXTURE
TOTAL INTERIOR WATTAGE SPECIFIED VERSUS ALLOWED (SPACE) 5,860 ALLOWED - 2,270 SPECIFIED
TOTAL EXTERIOR WATTAGE SPECIFIED VERSUS ALLOWED N/A

SECTION C406 ADDITIONAL EFFICIENCY PACKAGE OPTIONS

C406.1 BUILDINGS SHALL HAVE AT LEAST ONE OF THE FOLLOWING PRESCRIPTIVE COMPLIANCE (REQUIRED FOR NEW BUILDINGS
OPTIONAL FOR EXISTING BUILDINGS)

1. MORE EFFICIENT MECHANICAL EQUIPMENT PER C406.2
2. REDUCED LIGHTING POWER DENSITY PER C406.3
3. ENHANCED LIGHTING CONTROL SYSTEMS PER C406.4
4. ON-SITE SUPPLY OF RENEWABLE ENERGY PER C406.5
5. DEDICATED OUTDOOR AIR SYSTEM PER C406.6
6. HIGHER EFFICIENCY SERVICE WATER HEATING PER C406.

DESIGNER STATEMENT:
TO THE BEST OF MY KNOWLEDGE AND BELIEF, THE DESIGN OF THIS BUILDING COMPLIES WITH THE ELECTRICAL
SYSTEM AND EQUIPMENT REQUIREMENTS OF THE 2018 NC ENERGY CONSERVATION CODE.

SIGNED: Buddy Jenkins
NAME: BUDDY JENKINS
TITLE: PROFESSIONAL ENGINEER

PANEL "A"				PHASE 3				WIRE: 4				VOLTS: 208/120				MAIN: 400A MLO				
SECTION 1				TYPE: NEMA 1				MOUNTING: SURFACE				ENCLOSURE:								
SHORT CIRCUIT RATING: 22 kA RMS SYM.																				
				GROUND TERMINAL BAR								NEUTRAL TERMINAL BAR								
PHASE LOADING			DESCRIPTION	OKT. TYPE	OKT. RZR. TRF	OKT. NO.	A			B			OKT. RZR. TRF	OKT. NO.	WIRE SIZE	OKT. TYPE	DESCRIPTION	PHASE LOADING		
A	B	C					R	S	T	A	B	C						A	B	C
1.10			RECEPT-INTAKE 1 & RRa	R	#12	20/1	1						2	20/1	#12	R	RECEPT-TELHEALTH OFFICES	0.92		
	0.92		RECEPT-FRONT DESK 102	R	#12	20/1	3						4	20/1	#12	R	RECEPT-KID PRIVATE ROOMS		1.47	
	0.92		RECEPT-INTAKE 2 & RRa	R	#12	20/1	5						6	20/1	#12	R	RECEPT-CHAIR ROOMS			1.10
1.28			RECEPT-OFFICE 104 & 105	R	#12	20/1	7						8	20/1	#12	R	RECEPT-NURSE STATION	0.74		
	1.47		RECEPT-OFFICE 106 & 108	R	#12	20/1	9						10	20/1	#12	R	RECEPT-NURSE STATION		1.10	
	0.55		RECEPT- RR 107A & 117A	R	#12	20/1	11						12	20/1	#12	R	RECEPT-NURSE COUNTER		0.55	
0.74			RECEPT-KITCHEN COUNTER	R	#12	20/1	13						14	20/1	#12	R	RECEPT-NURSE COUNTER	0.55		
	0.55		RECEPT- STAFF RESTROOMS	R	#12	20/1	15						16	20/1	#12	R	RECEPT-CONFERENCE ROOM	0.92		
	1.10		RECEPT- OFFICE 124 & 125	R	#12	20/1	17						18	20/1	#12	R	RECEPT-WORK ROOM	0.55		
0.74			RECEPT- OFFICE 128	R	#12	20/1	19						20	20/1	#12	E	DRINKING FOUNTAIN	0.50		
	0.37		RECEPT- BREAKROOM	R	#12	20/1	21						22	20/1	#12	R	RECEPT-BREAKROOM COUNTER	0.55		
	0.37		RECEPT- RISER ROOM	R	#12	20/1	23						24	20/1	#12	E	BREAKROOM MICROWAVE		1.00	
0.60			CLOTH WASH	E	#12	20/1	25						26	20/1	#12	C	BREAKROOM FRIDGE	0.50		
	2.50			E	#10	30/2	27						28	20/1	#12	C	LIGHTING - FRONT SIDE	0.52		
	2.50		CLOTHES DRYER	E	#10	30/2	29						30	20/1	#12	C	LIGHTING - REAR SIDE		0.75	
0.64			ATTIC LIGHT + RECEPT	R	#12	20/1	31						32	20/1	#12	C	LIGHTING - NURSE AREA	0.35		
	0.75			E	#12	20/2	33						34	20/1	#12	C	LIGHTING - REAR WING AREA	0.45		
	0.75		IT UPS SYSTEM	C	#12	20/1	35						36	20/1	#12	C	LIGHTING - EXTERIOR WALLPACK	0.20		
1.00			IT RECEPT	C	#12	20/1	37						38	20/1	#12	C	WH-1 RECIPIR. PUMP	0.72		
	0.50		SPARE FOR FIRE ALARM	C	#12	20/1	39						40	20/1	#12	C	WH-2 RECIPIR. PUMP	0.00		
	0.50		WARMING KITCHEN FRIDGE	C	#12	20/1	41						42	20/1	#12	C	CRAWLSPACE LIGHT + RECEPT.	1.47		
	0.50		WARMING KITCHEN FREEZER	C	#12	20/1	43						44					0.00		
	0.00												46					0.00		
	0.00												48					0.00		
0.00													50					0.00		
	0.00												51					0.00		
	0.00												52					0.00		
													53							0.00

PHASE LOADING			DESCRIPTION	OCT. TYPE	WIRE SIZE	OCT. NO.	OCT. BKR. TRIP	A	B	C	OCT. NO.	OCT. BKR. TRIP	WIRE SIZE	OCT. TYPE	DESCRIPTION	PHASE LOADING			
A	B	C														A	B	C	
2.16			HP-1	H	#10	30/3	55				58				AHU-1		5.16		
	2.16						57				45/3	#8	H				5.16		
		2.16					59										5.16		
2.16			HP-2	H	#10	30/3	61				62				AHU-2		5.16		
	2.16						63				45/3	#8	H				5.16		
		2.16					65										5.16		
2.16			HP-3	H	#10	30/3	67				68				AHU-3		5.16		
	2.16						69				45/3	#8	H				5.16		
		2.16					71										5.16		
1.92			WH-1	E	#12	20/3	73				74				WH-2		1.44		
	1.92						75				20/3	#12	H				1.44		
		1.92					77										1.44		
1.25			IT CLOSET MINI-SPLIT	H	#10	25/2	79				80						0.00		
	1.25						81									0.00			
		0.00					83									0.00			
0.00							85				86						0.00		
	0.00						97				98						0.00		
		0.00					89				90						0.00		
0.00							91				92						0.00		
	0.00						93				94					0.00			
		0.00					96				96						0.00		
0.00							97				98						0.00		
	0.00						99				100						0.00		
		0.00					101				102						0.00		
0.00							103				104						0.00		
	0.00						105				106						0.00		
		0.00					107				108						0.00		
16.25	16.71	15.09	----- SUB-TOTAL (kVA) -----									SUB-TOTAL (VA) -----					21.20	21.93	22.54

H-HVAC LOAD	C-CONTINUOUS LOAD			TOTAL CONNECTED LOAD =	113.72 KVA
K-KITCHEN LOAD	N-NON CONTINUOUS LOAD			TOTAL AMPS =	315.65 A
E-ESTIMATED LOAD	R-RECEPTACLE LOAD			TOTAL OF: 108 SPACES	

TOTAL CONNECTED LOAD SUMMARY			
ITEM	CONNECTED LOAD (KVA)		ESTIMATED LOAD (KVA)
HVAC	88.38	● 100%	= 88.38
LIGHTING	4.38	● 125%	= 5.48
RECEPTACLES	18.56	(T=10.00*60%+10.00)	= 15.14
MISC. EQUIPMENT	22.40	● 60%	= 13.44
<hr/>			
TOTAL CONNECTED	113.72 KVA	315.65 AMPS	
ESTIMATED DEMAND	102.44 KVA	284.35 AMPS	

AVAILABLE FAULT CURRENT

08 VOLTS = 150 KVA XFMR 27,800 AMPS
CMIL ALUMINUM @ 100 FEET TO DISCONNECT AT SERVICE ENTRANCE

NT = 14,633 AMPS
INT = 8,324 AMPS

40 FEET TO PANEL (SHORTEST RUN)

NT = 12,302 AMPS
INT = 7,014 AMPS



E2

SHEET:

410 DENIM DRIVE, ERWIN, NC 28339

ELECTRICAL – POWER PLAN & LOW VOLTAGE

410 DENIM DRIVE, ERWIN, NC 28339

STE GENERAL CONTRACTORS LLC.

100 TUSHMAN DRIVE, DANN, NC 28334

OWNER/TENANT:
GOOD HOPE HOSPITAL
410 DENIM DRIVE, ERWIN, NC 28339

CONTRACTOR/BUILDER:
STE GENERAL CONTRACTORS LLC.

DATE: 25 JULY 2025

PROJECT #: 2025-01-16


DRAWN BY: TS.SAN.GD.BT.JC.JDL

FINAL DRAWING ☒ **FOR CONSTRUCTION**

PRELIMINARY ☐ **FOR DESIGN DEVELOPMENT ONLY**

PROFESSIONAL ENGINEER

25 JULY 2025

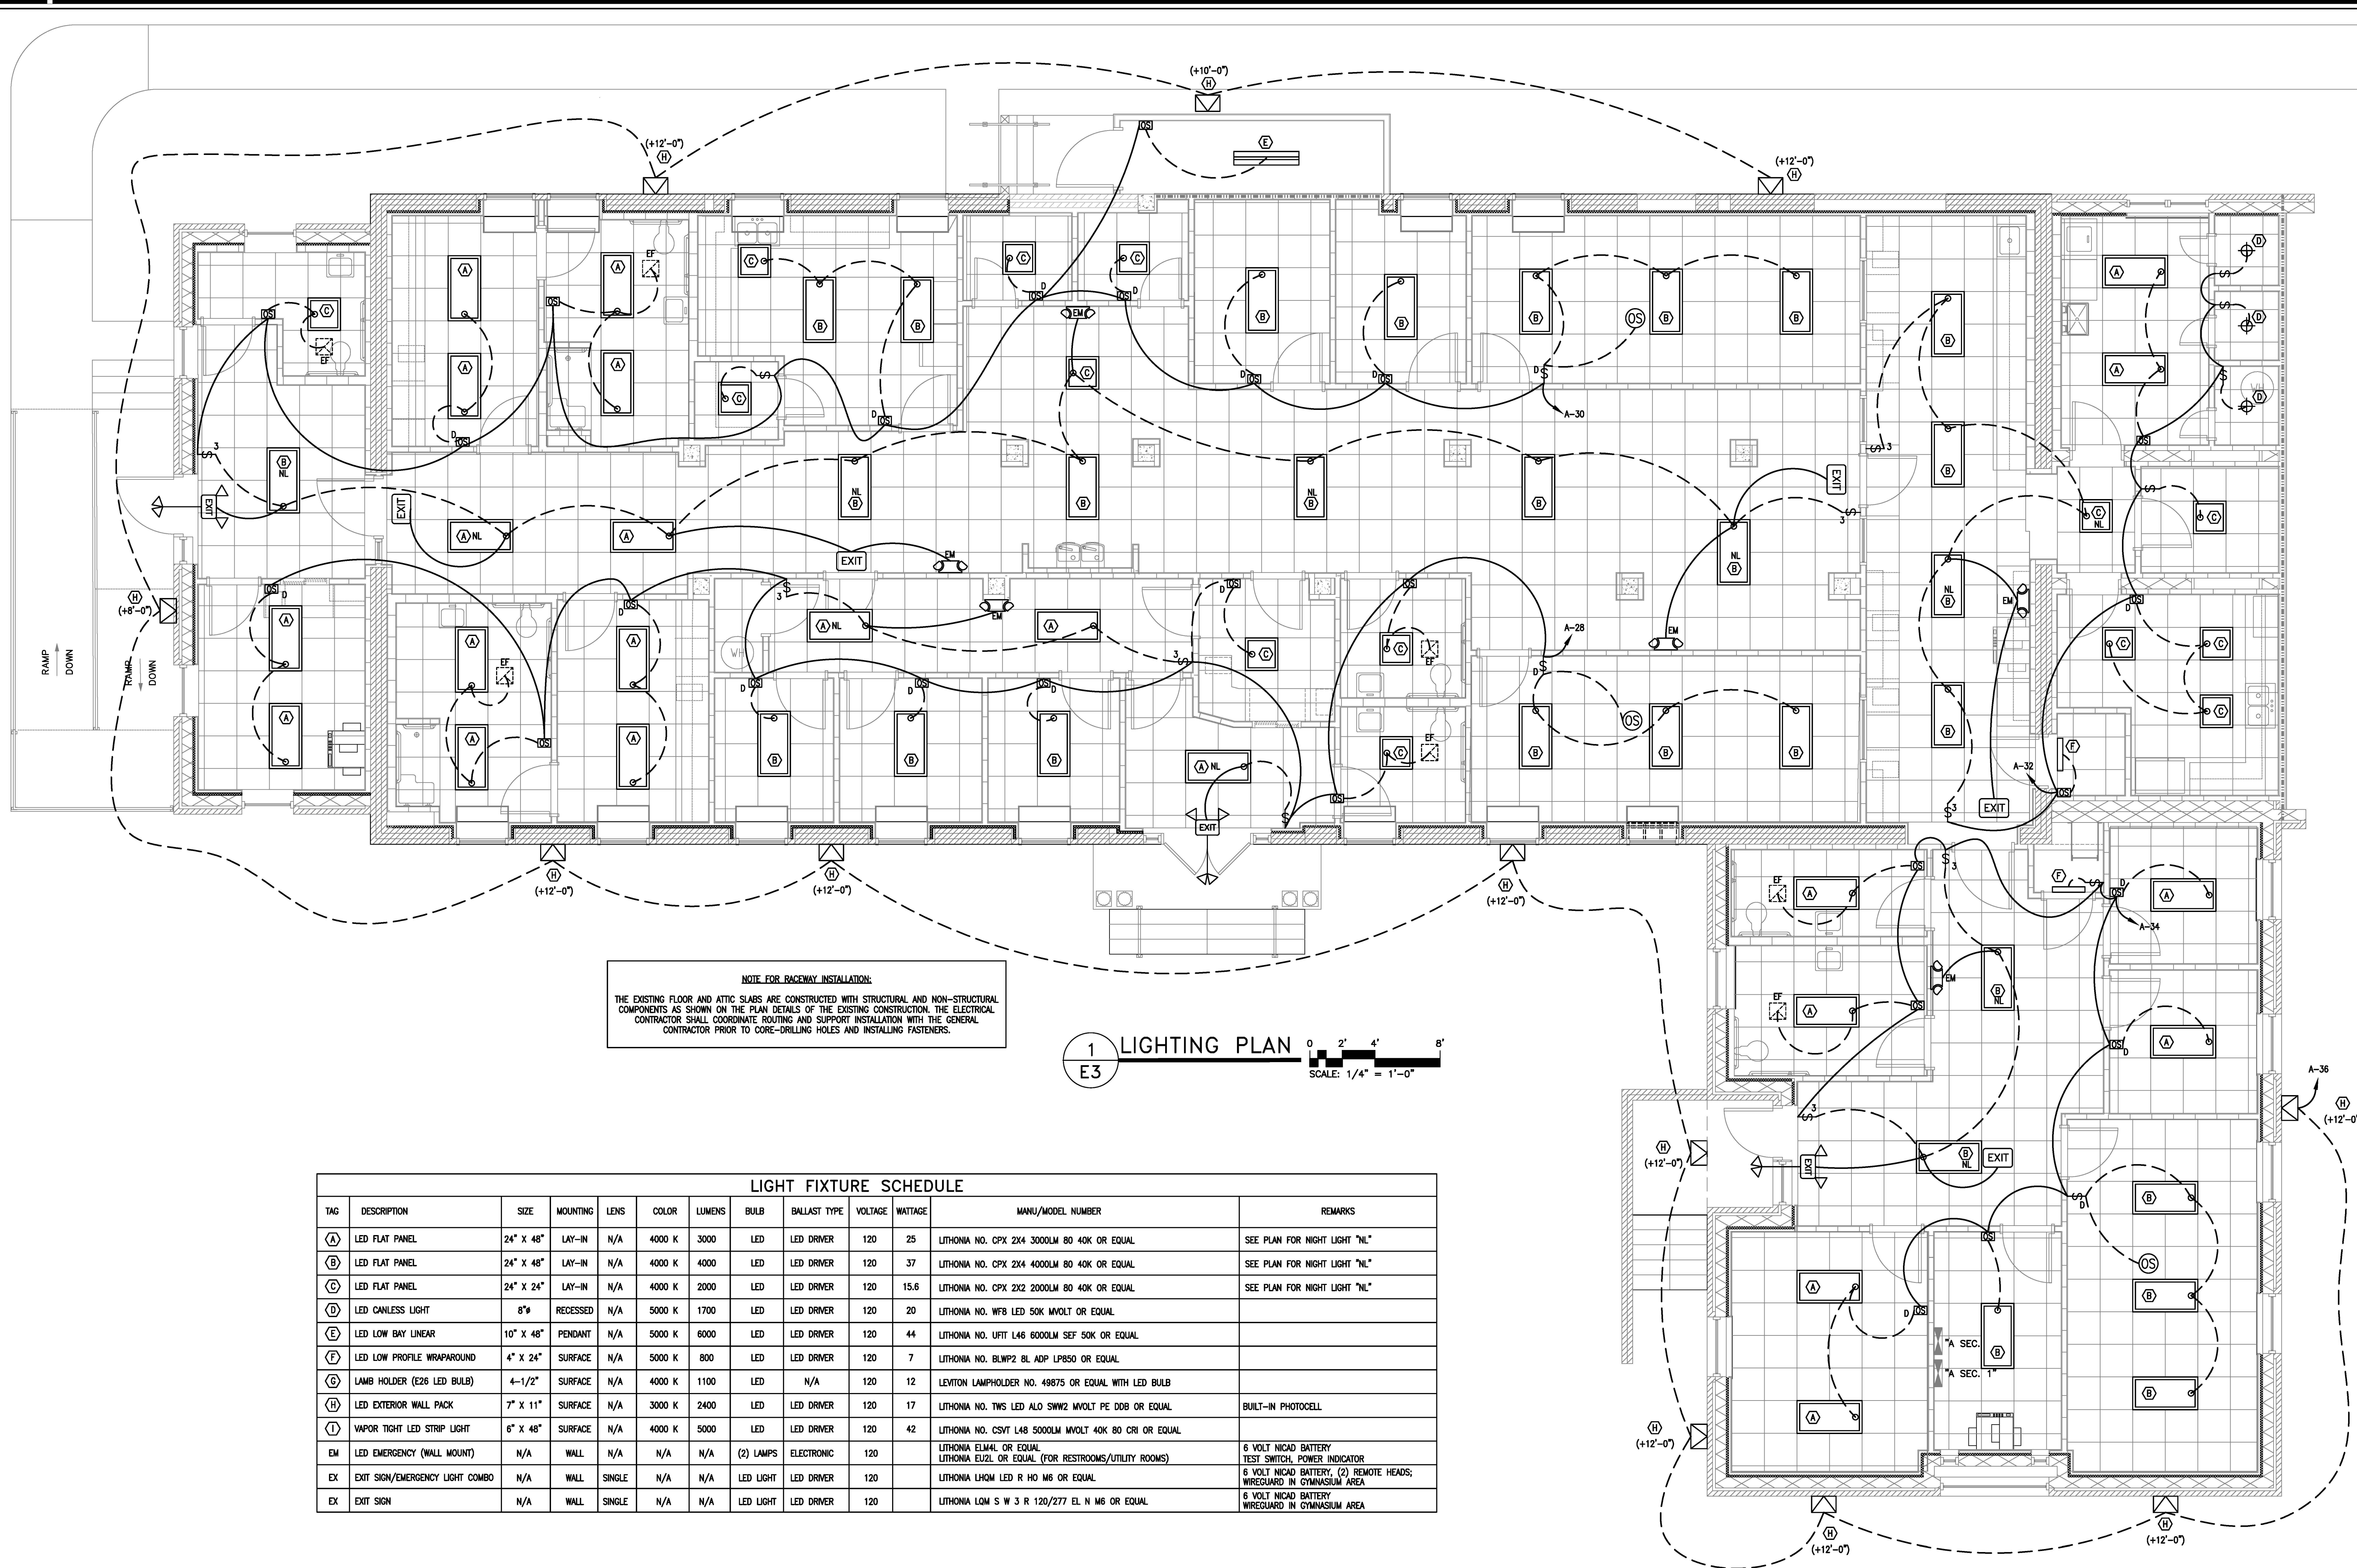

LIGHT FIXTURE SCHEDULE												
TAG	DESCRIPTION	SIZE	MOUNTING	LENS	COLOR	LUMENS	BULB	BALLAST TYPE	VOLTAGE	WATTAGE	MANU/MODEL NUMBER	REMARKS
(A)	LED FLAT PANEL	24" X 48"	LAY-IN	N/A	4000 K	3000	LED	LED DRIVER	120	25	LITHONIA NO. CPX 2X4 3000LM 80 40K OR EQUAL	SEE PLAN FOR NIGHT LIGHT "NL"
(B)	LED FLAT PANEL	24" X 48"	LAY-IN	N/A	4000 K	4000	LED	LED DRIVER	120	37	LITHONIA NO. CPX 2X4 4000LM 80 40K OR EQUAL	SEE PLAN FOR NIGHT LIGHT "NL"
(C)	LED FLAT PANEL	24" X 24"	LAY-IN	N/A	4000 K	2000	LED	LED DRIVER	120	15.6	LITHONIA NO. CPX 2X2 2000LM 80 40K OR EQUAL	SEE PLAN FOR NIGHT LIGHT "NL"
(D)	LED CANLESS LIGHT	8"	RECESSED	N/A	5000 K	1700	LED	LED DRIVER	120	20	LITHONIA NO. WF8 LED 50K 1MVOLT OR EQUAL	
(E)	LED LOW BAY LINEAR	10" X 48"	PENDANT	N/A	5000 K	6000	LED	LED DRIVER	120	44	LITHONIA NO. LIFT 16 6000LM SEF 50K OR EQUAL	
(F)	LED LOW PROFILE WRAPAROUND	4" X 24"	SURFACE	N/A	5000 K	800	LED	LED DRIVER	120	7	LITHONIA NO. BLWP2 8L ADP LP850 OR EQUAL	
(G)	LAMB HOLDER (E26 LED BULB)	4-1/2"	SURFACE	N/A	4000 K	1100	LED	N/A	120	12	LEVITON LAMPHOLDER NO. 49875 OR EQUAL WITH LED BULB	
(H)	LED EXTERIOR WALL PACK	7" X 11"	SURFACE	N/A	3000 K	2400	LED	LED DRIVER	120	17	LITHONIA NO. TWS LED ALD SWW2 1MVOLT PE DDB OR EQUAL	BUILT-IN PHOTOCCELL
(I)	VAPOR TIGHT LED STRIP LIGHT	6" X 48"	SURFACE	N/A	4000 K	5000	LED	LED DRIVER	120	42	LITHONIA NO. CSVT L48 5000LM 1MVOLT 40K 80 CRI OR EQUAL	
EM	LED EMERGENCY (WALL MOUNT)	N/A	WALL	N/A	N/A	N/A	(2) LAMPS	ELECTRONIC	120		LITHONIA ELMLR OR EQUAL LITHONIA ELZL OR EQUAL (FOR RESTROOMS/UTILITY ROOMS)	6 VOLT NICAD BATTERY TEST SWITCH, POWER INDICATOR
EX	EXIT SIGN/EMERGENCY LIGHT COMBO	N/A	WALL	SINGLE	N/A	N/A	LED LIGHT	LED DRIVER	120		LITHONIA LHQM LED R HO M6 OR EQUAL	6 VOLT NICAD BATTERY, (2) REMOTE HEADS; WIRECUARD IN GYMNASIUM AREA
EX	EXIT SIGN	N/A	WALL	SINGLE	N/A	N/A	LED LIGHT	LED DRIVER	120		LITHONIA LQM S W 3 R 120/277 EL N M6 OR EQUAL	6 VOLT NICAD BATTERY WIRECUARD IN GYMNASIUM AREA

NOTE FOR RACEWAY INSTALLATION:


THE EXISTING FLOOR AND ATTIC SLABS ARE CONSTRUCTED WITH STRUCTURAL AND NON-STRUCTURAL COMPONENTS AS SHOWN ON THE PLAN DETAILS OF THE EXISTING CONSTRUCTION. THE ELECTRICAL CONTRACTOR SHALL COORDINATE ROUTING AND SUPPORT INSTALLATION WITH THE GENERAL CONTRACTOR PRIOR TO CORE-DRILLING HOLES AND INSTALLING FASTENERS.


1 LIGHTING PLAN

0 2' 4' 8'


SCALE: 1/4" = 1'-0"

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

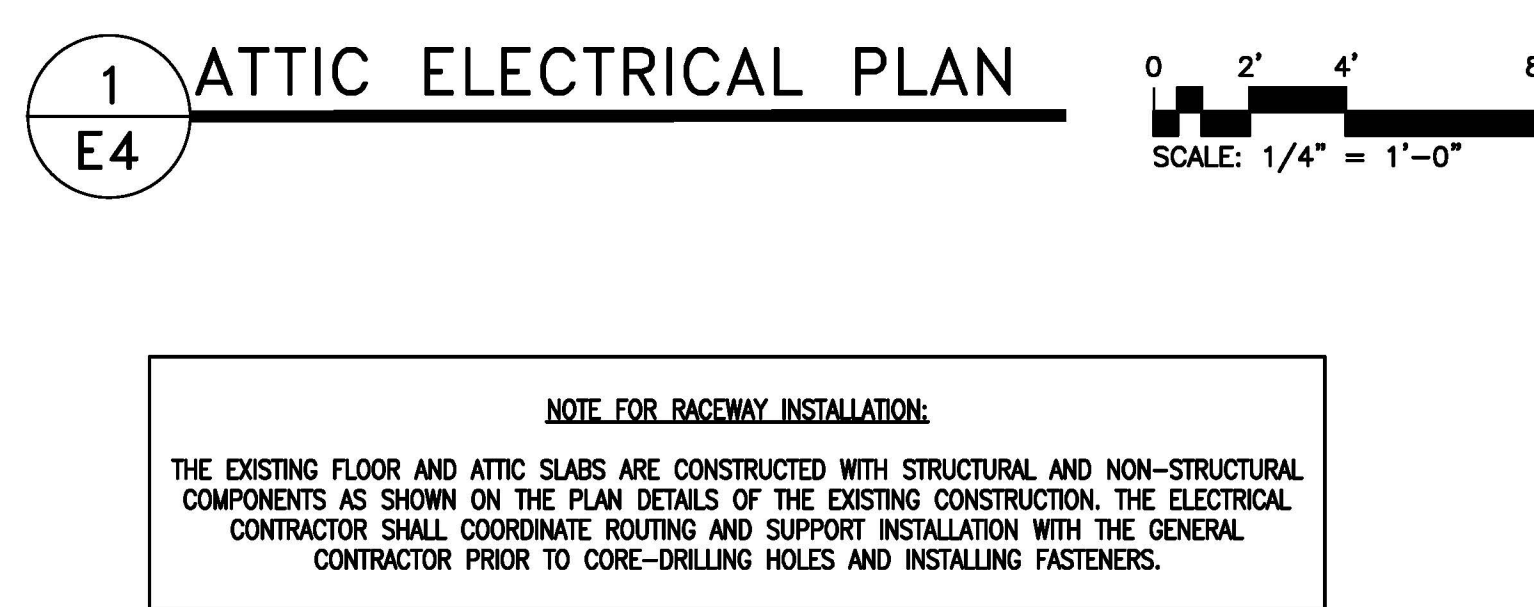[illegible]

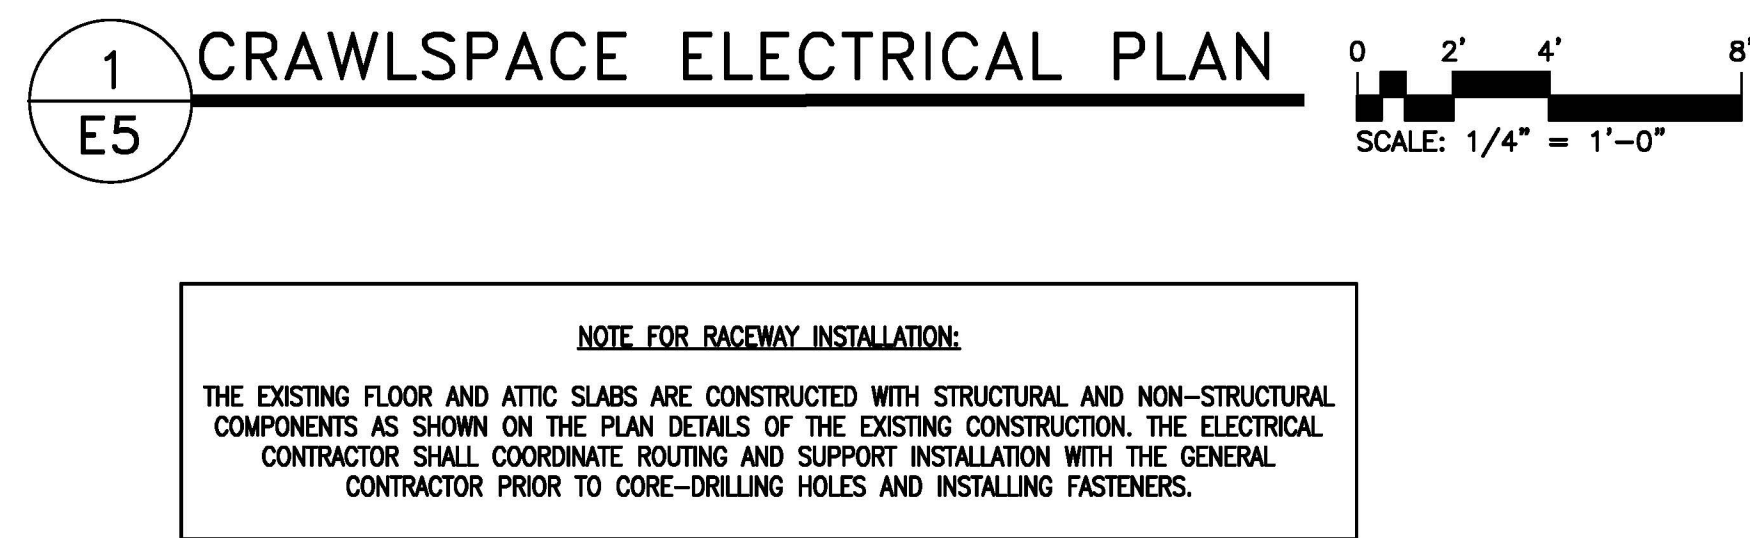

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM

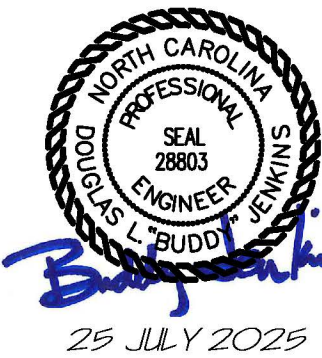

FINAL DRAWING ☐ FOR REVIEW PURPOSES ONLY
PRELIMINARY ☐ FOR DESIGN DEVELOPMENT ONLY
FINAL DRAWING ☒ FOR CONSTRUCTION


OWNER/TENANT:
GOOD HOPE HOSPITAL
410 DENIM DRIVE, ENMIN, NC 28339


CONTRACTOR/BUILDER:
STE GENERAL CONTRACTORS LLC,
100 TULSAH DRIVE, DUNN, NC 28334

[illegible]

PROJECT: **GOOD HOPE BEHAVIORAL HOSPITAL RENOVATION**
410 DENIM DRIVE, ERWIN, NC 28339
SHEET: **ELECTRICAL -- CRAWLSPACE**

E5

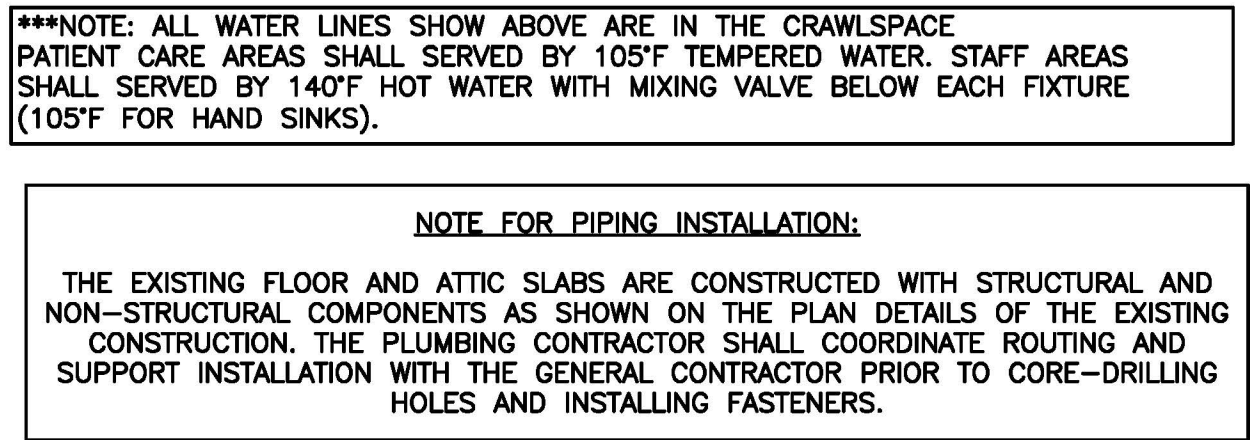[illegible]

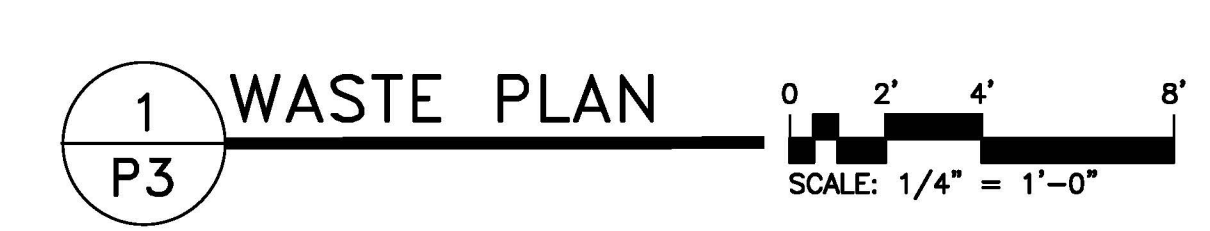

NOTE FOR PIPING INSTALLATION:

THE EXISTING FLOOR AND ATTIC SLABS ARE CONSTRUCTED WITH STRUCTURAL AND NON-STRUCTURAL COMPONENTS AS SHOWN ON THE PLAN DETAILS OF THE EXISTING CONSTRUCTION. THE PLUMBING CONTRACTOR SHALL COORDINATE ROUTING AND SUPPORT INSTALLATION WITH THE GENERAL CONTRACTOR PRIOR TO CORE-DRILLING HOLES AND INSTALLING FASTENERS.

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM



J. W. JENKINS, JR.
CONSULTING ENGINEERS, PA.
OFFICE IN NORTH CAROLINA
1008 MARTIN LUTHER KING, JR. BLVD.
FAYETTEVILLE, NC 28411-1002
NORTH CAROLINA CORPORATION NUMBER C-20811-1002
OFFICE 910.622.1174
FAX 910.655.9697

DESIGNED/CHECKED BY: BJ	
DRAWN BY: TS,SAN,GD,BT,JC,JDL	
PROJECT #: 2025-01-16	
DATE: 25 JULY 2025	

FINAL DRAWING ☐ FOR REVIEW PURPOSES ONLY
PRELIMINARY ☐ FOR DESIGN DEVELOPMENT ONLY
FINAL DRAWING ☒ FOR CONSTRUCTION

OWNER/TENANT:
GOOD HOPE HOSPITAL
410 DENIM DRIVE, ERMING, NC 28339

CONTRACTOR/BUILDER:
SITE GENERAL CONTRACTORS LLC.
100 S. WILKINSON DRIVE, RAYLE, NC 28384

[illegible]

PROJECT: **GOOD HOPE BEHAVIORAL HOSPITAL RENOVATION**
410 DENIM DRIVE, ERWIN, NC 28359

SHEET: **ISOMETRIC WATER RISER DIAGRAM**

P4



JENKINS
CONSULTING ENGINEERS, PA
OFFICE IN EUREKA SPRINGS, NORTH CAROLINA
1009 MARTIN RD.
FAYETTEVILLE, NC 28411-0022
CORPORATE CAMPUS NORTH
OFFICE 910.622.1722
FAX 910.630.9907

REGISTERED PROFESSIONAL ENGINEERS
SINCE 1970
NORTH CAROLINA
MEMBER SOCIETY OF PROFESSIONAL ENGINEERS



DESIGNED/CHECKED BY:	BJ
DRAWN BY:	TS,SAN,GD,BT,JC,JDL
PROJECT #:	2025-01-16
DATE:	25 JULY 2025

FINAL DRAWING ☐ FOR REVIEW PURPOSES ONLY
PRELIMINARY ☐ FOR DESIGN DEVELOPMENT ONLY
FINAL DRAWING ☒ FOR CONSTRUCTION

OWNER/TENANT:
GOOD HOPE HOSPITAL
410 DENNY DRIVE, ERWIN, NC 28539


CONTRACTOR/BUILDER:
STE GENERAL CONTRACTORS LLC.
100 TUGMAN DRIVE, DUNN, NC 28534

[illegible]

PROJECT: **GOOD HOPE BEHAVIORAL HOSPITAL RENOVATION**
 410 DENIM DRIVE, ERWIN, NC 28339


SHEET: **ISOMETRIC WASTE RISER DIAGRAM**

P5

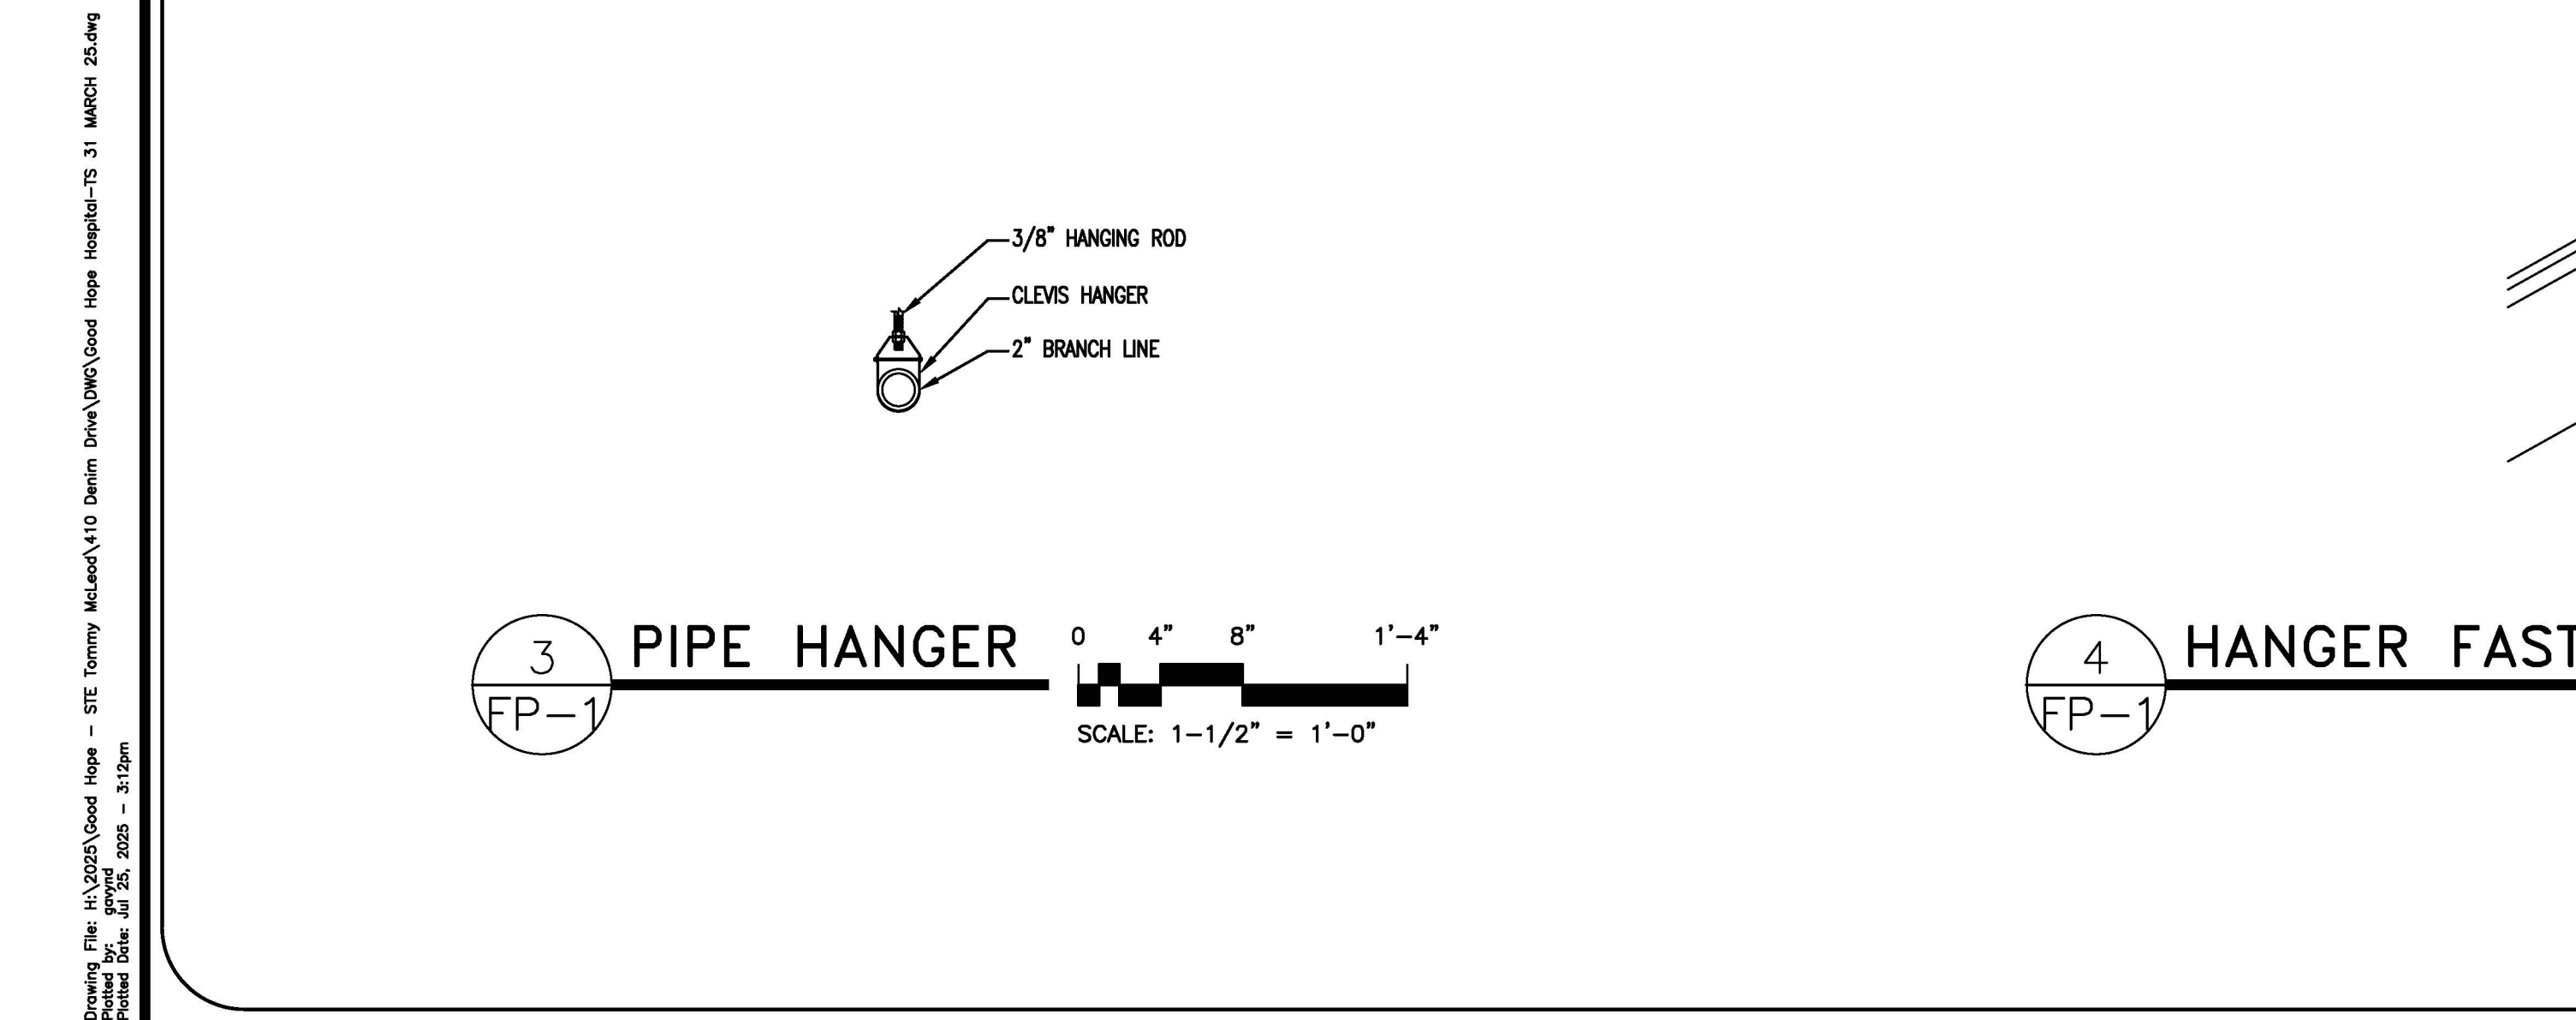

FP-1	
------	--



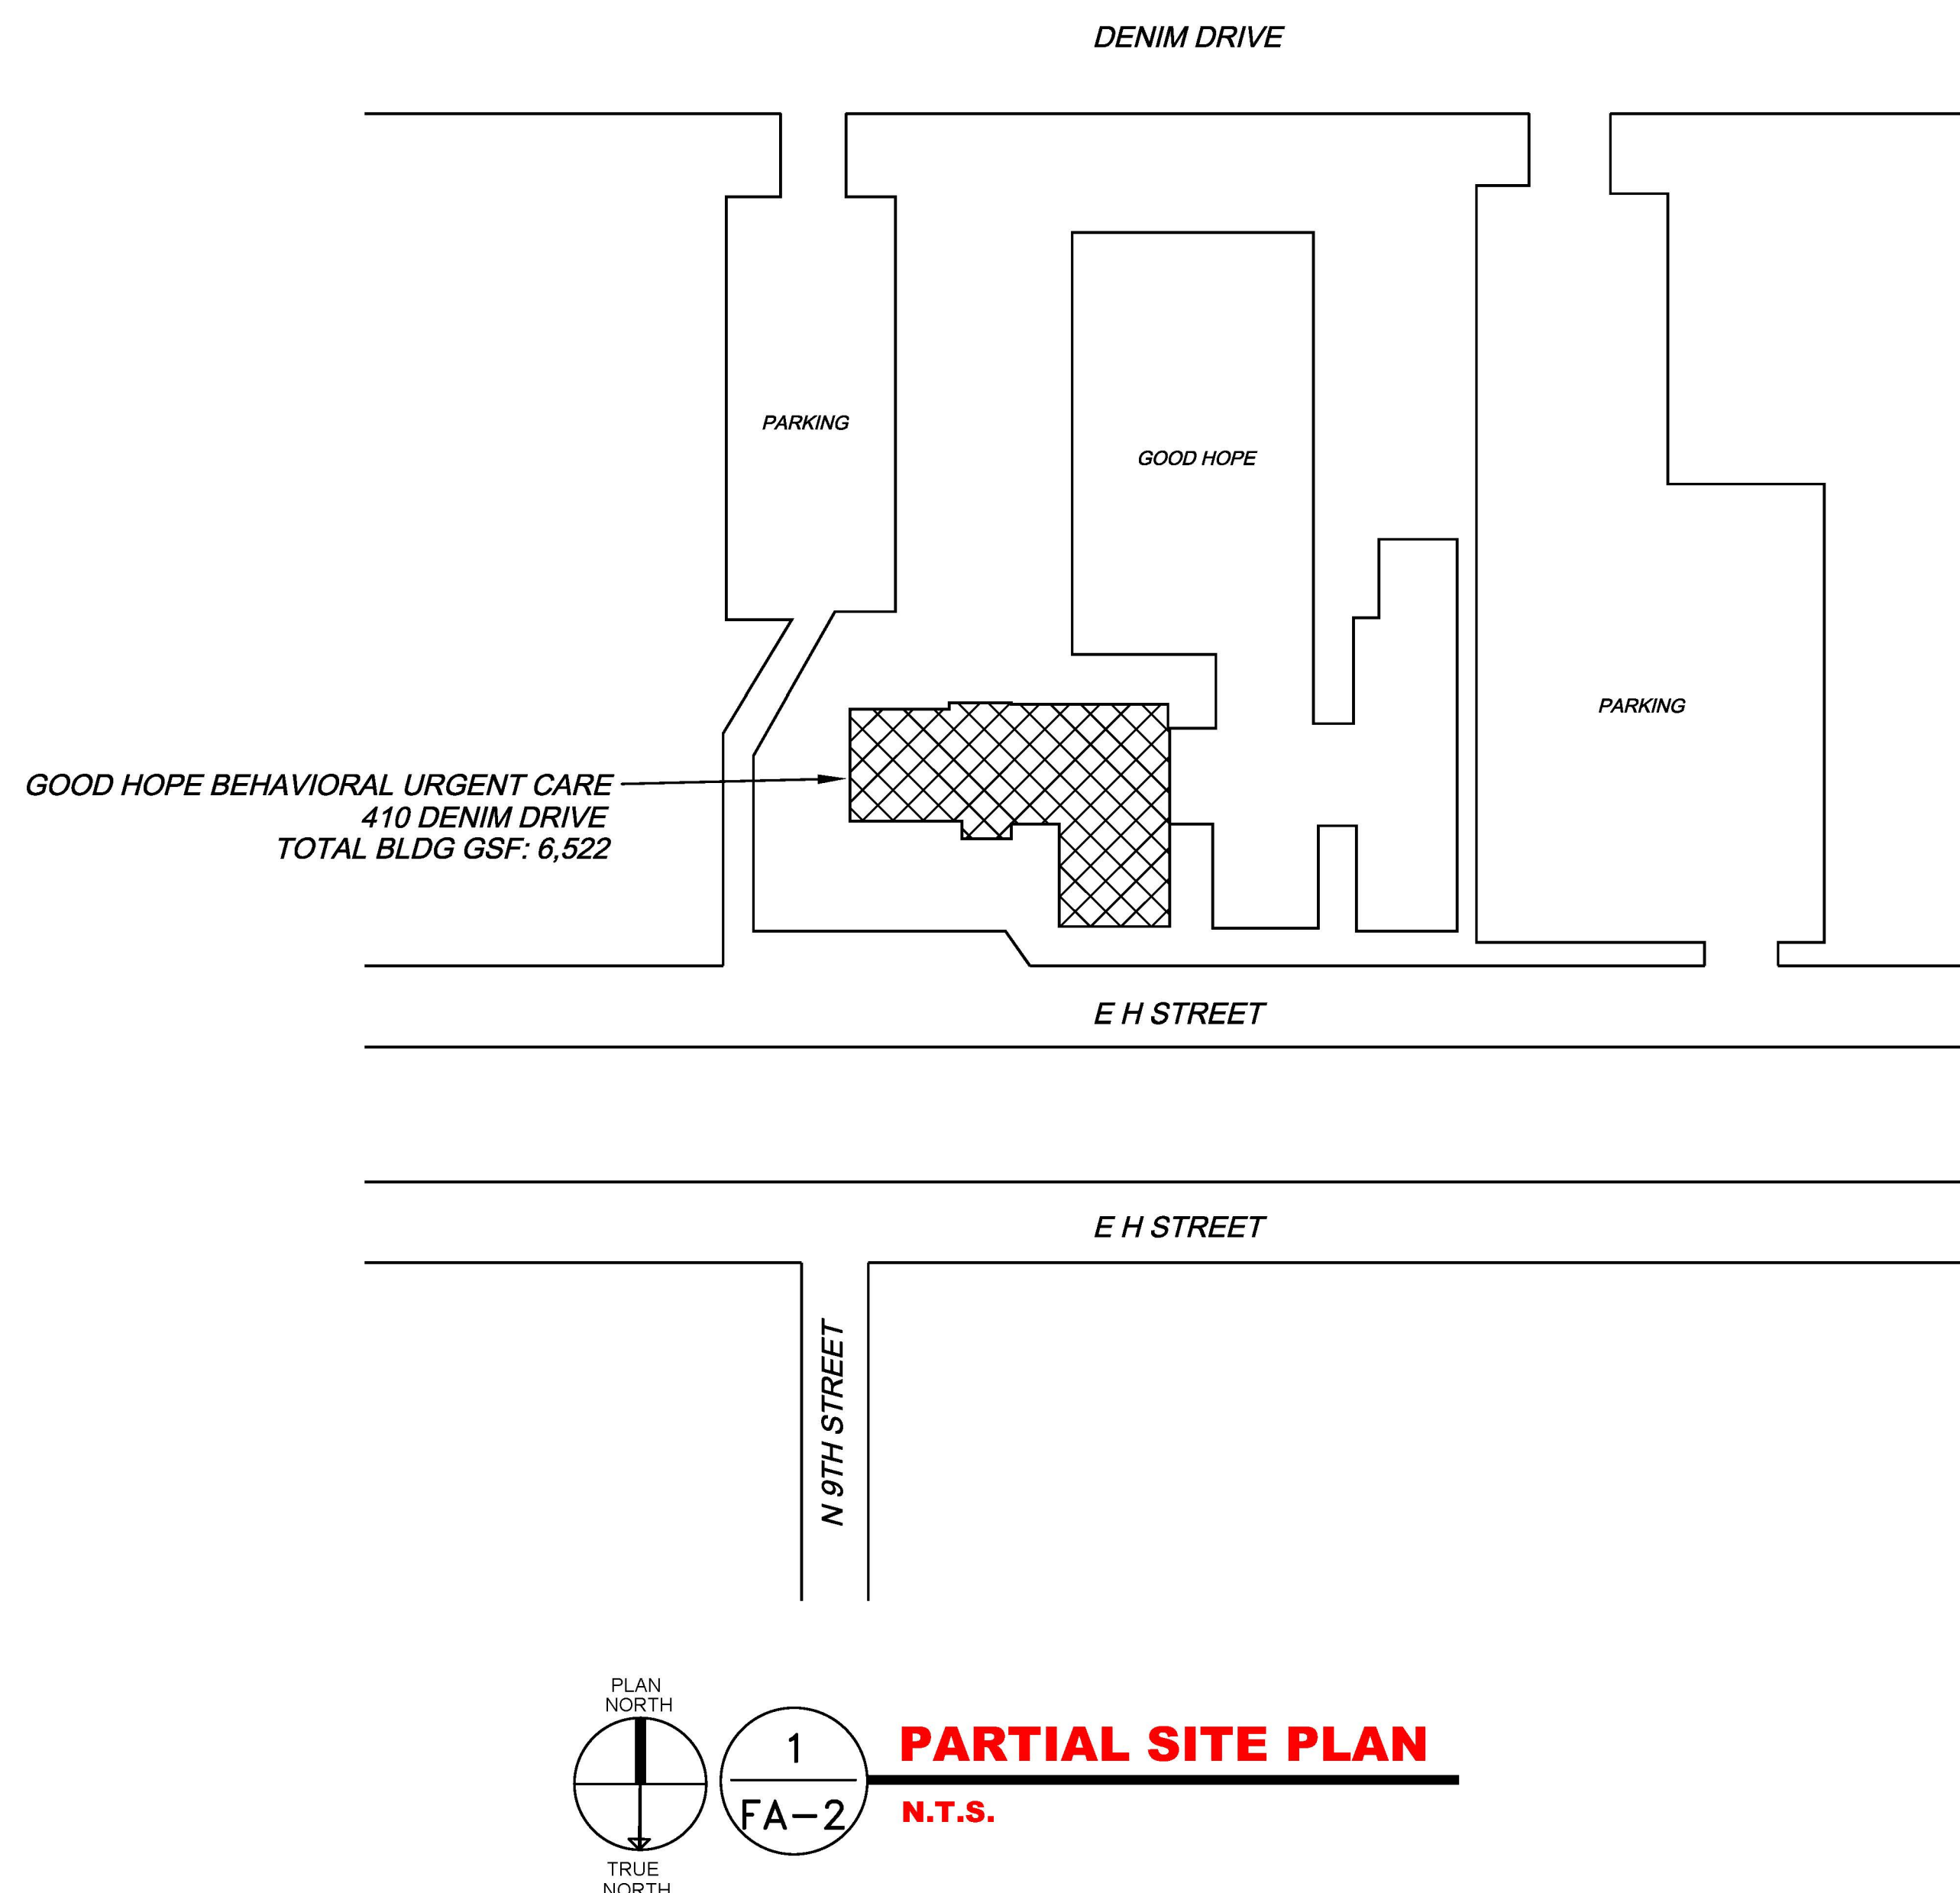





THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM



The diagram illustrates the wiring for a fire alarm system. A central box represents the **FIRE ALARM CONTROL PANEL FIRE-LITE ES-SOX**. To its left is the **ANNUNCIATOR PANEL**, connected by a **18-4 FIRE CABLE**. Below the annunciator panel, it is noted that **ADDITIONAL LINE VOLTAGE AS REQUIRED FOR AUXILIARY POWER** is needed. The control panel has several output lines:

- NOTIFICATION FIRST FLOOR:** This line branches to two square symbols representing notification appliances. It is powered by a **12 VDC** source, which is connected to a **12 VDC** source, which in turn is connected to **2-12 VOLT 80H BATTERIES - SECONDARY POWER SUPPLY**.
- INITIATING LOOP TO SMOKE AND PULLS:** This line, labeled **16-2 FIRE CABLE**, connects to a series of three circular symbols representing smoke and pull stations.
- INITIATING LOOP TO DOOR RELEASE AT DELAYED EGRESS DOORS:** This line, labeled **16-2**, connects to a rectangular symbol representing a door release device.
- NOTIFICATION APPLIANCE CIRCUIT (NEW):** This line, labeled **16-2 FIRE CABLE**, connects to a square symbol representing a new notification appliance. It is also powered by the **12 VDC** source.

 A note **CIRCUIT TBD** points to the bottom of the control panel. The system terminates at the **END OF LINE RESISTOR**.

FIRE ALARM SYMBOL LEGEND	
SYMBOL	DESCRIPTION
	FIRE ALARM CONTROL PANEL (FIRE-LITE ES-SOX)
	REMOTE ANNUNCIATOR (FIRE-LITE ANN-80)
	FIRE ALARM PULL STATION (HONEYWELL BO-12LX)
 95cd	STROBE UNIT (SYMBOL SENSOR SRL) (cd) CANDELA RATING
 95cd	HORN STROBE UNIT (SYMBOL SENSOR P2RL) (cd) CANDELA RATING
	SMOKE DETECTOR (SD 365)
	FLOW SWITCH (CONNECT TO FIRE SPRINKLER MAIN ON BEHAVIORAL SIDE OF DEMISING WALL)
	DELAYED EGRESS EXIT DOOR RELEASE
<h2>NOTES</h2>	
<p>ALL FIRE ALARM EQUIPMENT TO MEET NFPA 72</p> <p>THE FIRE ALARM SYMBOL SHOWN HERE DEPICTS A CLASS "B" SYSTEM</p> <p>NEW FIRE ALARM CONTROL PANEL IS A FIRE-LITE ES-SOX</p> <p>PROVIDE ADDITIONAL ZONE MODULES AS REQ'D FOR THE ADDITIONAL DEVICES</p>	

BUILDING SUMMARY AND SCOPE OF WORK:

THE BUILDING CONSTRUCTION TYPE IS TYPE III-B ACCORDING TO 2018 NORTH CAROLINA BUILDING CODE

TENANT SPACE GROSS SQUARE FEET: 6,522

BUILDING IS PROTECTED BY FIRE SPRINKLERS.

BUILDING USE WILL BE BUSINESS (B), GOOD HOPE BEHAVIORAL URGENT CARE CLINIC.

THIS DRAWING INCLUDES A BUILDING FLOOR PLAN THAT WAS PREPARED BY JENKINS CONSULTING ENGINEERS. THIS DRAWING SHOWS THE LOCATION OF NEW FIRE ALARM EQUIPMENT AND DEVICES.

THE FACILITY IS PROTECTED AND MONITORED BY A SECURITY SYSTEM.

THE SCOPE OF WORK INCLUDES INSTALLATION OF A FIRE ALARM CONTROL PANEL, NEW FIRE-1LITE ANNUNCIATOR, NEW FIRE PULL HANDLES, HORN STROBES, STROBES, SMOKE DETECTOR AND MONITOR MODULE RELAYS TO BE LOCATED IN THE TENANT SPACE AND WILL COMMUNICATE WITH THE NEW FIRE ALARM SYSTEM BY OTHERS. THE FIRE ALARM WILL BE MONITORED BY A CENTRAL STATION.

AN NEW ADDRESSABLE FIRE ALARM CONTROL PANEL, FIRE-LITE ES-50X FIRE ALARM CONTROL PANEL, WILL BE INSTALLED IN IT/FIRE ALARM ROOM.

AN NEW REMOTE ANNUNCIATOR PANEL WILL BE INSTALLED AND EQUAL TO FIRE-LITE ANN-80.

NEW FIRE PULL HANDLES WILL BE INSTALLED AND WILL BE EQUAL TO HONEYWELL BG-12LX.

NEW STROBE LIGHTS WILL BE INSTALLED AND WILL BE EQUAL TO SYSTEM SENSOR SRL.

NEW HORN STROBES WILL BE INSTALLED AND WILL BE EQUAL TO SYSTEM SENSOR P2RL.


A NEW SMOKE DETECTOR WILL BE INSTALLED AND WILL BE EQUAL TO SYSTEM SENSOR SD 365

FLOW SWITCH WILL BE INSTALLED AND WILL BE EQUAL TO MONITOR MODULE RELAY MD-300 AND WILL BE LOCATED IN THE AREA OF THE NEW SPRINKLER MAIN LINE THAT WILL PENETRATE THE DEMISING WALL INTO THIS SPACE FROM THE OTHER.

FIRE ALARM CONTRACTOR WILL TEST AND INSPECT NEW SYSTEM WITH LOCAL AUTHORITIES.

GENERAL NOTES:

1. CONTRACTOR SHALL PROVIDE AND INSTALL NEW NOTIFICATION DEVICES AND NEW INITIATING DEVICES BUILDING AS REQUIRED BY NFPA 101, LIFE SAFETY CODE AND NFPA 72, THE FIRE ALARM CODE.
2. PROVIDE BACK BOXES FOR ALL WALL MOUNTED DEVICES.
3. ALL WIRING IS COPPER, WITH RED JACKET.
4. DEVICES SHALL BE RED IN COLOR.
5. VERIFY LOCATION OF ANNUNCIATOR PANEL WITH FIRE MARSHAL.
6. PROVIDE WALL BRACKETS WHERE REQUIRED FOR ADDITIONAL FIRE EXTINGUISHERS.

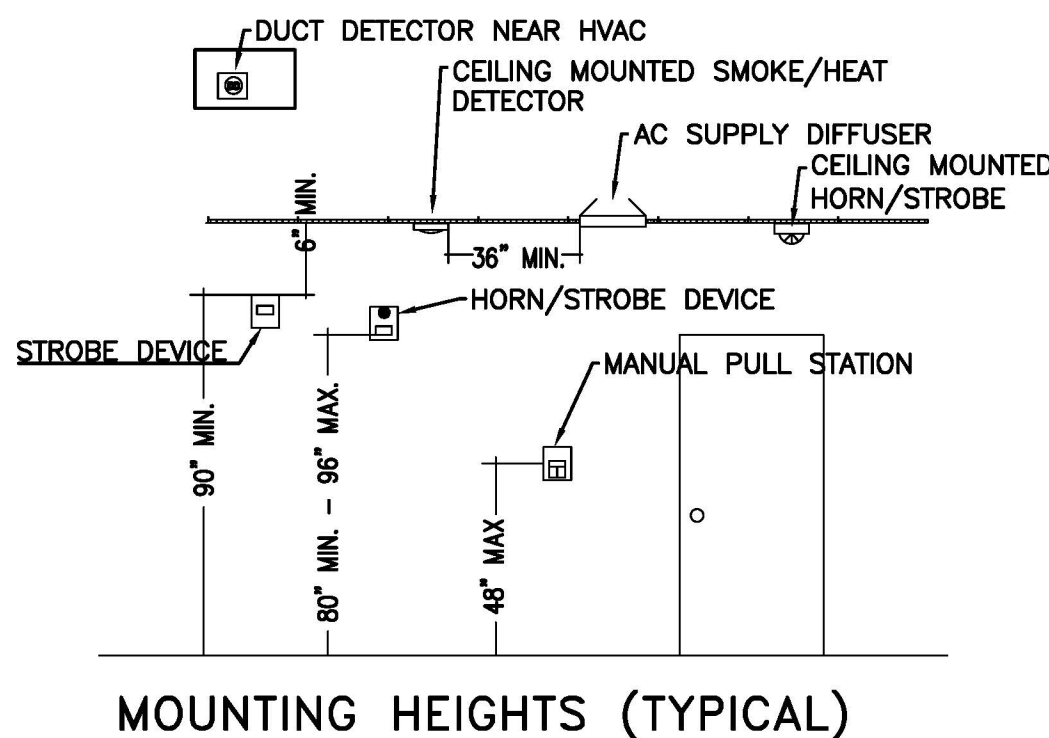

THIS BUILDING IS PROTECTED BY A SPRINKLER SYSTEM