



revision:

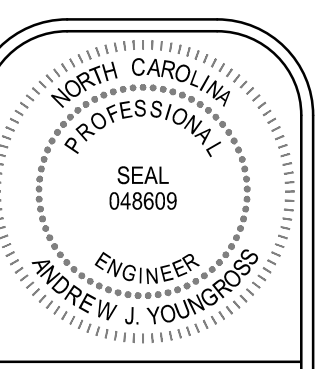

An Interior Renovation for:
**Harnett Health
 Central Sterile Renovation**
 215 Brightwater Drive
 Lillington, North Carolina

job no. 24-029/25157
 principal: AJY
 designer: RR/HL/KS
 file name:
 date: 09.26.25
 title:
**FIRE
 PROTECTION
 PLAN**

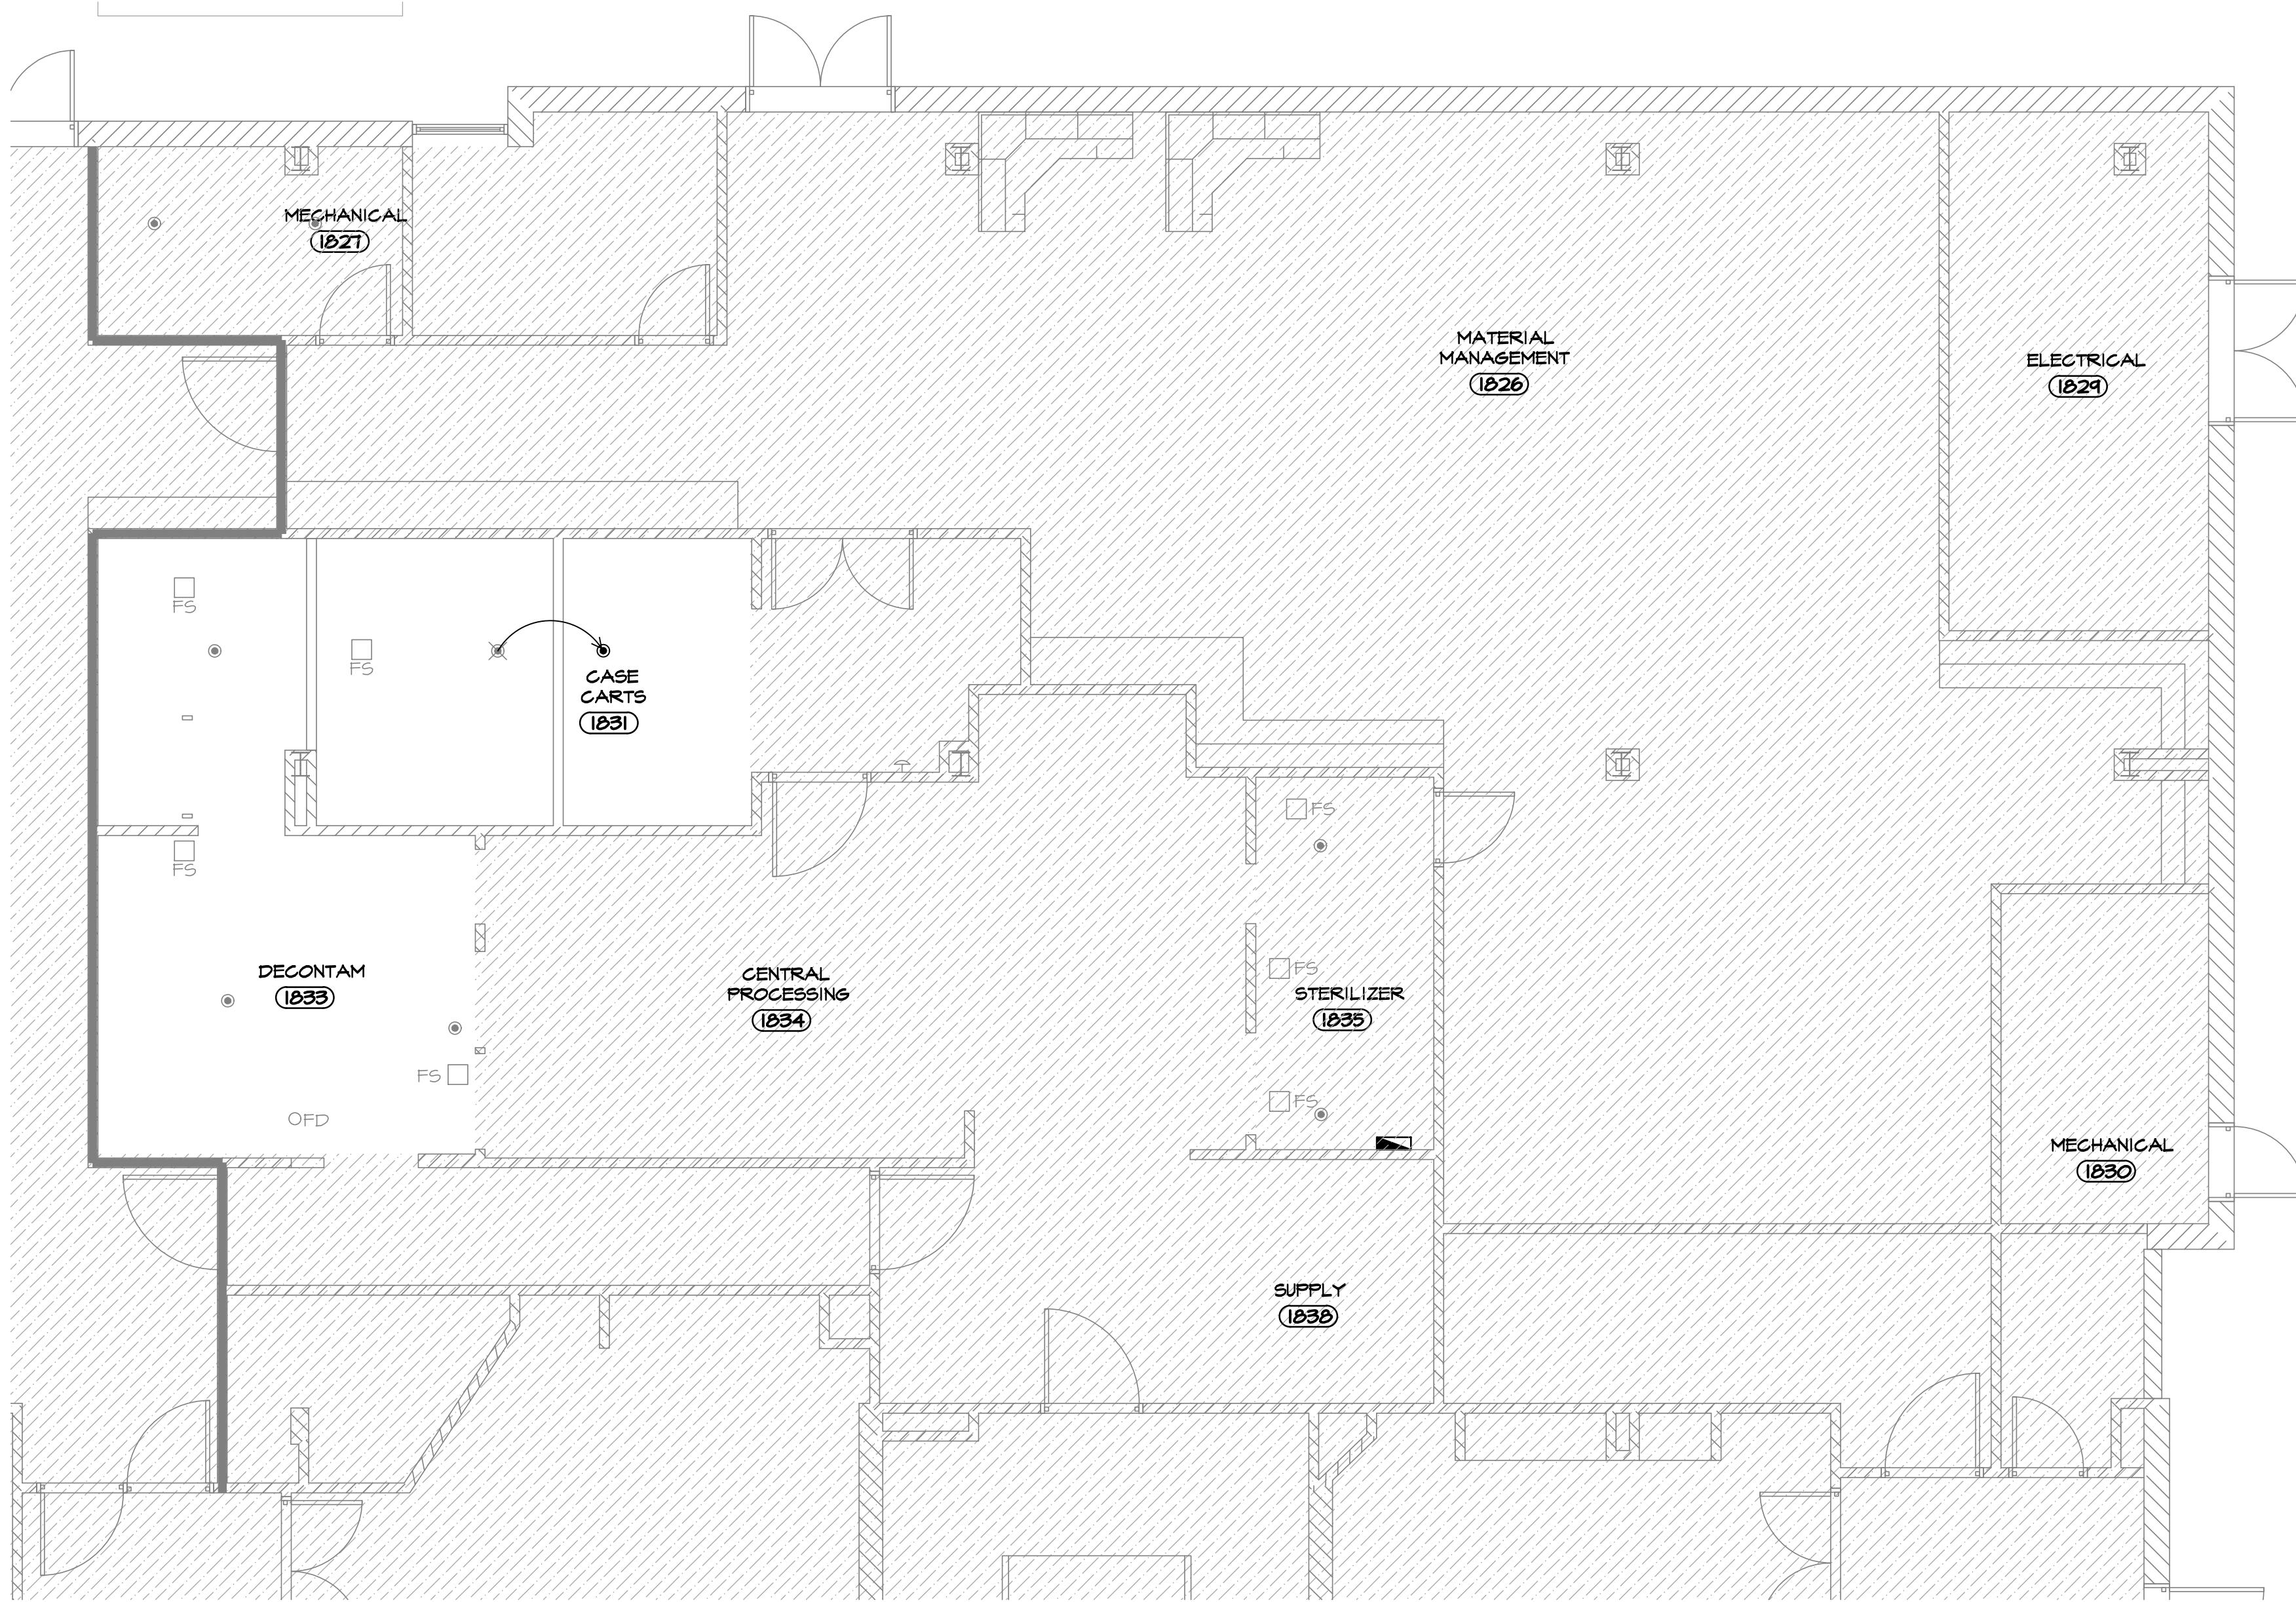


NOTE
 THESE DRAWINGS ARE INTENDED TO PROVIDE THE GENERAL REQUIREMENTS AND DESIGN CRITERIA FOR THE PROJECT. FIRE SPRINKLER CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR OBTAINING CURRENT FIRE FLOWS FROM LOCAL AUTHORITIES AND PREPARE COMPLETE DESIGN AND INSTALLATION DRAWINGS AND CALCULATIONS AS NECESSARY FOR FULL COMPLIANCE WITH ALL LAWS AND REGULATIONS AS REQUIRED BY THE AUTHORITY HAVING JURISDICTION. NO ADDITIONAL COMPENSATION WILL BE PROVIDED FOR ANYTHING DEEMED TO BE REQUIRED BY THE AUTHORITY HAVING JURISDICTION AFTER AWARD OF BID.


SCOPE OF WORK
 RELOCATE EXISTING HEAD SO IT IS NOT IN CONFLICT WITH NEW WALK IN WASHER. COORDINATE FINAL LOCATION IN THE FIELD.

FIRE PROTECTION LEGEND


- RELOCATED PENDENT SPRINKLER HEAD
- ⊙ EXISTING PENDENT SPRINKLER HEAD TO REMAIN
- ⊗ EXISTING PENDENT SPRINKLER HEAD TO BE REMOVED

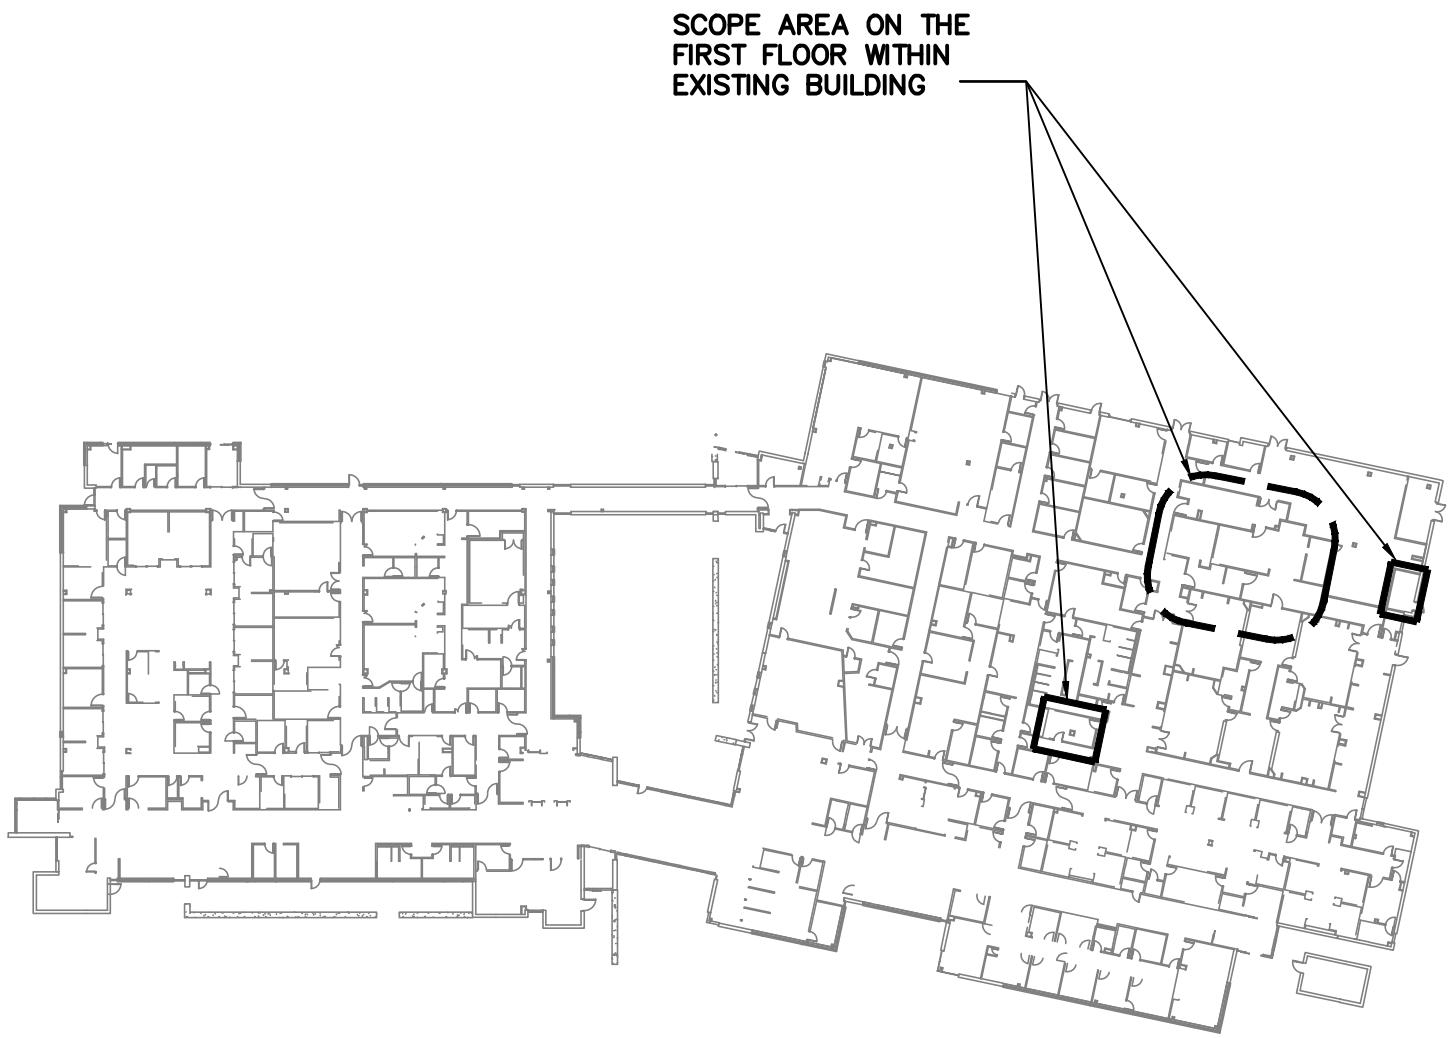

FIRE PROTECTION PLAN
 3/16"=1'-0"

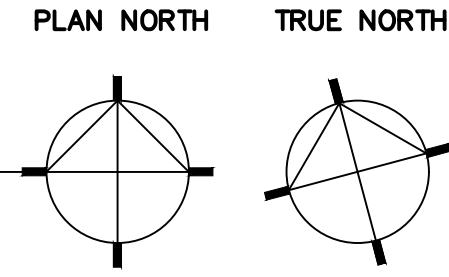

OVERALL FIRST FLOOR PLAN
 NTS



NOTE
 THESE DRAWINGS ARE PREPARED PER ESTABLISHED INDUSTRY STANDARDS AND REPRESENT THE ENGINEERS DESIGN CONCEPT. THEY ARE NOT INTENDED TO PROVIDE EVERY DETAIL OR CONDITION REQUIRED TO CONSTRUCT THE BUILDING. THE CONTRACTOR THROUGH SUBMITTALS AND OTHER COORDINATION EFFORTS IS FULLY RESPONSIBLE FOR PROVIDING A COMPLETE AND OPERATIONAL BUILDING WHETHER INDICATED ON THE PLANS OR NOT.

ANDREW J. YOUNGROSS, P.E.
 2522 S.E. COLUSA AVE.
 PORT ST. LUCIE, FLORIDA
 TEL: 561-900-2447
 FAX: 561-274-0222
 E-MAIL: andrew@tecfia.com

HVAC
 PLUMBING
 ELECTRICAL