


BACK
44ft

No fire extinguishers marked on plans.

Provide interior layout of the building.

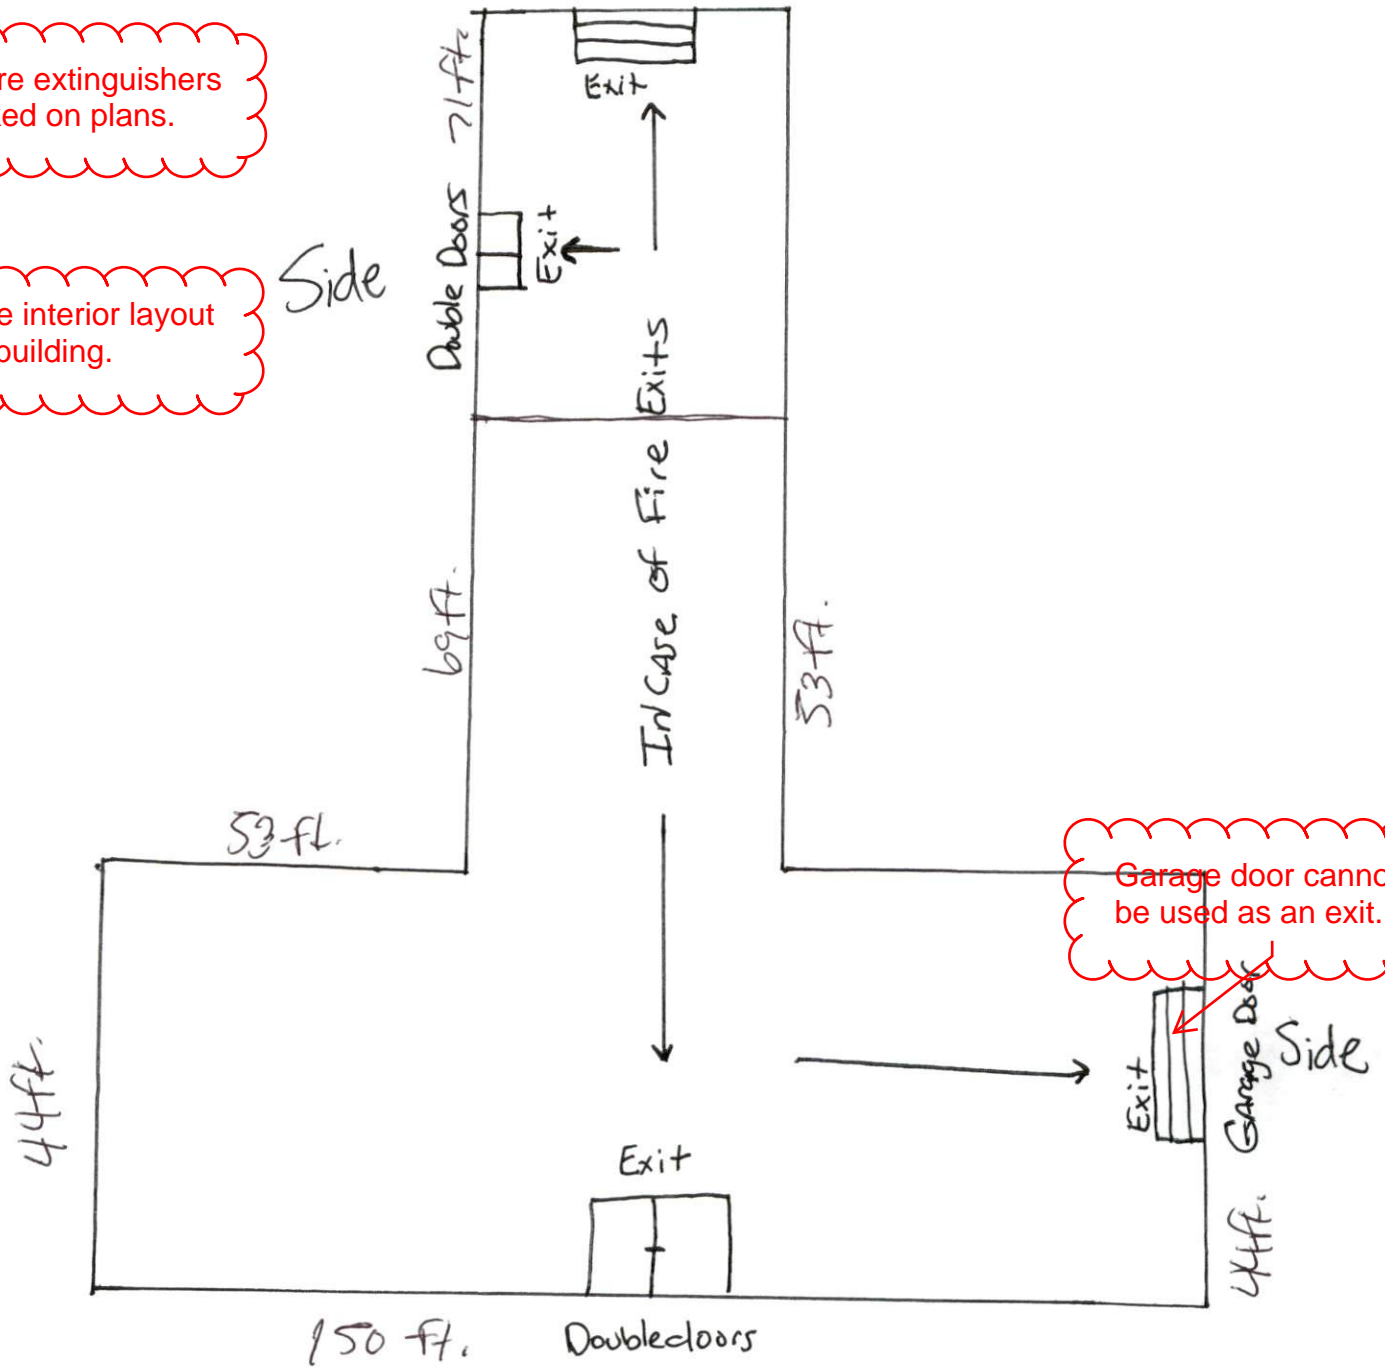

Garage door cannot be used as an exit.

Front