
LDFEC Building Layout

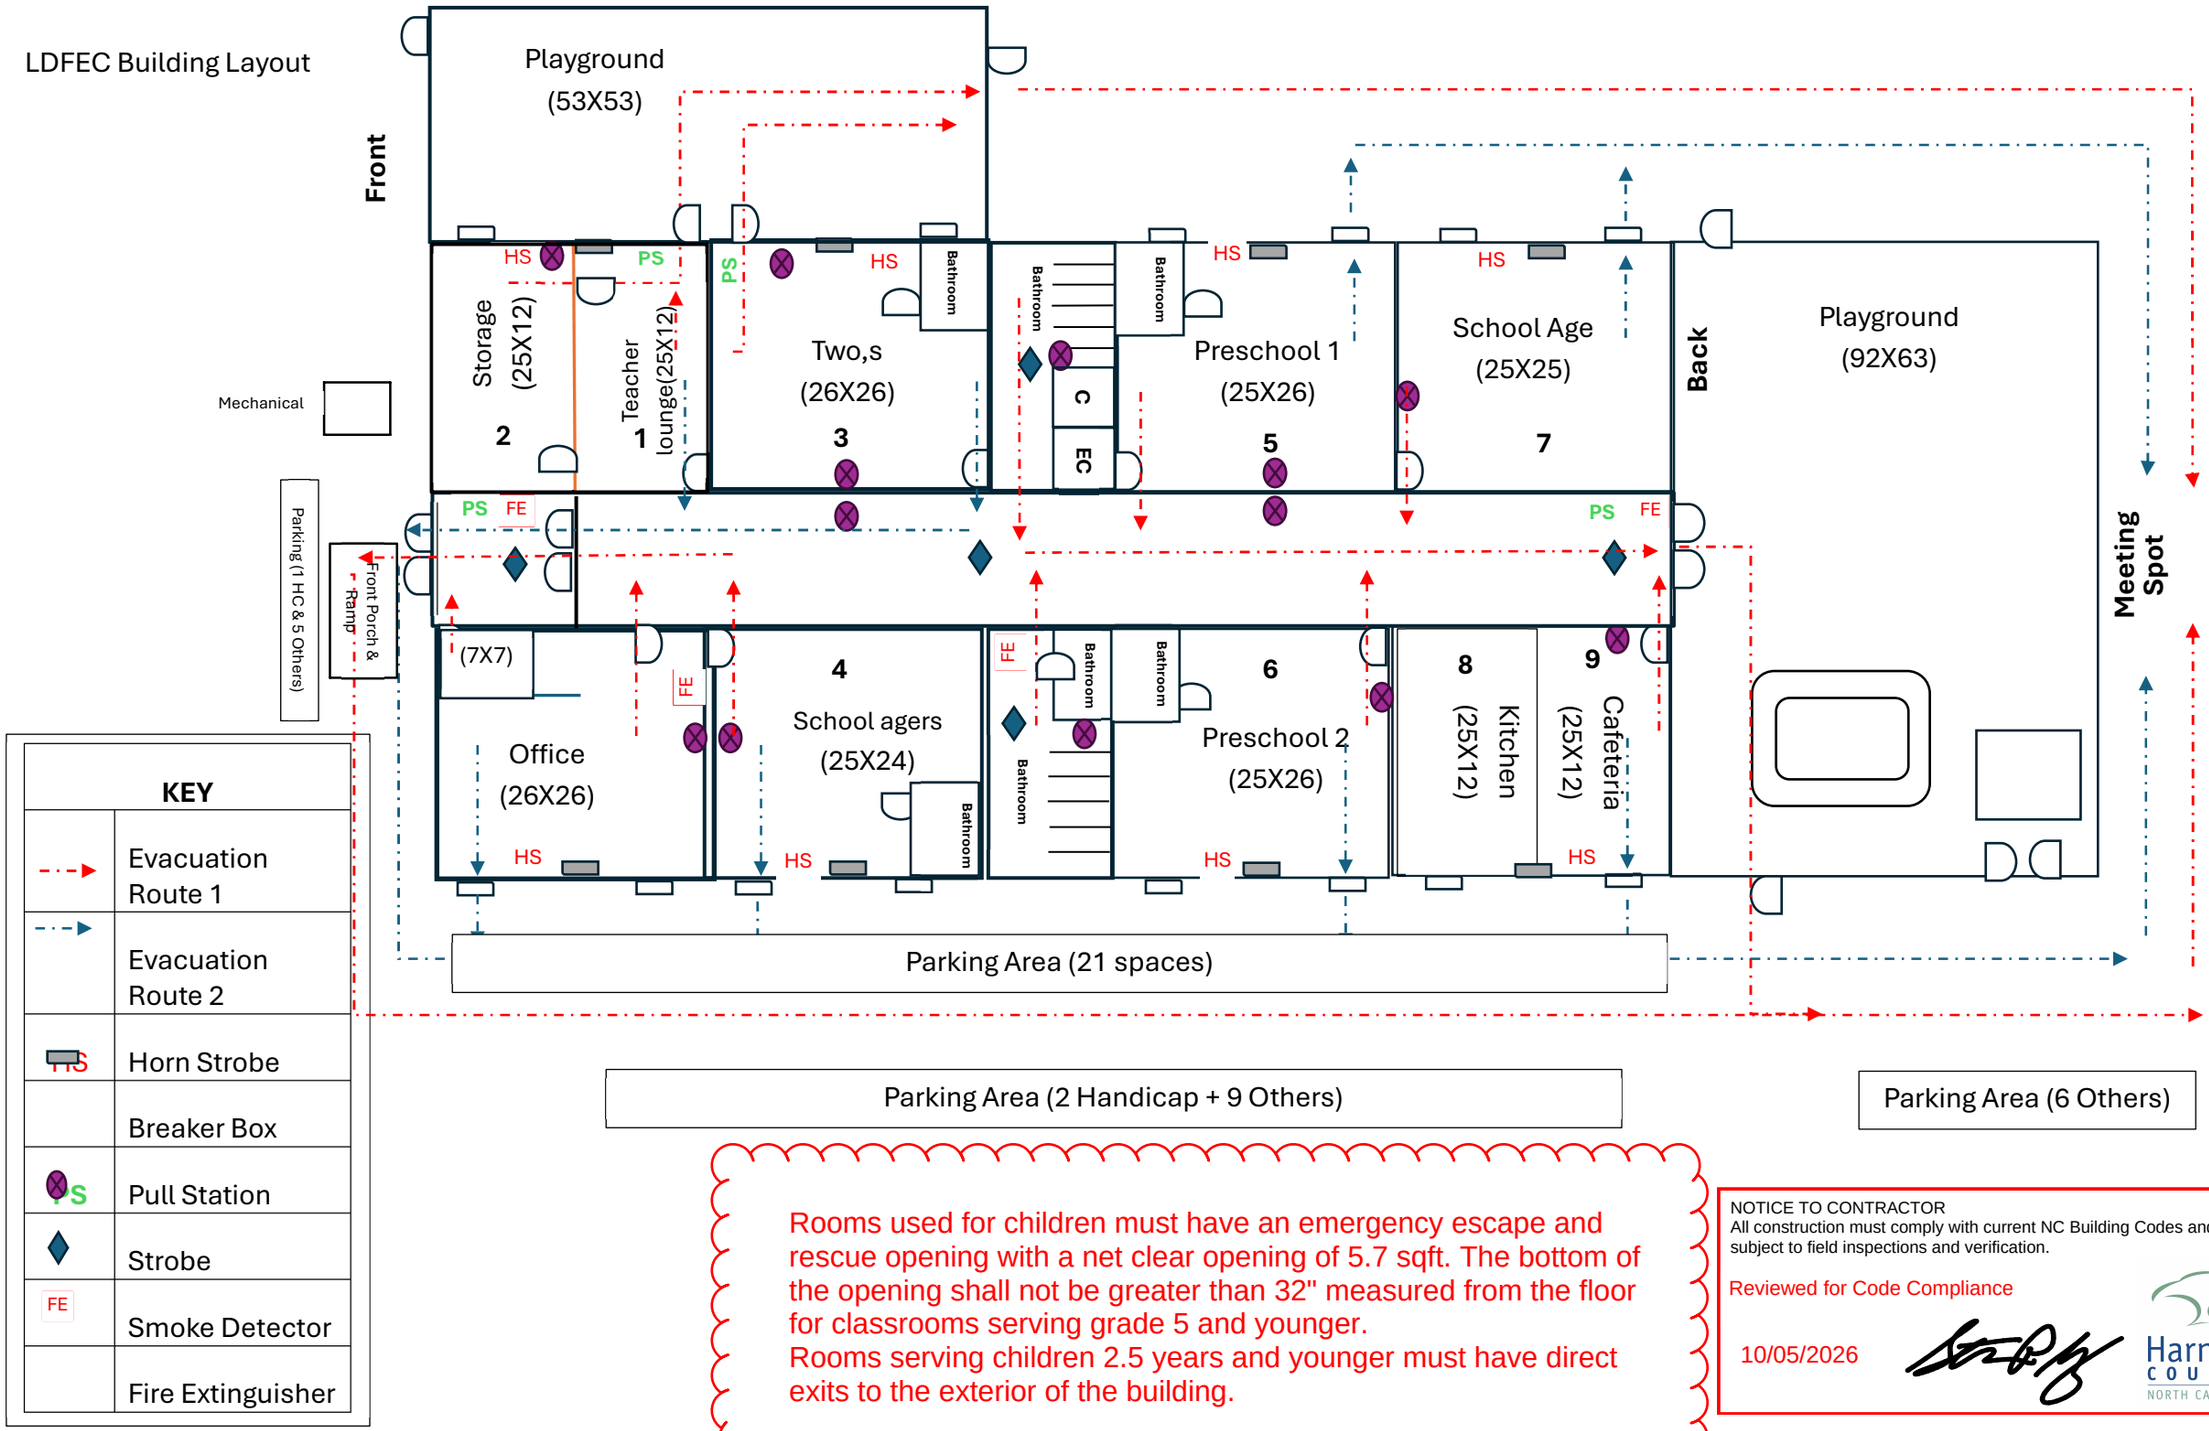

KEY	
	Evacuation Route 1
	Evacuation Route 2
HS	Horn Strobe
	Breaker Box
PS	Pull Station
	Strobe
FE	Smoke Detector
	Fire Extinguisher

Rooms used for children must have an emergency escape and rescue opening with a net clear opening of 5.7 sqft. The bottom of the opening shall not be greater than 32" measured from the floor for classrooms serving grade 5 and younger.
Rooms serving children 2.5 years and younger must have direct exits to the exterior of the building.

NOTICE TO CONTRACTOR
All construction must comply with current NC Building Codes and is subject to field inspections and verification.

Reviewed for Code Compliance

10/05/2026

Harnett COUNTY NORTH CAROLINA