

HTE# 08-5-20159

Harnett County Department of Public Health

20332

PERMIT # 24918

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: TRULOVE RD

Name: (owner) SCOTT LEE HOMES INC

SUBDIVISION JONATHANS RIDGE

LOT # 08

System Installer: BATTEN

Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well 100 feet


System Type: III

Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

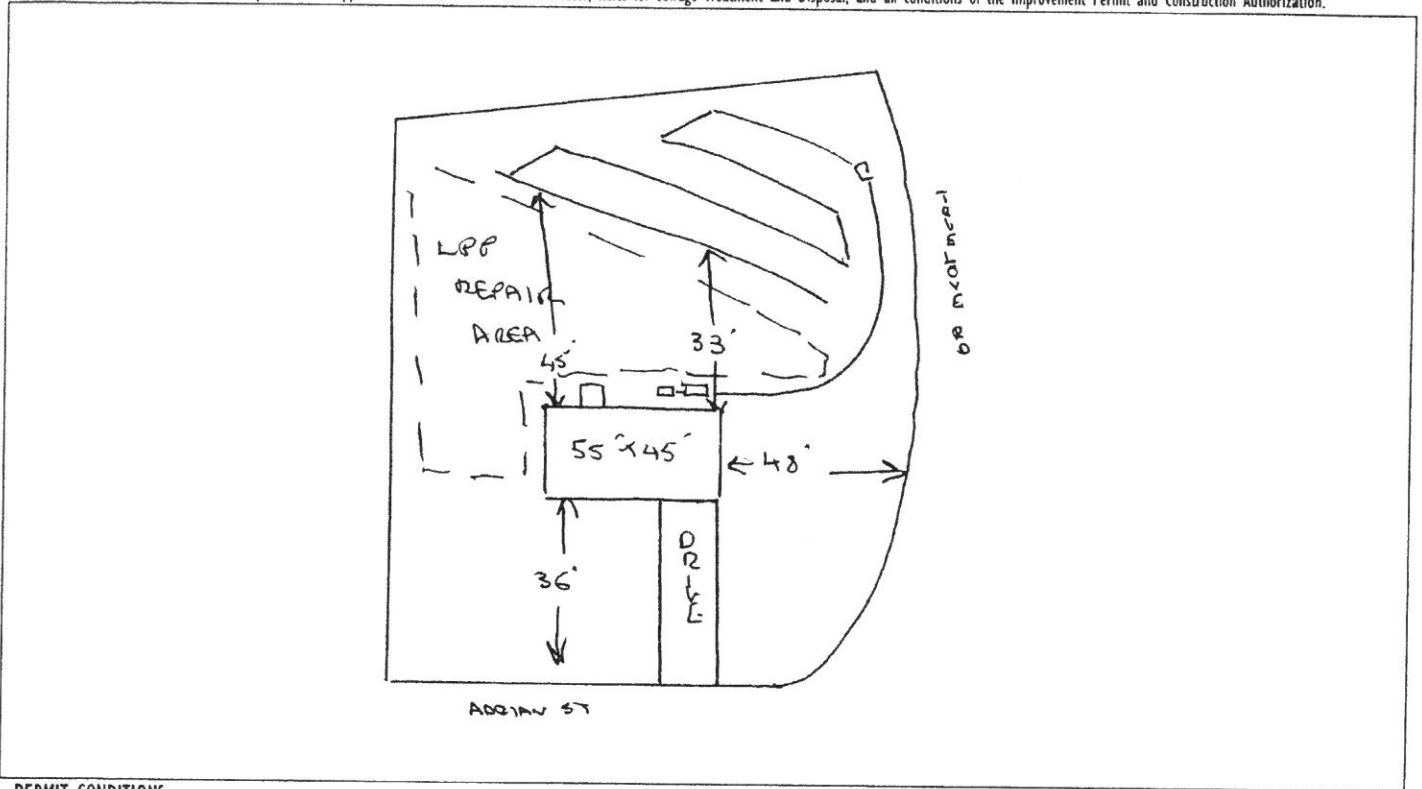

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: FIELD TANKS CHECKED BY OT. PUMP & ALARM STILL TO BE CHECKED
PUMP + ALARM CHECKED ON 11/25/08

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other E2 FLOW Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches _____ of each ditch 300 feet ditches 3 feet ditches 12-17 inches

French Drain Required: _____ Linear feet

Authorized State Agent _____

RS

Date 11/25/08