

HTE# BLED0811-0019

Harnett County Department of Public Health

25329

PERMIT # 30281

Operation Permit

SR 1769

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 135 Tyler Goodwin Rd. (Old Stage Rd S.)

Name: (owner) Craig Burton SUBDIVISION Riverland Ests LOT # 26

System Installer: Reginald Carter Registration # _____

Basement with plumbing: Garage Number of Bedrooms 4


Type of Water Supply: Community Public Well Distance from well NA feet

System Type: 25% Reduction sys. IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

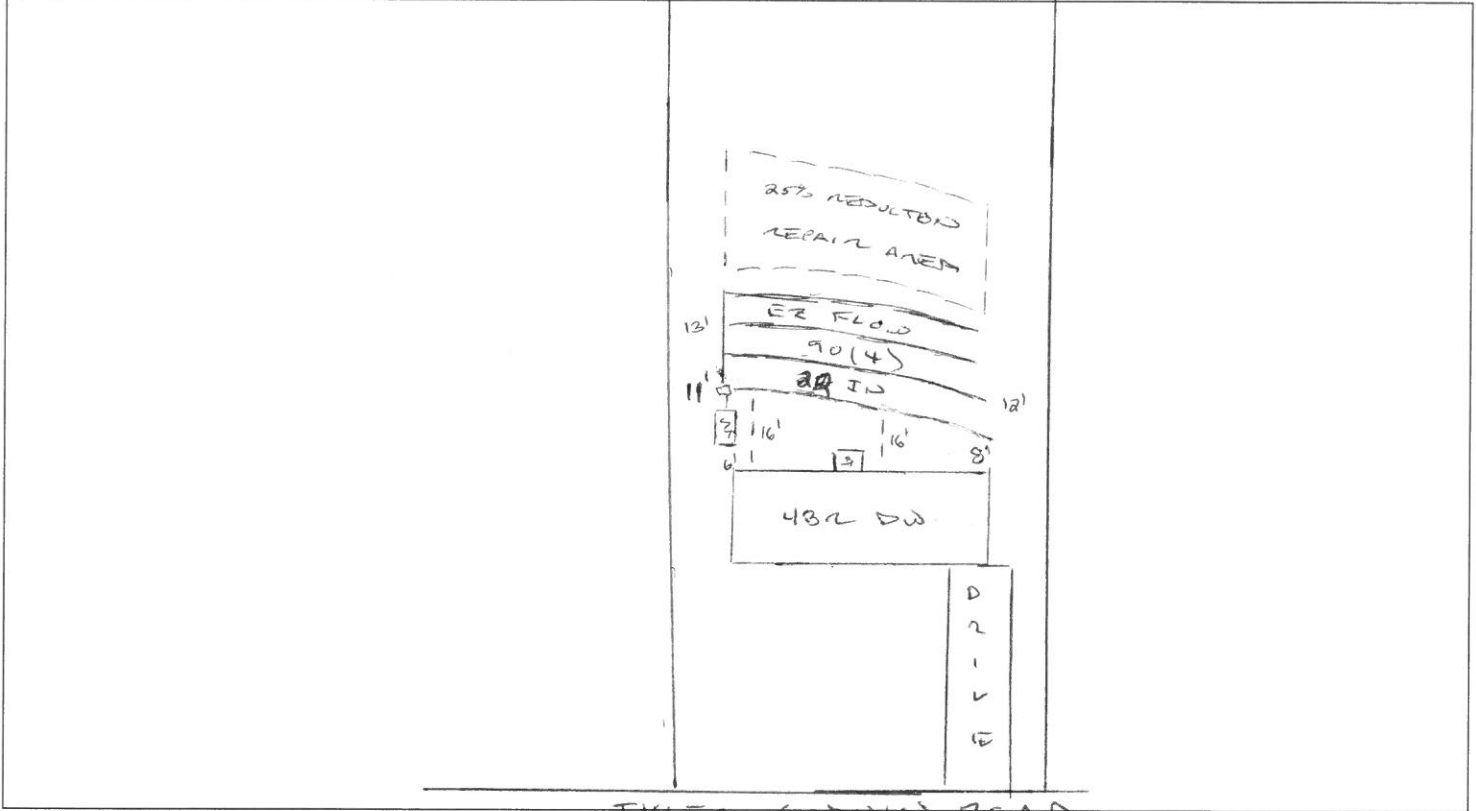

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2Oline PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other EZ Flow IIIg Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 4 of each ditch 90 feet ditches 3 feet ditches 22 inches
 French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 02/07/2019

BR201811-0019

135 Tyler

Godwin Rd.

Riverland Ests Lot 26

