

Improvement Permit

A building permit cannot be issued with only an Improvement Permit

ISSUED TO: HOWARD, Tim & TARA
PROPERTY LOCATION: THOMAS KELLY RD
NEW [X] REPAIR [ ] EXPANSION [ ]
Type of Structure: SFO (30'x40')
Proposed Wastewater System Type: CONVENTIONAL
Projected Daily Flow: 360 GPD
Number of bedrooms: 3 Number of Occupants: 6 max
Basement [X] Yes [ ] No
Pump Required: [ ] Yes [X] No
Type of Water Supply: [ ] Community [ ] Public [X] Well
Distance from well: 100 feet
Permit valid for: [X] Five years [ ] No expiration

Authorized State Agent: [Signature] REHS Date: 7/2/18 SEE ATTACHED SITE SKETCH
The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.

Construction Authorization

(Required for Building Permit)

The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance with the attached system layout.

ISSUED TO: HOWARD, Tim & TARA
PROPERTY LOCATION: THOMAS KELLY RD
Facility Type: SFO (30'x40') [X] New [ ] Expansion [ ] Repair
Basement? [X] Yes [ ] No Basement Fixtures? [X] Yes [ ] No
Type of Wastewater System: CONVENTIONAL (Initial) Wastewater Flow: 360 GPD
(See note below, if applicable [ ])
CONVENTIONAL (Repair)

Installation Requirements/Conditions
Number of trenches: 4
Septic Tank Size: 1090 gallons
Exact length of each trench: 120 feet
Trench Spacing: 9 Feet on Center
Pump Tank Size: \_\_\_\_\_ gallons
Trenches shall be installed on contour at a
Maximum Trench Depth of: 18 inches (Maximum soil cover shall not exceed 36" above the trench bottom)
(Pump Requirements: \_\_\_\_\_ ft. TDH vs. \_\_\_\_\_ GPM)
Aggregate Depth: 6 inches below pipe, 2 inches above pipe, 12 inches total

WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA. NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.

\*\*If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.

Owner/Legal Representative Signature: \_\_\_\_\_ Date: \_\_\_\_\_

This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH

Authorized State Agent: [Signature] REHS Date: 7/2/18
Construction Authorization Expiration Date: 7/2/23


HTE# 18-5-44325

Permit # 30138

# Harnett County Department of Public Health Site Sketch

ISSUED TO: HOWARD, Tim & TARA PROPERTY LOCATOR: THOMAS KELLY RD  
SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

Authorized State Agent: ~~REAS (OLIVER TOLKSDORF)~~ Date: 7/2/17

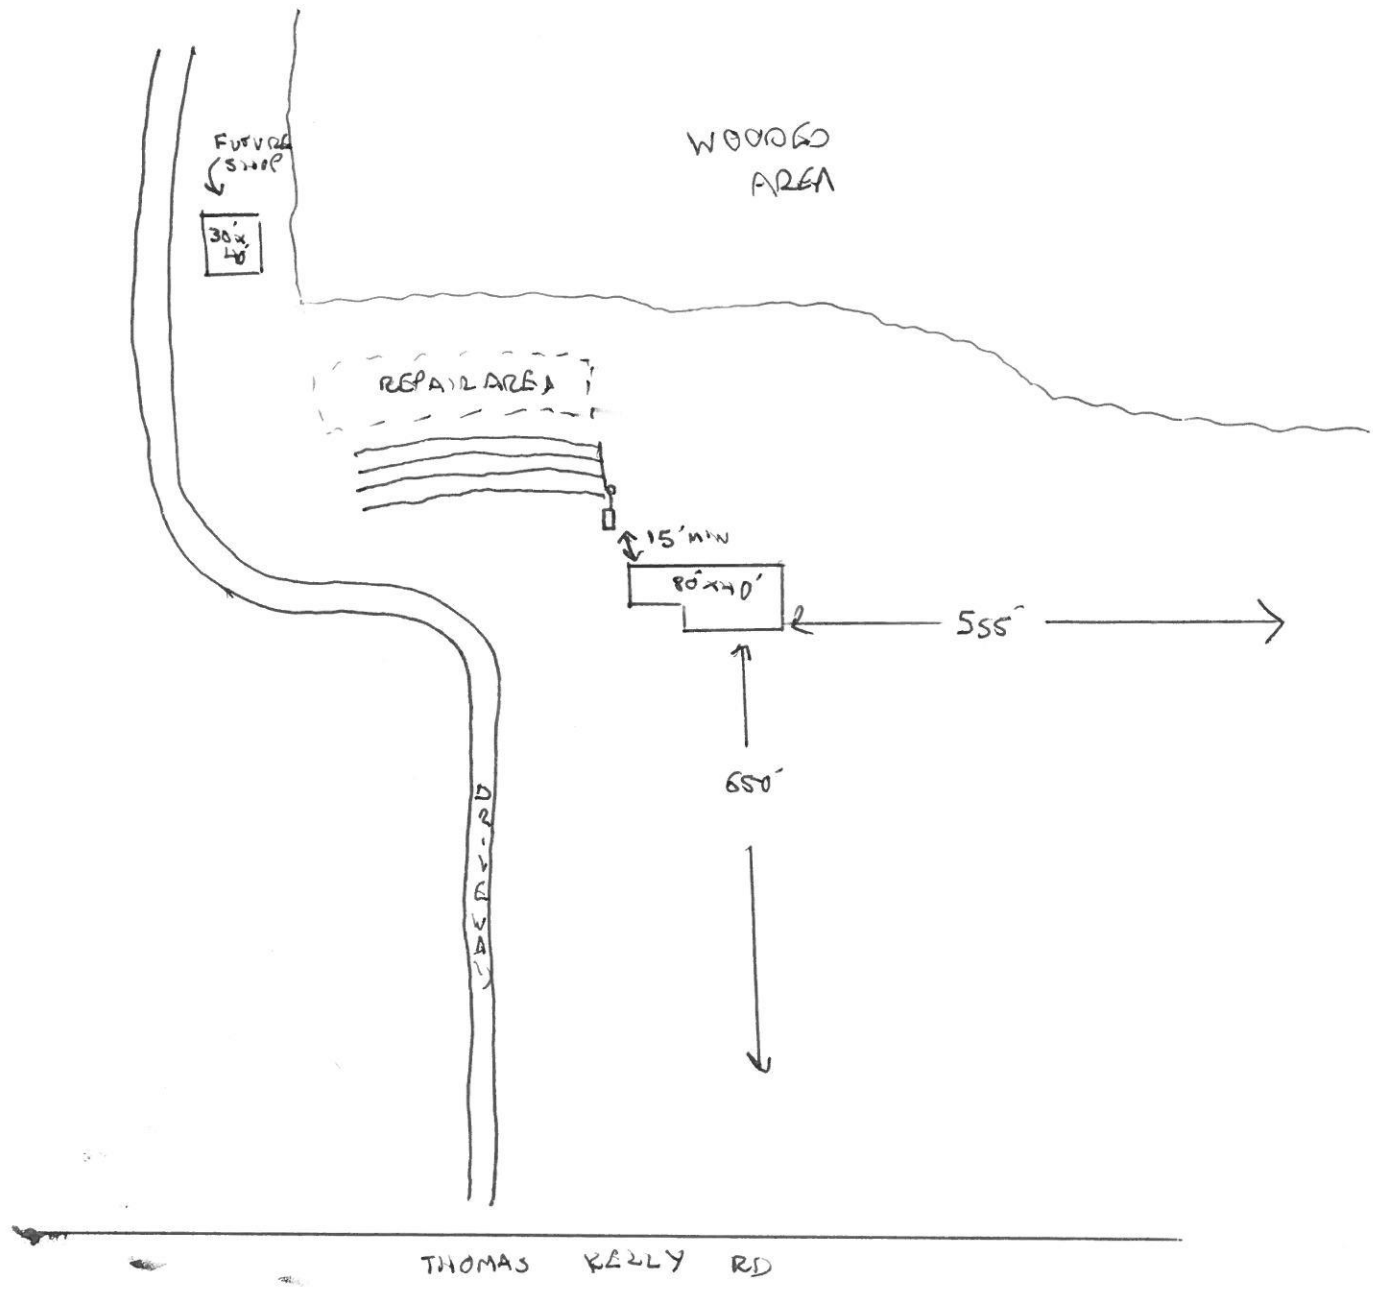

**SOIL/SITE EVALUATION  
 for ON-SITE WASTEWATER SYSTEM**

Owner:                      Applicant:  
 Address:                      Date Evaluated:  
 Proposed Facility: 3 BODM      Design Flow (.1949): 360 GPD  
 Location of Site:                      Property Recorded:  
 Water Supply:                       Public  Individual  Well       Spring       Other  
 Evaluation Method:  Auger Boring       Pit       Cut  
 Type of Wastewater:  Sewage       Industrial Process       Mixed

P R O F I L E #	.1940 Landscape Position/ Slope %	Horizon Depth (In.)	SOIL MORPHOLOGY .1941		OTHER PROFILE FACTORS				Profile Class & LTAR
			.1941 Structure/ Texture	.1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
1	LS 10% 10/10	0-6	G L	VFH NS/MP					
		6-20"	SBK C	FR S/P					
		22-42"	SBK C w/ Pm	FR S/S/P					PS .25
2		0-17	C L	VFH NS/MP					
		17-28"	SBK C	FR S/P					PS .25
		28"	SBK C w/ Pm	FR S/S/P					
3		0-6	G L	VFH NS/MP					
		6-30"	SBK C	FR S/P					
		30"	SBK C w/ Pm	FR S/S/P					

Description	Initial System	Repair System	Other Factors (.1946): Site Classification (.1948): PS Evaluated By: ST Others Present: -
Available Space (.1945)	✓	✓	
System Type(s)	25% P60		
Site LTAR	25	25	

4x120' x 12'