


DH3355

SIDEWALL OPENING (FT)		REQUIRED PIER LOAD (LBS)	
3	1175	4	1330
5	1485	6	1640
8	1950	10	2260

*FOR 30 lb & 40 lb ROOF LOAD REFER TO TABLES 7b & 7c IN THE INSTALLATION MANUAL.

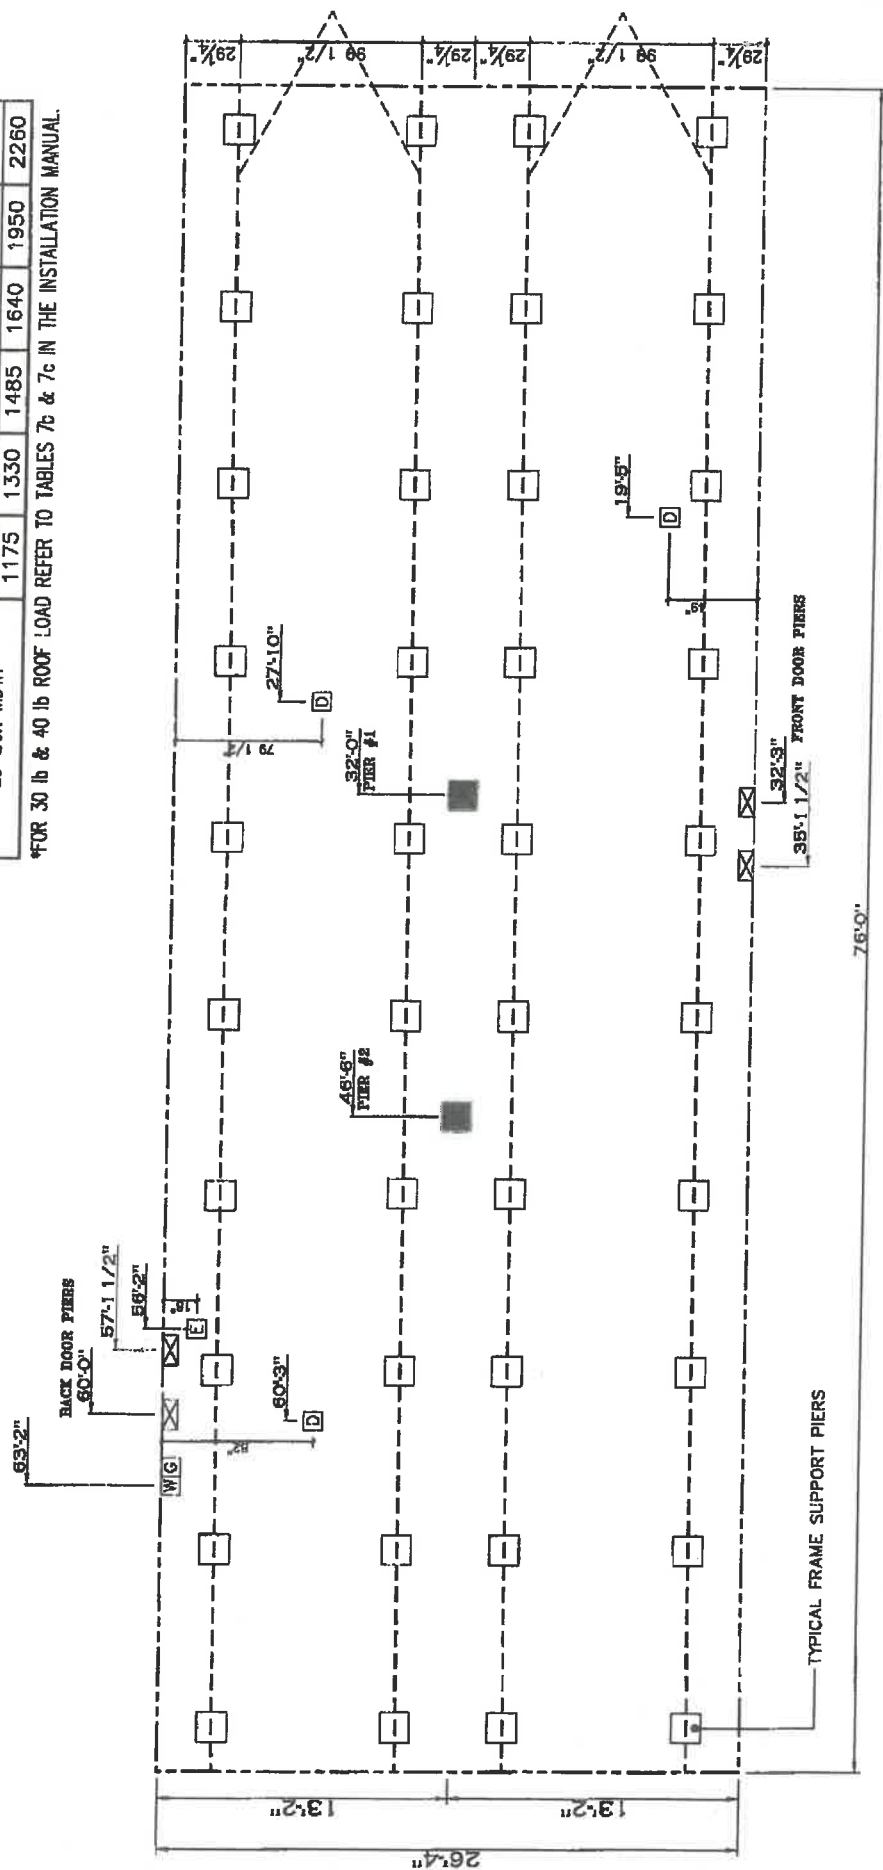

- GENERAL NOTES:
- PIER LOADS SHOWN ARE TO BE USED TO SIZE THE FOOTINGS BELOW THE MARRIAGEWALL FOR COLUMN SUPPORT PIERS. REFER TO TABLES 6b AND 6c IN THE INSTALLATION MANUAL FOR LOAD ON FRAME PIER FOOTINGS FOR HOMES THAT DO NOT REQUIRE PERIMETER BLOCKING. REFER TO TABLES 7b AND 7c IN THE INSTALLATION MANUAL FOR LOAD ON FRAME PIER FOOTINGS THAT REQUIRE PERIMETER BLOCKING. REFER TO TABLES 10 AND 10d TO DETERMINE FOOTING SIZE FOR ALL PIERS.
 - REFER TO TABLE 9 FOR PIER CONFIGURATION AND MAXIMUM ALLOWABLE HEIGHTS. CROSS REFERENCE THE PIER HEIGHT WITH THE MAXIMUM ALLOWABLE FLOOR HEIGHT LISTED IN THE FRAME TIEDOWN CHARTS (TABLE 18, 19, AND 20). FLOOR WIDTH SHOWN IS FOR STANDARD PRODUCT ONLY. CONTACT THE MFG PLANT FOR SPECIFICATIONS OF OPTIONS ORDERED.
 - SERVICE DROP LOCATIONS IDENTIFIED ARE APPROXIMATE. THE MAXIMUM SPACING FOR FRAME SUPPORT PIERS FOR 8" I-BEAMS IS 8 FEET, 10" & 12" I-BEAMS ARE 10 FEET.

PIER LEGEND	
□	SUPPORT UNDER WATING OPENING
■	SUPPORT AT WATING COLUMN
▨	SUPPORT UNDER WATING WALL
■	PIER PORCH/RECESS ENTRY
□	PIER MAIN BEAM
■	PIER PERIMETER
●	IE-DOWN SUPPORT (QTY PER THE MFG DETAIL D-8 OR FOUND. P.C.)

SERVICE DROP LEGEND	
[E]	ELECTRICAL DROP
[W]	WATER INLET
[D]	DWY PLUMBING DRIP
[G]	GAS INLET

Columns	Distances From Each Pier #	Number of Piers	Pier Load (lbs)	Per Unit (Per Ft)
1	32	0	3,054	922
2	46	6	3,054	509

N/A SQ.FT. (W/OPT. PORCH/RECESS "CONDITIONED")
 2,001 SQ.FT. (STD PLAN "CONDITIONED")
 Model # TRU2876SA
 Drawing # TRU-MOOR-76-5
 Product Designer: HarmondB
 Scale: N.T.S.
 TRU HOMES
 28' x 76'

PIER LOADS
 6/27/2018 11:40:23 AM, Hdtngpl