

# Harnett County Department of Public Health

PERMIT # BRES19050052

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 5137 Spring Hill Ch Rd

Name: (owner) THOMAS NASH SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: HAL BROWN


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: VI Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

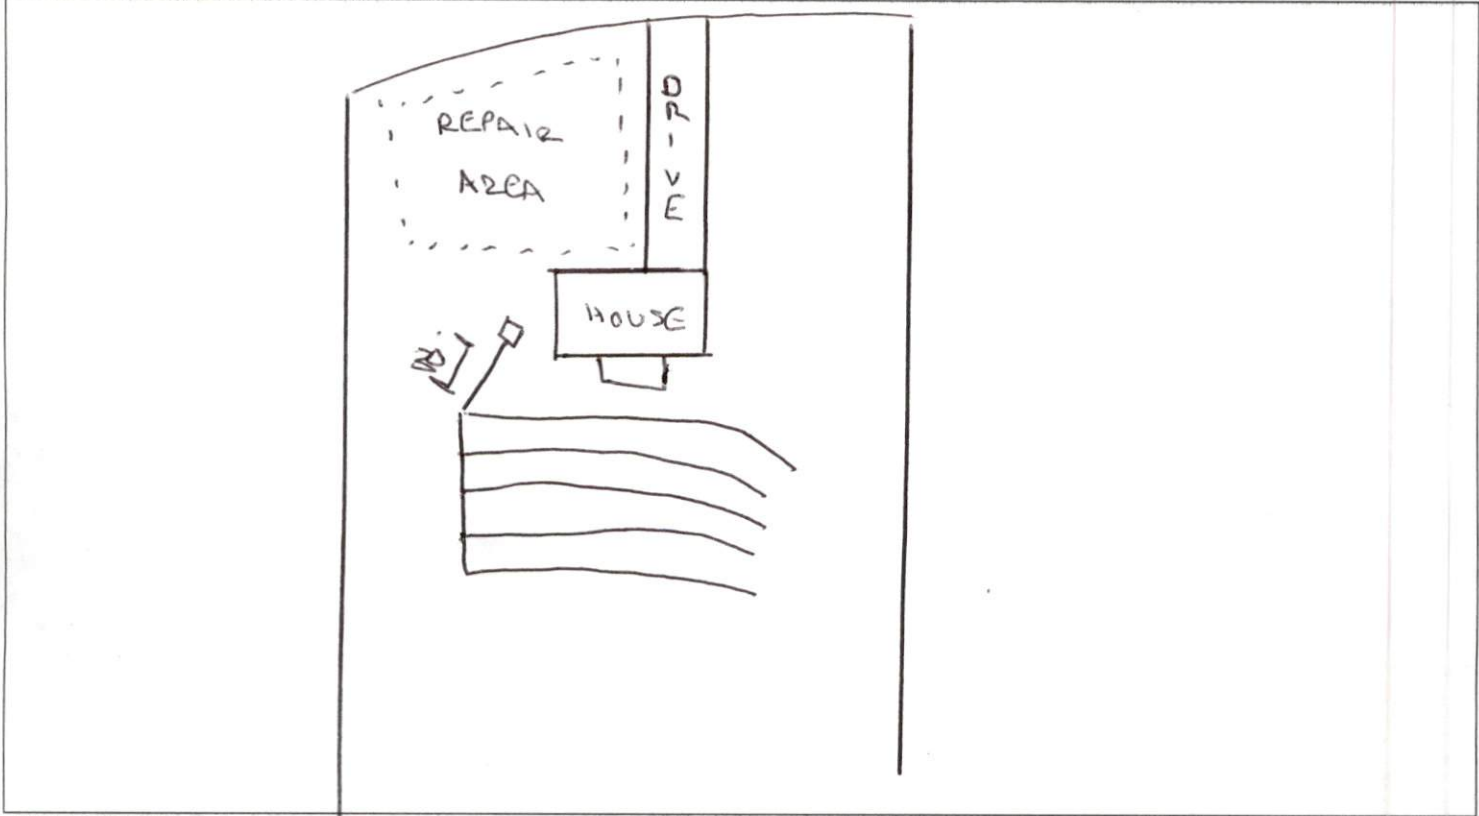

**PERMIT CONDITIONS:**

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes  No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: DWELLING REVISED TO SFD

D-Box    Pump    Alarm    H2O Line    PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other CHAMBER (QUI)   Septic Tank: 1000 gallons   Pump Tank: \_\_\_\_\_ gallons

Subsurface   No. of   exact length   width of   depth of  
 Drainage Field   ditches   of each ditch   ditches   ditches  
1   450 feet   9 feet   12 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] REIMS

Date 8/24/25