







1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC



PROJECT NO:  
DATE: 01-01-2019  
DRAWN BY: KLN  
CHECKED BY: KLN  
REVISION:

SHEET NUMBER  
**S-41-UT**  
SCALE: 1"=1'-0"

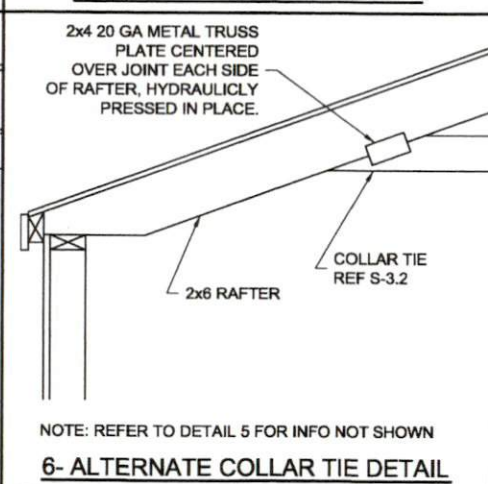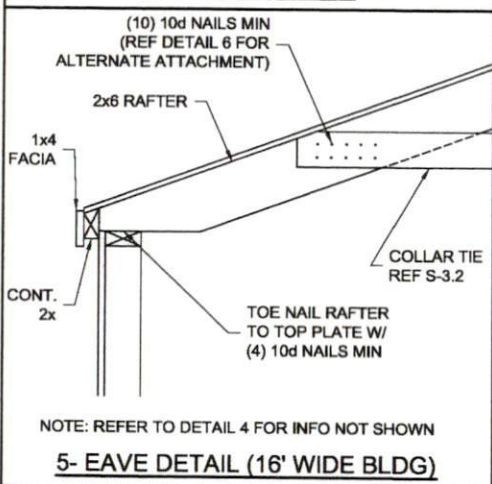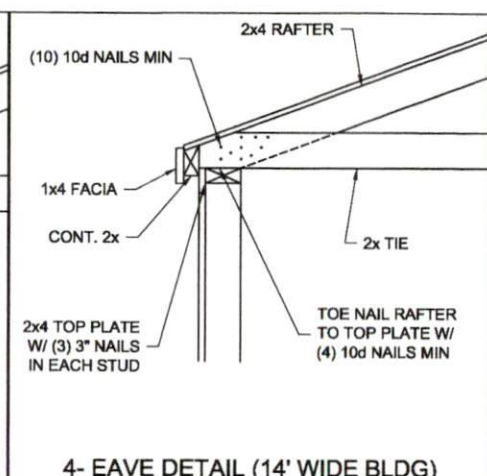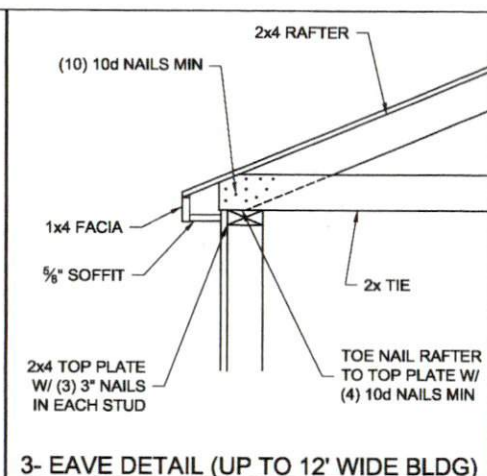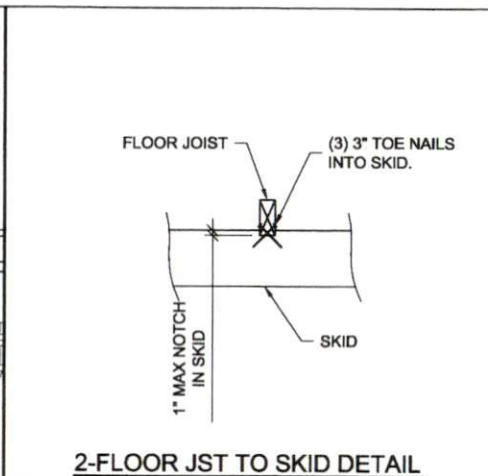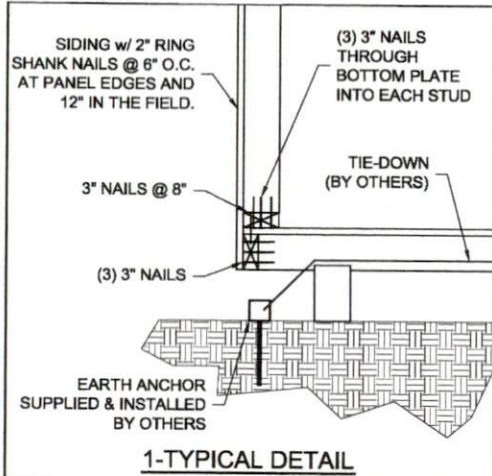

NORTH CAROLINA PROFESSIONAL ENGINEER SEAL 040950 KEVIN L. NOLAN


1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC



PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	

SHEET NUMBER  
**S-4.0-UT**  
SCALE: 1"=1'-0"

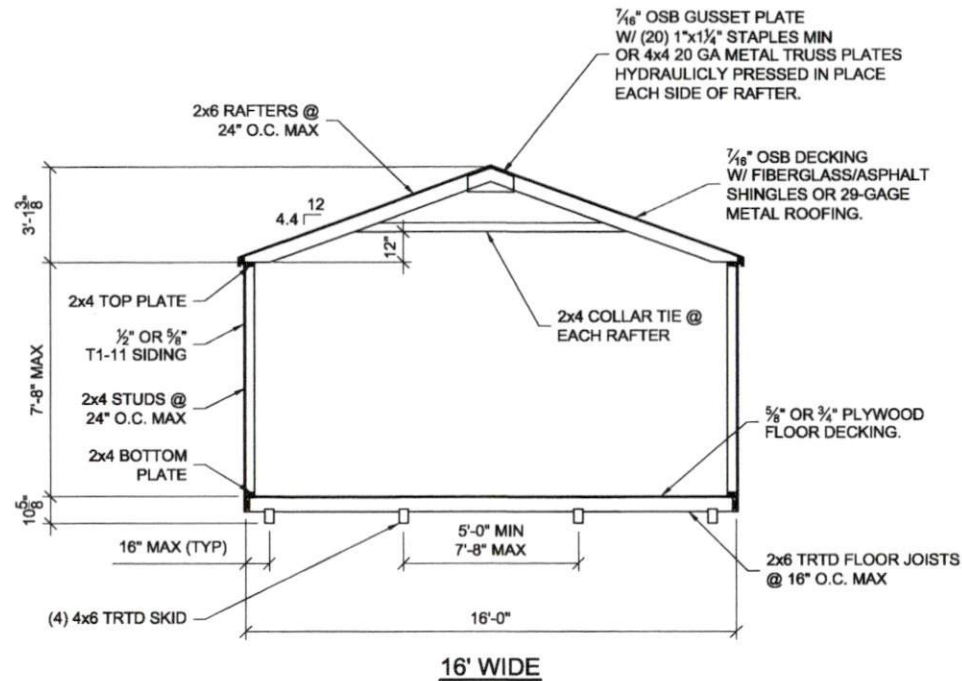

- NOTES: 1. PROVIDE A DOUBLE TOP PLATE ALONG THE SIDE WALLS WHEN THE  
RAFTER SPACING DOES NOT MATCH THE WALL STUD SPACING.  
2. ACTUAL SKID SPACING MAY VARY PROVIDED THAT THE CENTER TO  
CENTER SPACING IS WITHIN THE MAX/MIN SPACING STATED.  
3. 2x6 FRAMING MAY BE SUBSTITUTED FOR THE 2x4 FRAMING SHOWN.  
THE SPACING OF THE 2x6 FRAMING SHALL BE AS SHOWN FOR THE 2x4.

BUILDING SECTIONS





*Kevin L. Nolan*  
1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC




PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	

SHEET NUMBER  
**S-32-UT**  
SCALE: 1/4" = 1'-0"

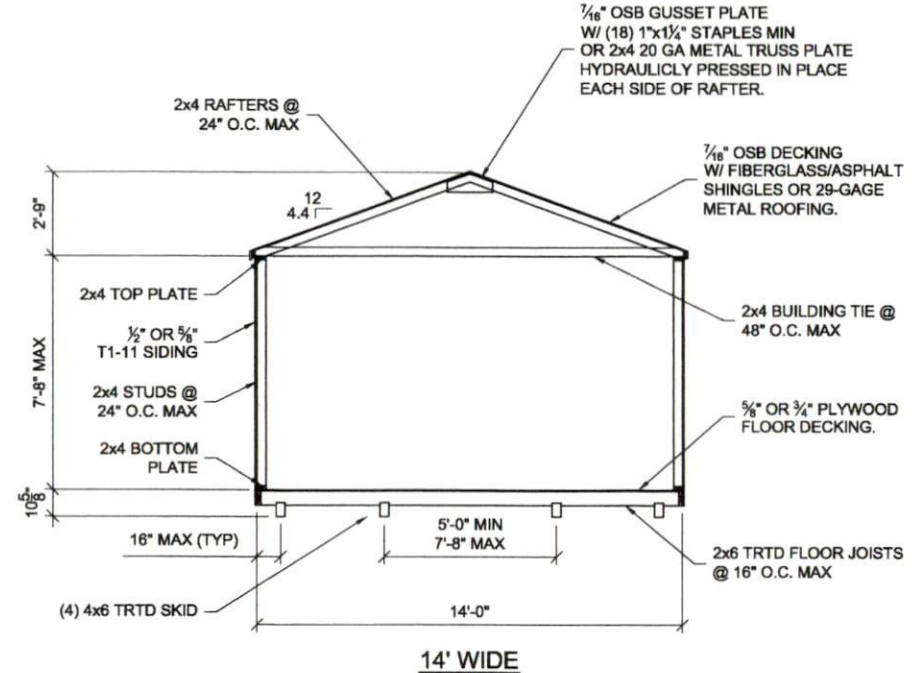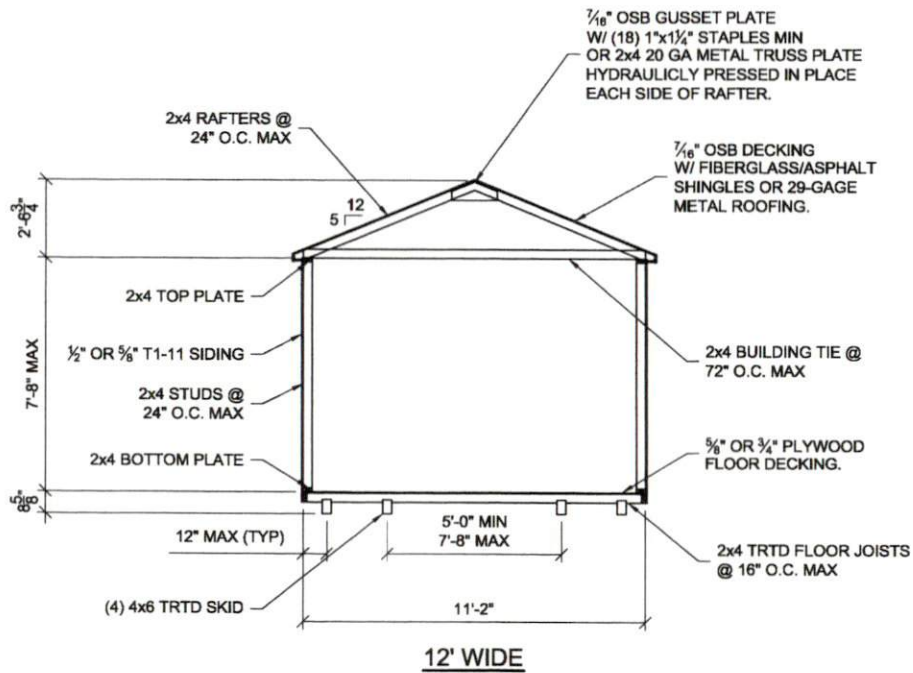

- NOTES: 1. PROVIDE A DOUBLE TOP PLATE ALONG THE SIDE WALLS WHEN THE RAFTER SPACING DOES NOT MATCH THE WALL STUD SPACING.  
 2. ACTUAL SKID SPACING MAY VARY PROVIDED THAT THE CENTER TO CENTER SPACING IS WITHIN THE MAX/MIN SPACING STATED.  
 3. 2x6 FRAMING MAY BE SUBSTITUTED FOR THE 2x4 FRAMING SHOWN. THE SPACING OF THE 2x6 FRAMING SHALL BE AS SHOWN FOR THE 2x4.

**BUILDING SECTIONS**



1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC





PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	

SHEET NUMBER

**S-31-UT**

SCALE: 1/4" = 1'-0"

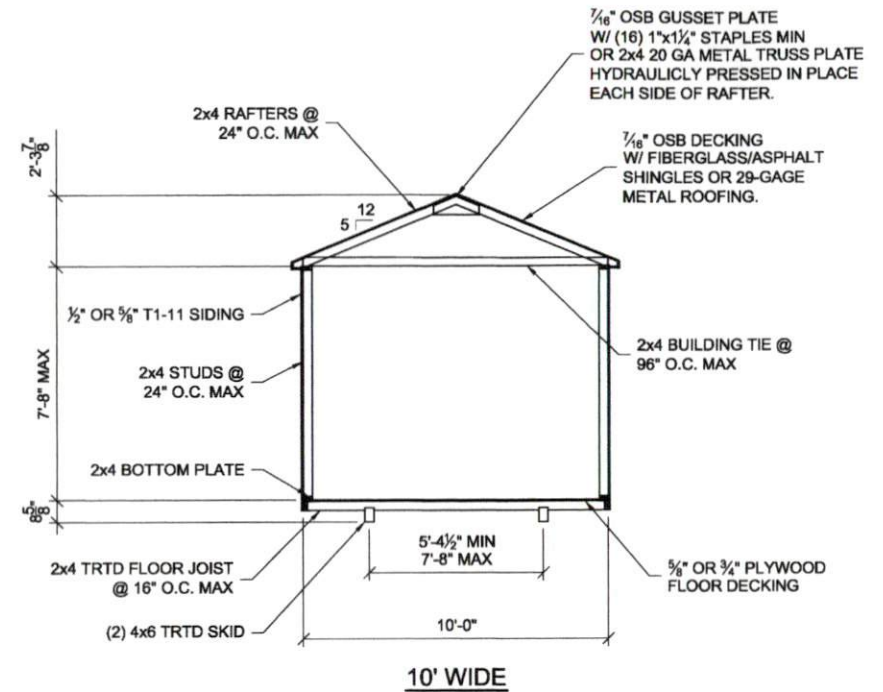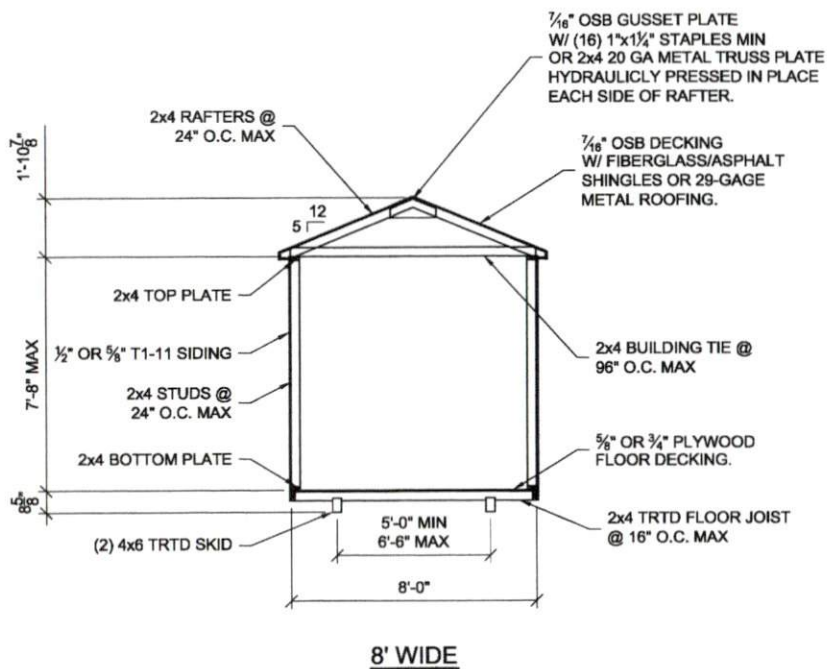

- NOTES: 1. PROVIDE A DOUBLE TOP PLATE ALONG THE SIDE WALLS WHEN THE RAFTER SPACING DOES NOT MATCH THE WALL STUD SPACING.  
 2. ACTUAL SKID SPACING MAY VARY PROVIDED THAT THE CENTER TO CENTER SPACING IS WITHIN THE MAX/MIN SPACING STATED.  
 3. 2x6 FRAMING MAY BE SUBSTITUTED FOR THE 2x4 FRAMING SHOWN. THE SPACING OF THE 2x6 FRAMING SHALL BE AS SHOWN FOR THE 2x4.

**BUILDING SECTIONS**

# UTILITY SHED--NORTH CAROLINA--2018 NCBC



1-1-19



PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	


SHEET NUMBER	<b>S-3.0-UT</b>
SCALE:	1/4" = 1'-0"

### UPLIFT ANCHORAGE SCHEDULE

BLDG LENGTH	8' WIDE BLDGS		10' WIDE BLDGS		12' WIDE BLDGS		14' WIDE BLDGS		16' WIDE BLDGS	
	NUMBER OF TIE-DOWNS	REQ'D ANCHOR CAPACITY	NUMBER OF TIE-DOWNS	REQ'D ANCHOR CAPACITY	NUMBER OF TIE-DOWNS	REQ'D ANCHOR CAPACITY	NUMBER OF TIE-DOWNS	REQ'D ANCHOR CAPACITY	NUMBER OF TIE-DOWNS	REQ'D ANCHOR CAPACITY
10'-0"	2	300#	2	300#	-	-	-	-	-	-
12'-0"	2	400#	2	350#	2	250#	-	-	-	-
14'-0"	2	450#	2	400#	2	300#	2	250#	-	-
16'-0"	2	500#	2	450#	2	300#	2	300#	2	300#
18'-0"	2	550#	2	500#	2	350#	2	300#	2	300#
20'-0"	3	400#	2	550#	2	400#	2	350#	2	350#
22'-0"	-	-	3	400#	2	400#	2	400#	2	400#
24'-0"	-	-	3	450#	2	450#	2	400#	2	400#
26'-0"	-	-	3	500#	2	500#	2	450#	2	450#
28'-0"	-	-	3	550#	2	550#	2	500#	2	500#
30'-0"	-	-	3	550#	3	400#	3	350#	3	350#
32'-0"	-	-	-	-	3	400#	3	400#	3	400#
34'-0"	-	-	-	-	3	450#	3	400#	3	400#
36'-0"	-	-	-	-	3	450#	3	400#	3	400#
38'-0"	-	-	-	-	3	500#	3	450#	3	450#
40'-0"	-	-	-	-	3	500#	3	450#	3	450#
42'-0"	-	-	-	-	-	-	-	-	3	500#
44'-0"	-	-	-	-	-	-	-	-	3	500#

**NOTES:**

- 1) TIE-DOWNS AND EARTH ANCHORS ARE TO BE SUPPLIED AND INSTALLED BY THE CUSTOMER. OLD HICKORY BUILDINGS IS NOT RESPONSIBLE FOR THE TIE-DOWN SYSTEM. REFER TO NOTE SHEET S-0.
- 2) THE SCHEDULE INDICATES THE RECOMMENDED NUMBER OF BUILDING TIE-DOWNS TO BE INSTALLED BY THE CUSTOMER. EACH TIE-DOWN HAS TWO EARTH ANCHORS. EACH EARTH ANCHOR IS TO BE RATED FOR AT LEAST THE CAPACITY SHOWN IN THE SCHEDULE.
- 3) AT A MINIMUM, PROVIDE A TIE-DOWN NEAR EACH END OF THE BUILDING. REMAINING TIE-DOWNS (IF REQUIRED) SHOULD BE EVENLY SPACED ALONG THE ENTIRE LENGTH OF BUILDING.

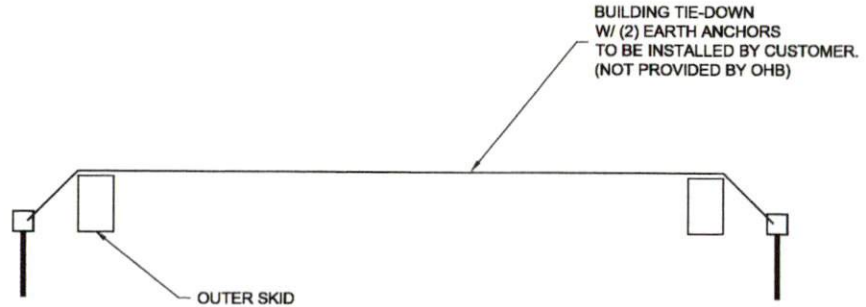

1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC




PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	

SHEET NUMBER

## S-2-UT

SCALE: NONE

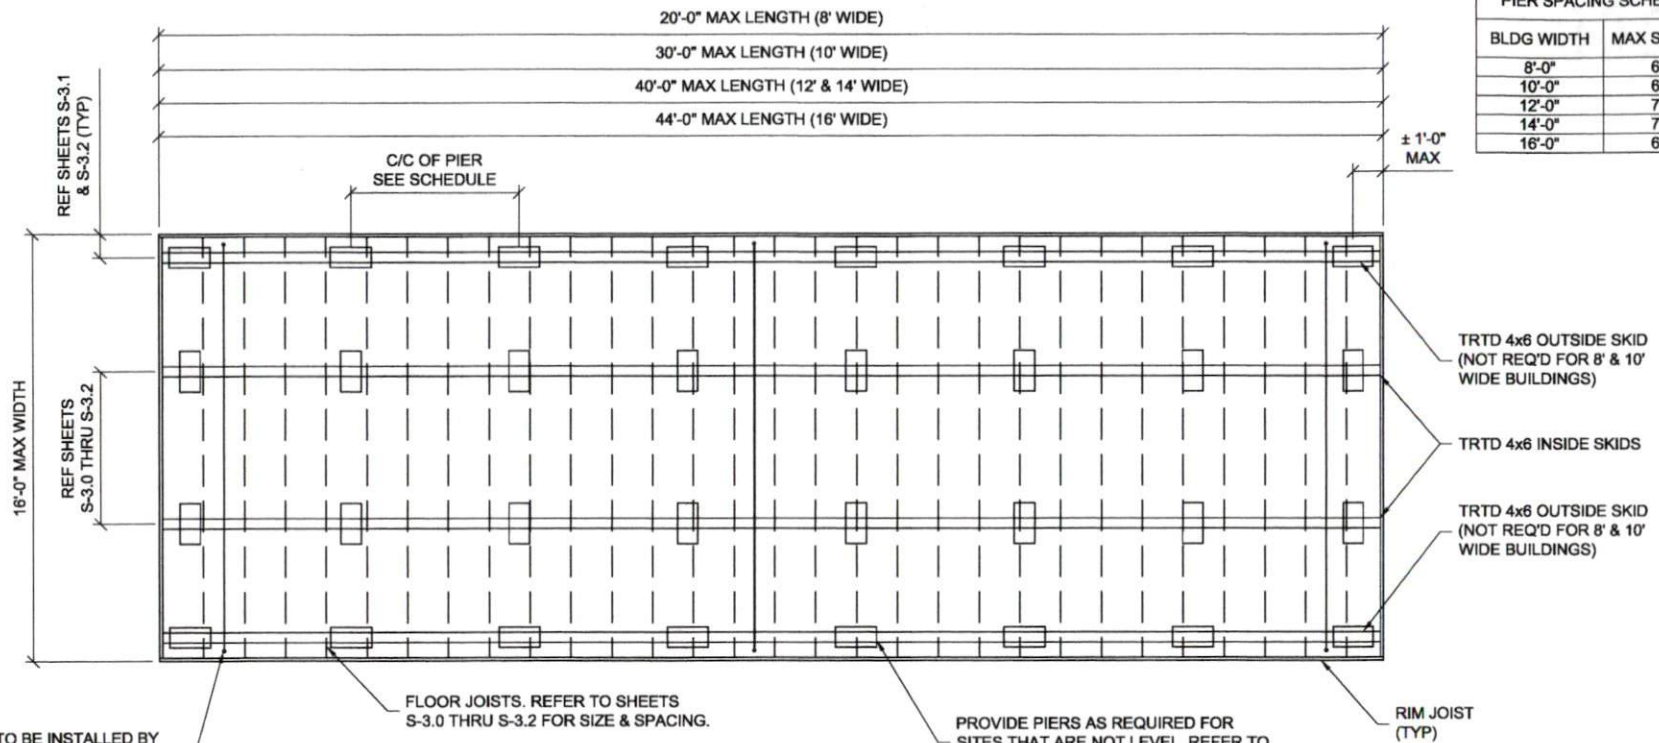

PIER SPACING SCHEDULE	
BLDG WIDTH	MAX SPACING
8'-0"	6'-0"
10'-0"	6'-0"
12'-0"	7'-0"
14'-0"	7'-0"
16'-0"	6'-0"

BUILDING TIE-DOWN TO BE INSTALLED BY THE CUSTOMER. REFER TO NOTES ON S-0. THE QUANTITY OF TIE-DOWNS SHOWN ON THIS PLAN ARE CONCEPTUAL AND MAY NOT REFLECT THE ACTUAL REQUIRED QUANTITY. SEE THE SCHEDULE ON SHEET S-2 FOR THE REQUIRED TIE-DOWN QUANTITY AND LOAD RATING BASED ON THE BUILDING LENGTH (TYP)

**FLOOR FRAMING PLAN**

**UTILITY SHED--NORTH CAROLINA--2018 NCBC**



1-1-19



PROJECT NO:  
 DATE: 01-01-2019  
 DRAWN BY: KLN  
 CHECKED BY: KLN  
 REVISION:

SHEET NUMBER  
**S-1-UT**  
 SCALE: NOT TO SCALE

**OLD HICKORY BUILDINGS, LLC**  
P.O. BOX 331973  
MURFREESBORO, TN 37133

**GENERAL NOTES:**

1. STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH THE 2018 NORTH CAROLINA RESIDENTIAL CODE (NCRC) AND THE 2018 NORTH CAROLINA BUILDING CODE (NCBC).
2. ALL MATERIALS AND CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE ABOVE CODES AT THE TIME OF MANUFACTURE.
3. DRAWINGS SHALL NOT BE SCALED FOR DIMENSIONS.
4. STRUCTURES ARE CLASSIFIED AS "MINOR STORAGE FACILITIES" (RISK CATEGORY I) AND SHOULD NOT BE USED FOR HUMAN HABITATION.
5. STRUCTURES ARE DESIGNED FOR LOCATIONS THAT HAVE A 3 SECOND WIND GUST OF 105 MPH FOR RISK CATEGORY I STRUCTURES PER NCBC FIGURE 1609.3(3) AND ASCE 7-10 FIGURE 26.5-1C. STRUCTURES SHOULD NOT BE USED IN OTHER LOCATIONS.
6. SIDING FASTENERS SHALL NOT BE INSTALLED IN PANEL SIDING GROOVES IN THE FIELD OF THE PANEL OR WHEN THE SIDING GROOVES OCCUR AT CUT EDGES OF THE SIDING PANEL.
7. STRUCTURES ARE DESIGNED FOR LOCATIONS THAT HAVE A MAXIMUM GROUND SNOW LOAD OF 20 PSF AND A PARTIALLY EXPOSED TERRAIN CATEGORY AND SHOULD NOT BE USED IN OTHER LOCATIONS.
8. STRUCTURES SHOULD HAVE 25 YEAR RATED FIBERGLASS/ ASPHALT SHINGLES OR 29 GA METAL ROOFING OVER WOOD SHEATHING.

9. WOOD FRAMING SHALL COMPLY WITH THE ANSI/AWC "NATIONAL DESIGN SPECIFICATION (NDS) FOR WOOD CONSTRUCTION", 2015.
10. ALL ROOF DECKING IS TO BE 7/8" O.S.B.
11. ALL SIDING IS TO BE 1/2" or 5/8" TREATED T1-11 PLYWOOD.
12. ALL FLOOR JOISTS ARE TO BE PRESSURE TREATED SYP #2, OR BETTER, UNLESS NOTED OTHERWISE. FLOOR JOISTS FOR 10' WIDE BUILDINGS ARE TO BE SYP #1, OR BETTER.
13. ALL UN-TREATED WOOD FRAMING IS TO BE TO BE SPF #2 OR BETTER.
14. ALL EXTERIOR NAILS ARE TO BE ZINC COATED.
15. ALL FLOOR DECKING IS TO BE 5/8" OR 3/4" PLYWOOD.
16. ALL SKIDS ARE TO BE 4x6 PRESSURE TREATED, RATED FOR GROUND CONTACT.

**ITEMS BY OTHERS:**

THE FOLLOWING ITEMS ARE TO BE SUPPLIED AND INSTALLED BY OTHERS. THESE ITEMS MAY BE SUBJECT TO LOCAL JURISDICTION APPROVAL. OLD HICKORY BUILDINGS IS NOT RESPONSIBLE FOR THESE ITEMS.

1. THE COMPLETE FOUNDATION AND TIE-DOWN SYSTEM
2. RAMPS, STAIRS, AND GENERAL ACCESS
3. ELECTRICAL SERVICE HOOKUP

**DESIGN CRITERIA:**

1. RISK CATEGORY I
2. FLOOR LIVE LOAD: 40 PSF
3. ROOF LIVE LOAD: 20 PSF
4. ROOF SNOW LOADS:  
GROUND SNOW LOAD, P<sub>g</sub> = 20 PSF  
FLAT ROOF SNOW LOAD, P<sub>f</sub> = 16 PSF  
EXPOSURE FACTOR, C<sub>e</sub> = 1.0  
IMPORTANCE FACTOR, I = 0.8  
THERMAL FACTOR, C<sub>t</sub> = 1.2
5. WIND LOADS ARE BASED ON THE FOLLOWING:  
DESIGN WIND SPEED: V = 105 MPH  
RISK CATEGORY I  
EXPOSURE CATEGORY B  
INTERNAL PRESSURE COEFFICIENT:  
G<sub>Cpi</sub> = ±0.18  
COMPONENTS & CLADDING:  
ROOF-ZONE 1 = 10.0, -10.9 PSF  
ROOF-ZONE 2 = 10.0, -19.0 PSF  
ROOF-ZONE 3 = 10.0, -28.0 PSF  
WALL-ZONE 4 = 11.9, -12.9 PSF  
WALL-ZONE 5 = 11.9, -15.4 PSF

NOTE: C&C WIND PRESSURES SHOWN ARE FOR A 10 SQUARE FOOT EFFECTIVE AREA (A<sub>e</sub>) AND MAY BE REDUCED FOR LARGER AREAS AS ALLOWED BY CODE.

**PIERS (IF REQUIRED):**

1. PIERS ARE NOT REQUIRED WHEN THE SKIDS CAN BE SUPPORTED ON FIRM, LEVEL GROUND. PIERS ALONG INTERIOR SKIDS SHALL BE ORIENTED WITH THE LONG SIDE PERPENDICULAR TO THE SKID. PIERS ALONG THE OUTSIDE SKIDS OF BUILDINGS WITH 4 SKIDS ARE PERMITTED TO BE ORIENTED WITH THE LONG SIDE PARALLEL TO THE SKID PROVIDED THAT THE PIERS ALONG THE INTERIOR SKID ARE ORIENTED PERPENDICULAR TO THE SKID.
2. PIERS SHALL TYPICALLY BE 8"x8"x16" OPEN CELL OR SOLID CONCRETE BLOCKS, DRY STACKED TO A MAXIMUM HEIGHT OF 36". THE BLOCK IN CONTACT WITH THE GROUND AT EACH PIER SHALL BE A 4"x8"x16" SOLID BLOCK. OPEN CELL BLOCKS AND 2" THICK SOLID BLOCKS ARE NOT TO BE USED AS THE BASE OF ANY PIERS. OPEN CELL BLOCKS ARE TO BE PLACED ON TOP OF SOLID BLOCKS AS NEEDED WITH THE OPEN CELLS RUNNING VERTICALLY AND MUST NOT BE PLACED ON THEIR SIDE.  
  
CORNER PIERS OVER 20" TALL SHALL BE DOUBLE STACKED CONCRETE BLOCKS. TIE DOUBLE STACKED BLOCKS BY ALTERNATING THE DIRECTION OF BLOCKS ON EACH ROW.
3. OLD HICKORY BUILDINGS IS NOT RESPONSIBLE FOR THE PREPARATION OF THE PROPOSED SITE OR DETERMINATION OF THE SITE'S SUITABILITY TO SUPPORT THE PROPOSED STRUCTURE. IT IS THE PROPERTY OWNER'S RESPONSIBILITY TO DETERMINE IF SITE CONDITIONS ARE SUITABLE TO SUPPORT THE STRUCTURE.
4. PIERS SHOWN ON SHEET S-1 ARE CONCEPTUAL AND MAY NOT REFLECT ACTUAL CONDITIONS. THE PIER LAYOUT MAY BE ADJUSTED AS NEEDED BASED ON SITE CONDITIONS, PROVIDED THAT THE MAXIMUM SPACING SHOWN IS NOT EXCEEDED.



1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC








PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	

SHEET NUMBER

S-0-UT

SCALE: NONE



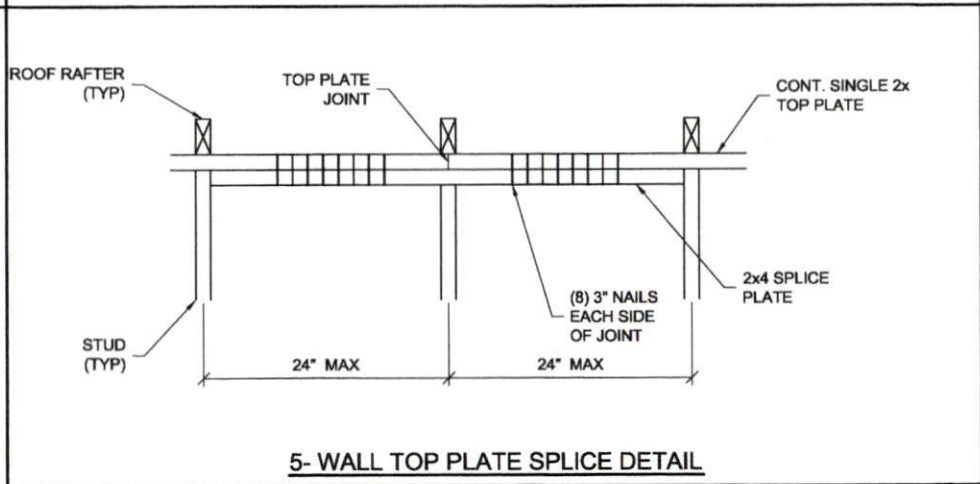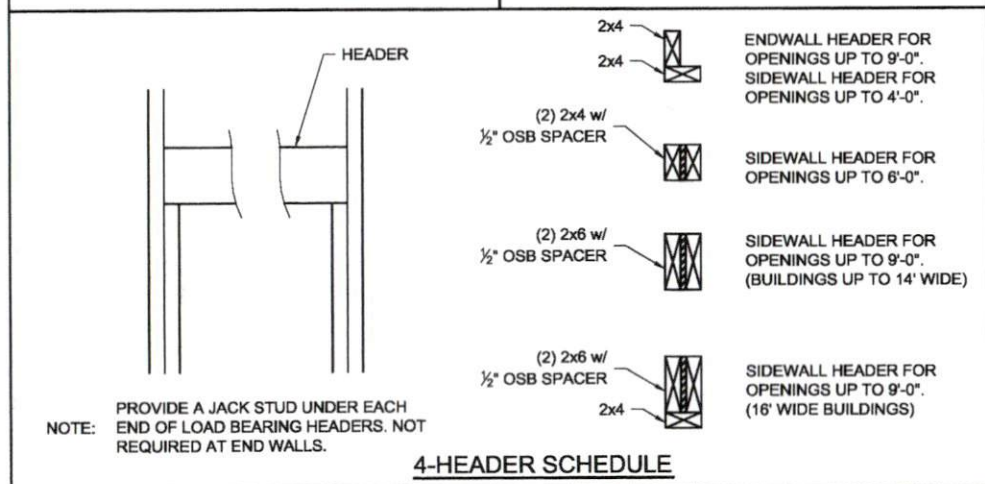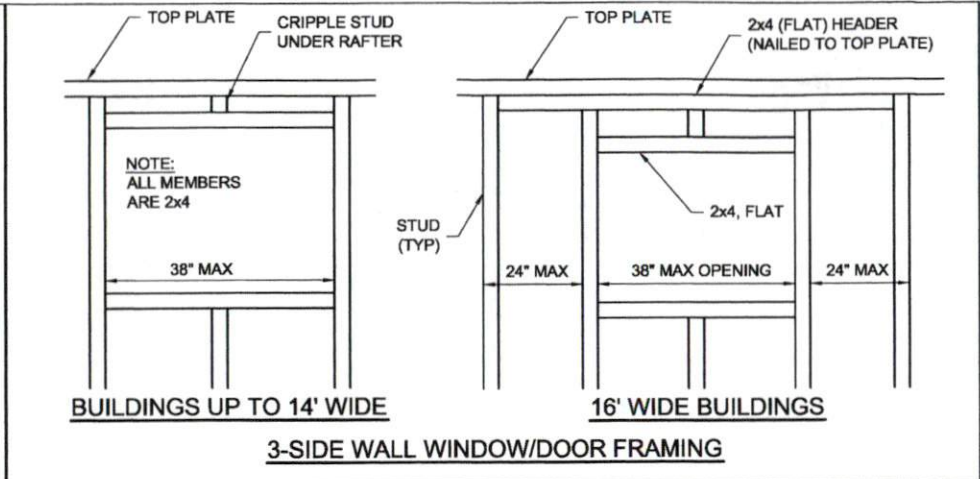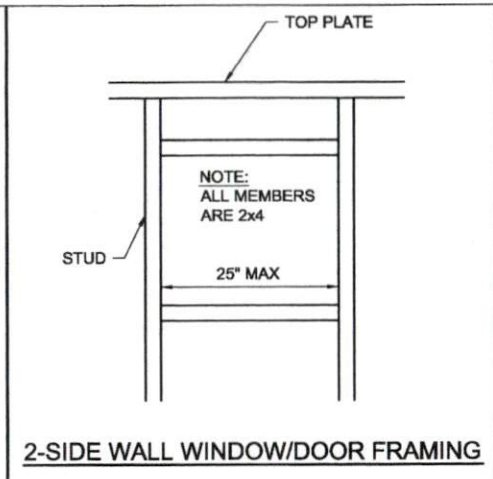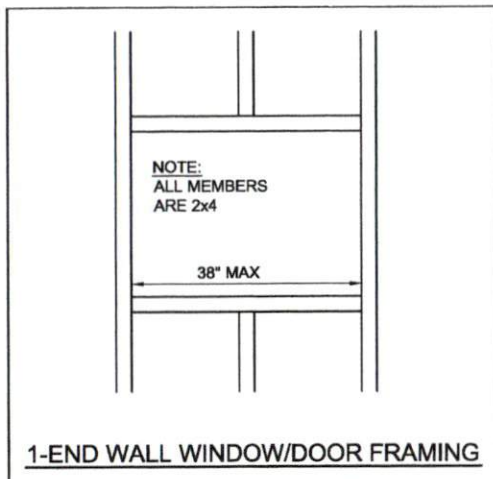







1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC



PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	

SHEET NUMBER	<b>S-41-UT</b>
SCALE:	1"=1'-0

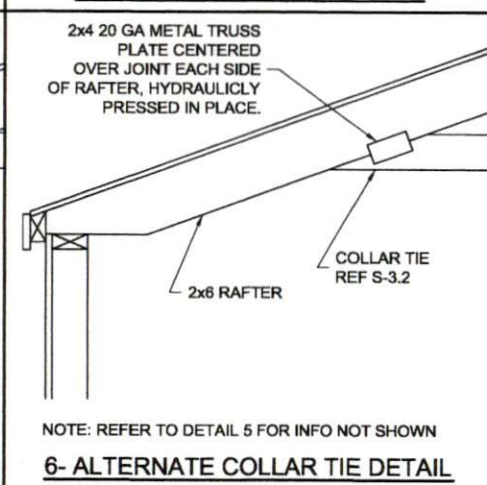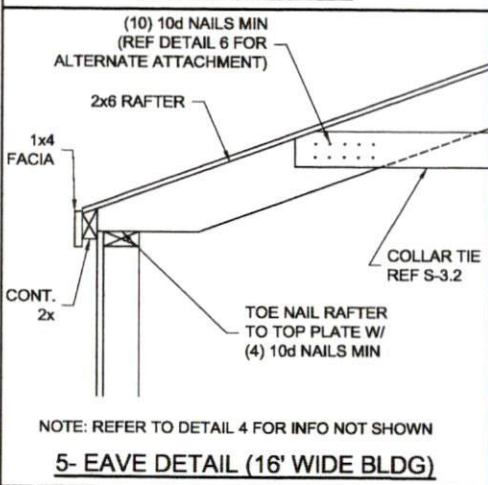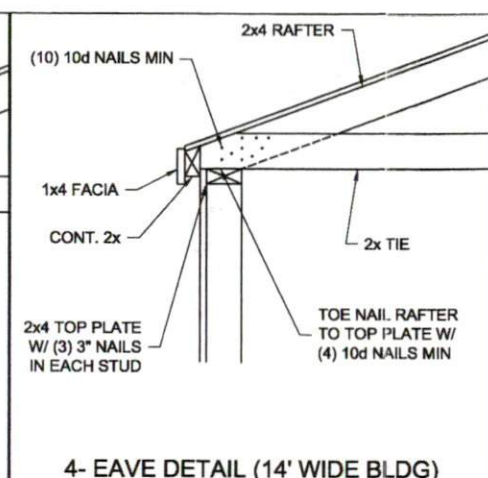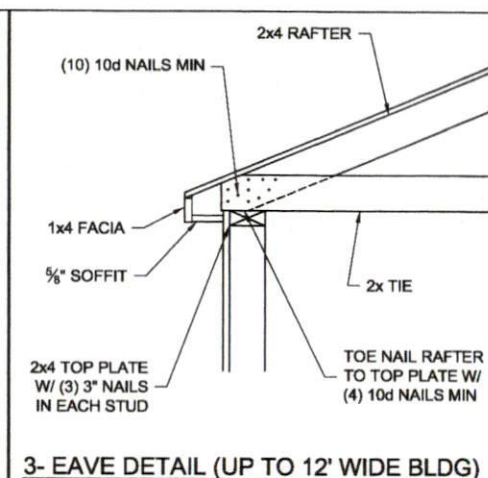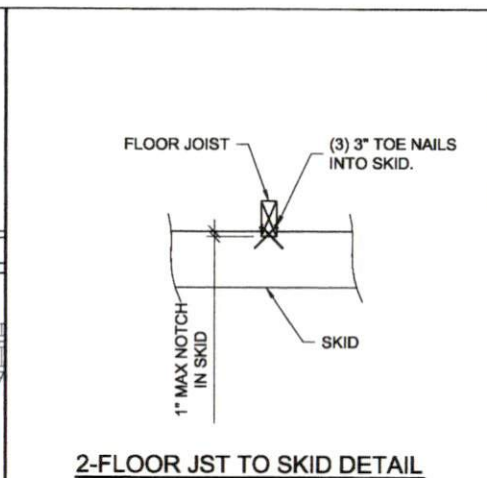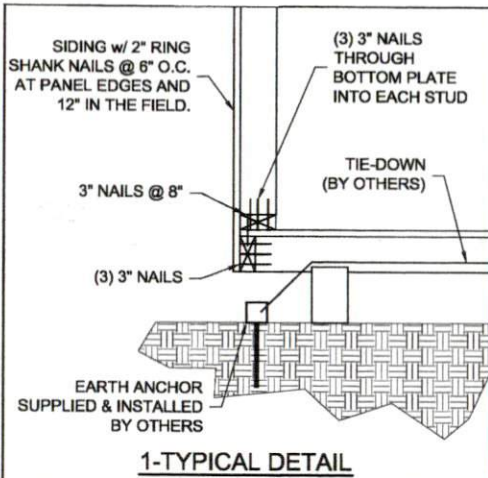


# UTILITY SHED--NORTH CAROLINA--2018 NCBC



PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	

SHEET NUMBER	<b>S-4.0-UT</b>
SCALE:	1"=1'-0"

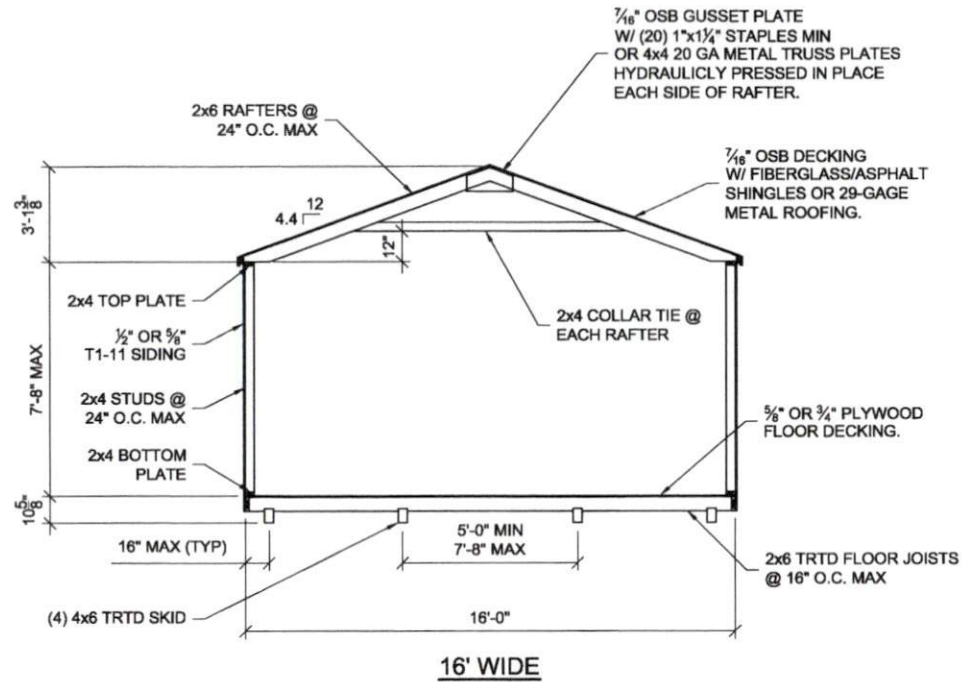

- NOTES: 1. PROVIDE A DOUBLE TOP PLATE ALONG THE SIDE WALLS WHEN THE  
RAFTER SPACING DOES NOT MATCH THE WALL STUD SPACING.  
2. ACTUAL SKID SPACING MAY VARY PROVIDED THAT THE CENTER TO  
CENTER SPACING IS WITHIN THE MAX/MIN SPACING STATED.  
3. 2x6 FRAMING MAY BE SUBSTITUTED FOR THE 2x4 FRAMING SHOWN.  
THE SPACING OF THE 2x6 FRAMING SHALL BE AS SHOWN FOR THE 2x4.

BUILDING SECTIONS



1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC





PROJECT NO:  
DATE: 01-01-2019  
DRAWN BY: KLN  
CHECKED BY: KLN  
REVISION:

SHEET NUMBER

**S-32-UT**

SCALE: 1/4" = 1'-0"

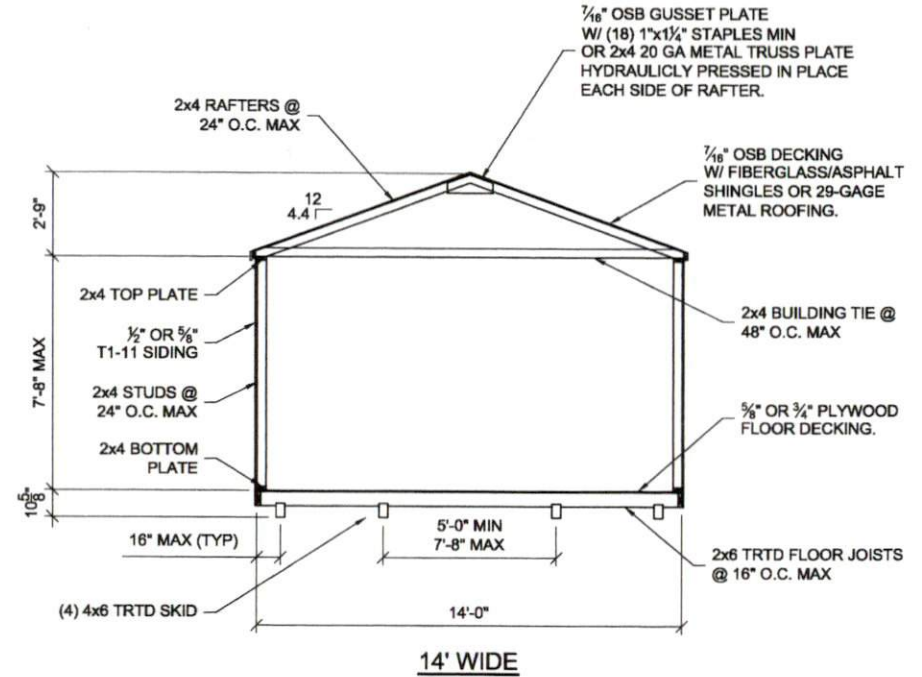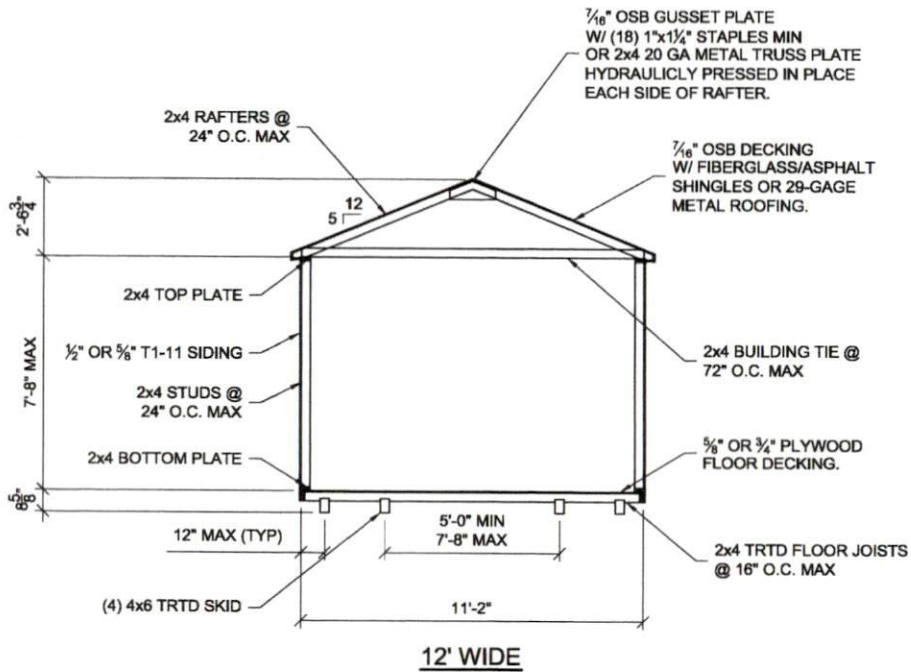

- NOTES: 1. PROVIDE A DOUBLE TOP PLATE ALONG THE SIDE WALLS WHEN THE RAFTER SPACING DOES NOT MATCH THE WALL STUD SPACING.  
 2. ACTUAL SKID SPACING MAY VARY PROVIDED THAT THE CENTER TO CENTER SPACING IS WITHIN THE MAX/MIN SPACING STATED.  
 3. 2x6 FRAMING MAY BE SUBSTITUTED FOR THE 2x4 FRAMING SHOWN. THE SPACING OF THE 2x6 FRAMING SHALL BE AS SHOWN FOR THE 2x4.

**BUILDING SECTIONS**



1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC





PROJECT NO:  
 DATE: 01-01-2019  
 DRAWN BY: KLN  
 CHECKED BY: KLN  
 REVISION:

SHEET NUMBER

**S-31-UT**

SCALE: 1/4" = 1'-0"

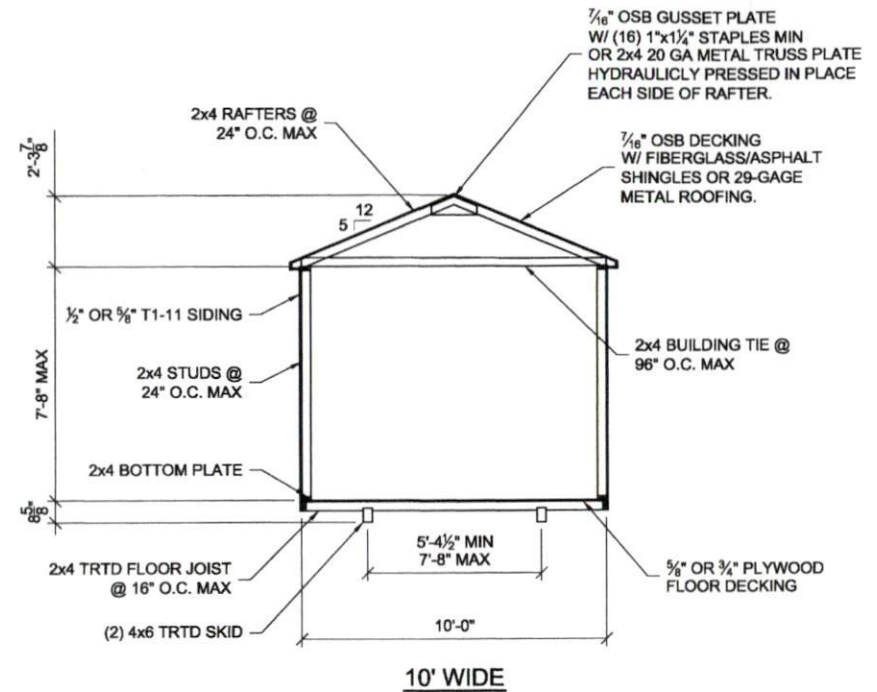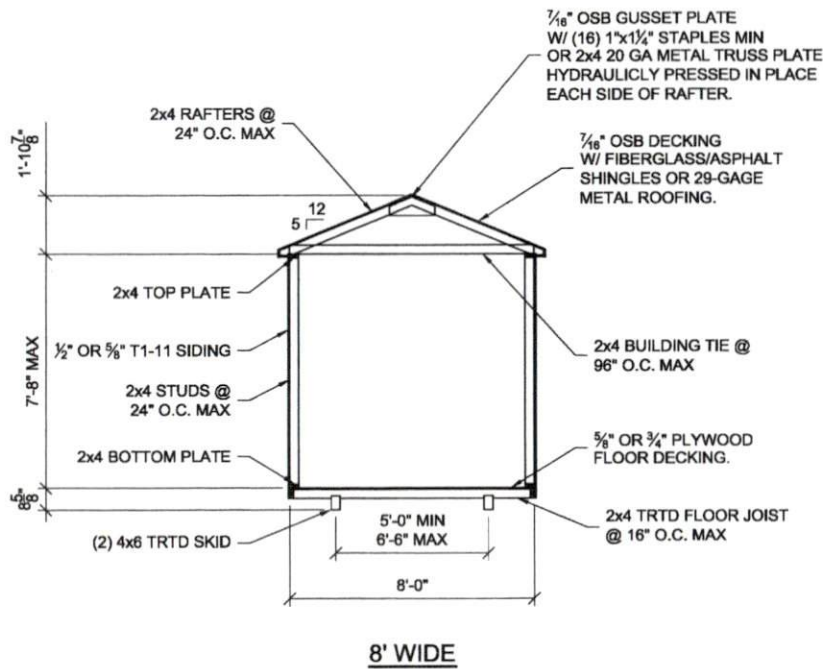

- NOTES: 1. PROVIDE A DOUBLE TOP PLATE ALONG THE SIDE WALLS WHEN THE RAFTER SPACING DOES NOT MATCH THE WALL STUD SPACING.  
 2. ACTUAL SKID SPACING MAY VARY PROVIDED THAT THE CENTER TO CENTER SPACING IS WITHIN THE MAX/MIN SPACING STATED.  
 3. 2x6 FRAMING MAY BE SUBSTITUTED FOR THE 2x4 FRAMING SHOWN. THE SPACING OF THE 2x6 FRAMING SHALL BE AS SHOWN FOR THE 2x4.

BUILDING SECTIONS



1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC



PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	

SHEET NUMBER

**S-3.0-UT**


SCALE: 1/4" = 1'-0"

### UPLIFT ANCHORAGE SCHEDULE

BLDG LENGTH	8' WIDE BLDGS		10' WIDE BLDGS		12' WIDE BLDGS		14' WIDE BLDGS		16' WIDE BLDGS	
	NUMBER OF TIE-DOWNS	REQ'D ANCHOR CAPACITY	NUMBER OF TIE-DOWNS	REQ'D ANCHOR CAPACITY	NUMBER OF TIE-DOWNS	REQ'D ANCHOR CAPACITY	NUMBER OF TIE-DOWNS	REQ'D ANCHOR CAPACITY	NUMBER OF TIE-DOWNS	REQ'D ANCHOR CAPACITY
10'-0"	2	300#	2	300#	-	-	-	-	-	-
12'-0"	2	400#	2	350#	2	250#	-	-	-	-
14'-0"	2	450#	2	400#	2	300#	2	250#	-	-
16'-0"	2	500#	2	450#	2	300#	2	300#	2	300#
18'-0"	2	550#	2	500#	2	350#	2	300#	2	300#
20'-0"	3	400#	2	550#	2	400#	2	350#	2	350#
22'-0"	-	-	3	400#	2	400#	2	400#	2	400#
24'-0"	-	-	3	450#	2	450#	2	400#	2	400#
26'-0"	-	-	3	500#	2	500#	2	450#	2	450#
28'-0"	-	-	3	550#	2	550#	2	500#	2	500#
30'-0"	-	-	3	550#	3	400#	3	350#	3	350#
32'-0"	-	-	-	-	3	400#	3	400#	3	400#
34'-0"	-	-	-	-	3	450#	3	400#	3	400#
36'-0"	-	-	-	-	3	450#	3	400#	3	400#
38'-0"	-	-	-	-	3	500#	3	450#	3	450#
40'-0"	-	-	-	-	3	500#	3	450#	3	450#
42'-0"	-	-	-	-	-	-	-	-	3	500#
44'-0"	-	-	-	-	-	-	-	-	3	500#

**NOTES:**

- 1) TIE-DOWNS AND EARTH ANCHORS ARE TO BE SUPPLIED AND INSTALLED BY THE CUSTOMER. OLD HICKORY BUILDINGS IS NOT RESPONSIBLE FOR THE TIE-DOWN SYSTEM. REFER TO NOTE SHEET S-0.
- 2) THE SCHEDULE INDICATES THE RECOMMENDED NUMBER OF BUILDING TIE-DOWNS TO BE INSTALLED BY THE CUSTOMER. EACH TIE-DOWN HAS TWO EARTH ANCHORS. EACH EARTH ANCHOR IS TO BE RATED FOR AT LEAST THE CAPACITY SHOWN IN THE SCHEDULE.
- 3) AT A MINIMUM, PROVIDE A TIE-DOWN NEAR EACH END OF THE BUILDING. REMAINING TIE-DOWNS (IF REQUIRED) SHOULD BE EVENLY SPACED ALONG THE ENTIRE LENGTH OF BUILDING.

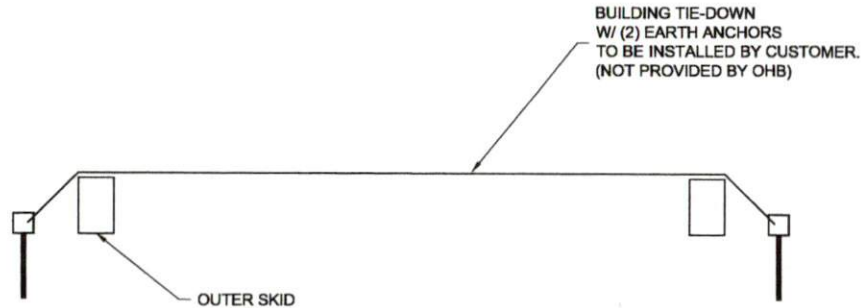


1-1-19

# UTILITY SHED--NORTH CAROLINA--2018 NCBC



PROJECT NO:  
DATE: 01-01-2019  
DRAWN BY: KLN  
CHECKED BY: KLN  
REVISION:

SHEET NUMBER  
**S-2-UT**  
SCALE: NONE

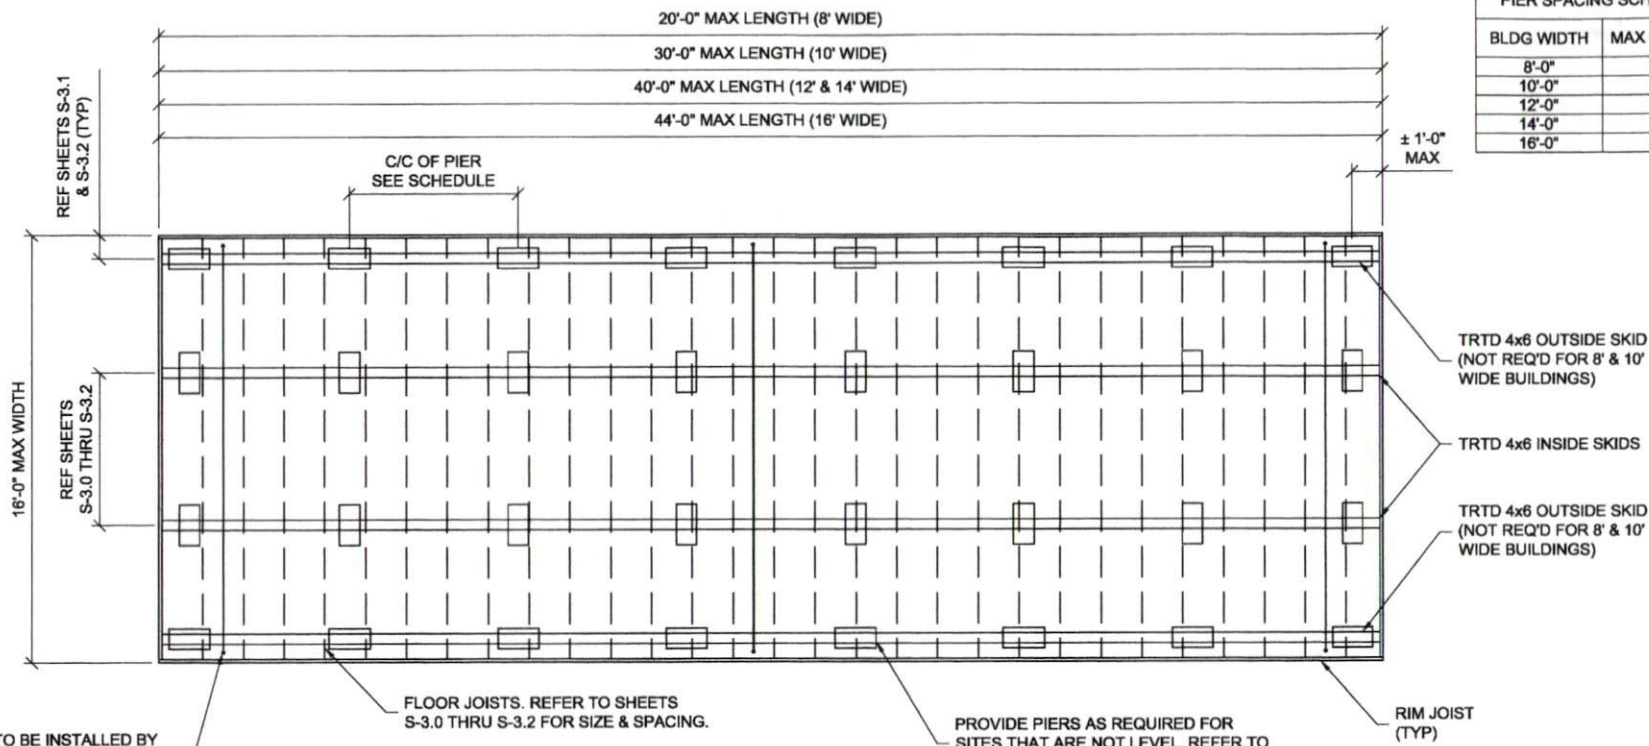

**FLOOR FRAMING PLAN**

BUILDING TIE-DOWN TO BE INSTALLED BY THE CUSTOMER. REFER TO NOTES ON S-0. THE QUANTITY OF TIE-DOWNS SHOWN ON THIS PLAN ARE CONCEPTUAL AND MAY NOT REFLECT THE ACTUAL REQUIRED QUANTITY. SEE THE SCHEDULE ON SHEET S-2 FOR THE REQUIRED TIE-DOWN QUANTITY AND LOAD RATING BASED ON THE BUILDING LENGTH (TYP)

# UTILITY SHED--NORTH CAROLINA--2018 NCBC



PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	

SHEET NUMBER

## S-1-UT

SCALE: NOT TO SCALE

# OLD HICKORY BUILDINGS, LLC

P.O. BOX 331973

MURFREESBORO, TN 37133

**GENERAL NOTES:**

- STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH THE 2018 NORTH CAROLINA RESIDENTIAL CODE (NCR) AND THE 2018 NORTH CAROLINA BUILDING CODE (NCBC).
- ALL MATERIALS AND CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE ABOVE CODES AT THE TIME OF MANUFACTURE.
- DRAWINGS SHALL NOT BE SCALED FOR DIMENSIONS.
- STRUCTURES ARE CLASSIFIED AS "MINOR STORAGE FACILITIES" (RISK CATEGORY I) AND SHOULD NOT BE USED FOR HUMAN HABITATION.
- STRUCTURES ARE DESIGNED FOR LOCATIONS THAT HAVE A 3 SECOND WIND GUST OF 105 MPH FOR RISK CATEGORY I STRUCTURES PER NCBC FIGURE 1609.3(3) AND ASCE 7-10 FIGURE 26.5-1C. STRUCTURES SHOULD NOT BE USED IN OTHER LOCATIONS.
- SIDING FASTENERS SHALL NOT BE INSTALLED IN PANEL SIDING GROOVES IN THE FIELD OF THE PANEL OR WHEN THE SIDING GROOVES OCCUR AT CUT EDGES OF THE SIDING PANEL.
- STRUCTURES ARE DESIGNED FOR LOCATIONS THAT HAVE A MAXIMUM GROUND SNOW LOAD OF 20 PSF AND A PARTIALLY EXPOSED TERRAIN CATEGORY AND SHOULD NOT BE USED IN OTHER LOCATIONS.
- STRUCTURES SHOULD HAVE 25 YEAR RATED FIBERGLASS/ ASPHALT SHINGLES OR 29 GA METAL ROOFING OVER WOOD SHEATHING.

- WOOD FRAMING SHALL COMPLY WITH THE ANSI/AWC "NATIONAL DESIGN SPECIFICATION (NDS) FOR WOOD CONSTRUCTION", 2015.
- ALL ROOF DECKING IS TO BE 7/16" O.S.B.
- ALL SIDING IS TO BE 1/2" or 5/8" TREATED T1-11 PLYWOOD.
- ALL FLOOR JOISTS ARE TO BE PRESSURE TREATED SYP #2, OR BETTER, UNLESS NOTED OTHERWISE. FLOOR JOISTS FOR 10' WIDE BUILDINGS ARE TO BE SYP #1, OR BETTER.
- ALL UN-TREATED WOOD FRAMING IS TO BE TO BE SPF #2 OR BETTER.
- ALL EXTERIOR NAILS ARE TO BE ZINC COATED.
- ALL FLOOR DECKING IS TO BE 5/8" OR 3/4" PLYWOOD.
- ALL SKIDS ARE TO BE 4x6 PRESSURE TREATED, RATED FOR GROUND CONTACT.

**ITEMS BY OTHERS:**

THE FOLLOWING ITEMS ARE TO BE SUPPLIED AND INSTALLED BY OTHERS. THESE ITEMS MAY BE SUBJECT TO LOCAL JURISDICTION APPROVAL. OLD HICKORY BUILDINGS IS NOT RESPONSIBLE FOR THESE ITEMS.

- THE COMPLETE FOUNDATION AND TIE-DOWN SYSTEM
- RAMPS, STAIRS, AND GENERAL ACCESS
- ELECTRICAL SERVICE HOOKUP

**DESIGN CRITERIA:**

- RISK CATEGORY I
- FLOOR LIVE LOAD: 40 PSF
- ROOF LIVE LOAD: 20 PSF
- ROOF SNOW LOADS:  
GROUND SNOW LOAD,  $P_g = 20$  PSF  
FLAT ROOF SNOW LOAD,  $P_f = 16$  PSF  
EXPOSURE FACTOR,  $C_e = 1.0$   
IMPORTANCE FACTOR,  $I = 0.8$   
THERMAL FACTOR,  $C_t = 1.2$
- WIND LOADS ARE BASED ON THE FOLLOWING:  
DESIGN WIND SPEED:  $V = 105$  MPH  
RISK CATEGORY I  
EXPOSURE CATEGORY B  
INTERNAL PRESSURE COEFFICIENT:  
 $G C_{pi} = \pm 0.18$   
COMPONENTS & CLADDING:  
ROOF-ZONE 1 = 10.0, -10.9 PSF  
ROOF-ZONE 2 = 10.0, -19.0 PSF  
ROOF-ZONE 3 = 10.0, -28.0 PSF  
WALL-ZONE 4 = 11.9, -12.9 PSF  
WALL-ZONE 5 = 11.9, -15.4 PSF

NOTE: C&C WIND PRESSURES SHOWN ARE FOR A 10 SQUARE FOOT EFFECTIVE AREA ( $A_e$ ) AND MAY BE REDUCED FOR LARGER AREAS AS ALLOWED BY CODE.

**PIERS (IF REQUIRED):**

- PIERS ARE NOT REQUIRED WHEN THE SKIDS CAN BE SUPPORTED ON FIRM, LEVEL GROUND. PIERS ALONG INTERIOR SKIDS SHALL BE ORIENTED WITH THE LONG SIDE PERPENDICULAR TO THE SKID. PIERS ALONG THE OUTSIDE SKIDS OF BUILDINGS WITH 4 SKIDS ARE PERMITTED TO BE ORIENTED WITH THE LONG SIDE PARALLEL TO THE SKID PROVIDED THAT THE PIERS ALONG THE INTERIOR SKID ARE ORIENTED PERPENDICULAR TO THE SKID.
- PIERS SHALL TYPICALLY BE 8"x8"x16" OPEN CELL OR SOLID CONCRETE BLOCKS, DRY STACKED TO A MAXIMUM HEIGHT OF 36". THE BLOCK IN CONTACT WITH THE GROUND AT EACH PIER SHALL BE A 4"x8"x16" SOLID BLOCK. OPEN CELL BLOCKS AND 2" THICK SOLID BLOCKS ARE NOT TO BE USED AS THE BASE OF ANY PIERS. OPEN CELL BLOCKS ARE TO BE PLACED ON TOP OF SOLID BLOCKS AS NEEDED WITH THE OPEN CELLS RUNNING VERTICALLY AND MUST NOT BE PLACED ON THEIR SIDE.  
  
CORNER PIERS OVER 20" TALL SHALL BE DOUBLE STACKED CONCRETE BLOCKS. TIE DOUBLE STACKED BLOCKS BY ALTERNATING THE DIRECTION OF BLOCKS ON EACH ROW.
- OLD HICKORY BUILDINGS IS NOT RESPONSIBLE FOR THE PREPARATION OF THE PROPOSED SITE OR DETERMINATION OF THE SITE'S SUITABILITY TO SUPPORT THE PROPOSED STRUCTURE. IT IS THE PROPERTY OWNER'S RESPONSIBILITY TO DETERMINE IF SITE CONDITIONS ARE SUITABLE TO SUPPORT THE STRUCTURE.
- PIERS SHOWN ON SHEET S-1 ARE CONCEPTUAL AND MAY NOT REFLECT ACTUAL CONDITIONS. THE PIER LAYOUT MAY BE ADJUSTED AS NEEDED BASED ON SITE CONDITIONS, PROVIDED THAT THE MAXIMUM SPACING SHOWN IS NOT EXCEEDED.



1-1-19

## UTILITY SHED--NORTH CAROLINA--2018 NCBC



PROJECT NO:	
DATE:	01-01-2019
DRAWN BY:	KLN
CHECKED BY:	KLN
REVISION:	

SHEET NUMBER

**S-0-UT**

SCALE: NONE