

HTE# BRES1912-0006

Harnett County Department of Public Health

25813

PERMIT # _____

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 24677 NC 24-27

Name: (owner) Dairus Davis SUBDIVISION _____ LOT # _____

System Installer: Larry Sharpe Registration # _____


Basement with plumbing: Garage Number of Bedrooms 3

Type of Water Supply: Community Public Well Distance from well 50+ feet

System Type: conventional w/ tire chip Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

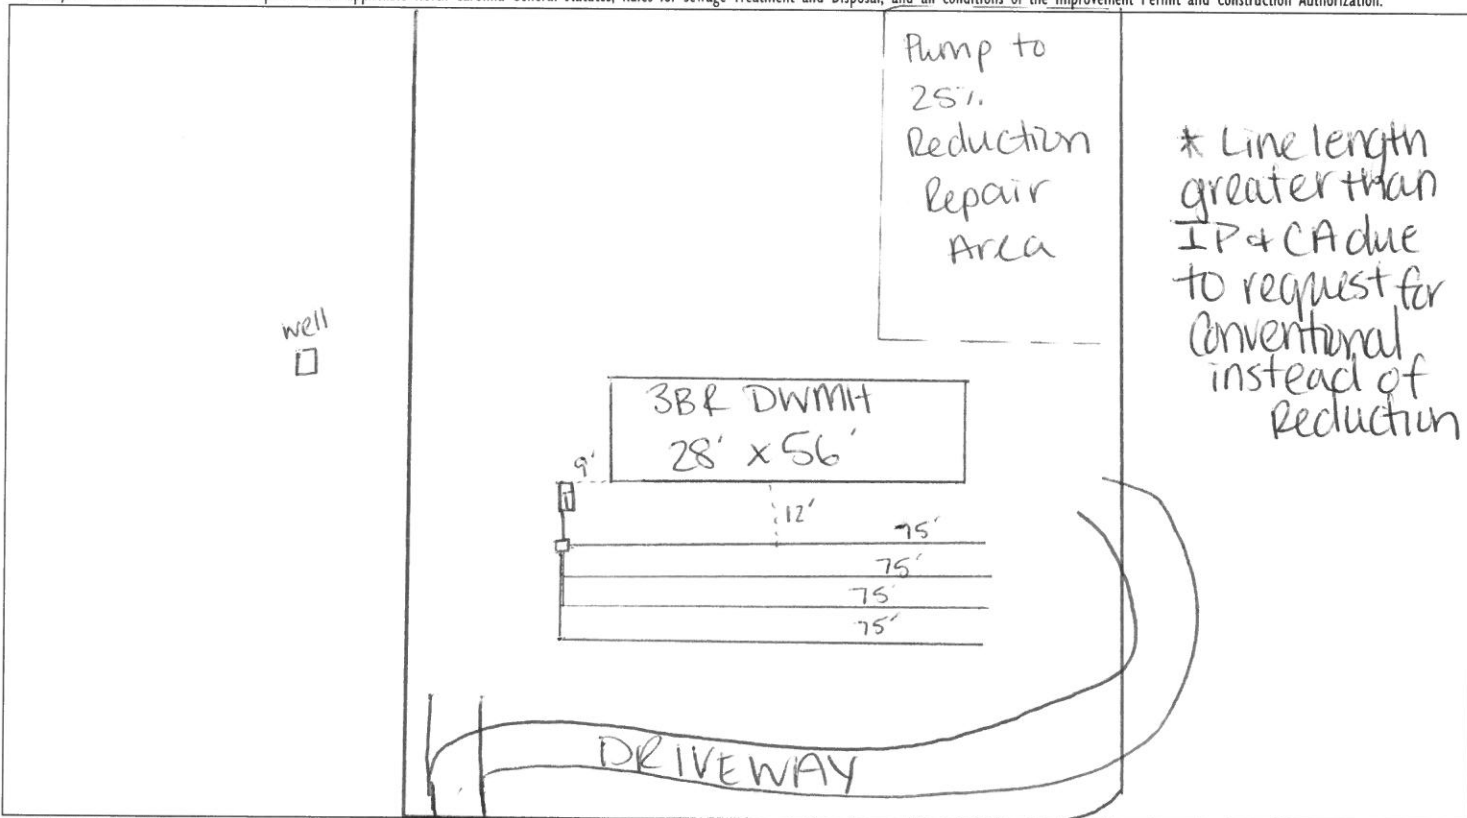

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other tire chip Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of 4 exact length 75 width of 3 depth of _____
 Drainage Field ditches _____ of each ditch _____ feet ditches _____ depth of _____
 French Drain Required: _____ Linear feet

Authorized State Agent Bob Adair PEHS-I Date 1/28/2020

Customer: 0369650001 / Larry Sharpes

Scale
Gross: 43000 LBS Out Manual Wt
Tare: 21980 LBS In Manual Wt
Net: 21020 LBS

Generator: NA / Not Applicable
Dest: DEST: CUSTOMER / Customer
Truck: LARRY SHAR

Comment:

Origin	Wastes & Sevices	Quantity	Unit	Rate/Unit	Amount
NA / Not Applicable	DFMT116/Drain Fill Material	10.51	TON	\$25.00/TN	\$262.75
				Total Taxes:	\$18.39
				Total Amount:	\$281.14

Driver: _____

Deputy Weighmaster: Libby Cameron

Libby

This load of tire chips is from the Fuel Grade location and meets the NC specification as stated in Innovative Wastewater system approval IWWS-2002-03R for the tire chip Substitution for Rock Aggregate in Nitrification Fields.