

HTE# 09-5-231772

Harnett County Department of Public Health

21037

PERMIT # 25448

Operation Permit

New Installation Septic Tank Repair Nitrification Line Expansion

PROPERTY LOCATION: SR1432 Wilburn RD

Name: (owner) Tommy Wilson Barber Jr SUBDIVISION Kathy Adams LOT # 24

System Installer: Dennis Medina Registration # _____


Basement with plumbing: Garage Number of Bedrooms _____

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: EZ LAY 250/10 REDUCION (ACCEPTED) TYPE III Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

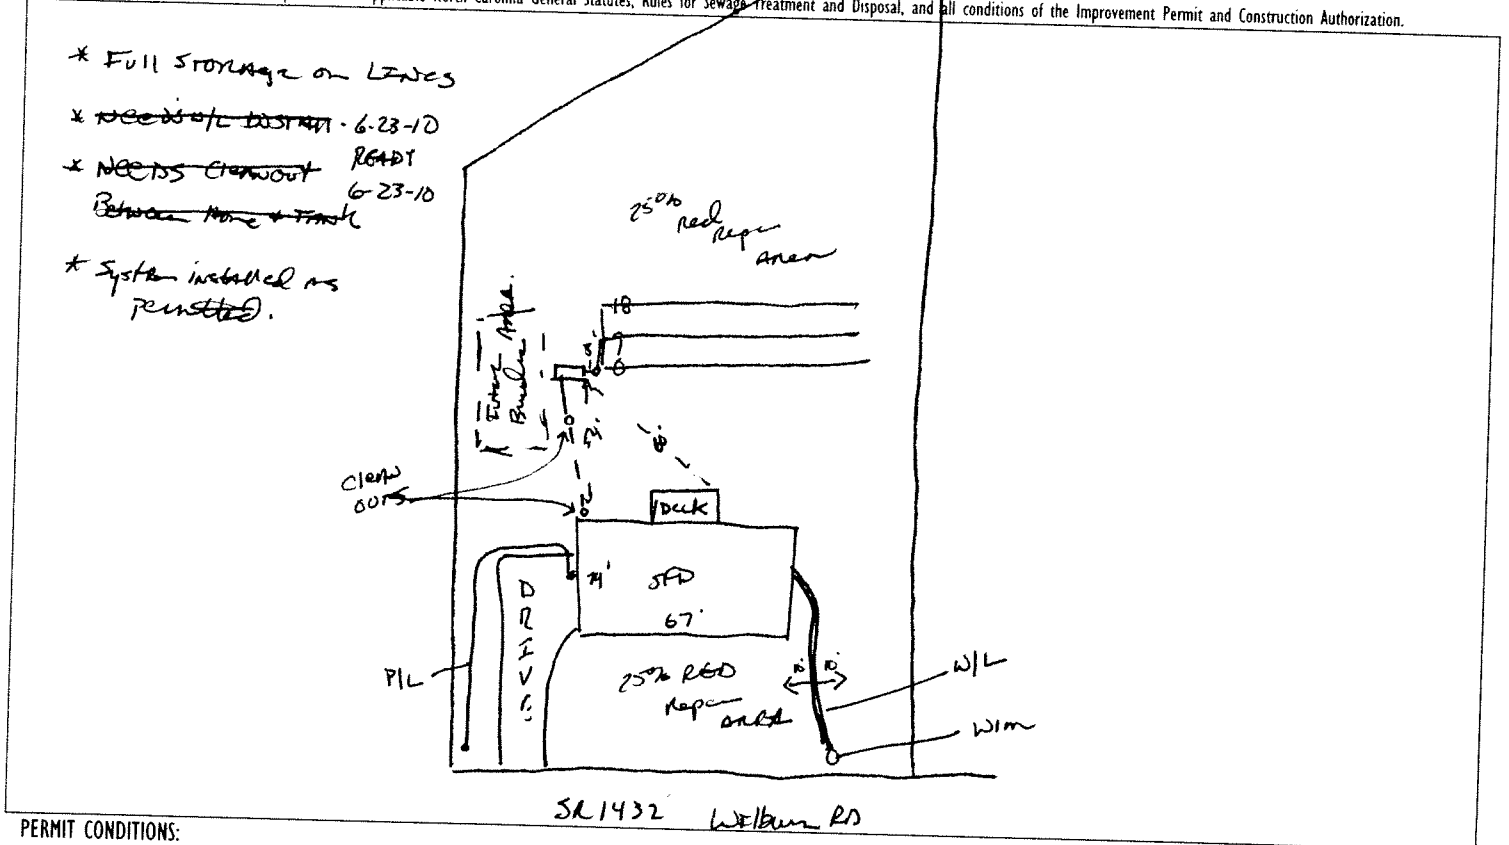

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 250/10 REDUCION Type III & EZ LAY Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 3 exact length of each ditch 100 feet width of ditches 3 feet depth of ditches 28 ~ 20 inches

French Drain Required: _____ Linear feet

Authorized State Agent James E. Markant 21037 Date 6-23-10