


**APPROVED**

Limited building only review  
Permit holder responsible for  
full compliance with the code

**NOTICE TO CONTRACTOR**  
All construction must comply with current NC Building Codes  
and is subject to field inspection and verification.




**02/24/2020**

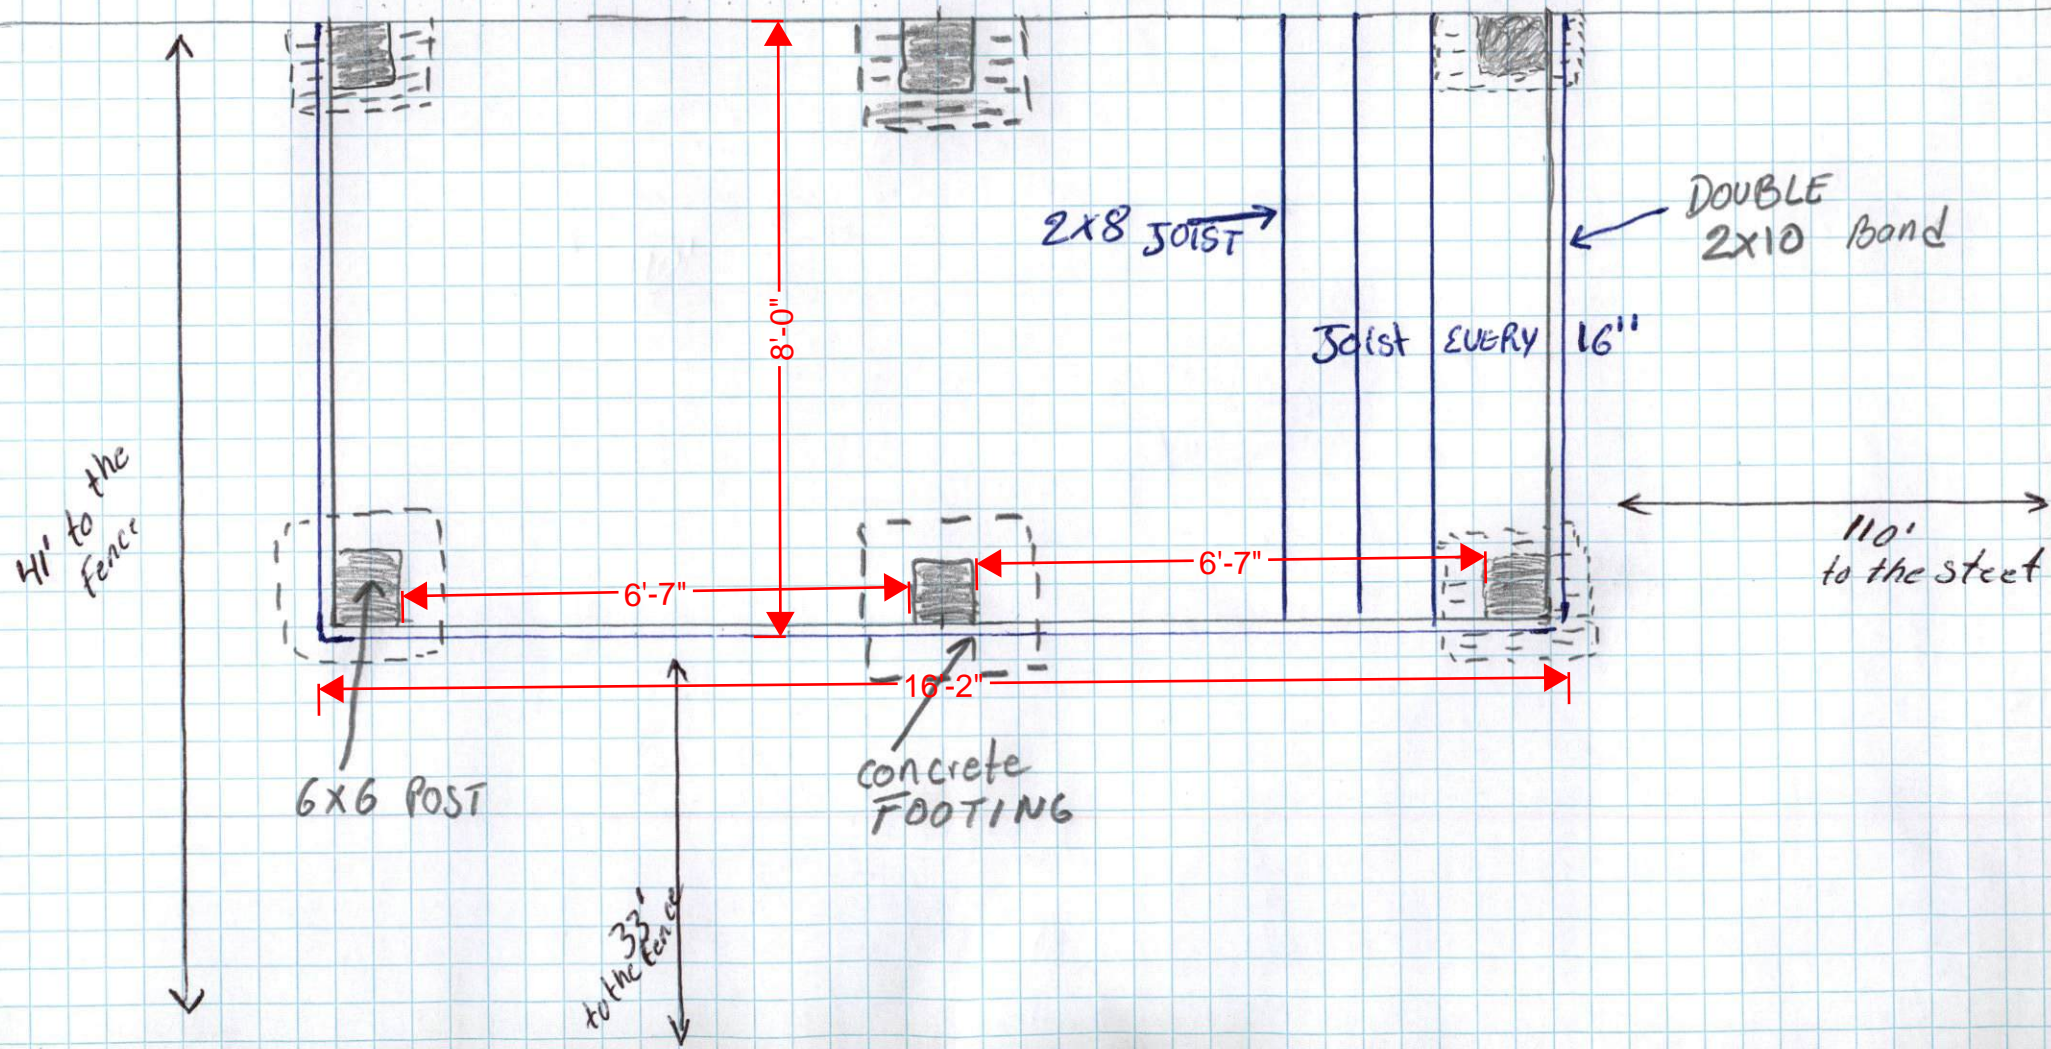

Ties must be in upper third of rafter with max spacing of every third rafter.

Must have 2x6 @ 16 o.c. min ceiling joists in bottom third of each rafter.

Spacing 16 o.c. max

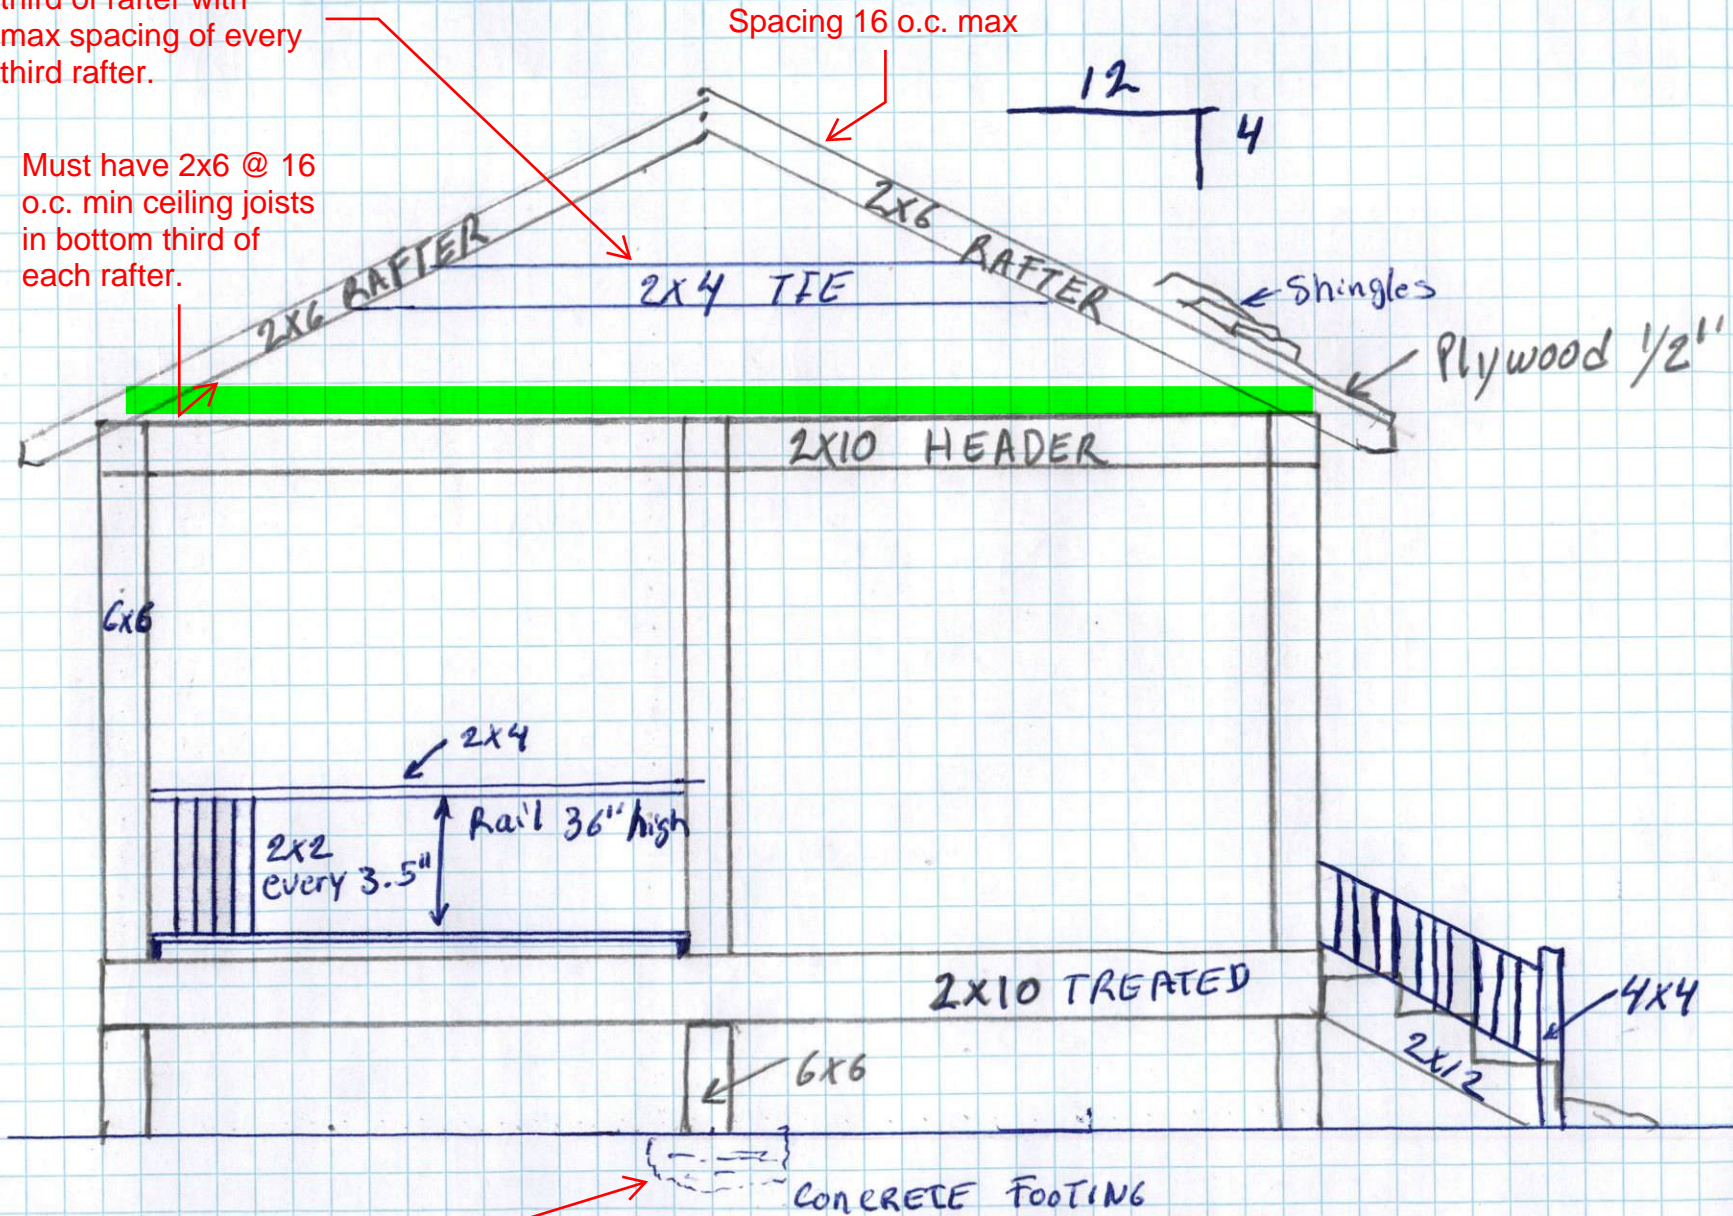

Min 16x16 x 8 thick footing

CONCRETE FOOTING