

HTE# SFD 2004-0005

# Harnett County Department of Public Health

No. 26643

PERMIT # \_\_\_\_\_

## Operation Permit

New Installation  Septic Tank  Nitrification Line  Repair  Expansion

PROPERTY LOCATION: 51109 Flynn McPherson RD

Name: (owner) Matthew + Sarah TenBrink SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: Lanny Shange Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 5

Type of Water Supply:  Community  Public  Well Distance from well 50' feet


System Type: 25% Reduction System Type IFC Under Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

Queue 4

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

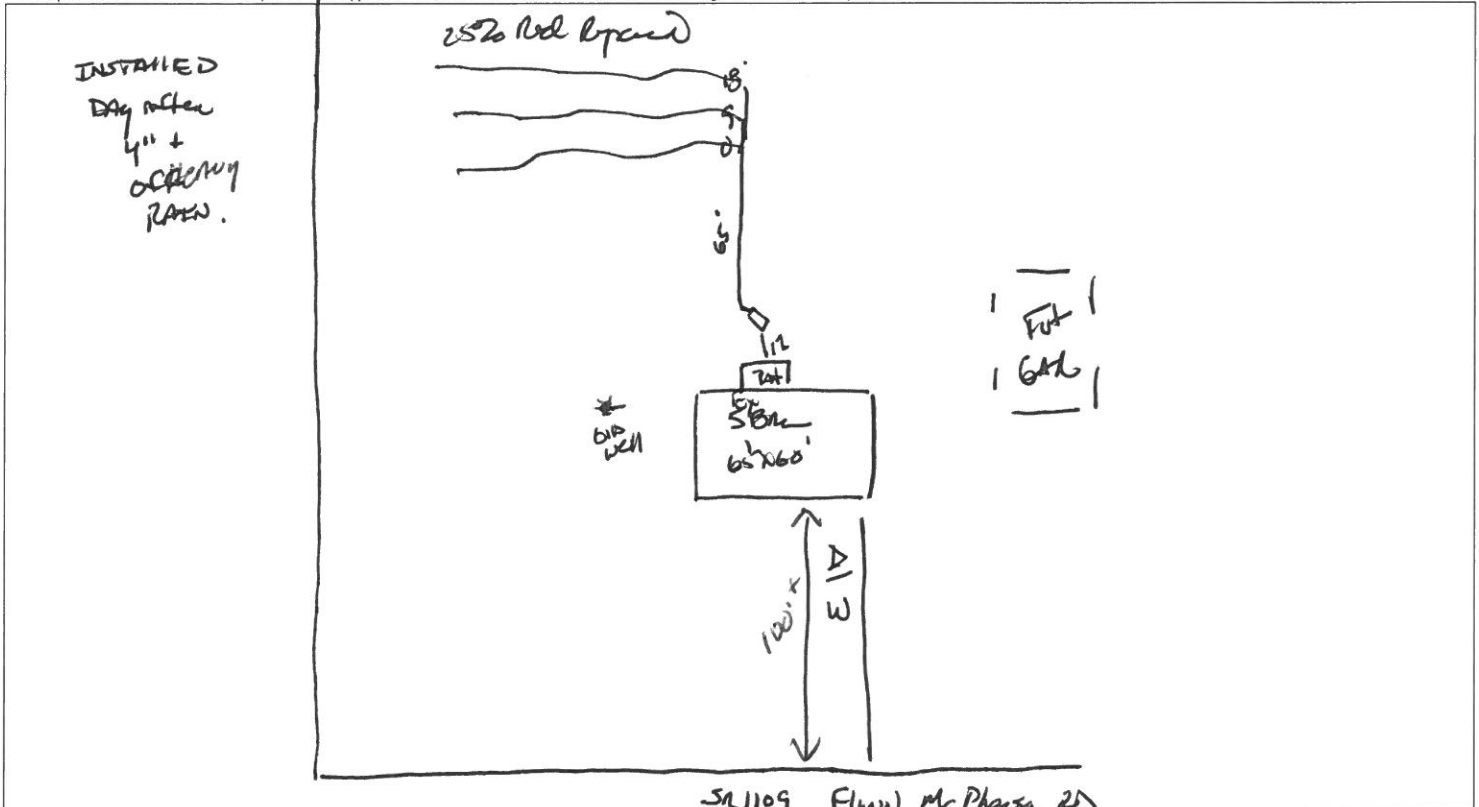

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes  No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other 25% REDUCTION SYSTEM Septic Tank: 1250 gallons Pump Tank: \_\_\_\_\_ gallons

Subsurface No. of exact length width of depth of

Drainage Field ditches 3 of each ditch 100 feet ditches 3 feet ditches 24-18 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent James E. Markham Date 10-12-20