


STEVE & CECILIA GREGORY  
 681 MAMIE UPTON RD  
 WILMINGTON, NC 27546

THIS LAYOUT IS TO BE USED AS A TRUSS PLACEMENT GUIDE ONLY.  
 PLEASE REFER TO BUILDING PLANS FOR BUILDING CONSTRUCTION AND DETAILS,  
 SUCH AS PLUMBING OR DUCT DROPS.

Gregory Carport  
 Roof Truss  
 6/12 Pitch  
 1' OH, 2' OC

Existing House  
 Not Matching


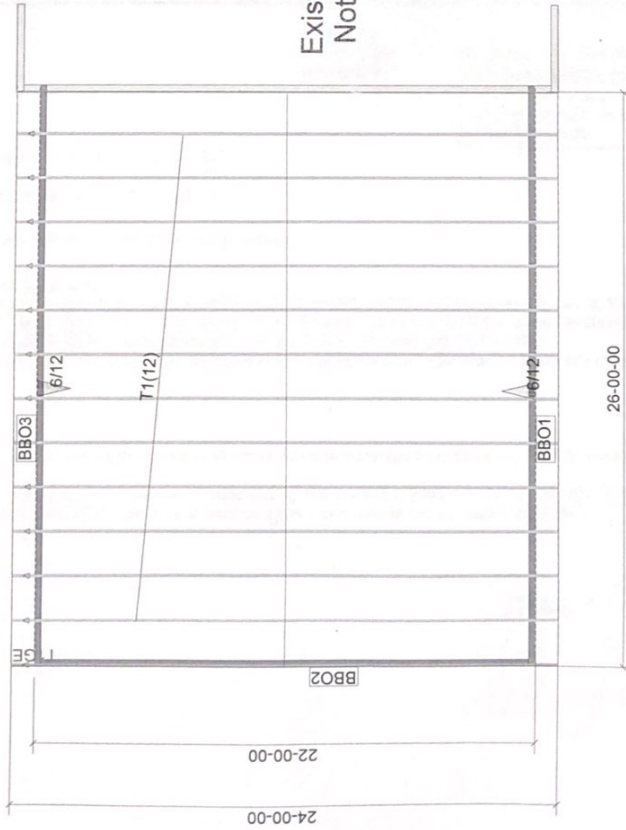


Roof Truss Loading per  
 2018 IRC Residential Code  
 Top Chord Dead Load 10# PSF  
 Top Chord Live Load 0# PSF  
 Bottom Chord Live Load 10# PSF  
 Bottom Chord Dead Load 10# PSF  
 Trusses are designed for occasional  
 snow loads of 20# PSF.  
 Trusses will fit between the walls.

△ This symbol denotes the end of  
 truss at tower with truss cleangings  
 to be made by the contractor. All  
 other trusses are standard trusses.  
 Shop. Builder please confirm.

Truss connections by others:  
 (W) Welded  
 (L) Ledger

Notes:  
 1. Elevation dimensions shown are  
 assumed to be  
 finished.  
 2. Additions locations as  
 shown are for informational purposes  
 only. Mechanical clearance. Unless  
 otherwise noted, all O.C. spacing  
 shown is not exceeded.  
 3. Trusses are shown without  
 approval of any part of any truss  
 without prior approval from Peak  
 Builders, LLC.  
 4. Do not approve drawings if any  
 information herein is unclear.  
 5. Trusses are shown without  
 fabrication as approved.  
 6. Trusses with any questions. We  
 are available to help any way  
 we can. Please call or email at  
 919-545-2555 or  
 sales@peaktruss.com

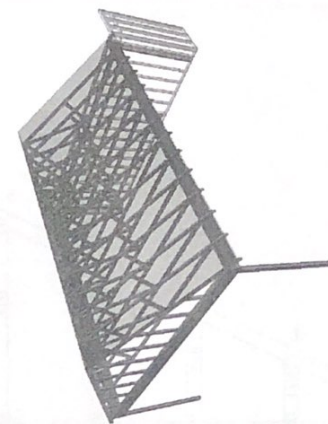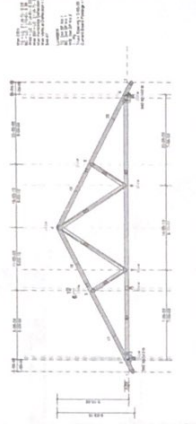

PROPOSED DESIGN-  
 NOT FOR  
 CONSTRUCTION

Job # Q-2000988


Designer: Austin McInnis

Date Quoted:

Gregory Carport  
 681 Mamie Upton Rd  
 Lillington NC  
 27546

Carolina Remodeling &  
 Construction  
 811 Garden St  
 Lillington, NC  
 27546

Peak Truss  
 Builders, LLC  
 PO Box 340, New Hill, NC 27562

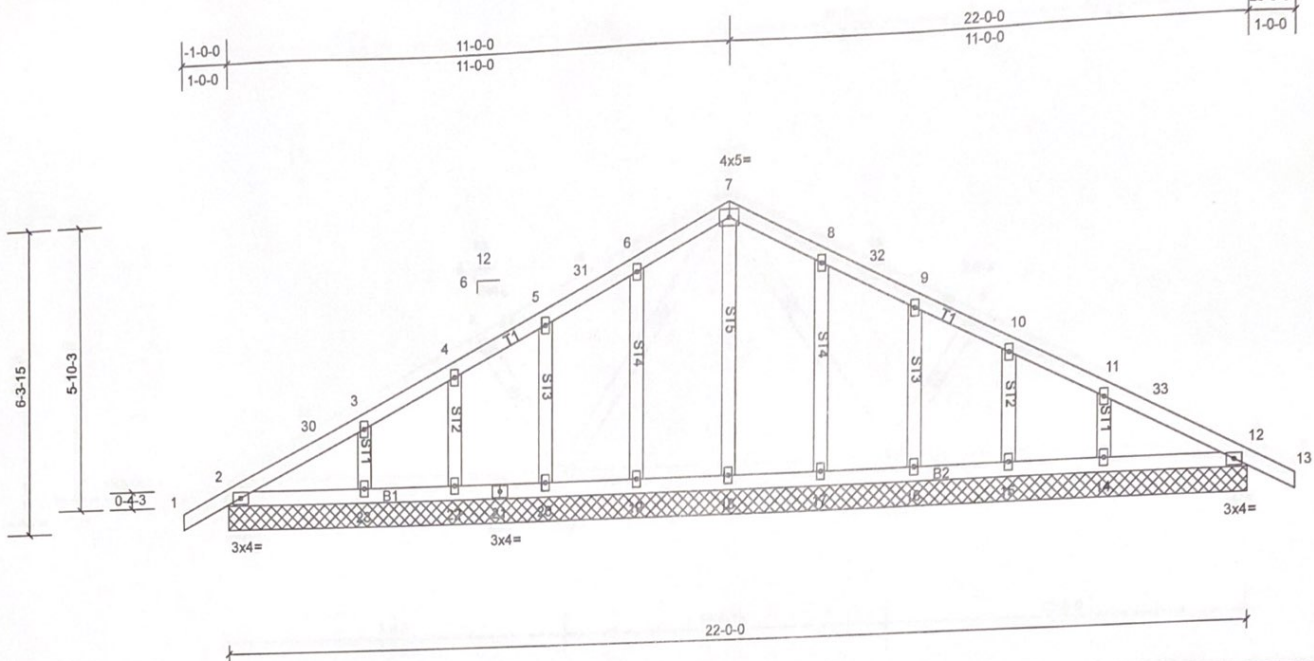

Loading	(psf)	Spacing	2-0-0	CSI	0.06	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.06	Horz(CT)	0.00	27	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MS							Weight: 114 lb	FT = 20%

**LUMBER**  
 TOP CHORD 2x4 SP No.1  
 BOT CHORD 2x4 SP No.1  
 OTHERS 2x4 SP No.3

**BRACING**  
 TOP CHORD  
 BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 Rigid ceiling directly applied or 10-0-0 oc bracing.  
 MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS** All bearings 22-0-0.  
 (lb) - Max Horiz 2=89 (LC 10)  
 Max Uplift All uplift 100 (lb) or less at joint(s) 14, 15, 16, 17, 19, 20, 22, 23, 2, 12  
 Max Grav All reactions 250 (lb) or less at joint(s) 14, 15, 16, 17, 18, 19, 20, 22, 23, 2, 12

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCCL=6.0psf, BCDL=6.0psf; h=30ft; B=20ft; L=22ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Corner (3) -1-0-0 to 2-0-0, Exterior (2) 2-0-0 to 11-0-0, Corner (3) 11-0-0 to 14-0-0, Exterior (2) 14-0-0 to 23-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 19, 20, 22, 23, 17, 16, 15, 14, 12, 2, 12.
- This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

STEVE & CECILIA GREGORY  
 681 MAMIE UPCHURCH RD  
 LITTLETON NC 27546


Job Q-2000988-1	Truss T1	Truss Type Common	Qty 12	Ply 1	Gregory Carport-Roof Job Reference (optional)
--------------------	-------------	----------------------	-----------	----------	--

Peak Truss Builders LLC, New Hill, user

Run: 8:31 S Sep 9 2019 Print: 8:31 S Sep 9 2019 MiTek Industries, Inc. Mon Apr 20 15:47:18

Page: 1

ID: H\_He59089aRZe4YAd7PpFazOoAo-hvhwel\_lv1BncK00KDiH6VYa511MbQdWbYSZaZnZo04t

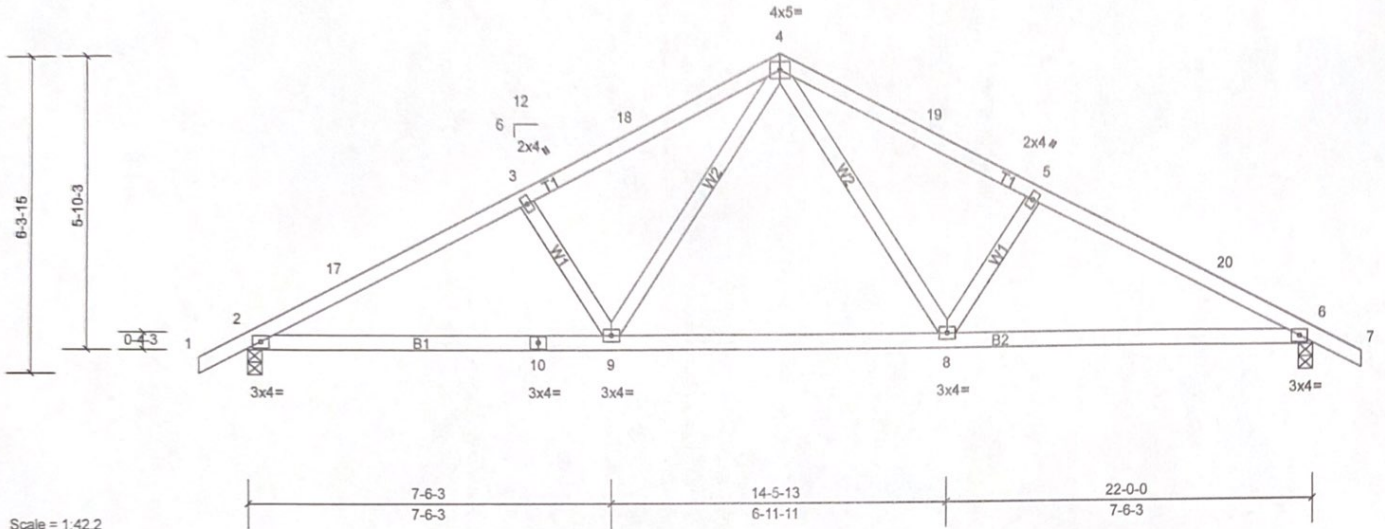

Scale = 1:42.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.29	Vert(LL)	-0.05	8-16	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.39	Vert(CT)	-0.14	8-16	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.22	Horz(CT)	0.03	6	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MS								Weight: 101 lb FT = 20%

**LUMBER**  
 TOP CHORD 2x4 SP No.1  
 BOT CHORD 2x4 SP No.1  
 WEBS 2x4 SP No.3

**BRACING**  
 TOP CHORD  
 BOT CHORD

Structural wood sheathing directly applied or 4-9-14 oc purlins.  
 Rigid ceiling directly applied or 10-0-0 oc bracing.  
 MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS** (lb/size) 2=940/0-3-8, (min. 0-1-8), 6=940/0-3-8, (min. 0-1-8)  
 Max Horiz 2=-89 (LC 9)  
 Max Uplift 2=-143 (LC 11), 6=-143 (LC 11)

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-17=-1524/194, 3-17=-1485/219, 3-18=-1367/216, 4-18=-1287/232, 4-19=-1287/232, 5-19=-1367/216, 5-20=-1485/219, 6-20=-1524/194  
 BOT CHORD 2-10=-109/1328, 9-10=-109/1328, 8-9=0/876, 6-8=-109/1328  
 WEBS 4-8=-53/526, 5-8=-340/153, 4-9=-53/526, 3-9=-340/153

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=22ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) -1-0-0 to 2-0-0, Interior (1) 2-0-0 to 11-0-0, Exterior (2) 11-0-0 to 14-0-0, Interior (1) 14-0-0 to 23-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 143 lb uplift at joint 2 and 143 lb uplift at joint 6.
  - This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

STEVE & SHELLEY GREGORY  
 651 MAMIE UPCHURCH Rd  
 WILMINGTON NC 27546