

HTE# 06-500-19407e

# Harnett County Department of Public Health

20136

PERMIT # 24672

## Operation Permit

New Installation  Septic Tank  Repair  Nitrification Line  Expansion

Name: (owner) Kurt Pierce

PROPERTY LOCATION: 1210

System Installer: Ted Brown

SUBDIVISION Persimmon Hill

LOT # 24

Basement with plumbing:  Garage  Number of Bedrooms 3

Registration # \_\_\_\_\_

Type of Water Supply:  Community  Public  Well

Distance from well 50 feet


System Type: Quick 4

Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

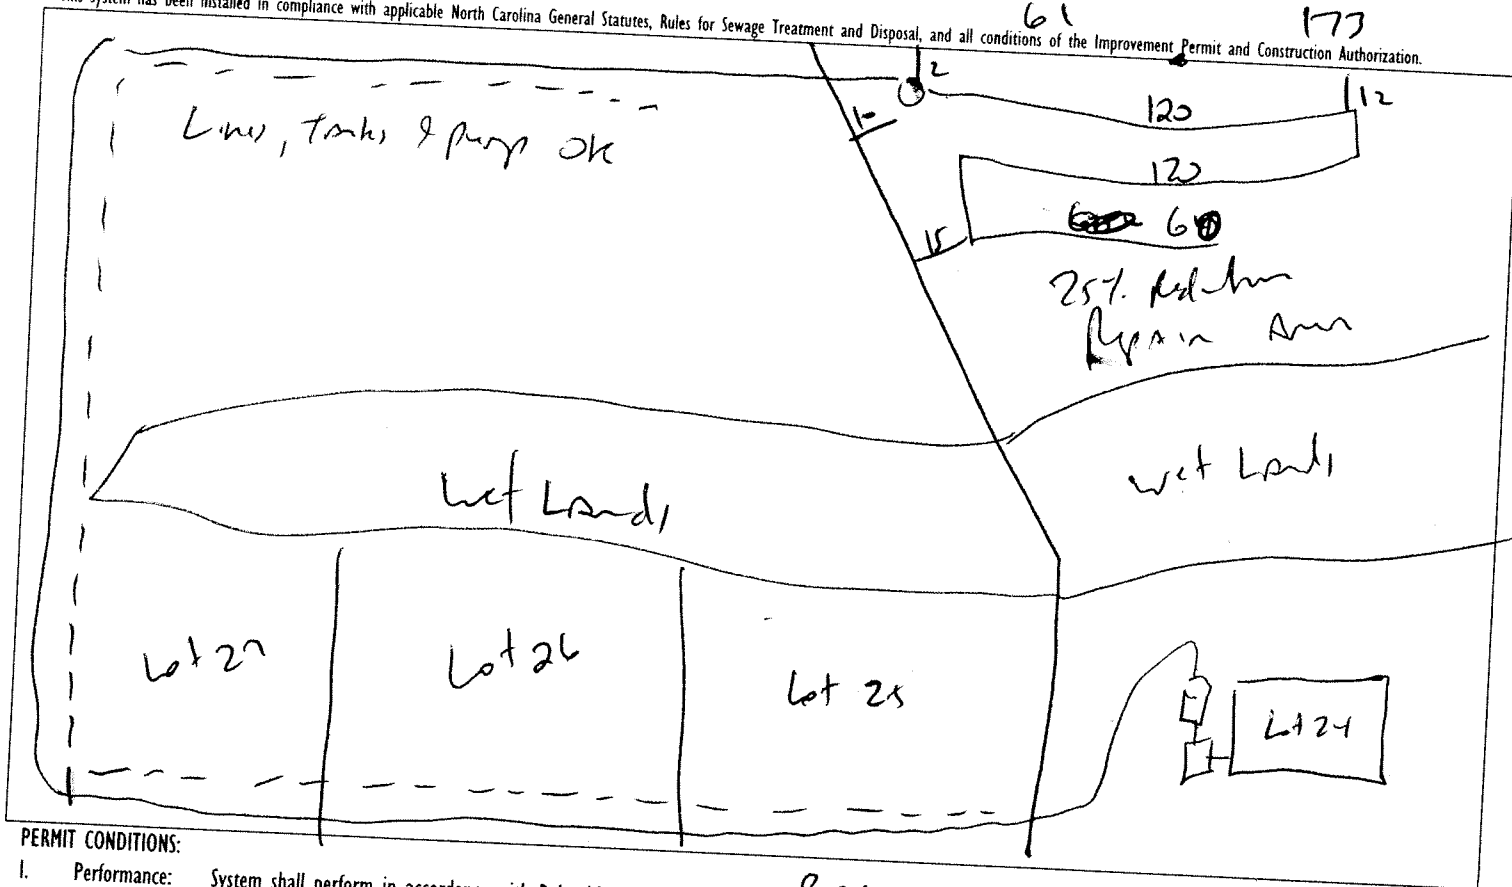

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No
- IV. Operation: If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- V. Other: \_\_\_\_\_

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other Quick 4

Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface Drainage Field: No. of ditches 1 exact length of each ditch 300 feet

French Drain Required: \_\_\_\_\_ Linear feet

width of ditches 3 feet depth of ditches 18 inches

Authorized State Agent

*[Signature]*

Date 07-08-08