

HTE# 14-5-33423R

Harnett County Department of Public Health

23432

PERMIT # 28000

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: McKoy Towne Rd

Name: (owner) Delton McKoy SUBDIVISION _____ LOT # 5

System Installer: Larry Sharpe Registration # _____

Basement with plumbing: Garage Number of Bedrooms 2


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: III g Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

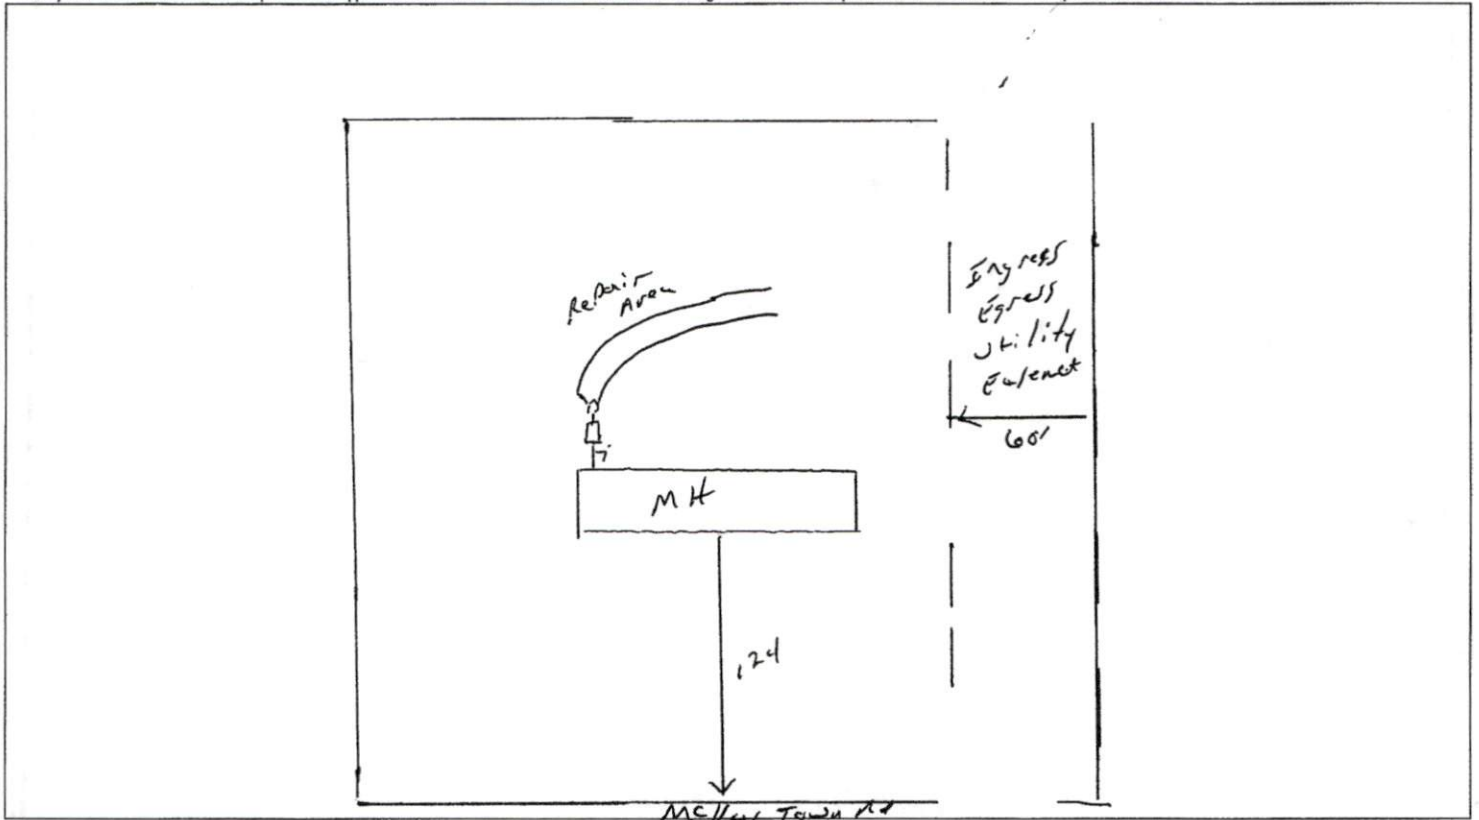

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Tire Chips Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field No. of ditches 2 exact length of each ditch 70 feet width of ditches 3 feet depth of ditches 26 inches

French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 12/19/2014

Central Carolina Holdings

Ticket: 614051

Date: 10/10/2014

Time: 09:40:32 - 10:08:33

Customer: 0369650001 / Larry Sharpes

Gross: 42480 lb Out Manual Wt

Tare: 22400 lb In Manual Wt

Net: 20080 lb

Scale

Generator: NA / Not Applicable

Dest: DEST: CUSTOMER / Customer

Truck: SHARPE

Comment: SHAPE SEPTIC

Origin	Wastes & Services	Quantity Unit	Rate/Unit	Amount
NA / Not Applicable	DFMT116/Drain Fill Material	10.04 TON	\$22.00/TN	\$220.88
			Total Taxes:	\$15.46
			Total Amount:	\$236.34

Weighmaster:

Libby Cameron

Driver:

Larry Sharpes

This load of fire chips is from the Fuel Grade location and meets the Nc specification at site for Innovative Wastewater system approval (WWS-2002-03R for fire chip Substitution for Rock Aggregate in Nitrification Fields.