

#03-5-6676

HARNETT COUNTY HEALTH DEPARTMENT

No 19962

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) FELICIANO AVILEZ
Property Location: SR# 1412 Christian Light Rd
New Installation, Septic Tank, Repairs, Nitrification Line

Subdivision Shered Forest Lot # 1

Tax ID # Quadrant #

Number of Bedrooms Proposed: 3 Lot Size: 1.51 Acre

Basement with Plumbing: Garage:

Water Supply: Well, Public, Community

Distance From Well: 50' ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional, Other

Size of tank: Septic Tank: 1000 gallons Pump Tank: 1000 gallons


Subsurface Drainage Field: No. of ditches 3, exact length of each ditch 115 ft, width of ditches 3 ft, depth of ditches 18 in.

French Drain Required: Linear feet

This permit is subject to revocation if site plans or intended use change.

Date: 3-26-03
Signed: James S. Manhart, Environmental Health Specialist

* CONTRACTOR TO MGMT ON SITE PRIOR TO INSTALLATIONS

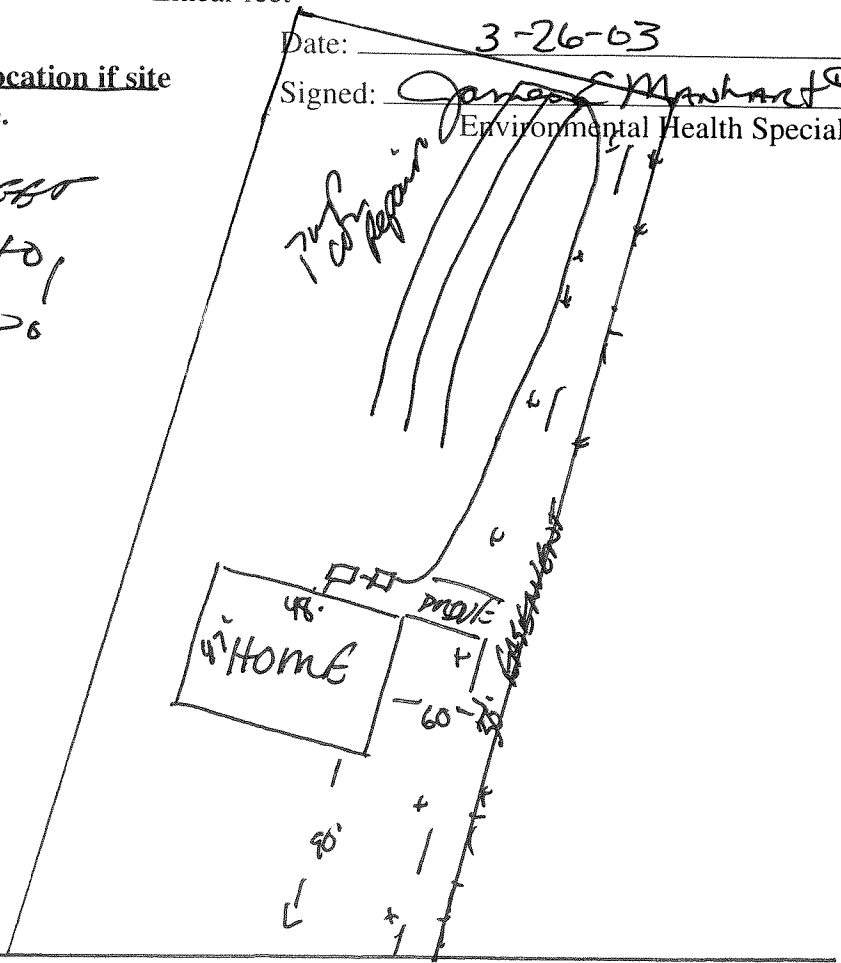

SR 1412 CHRISTIAN LIGHT RD

HARNETT COUNTY HEALTH DEPARTMENT AUTHORIZATION TO CONSTRUCT

Authorization is hereby given to construct a wastewater system to the specifications described by Harnett County Health Department, Improvement Permit # 19962. This authorization shall be valid for a period not to exceed five (5) years from the date of issuance. This authorization will be invalid if ownership, site plans, or intended use change.

FELICIANO AVILEZ 919-291-7888
Name Telephone#

355 Chantier St F.V. N.C. 27526
Address

1412 Christian Light
Property Location SR# Road Name

Shenod Forest 1 3 1.51 Acre
Subdivision Lot # # Bedrooms Proposed Lot Size

TYPE OF SYSTEM

New Installation Repair Septic Tank Nitrification Lines

Conventional Other _____

Basement With Plumbing Without Plumbing

Water Supply: Well Public Water Supply Minimum Well Setback: _____ Ft.

Septic Tank 1000 gal Pump Chamber _____ gal

NITIRFICATION FIELD SPECIFICATIONS

Number of fields 2 # of lines per field 3 Length of lines 115 Ft.

Width of ditches 3 ft. Depth of ditches 18 inches

French Drain: Linear feet required _____ Depth of gravel _____

No wastewater system shall be covered or placed into use by any person until an inspection by the Harnett County Health Department has determined that the system has been installed according to the conditions of the Improvement Permit and that a valid Operations Permit has been issued.

James E. Manhart
Signature of Authorized Agent for Harnett County of Harnett

3-26-03
Date