

HTE# B125 2008-0037

# Harnett County Department of Public Health

No. 26456

PERMIT # NA

## Operation Permit

- Relocation SL 15711
- New Installation
- Septic Tank
- Nitrification Line
- Repair
- Expansion

PROPERTY LOCATION: 40 FRANKLIDGE CT. (NATHAN MATTHEWS RD)

Name: (owner) JAMES FLEMING SUBDIVISION PINECROFT LOT # 23

System Installer: CLINT ADAMS Registration # \_\_\_\_\_

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well NA feet

System Type: 25% REDUCTION SIS IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

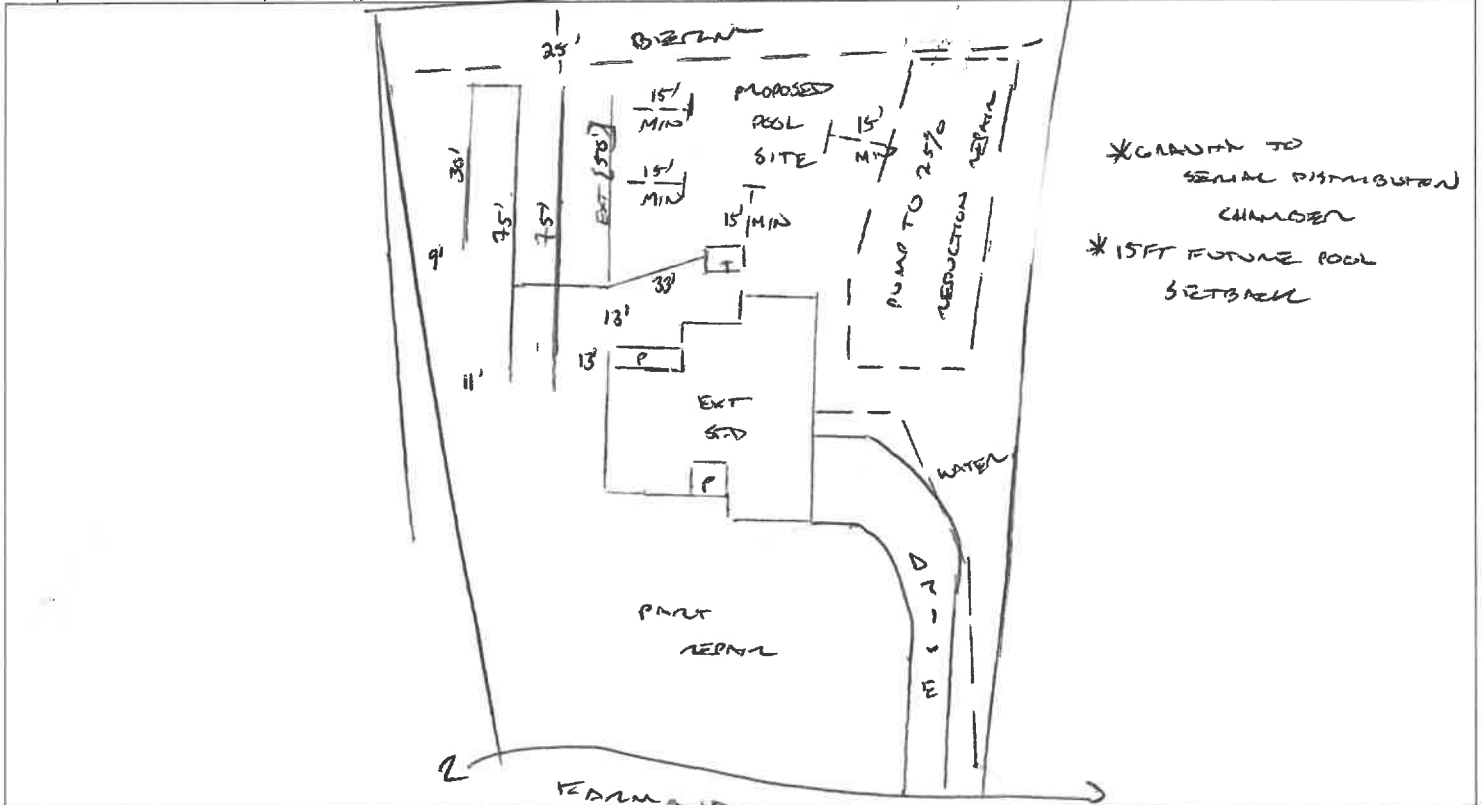

### PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  Pump  Alarm  H2O Line  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  Other OUT CHANGER IIIg Septic Tank: EXT (1000) gallons Pump Tank: \_\_\_\_\_ gallons  
 Subsurface No. of exact length width of depth of  
 Drainage Field ditches 1 of each ditch 230 feet ditches 3 feet ditches 26 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 01/20/2021