

HTE# 08-5-20949

Harnett County Department of Public Health

20310

PERMIT # 24845

Operation Permit

- New Installation
 Septic Tank
 Repair
 Nitrification Line
 Expansion

PROPERTY LOCATION: SR1452 Trulove RD

Name: (owner) JOHN C Duffin SR SUBDIVISION Trulove RD LOT # _____

System Installer: Adcock Excavation Registration # _____

Basement with plumbing: Garage Number of Bedrooms 3


Type of Water Supply: Community Public Well Distance from well 50 feet

System Type: 75% REDUCTION 5' x 6' Type III G S2 Lay Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

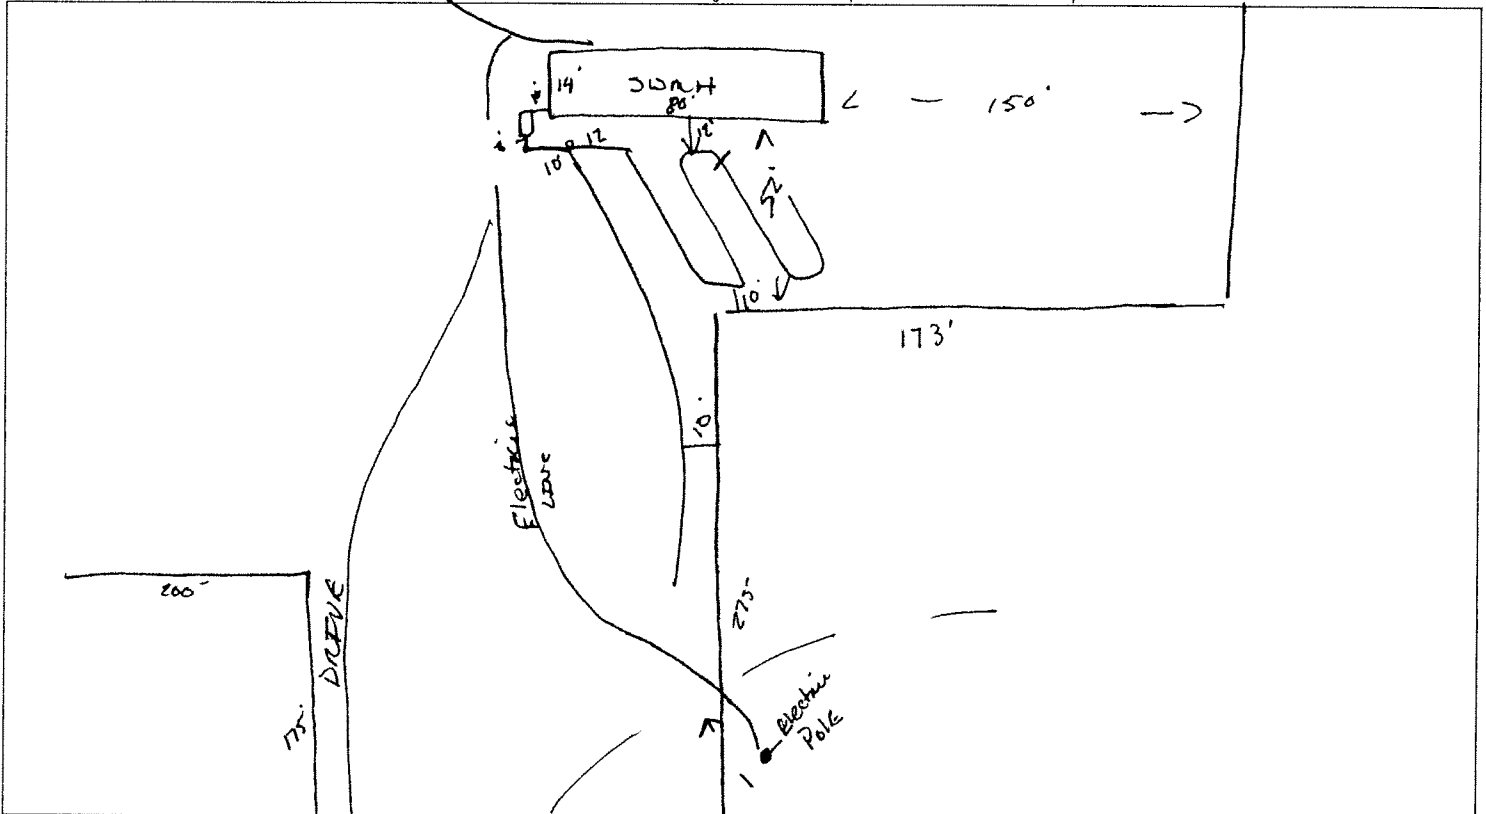

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

EX HOME

SR1452

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 75% REDUCTION Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface No. of exact length width of depth of

Drainage Field ditches 2 of each ditch 120 feet ditches 3 feet ditches 24-26-22 inches

French Drain Required: _____ Linear feet

Authorized State Agent

James E. Manhart

Date 10-30-08