




NOTICE TO CONTRACTOR
 All construction must comply with current NC Building Codes and is subject to field inspection and verification.


APPROVED
 Limited building only review
 Permit holder responsible for full compliance with the code

10/19/2020

Boyer

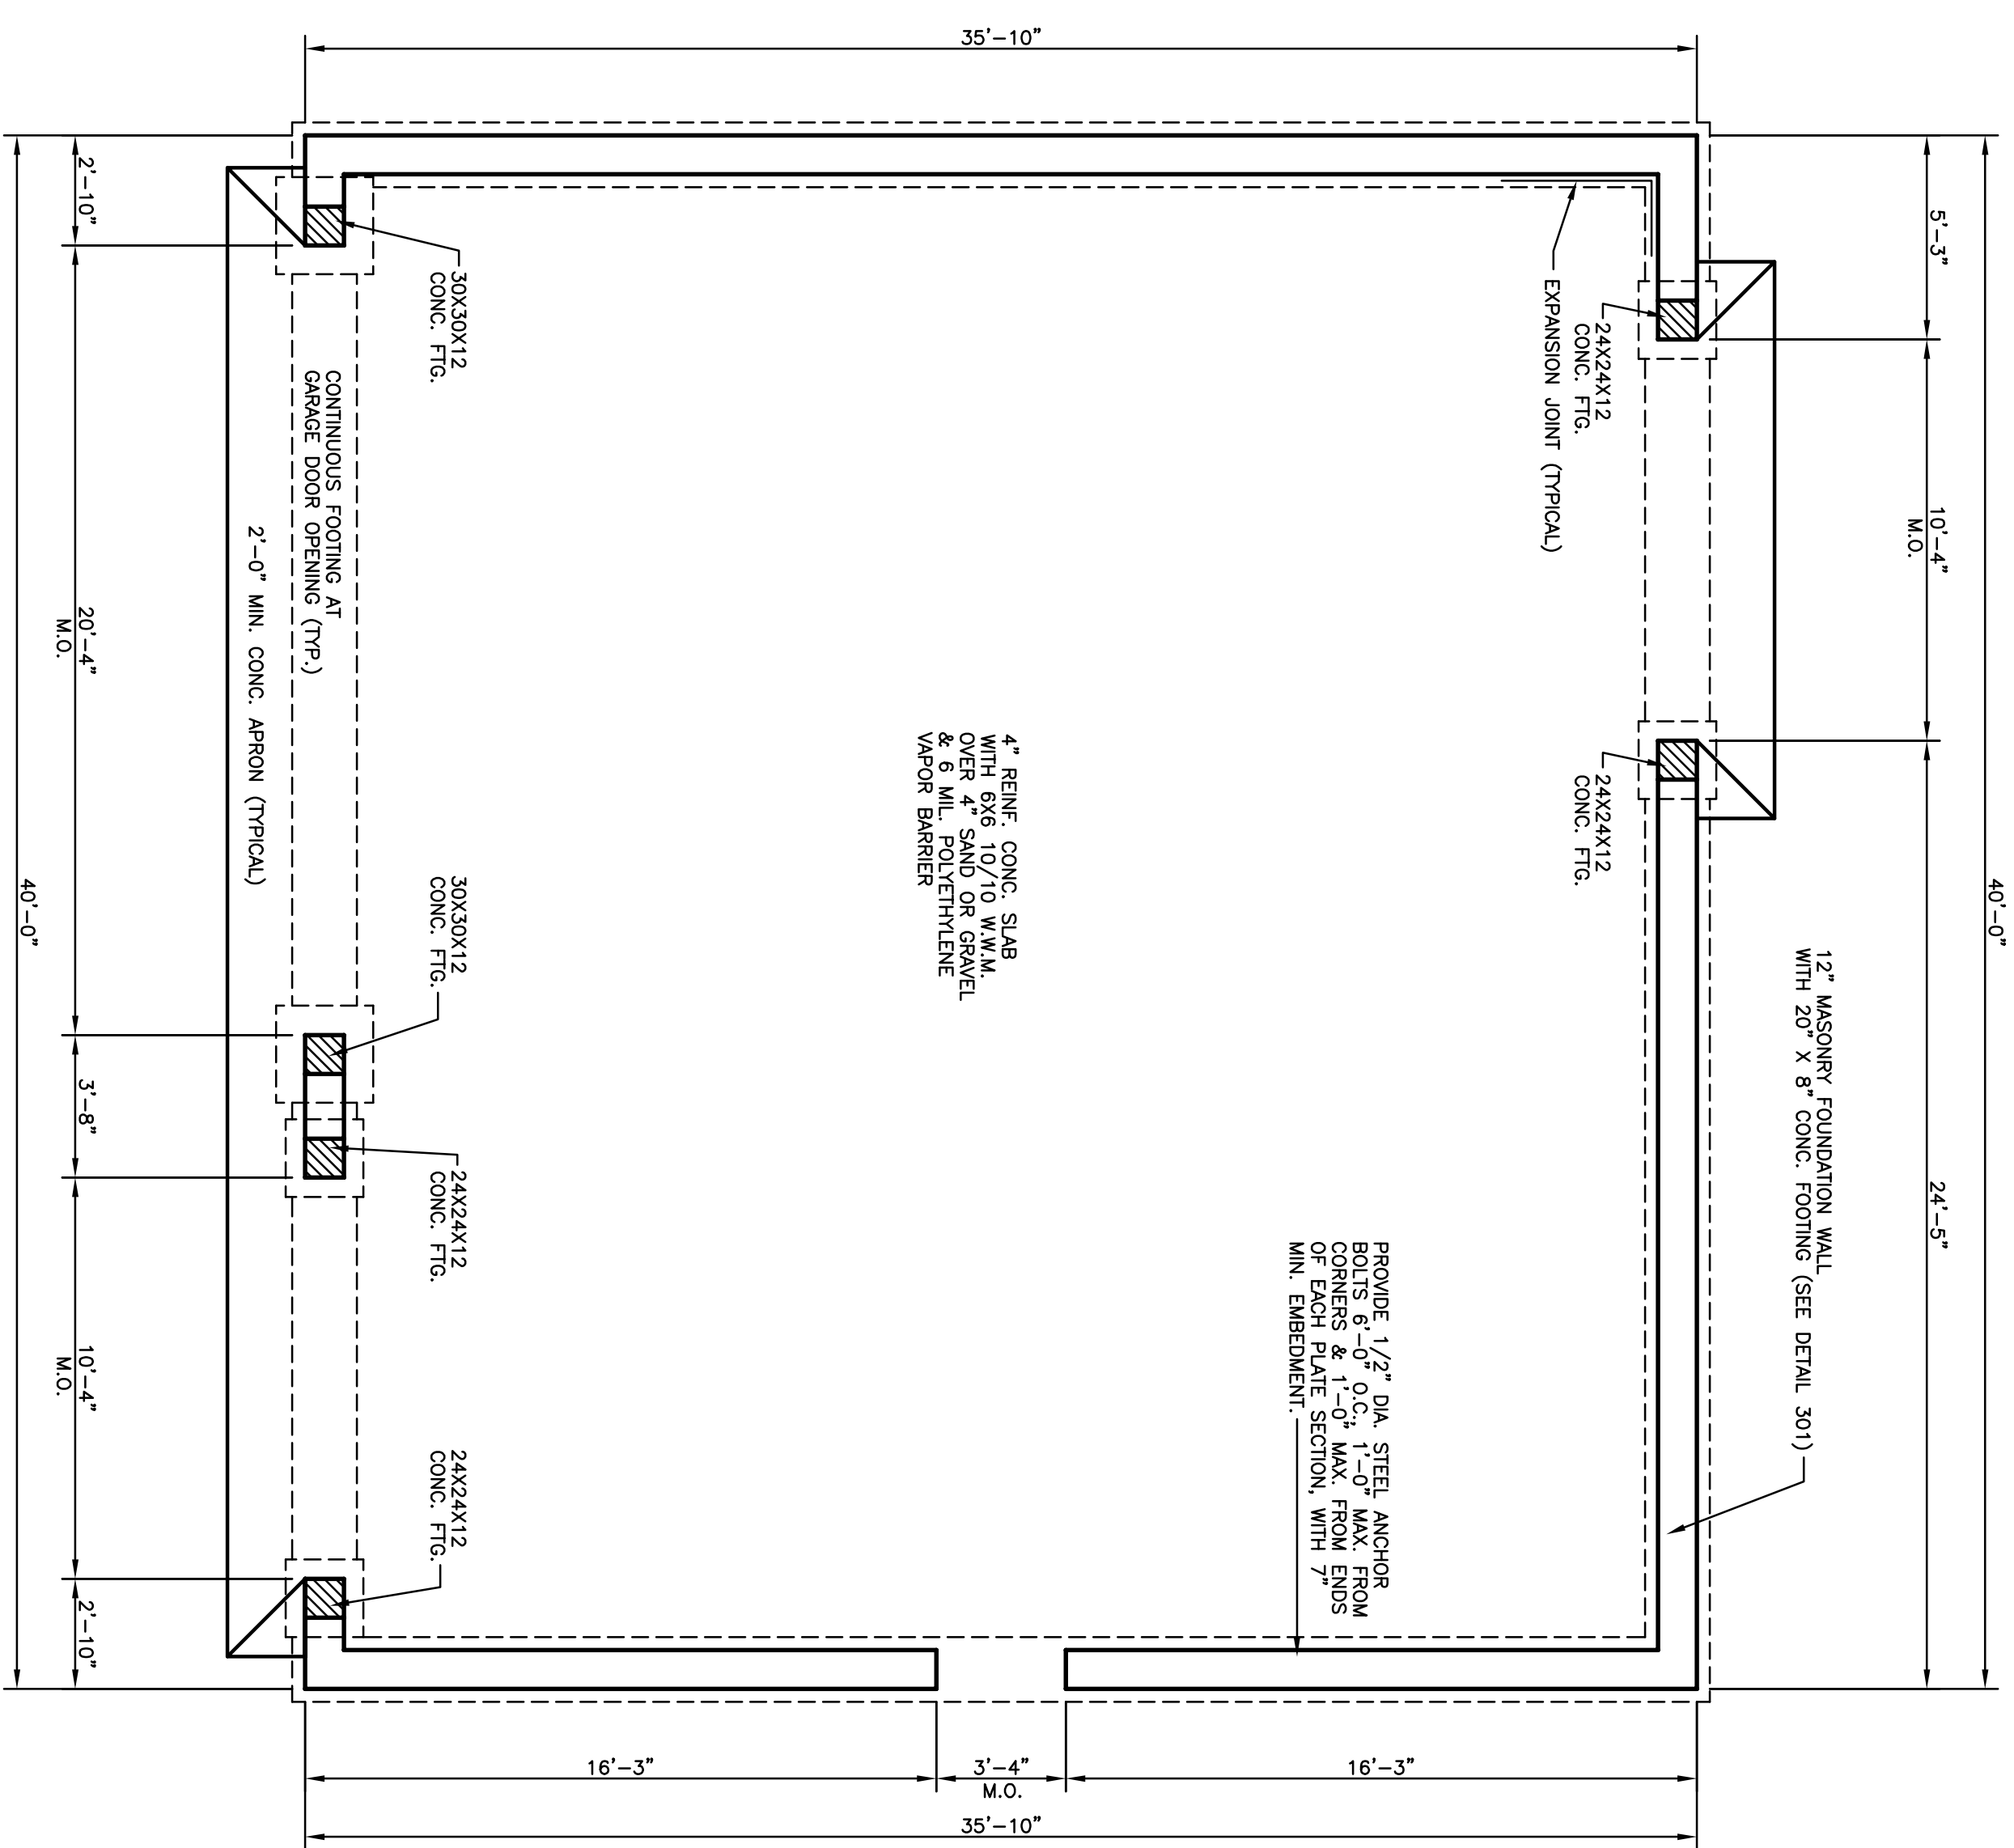


FOUNDATION PLAN
 SCALE: 1/4" = 1'-0"

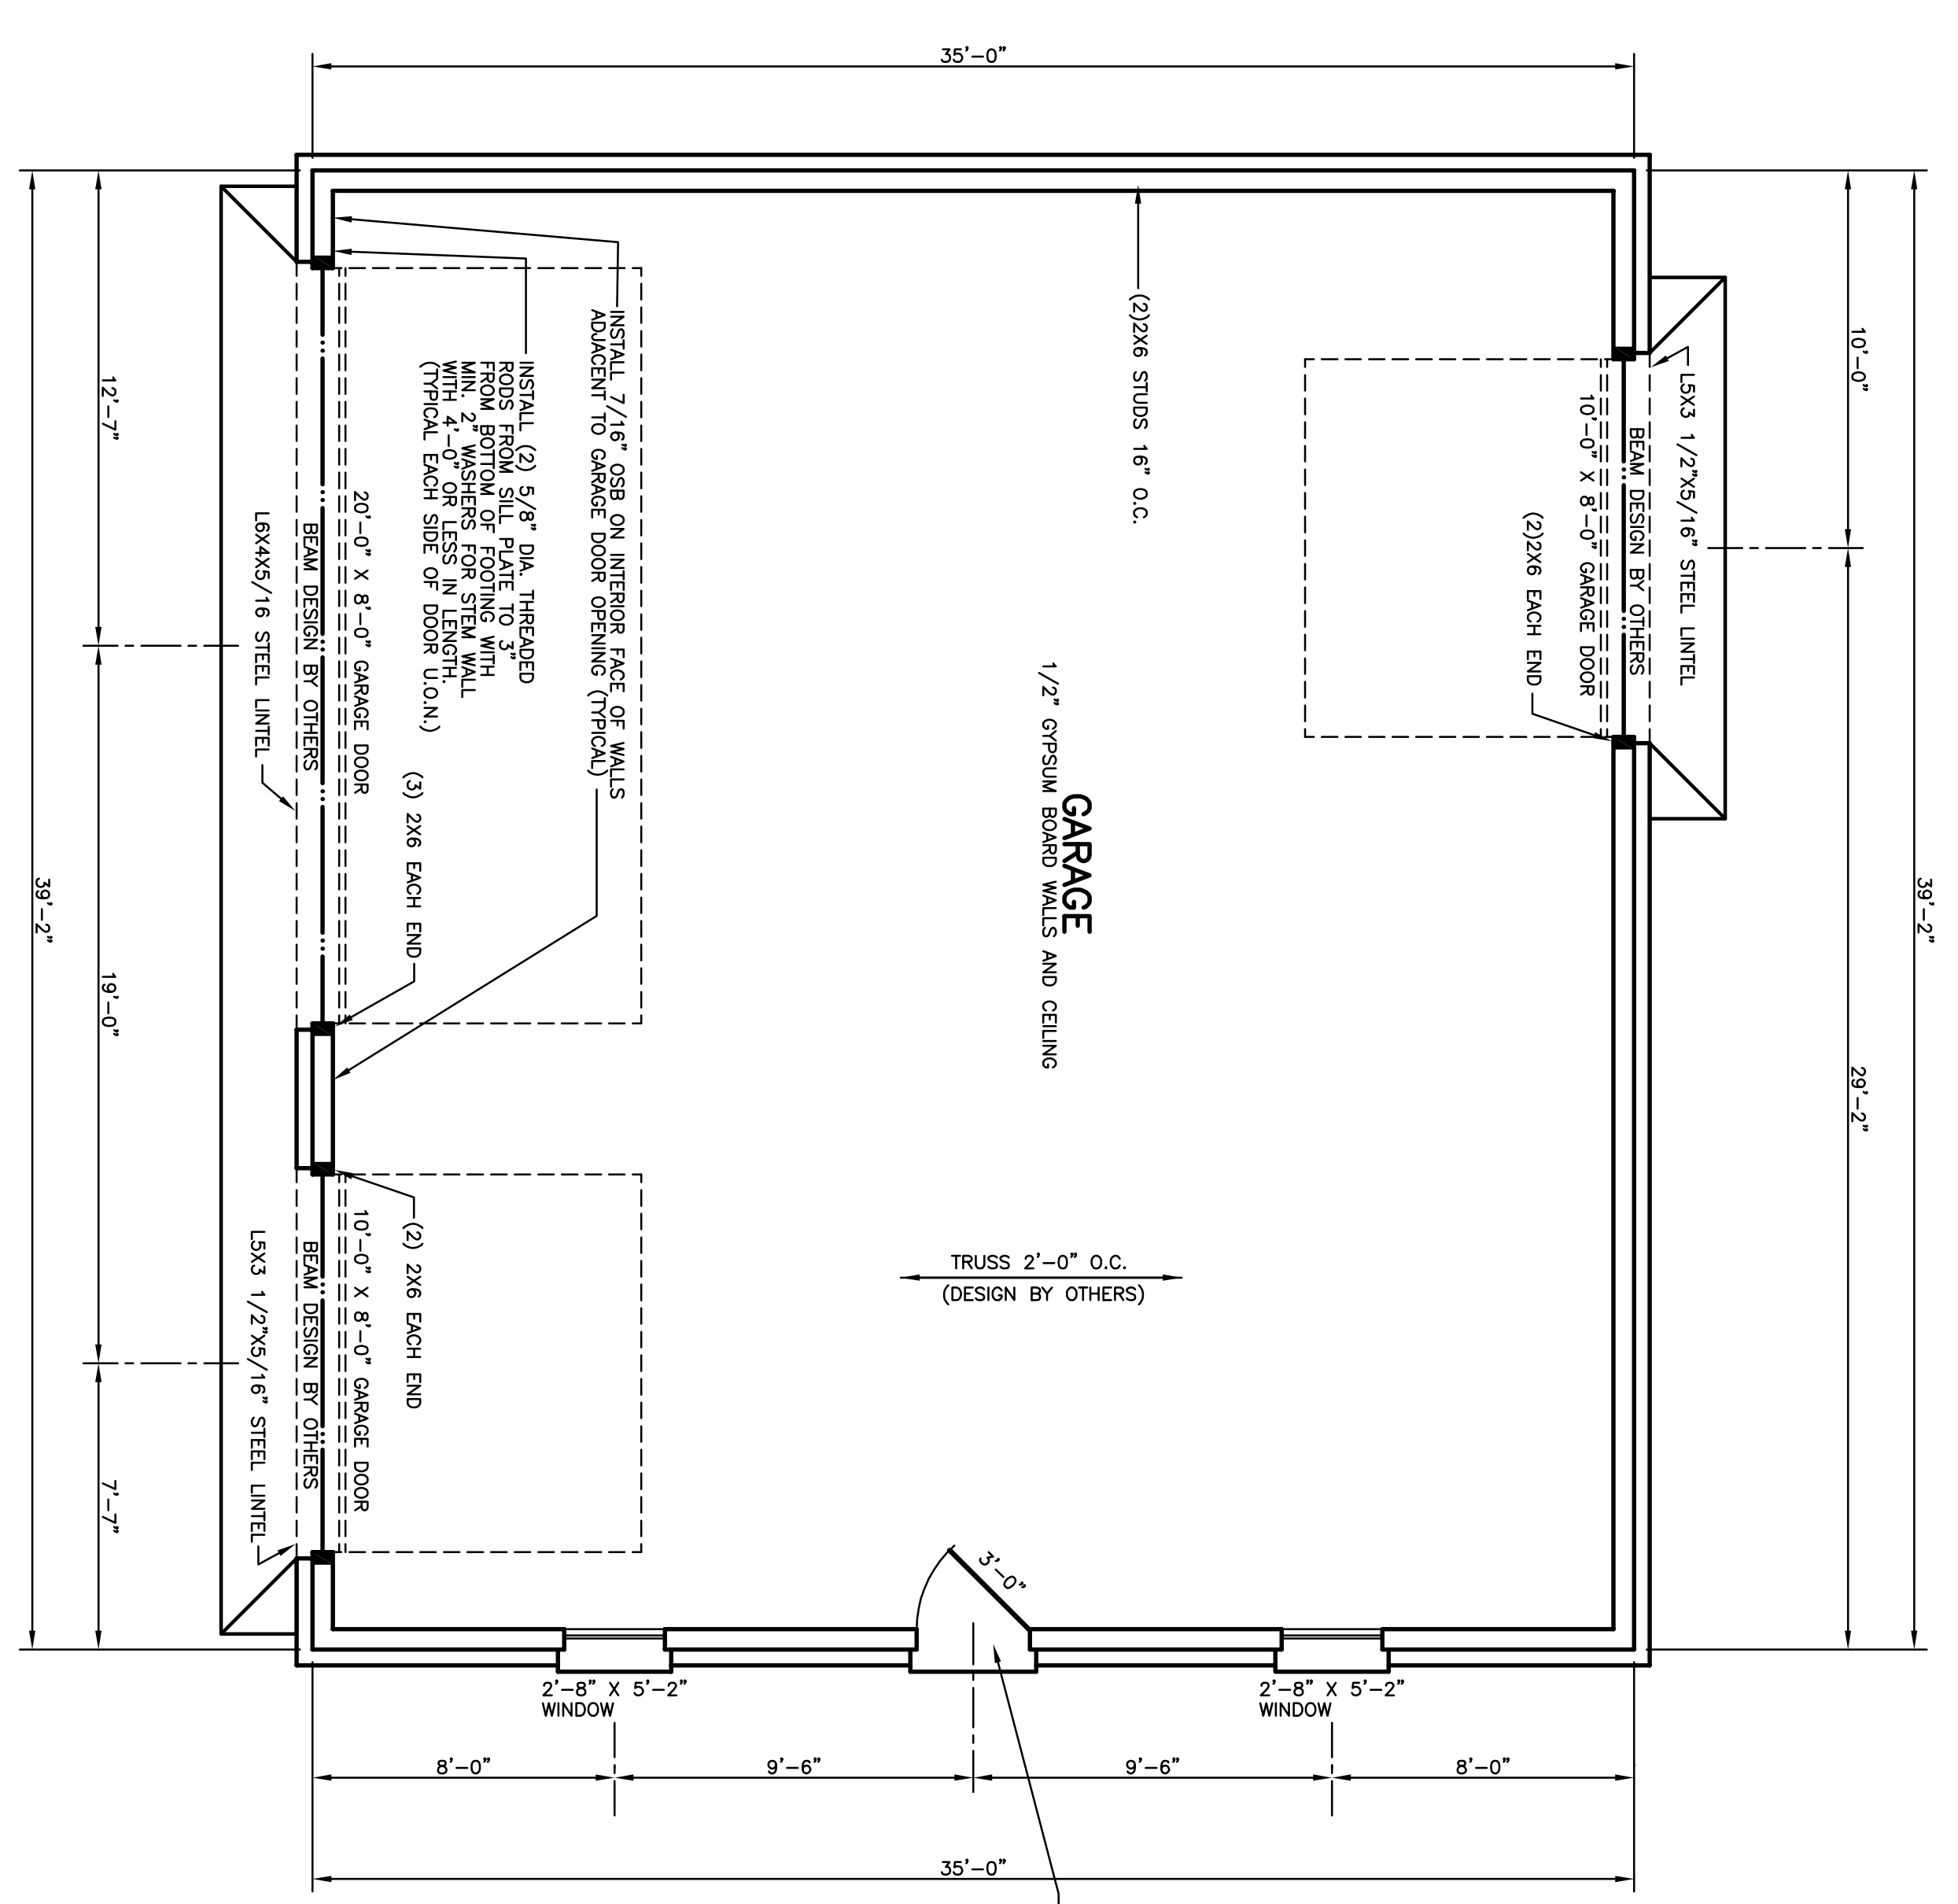


FLOOR PLAN
 SCALE: 1/4" = 1'-0"

TOTAL AREA: 1433 SQ. FT.
 CEILING HEIGHT: 12'-0"


WALL BRACING METHODS:
 CONTINUOUS SHEATHED WSP PER 2018 NCRG R602.10.3.1
 PORTAL FRAME AT GARAGE DOOR OPENINGS PER 2018 NCRG R602.10.1
 (NOTE: 3 1/2" X 11 1/4" NET HEADERS)

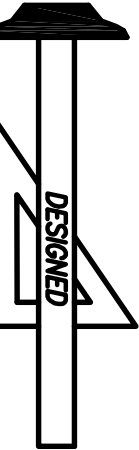

Standard Homes Plan Service, Inc.
 7200 SUNSET LAKE ROAD FLOUQUAY-VARINA, NC 27526
 (919)552-5677
 SEE HOME DESIGN FREQUENCIES ONLINE AT WWW.STANDARDHOMES.COM

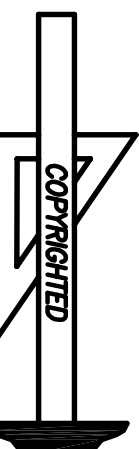


DESIGNED FOR	PLAN	NO.	DATE	SHEET
SHANE AND CARROLL HOLLAND	CUSTOM	2563	B.V.	2 OF 4

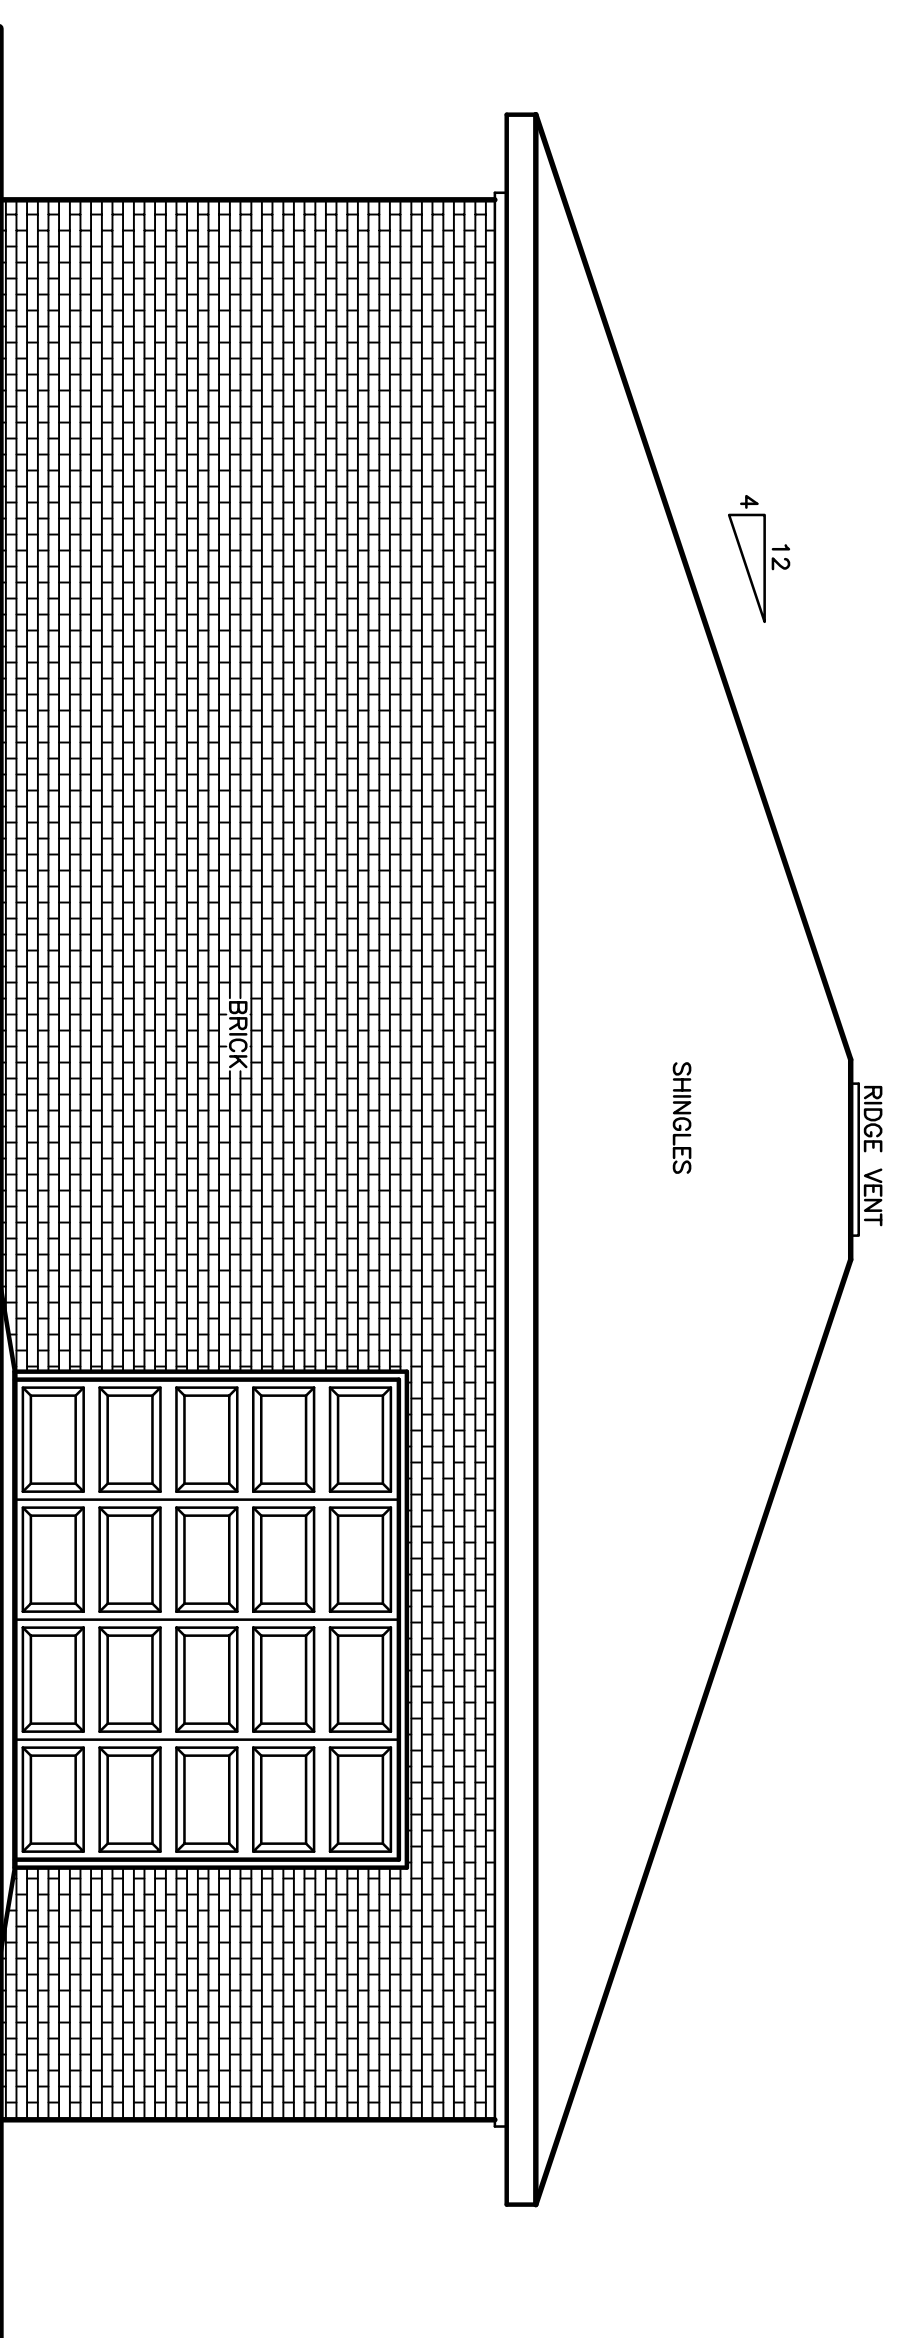


REAR ELEVATION

SCALE: 1/4" = 1'-0"

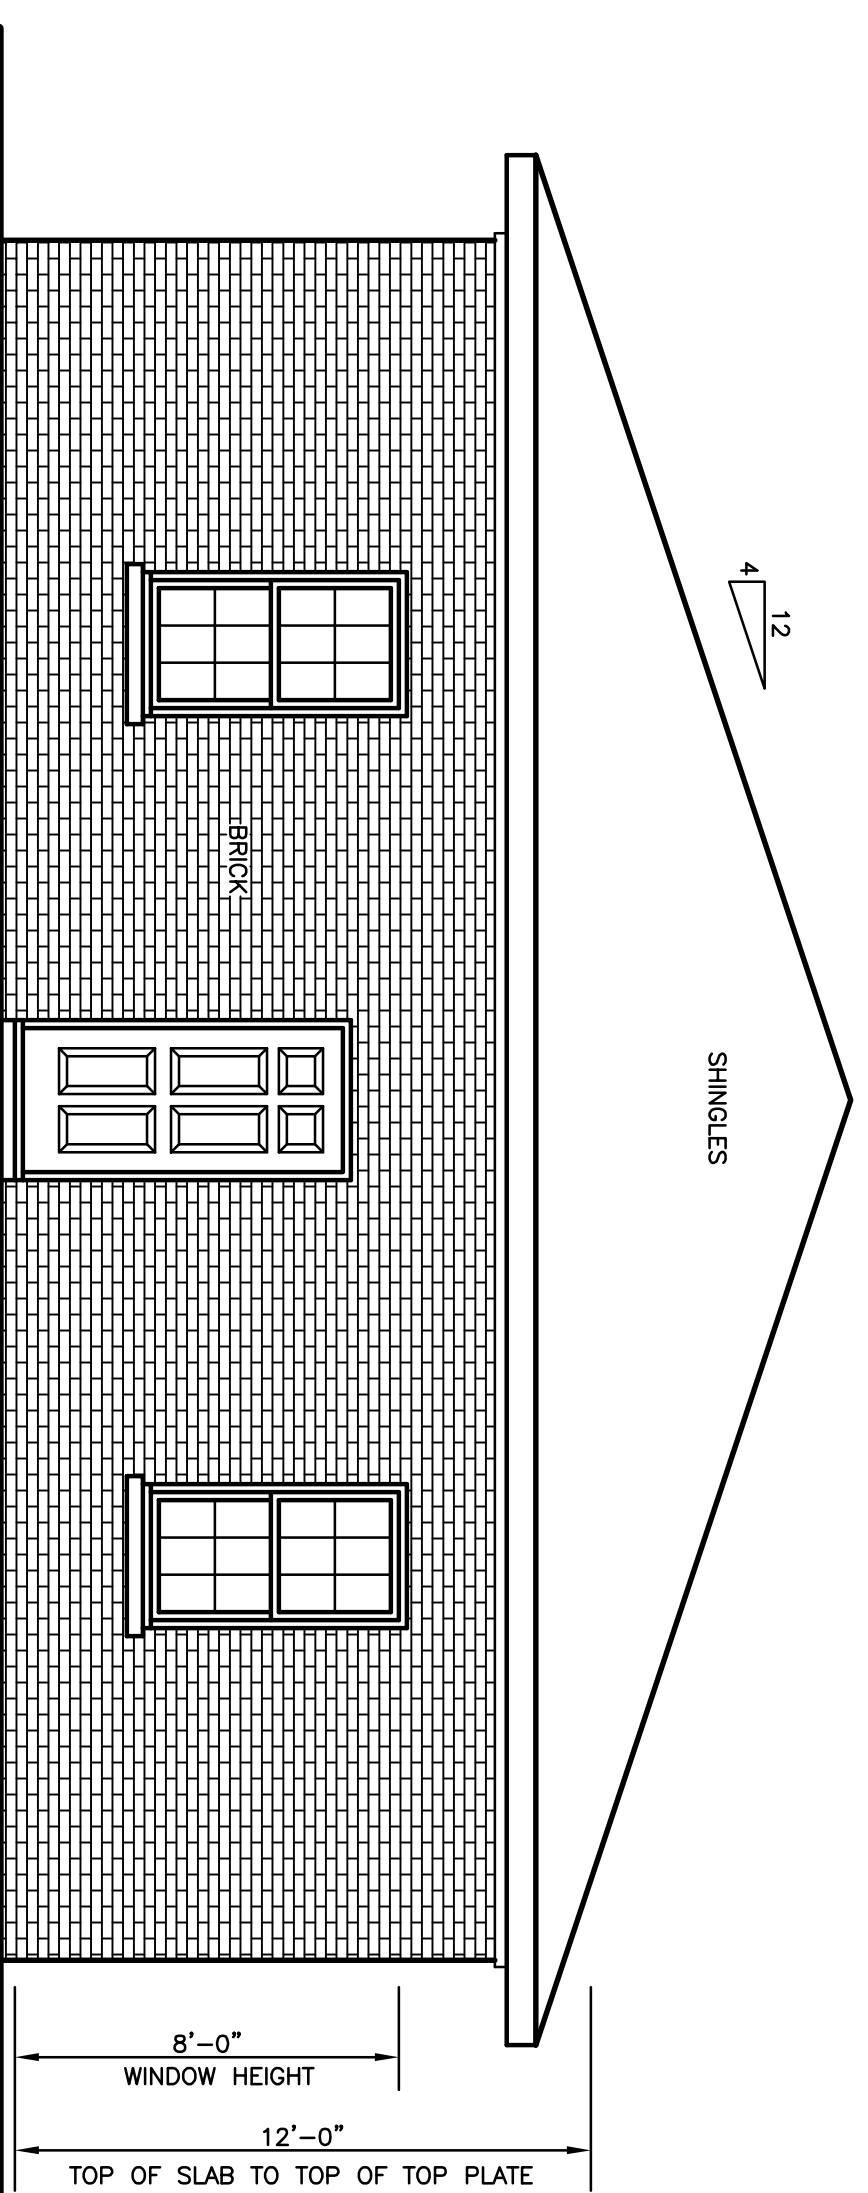


RIGHT SIDE ELEVATION

SCALE: 1/4" = 1'-0"

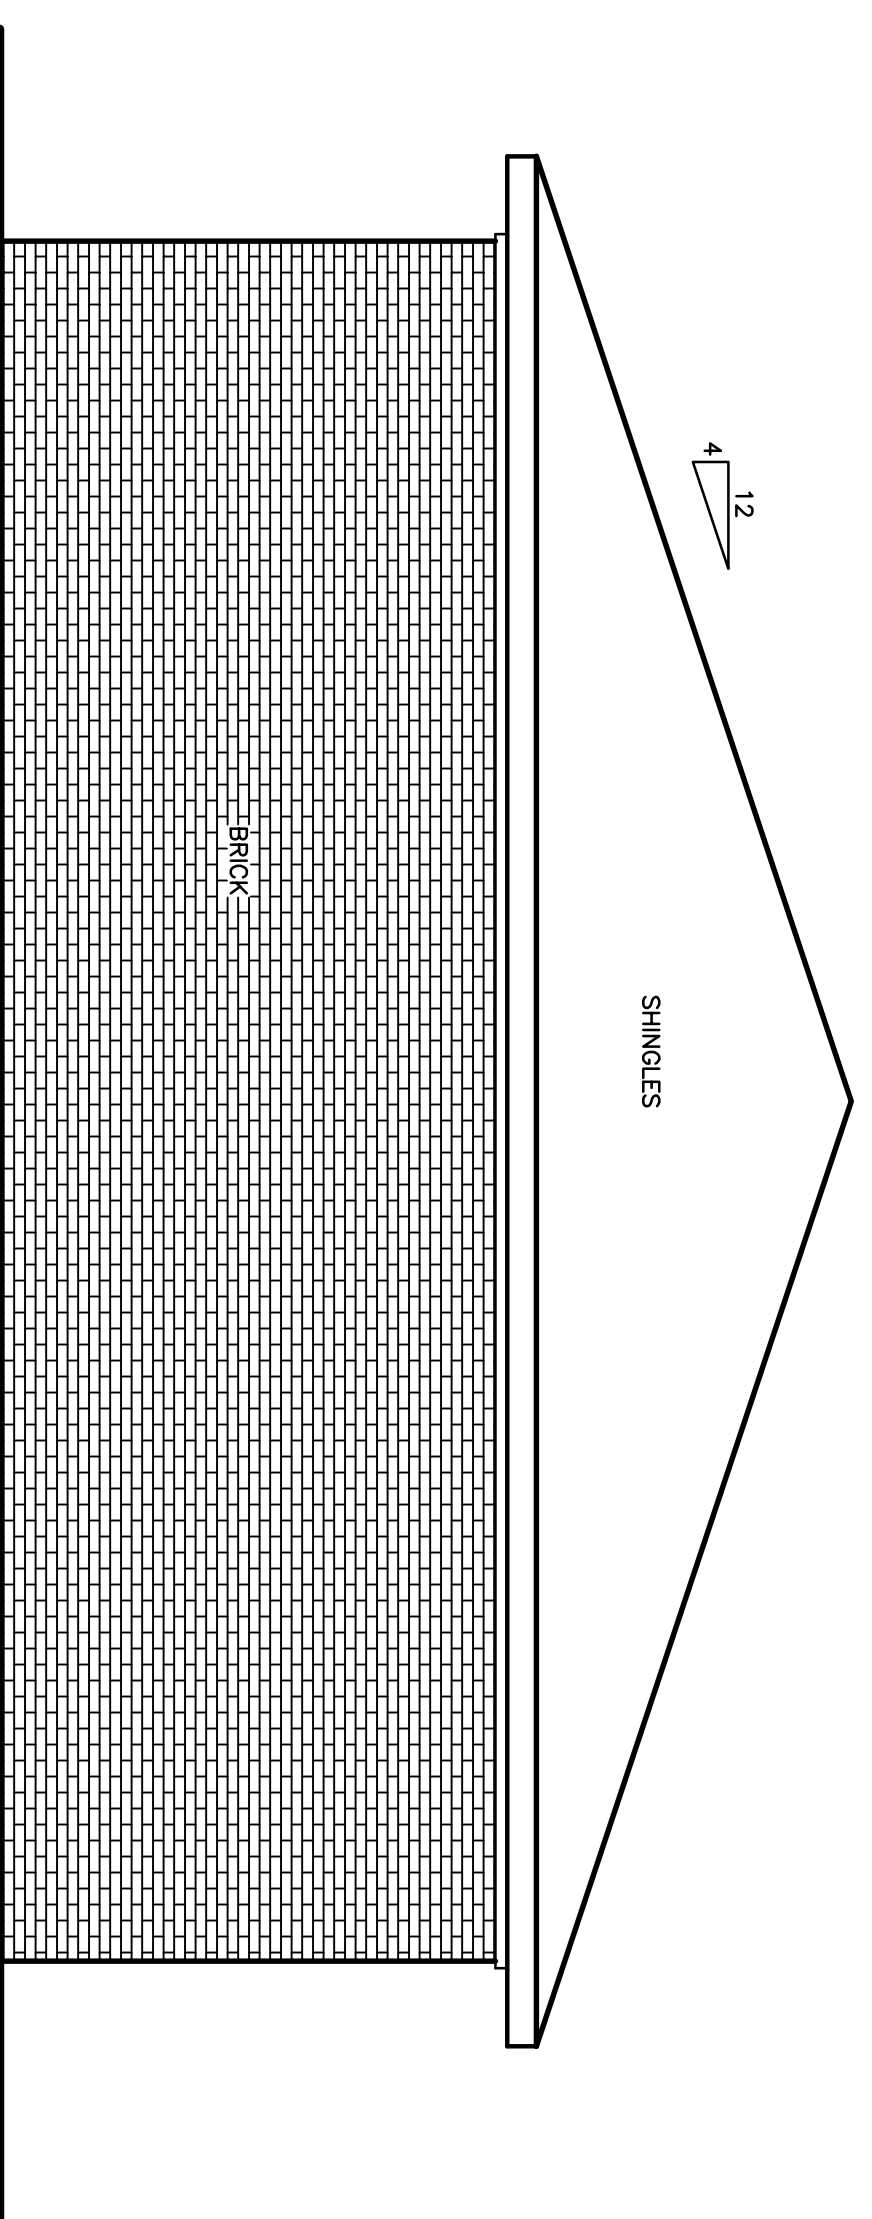


LEFT SIDE ELEVATION

SCALE: 1/4" = 1'-0"

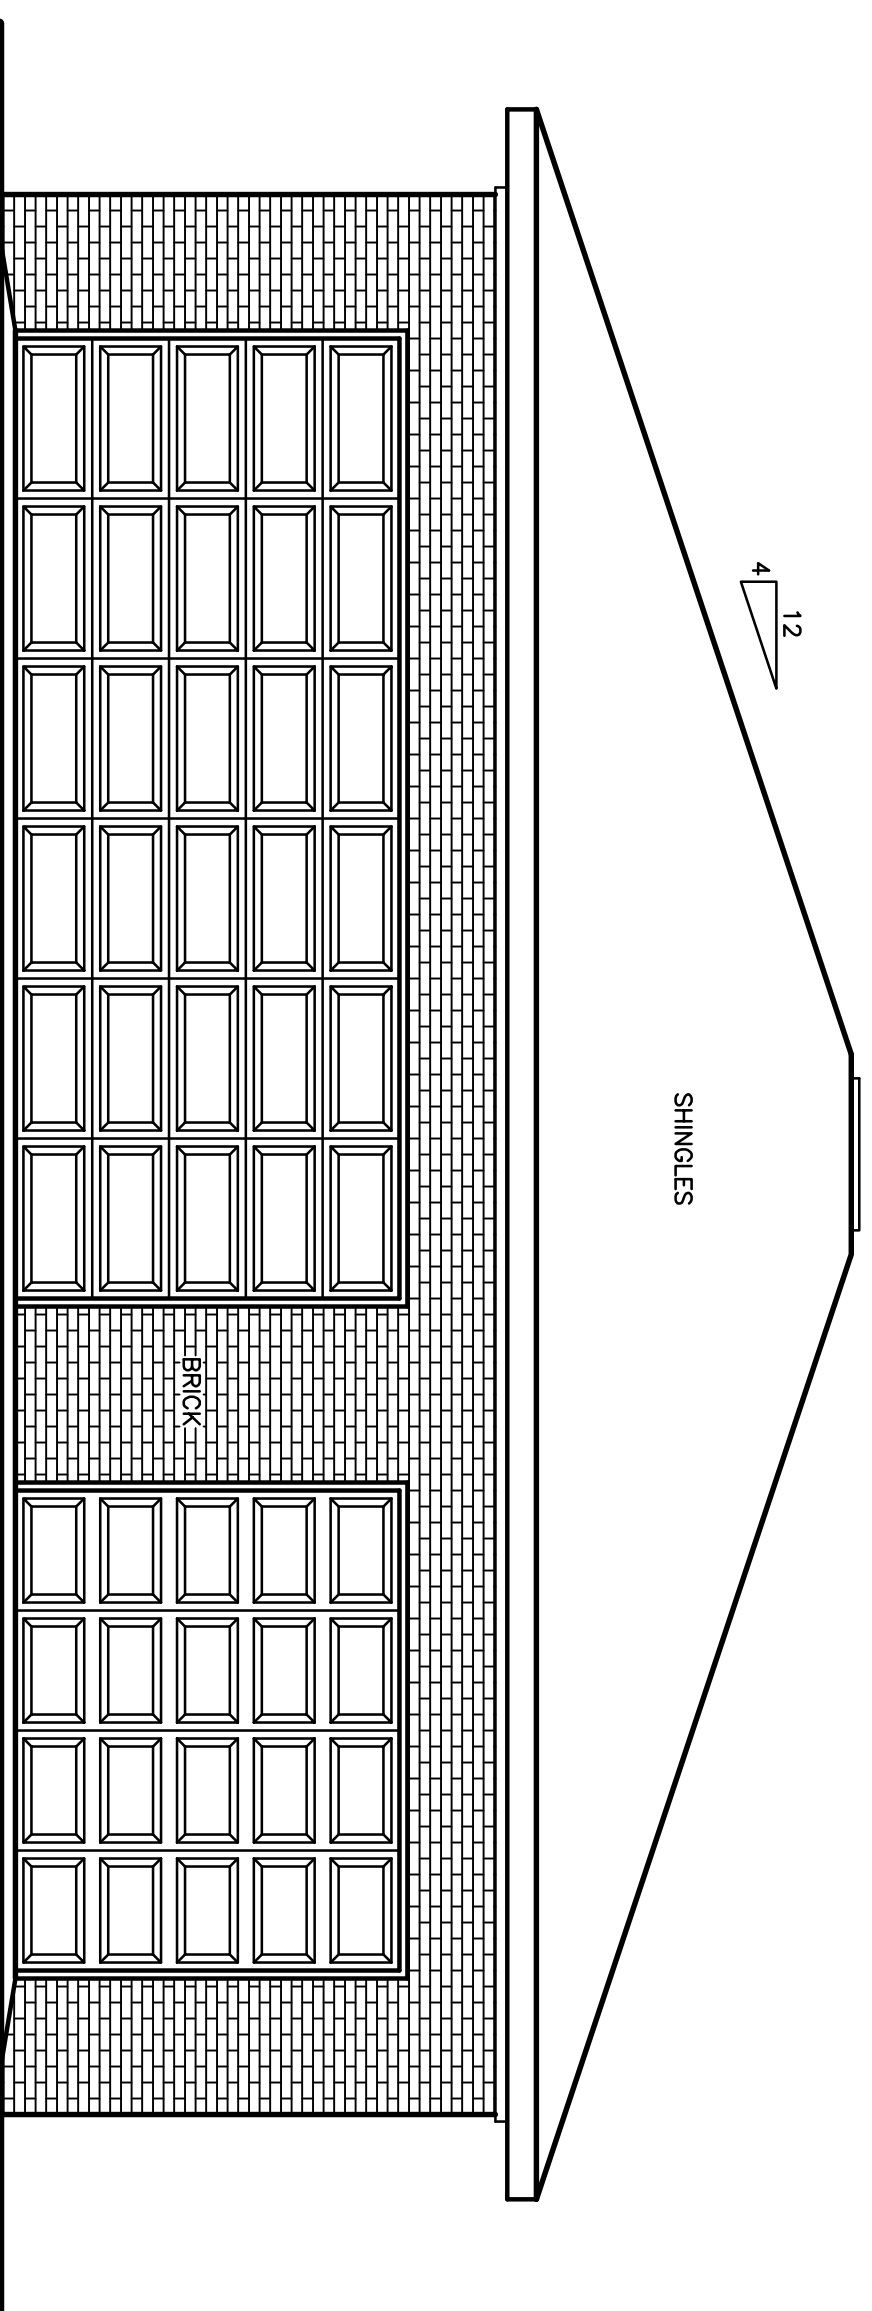

FRONT ELEVATION


SCALE: 1/4" = 1'-0"

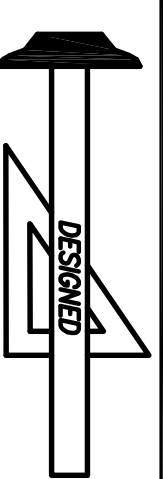

Standard Homes Plan Service, Inc.

7200 SUNSET LAKE ROAD FLOUQUA-VARINA, NC 27526

(919)552-5677

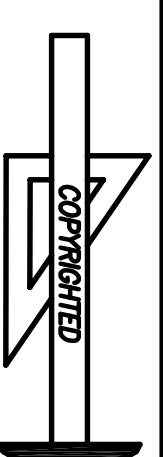

DESIGNED FOR
SHANE AND CARROLL HOLLAND

PLAN
CUSTOM

NO.
2563

MAT'L
B.V.

SHEET
4 OF 4


DRAWN 09-25-20

© 2009 STANDARD HOMES PLAN SERVICE, INC.

THIS LAYOUT IS TO BE USED AS A TRUSS PLACEMENT GUIDE ONLY.
PLEASE REFER TO BUILDING PLANS FOR BUILDING CONSTRUCTION AND DETAILS,
SUCH AS PLUMBING OR DUCT DROPS.

**PROPOSED DESIGN-
NOT FOR
CONSTRUCTION**

**HOLLAND HIP GARAGE
ROOF TRUSSES
2' OC, 17.5" OH**

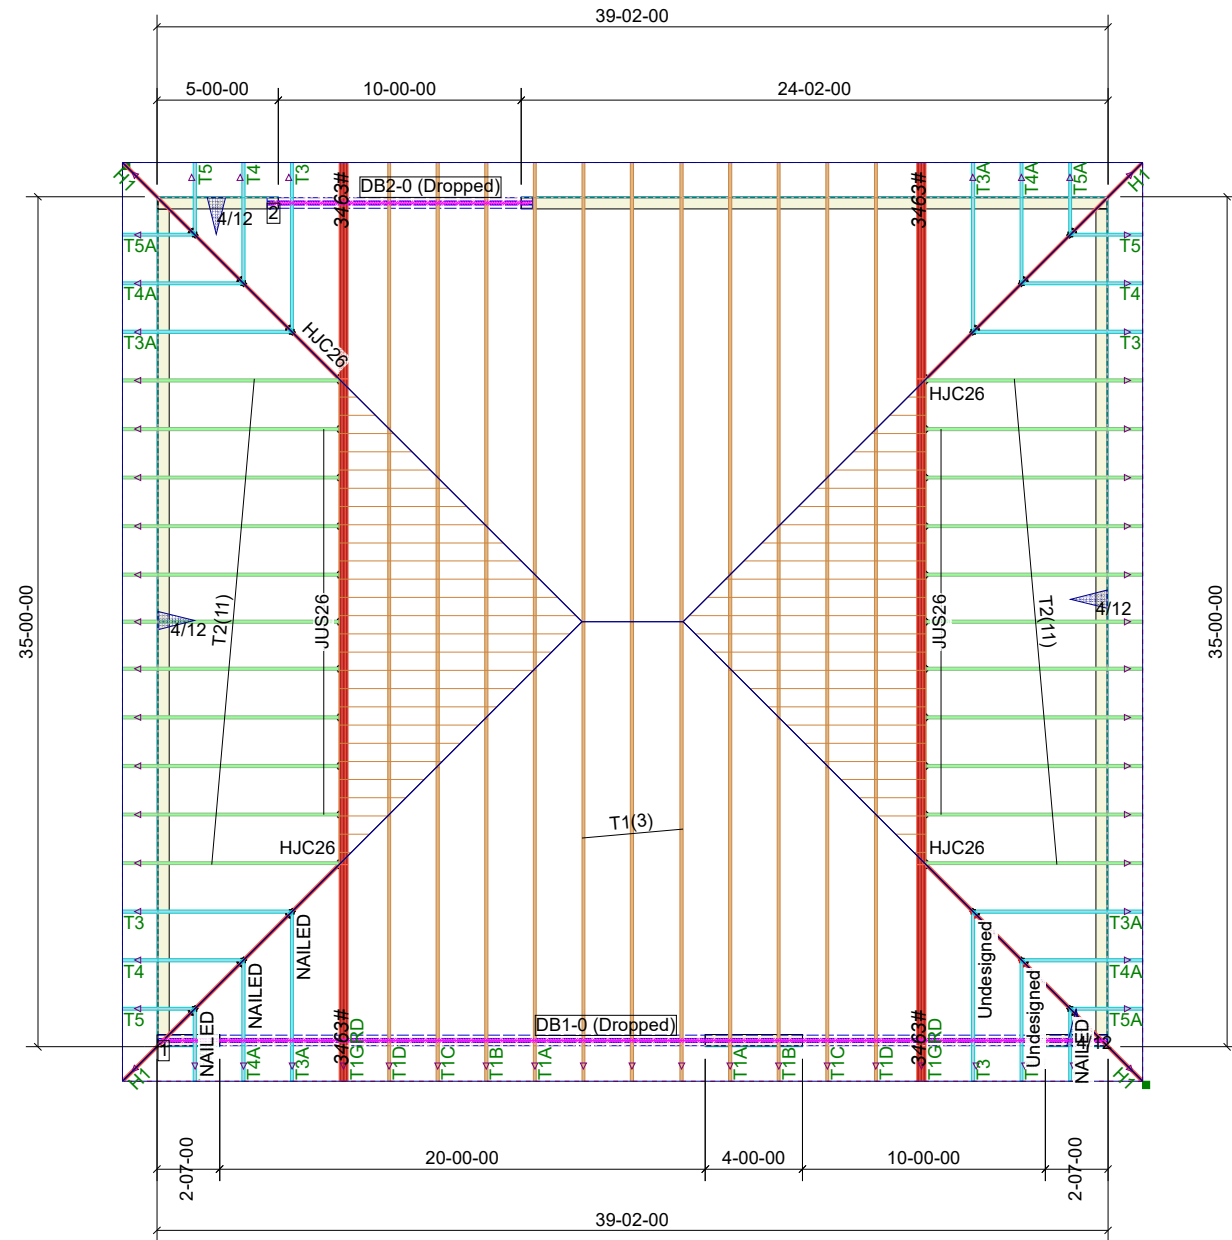

Products						
PlotID	Length	Product	Plies	Net Qty	Fab Type	
DB2-0 (Dropped)	12-00-00	1-3/4X9-1/4 LP-LVL 2900Fb-2.0E	3	3	MFD	
DB1-0 (Dropped)	40-00-00	1-3/4X16 LP-LVL 2900Fb-2.0E	3	3	MFD	

Truss Connector Total List		
Manuf	Product	Qty
USP	HJC26	4
USP	JUS26	18

Roof Truss Loading per
2018 NC Residential Code
Top Chord Live Load 20# PSF
Top Chord Dead Load 10# PSF
Bottom Chord Live Load 0# PSF
Bottom Chord Dead Load 10# PSF

Trusses are designed for additional
storage load wherever a 42"x24"
box will fit between the webs.



△ - This symbol denotes left end of
truss as shown on truss drawings

● - Approximate location of toilet
drop. Builder please confirm.

Truss connections by others:

⊕ -Nailed
⊖ -Ledger

- Notes:
- Exterior dimensions shown are assumed to be:
 Out-to-out of stud
 Out-to-out of sheathing
 - Adjust truss locations as needed for plumbing and mechanical clearance. Unless otherwise noted, trusses may be shifted as long as O.C. spacing shown is not exceeded.
 - Do not cut, drill, or otherwise damage any part of any truss without prior approval from Peak Truss.
 - Do not approve drawings if any information herein is unclear. Once ordered trusses will be fabricated as approved.
 - Please contact Peak Truss Builders with any questions. We are available to help in any way we can. We can be reached at 919-545-5555 or sales@peaktruss.com

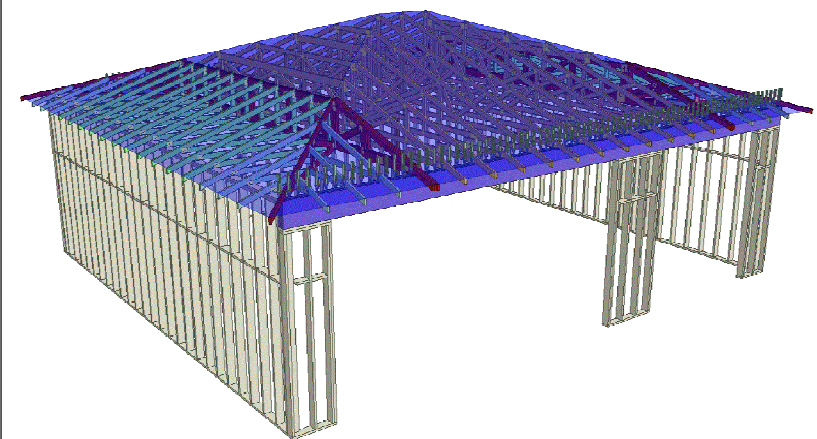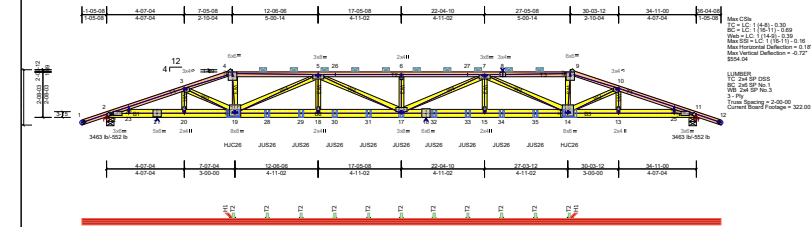

Job #

Q-2002493

Holland Hip Garage
3280 NC 210 South
Bunlevel NC
28323

Date Quoted:

Designer:

Sarah Billings

Valued Customer

**Peak Truss
Builders, LLC**
PO Box 340, New Hill, NC 27562


Job Q-2002493-1	Truss H1	Truss Type Diagonal Hip Girder	Qty 4	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	-------------	-----------------------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:17

Page: 1

ID: YGDyg?jRu3zgB1c?b?zNFayUC7V-?iFDkmm1?5XhUV5rOjo0pwBNO6BycUuDXz?J1XyUA6K

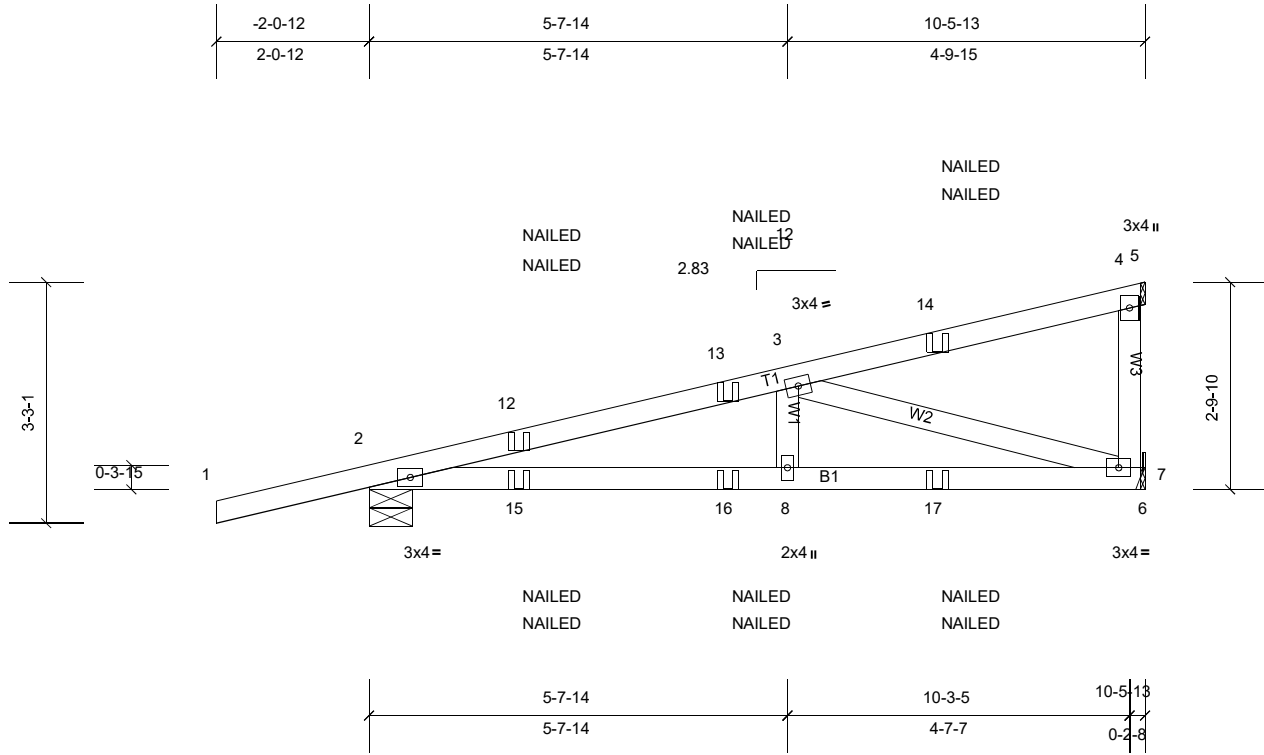

Scale = 1:31.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.43	Vert(LL)	-0.03	8-11	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.37	Vert(CT)	-0.07	8-11	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.50	Horz(CT)	0.01	7	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MS								
											Weight: 46 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-8-9 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=601/0-7-1, (min. 0-1-8), 7=557/ Mechanical, (min. 0-1-8)
 Max Horiz 2=86 (LC 19)
 Max Uplift 2=-124 (LC 7), 7=-49 (LC 7)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-12=-1154/54, 12-13=-1136/63, 3-13=-1103/65
 BOT CHORD 2-15=-72/1106, 15-16=-72/1106, 8-16=-72/1106, 8-17=-72/1106, 7-17=-72/1106
 WEBS 3-7=-1086/86

NOTES

- 1) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TC DL=6.0psf; BC DL=6.0psf; h=30ft; B=20ft; L=20ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 124 lb uplift at joint 2 and 49 lb uplift at joint 7.
- 5) This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- 6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-4=-60, 4-5=-20, 6-9=-20
 Concentrated Loads (lb)
 Vert: 13=5 (F=-3, B=-3), 14=-105 (F=-52, B=-52), 15=9 (F=5, B=5), 16=-23 (F=-11, B=-11), 17=-80 (F=-40, B=-40)

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


Job Q-2002493-1	Truss T1	Truss Type Common	Qty 3	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	-------------	----------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:17

Page: 1

ID:N93nMEaXUgaEMLGtSBHoJFyUC7g-?iFDkmm1?5XhUV5rOjo0pwBLs64UcQ9DXz?J1XyUA6K

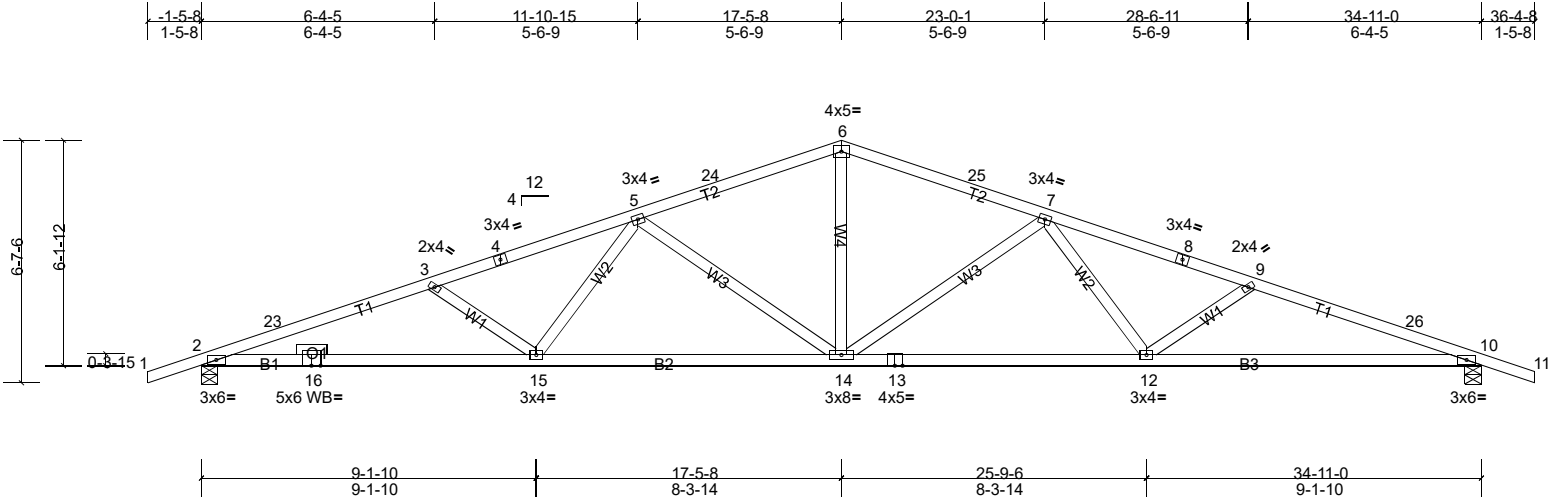

Scale = 1:62.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.53	Vert(LL)	-0.23	14	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.78	Vert(CT)	-0.50	14-15	>830	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.74	Horz(CT)	0.15	10	n/a	n/a	
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MS							Weight: 165 lb FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-9-2 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=1484/0-5-4, (min. 0-2-5), 10=1484/0-5-8, (min. 0-2-5)
 Max Horiz 2=-63 (LC 9)
 Max Uplift 2=-223 (LC 11), 10=-223 (LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-23=-3615/457, 3-23=-3585/476, 3-4=-3273/392, 4-5=-3219/406, 5-24=-2277/323, 6-24=-2221/342, 6-25=-2221/342, 7-25=-2277/323, 7-8=-3219/406, 8-9=-3273/392, 9-26=-3585/476, 10-26=-3615/457
 BOT CHORD 2-16=-377/3401, 15-16=-377/3401, 14-15=-261/2754, 13-14=-261/2754, 12-13=-261/2754, 10-12=-377/3401
 WEBS 6-14=-102/1096, 7-14=-809/170, 7-12=0/530, 9-12=-430/155, 5-14=-809/170, 5-15=0/530, 3-15=-430/155

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TC DL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=35ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) -1-5-8 to 2-0-6, Interior (1) 2-0-6 to 17-5-8, Exterior (2) 17-5-8 to 20-11-6, Interior (1) 20-11-6 to 36-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 223 lb uplift at joint 2 and 223 lb uplift at joint 10.
 - This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard


Job Q-2002493-1	Truss T1A	Truss Type Hip	Qty 2	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	--------------	-------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:18

Page: 1

ID: rLdAZabAF_i5_Vr40uo1rTyUC7f-Tupbx6nfmPFY6fg1yQJFL7kSfWPuLpQMmdkZ_yUA6J

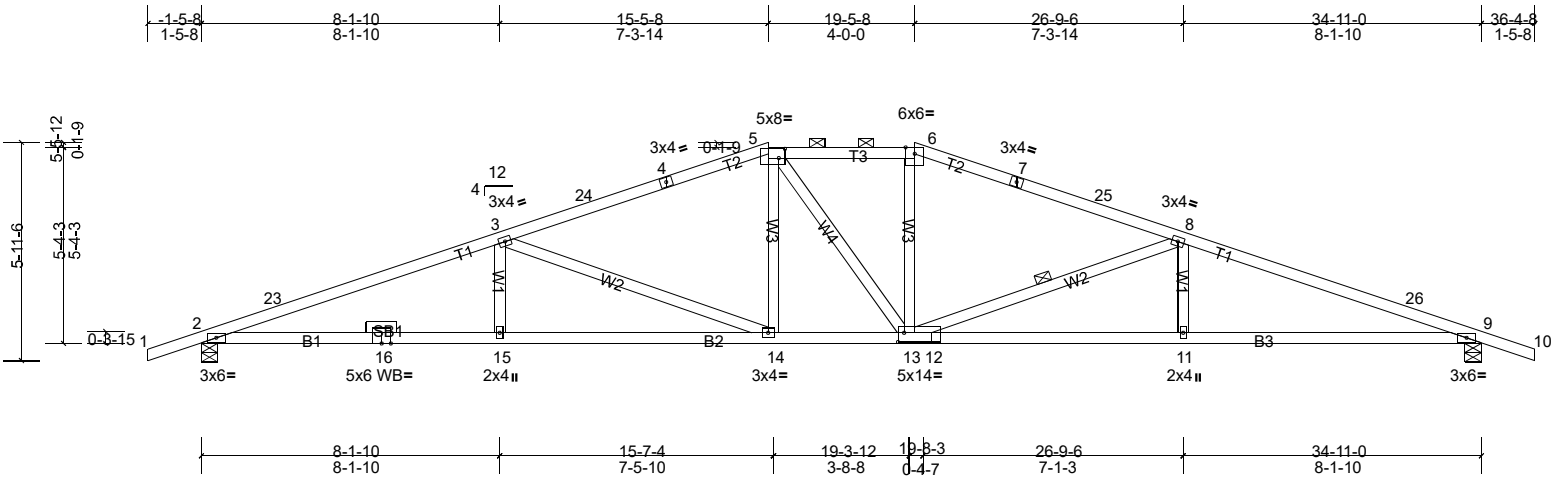

Scale = 1:62.8

Plate Offsets (X, Y): [5:0-2-0,0-3-0], [12:0-2-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	0.78	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.78	Vert(LL)	-0.25 11-12	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.83	Vert(CT)	-0.56 11-12	>751	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	1.00	Horz(CT)	0.15 9	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MS							Weight: 166 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3 *Except* W2:2x4 SP No.1
 OTHERS 2x4 SP No.3

REACTIONS (lb/size) 2=1479/0-5-4, (min. 0-2-5), 9=1477/0-5-8, (min. 0-2-5)
 Max Horiz 2=-56 (LC 9)
 Max Uplift 2=-226 (LC 11), 9=-227 (LC 11)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-23=-3531/427, 3-23=-3471/452, 3-24=-2537/347, 4-24=-2464/360, 4-5=-2447/372, 5-6=-2337/387, 6-7=-2433/383,
 7-25=-2450/371, 8-25=-2522/358, 8-26=-3475/456, 9-26=-3535/431
 BOT CHORD 2-16=-344/3293, 15-16=-344/3293, 14-15=-344/3293, 13-14=-181/2351, 11-12=-348/3297, 9-11=-348/3297
 WEBS 3-14=-1030/174, 5-14=0/473, 6-13=-2/441, 12-13=-192/2324, 8-12=-1052/169

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=35ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) -1-5-8 to 2-0-6, Interior (1) 2-0-6 to 15-5-8, Exterior (2) 15-5-8 to 24-4-12, Interior (1) 24-4-12 to 36-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 226 lb uplift at joint 2 and 227 lb uplift at joint 9.
- This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


Job Q-2002493-1	Truss T1B	Truss Type Hip	Qty 2	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	--------------	-------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:18

Page: 1

ID:JXBYnwco0lrycfQGacJGQgyUC7e-Tupbx6nfmPFY6fg1yQJFL7kVqWR1LIFmmdkZ_yUA6J

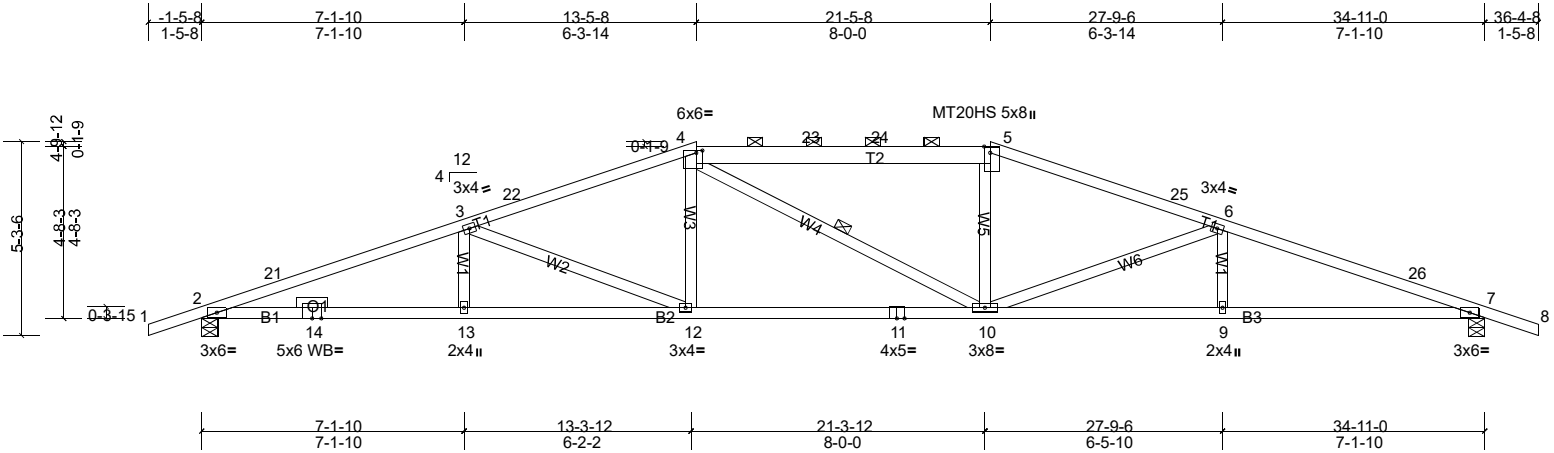

Scale = 1:62.7

Plate Offsets (X, Y): [4:0-2-0,0-0-12], [5:0-2-1,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	0.58	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.58	Vert(LL)	-0.23 10-12	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.76	Vert(CT)	-0.52 10-12	>800	180	MT20HS	187/143
BCLL	0.0*	Rep Stress Incr	YES	WB	0.75	Horz(CT)	0.15 7	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MS							Weight: 169 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1 *Except* T2:2x6 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

REACTIONS (lb/size) 2=1484/0-5-4, (min. 0-2-5), 7=1484/0-5-4, (min. 0-2-5)
 Max Horiz 2=49 (LC 10)
 Max Uplift 2=-223 (LC 11), 7=-223 (LC 11)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-21=-3601/427, 3-21=-3562/449, 3-22=-2838/361, 4-22=-2776/382, 4-23=-2636/383, 23-24=-2636/383, 5-24=-2636/383,
 5-25=-2755/381, 6-25=-2817/360, 6-26=-3562/448, 7-26=-3601/426
 BOT CHORD 2-14=-348/3379, 13-14=-348/3379, 12-13=-348/3379, 11-12=-214/2627, 10-11=-214/2627, 9-10=-347/3379,
 7-9=-347/3379
 WEBS 3-12=-802/145, 4-12=0/435, 5-10=0/429, 6-10=-819/144

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=35ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) -1-5-8 to 2-0-6, Interior (1) 2-0-6 to 13-5-8, Exterior (2) 13-5-8 to 18-4-12, Interior (1) 18-4-12 to 21-5-8, Exterior (2) 21-5-8 to 26-4-12, Interior (1) 26-4-12 to 36-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 223 lb uplift at joint 2 and 223 lb uplift at joint 7.
- This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-8-6 oc purlins, except 2-0-0 oc purlins (4-2-11 max.); 4-5.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 4-10

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


Job Q-2002493-1	Truss T1C	Truss Type Hip	Qty 2	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	--------------	-------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:18

Page: 1

ID:JXBjYnwco0lrycfQGacJGOGyUC7e-Tupbx6nfmPFY6fy1yQJFL7kX3WSzLvbMmdktZ_yUA6J

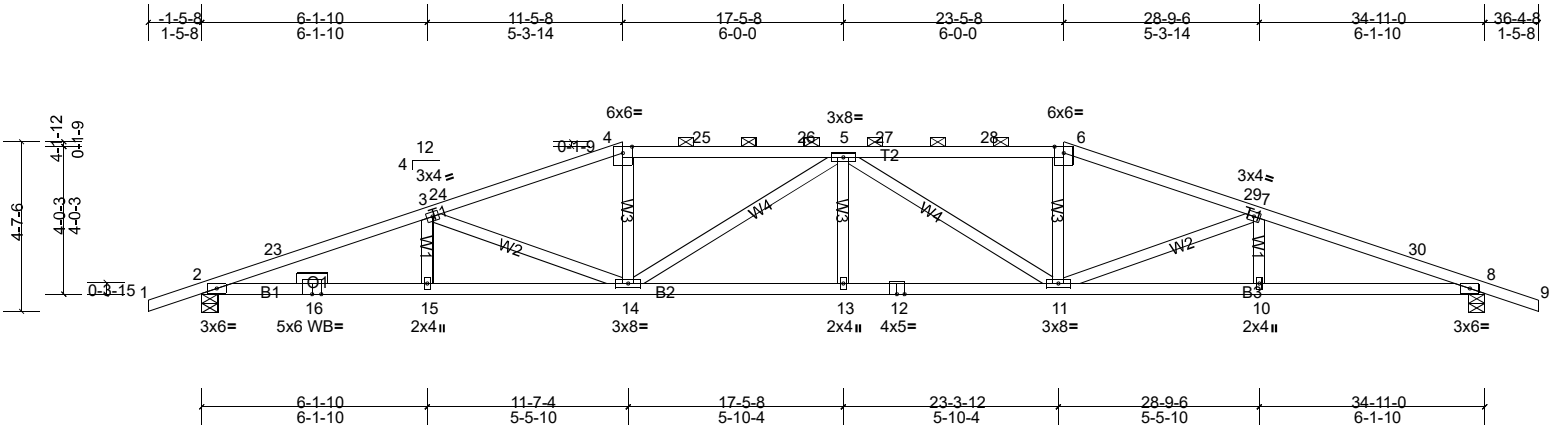

Scale = 1:62.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.50	Vert(LL)	-0.27	13	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.70	Vert(CT)	-0.55	13-14	>756	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.60	Horz(CT)	0.16	8	n/a	n/a	
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MS							Weight: 168 lb FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-10-3 oc purlins, except
 2-0-0 oc purlins (3-3-8 max.): 4-6.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=1484/0-5-4, (min. 0-2-5), 8=1484/0-5-4, (min. 0-2-5)
 Max Horiz 2=42 (LC 10)
 Max Uplift 2=-223 (LC 11), 8=-223 (LC 11)

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-23=-3678/432, 3-23=-3633/450, 3-24=-3047/385, 4-24=-3040/404, 4-25=-2876/403, 25-26=-2876/403, 5-26=-2878/402, 5-27=-2878/402, 27-28=-2876/403, 6-28=-2876/403, 6-29=-3040/404, 7-29=-3047/385, 7-30=-3633/450, 8-30=-3678/432
 BOT CHORD 2-16=-356/3447, 15-16=-356/3447, 14-15=-356/3447, 13-14=-318/3320, 12-13=-318/3320, 11-12=-318/3320, 10-11=-356/3447, 8-10=-356/3447
 WEBS 3-14=-647/110, 4-14=-14/632, 5-14=-665/77, 5-11=-665/77, 6-11=-14/632, 7-11=-647/110

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TC DL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=35ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) -1-5-8 to 2-0-6, Interior (1) 2-0-6 to 11-5-8, Exterior (2) 11-5-8 to 16-4-12, Interior (1) 16-4-12 to 23-5-8, Exterior (2) 23-5-8 to 28-4-12, Interior (1) 28-4-12 to 36-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 223 lb uplift at joint 2 and 223 lb uplift at joint 8.
 - This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard


Job Q-2002493-1	Truss T1D	Truss Type Hip	Qty 2	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	--------------	-------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:19

Page: 1

ID:ct6BFJhBMRjzksScUaxvA9yUC7X-x5Nz8SnlXinPjpFEV8qUuLgJNw?4OtW_HUQ5QyUA6l

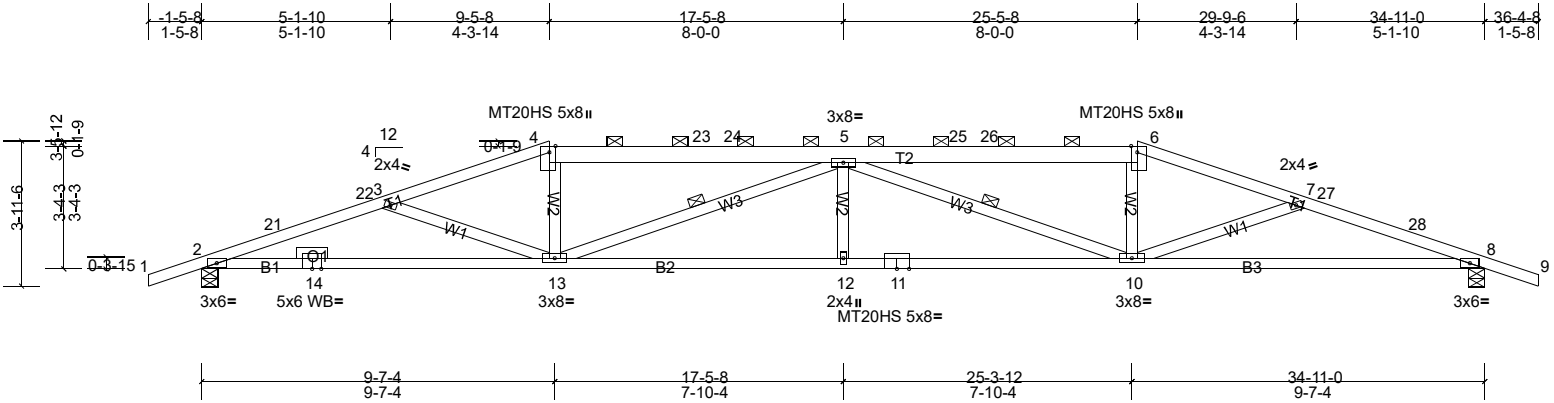

Scale = 1:62.7

Plate Offsets (X, Y): [4:0-2-1,0-2-0], [6:0-2-1,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	0.40	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.40	Vert(LL)	-0.34	12	>999	240	MT20HS	187/143
TCDL	10.0	Lumber DOL	1.15	BC	0.84	Vert(CT)	-0.68	12-13	>618	180	MT20	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.18	8	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MS								Weight: 175 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1 *Except* T2:2x6 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

REACTIONS (lb/size) 2=1484/0-5-4, (min. 0-2-5), 8=1484/0-5-4, (min. 0-2-5)
 Max Horiz 2=-36 (LC 9)
 Max Uplift 2=-223 (LC 11), 8=-223 (LC 11)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-21=-3681/477, 21-22=-3658/489, 3-22=-3612/491, 3-4=-3331/409, 4-23=-3169/407, 23-24=-3169/406, 5-24=-3173/406, 5-25=-3173/406, 25-26=-3169/406, 6-26=-3169/407, 6-7=-3331/409, 7-27=-3612/491, 27-28=-3658/489, 8-28=-3681/477
 BOT CHORD 2-14=-397/3470, 13-14=-397/3470, 12-13=-445/4184, 11-12=-445/4184, 10-11=-445/4184, 8-10=-397/3470
 WEBS 3-13=-363/124, 4-13=0/693, 5-13=-1223/175, 5-10=-1223/175, 6-10=0/693, 7-10=-363/124

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=35ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) 1-5-8 to 2-0-6, Interior (1) 2-0-6 to 9-5-8, Exterior (2) 9-5-8 to 14-4-12, Interior (1) 14-4-12 to 25-5-8, Exterior (2) 25-5-8 to 30-4-12, Interior (1) 30-4-12 to 36-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 223 lb uplift at joint 2 and 223 lb uplift at joint 8.
- This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


Job	Truss	Truss Type	Qty	Ply	Holland Hip Garage-Roof
Q-2002493-1	T1GRD	Hip Girder	2	3	Job Reference (optional)

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:19

Page: 1

ID:rc9b8OoqFCshX6eLWzb012yUC70-x5Nz8SnIXinPjPFEV8qUuLGIvwoG4P3W_HUQ5QyUA6I

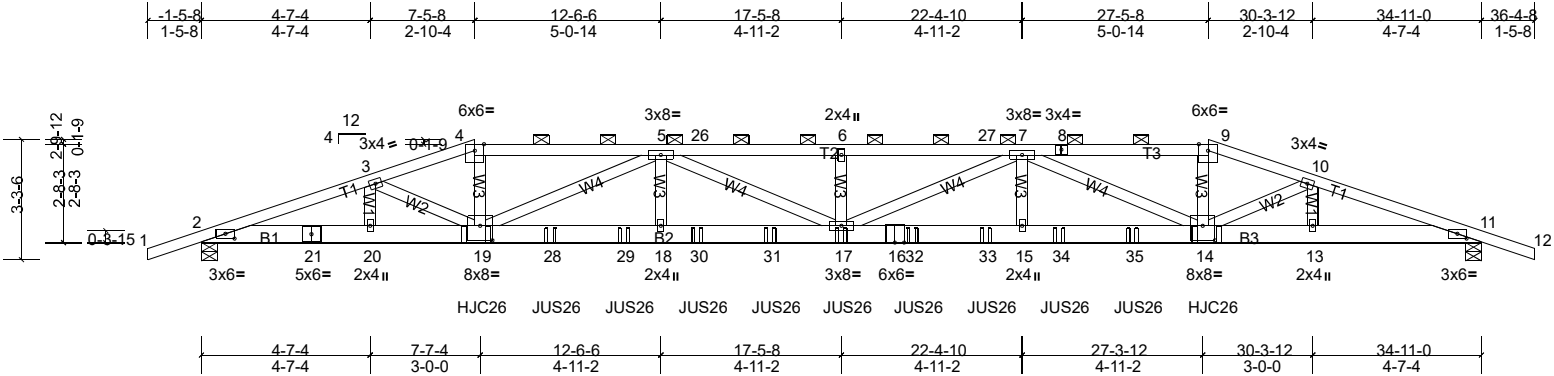

Scale = 1:62.8

Plate Offsets (X, Y): [2:0-3-0,0-1-9], [11:0-3-0,0-1-9], [14:0-4-0,0-4-12], [19:0-4-0,0-4-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	-0.37	17	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.69	Vert(CT)	-0.72	17	>582	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.39	Horz(CT)	0.13	11	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MS								Weight: 588 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP DSS
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 4-9.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=3463/0-5-4, (min. 0-1-13), 11=3463/0-5-4, (min. 0-1-13)
 Max Horiz 2=-29 (LC 5)
 Max Uplift 2=-552 (LC 7), 11=-552 (LC 7)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-10012/1482, 3-4=-10228/1554, 4-5=-9944/1520, 5-26=-14545/2255, 6-26=-14545/2255, 6-27=-14545/2255, 7-27=-14545/2255, 7-8=-9948/1519, 8-9=-9949/1521, 9-10=-10233/1554, 10-11=-10009/1482
 BOT CHORD 2-21=-1344/9473, 20-21=-1344/9473, 19-20=-1344/9473, 19-28=-1987/13480, 28-29=-1987/13480, 18-29=-1987/13480, 18-30=-1987/13480, 30-31=-1987/13480, 17-31=-1987/13480, 16-17=-1990/13502, 16-32=-1990/13502, 32-33=-1990/13502, 15-33=-1990/13502, 15-34=-1990/13502, 34-35=-1990/13502, 14-35=-1990/13502, 13-14=-1344/9471, 11-13=-1344/9471
 WEBS 3-19=-203/528, 4-19=-386/2849, 5-19=-3974/631, 5-18=-59/733, 5-17=-183/1248, 6-17=-258/108, 7-17=-179/1225, 7-15=-59/733, 7-14=-3989/634, 9-14=-387/2850, 10-14=-201/537

NOTES

- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Web connected as follows: 2x4 - 1 row at 0-9-0 oc, Except member 4-19 2x4 - 2 rows staggered at 0-6-0 oc, Except member 9-14 2x4 - 2 rows staggered at 0-6-0 oc, member 6-17 2x4 - 1 row at 0-8-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=35ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 552 lb uplift at joint 2 and 552 lb uplift at joint 11.
- This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use USP HJC26 (With 16-16d nails into Girder & 10d nails into Truss) or equivalent spaced at 19-11-4 oc max. starting at 7-5-14 from the left end to 27-5-2 to connect truss (es) T2 (1 ply 2x4 SP), H1 (1 ply 2x4 SP), T2 (1 ply 2x4 SP), H1 (1 ply 2x4 SP) to back face of bottom chord.
- Use USP JUS26 (With 4-10d nails into Girder & 4-10d nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 9-6-4 from the left end to 25-4-12 to connect truss(es) T2 (1 ply 2x4 SP) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

Job Q-2002493-1	Truss T1GRD	Truss Type Hip Girder	Qty 2	Ply 3	Holland Hip Garage-Roof Job Reference (optional)
--------------------	----------------	--------------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:19

Page: 2

ID:rc9b8OoqFCshX6eLWzb012yUC7O-x5Nz8SnIXinPjpFEV8qUuLGIvwoG4P3W_HUQ5QyUA6I

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (lb/ft)

Vert: 1-4=-60, 4-9=-60, 9-12=-60, 2-11=-20

Concentrated Loads (lb)

Vert: 19=-792 (B), 17=-264 (B), 14=-792 (B), 28=-264 (B), 29=-264 (B), 30=-264 (B), 31=-264 (B), 32=-264 (B), 33=-264 (B), 34=-264 (B), 35=-264 (B)


Job Q-2002493-1	Truss T2	Truss Type Jack-Closed	Qty 22	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	-------------	---------------------------	-----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:19

Page: 1

ID:ct6BFJhBMRJzkkScUaxvA9yUC7X-x5Nz8SnIXinPjpFEV8qUuLgGdwr74VCW_HUQ5QyUA6I

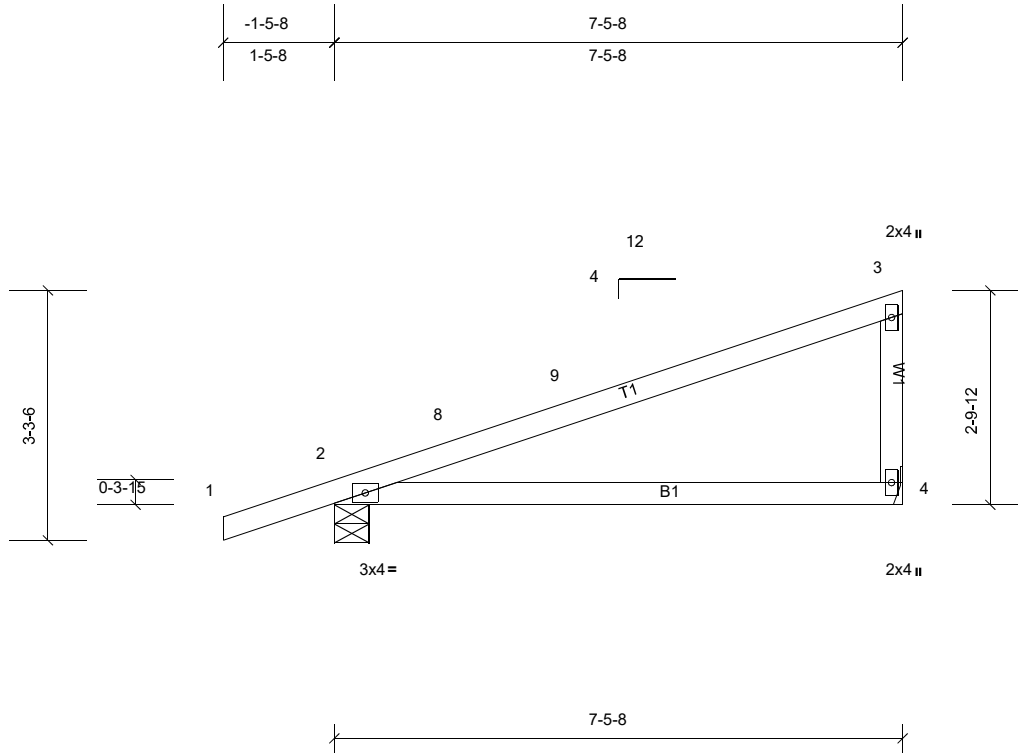

Scale = 1:30.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.60	Vert(LL)	-0.10	4-7	>844	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.46	Vert(CT)	-0.25	4-7	>354	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MP							Weight: 29 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=389/0-5-8, (min. 0-1-8), 4=284/ Mechanical, (min. 0-1-8)
 Max Horiz 2=84 (LC 10)
 Max Uplift 2=-87 (LC 11), 4=-36 (LC 11)

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- 1) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TC DL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=20ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) -1-5-8 to 1-6-8, Interior (1) 1-6-8 to 7-3-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 4 and 87 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



Job Q-2002493-1	Truss T3	Truss Type Jack-Open	Qty 4	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	-------------	-------------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user


Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:19

Page: 1

ID:ct6BFJhBMRjzskScUaxvA9yUC7X-x5Nz8SnlXinPjpFEV8qUuLGI?wvX4VCW_HUQ5QyUA6I

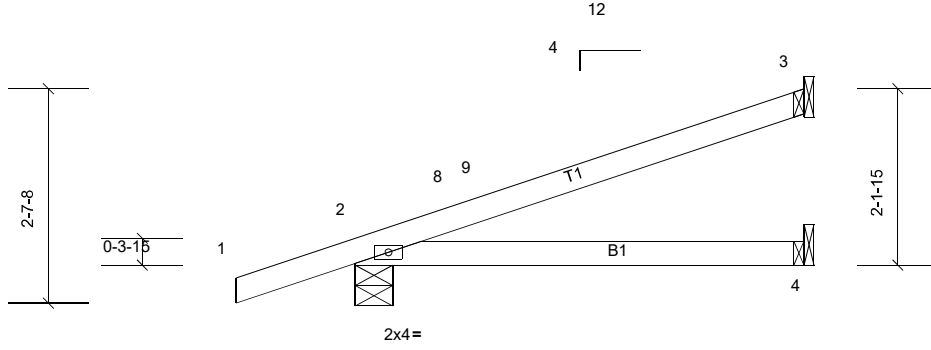

Scale = 1:28.2



Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	0.03	4-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.23	Vert(CT)	-0.07	4-7	>909	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MP							Weight: 19 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 5-5-15 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=317/0-5-8, (min. 0-1-8), 3=137/ Mechanical, (min. 0-1-8),
4=68/ Mechanical, (min. 0-1-8)
Max Horiz 2=84 (LC 11)
Max Uplift 2=-75 (LC 11), 3=-48 (LC 11)

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- 1) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TC DL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=20ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) -1-5-8 to 1-6-8, Interior (1) 1-6-8 to 5-5-3 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 3 and 75 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



Job Q-2002493-1	Truss T3A	Truss Type Jack-Open	Qty 4	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	--------------	-------------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user


Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:19

Page: 1

ID:ct6BFJhBMRjzskScUaxvA9yUC7X-x5Nz8SnlXinPjpFEV8qUuLGI?wvX4VCW_HUQ5QyUA6I

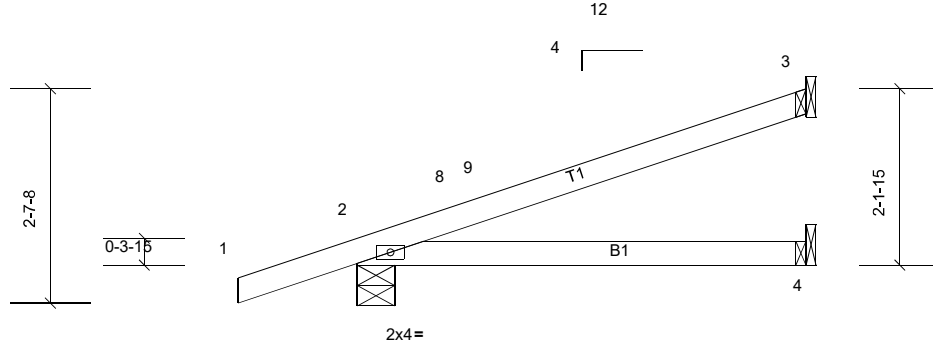

Scale = 1:28.2



Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	0.03	4-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.23	Vert(CT)	-0.07	4-7	>909	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MP							Weight: 19 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 5-5-15 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=317/0-5-8, (min. 0-1-8), 3=137/ Mechanical, (min. 0-1-8),
4=68/ Mechanical, (min. 0-1-8)
Max Horiz 2=84 (LC 11)
Max Uplift 2=-75 (LC 11), 3=-48 (LC 11)

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- 1) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TC DL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=20ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) -1-5-8 to 1-6-8, Interior (1) 1-6-8 to 5-5-3 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 3 and 75 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard


Job Q-2002493-1	Truss T4	Truss Type Jack-Open	Qty 4	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	-------------	-------------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:20

Page: 1

ID:44gZSfip7IrpZu1o2HS8jMyUC7W-PHxLMoowI0vGLyqQ3rLjRYpznKGGpySfDxD_dsyUA6H

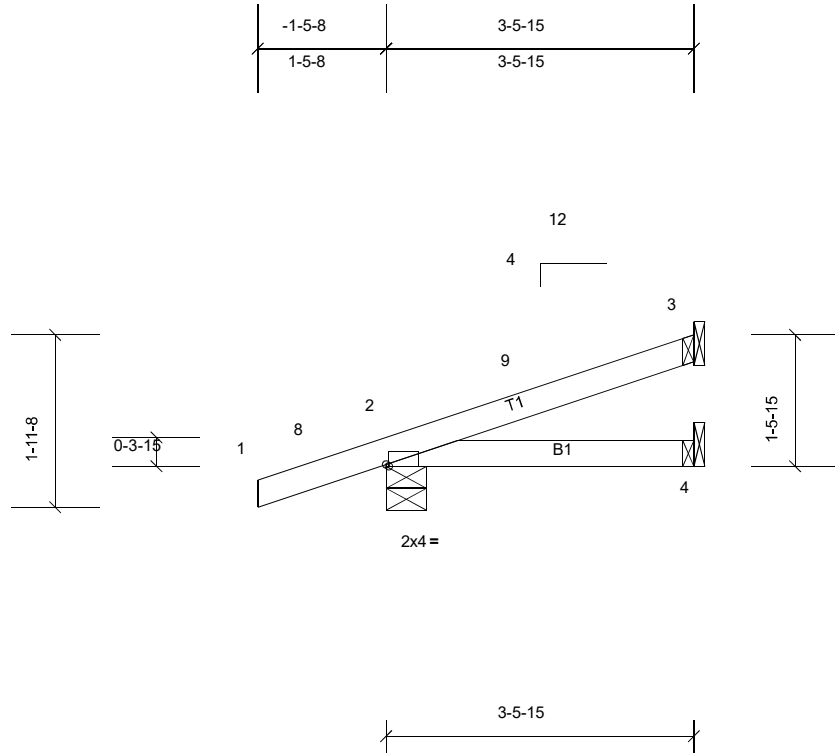

Scale = 1:26.2

Plate Offsets (X, Y): [2:0-0-6,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	0.00	4-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(CT)	-0.01	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MP							Weight: 13 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 3-5-15 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=243/0-5-8, (min. 0-1-8), 3=79/ Mechanical, (min. 0-1-8),
4=40/ Mechanical, (min. 0-1-8)
Max Horiz 2=62 (LC 11)
Max Uplift 2=-73 (LC 11), 3=-25 (LC 11)

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- 1) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=20ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) 1-5-8 to 1-6-8, Interior (1) 1-6-8 to 3-5-3 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 3 and 73 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard


Job Q-2002493-1	Truss T4A	Truss Type Jack-Open	Qty 4	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	--------------	-------------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:20

Page: 1

ID:44gZSfip7IrpZu1o2HS8jMyUC7W-PHxLMoowI0vGLyqQ3rLjRYpznKGGpySfDxD_dsyUA6H

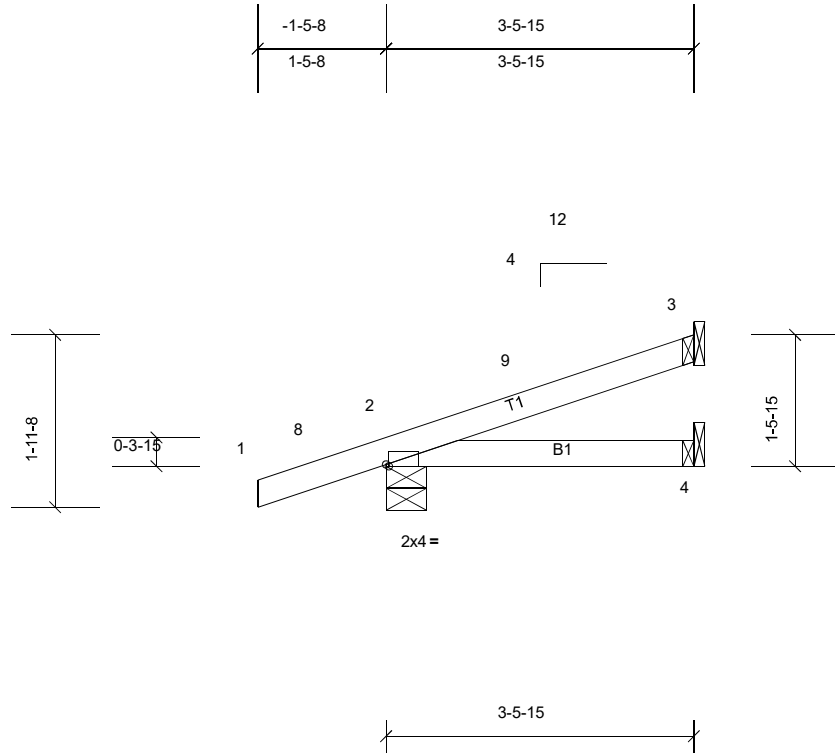

Scale = 1:26.2

Plate Offsets (X, Y): [2:0-0-6,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	0.00	4-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(CT)	-0.01	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MP							Weight: 13 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 3-5-15 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=243/0-5-8, (min. 0-1-8), 3=79/ Mechanical, (min. 0-1-8),
4=40/ Mechanical, (min. 0-1-8)
Max Horiz 2=62 (LC 11)
Max Uplift 2=-73 (LC 11), 3=-25 (LC 11)

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- 1) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=20ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) 1-5-8 to 1-6-8, Interior (1) 1-6-8 to 3-5-3 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 3 and 73 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard


Job Q-2002493-1	Truss T5	Truss Type Jack-Open	Qty 4	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	-------------	-------------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:20

Page: 1

ID:44gZStip7lrpZu1o2HS8jMyUC7W-PHxLMoowl0vGLyqQ3rLjRypziKHCPyStfDxD_dsyUA6H

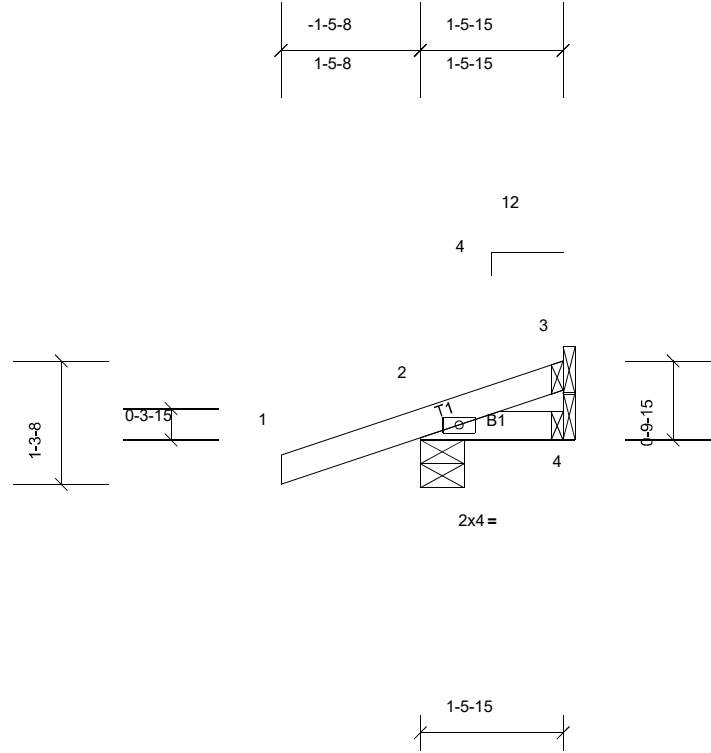

Scale = 1:24.1

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	0.00	7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.01	Vert(CT)	0.00	7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MP							Weight: 7 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1

REACTIONS (lb/size) 2=190/0-5-8, (min. 0-1-8), 3=15/ Mechanical, (min. 0-1-8), 4=1/ Mechanical, (min. 0-1-8)
Max Horiz 2=40 (LC 11)
Max Uplift 2=-84 (LC 11)
Max Grav 2=190 (LC 1), 3=15 (LC 1), 4=15 (LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- 1) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=20ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 84 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 1-5-15 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.


Job Q-2002493-1	Truss T5A	Truss Type Jack-Open	Qty 4	Ply 1	Holland Hip Garage-Roof Job Reference (optional)
--------------------	--------------	-------------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.31 S Sep 9 2019 Print: 8.310 S Sep 9 2019 MiTek Industries, Inc. Mon Oct 12 12:42:20

Page: 1

ID:44gZStip7IrpZu1o2HS8jMyUC7W-PHxLMoowl0vGLyqQ3rLjRYpzIKHCpyStDxD_dsyUA6H

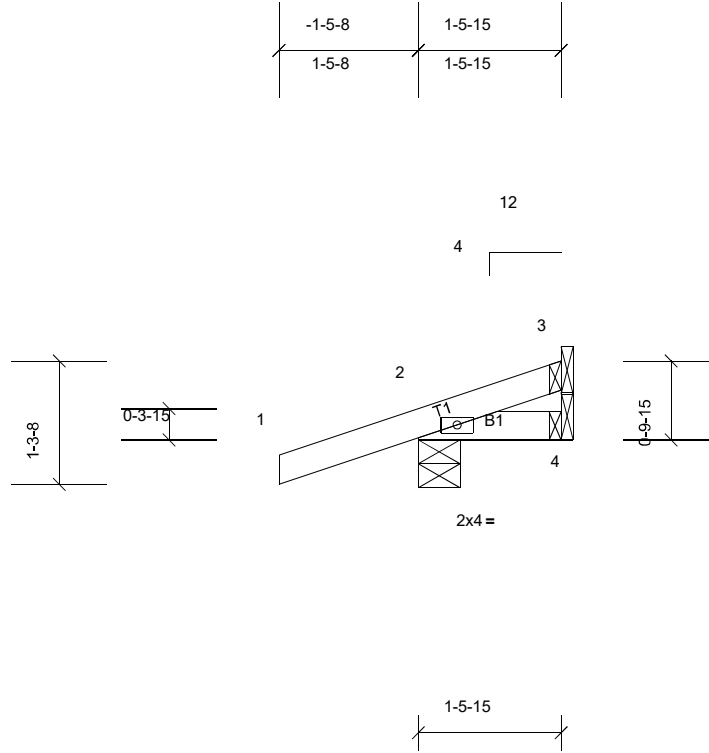

Scale = 1:24.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	0.00	7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.01	Vert(CT)	0.00	7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IBC2015/TPI2014	Matrix-MP							Weight: 7 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1

REACTIONS (lb/size) 2=190/0-5-4, (min. 0-1-8), 3=15/ Mechanical, (min. 0-1-8), 4=1/ Mechanical, (min. 0-1-8)
Max Horiz 2=40 (LC 11)
Max Uplift 2=-84 (LC 11)
Max Grav 2=190 (LC 1), 3=15 (LC 1), 4=15 (LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- 1) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=20ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 84 lb uplift at joint 2.
- 5) This truss is designed in accordance with the 2015 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 1-5-15 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.