

OPERATIONS PERMIT

Name: (owner) Danny Morris New Installation Septic Tank
Property Location: SR# 1115 Repairs Nitrification Line
Subdivision Crestview Lot # 24
TAX ID# _____ Quadrant # _____
Contractor: Ted Brown Registration # _____


Basement with Plumbing: Garage:
Water Supply: Well Public Community
Distance From Well: 50 ft.

Following are the specifications for the sewage disposal system on above captioned property.

Type of system: Conventional Other _____
Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons
Subsurface Drainage Field No. of ditches 2 exact length of each ditch 80 ft. width of ditches 3 ft. depth of ditches 18-24 in.
French Drain: _____ Linear feet

Date: 3-31-99
Inspected by: J. J. [Signature]
Environmental Health Specialist

PERMIT NO. 15279

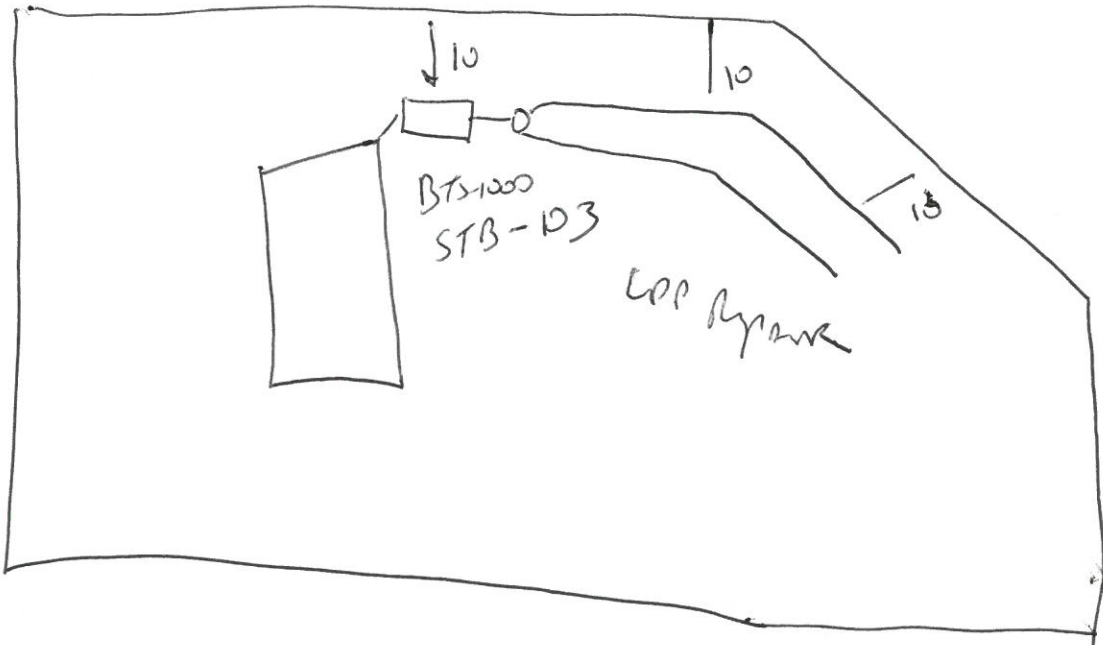

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Danny Morris New Installation Septic Tank
Property Location: SR# 9115 Repairs Nitrification Line

Subdivision Crestview Lot # 24

Tax ID # _____ Quadrant # _____

Number of Bedrooms Proposed: 3 Lot Size: 0.76 AC

Basement with Plumbing: Garage: MUST meet on-site

Water Supply: Well Public Community

Distance From Well: 50 min ft.

Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 2 exact length of each ditch 80 ft. width of ditches 3 ft. depth of ditches 18-24 in.

French Drain Required: _____ Linear feet

Date: 12-14-98

This permit is subject to revocation if site plans or intended use change.

Signed: [Signature]
Environmental Health Specialist

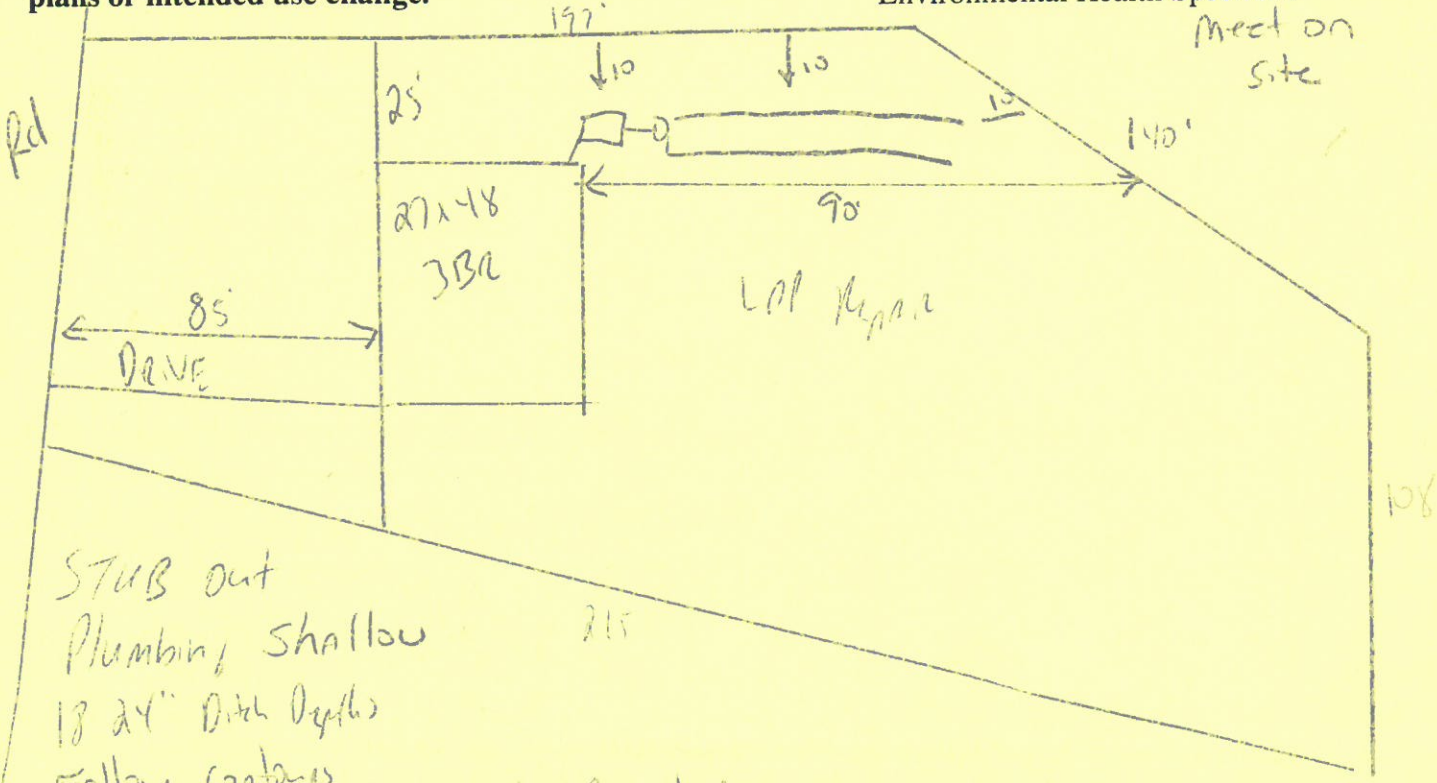

STUB out
 Plumbing shallow
 18-24" Ditch Depth
 Follow contours
 keep lines close to lot & eas Property Line
 Do not DRIVE OR PACE ON ANY PART of SEPTIC SYSTEM