
## THIS LAYOUT IS TO BE USED AS A TRUSS PLACEMENT GUIDE ONLY. PROPOSED DESIGN- $\mathcal{C}$ NOT FOR PLEASE REFER TO BUILDING PLANS FOR BUILDING CONSTRUCTION AND DETAILS, 27. CONSTRUCTION SUCH AS PLUMBING OR DUCT DROPS. Q-2001; # dol Exterior dimensions shown are assumed to be: ☐ Out-to-out of stud ☒ Out-to-out of sheathing 55-10-00 2. Adjust truss locations as needed for plumbing and mechanical clearance. Unless 20-02-00 4-05-00 L 3-04-00 20-02-00 3-04-00 L 4-05-00 otherwise noted, trusses may be shifted as long as O.C. spacing Fire wall shown is not exceeded. 3. Do not cut, drill, or otherwise extends to damage any part of any truss without prior approval from Peak < 2' OC Start Roof Deck Truss. 4. Do not approve drawings if any Dropped BBO7 information herein is unclear. Once ordered trusses will be Bunnlevel NC Surles Duplex fabricated as approved. 5. Please contact Peak Truss Builders with any questions. We 7-08-00 are available to help any way we can. We can be reached at 919-545-5555 or sales@peaktruss.con Roof Truss Loading per 2018 NC Residential Code Top Chord Live Load Top Chord Dead Load 20# PSF 10# PSF PDS PDS T1C(2) T1D(6) Bottom Chord Live Load Bottom Chord Dead Load HVAC HVAC Trusses are designed for additional storage load wherever a 42"x24" box will fit between the webs. Platform Platform This symbol denotes left end of truss as shown on truss drawings Approximate location of toilet drop. Builder please confirm. **Aron Meeks** Designer: Date N -Nailed L -Ledger PBS - Raleigh 10405 Chapel Hill Rd. Morrisville,NC 27577 10/12 10/12 NAILED T3D T3D **Surles Duplex** 17" OH T5A(2) 2' OC Dropped BBO6 Hill, NC 27562 Truss Connector Total List 10/12 10/12 Manuf Product Qty USP HUS26 11-03-00 15-08-00 15-08-00 12-00-00 USP JUS26 36 55-10-00

Porch beams are assumed



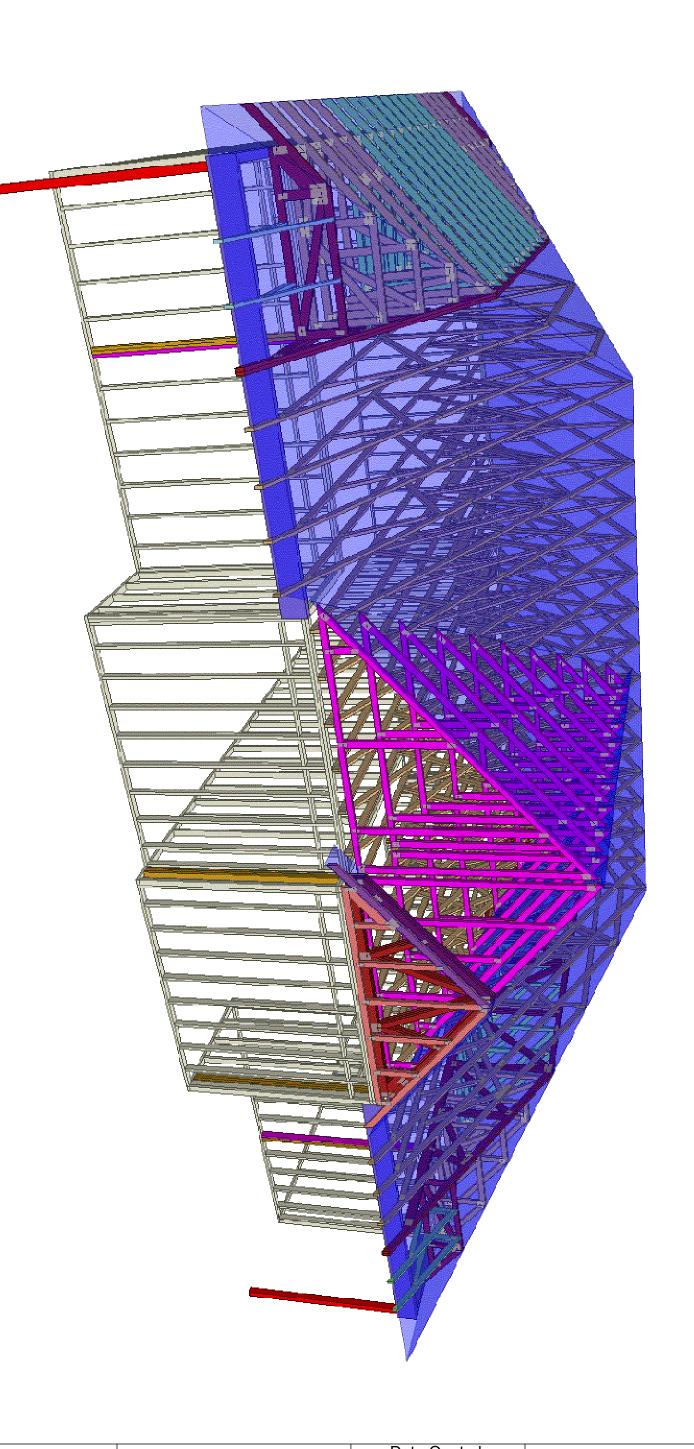

PBS - Raleigh 10405 Chapel Hill Rd. Morrisville,NC 27577 Date Quoted:

Designer:
Aron Meeks

Surles Duplex

Bunnlevel NC

Job #

Q-2001273