HTE 04-5-8843

HARNETT COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SECTION

17452

OPERATIONS PERMIT

Name: (owner) Rodney + Shannon Eason

☑ New Installation ☑ Septic Tank

Property Location: SR# 1708 McLean RD

☐ Repairs ☑ Nitrification Line

Subdivision _____ Lot # 4

Tax ID # _____ Quadrant # _____

Contractor: Kenneth Weekes Registration # _____

Basement with Plumbing: ☐ Garage: ☑

Water Supply: ☐ Well ☑ Public ☐ Community

Distance From Well: 50' ft.

Following are the specifications for the sewage disposal system on above captioned property.

Type of system: ☑ Conventional ☐ Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons

Subsurface Drainage Field: No. of ditches 4; exact length of each ditch 75 ft.; width of ditches 3 ft.; depth of ditches 18→24 in.

French Drain Required: — Linear feet

Date: 8-17-04

Inspected by: James E Manhart QSEE
Environmental Health Specialist
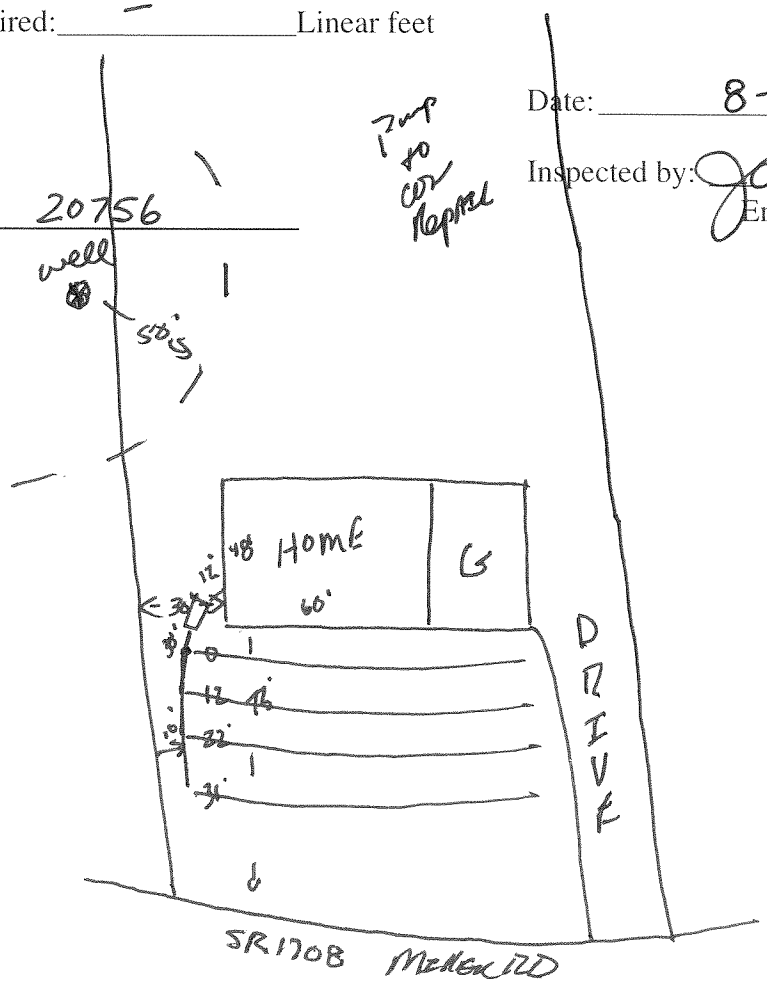
PERMIT NO. 20756