

OPERATIONS PERMIT

Name: (owner) Jodi L. Brown New Installation Septic Tank
 Property Location: SR# 1103 Repairs Nitrification Line
 Subdivision Weswood IV Lot # 24
 TAX ID# _____ Quadrant # _____
 Contractor: E. Shapec Registration # _____

Basement with Plumbing: Garage:
 Water Supply: Well Public Community
 Distance From Well: 100' ft.

Following are the specifications for the sewage disposal system on above captioned property.

Type of system: Conventional Other _____

Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons


Subsurface Drainage Field No. of ditches 2 exact length of each ditch 100 ft. width of ditches 3 ft. depth of ditches 18-24 in.

French Drain: _____ Linear feet

Date: 12-3-99

PERMIT NO. 16616

Inspected by: Jon West
Environmental Health Specialist

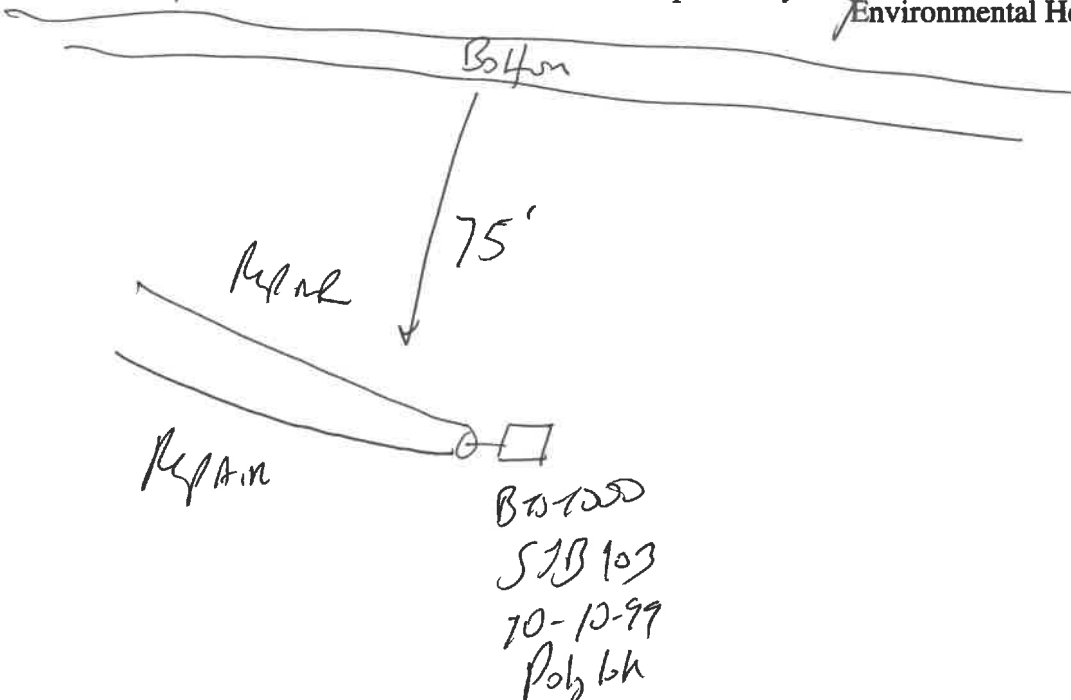

IMPROVEMENT PERMIT

Be it ordained by the Harnett County Board of Health as follows: Section III, Item B. "No Person shall begin construction of any building at which a septic tank system is to be used for disposal of sewage without first obtaining a written permit from the Harnett County Health Department."

Name: (owner) Sadi L Brown New Installation Septic Tank
 Property Location: SR# 1103 Repairs Nitrification Line
Mer Saides
 Subdivision Westwood IV Lot # 24

Tax ID # _____ Quadrant # _____
 Number of Bedrooms Proposed: 3 (27x60) Lot Size: 10.02 AC

Basement with Plumbing: Garage: MUST use filter & septic
 Water Supply: Well Public Community TANK MARK
 Distance From Well: 100' ft. * MUST meet on site *


Following is the minimum specifications for sewage disposal system on above captioned property. Subject to final approval.

Type of system: Conventional Other _____
 Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface Drainage Field No. of ditches 2 exact length of each ditch 100 ft. width of ditches 3 ft. depth of ditches 18-24 in.
 French Drain Required: _____ Linear feet

Date: 11-24-99

Signed: [Signature]
Environmental Health Specialist

This permit is subject to revocation if site plans or intended use change.

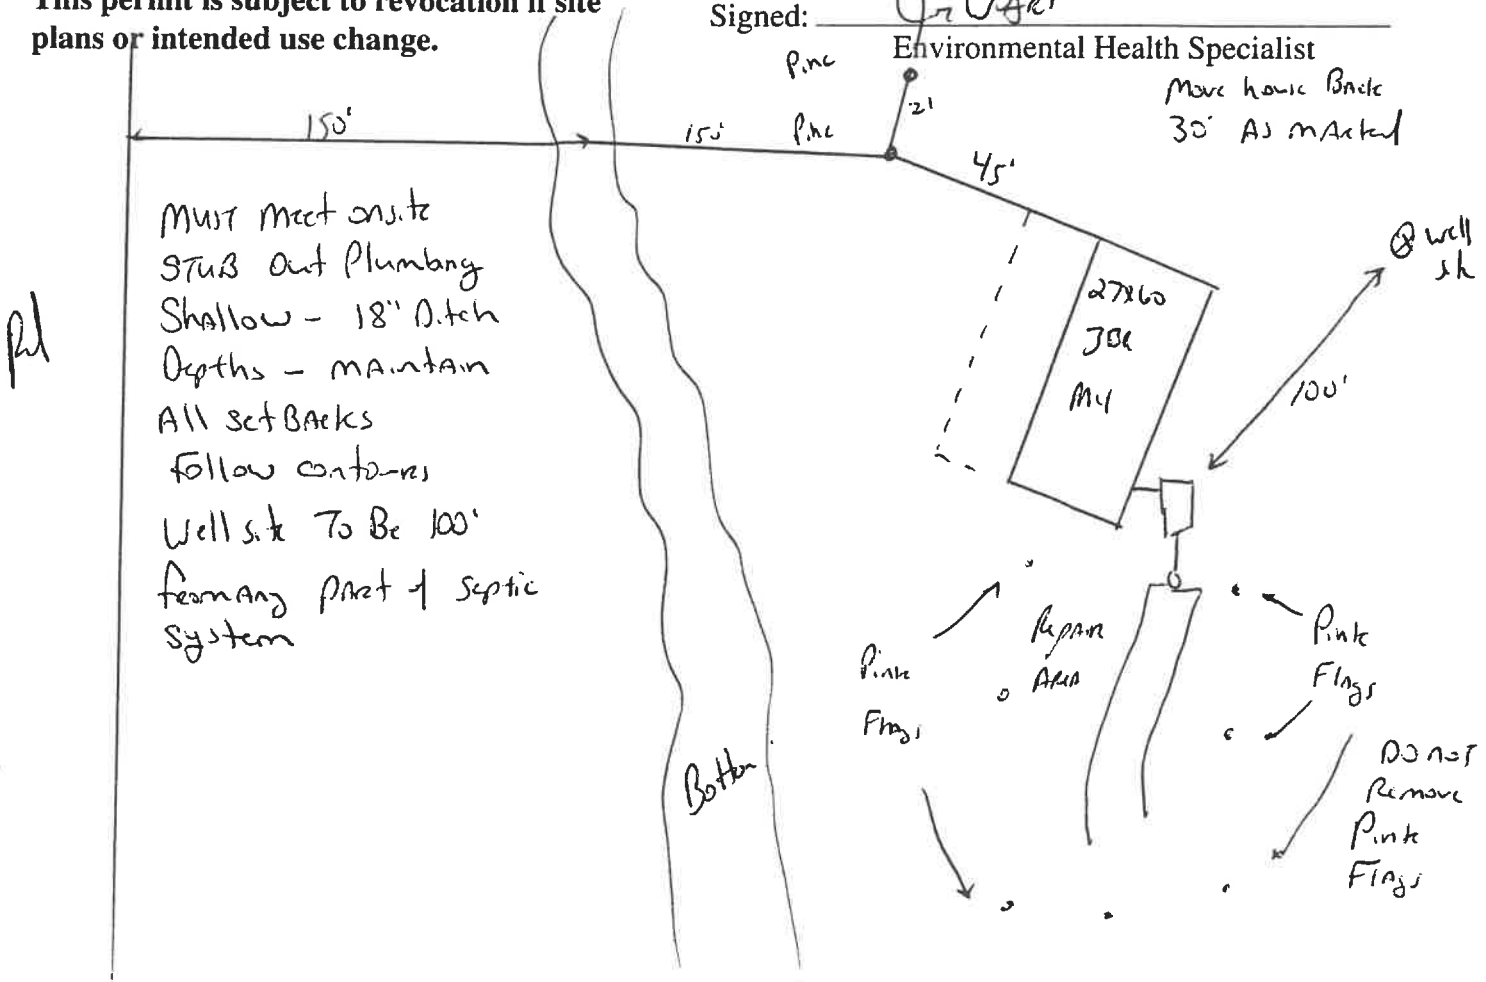

ibet
ion
on