Harnett County Department of Public Health

Improvement Permit

ISSUED TO: Bradford Jenkins

Type of Structure: 28' x 64' SFD

Projected Daily Flow: 360

Number of bedrooms: 3 Basement Yes

Pump Required: Yes

Authorized State Agent::

with the attached system layout.

ISSUED TO: Bradford Jenkins

Permit conditions:

REPAIR

X No

☐ No

A building permit cannot be issued with only an Improvement Permit

PROPERTY LOCATION: 292 Bernard St (SR1156) SUBDIVISION Anderson Creek Homes EXPANSION Site Improvements required prior to Construction Authorization Issuance: Proposed Wastewater System Type: 25% reduction GPD Number of Occupants: 6 May be required based on final location and elevations of facilities Permit valid for: X Five years ■ No expiration Date: 05-07-21 SEE ATTACHED SITE SKETCH The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit. Construction Authorization (Required for Building Permit) The construction and installation requirements of Rules 1950, 1952, 1954, 1955, 1956, 1957, 1958, and 1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance PROPERTY LOCATION: 292 Bernard St (SR1156) SUBDIVISION Anderson Creek Homes LOT # 13


Facility Type: 28' x 64' SFD	New Expansion Repair	
Basement? Yes X No Basement Fix	tures? Yes No	
Type of Wastewater System** 25% reduct	ion	(Initial) Wastewater Flow: 360 GPD
(See note below, if applicable)		
25% reduc	tion (Repair)	
Installation Requirements/Conditions	Number of trenches 1	
Septic Tank Size 1000 gallons	Exact length of each trench 180 feet	Trench Spacing: 9 Feet on Center
Pump Tank Sizegallons	Trenches shall be installed on contour at a	Soil Cover: 6inches
	Maximum Trench Depth of: 18" - 24" inches	(Maximum soil cover shall not exceed
	(Trench bottoms shall be level to +/-1/4"	36" above the trench bottom)
	in all directions)	
Pump Requirements:ft. TDH vs	GPM	inches below pipe
		Aggregate Depth: inches above pipe
Conditions:		inches total
WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA		

NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.

**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit. Owner/Legal Representative Signature: Date: This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit. SEE ATTACHED SITE SKETCH

REHS Date: 05-07-21 Authorized State Agent: Construction Authorization Expiration Date: 05-07-26

Harnett County Department of Public Health Site Sketch

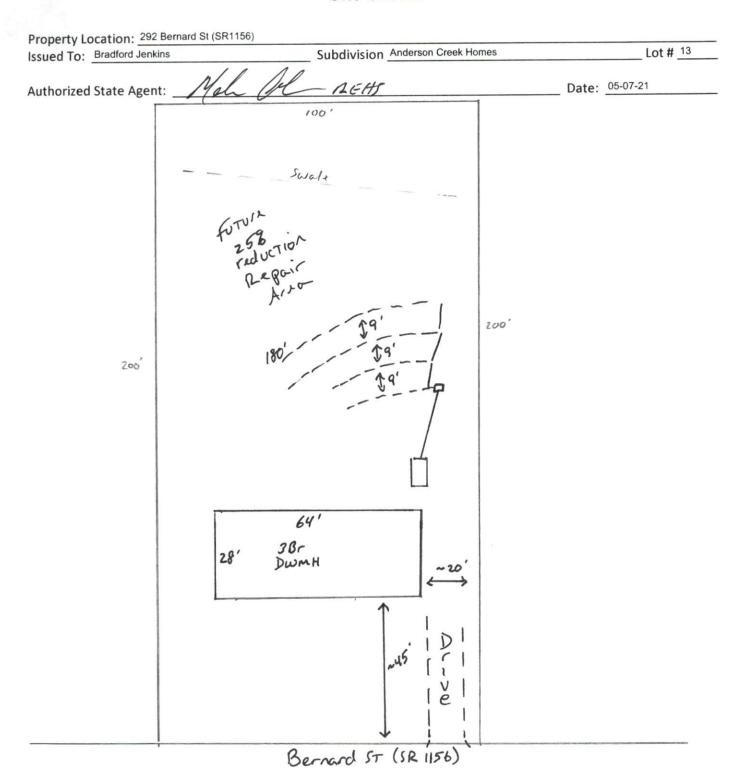

This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.