

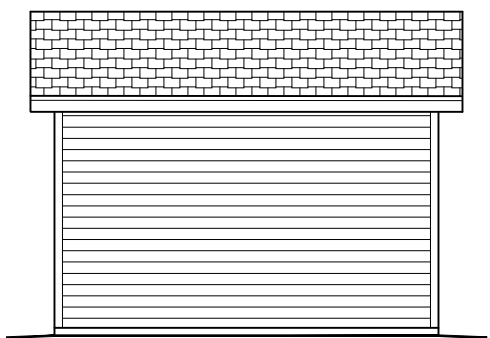



PREPARED UNDER THE SUPERVISION OF:

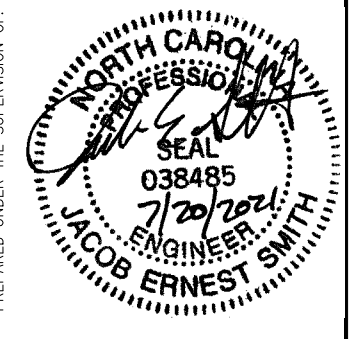


REAR ELEVATION

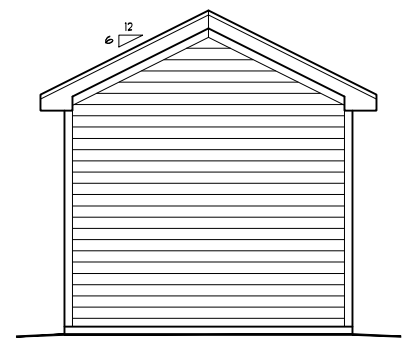


LEFT ELEVATION

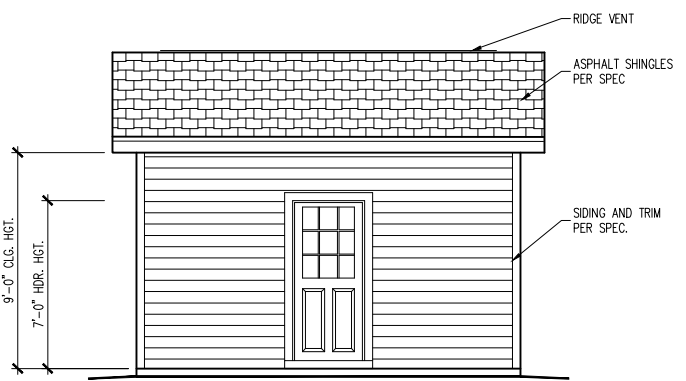

FRONT ELEVATION

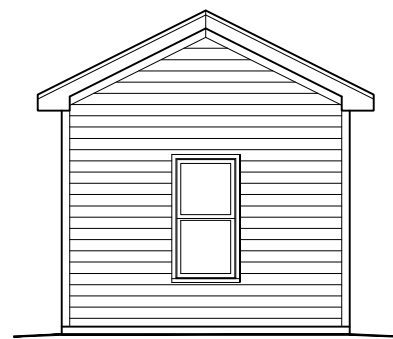


RIGHT ELEVATION

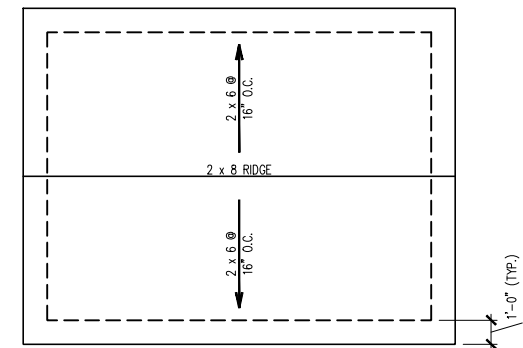


ROOF FRAMING PLAN

SQUARE FOOTAGE  
POOL HOUSE: 192 SQ. FT.

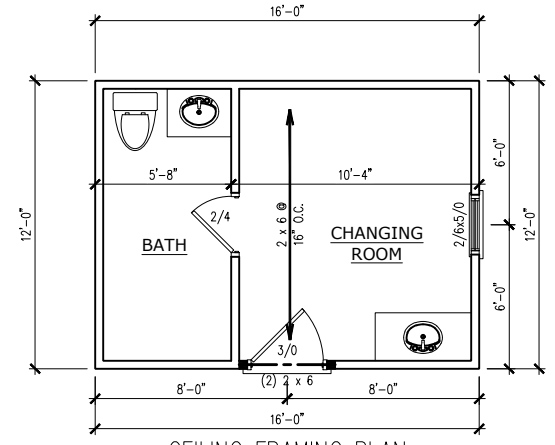

CEILING FRAMING PLAN

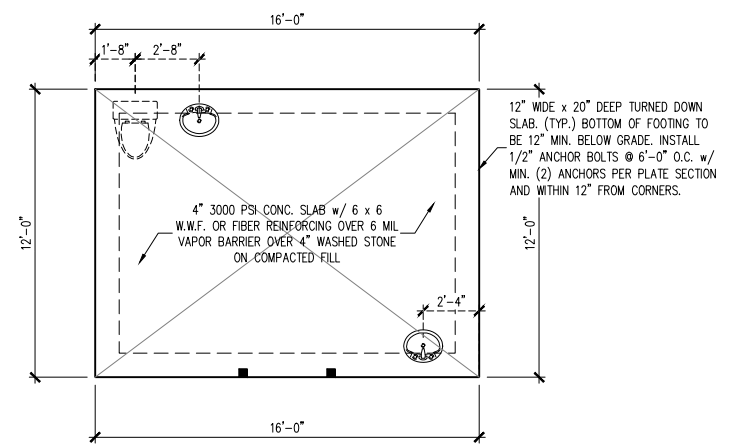

FOUNDATION PLAN

- CODE NOTES: 120 MPH ULTIMATE DESIGN WIND SPEED w/ MEAN ROOF HEIGHT LESS THAN 30'.  
 1. ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT INCLUDING ROOF SYSTEM.  
 2. STRUCTURAL DESIGN PER NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.  
 3. INSTALL 1/2" ANCHOR BOLTS 6'-0" O.C. AND WITHIN 1'-0" FROM END OF EACH CORNER. (MIN (2) ANCHORS PER PLATE SECTION.) ANCHOR BOLTS MUST EXTEND A MINIMUM OF 7" INTO MASONRY OR CONCRETE. LOCATE BOLT WITHIN MIDDLE THIRD OF PLATE WIDTH.  
 4. MEAN ROOF HEIGHT IS LESS THAN 30 FEET.  
 5. EXTERIOR WALLS DESIGNED FOR 120 MPH WINDS.  
 6. WALL CLADDING DESIGNED FOR +15.5 PSF AND -20 PSF (+/- INDICATE POSITIVE / NEGATIVE PRESSURE (TYP)).  
 7. ROOF CLADDING DESIGNED FOR +14.2 PSF AND -18 PSF FOR ROOF PITCHES 7/12 TO 12/12 AND +10 PSF AND -36 PSF FOR ROOF PITCHED 2.25/12 TO 7/12.  
 8. INSTALL 7/16" OSB SHEATHING ON ALL EXTERIOR WALLS OF ALL STORIES IN ACCORDANCE WITH SECTION R602.10.3 OF THE NRCR, 2018 EDITION. SEE THE WALL BRACING DETAILS SHEET FOR MORE INFORMATION.  
 9. ENERGY EFFICIENCY COMPLIANCE AND INSULATION VALUES OF THE BUILDING TO BE IN ACCORDANCE WITH CHAPTER 11 OF THE NRCR, 2018 EDITION.

- STRUCTURAL FRAMING NOTES:  
 1. ALL FRAMING LUMBER TO BE SPF #2 (UNO). ALL TREATED LUMBER TO BE SYP #2 (UNO).  
 2. ALL LOAD BEARING HEADERS TO BE (2) 2 x 6 (UNO).  
 3. WINDOW AND DOOR HEADERS TO BE SUPPORTED w/ (1) JACK STUD AND (1) KING STUD EA. END (UNO).  
 4. BRACED WALL DESIGN PER SECTION R602.10 OF THE NRCR 2018 EDITION.  
 5. CONTRACTOR SHALL INSTALL 7/16" OSB ON ALL EXTERIOR WALLS ATTACHED w/ 8d NAILS SPACED 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD.  
 6. SHEATH ROOF w/ 7/16" OSB SHEATHING SECURED w/ 8d NAILS @ 6" O.C. ALONG EDGES AND 12" O.C. IN THE FIELD.  
 7. FOUNDATION DESIGN BASED ON A MINIMUM ALLOWABLE BEARING CAPACITY OF 2000 PSF. CONTACT ENGINEER IF ALLOWABLE BEARING CAPACITY CAN NOT BE ACHIEVED.

**J. SMITH STRUCTURAL ENGINEERING, PLLC**  
 1532 CONE AVE. • APEX, NC 27502  
 (919) 864-1430 • jsmithstructural@gmail.com  
 N.C. CERTIFICATE NUMBER: P-2212



**POOL HOUSE**  
 261 HOBBY ROAD  
 HOLLY SPRINGS, NC  
 TRIANGLE HOME PROS, LLC.

DRAWN BY: THP  
 ENGINEERED BY: J. SMITH  
 SCALE: 1/8" = 1'-0"  
 DATE: 7-20-2021  
 SHEET: 1 OF 1

**S-1**  
**POOL HOUSE PLANS**