
## Harnett County Department of Public Health

## Improvement Permit

A building permit cannot be issued with only an Improvement Permit			
Octobe Dell		B Hicks Rd (SR1266)	
ISSUED TO: Saketa Bell	SUBDIVISION		LOT #
NEW X REPAIR EXPANSION  Type of Structure: 14' x 76' SWMH		vements required prior to Construction Auth	iorization Issuance:
Proposed Wastewater System Type: 25% reduction	on		
Projected Daily Flow: 360 GPD	•		
Number of bedrooms: 3 Number of Occup	ints: 6 max		
Basement Yes No	11 1 7 11 2 11 2 11	952	
	ed based on final location and elevations of faci  Well Distance from well		▼ Five years
Permit conditions:	Well Distance from well	leet	No expiration
Terrint Conditions.			no expiration
-// 1/			
Authorized State Agent:: Mola Man	<i>LEHI</i> Date: 08-03-2		TTACHED SITE SKETCH
The issuance of this permit by the Health Department in no way guaran			
site is subject to revocation if the site plan, plat, or the intended use of the Laws and Rules for Sewage Treatment and Disposal and to condition		change in ownership of the site. This permit is subject	to compliance with the provisions of
the cars and traces for schage freatment and proposal and to conditions	or the perme.		
	Construction Authoring	4:	
	Construction Authoriza	tion .	
	(Required for Building Permit)		
The construction and installation requirements of Rules .1950, .1952, .19	54, 1955, 1956, 1957, 1958, and 1959 are incorporated	by references into this permit and shall be met. Syst	ems shall be installed in accordance
with the attached system layout.			
ISSUED TO: Saketa Bell	PROPERTY LOCATION	413 Hicks Rd (SR1266	)
	SUBDIVISION	•	LOT #
Facility Type: 14' x 76' SWMH	New □ Expansion □	Repair	
Basement? Yes No Basement Fixt			
Type of Wastewater System** 25% reduction		(Initial) Wastewater Flow	g: 360 GPD
(See note below, if applicable )	<u> </u>	(initial) Wastewater 1101	010
25% reduct	ion (Repair)		
Installation Requirements/Conditions	Number of trenches 3		
Septic Tank Size 1000 gallons	Exact length of each trench 70	feet Trench Spacing: 9	Feet on Center
	Trenches shall be installed on contour at a	, 0	inches
Pump Tank Sizegallons			
	Maximum Trench Depth of: 18" - 24"		
	(Trench bottoms shall be level to +/-1/4"	36" above the trench b	ottom)
	in all directions)		
Pump Requirements:ft. TDH vs	GPM		inches below pipe
		Aggregate Depth:	
Conditions:			inches total
WATER LINES (INCLUDING IRRIGATION) MUST B	E 10FT. FROM ANY PART OF SEPTIC SYS	STEM OR REPAIR AREA.	
NO UTILITIES ALLOWED IN INITIAL OR REPAIR D	RAIN FIELD AREA.		
**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.			
The applicable: I understand the system type specified	is different from the type specified on the	application. I accept the specifications i	of this permit.
			648
Owner/Legal Representative Signature:		Date:	
This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes The Construction Authorization shall not be transferred when there is a change in ownership of the site. This			
Construction Authorization is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.  SEE ATTACHED SITE SKETCH			
Authorized State Agent: Date: 08-03-21			
Construction Authorization Expiration Date: 08-03-26			

## Harnett County Department of Public Health Site Sketch

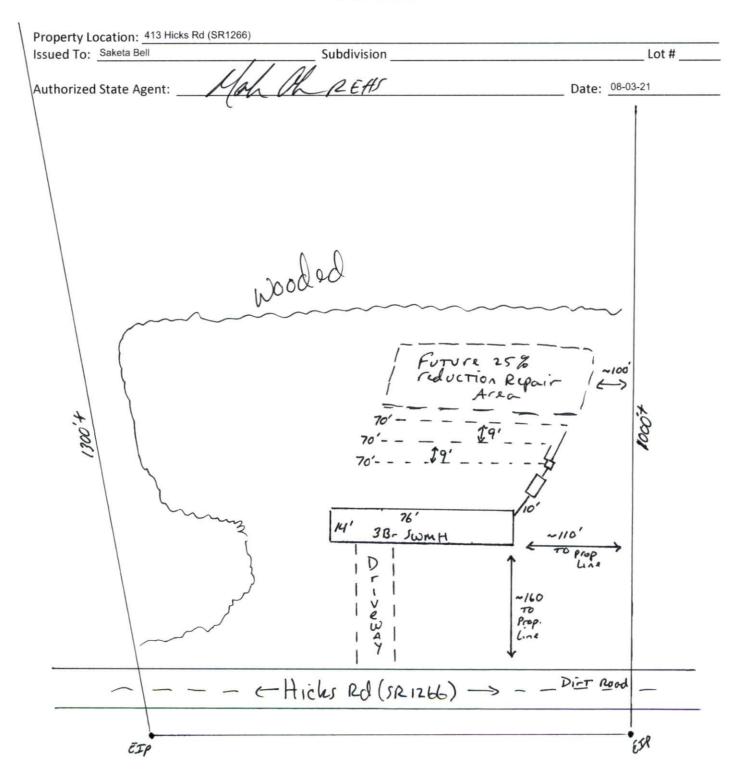

This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.