

# Harnett County Department of Public Health

PERMIT # BUES2107-0635

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion  
 PROPERTY LOCATION: 1498 CARSON GIBSON RD. (SUB 1547)

Name: (owner) GREENFIELD HOUSING SUBDIVISION \_\_\_\_\_ LOT # \_\_\_\_\_

System Installer: HAROLD STUCKLAND


Basement with plumbing:  Garage  Number of Bedrooms 3

Type of Water Supply:  Community  Public  Well Distance from well 50+ feet

System Type: 25% REDUCTION SIS - IIIg Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

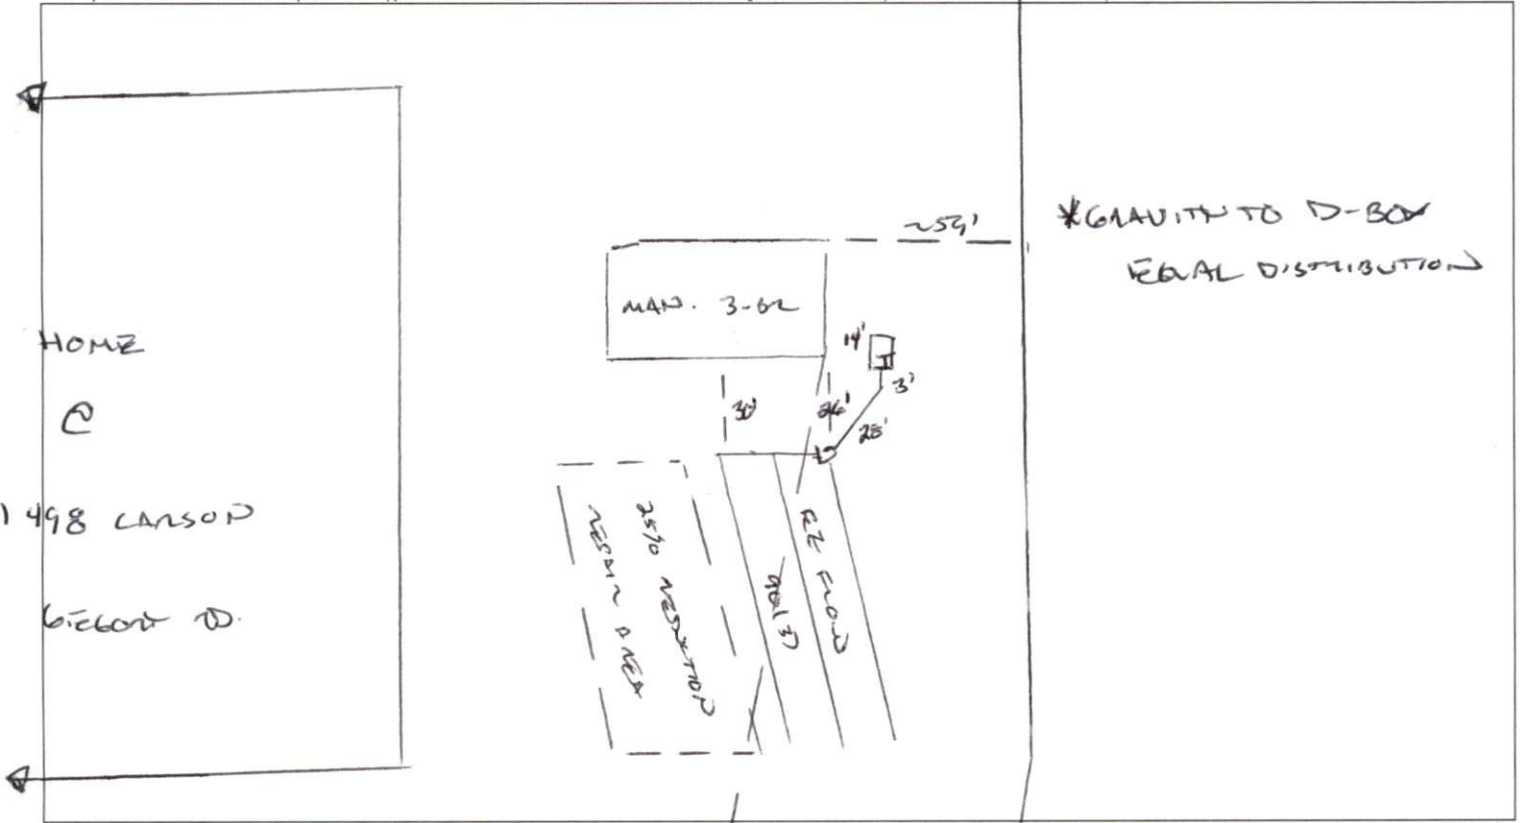

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  
  Pump  
  Alarm  
  H2O Line  
  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  
 Other FR. DRAIN IIIg  
 Septic Tank: 1000 gallons  
 Pump Tank: \_\_\_\_\_ gallons

Subsurface No. of exact length width of depth of  
 Drainage Field ditches 3 of each ditch 90 feet ditches 3 feet ditches 24 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature] Date 10/25/2021