


Secure posts to footings per code requirements

Through bolt beams to posts or provide otherwise code compliant post bracing to beams.

Must have ceiling joists 2x8 16" o.c. in lower 1/3 of rafter and nailed to rafter per code.

All beams must be minimum 2-2x10

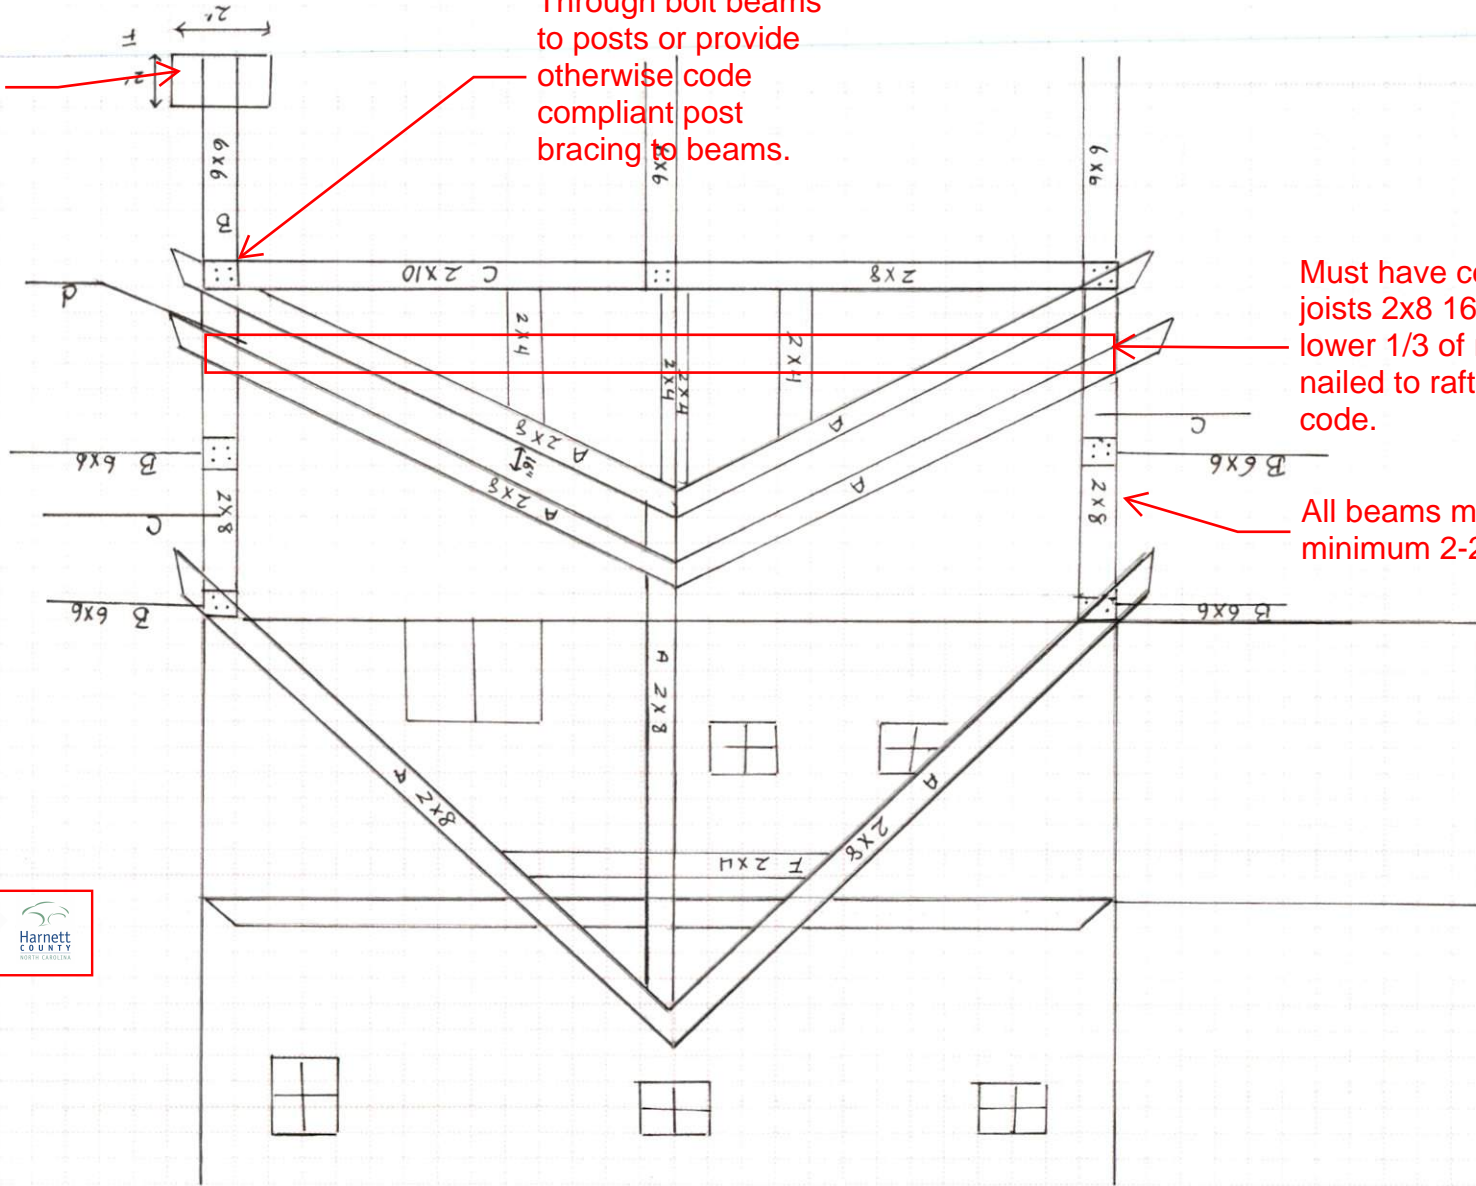

72
Saw

F Concrete
 E Gypsum
 D Joist H
 C End Ra
 B Posts
 A Rafter

Covered